

CASE_001

GT页码：2, 10, 12

编辑指令：在第10页的使用年限饼图中，将“少于三年”占比从17.06%提高至35.00%，并将“不清楚使用年限”占比从22.66%降至4.72%，使总和仍为100%；同步更新整份文稿中对这两组数据的文字讨论，不得修改无关结论。



Abstract

The type of septic tank material used can vary but must be impermeable to water. Septic tanks made of cast concrete but at the bottom are not cast and deliberately made seepage should not be used because they pollute from its seepage. The use of this particular material also directly impacts the service life and affects the performance of the septic tank even though there is no standard regarding its usage time limit. This research aims to identify the use of material and life service of the septic tank in Kelurahan Pademangan Barat, which is the area with the highest biological pollution of groundwater in the study conducted by BPLHD in 2015. The results of this research identified more than half of the respondents, as many as 65.99%, used septic tanks with partially cast concrete, 33.31% usefully cast material, and the rest from other types of materials. The highest yield was 29.60% had septic tanks that were more than ten years old. The rest is as much 22.66% not knowing the service life, 19.16% with service life 5 - 10 years of use, 11.53% with 3 - 5 years of use, and 17.06%, which are less than three years old.




Abstract

The type of septic tank material used can vary but must be impermeable to water. Septic tanks made of cast concrete but at the bottom are not cast and deliberately made seepage should not be used because they pollute from its seepage. The use of this particular material also directly impacts the service life and affects the performance of the septic tank even though there is no standard regarding its usage time limit. This research aims to identify the use of material and life service of the septic tank in Kelurahan Pademangan Barat, which is the area with the highest biological pollution of groundwater in the study conducted by BPLHD in 2015. The results of this research identified more than half of the respondents, as many as 65.99%, used septic tanks with partially cast concrete, 33.31% usefully cast material, and the rest from other types of materials. The highest yield was 29.60% had septic tanks that were more than ten years old. The rest is as much 4.72% not knowing the service life, 19.16% with service life 5 - 10 years of use, 11.53% with 3 - 5 years of use, and 35.00%, which are less than three years old.



Abstract

The type of septic tank material used can vary but must be impermeable to water. Septic tanks made of cast concrete but at the bottom are not cast and deliberately made seepage should not be used because they pollute from its seepage. The use of this particular material also directly impacts the service life and affects the performance of the septic tank even though there is no standard regarding its usage time limit. This research aims to identify the use of material and life service of the septic tank in Kelurahan Pademangan Barat, which is the area with the highest biological pollution of groundwater in the study conducted by BPLHD in 2015. The results of this research identified more than half of the respondents, as many as 65.99%, used septic tanks with partially cast concrete, 33.31% usefully cast material, and the rest from other types of materials. The largest group, 35.00%, had septic tanks less than three years old. The other groups were 29.60% more than ten years old, 4.72% not knowing the service life, 19.16% with service life 5 - 10 years of use, and 11.53% with 3 - 5 years of use.



Relation Between Type and Service Life

- Most of the houses or buildings of residents in Kelurahan Pademangan Barat have septic tanks that are more than ten years old, as much as 29.60%;
- 22.66% not knowing the service life of their septic tank, 19.16% mentioned that their septic tank has a service life of 5 - 10 years, the rest, i.e., 11.53% with 3 - 5 years of use and 17.06% which are less than three years old;
- The type of material used in the design of a septic tank affects the septic tank's life and its resistance to collecting wastewater (Adegoke & Stenstrom, 2019);
- The type of material for using the septic tank can vary, but it must be ensured that they are waterproof.


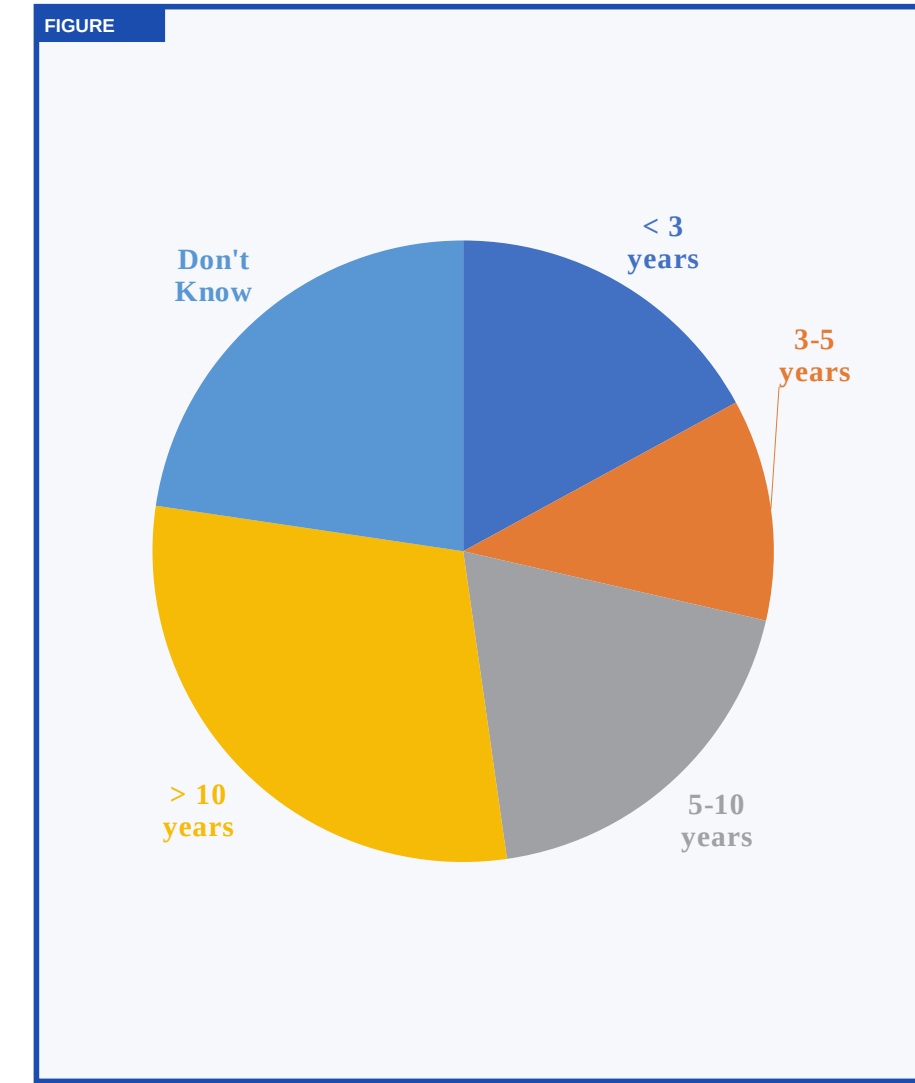


Figure 5. Service Life of Septic Tank at Kelurahan Pademangan Barat



Relation Between Type and Service Life

- Most of the houses or buildings of residents in Kelurahan Pademangan Barat have septic tanks that are more than ten years old, as much as 29.60%;
- 4.72% not knowing the service life of their septic tank, 19.16% mentioned that their septic tank has a service life of 5 - 10 years, the rest, i.e., 11.53% with 3 - 5 years of use and 35.00% which are less than three years old;
- The type of material used in the design of a septic tank affects the septic tank's life and its resistance to collecting wastewater (Adegoke & Stenstrom, 2019);
- The type of material for using the septic tank can vary, but it must be ensured that they are waterproof.


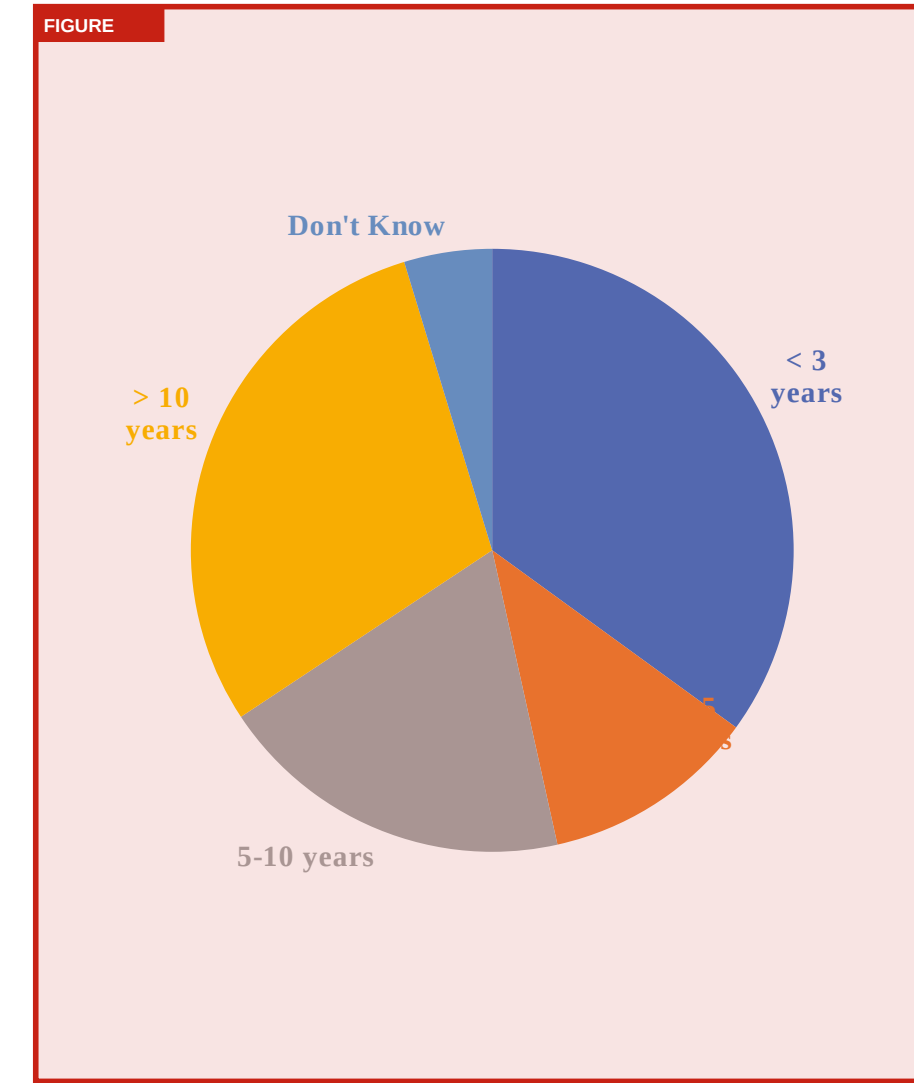


Figure 5. Service Life of Septic Tank at Kelurahan Pademangan Barat



Relation Between Type and Service Life

- The largest group of houses or buildings in Kelurahan Pademangan Barat have septic tanks less than three years old, at 35.00%;
- 4.72% not knowing the service life of their septic tank, 19.16% mentioned that their septic tank has a service life of 5 - 10 years, the rest, i.e., 11.53% with 3 - 5 years of use and 29.60% which are more than ten years old;
- The type of material used in the design of a septic tank affects the septic tank's life and its resistance to collecting wastewater (Adegoke & Stenstrom, 2019);
- The type of material for using the septic tank can vary, but it must be ensured that they are waterproof.


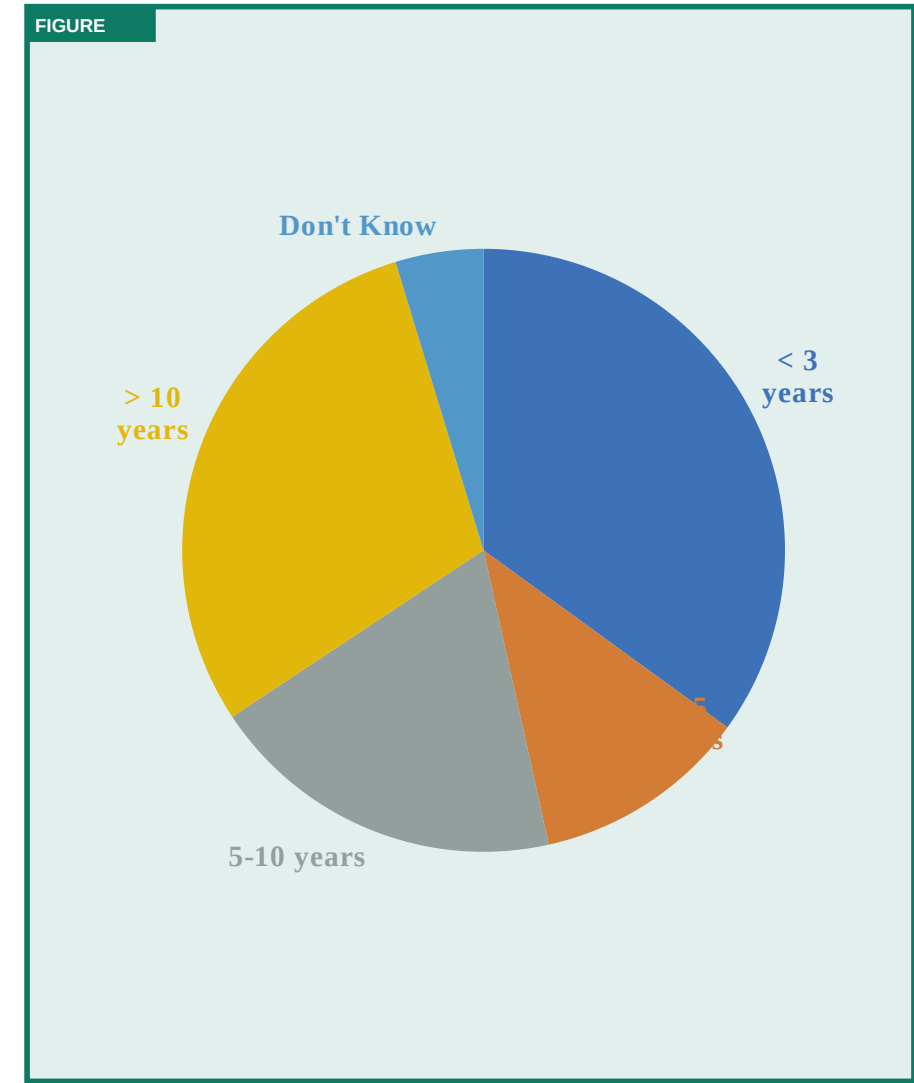



Figure 5. Service Life of Septic Tank at Kelurahan Pademangan Barat



Conclusion

From a survey of 1,273 respondents regarding the design and service life of their septic tank at the study area;

- 65.99 % of respondents using a septic tank made from partially cast concrete, 33.31% of respondents using fully cast material and the rest uses others.
- 94.94% of respondents use groundwater as their daily clean water; only 5% use services from local government-owned drinking water companies.
- For the life of the septic tank, as much as 29,60 % have septic tanks that are more than ten years old, 22.66% not knowing the service life of their septic tank, 19.16% have a septic tank that is 5 - 10 years old, 11.53% with 3 - 5 years of use and 17.06% which are less than three years old.



Conclusion

From a survey of 1,273 respondents regarding the design and service life of their septic tank at the study area;

- 65.99 % of respondents using a septic tank made from partially cast concrete, 33.31% of respondents using fully cast material and the rest uses others.
- 94.94% of respondents use groundwater as their daily clean water; only 5% use services from local government-owned drinking water companies.
- For the life of the septic tank, as much as 29,60 % have septic tanks that are more than ten years old, 4.72% not knowing the service life of their septic tank, 19.16% have a septic tank that is 5 - 10 years old, 11.53% with 3 - 5 years of use and 35.00% which are less than three years old.



Conclusion

From a survey of 1,273 respondents regarding the design and service life of their septic tank at the study area;

- 65.99 % of respondents using a septic tank made from partially cast concrete, 33.31% of respondents using fully cast material and the rest uses others.
- 94.94% of respondents use groundwater as their daily clean water; only 5% use services from local government-owned drinking water companies.
- For the life of the septic tank, as much as 29,60 % have septic tanks that are more than ten years old, 4.72% not knowing the service life of their septic tank, 19.16% have a septic tank that is 5 - 10 years old, 11.53% with 3 - 5 years of use and 35.00% which are less than three years old.


CASE_002

GT页码：6, 7

编辑指令：在第7页左侧标题为“LNG price = USD 15.77/MMBtu”的敏感性图中，将“Base case 100%”的IRR从19.72%改为30.00%；同步更新文稿其他页面中对同一基准IRR的文字引用，右侧图表及其他情景数值保持不变。

Results

6

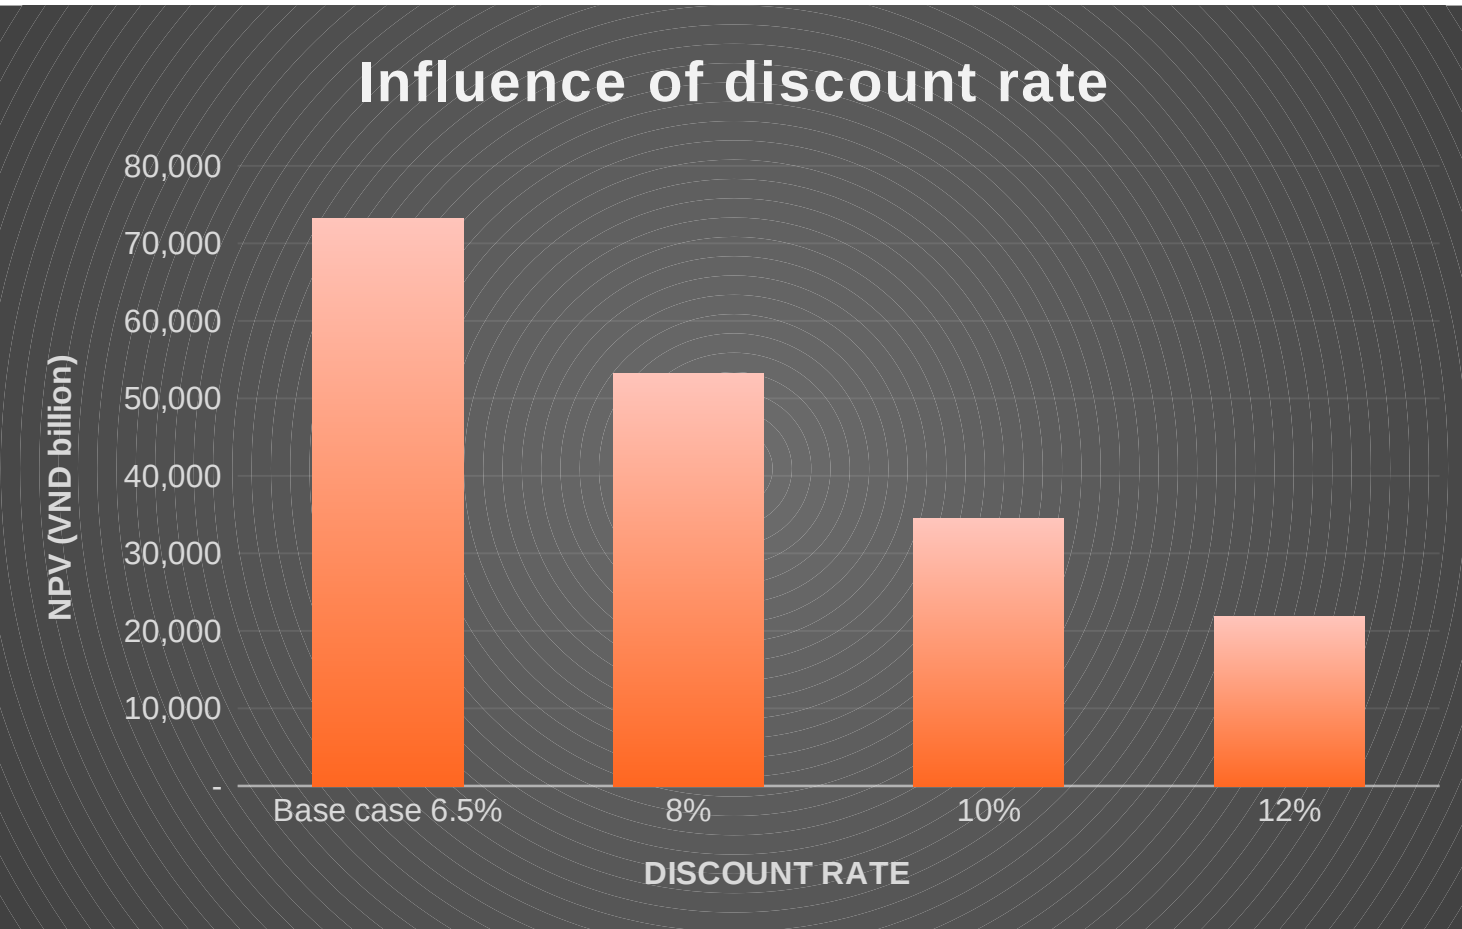


Basecase

- NPV: VND 73,155.35 billion
- IRR: 19.72%

☐ The project is financially viable

Results

6

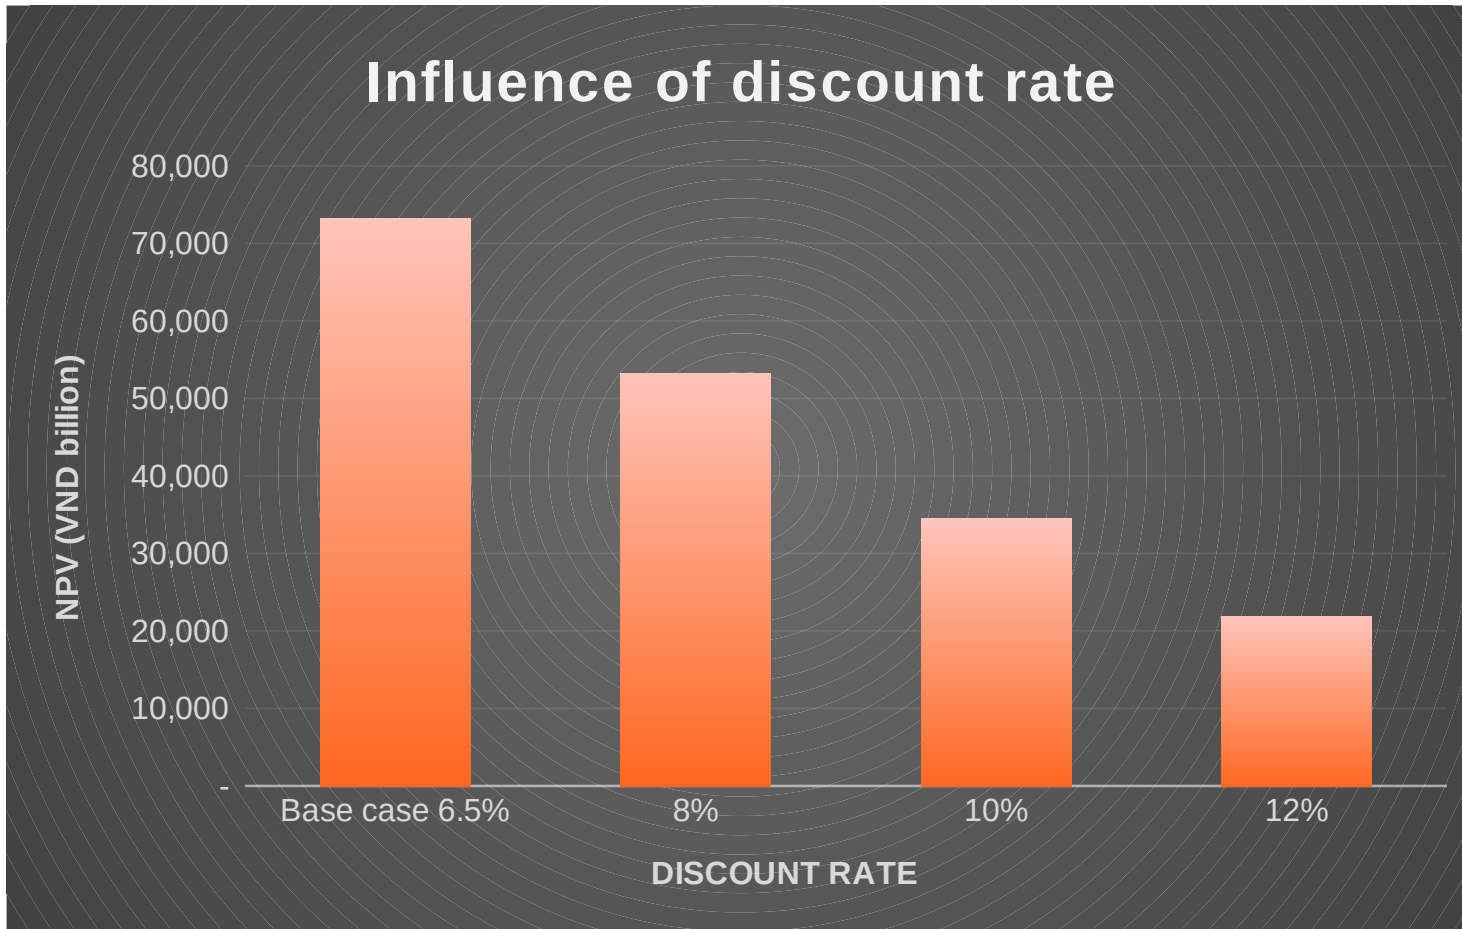


Basecase

- NPV: VND 73,155.35 billion
- IRR: 30.00%

☐ The project is financially viable

Results

6

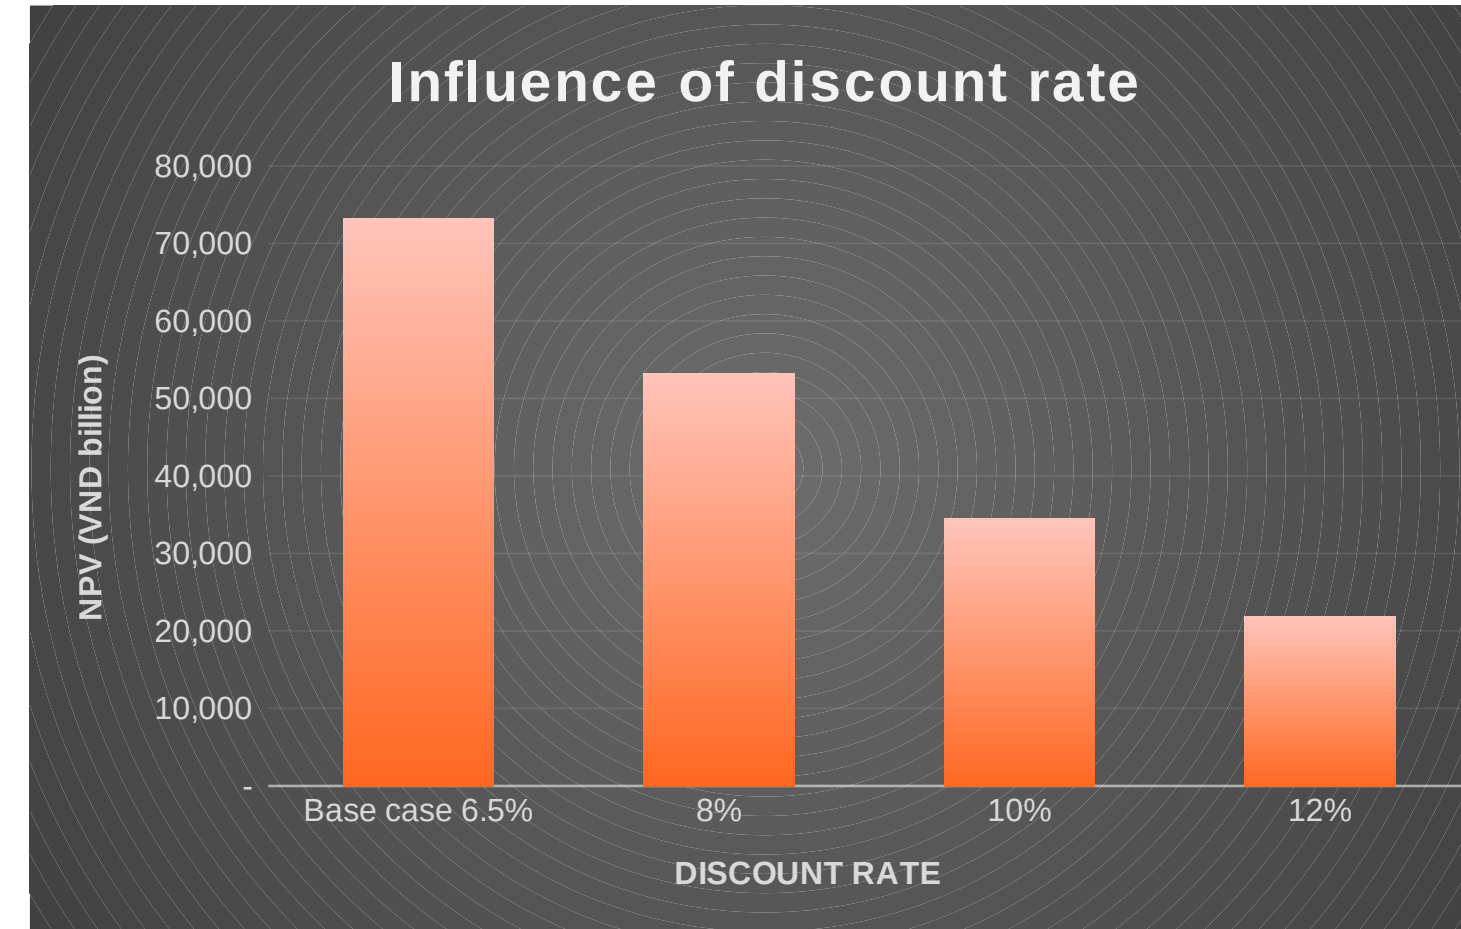


Basecase

- NPV: VND 73,155.35 billion
- IRR: 30.00%

☐ The project is financially viable


Influence of Power Purchase Ratio and LNG price

7

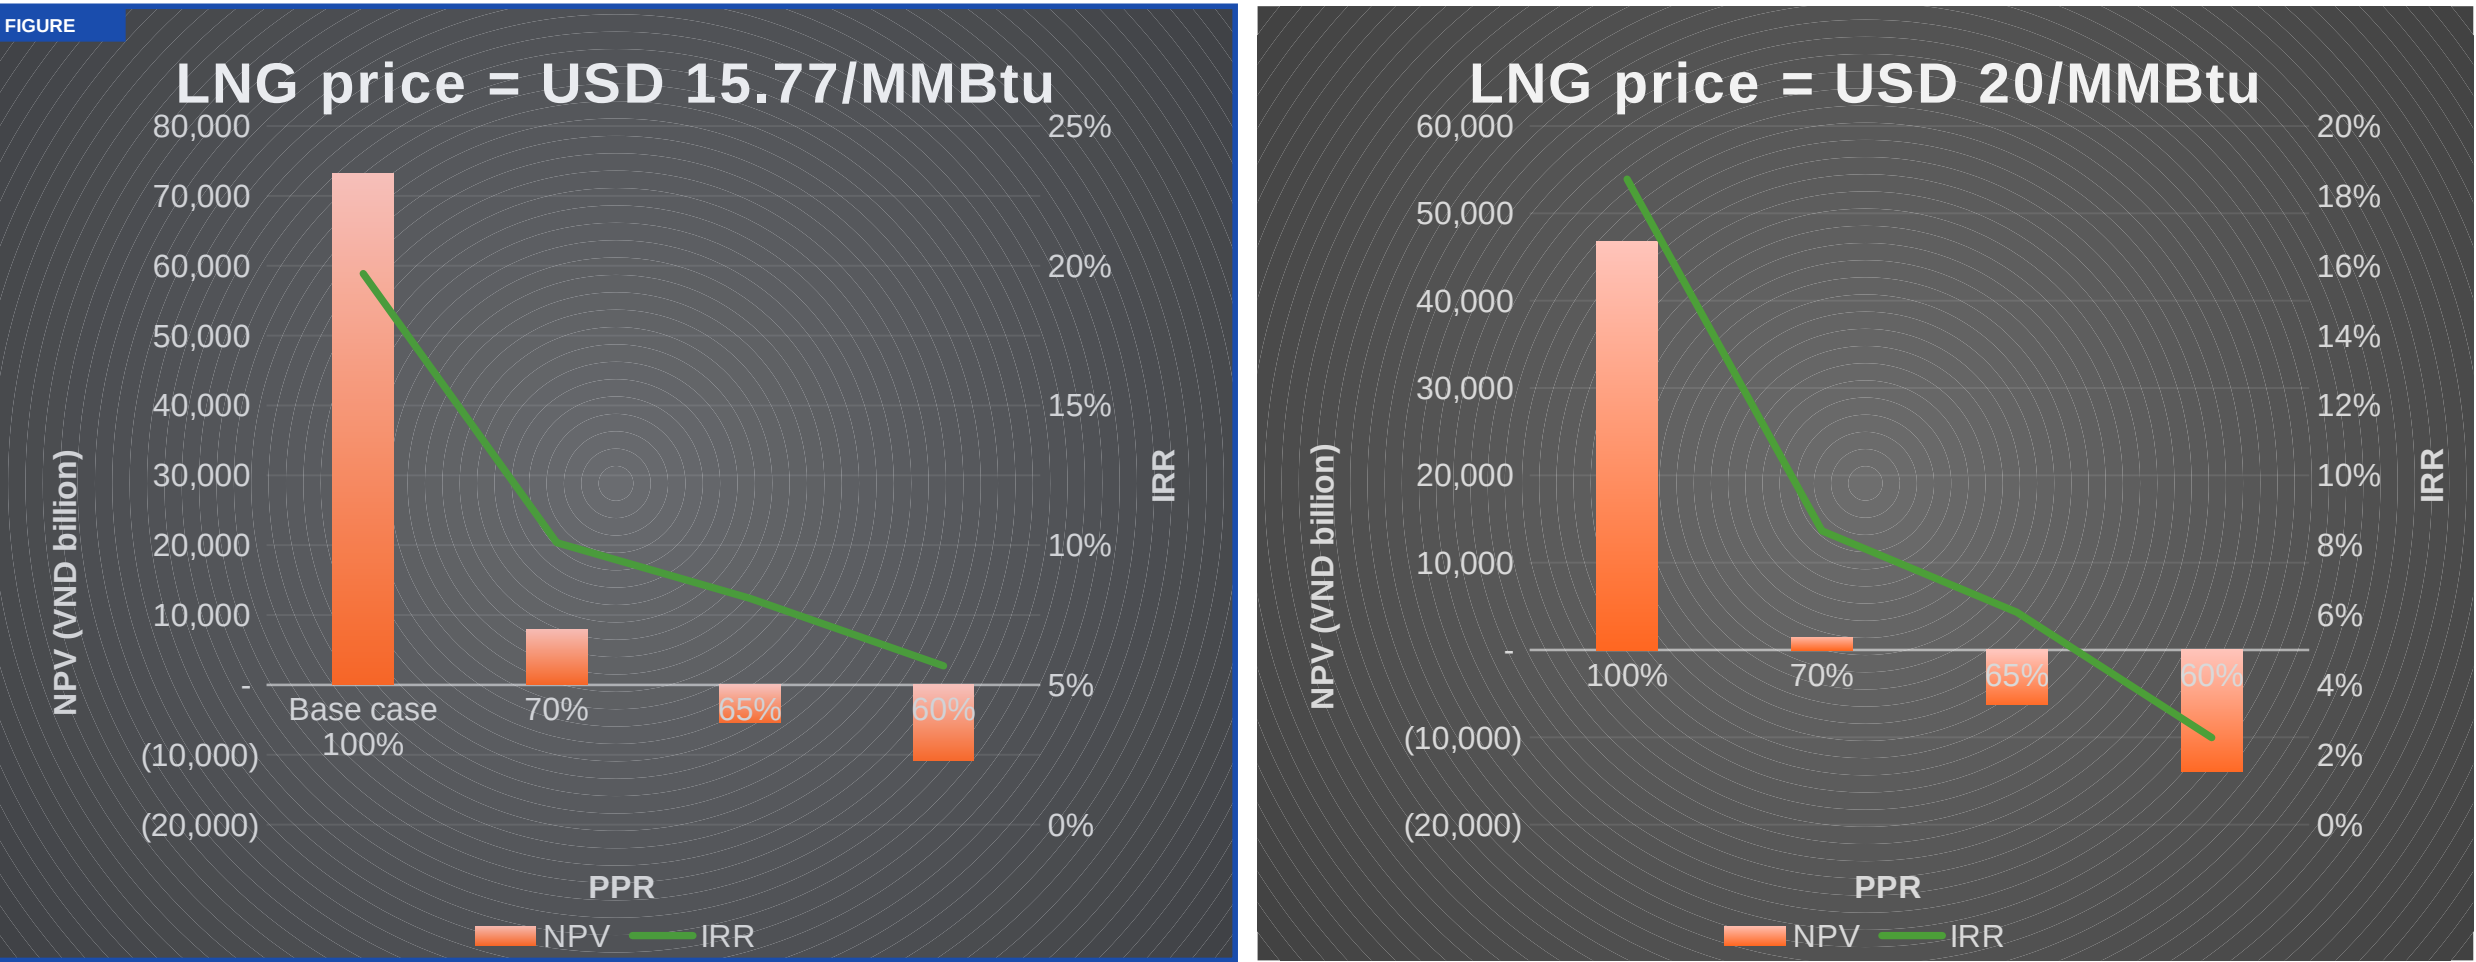


Influence of Power Purchase Ratio and LNG price

7

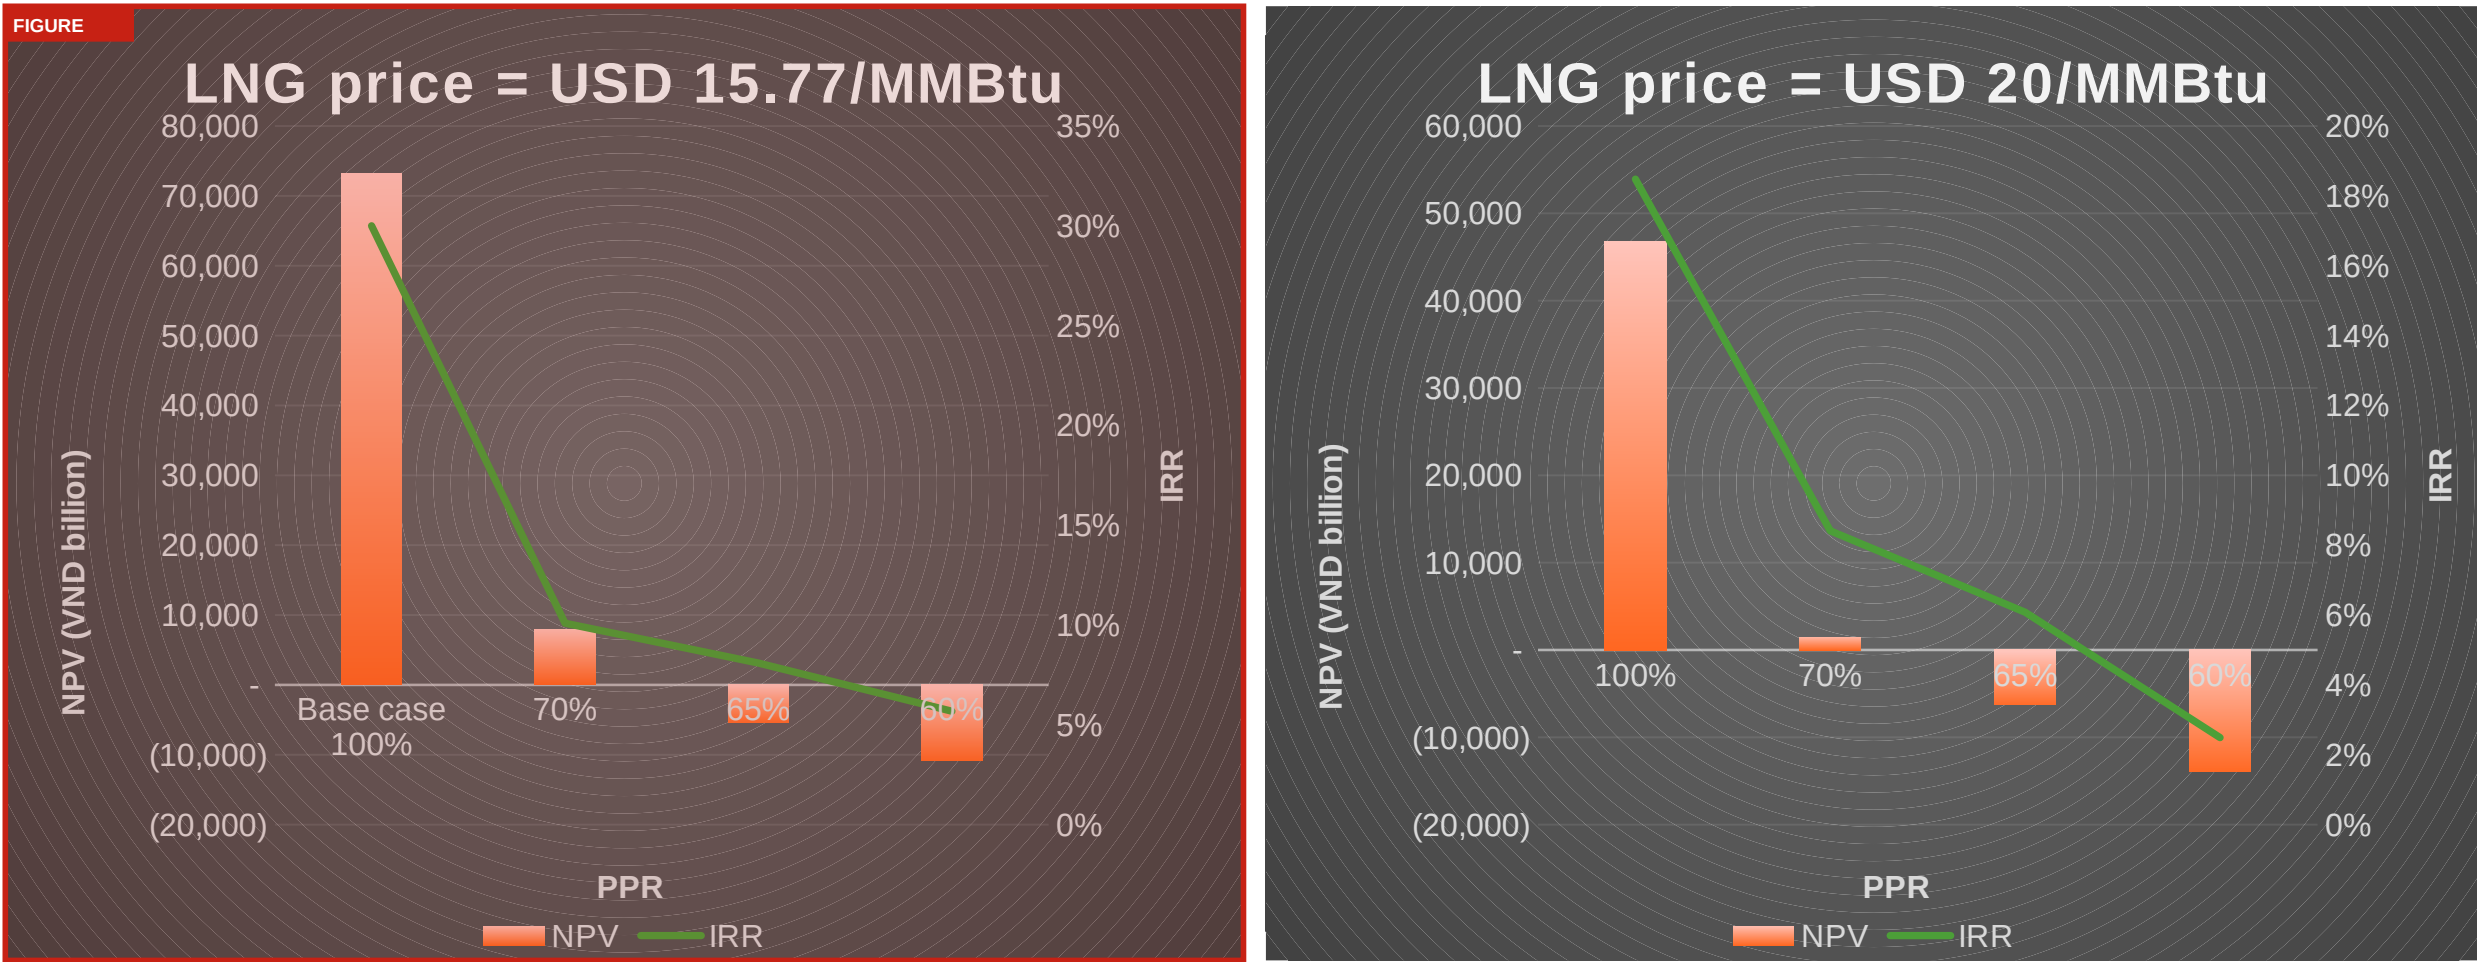

Influence of Power Purchase Ratio and LNG price

7

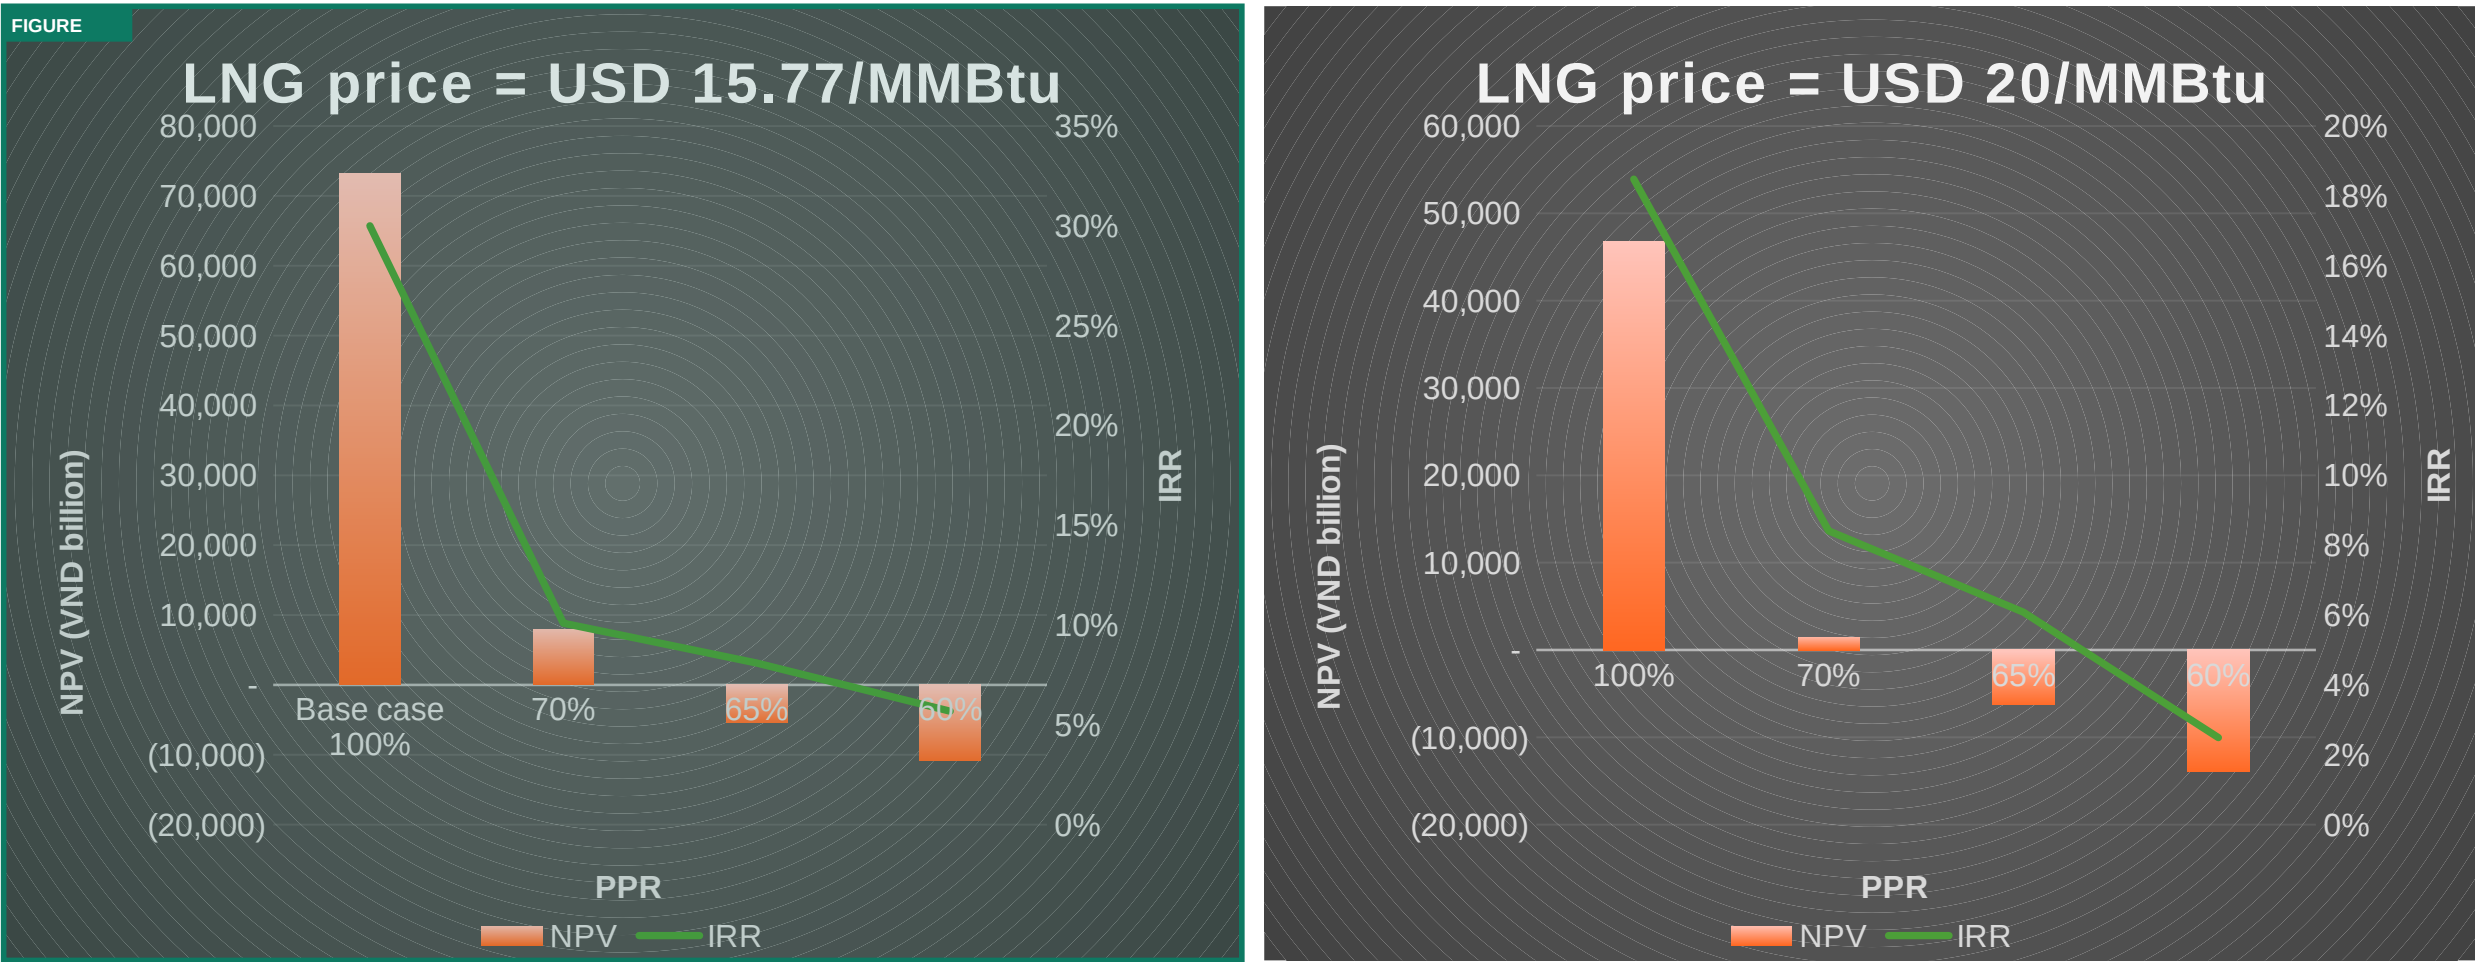


CASE_003


GT页码: 11, 12

编辑指令: 在第11页的问卷饼图中, 将 “good enough” 占比从12.50%提高至30.00%, 并将 “good” 占比从42.09%降至24.59%, 使分布总和仍为100%; 同步更新所有相关文字总结, 其他类别保持不变。


Easy Access To Schools

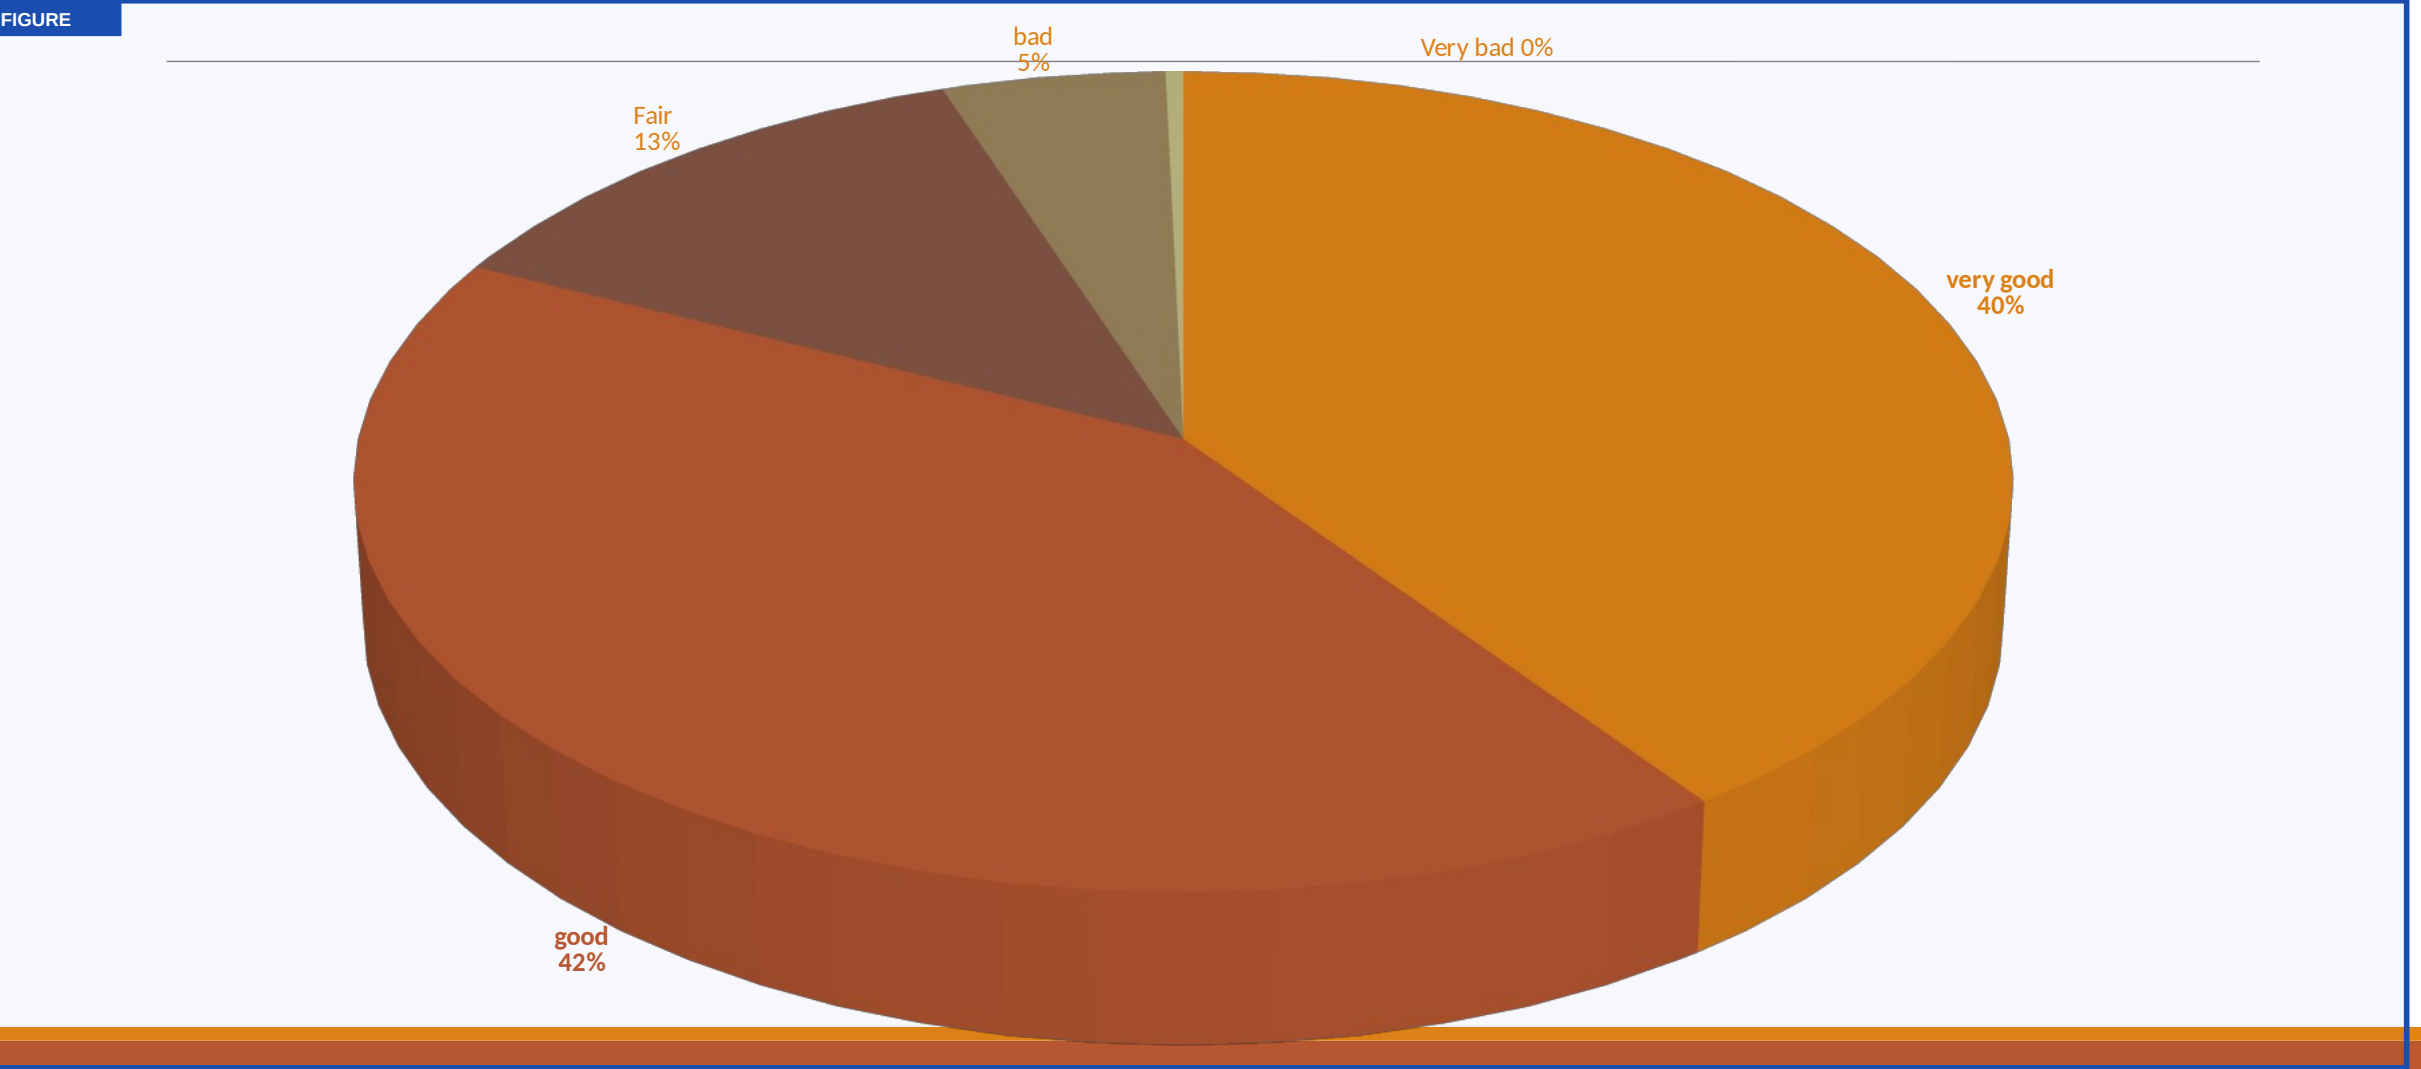

Easy Access To Schools

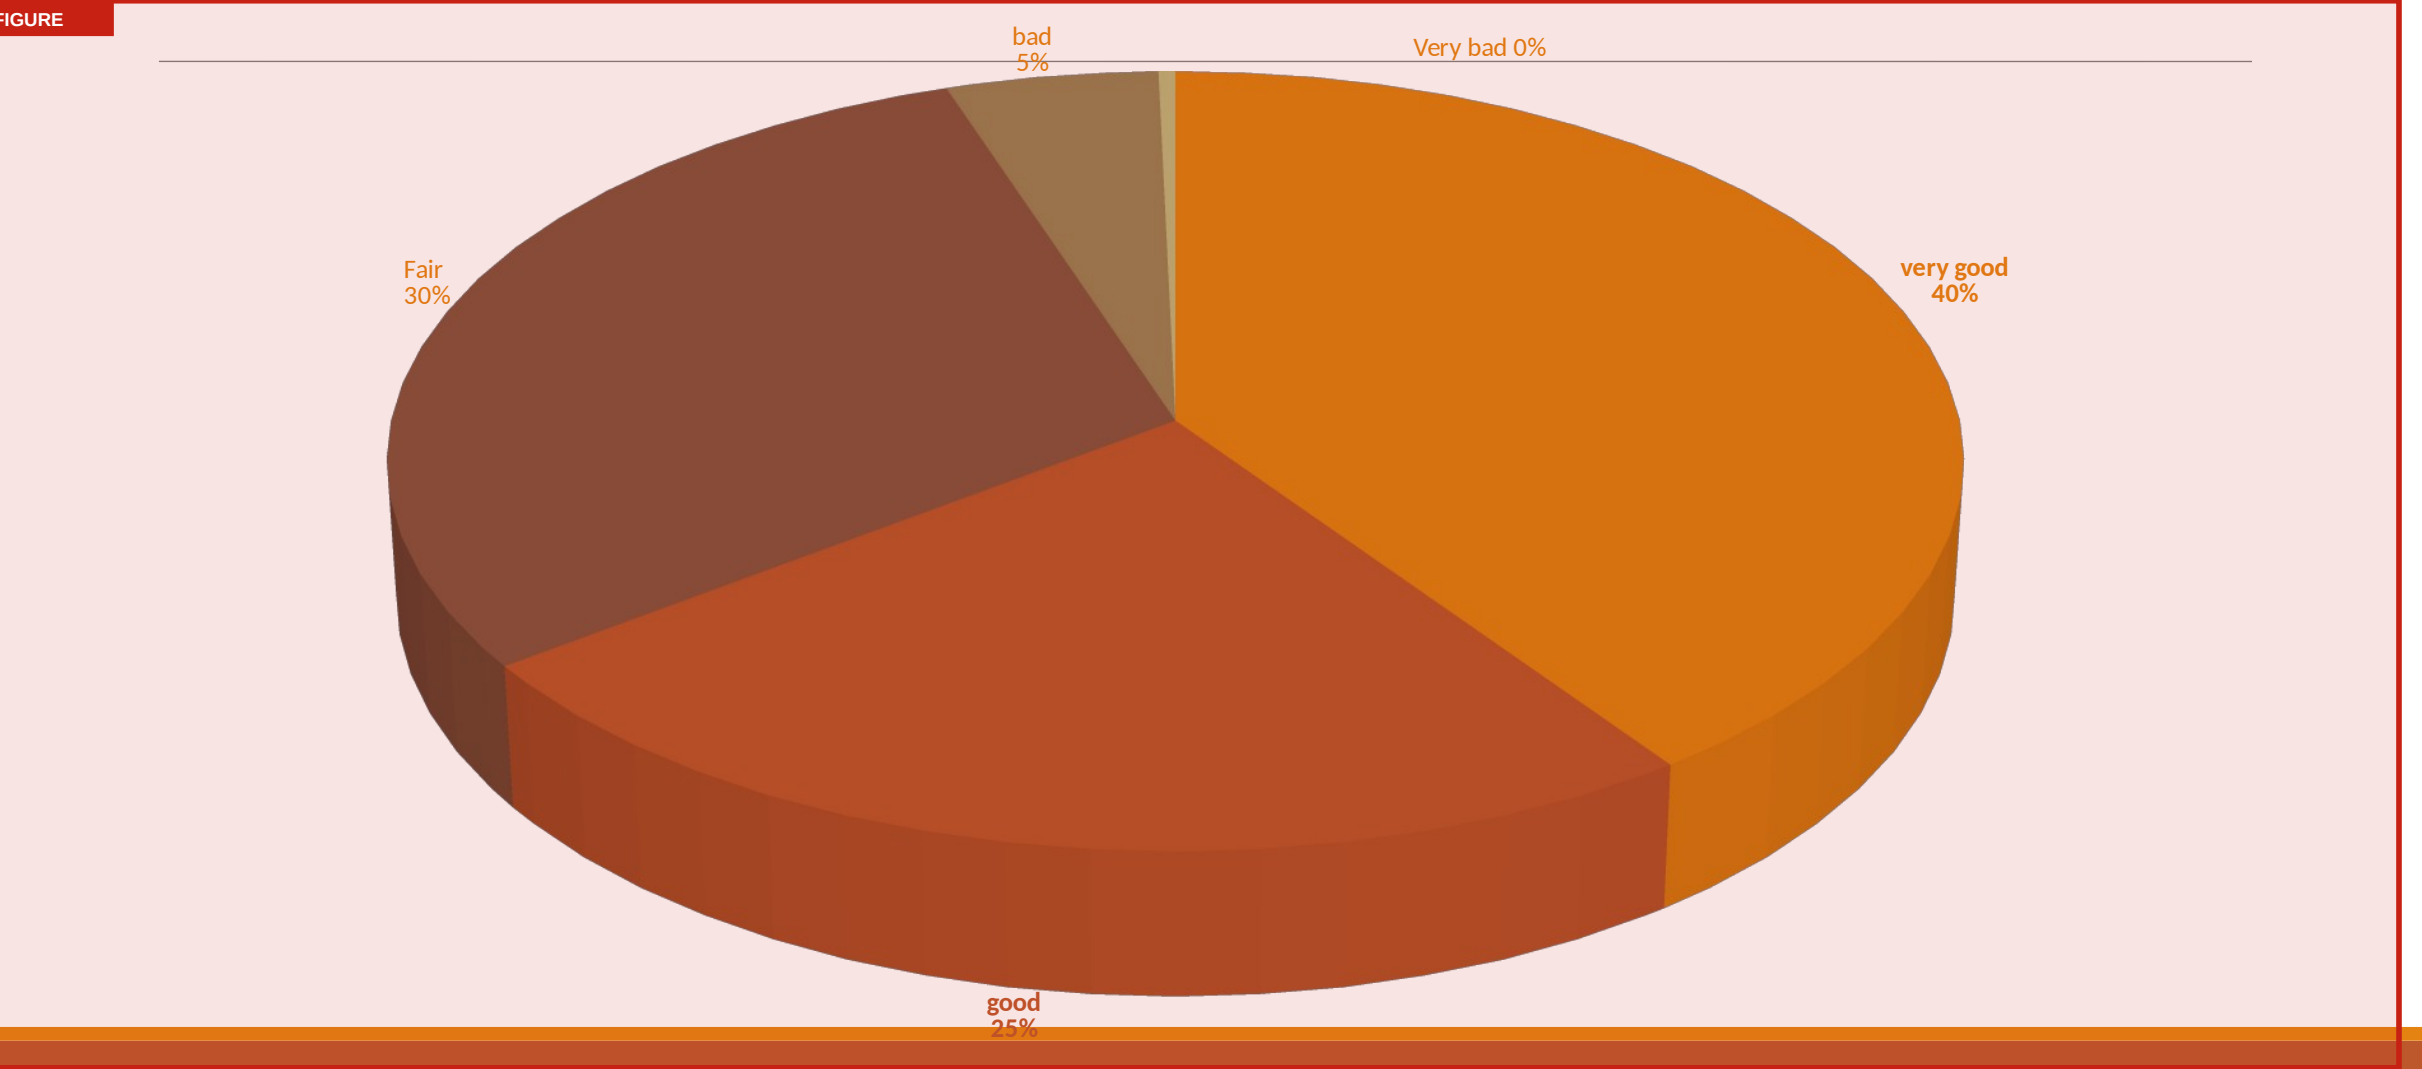

Easy Access To Schools

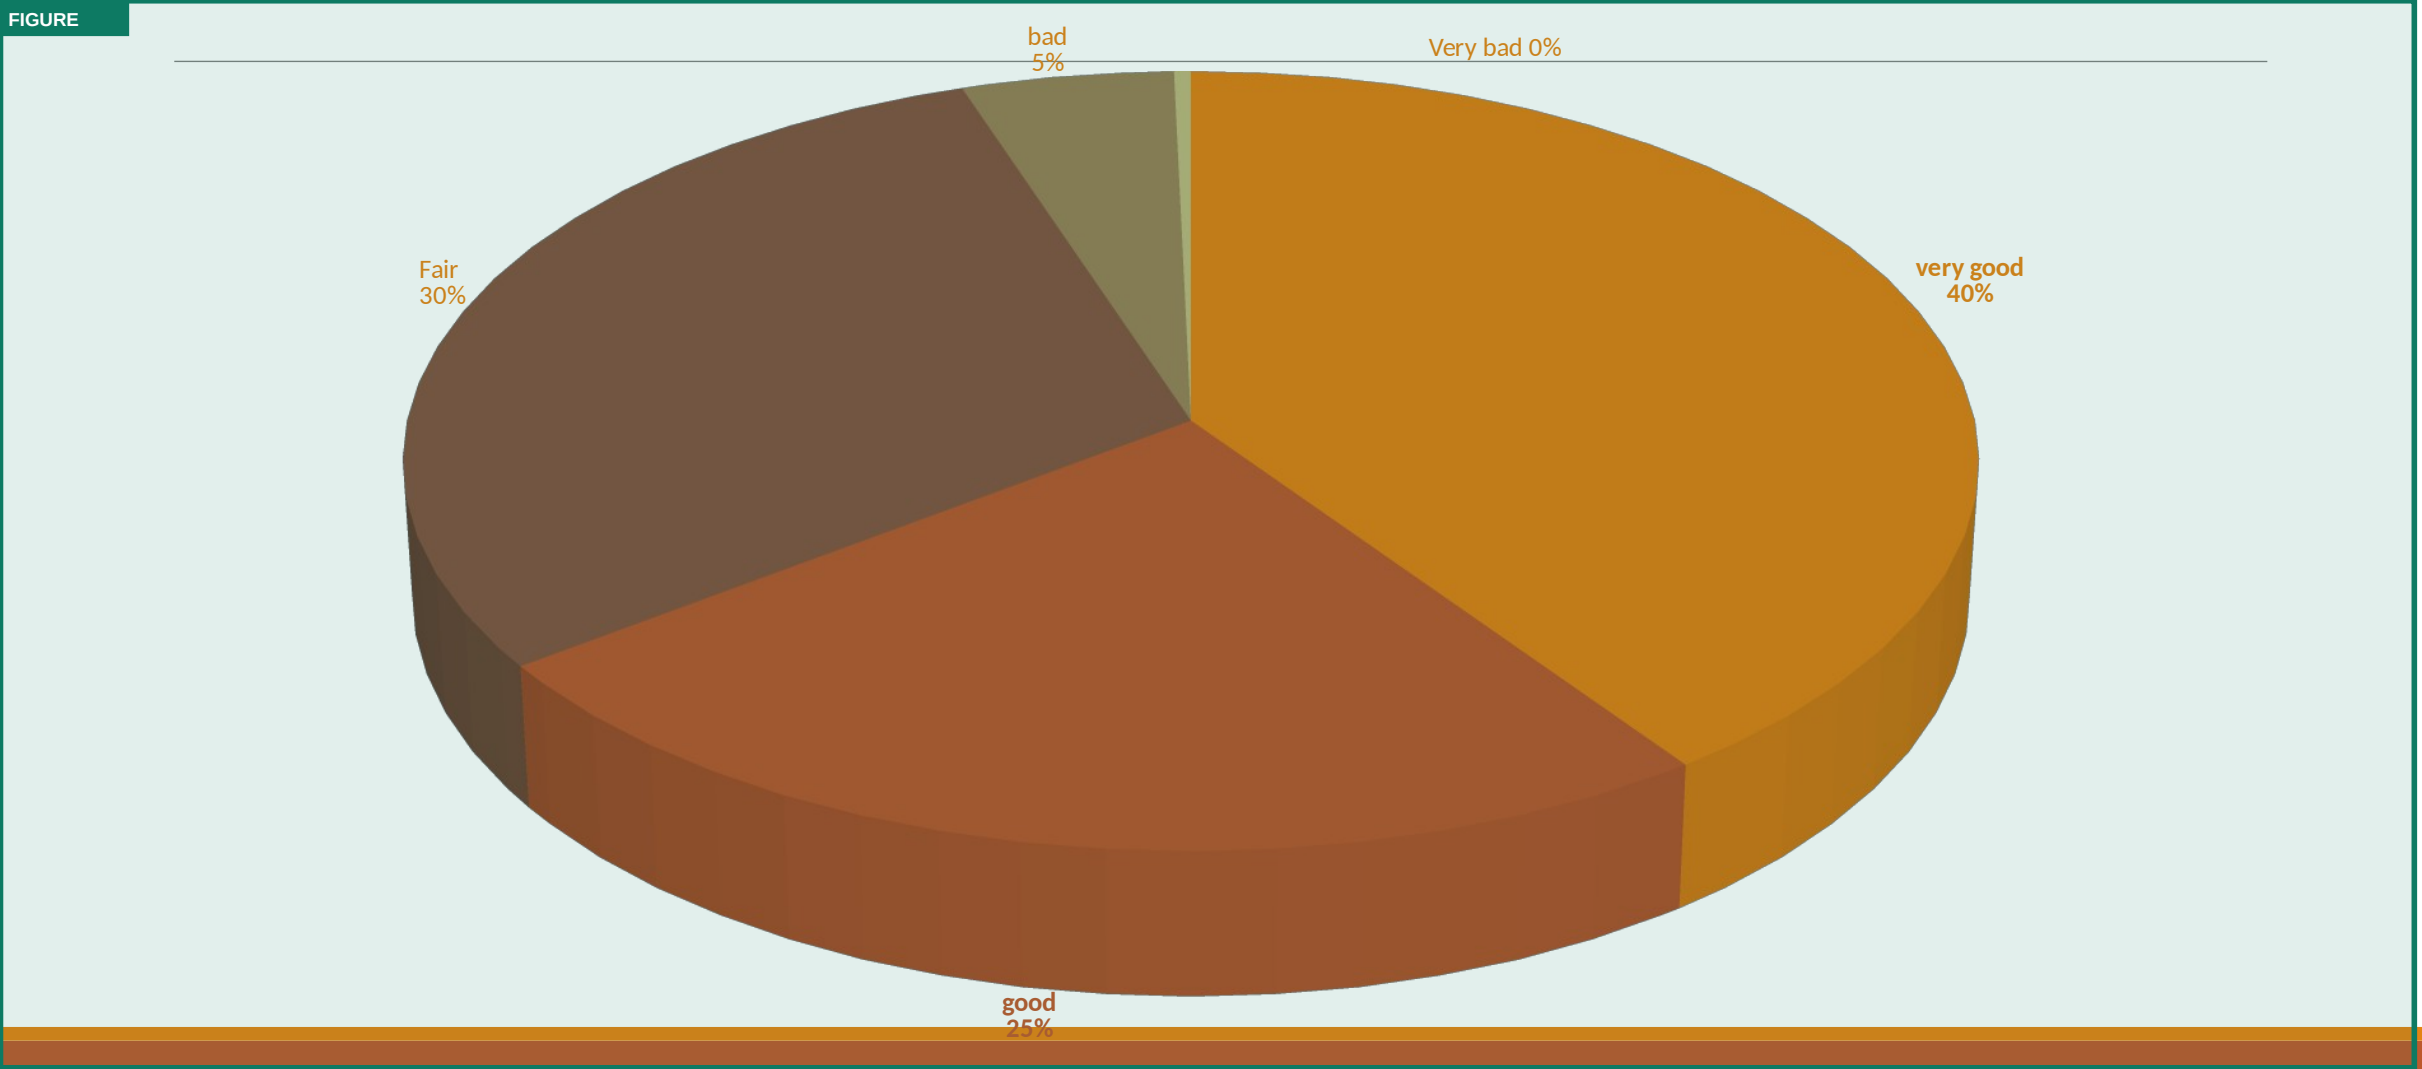

The research results from the questionnaire filled out by students stated that 40.21% of the access indicators were very good, 42.09% were good, 12.50% were good enough, 4.82% were not good, and 0.38 was very bad. This shows that in general the access indicators fall into the very good category with a percentage of 40.21% and 42.09%. This is also confirmed by the results of qualitative research that schools are affordable from home, and there are at least 2 schools in one village.

The research results from the questionnaire filled out by students stated that 40.21% of the access indicators were very good, 24.59% were good, 30.00% were good enough, 4.82% were not good, and 0.38 was very bad. This shows that in general the access indicators fall into the very good category with a percentage of 40.21% and 24.59%. This is also confirmed by the results of qualitative research that schools are affordable from home, and there are at least 2 schools in one village.

The research results from the questionnaire filled out by students stated that 40.21% of the access indicators were very good, 24.59% were good, 30.00% were good enough, 4.82% were not good, and 0.38 was very bad. This shows that very good was the most common rating at 40.21%, while 24.59% rated access as good. This is also confirmed by the results of qualitative research that schools are affordable from home, and there are at least 2 schools in one village.


CASE_004

GT页码：5, 6, 7

编辑指令：在第5页右侧NPV/IRR图中，将27.5 GW基准产量点的IRR从20.3%改为30.0%；在第6页右侧NPV/IRR图中，将USD 0.045/kWh基准售价点作相同修改；同步更新引用该基准IRR的结论，19%的减产情景IRR及其他数值保持不变。


Results

5

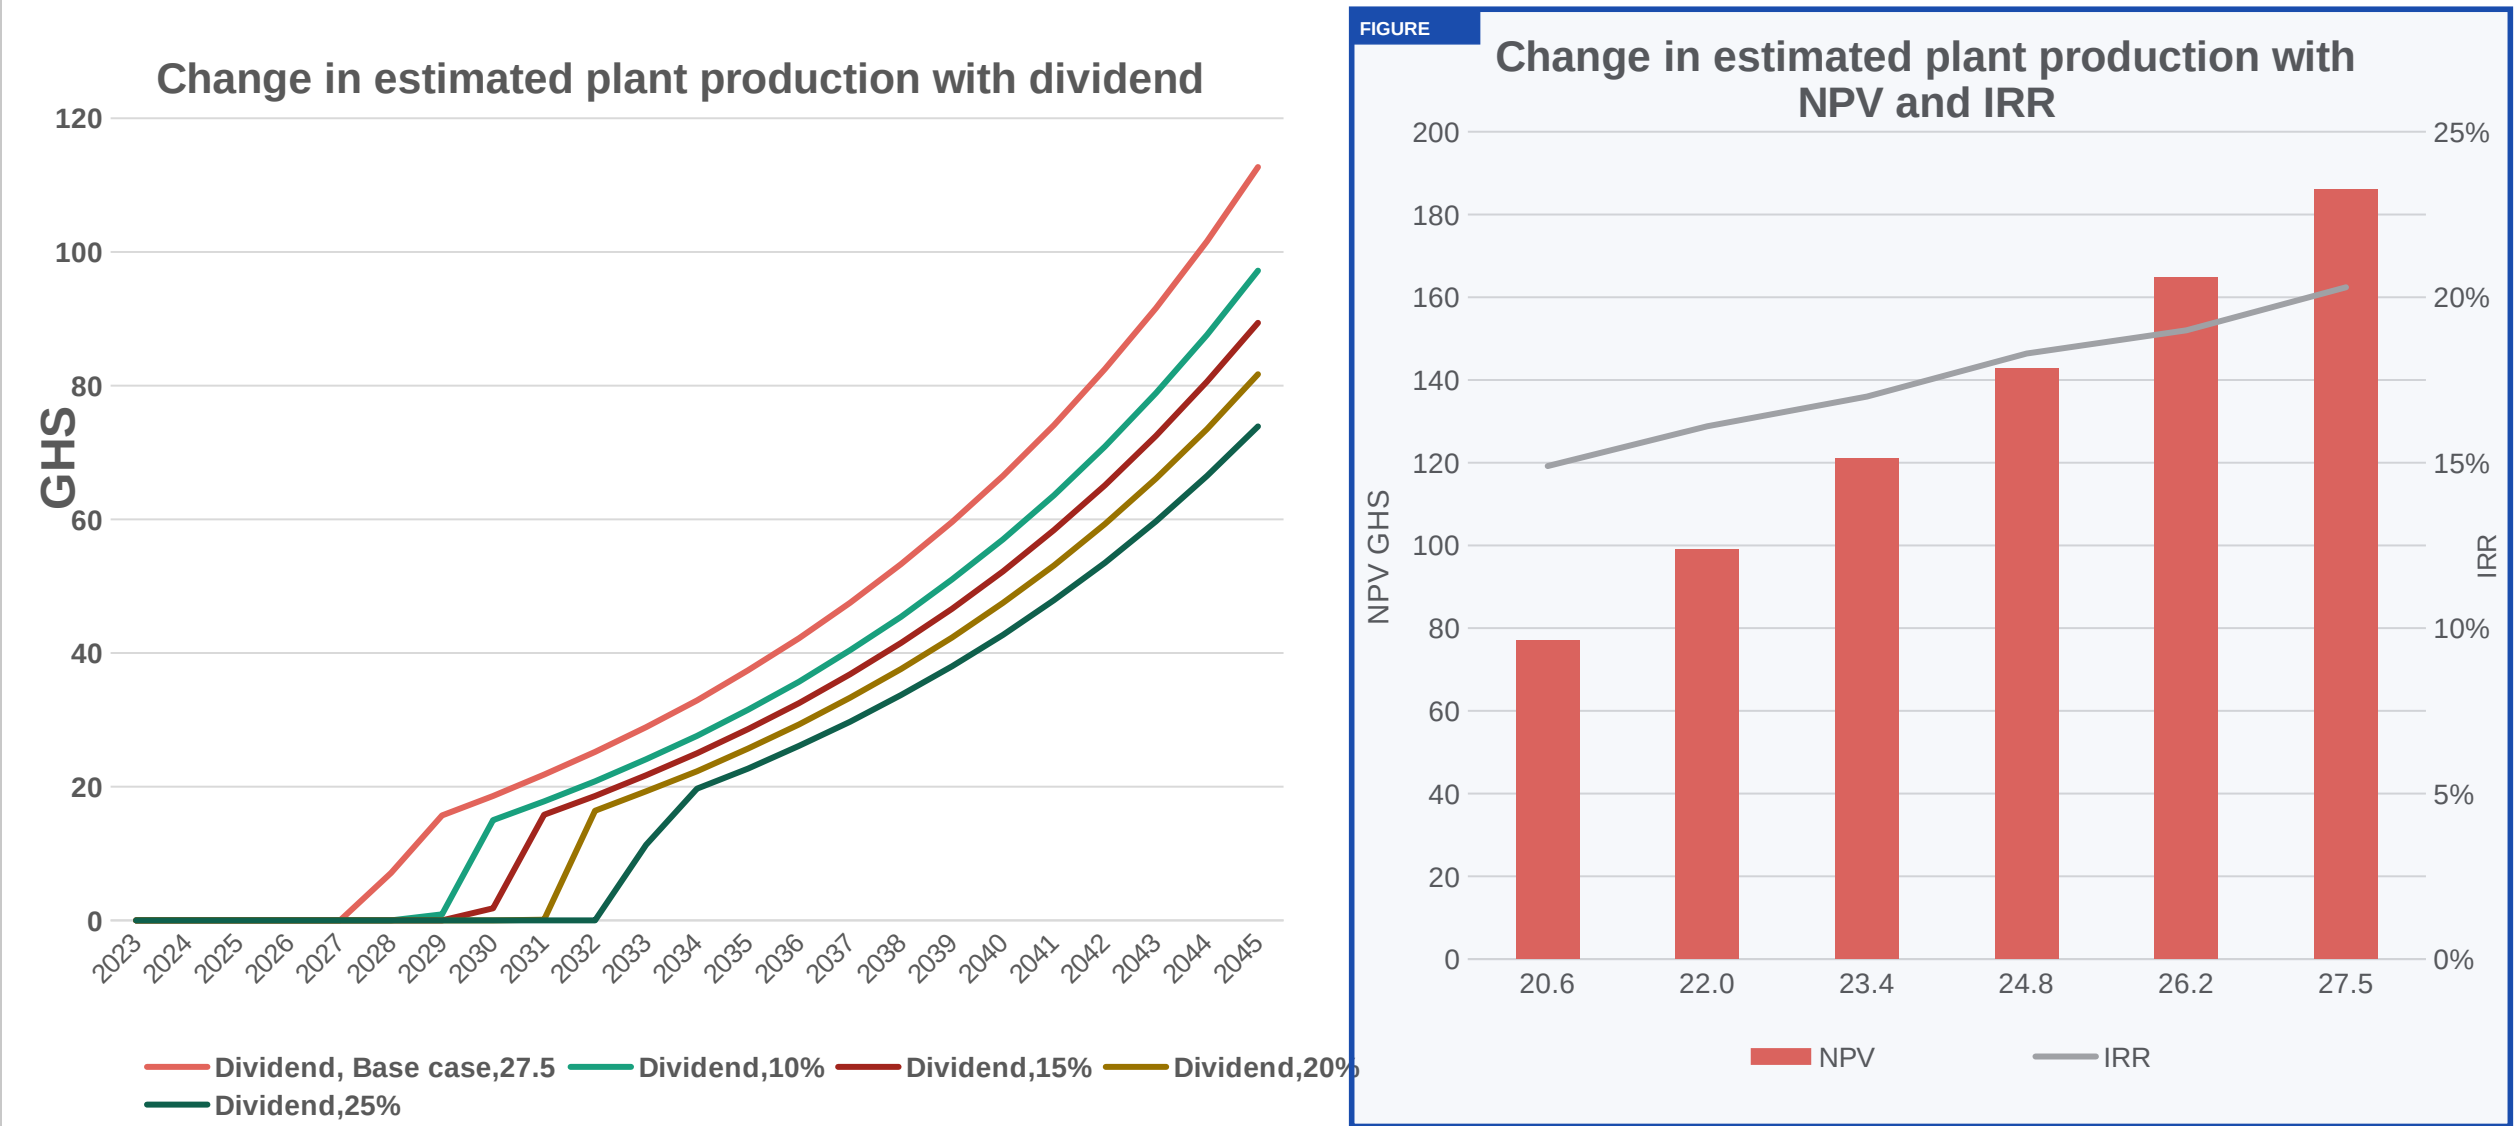


Results

5

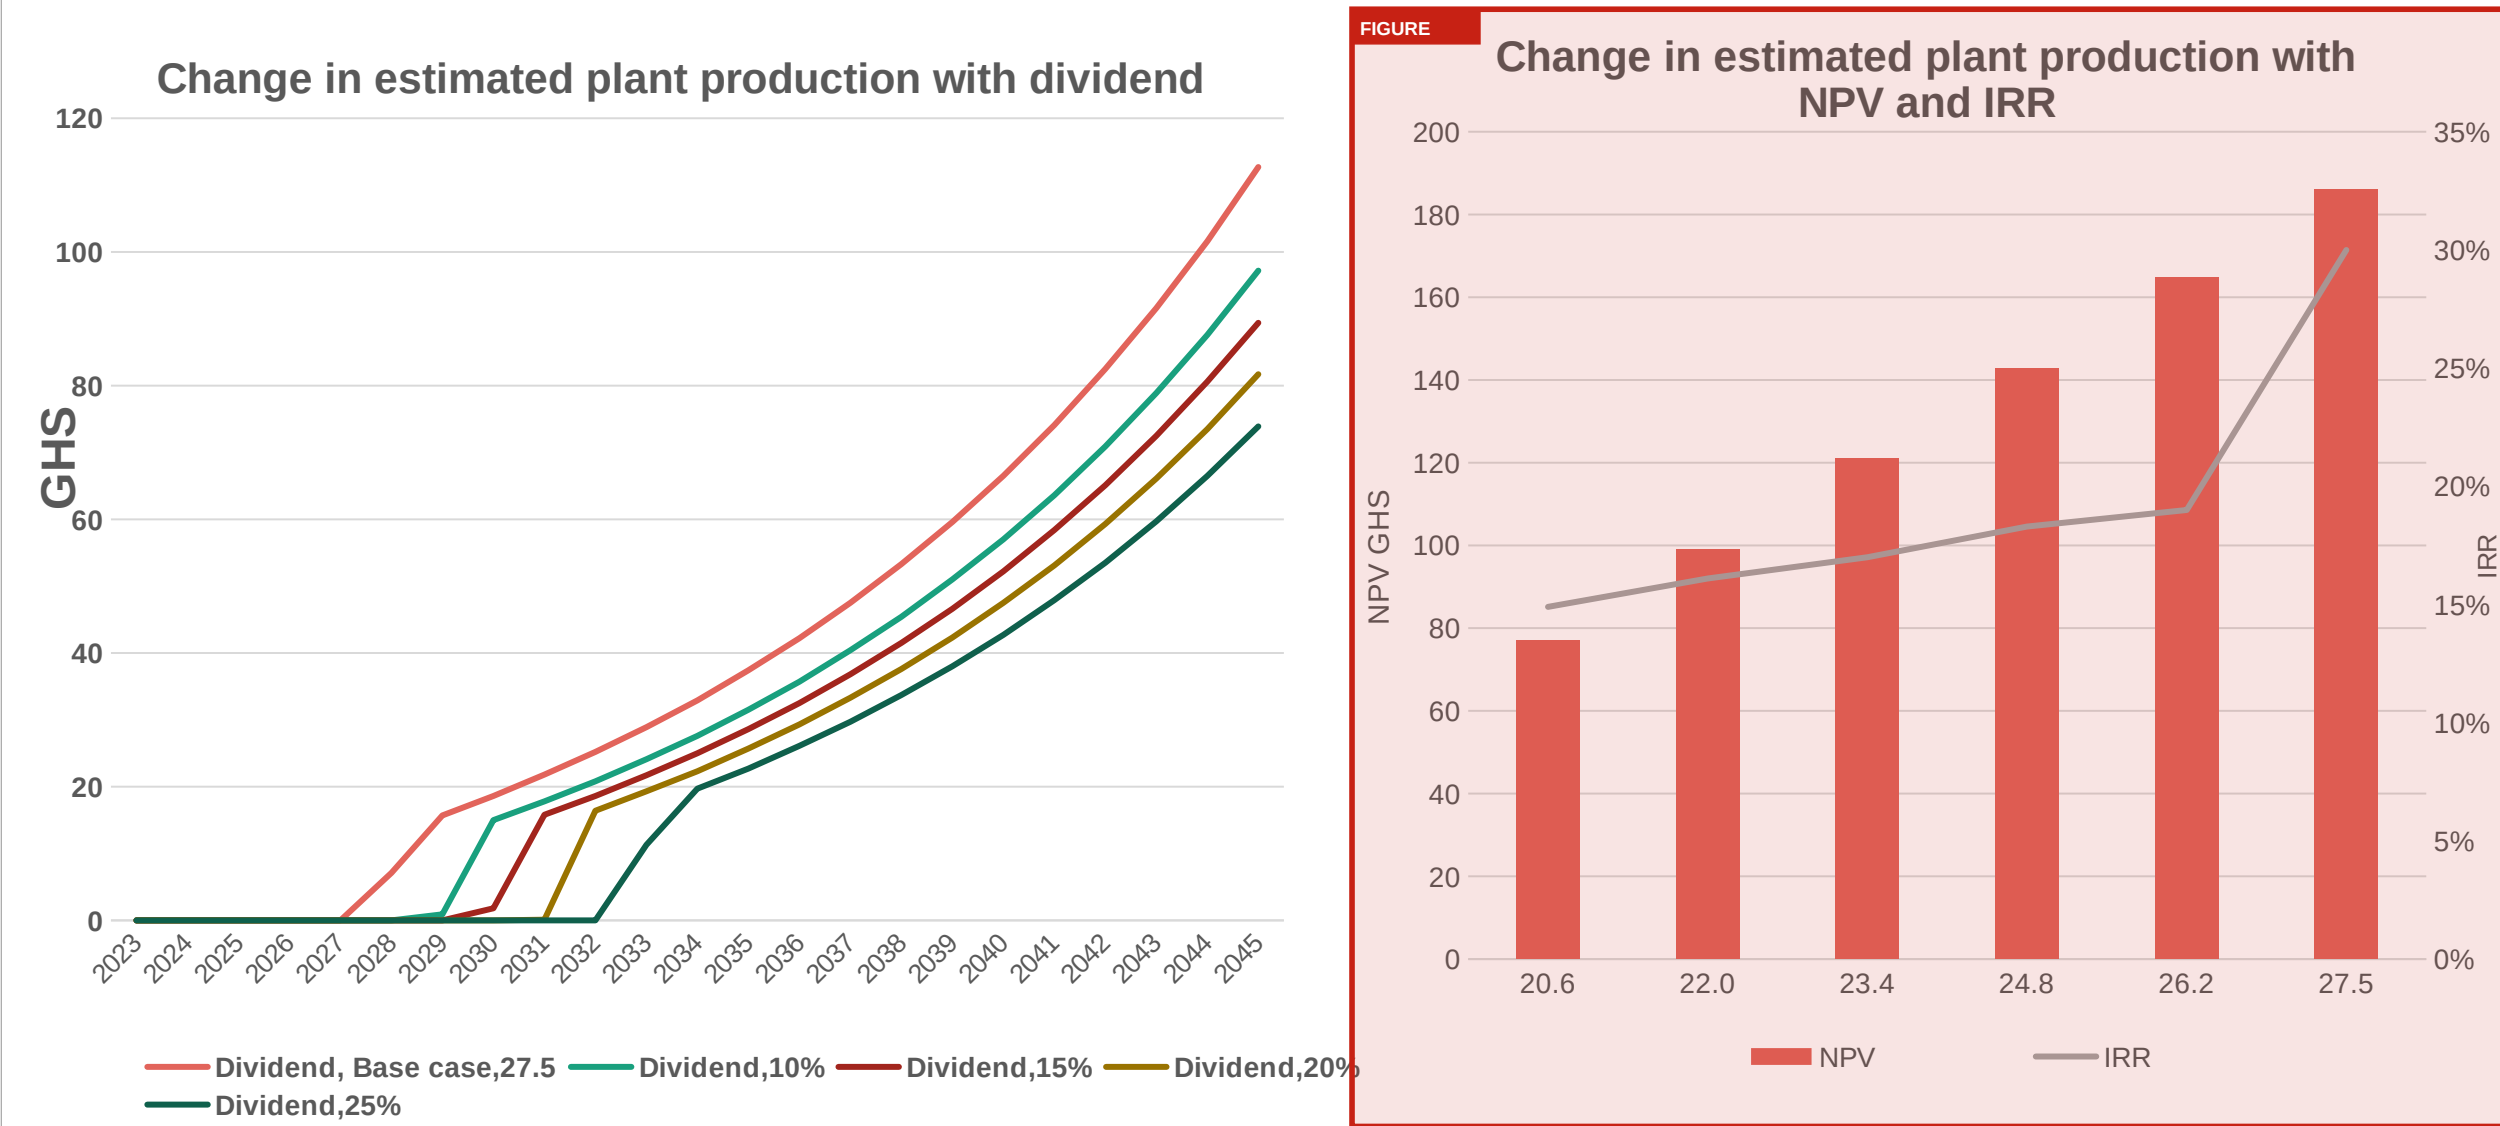


Results

5

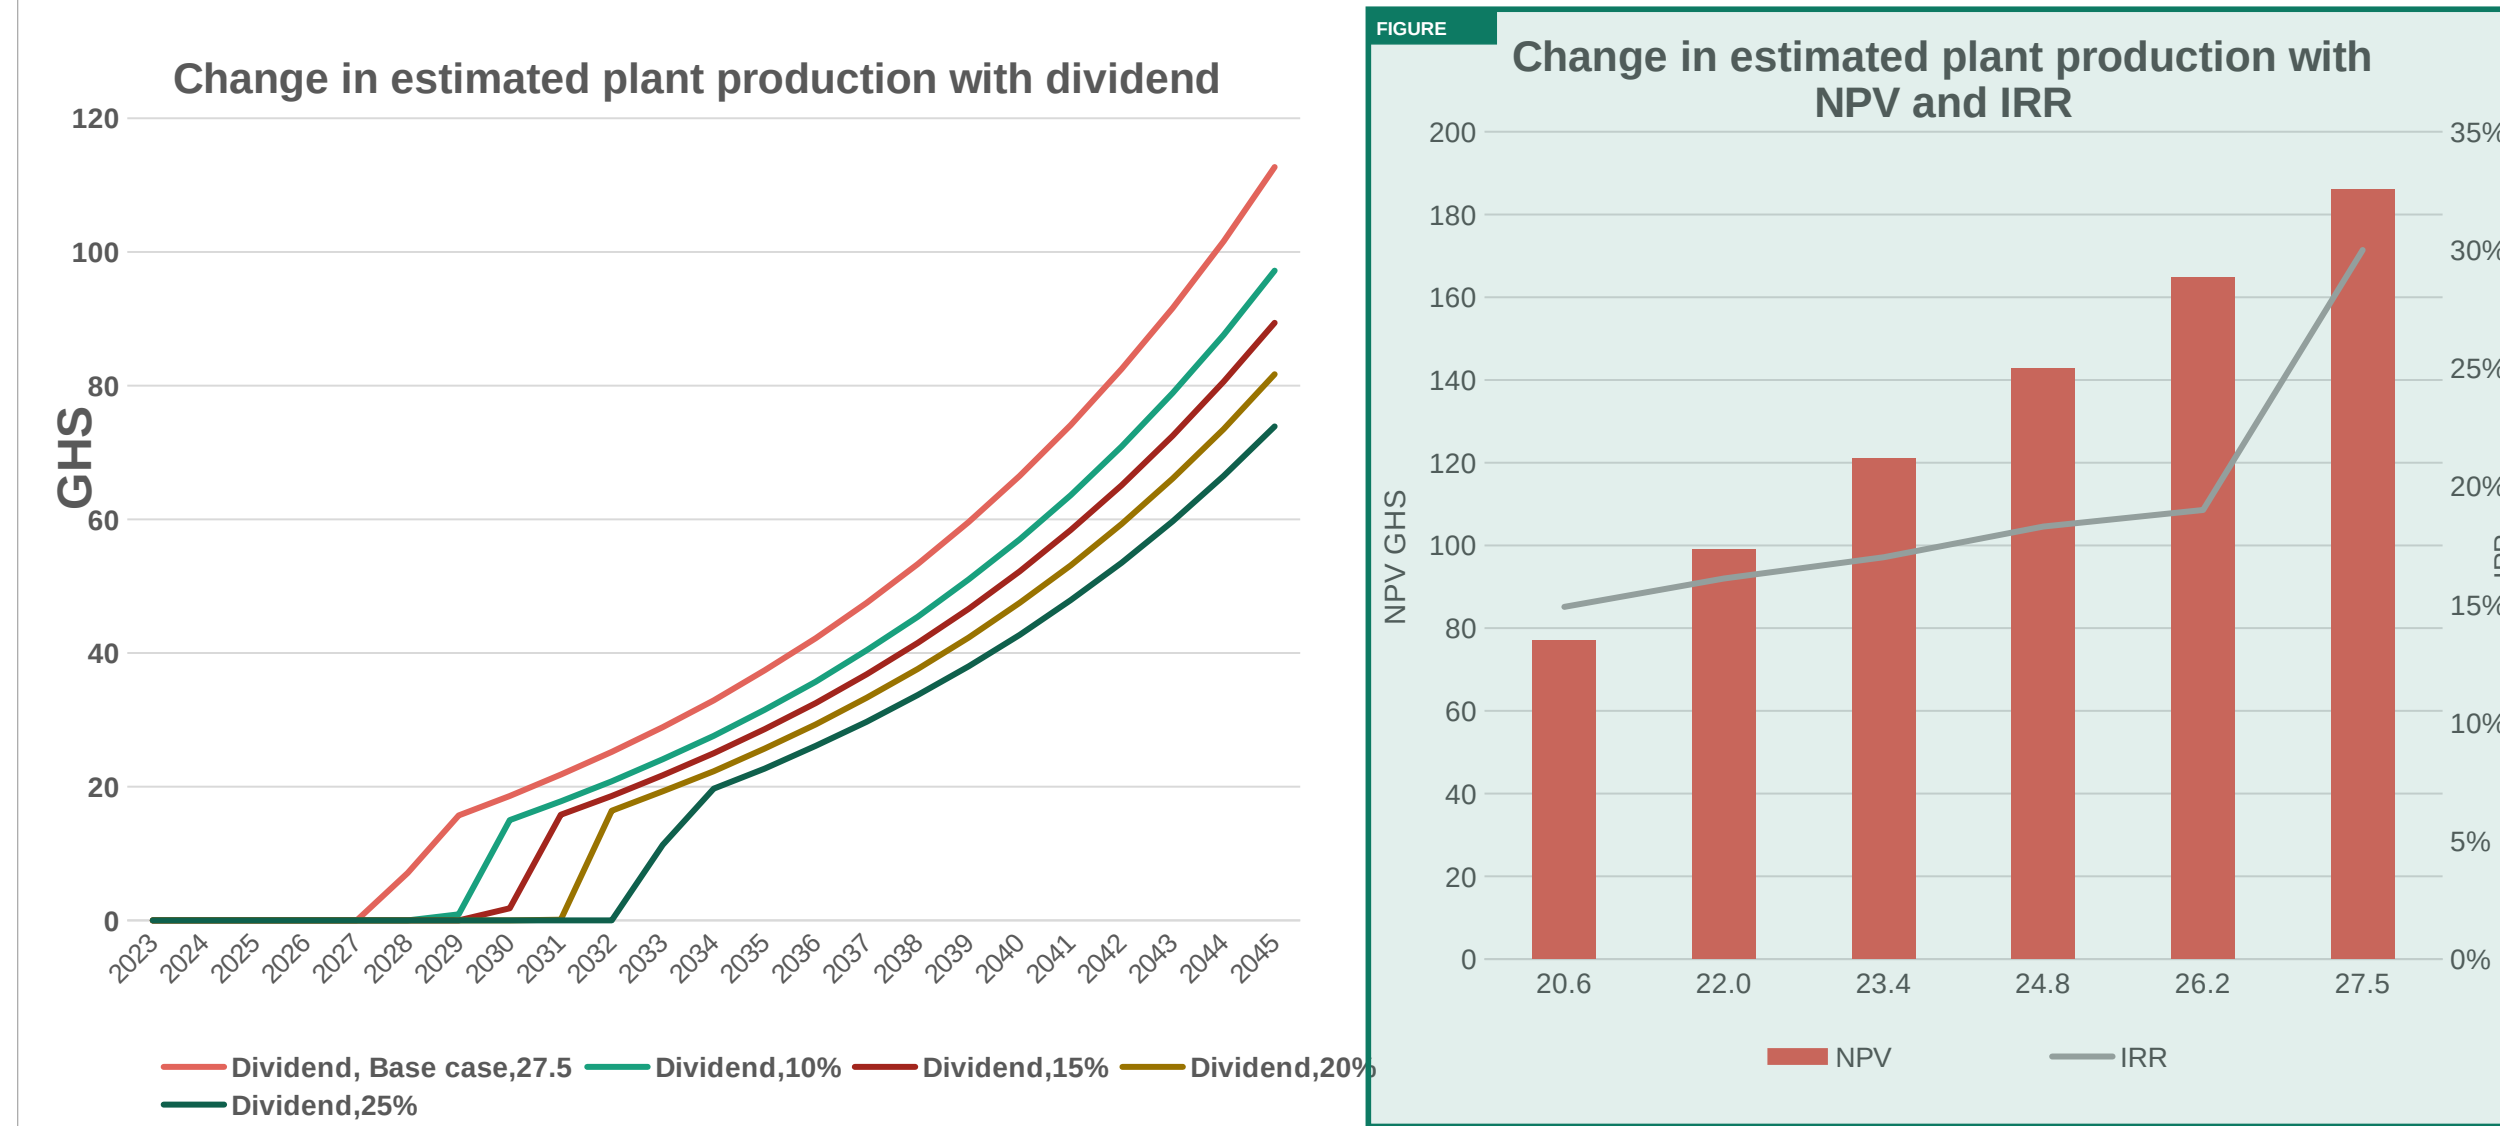


Results

6

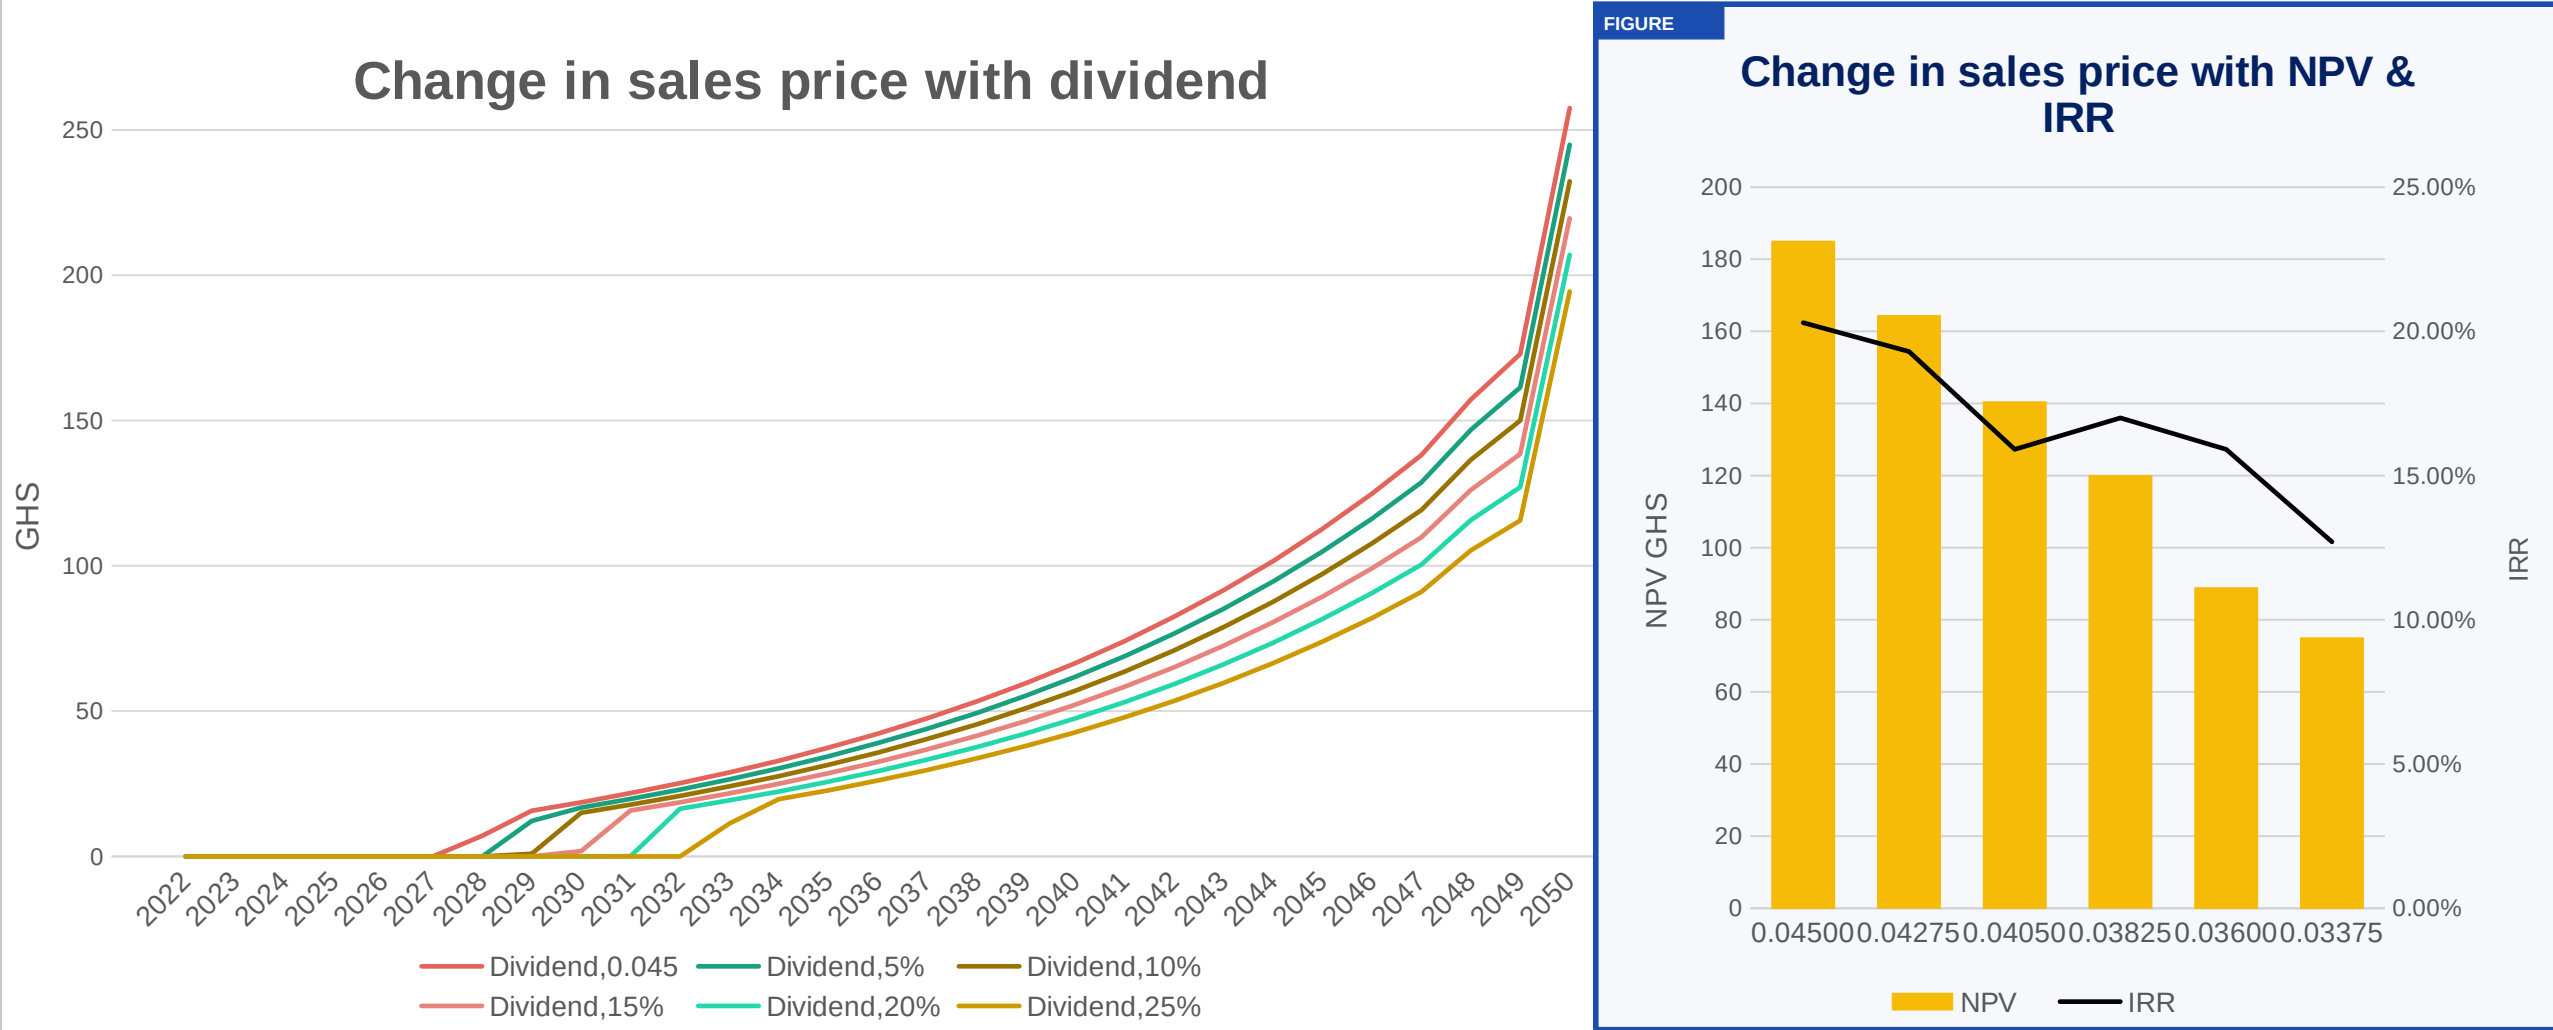


Results

6

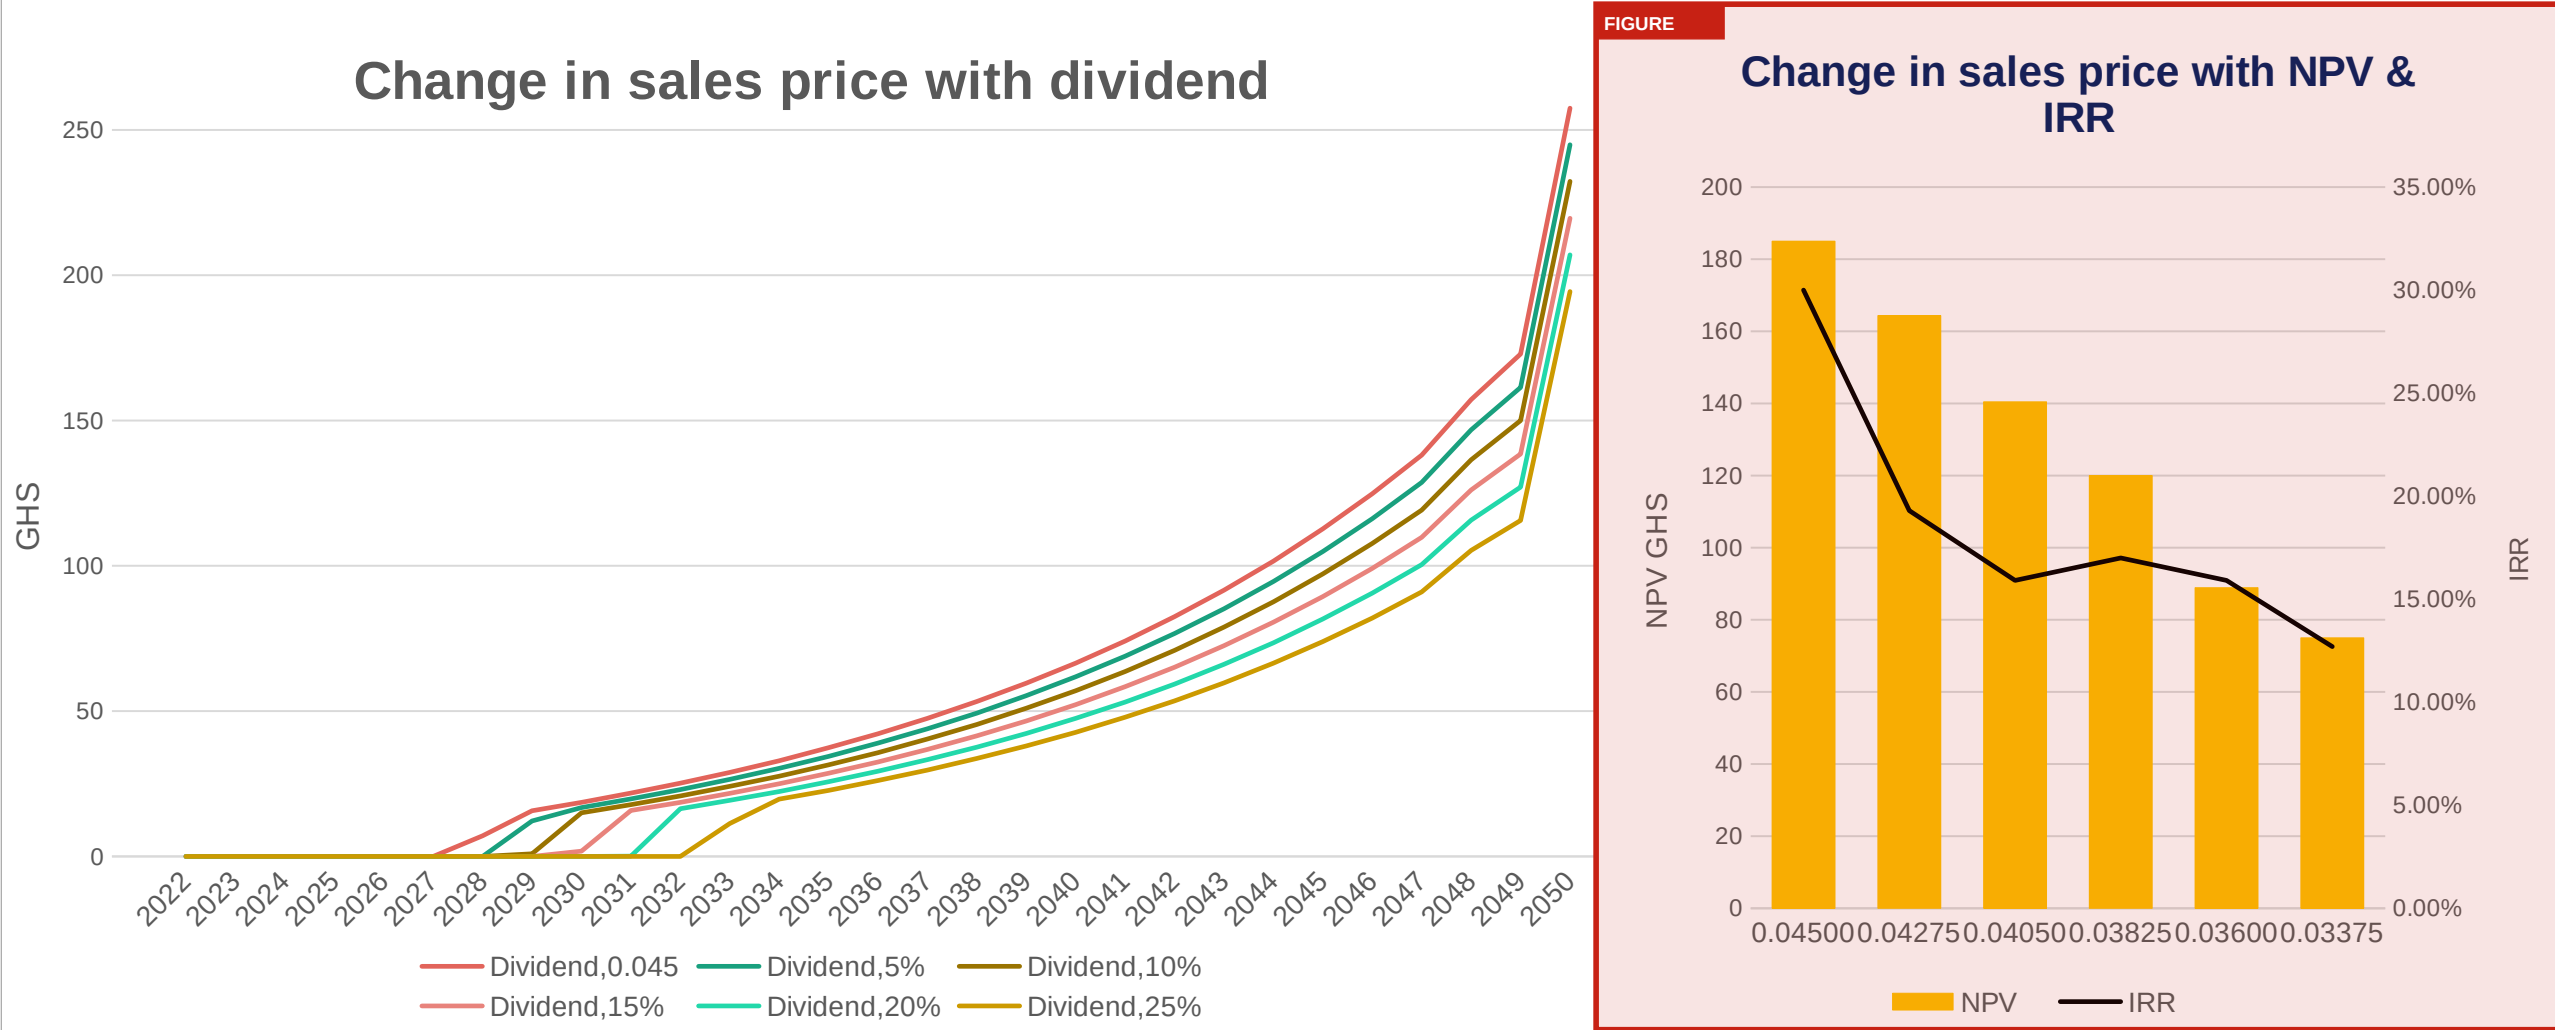

Results

6

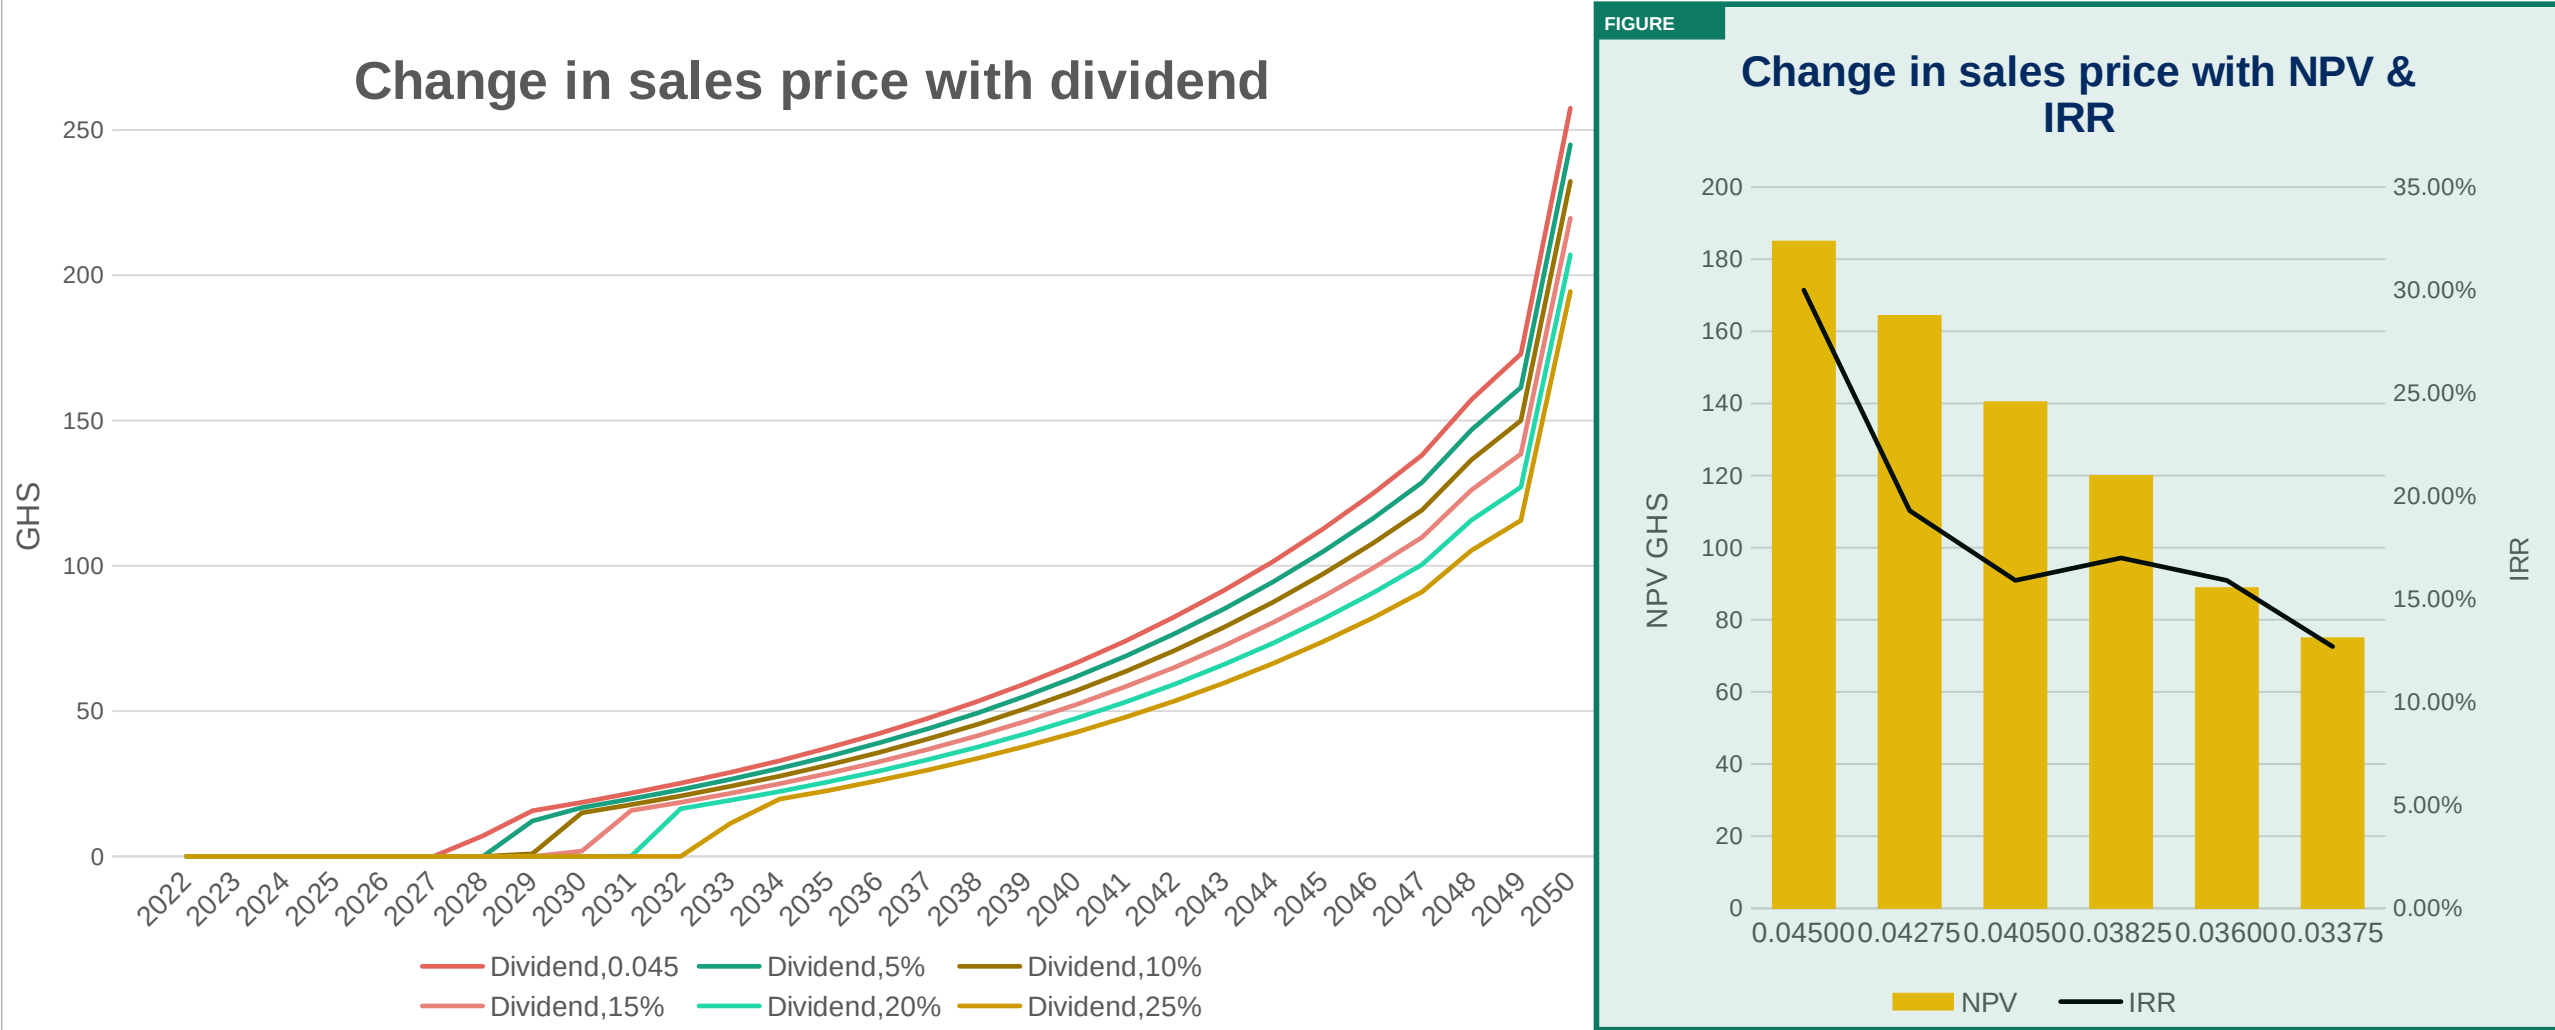

Conclusions and Policy Insights

7

Main insights and Conclusion

- ❑ Base case model is profitable
- ❑ With reduced plant production and sales price profitability is still ensured (NPV and IRR)
- ❑ An example : For 5% reduction i.e. from 27.5GW to 26.15GW, NPV decreases by 14% from 185.9 to 164.7 and IRR from 20.3% to 19%.
- ❑ Dividend to shareholders reduces as plant production and sales price reduce.
- ❑ For example: 10% reduction in sales price of electricity, from 0.045 to 0.0405 decreases dividend from 18.6 to 15 i. e a 19% drop.
- ❑ Irrespective of all the decreases, the project is financially viable(with marginal dividend and IRR) even with up to 25% reductions in electricity price sales and yearly production.

Government actions

- ❑ Encourage investors to invest in solar technologies – high profitability
- ❑ Electricity sales price of 0.045 USD kW/h can be reduced between 5%-20%

Future work

- ❑ Further expansion of the size of the plant by 5MW or more

Conclusions and Policy Insights

7

Main insights and Conclusion

- ❑ Base case model is profitable
- ❑ With reduced plant production and sales price profitability is still ensured (NPV and IRR)
- ❑ An example : For 5% reduction i.e. from 27.5GW to 26.15GW, NPV decreases by 14% from 185.9 to 164.7 and IRR from 30.0% to 19%.
- ❑ Dividend to shareholders reduces as plant production and sales price reduce.
- ❑ For example: 10% reduction in sales price of electricity, from 0.045 to 0.0405 decreases dividend from 18.6 to 15 i. e a 19% drop.
- ❑ Irrespective of all the decreases, the project is financially viable(with marginal dividend and IRR) even with up to 25% reductions in electricity price sales and yearly production.

Government actions

- ❑ Encourage investors to invest in solar technologies – high profitability
- ❑ Electricity sales price of 0.045 USD kW/h can be reduced between 5%-20%

Future work

- ❑ Further expansion of the size of the plant by 5MW or more

Conclusions and Policy Insights

7

Main insights and Conclusion

- ❑ Base case model is profitable
- ❑ With reduced plant production and sales price profitability is still ensured (NPV and IRR)
- ❑ An example : For 5% reduction i.e. from 27.5GW to 26.15GW, NPV decreases by 14% from 185.9 to 164.7 and IRR from 30.0% to 19%.
- ❑ Dividend to shareholders reduces as plant production and sales price reduce.
- ❑ For example: 10% reduction in sales price of electricity, from 0.045 to 0.0405 decreases dividend from 18.6 to 15 i. e a 19% drop.
- ❑ Irrespective of all the decreases, the project is financially viable(with marginal dividend and IRR) even with up to 25% reductions in electricity price sales and yearly production.

Government actions

- ❑ Encourage investors to invest in solar technologies – high profitability
- ❑ Electricity sales price of 0.045 USD kW/h can be reduced between 5%-20%

Future work

- ❑ Further expansion of the size of the plant by 5MW or more

CASE_005


GT页码：5, 8

编辑指令：在第5页5 km缓冲区投资占比饼图中，将电网/微电网/独立光伏从89%/4%/7%改为70%/15%/15%；同步更新结论中对5 km电网占比的描述，但不要修改10 km情景的94%。


Bottom Up demand scenario : Results

5

	Grid	Mini Grid	SA PV	Total
Population in 2030	20215257 (94%)	460275 (2,14%)	826604 (3,86%)	21 502 139 (100%)
Total investment (million USD)	2034,1 (89%)	113,73 (4%)	197,35 (7%)	2858,13 (100%)
Total new connections	6779408 (89%)	462154 (4%)	829338 (7%)	8070900 (100%)
Total Capacity (MW)	344 (78%)	54 (12%)	43 (10%)	441 (100%)

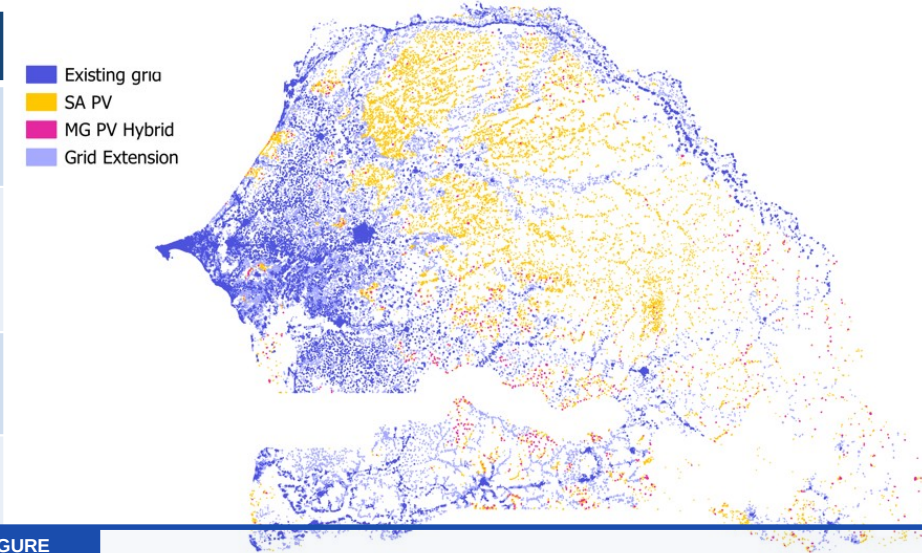


- Number of mini-grids : **1037**
- Number of SHS : **14 902**
- Annual investment required : **\$357 million**
- The electrification rate achieved in 2025 is 90%
- 89% of new connections are On-Grid vs 11% PV off grid

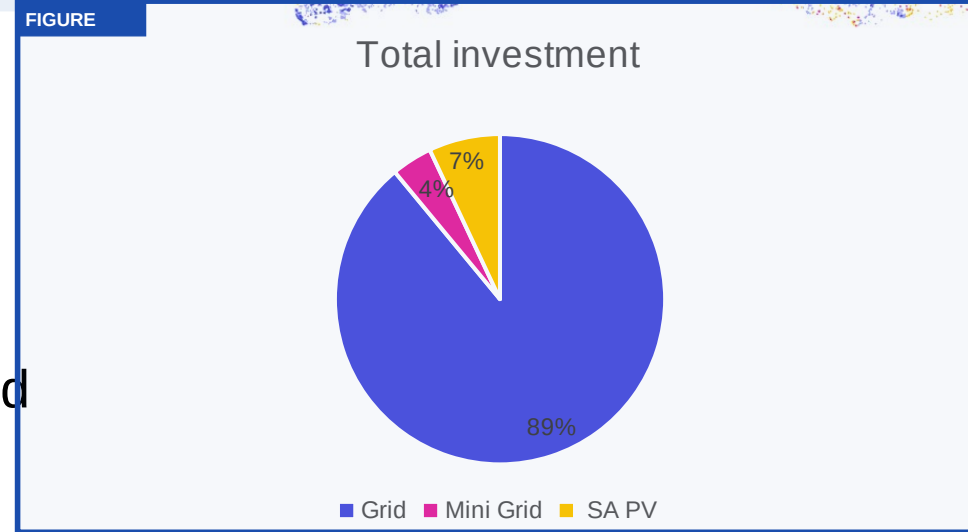


Bottom Up demand scenario : Results

5

	Grid	Mini Grid	SA PV	Total
Population in 2030	20215257 (94%)	460275 (2,14%)	826604 (3,86%)	21 502 139 (100%)
Total investment (million USD)	2034,1 (89%)	113,73 (4%)	197,35 (7%)	2858,13 (100%)
Total new connections	6779408 (89%)	462154 (4%)	829338 (7%)	8070900 (100%)
Total Capacity (MW)	344 (78%)	54 (12%)	43 (10%)	441 (100%)

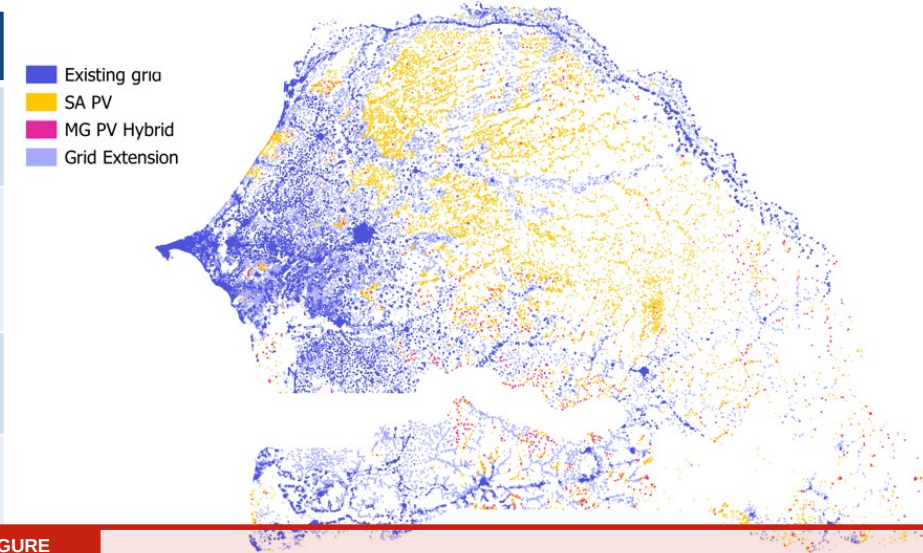


- Number of mini-grids : **1037**
- Number of SHS : **14 902**
- Annual investment required : **\$357 million**
- The electrification rate achieved in 2025 is 90%
- 89% of new connections are On-Grid vs 11% PV off grid

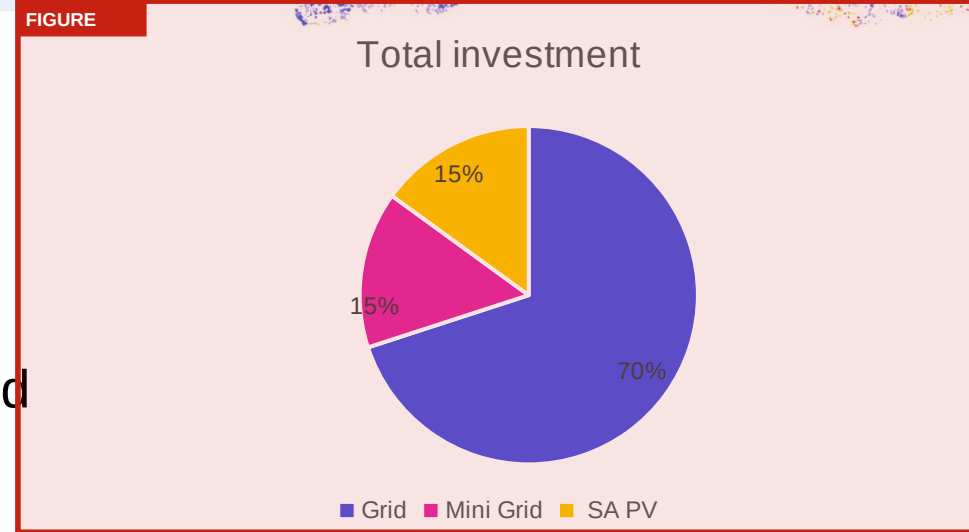


Bottom Up demand scenario : Results

5

	Grid	Mini Grid	SA PV	Total
Population in 2030	20215257 (94%)	460275 (2,14%)	826604 (3,86%)	21 502 139 (100%)
Total investment (million USD)	2034,1 (89%)	113,73 (4%)	197,35 (7%)	2858,13 (100%)
Total new connections	6779408 (89%)	462154 (4%)	829338 (7%)	8070900 (100%)
Total Capacity (MW)	344 (78%)	54 (12%)	43 (10%)	441 (100%)

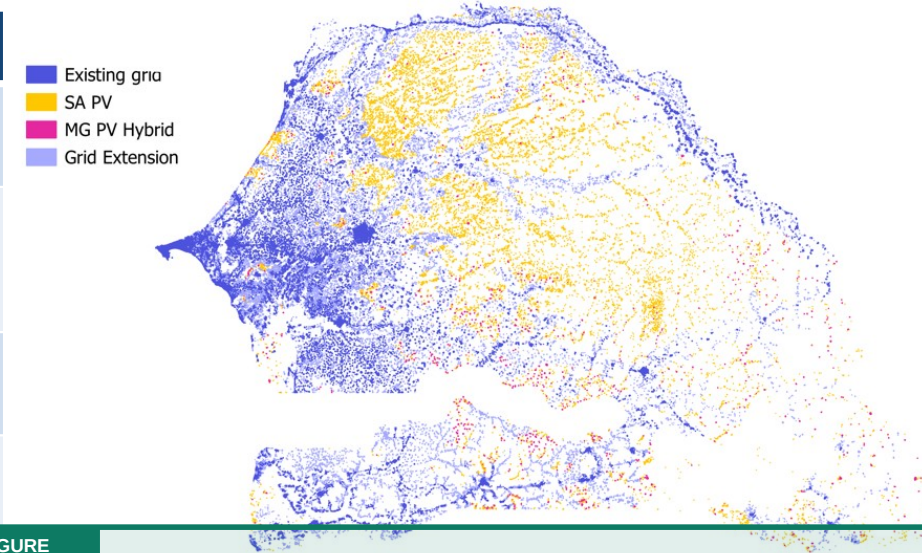

- Number of mini-grids : **1037**
- Number of SHS : **14 902**
- Annual investment required : **\$357 million**
- The electrification rate achieved in 2025 is 90%
- 89% of new connections are On-Grid vs 11% PV off grid

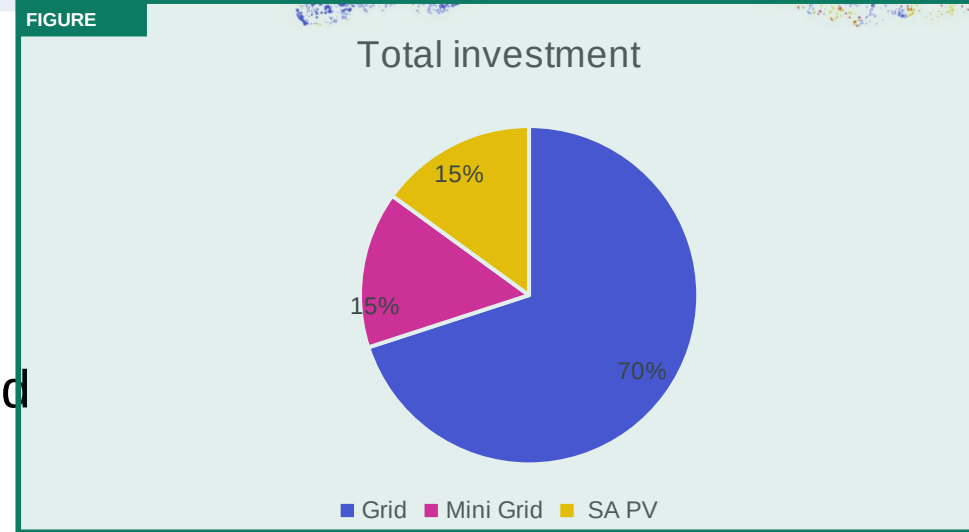

Conclusions and Policy Insights

- Conclusions
 - The share of the grid (densification + extension) is very significant in achieving universal access by 2030 due to the robustness of existing grid
 - The share of the grid grow (89% -> 94%) with the increase of the forced grid buffer (5 km -> 10 km)
 - A larger forced grid buffer increase the total investment cost
 - A higher demand increase the share of the grid and mini-grid connections
- Policy Insights
 - The government needs to prioritize investment in modernizing the grid in order to achieve universal access
 - Definition of a regulatory framework for the development SA PV
 - Intensification of rural electrification programs and projects
 - Mobilization funds to achieve electrification goal

Conclusions and Policy Insights

- Conclusions
 - The share of the grid (densification + extension) is very significant in achieving universal access by 2030 due to the robustness of existing grid
 - The share of the grid grow (70% -> 94%) with the increase of the forced grid buffer (5 km -> 10 km)
 - A larger forced grid buffer increase the total investment cost
 - A higher demand increase the share of the grid and mini-grid connections
- Policy Insights
 - The government needs to prioritize investment in modernizing the grid in order to achieve universal access
 - Definition of a regulatory framework for the development SA PV
 - Intensification of rural electrification programs and projects
 - Mobilization funds to achieve electrification goal

Conclusions and Policy Insights




- Conclusions
 - The share of the grid (densification + extension) is very significant in achieving universal access by 2030 due to the robustness of existing grid
 - The share of the grid grow (70% -> 94%) with the increase of the forced grid buffer (5 km -> 10 km)
 - A larger forced grid buffer increase the total investment cost
 - A higher demand increase the share of the grid and mini-grid connections
- Policy Insights
 - The government needs to prioritize investment in modernizing the grid in order to achieve universal access
 - Definition of a regulatory framework for the development SA PV
 - Intensification of rural electrification programs and projects
 - Mobilization funds to achieve electrification goal

CASE_006




GT页码：7, 9

编辑指令：在第7页右上角标题为“Goal 25% by 2030”的图表中，将“Porcentage RES.”系列的2030年数值从34.2%改为40.0%；同步更新结论中引用该预测值的文字，“Goal.”系列仍为25%，其他年份保持不变。



Scenario 25% by 2030.

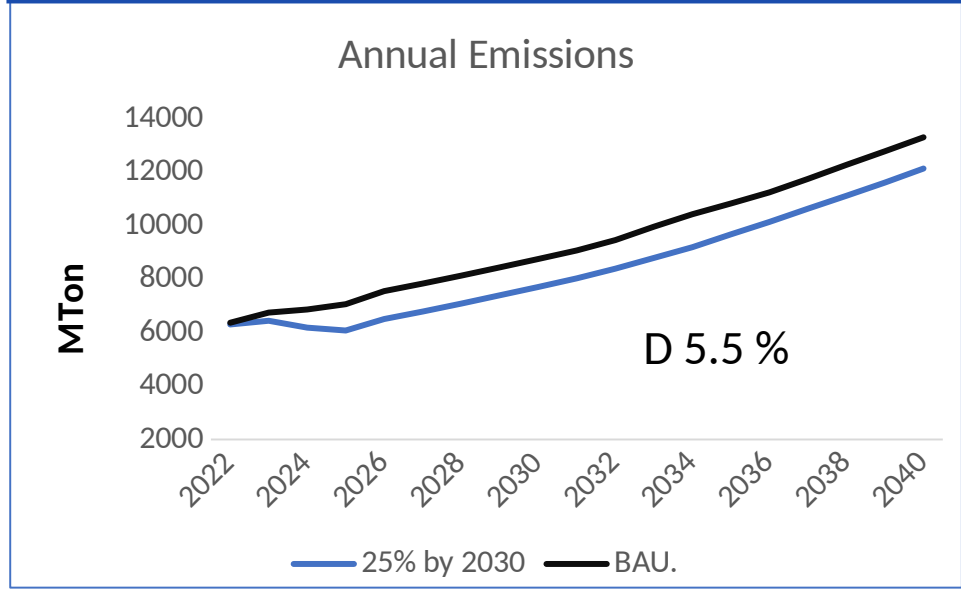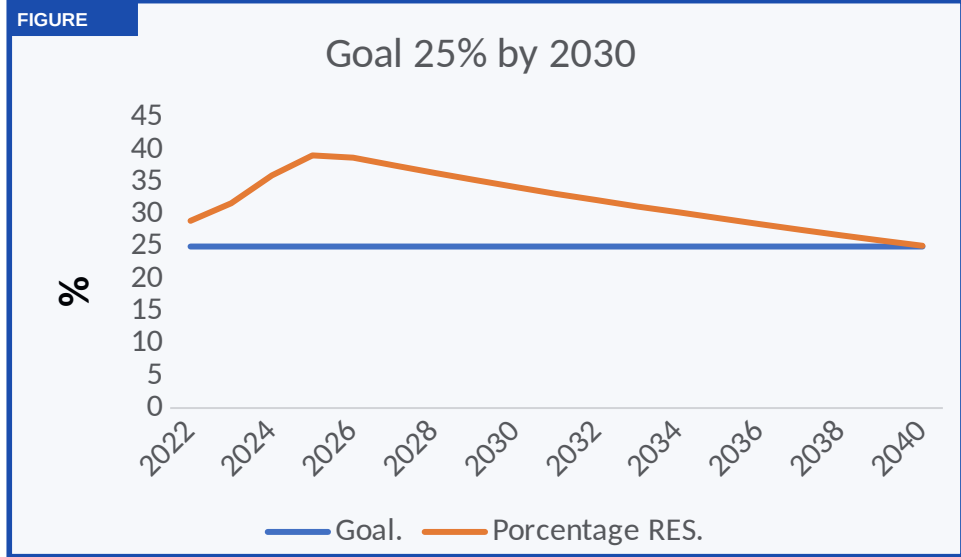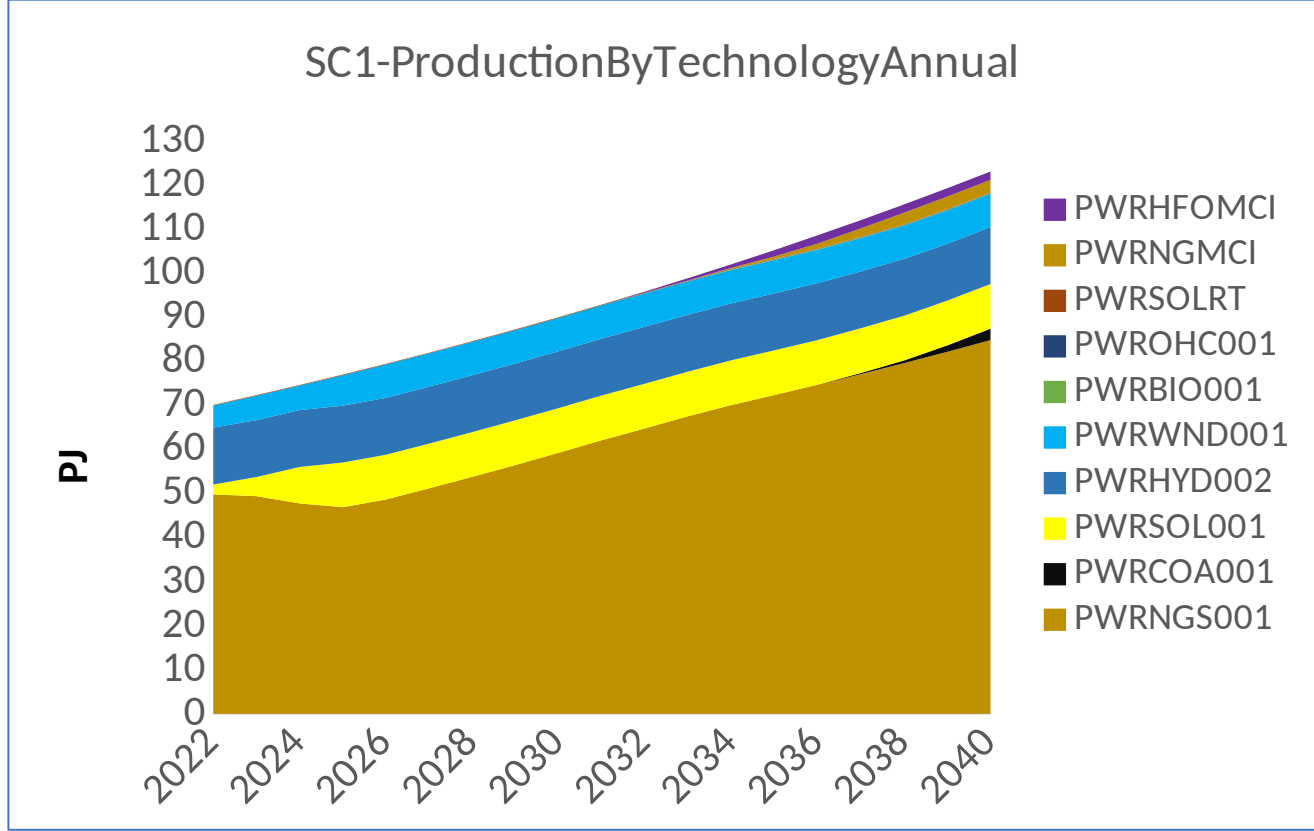

Scenario 25% by 2030.

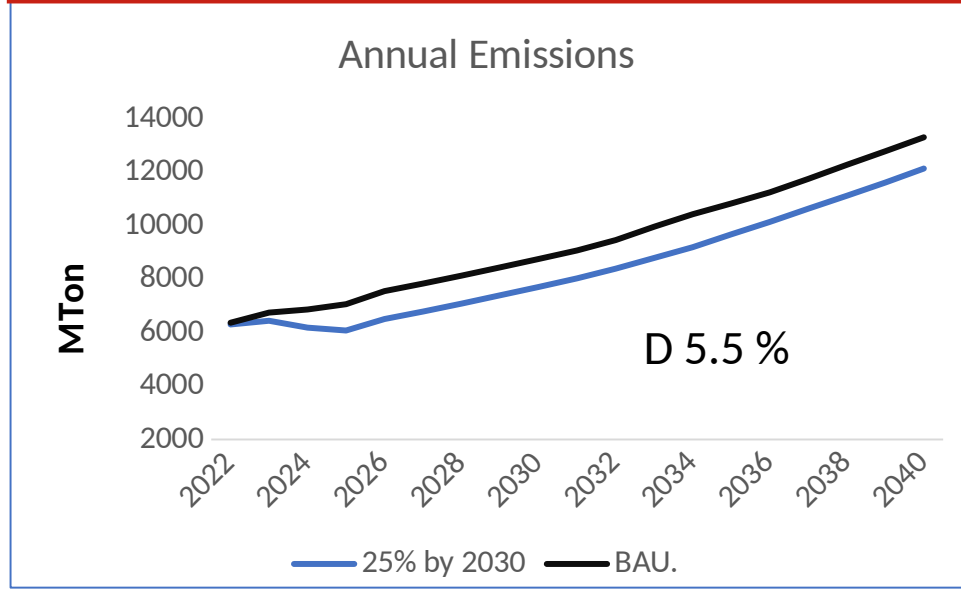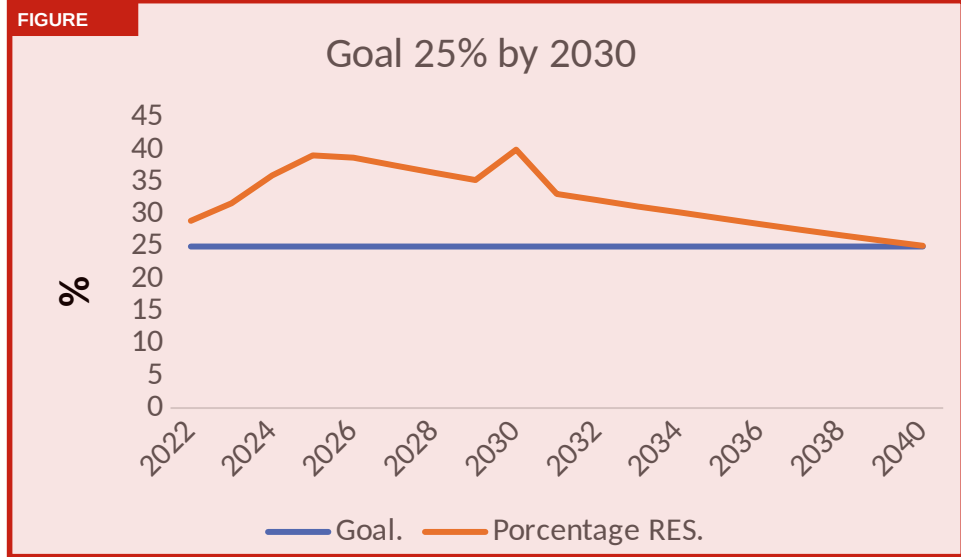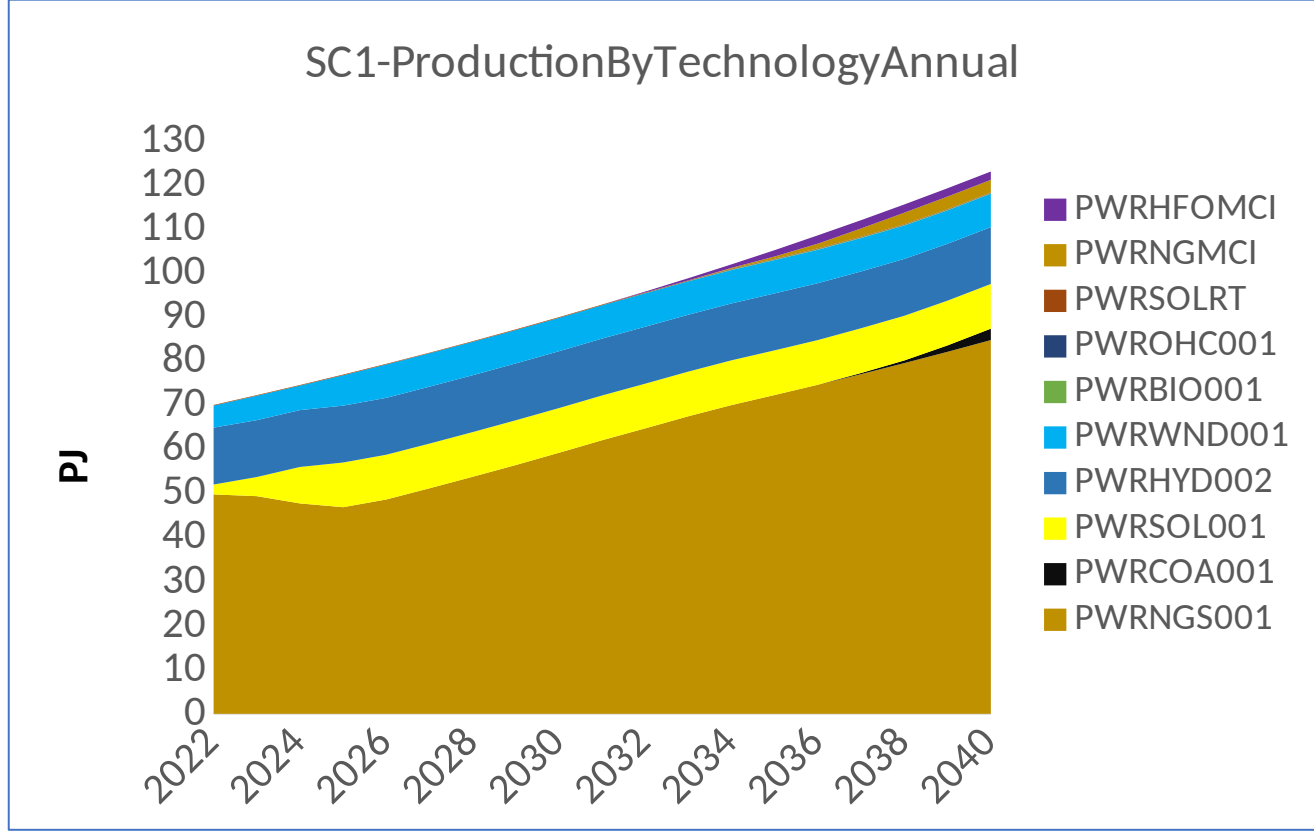

Scenario 25% by 2030.

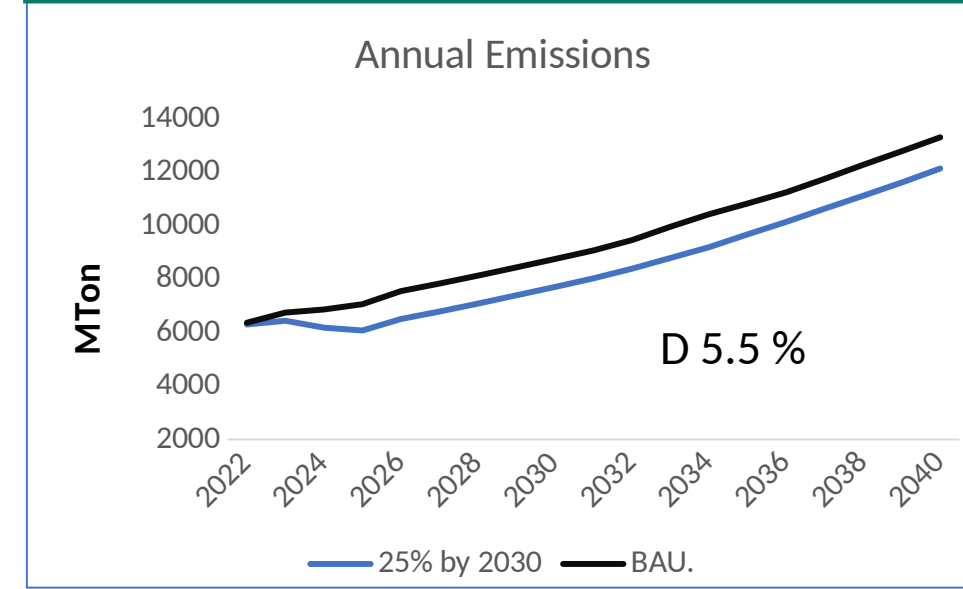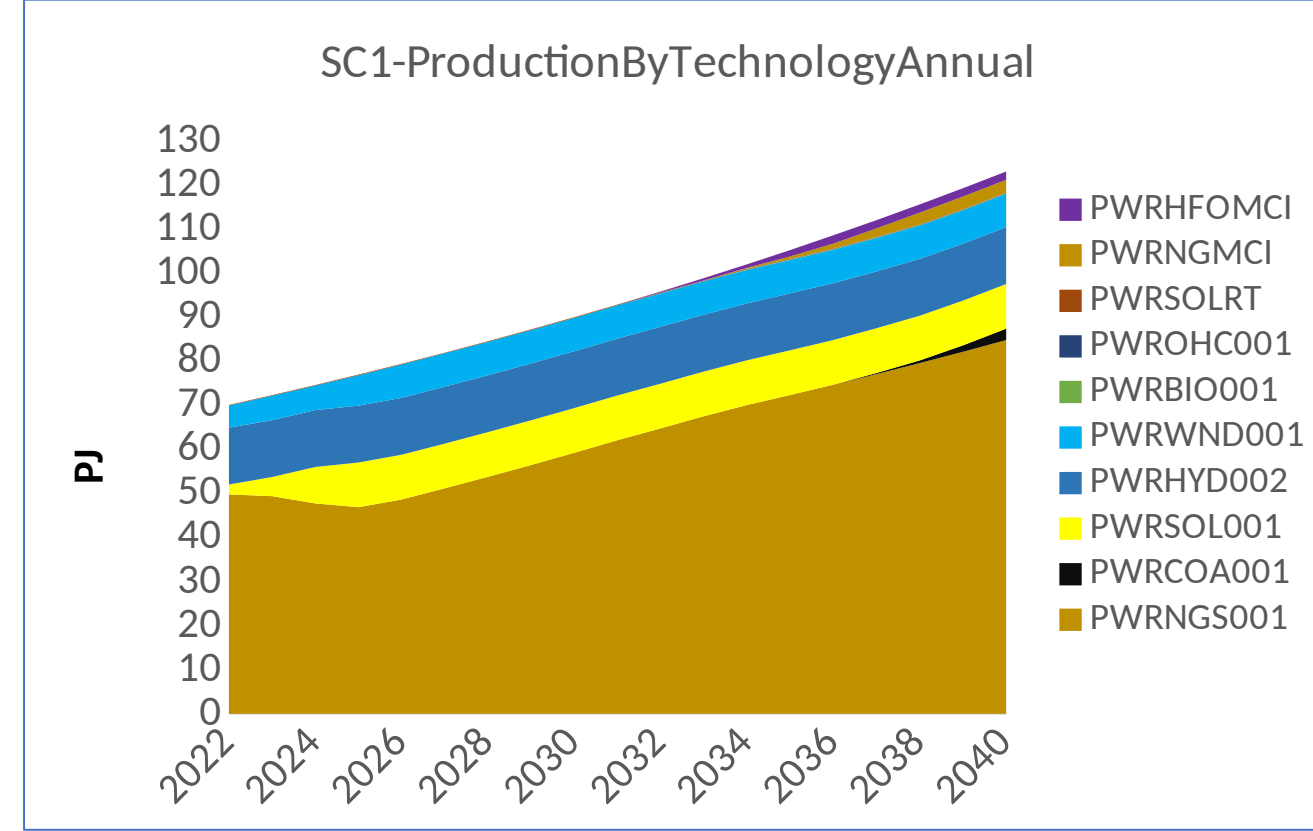

Conclusion and Policy Insights

If the new Renewable Projects fulfil their commitment DR will be able to reach the goal of supply 25% of the demand form RES by 2030.

When a Zero-Emissions scenario is set, the transport demand is moved to the electrical sector and the model recommend new capacity from Biomass technology. It suggests that BECS could be a good option to reach Net-Zero by 2050.

The government should continue encouraging new investments to install new RES capacity but should beware of diversify the matrix not only with Solar PV technology, as it is happening now.

Future Work

Even though this model can be used as example in future works, its needed to improved the transport input data and split the electricity demand.

The scenario chart projects renewable energy at 34.2% of demand in 2030.

Conclusion and Policy Insights

If the new Renewable Projects fulfil their commitment DR will be able to reach the goal of supply 25% of the demand form RES by 2030.

When a Zero-Emissions scenario is set, the transport demand is moved to the electrical sector and the model recommend new capacity from Biomass technology. It suggests that BECS could be a good option to reach Net-Zero by 2050.

The government should continue encouraging new investments to install new RES capacity but should beware of diversify the matrix not only with Solar PV technology, as it is happening now.

Future Work

Even though this model can be used as example in future works, its needed to improved the transport input data and split the electricity demand.

The scenario chart projects renewable energy at 40.0% of demand in 2030.

Conclusion and Policy Insights

If the new Renewable Projects fulfil their commitment DR will be able to reach the goal of supply 25% of the demand form RES by 2030.

When a Zero-Emissions scenario is set, the transport demand is moved to the electrical sector and the model recommend new capacity from Biomass technology. It suggests that BECS could be a good option to reach Net-Zero by 2050.

The government should continue encouraging new investments to install new RES capacity but should beware of diversify the matrix not only with Solar PV technology, as it is happening now.

Future Work

Even though this model can be used as example in future works, its needed to improved the transport input data and split the electricity demand.

The scenario chart projects renewable energy at 40.0% of demand in 2030.


CASE_007

GT页码：15, 16

编辑指令：在第15页适用性图表中，将“尚无法替代”的工业应用数量从25改为50；同步更新必要用途讨论中的相关表述，其他用途类别保持不变。

Are the alternatives suitable and available?


- Overall, no suitable alternatives available for ~25% of PFAS applications

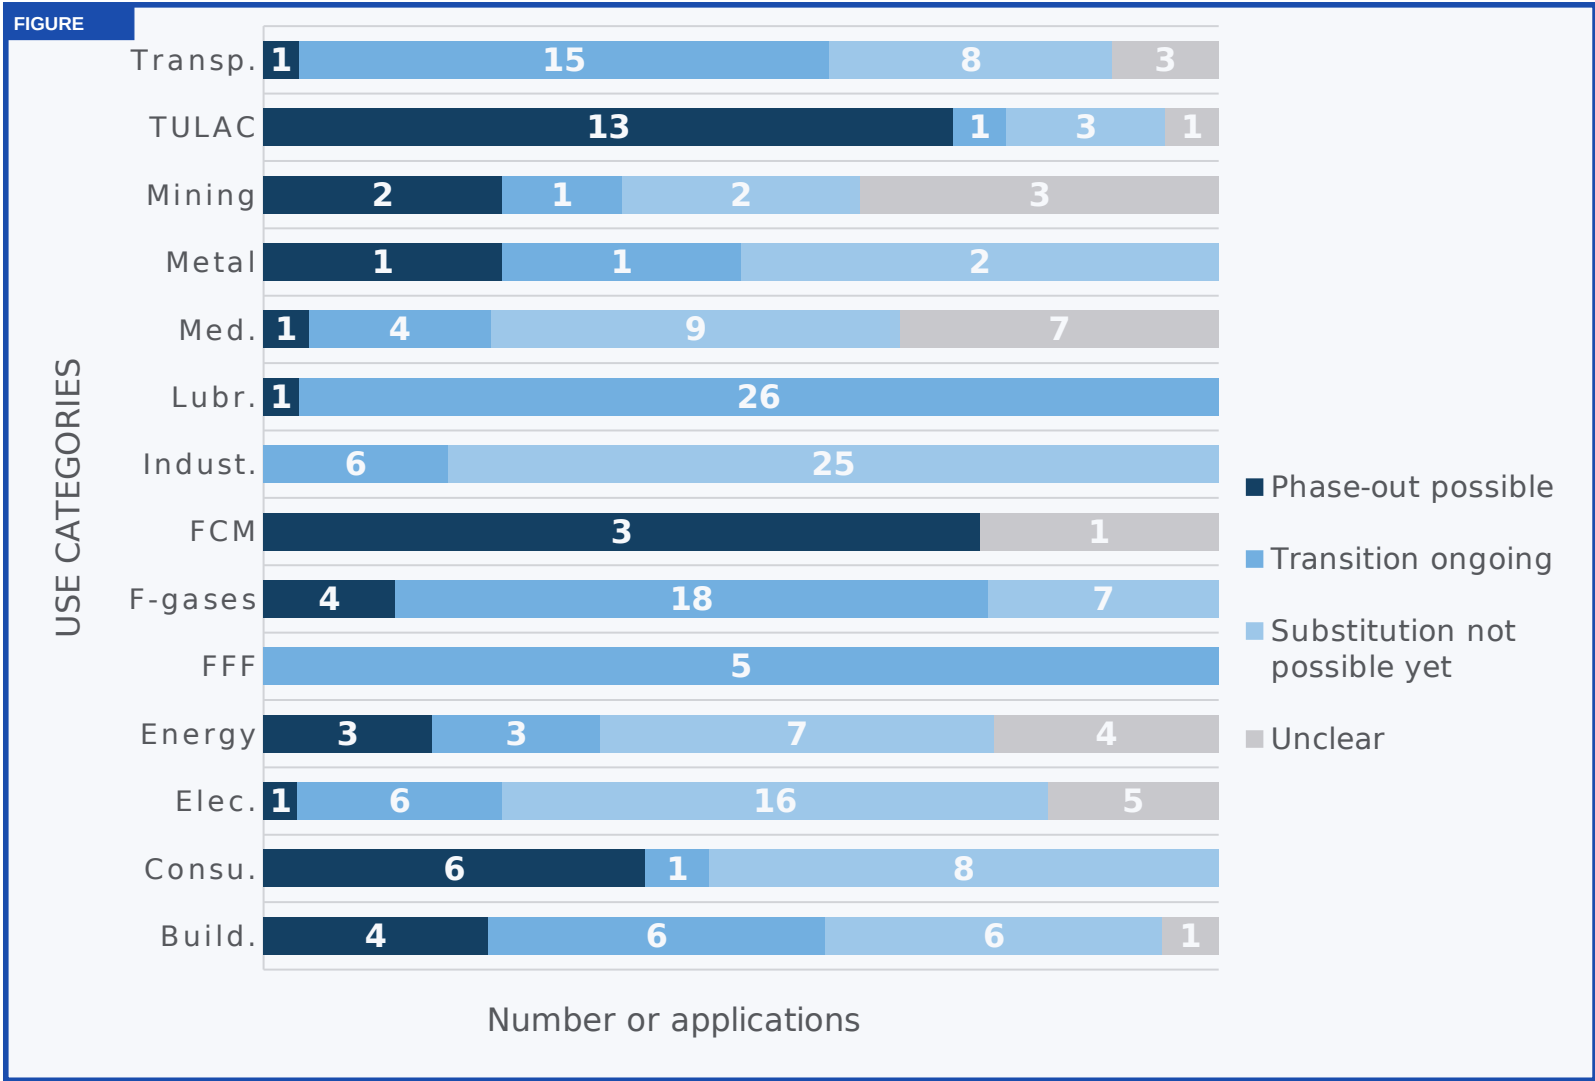

15

Are the alternatives suitable and available?


- Overall, no suitable alternatives available for ~25% of PFAS applications

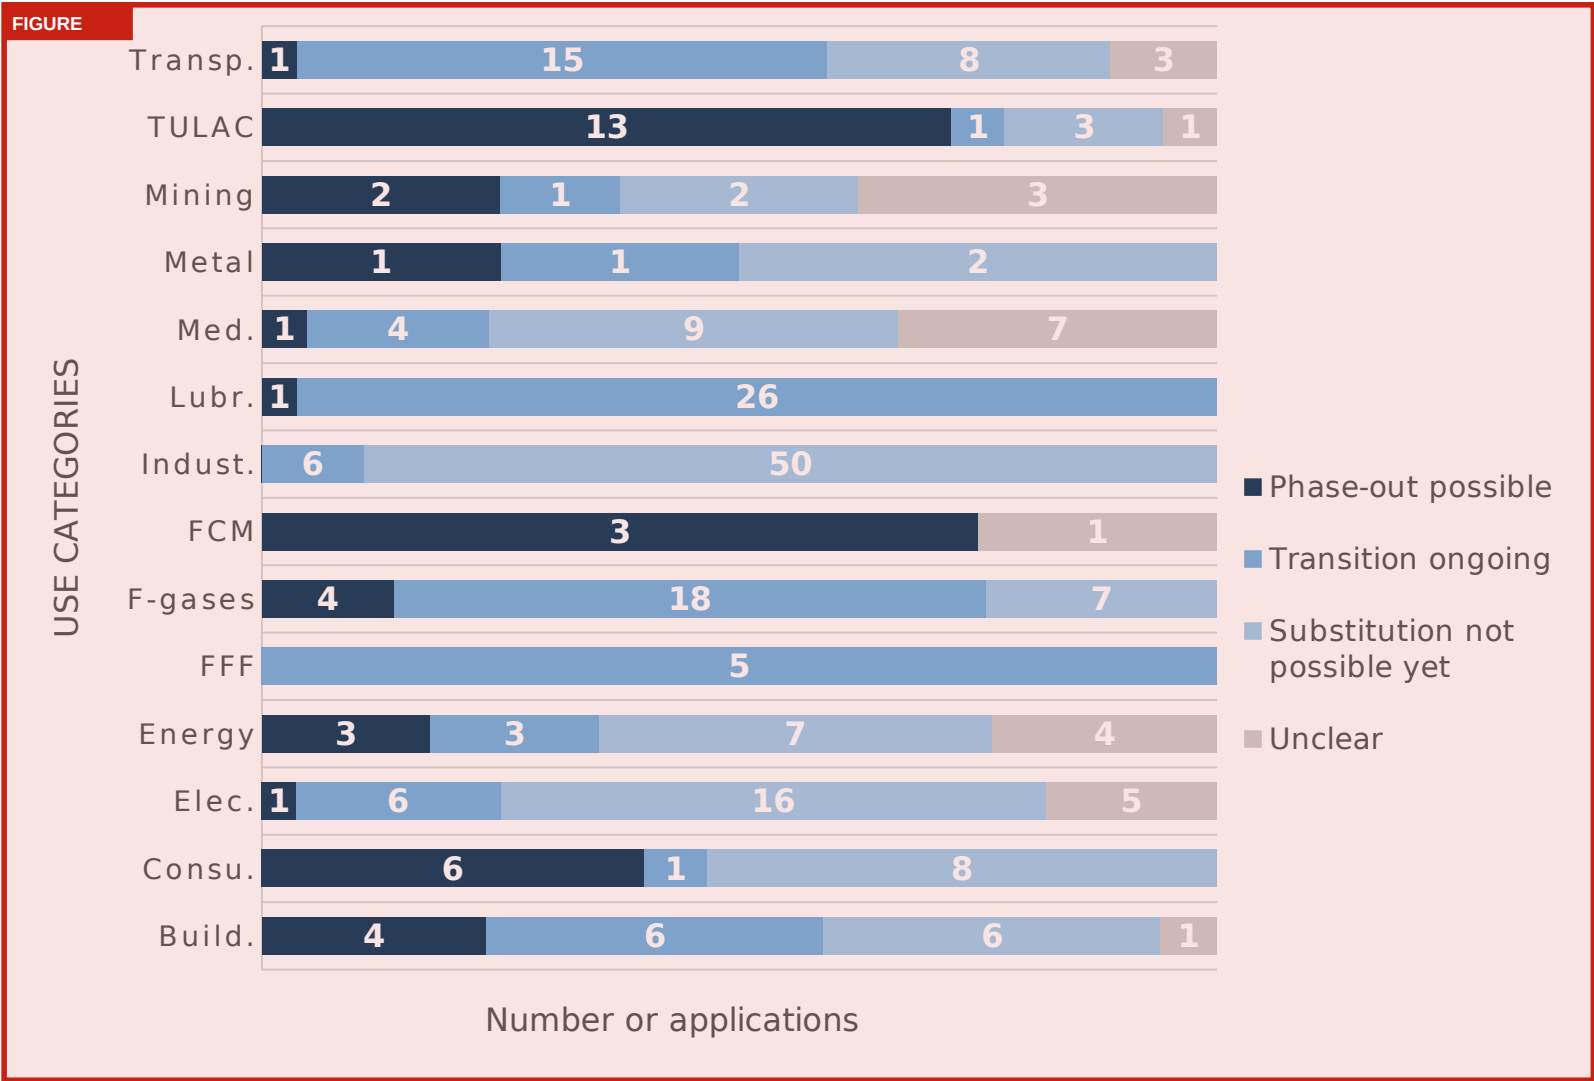

15

Are the alternatives suitable and available?


- Overall, no suitable alternatives available for ~25% of PFAS applications

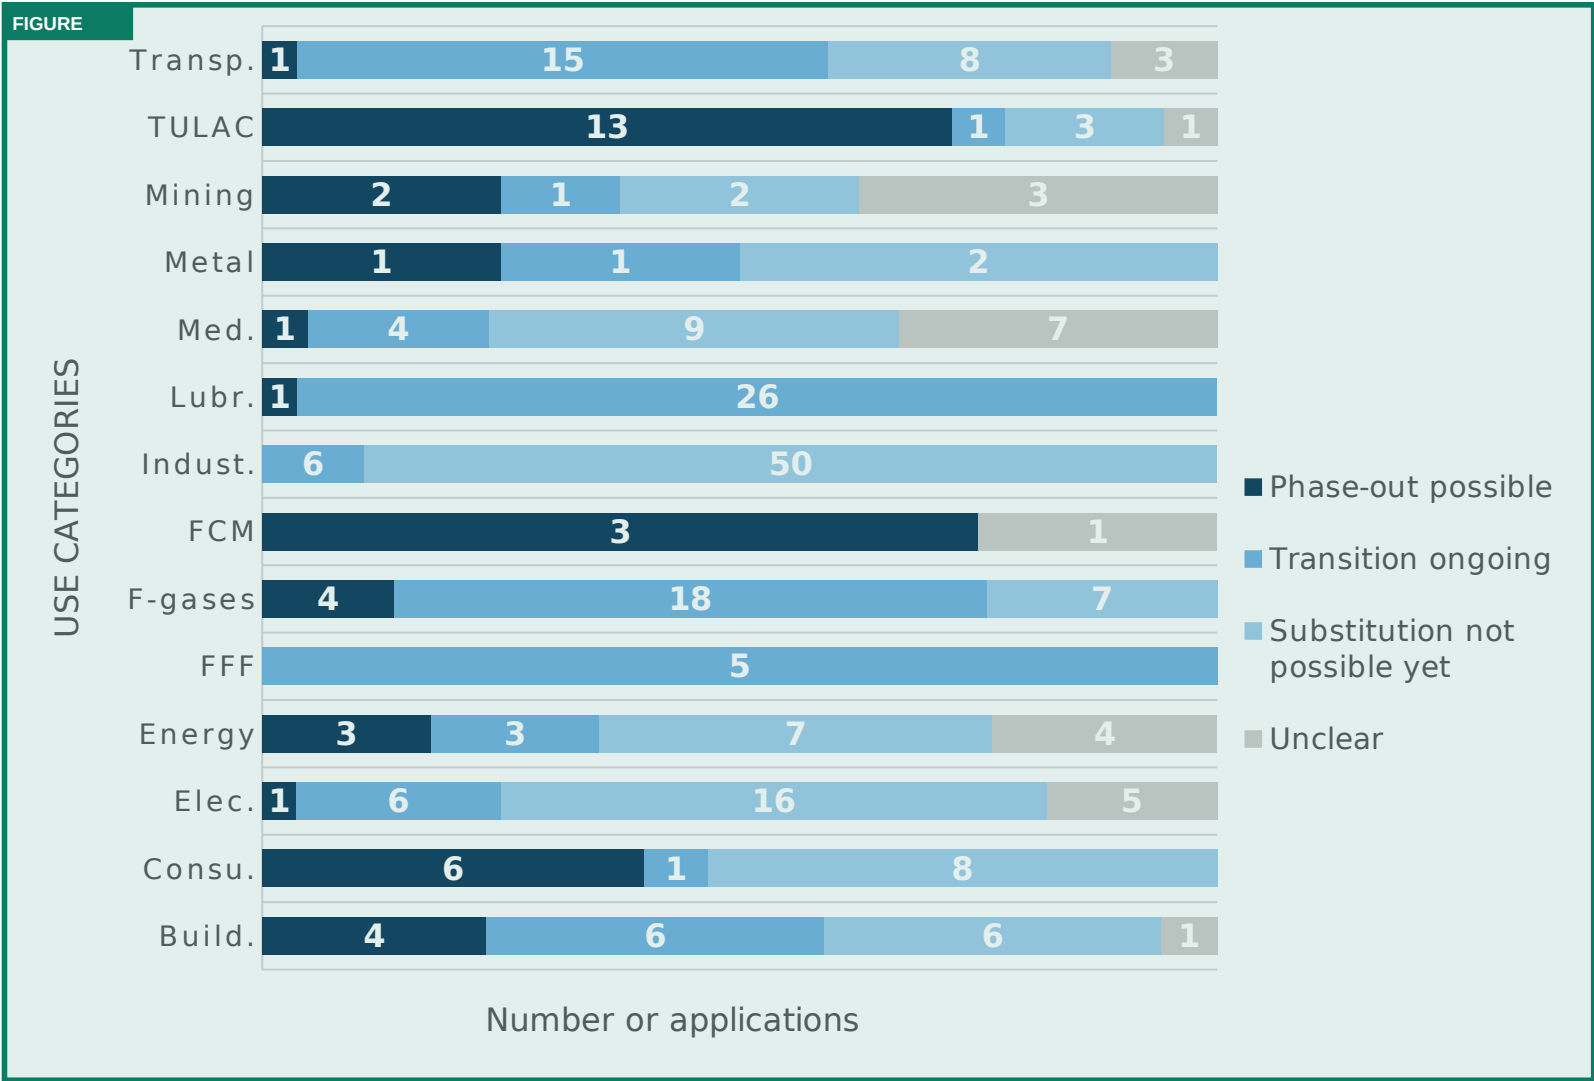

15


Are uses of PFAS essential?

- Information in the database useful for evaluation of the need for the technical function
- **Based on availability of alternatives**, ~25% of uses of PFAS could be considered non-essential
- The suitability chart shows that substitution is not yet possible for **25 industrial applications**.

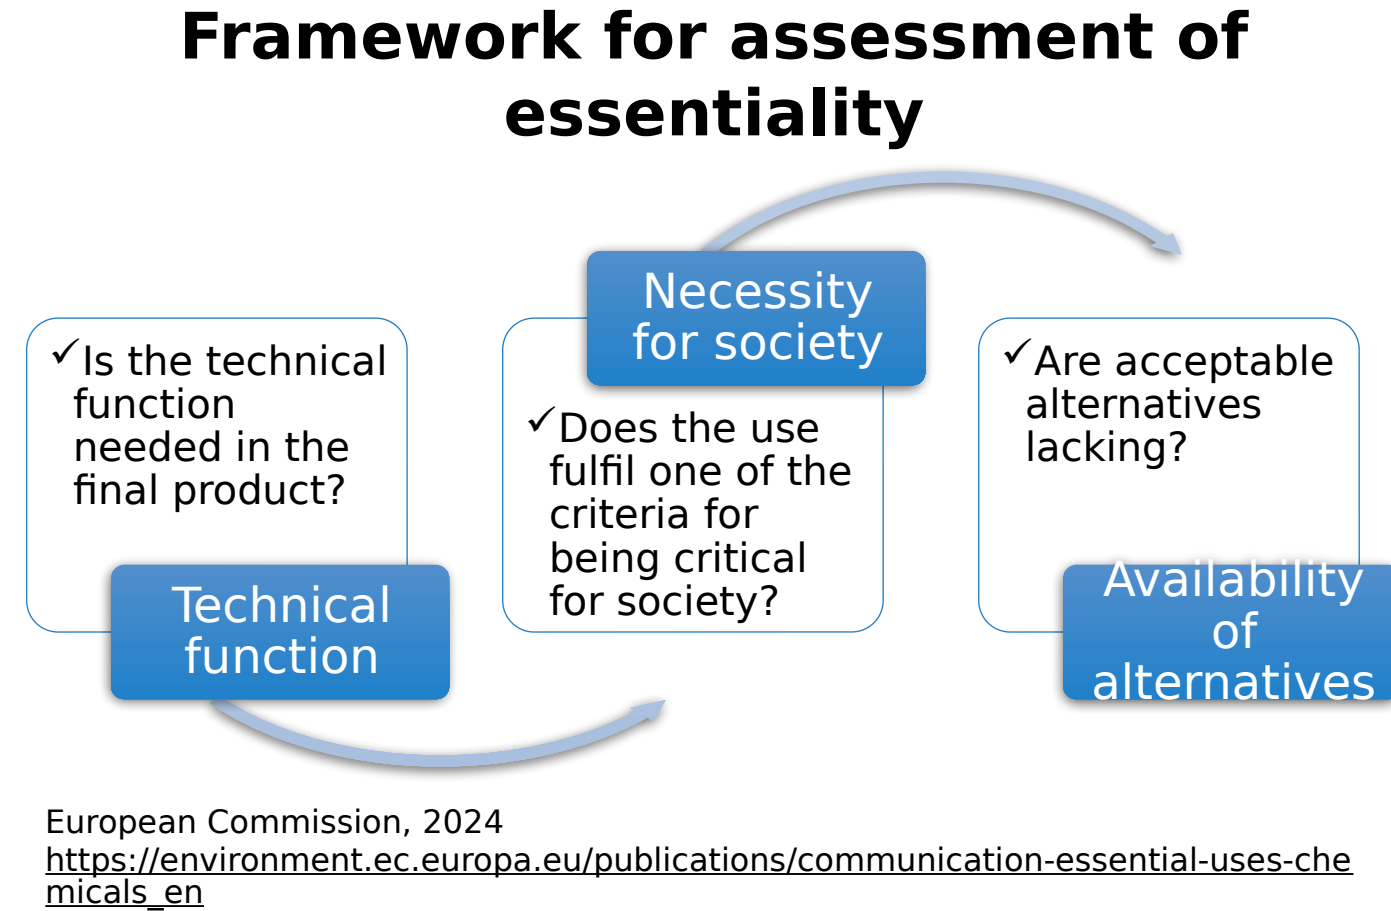


Are uses of PFAS essential?

- Information in the database useful for evaluation of the need for the technical function
- **Based on availability of alternatives**, ~25% of uses of PFAS could be considered non-essential
- The suitability chart shows that substitution is not yet possible for **50 industrial applications**.

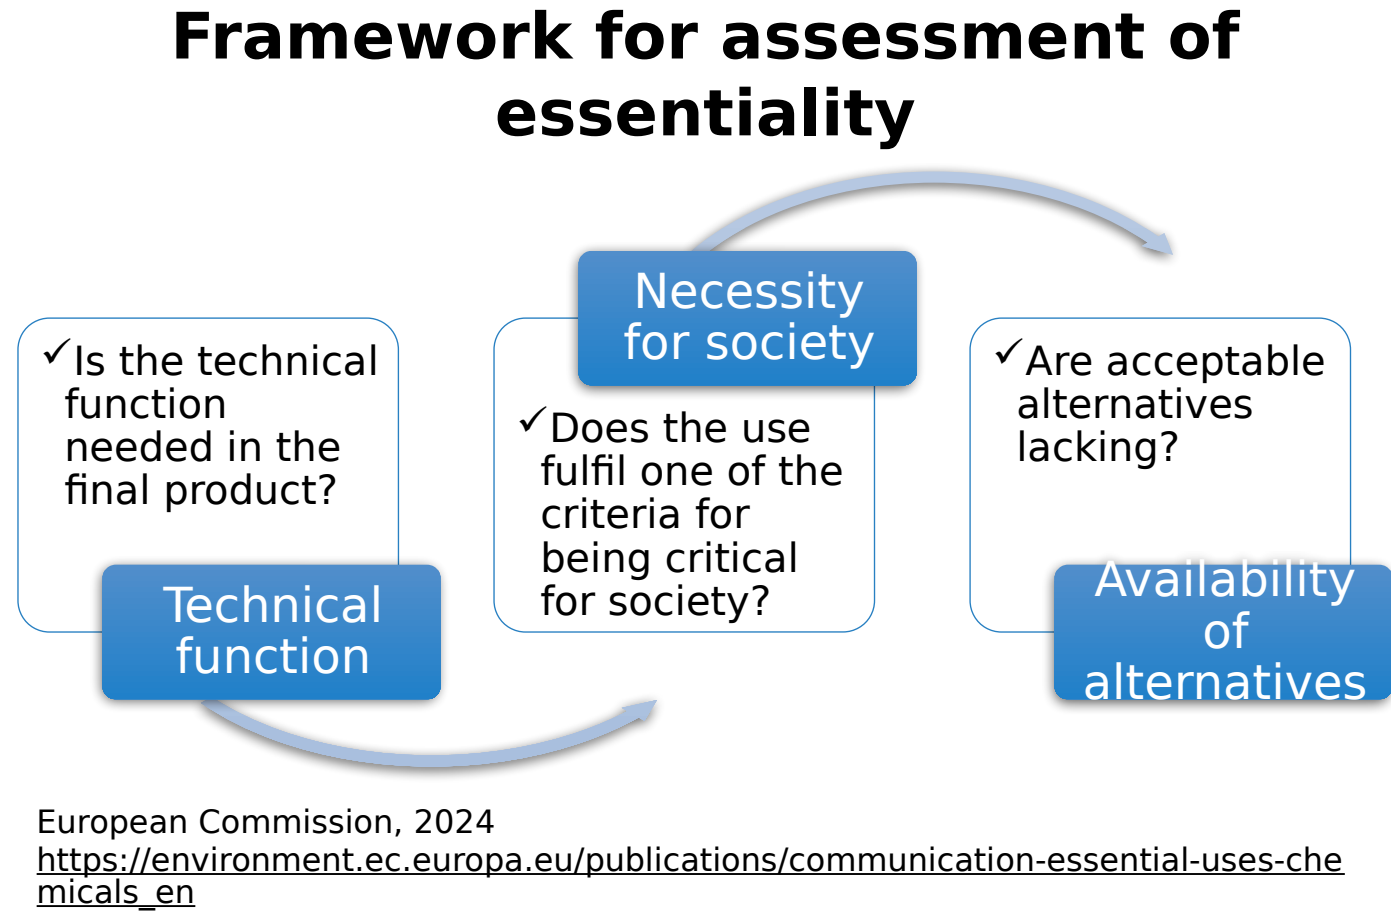

Are uses of PFAS essential?

- Information in the database useful for evaluation of the need for the technical function
- **Based on availability of alternatives**, ~25% of uses of PFAS could be considered non-essential
- The suitability chart shows that substitution is not yet possible for **50 industrial applications**.

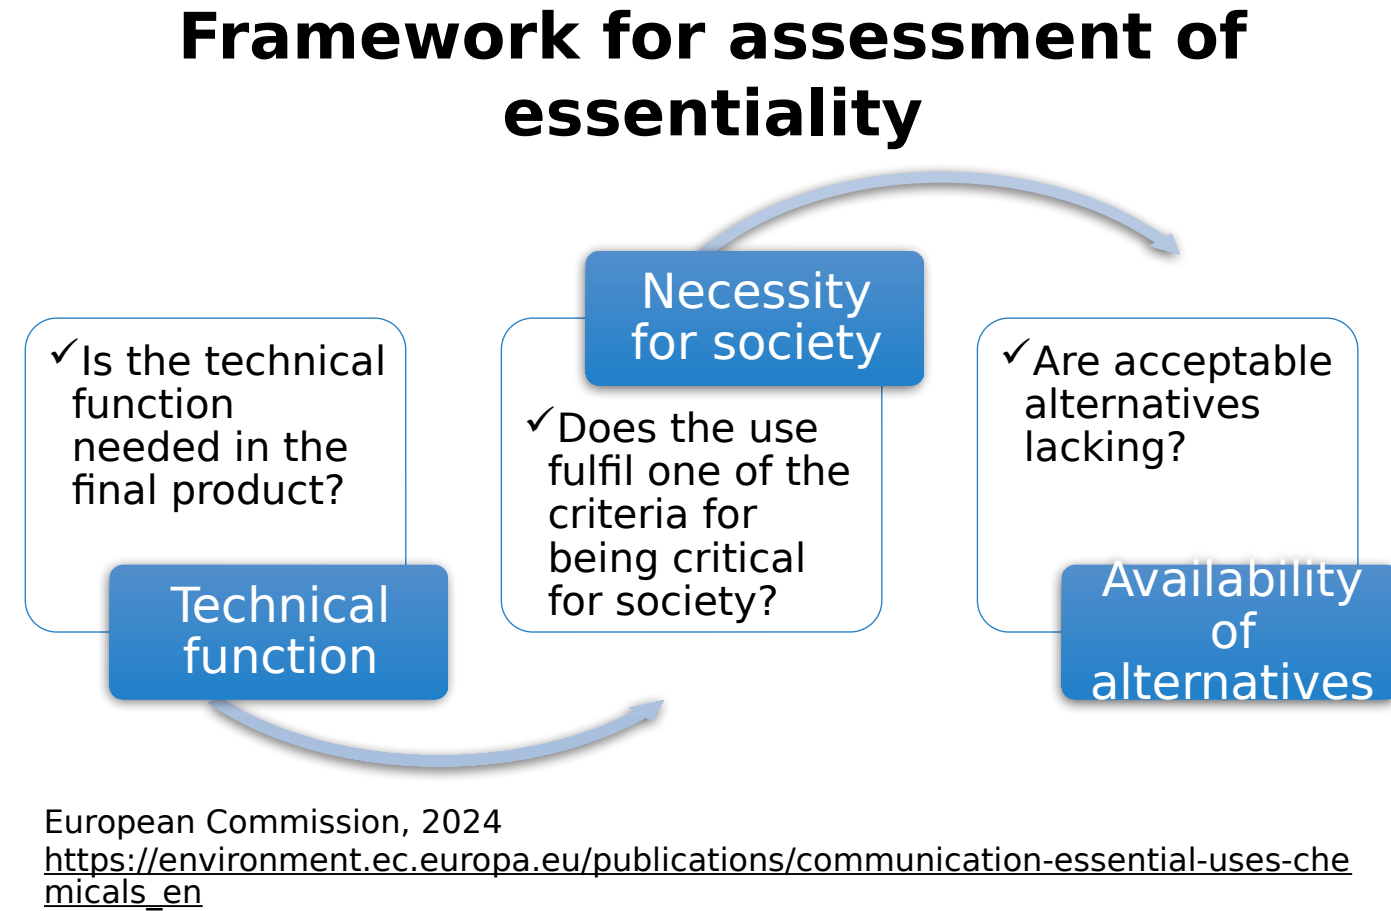

CASE_008

GT页码：6, 20

编辑指令：在第6页出版语言图表中，将英语占比从64%改为45%、芬兰语占比从25%改为44%；同步更新所有相关文字引用，包括后面的政策讨论，其他小语种类别保持不变。




Publishing activity of Finnish universities - languages

- From the total number of publications **64 %** were written in English.
- 25 %** in Finnish




Publishing activity of Finnish universities - languages

- From the total number of publications **45 %** were written in English.
- 44 %** in Finnish

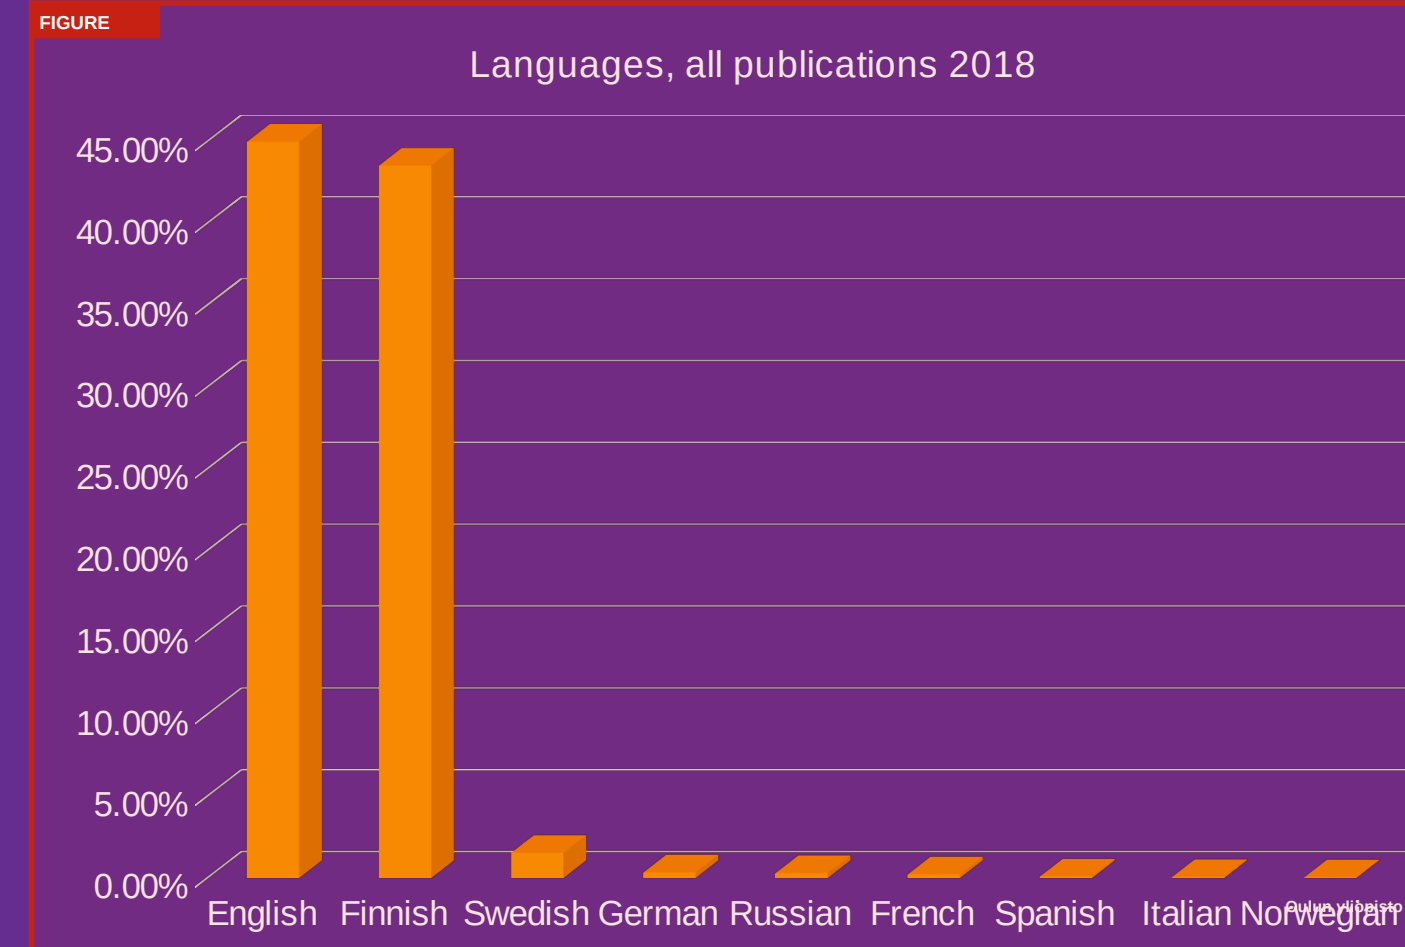

Publishing activity of Finnish universities - languages

- From the total number of publications **45 %** were written in English.
- 44 %** in Finnish

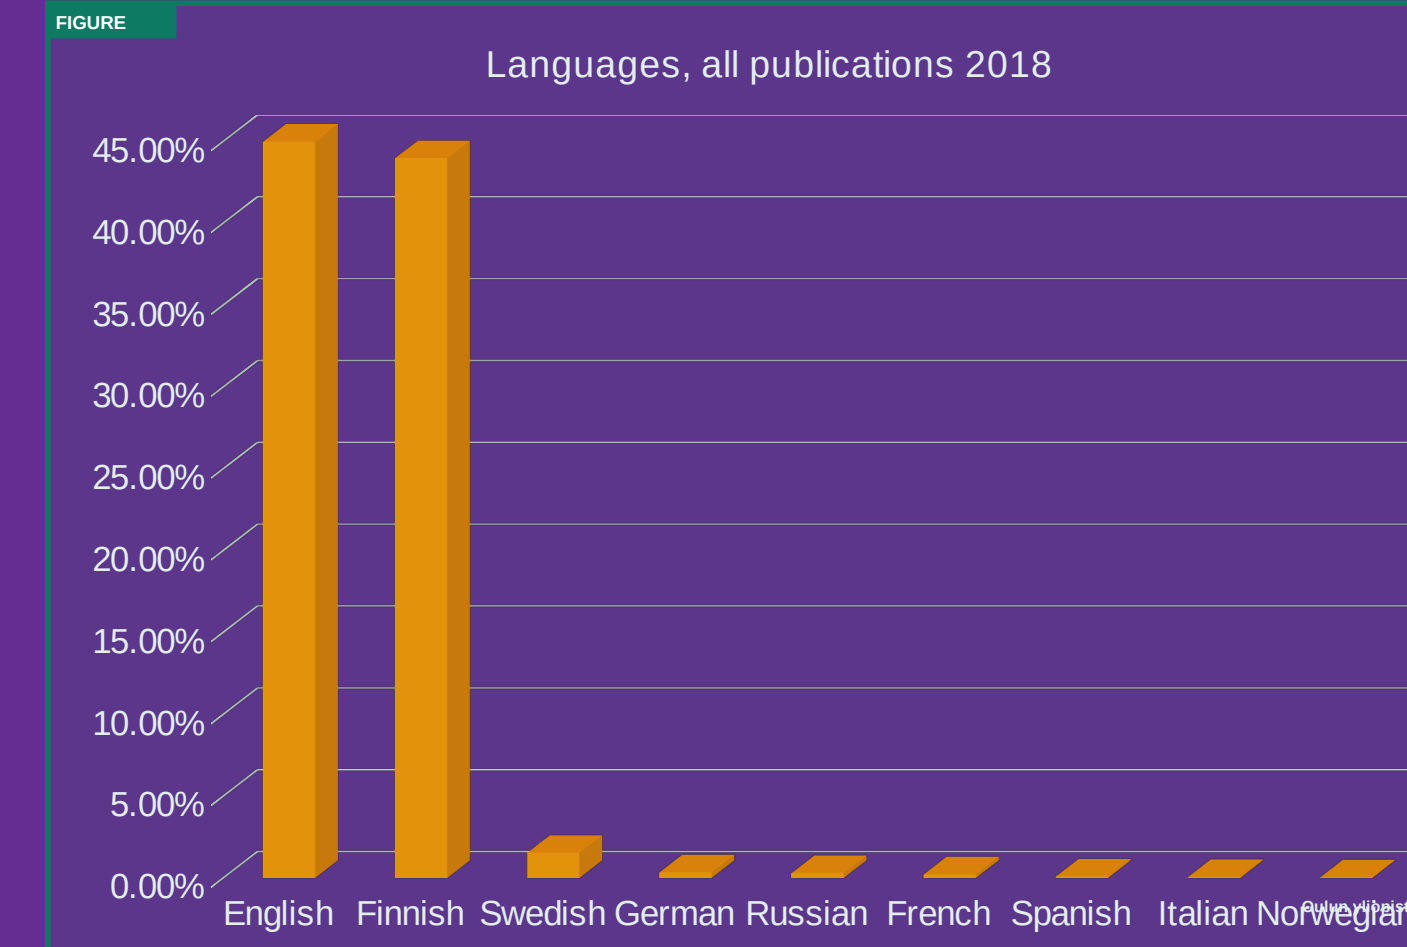



The pressure for finding a national solution for Open Access is growing.

But national languages and locally important research must be kept alive!

Important questions:

The language chart shows that 64% of publications are in English and 25% are in Finnish; this imbalance underscores why national languages must be protected in the transition to open access.

Will national publishers and learned societies survive in fully open publishing environment?

Where will the money come from when there ´s no paying subscribers?

In Finland, the government is not willing to fund publishers no more than they already do. Will we find a common understanding inside the scholarly community?



The pressure for finding a national solution for Open Access is growing.

But national languages and locally important research must be kept alive!

Important questions:

The language chart shows that 45% of publications are in English and 44% are in Finnish; this imbalance underscores why national languages must be protected in the transition to open access.

Will national publishers and learned societies survive in fully open publishing environment?

Where will the money come from when there ´s no paying subscribers?

In Finland, the government is not willing to fund publishers no more than they already do. Will we find a common understanding inside the scholarly community?



The pressure for finding a national solution for Open Access is growing.

But national languages and locally important research must be kept alive!

Important questions:

The language chart shows that 45% of publications are in English and 44% are in Finnish; this near-even split highlights the importance of national languages in the transition to open access.

Will national publishers and learned societies survive in fully open publishing environment?




Where will the money come from when there ´s no paying subscribers?

In Finland, the government is not willing to fund publishers no more than they already do. Will we find a common understanding inside the scholarly community?

CASE_009

GT页码：5, 9

编辑指令：在第5页跨城市CAM使用情况图表中，将新德里选择瑜伽的受访者数量从78改为40；同步更新结论中的文字引用，其他城市和实践项目保持不变。

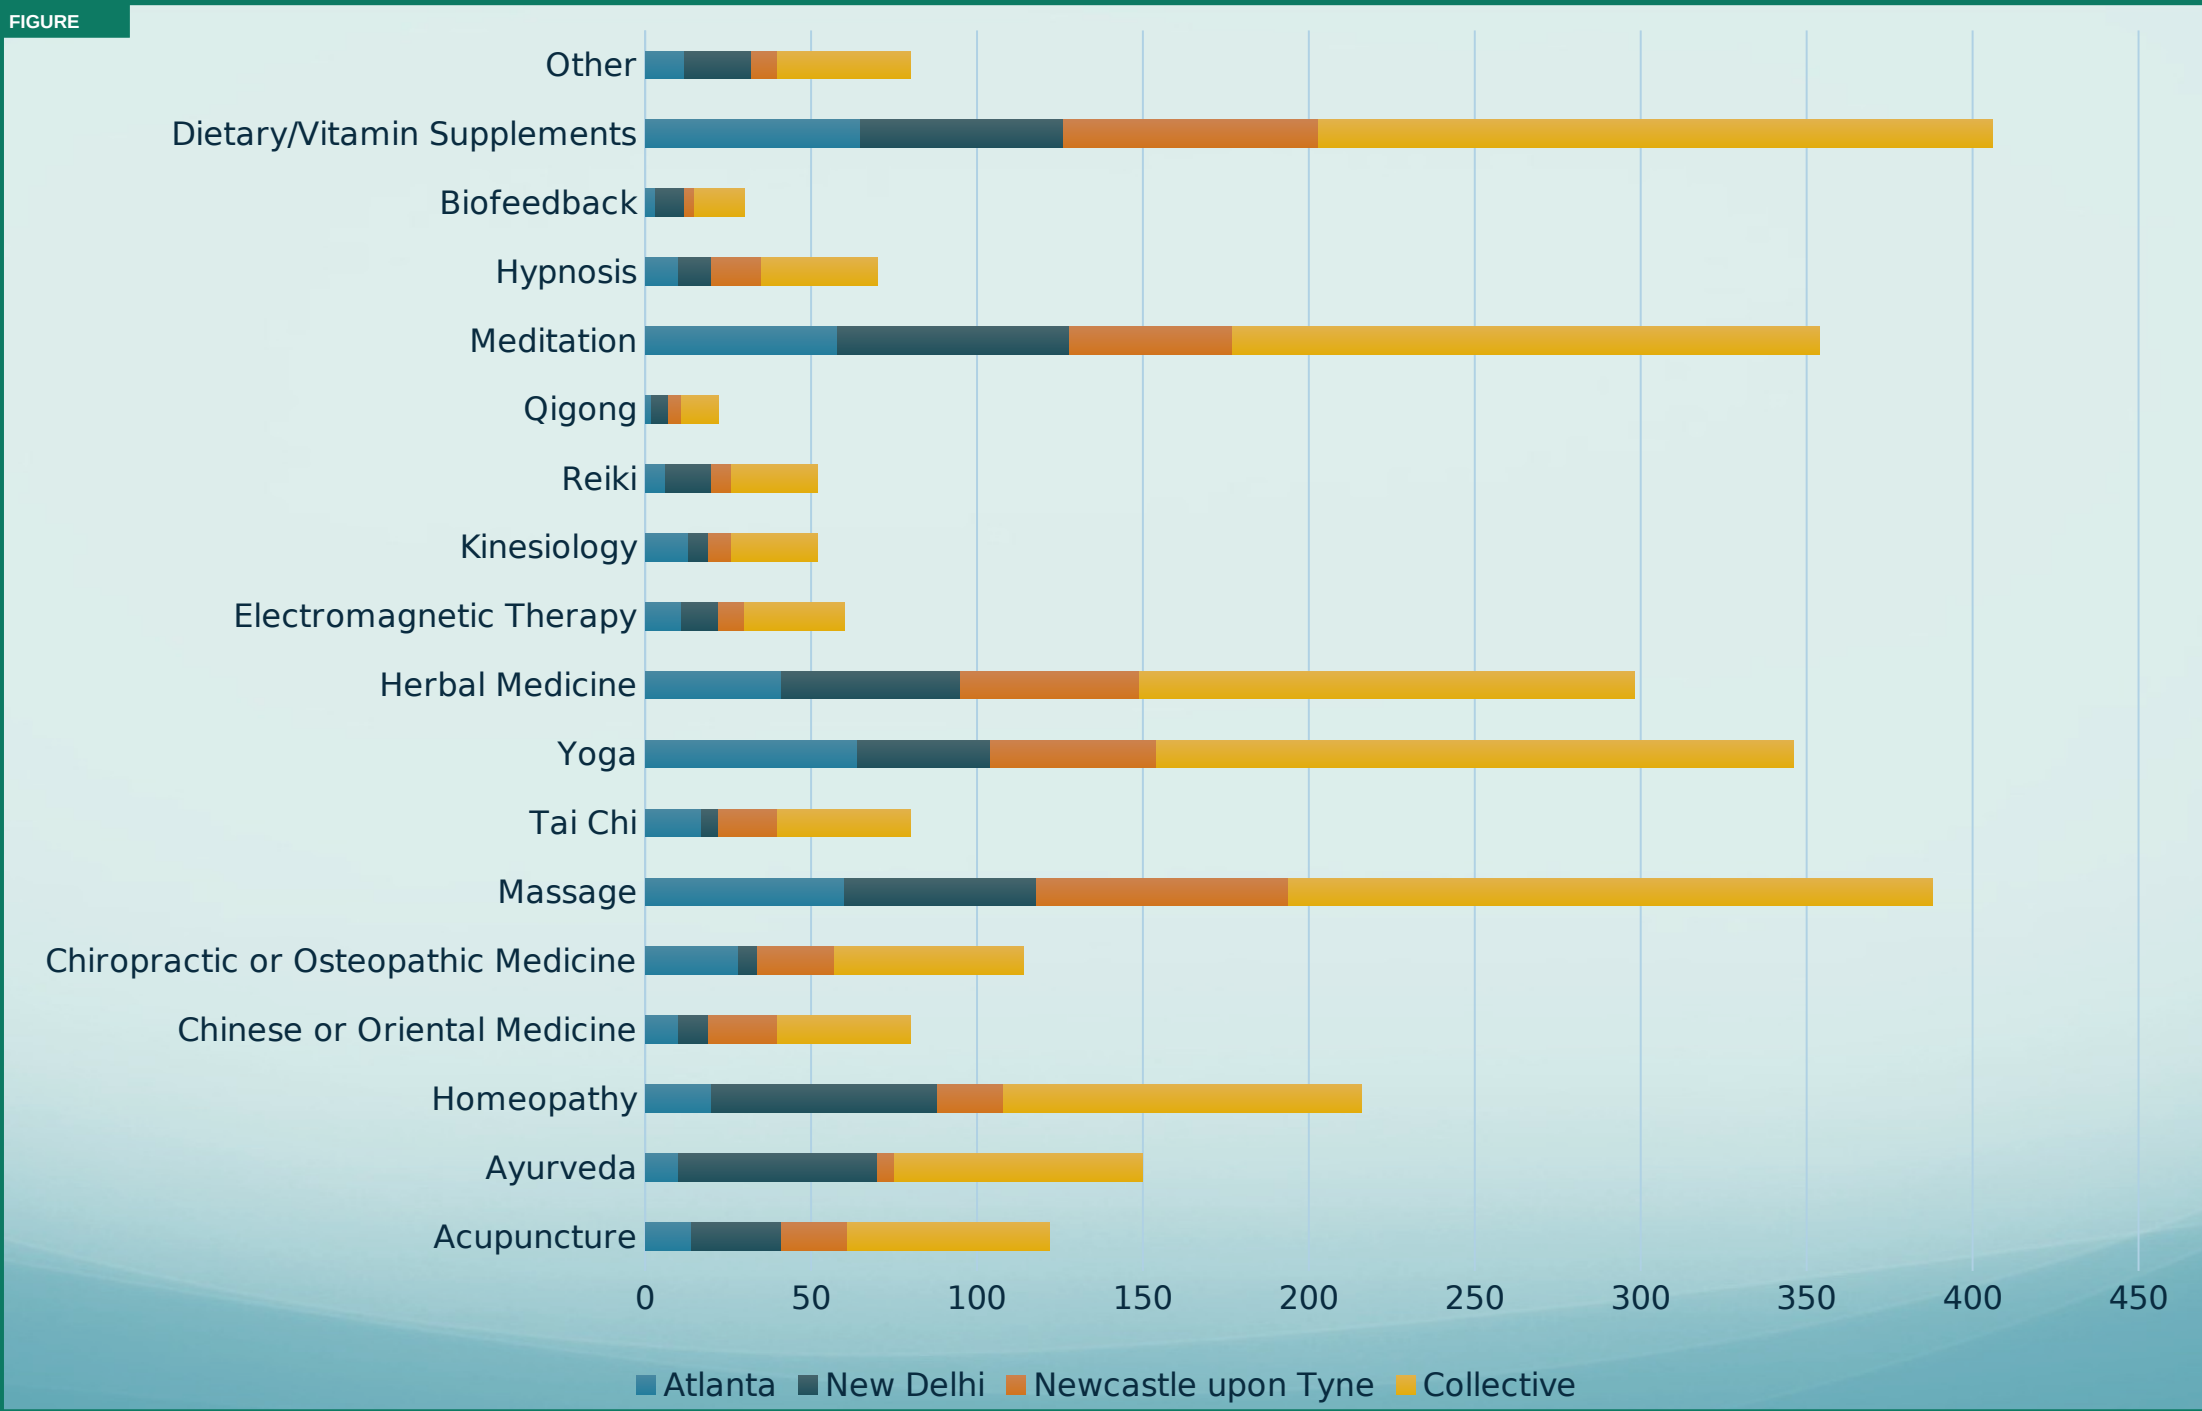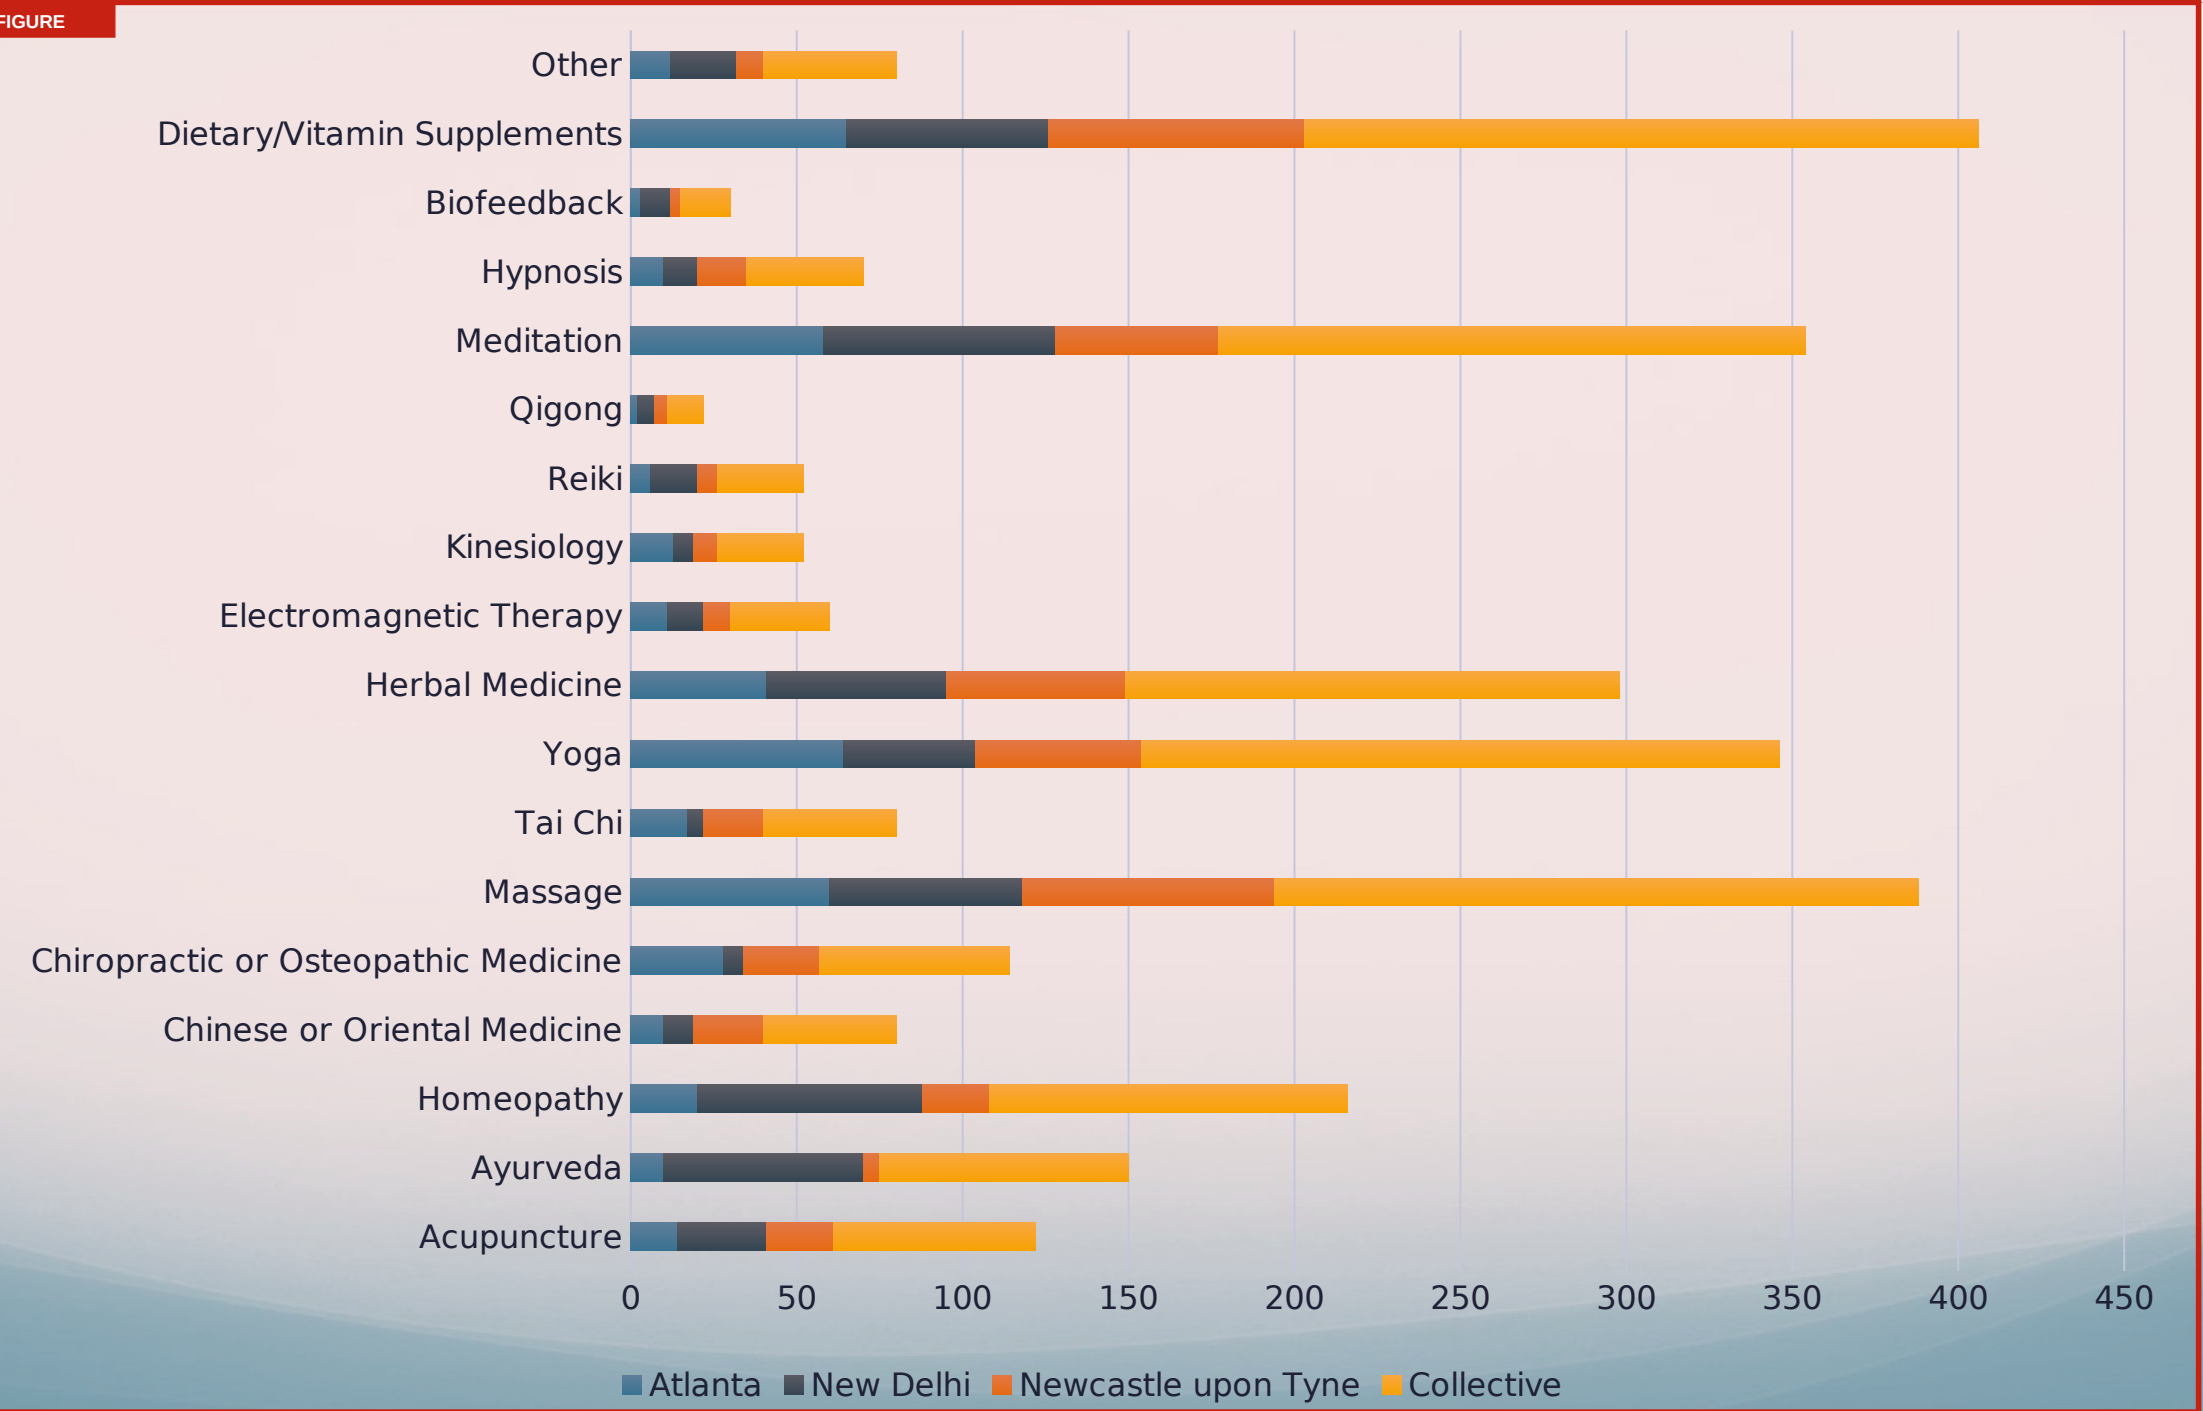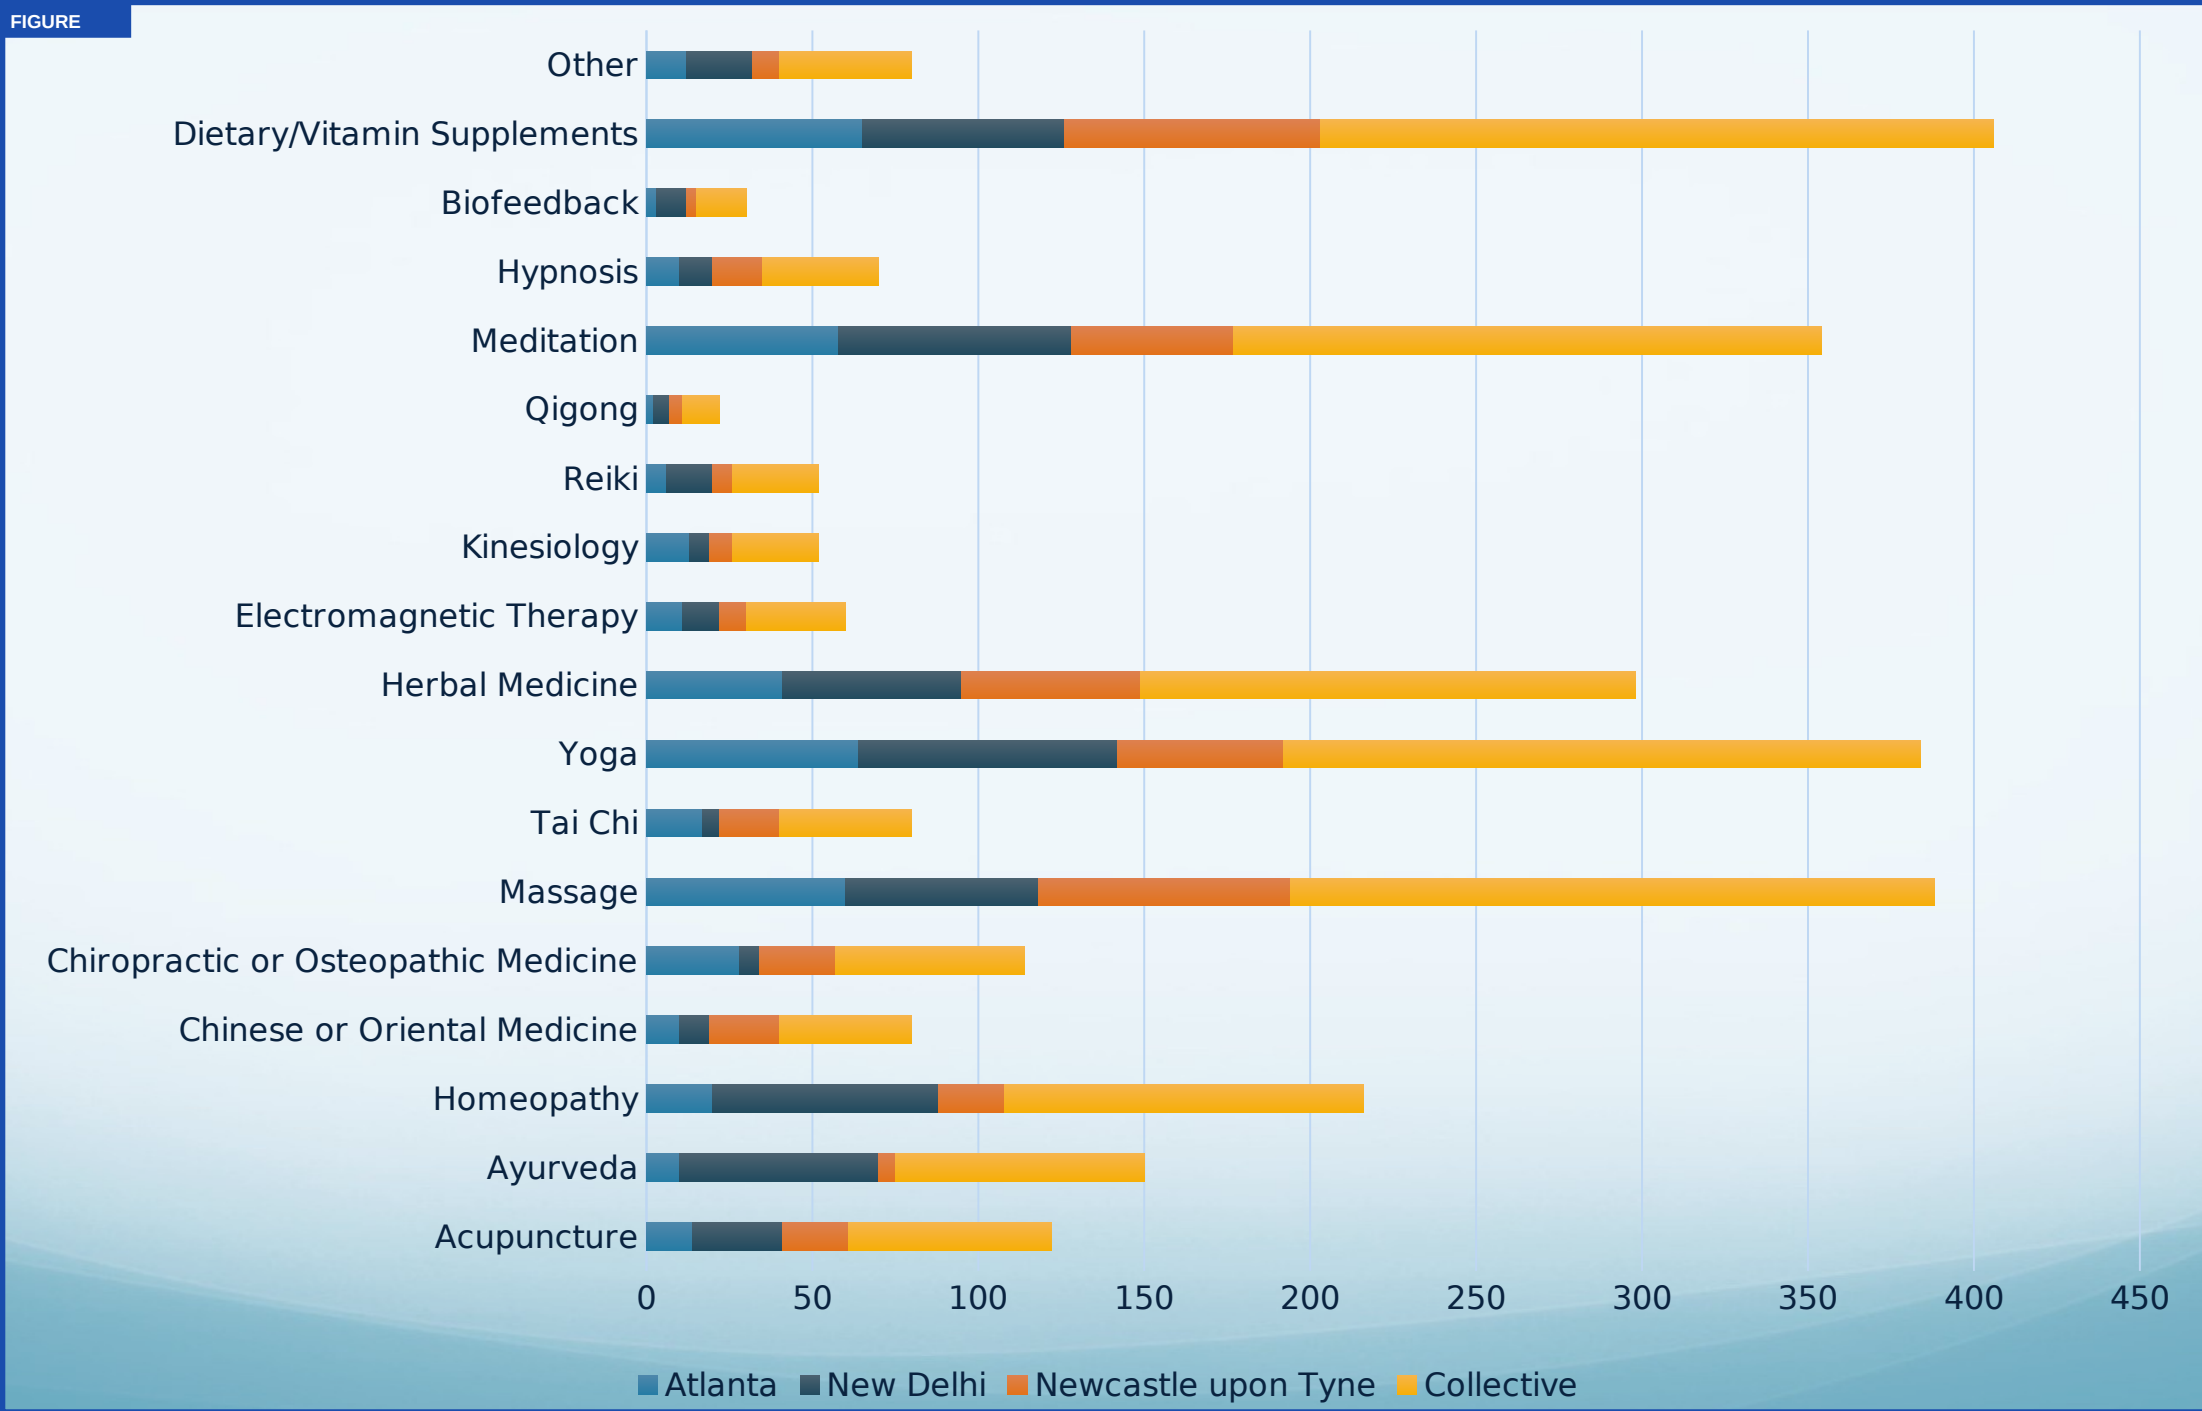

Conclusion

- ❖ Student interest in promoting self care and preventative medicine could be seen in their selection and usage of CAM therapies.
- ❖ **Although some students tried CAM to address a health concern they had, majority of them used CAM for other reasons.**
- ❖ **In India, CAM has a financial advantage of costing less than conventional medicine.** Many Indians never receive the services of allopathic physicians at all.
- ❖ But in Western countries with socialized healthcare systems and prevalent medical insurance policies, CAM practices have a higher out-of-pocket expense, hence it is less popular. However, more prevalent CAM practices were those that cost less than others including dietary and vitamin supplements, yoga, and meditation.
- ❖ The cross-city usage chart reports 78 New Delhi respondents selecting yoga.

Conclusion

- ❖ Student interest in promoting self care and preventative medicine could be seen in their selection and usage of CAM therapies.
- ❖ **Although some students tried CAM to address a health concern they had, majority of them used CAM for other reasons.**
- ❖ **In India, CAM has a financial advantage of costing less than conventional medicine.** Many Indians never receive the services of allopathic physicians at all.
- ❖ But in Western countries with socialized healthcare systems and prevalent medical insurance policies, CAM practices have a higher out-of-pocket expense, hence it is less popular. However, more prevalent CAM practices were those that cost less than others including dietary and vitamin supplements, yoga, and meditation.
- ❖ The cross-city usage chart reports 40 New Delhi respondents selecting yoga.

Conclusion

- ❖ Student interest in promoting self care and preventative medicine could be seen in their selection and usage of CAM therapies.
- ❖ **Although some students tried CAM to address a health concern they had, majority of them used CAM for other reasons.**
- ❖ **In India, CAM has a financial advantage of costing less than conventional medicine.** Many Indians never receive the services of allopathic physicians at all.
- ❖ But in Western countries with socialized healthcare systems and prevalent medical insurance policies, CAM practices have a higher out-of-pocket expense, hence it is less popular. However, more prevalent CAM practices were those that cost less than others including dietary and vitamin supplements, yoga, and meditation.
- ❖ The cross-city usage chart reports 40 New Delhi respondents selecting yoga.

CASE_010

GT页码：2, 12

编辑指令：在第12页免疫阶段图表中，将12名受访者从麻疹重新分配到DPT 3/Polio 4：DPT 3/Polio 4从24改为36，麻疹从12改为0；同步更新所有相关文字报告，总样本量和其他阶段保持不变。

Abstract

During the covid-19 pandemic, many parents are worried about providing basic immunizations for their infants. This caused the basic immunization coverage at Gandusari Public Health Service in Blitar Regency in April 2020 to decrease by **4.9%**, and in May 2020 to decrease by **19.7%**. Study objective: relate Covid-19 knowledge to immunization timeliness; the stage chart includes 24 infants due for DPT 3 / Polio 4 and 12 infants due for measles.



Abstract

During the covid-19 pandemic, many parents are worried about providing basic immunizations for their infants. This caused the basic immunization coverage at Gandusari Public Health Service in Blitar Regency in April 2020 to decrease by **4.9%**, and in May 2020 to decrease by **19.7%**. Study objective: relate Covid-19 knowledge to immunization timeliness; the stage chart includes 36 infants due for DPT 3 / Polio 4 and 0 infants due for measles.



Abstract

During the covid-19 pandemic, many parents are worried about providing basic immunizations for their infants. This caused the basic immunization coverage at Gandusari Public Health Service in Blitar Regency in April 2020 to decrease by **4.9%**, and in May 2020 to decrease by **19.7%**. Study objective: relate Covid-19 knowledge to immunization timeliness; the stage chart includes 36 infants due for DPT 3 / Polio 4 and 0 infants due for measles.




Result & Discussion

General Data

- Based on diagram 4, it was found that out of 71 respondents it showed that a number of 24 respondents (34%) were should given DPT 3 Polio 4 to their infants.
- In the maternal and child health handbook, there is a table that lists what types of immunizations in infants should get and at what age immunizations should be done.
- The immunization schedule is made based on the course of the disease, so that when it is given too late, the results are not optimal.

FIGURE

Diagram 4. Types of Immunization

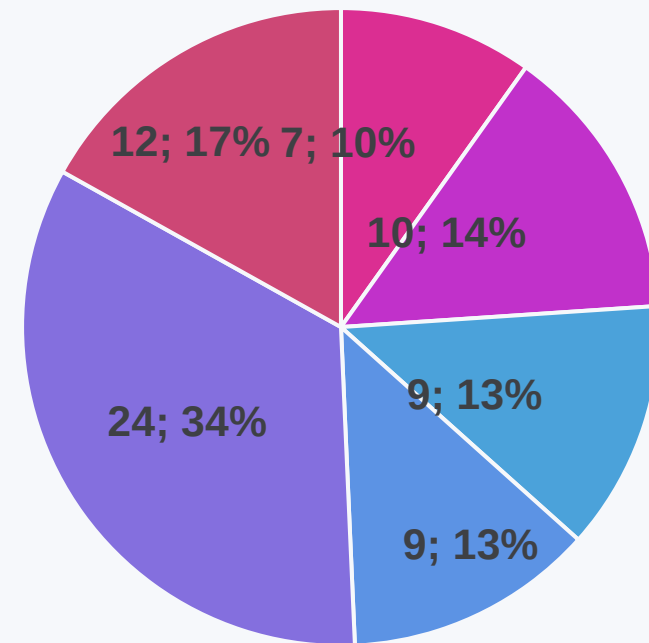

■ Hepatitis 0 ■ BCG Polio 1 ■ DPT 1 Polio 2
■ DPT 2 Polio 3 ■ DPT 3 Polio 4 ■ Measles


Result & Discussion

General Data

- Based on diagram 4, it was found that out of 71 respondents it showed that a number of 36 respondents (51%) were should given DPT 3 Polio 4 to their infants.
- In the maternal and child health handbook, there is a table that lists what types of immunizations in infants should get and at what age immunizations should be done.
- The immunization schedule is made based on the course of the disease, so that when it is given too late, the results are not optimal.

FIGURE

Diagram 4. Types of Immunization

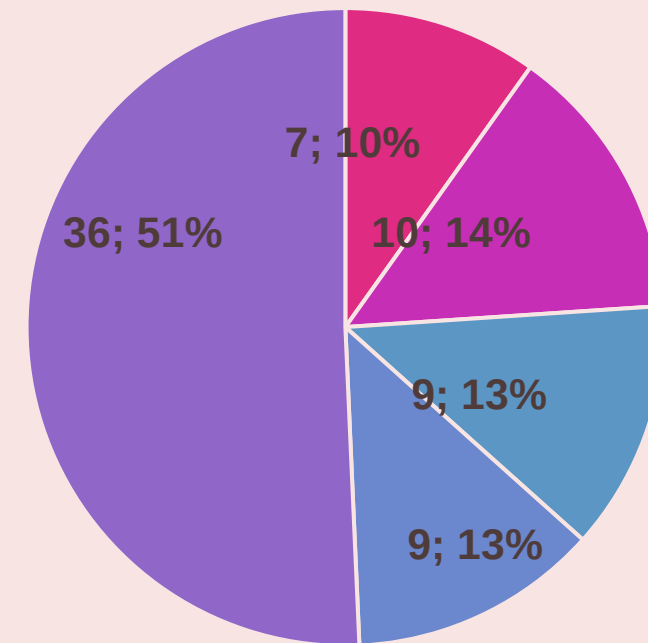

■ Hepatitis 0 ■ BCG Polio 1 ■ DPT 1 Polio 2
■ DPT 2 Polio 3 ■ DPT 3 Polio 4 ■ Measles


Result & Discussion

General Data

- Based on diagram 4, it was found that out of 71 respondents it showed that a number of 36 respondents (51%) were should given DPT 3 Polio 4 to their infants.
- In the maternal and child health handbook, there is a table that lists what types of immunizations in infants should get and at what age immunizations should be done.
- The immunization schedule is made based on the course of the disease, so that when it is given too late, the results are not optimal.

FIGURE

Diagram 4. Types of Immunization

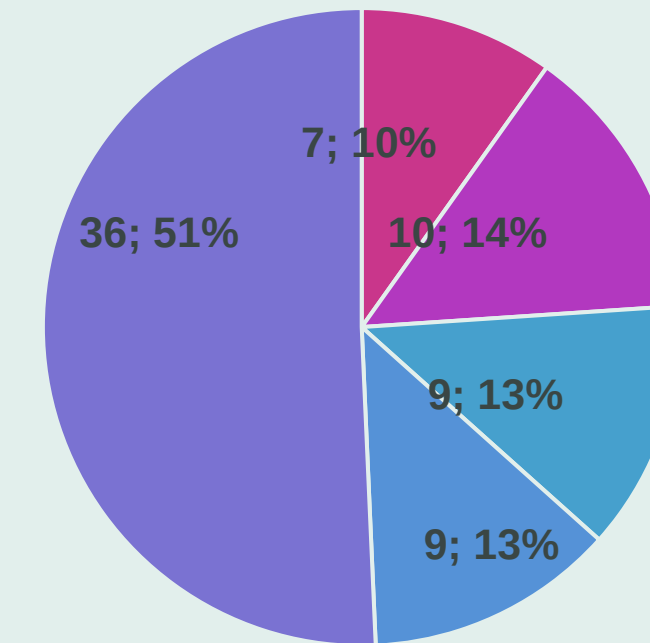

■ Hepatitis 0 ■ BCG Polio 1 ■ DPT 1 Polio 2
■ DPT 2 Polio 3 ■ DPT 3 Polio 4 ■ Measles