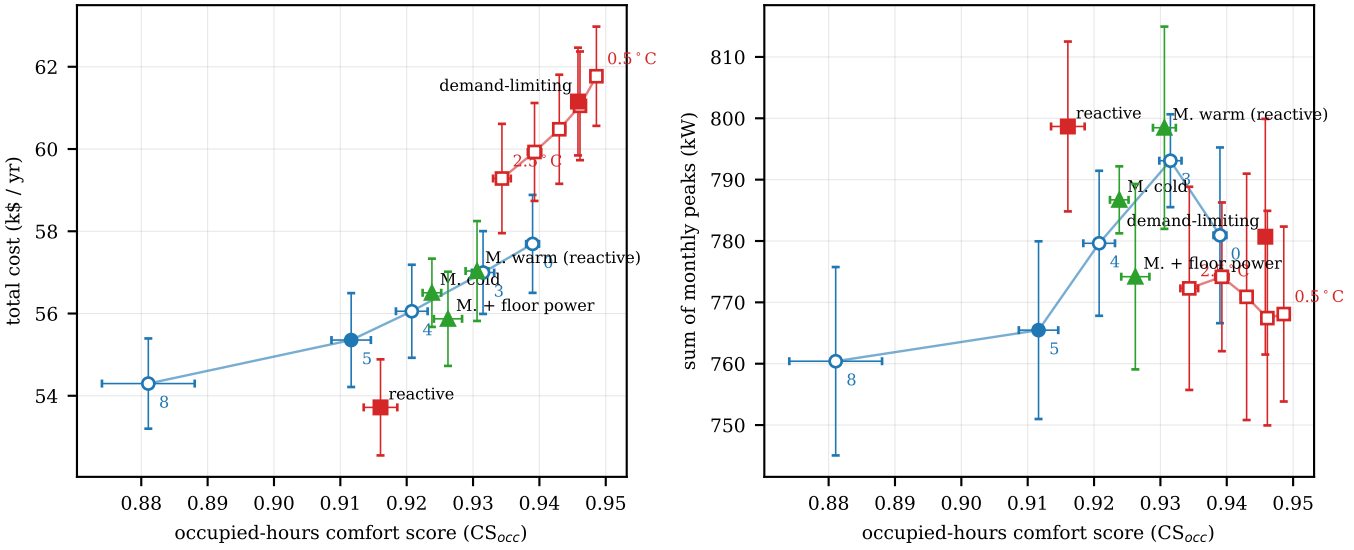
total cost (k$ / yr)
sum of monthly peaks (kW)
occupied-hours comfort score (CS_{occ})
occupied-hours comfort score (CS_{occ})
demand-limiting
0.5 °C
2.5 °C
M. warm (reactive)
M. cold
M. + floor power
reactive
reactive
M. warm (reactive)
M. cold
demand-limiting
M. + floor power
0.5 °C
AIF, congestion weight 0 to 8
RBC proactive, cooling margin 0.5 to 2.5 °C
RBC reactive / demand-limiting
MADDPG (cold, warm reactive, + floor meters)