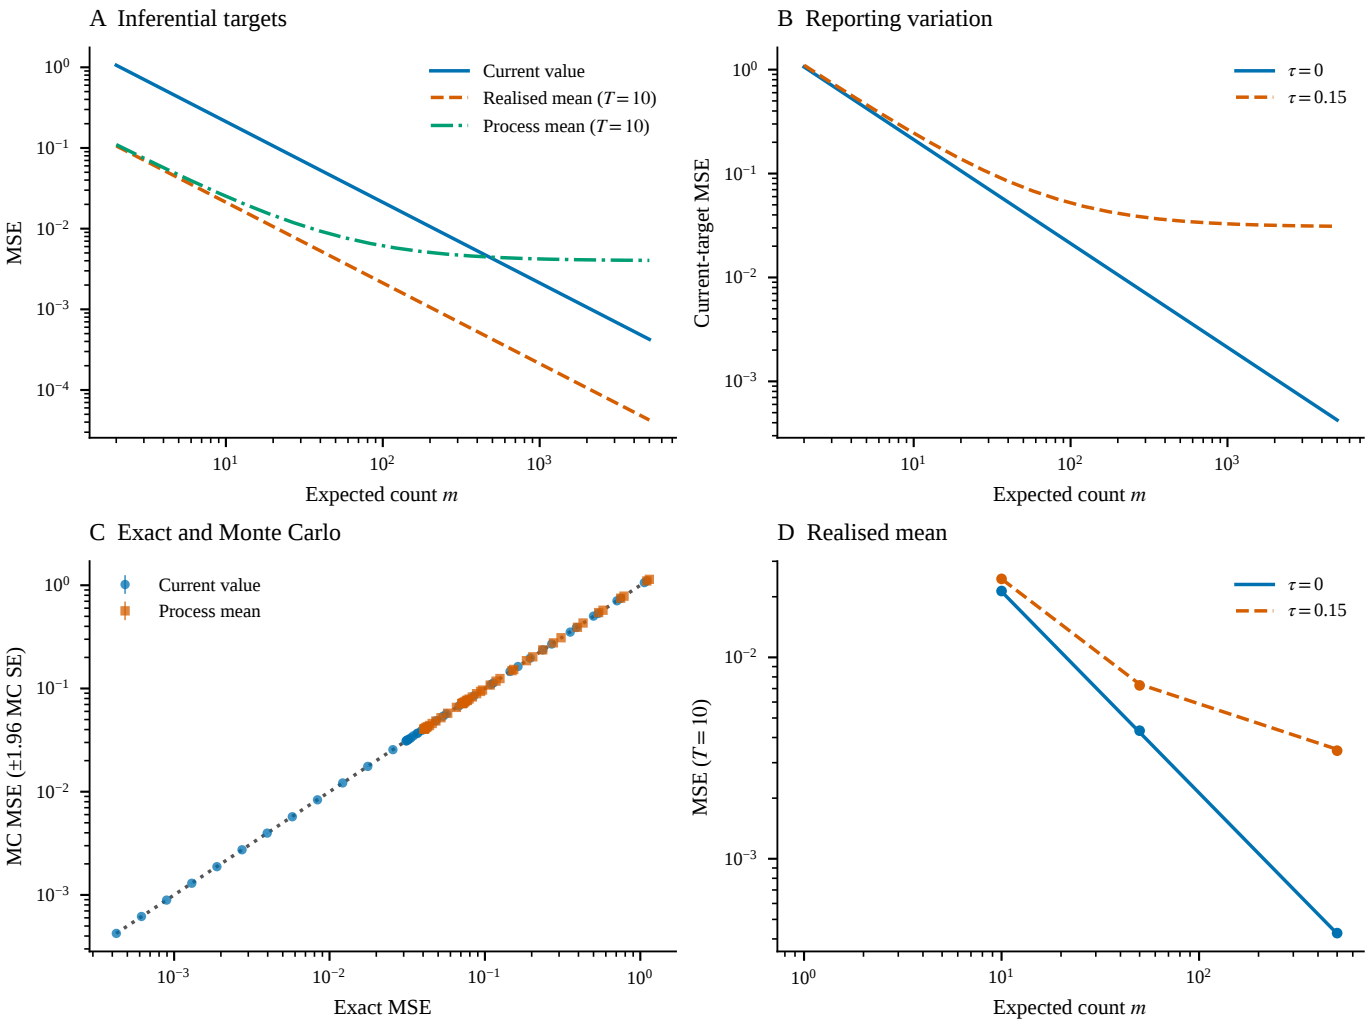
A Inferential targets
Current value
Realised mean ($T = 10$)
Process mean ($T = 10$)
MSE
Expected count m
B Reporting variation
$\tau = 0$
$\tau = 0.15$
Current-target MSE
Expected count m
C Exact and Monte Carlo
Current value
Process mean
MC MSE (±1.96 MC SE)
Exact MSE
D Realised mean
$\tau = 0$
$\tau = 0.15$
MSE ($T = 10$)
Expected count m