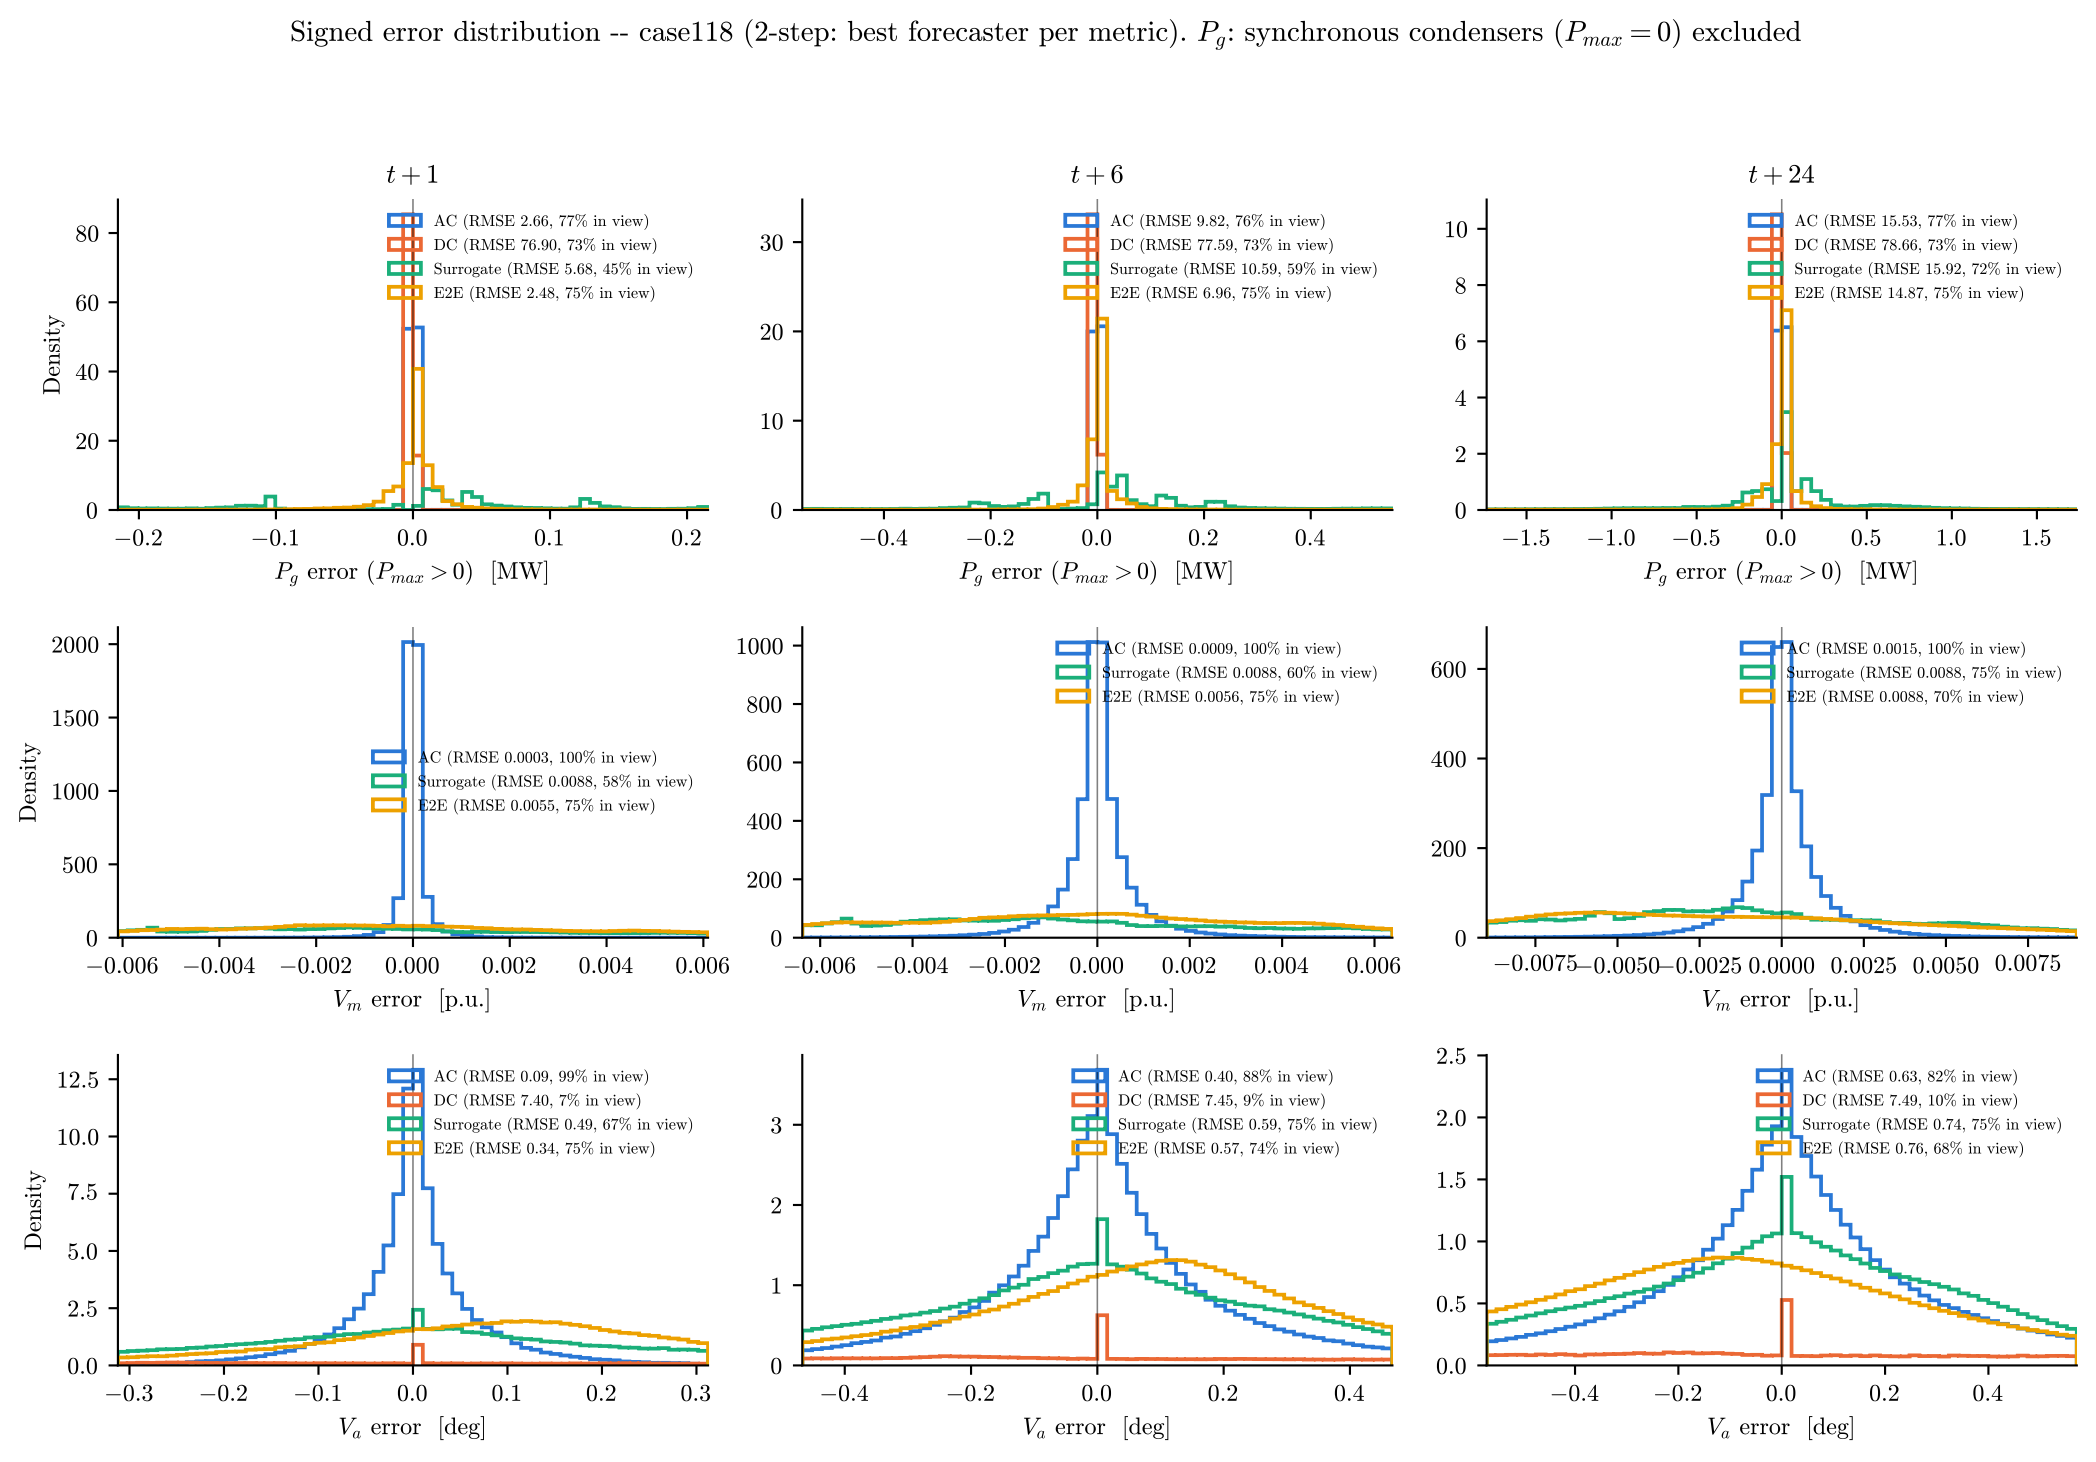

Signed error distribution -- case118 (2-step: best forecaster per metric). P_g: synchronous condensers ($P_{max} = 0$) excluded
$t+1$
$t+6$
$t+24$
Density
AC (RMSE 2.66, 77% in view)
DC (RMSE 76.90, 73% in view)
Surrogate (RMSE 5.68, 45% in view)
E2E (RMSE 2.48, 75% in view)
AC (RMSE 9.82, 76% in view)
DC (RMSE 77.59, 73% in view)
Surrogate (RMSE 10.59, 59% in view)
E2E (RMSE 6.96, 75% in view)
AC (RMSE 15.53, 77% in view)
DC (RMSE 78.66, 73% in view)
Surrogate (RMSE 15.92, 72% in view)
E2E (RMSE 14.87, 75% in view)
P_g error ($P_{max} > 0$) [MW]
AC (RMSE 0.0003, 100% in view)
Surrogate (RMSE 0.0088, 58% in view)
E2E (RMSE 0.0055, 75% in view)
AC (RMSE 0.0009, 100% in view)
Surrogate (RMSE 0.0088, 60% in view)
E2E (RMSE 0.0056, 75% in view)
AC (RMSE 0.0015, 100% in view)
Surrogate (RMSE 0.0088, 75% in view)
E2E (RMSE 0.0088, 70% in view)
V_m error [p.u.]
AC (RMSE 0.09, 99% in view)
DC (RMSE 7.40, 7% in view)
Surrogate (RMSE 0.49, 67% in view)
E2E (RMSE 0.34, 75% in view)
AC (RMSE 0.40, 88% in view)
DC (RMSE 7.45, 9% in view)
Surrogate (RMSE 0.59, 75% in view)
E2E (RMSE 0.57, 74% in view)
AC (RMSE 0.63, 82% in view)
DC (RMSE 7.49, 10% in view)
Surrogate (RMSE 0.74, 75% in view)
E2E (RMSE 0.76, 68% in view)
V_a error [deg]