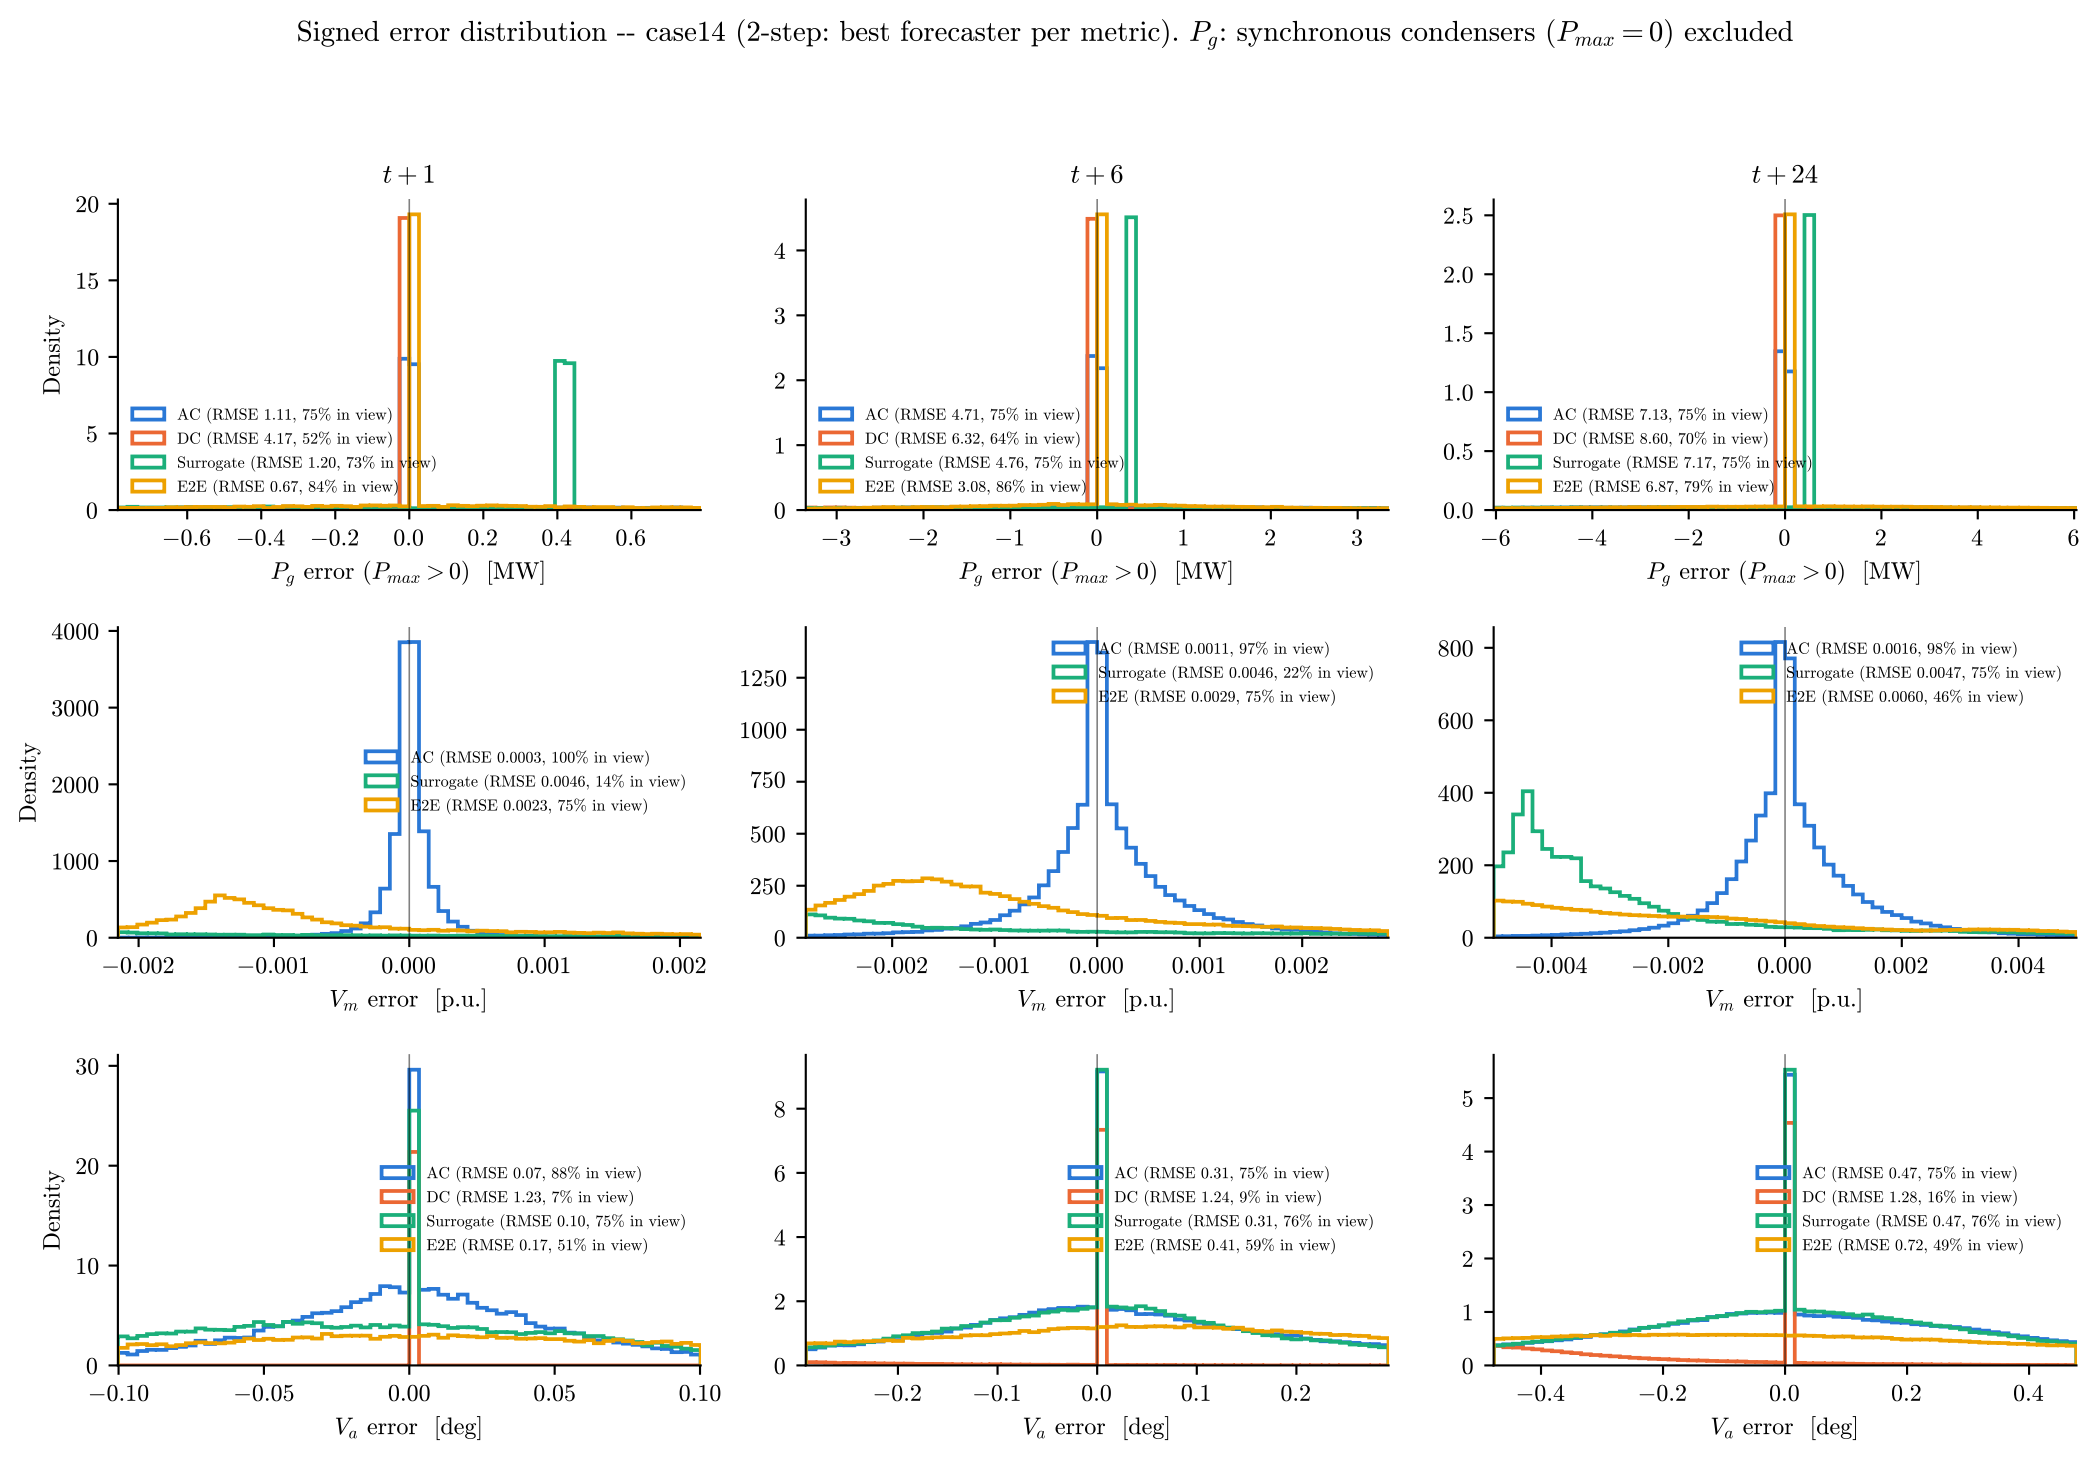

Signed error distribution -- case14 (2-step: best forecaster per metric). P_g: synchronous condensers ($P_{max} = 0$) excluded
$t+1$
$t+6$
$t+24$
Density
AC (RMSE 1.11, 75% in view)
DC (RMSE 4.17, 52% in view)
Surrogate (RMSE 1.20, 73% in view)
E2E (RMSE 0.67, 84% in view)
P_g error ($P_{max} > 0$) [MW]
AC (RMSE 4.71, 75% in view)
DC (RMSE 6.32, 64% in view)
Surrogate (RMSE 4.76, 75% in view)
E2E (RMSE 3.08, 86% in view)
P_g error ($P_{max} > 0$) [MW]
AC (RMSE 7.13, 75% in view)
DC (RMSE 8.60, 70% in view)
Surrogate (RMSE 7.17, 75% in view)
E2E (RMSE 6.87, 79% in view)
P_g error ($P_{max} > 0$) [MW]
Density
AC (RMSE 0.0003, 100% in view)
Surrogate (RMSE 0.0046, 14% in view)
E2E (RMSE 0.0023, 75% in view)
V_m error [p.u.]
AC (RMSE 0.0011, 97% in view)
Surrogate (RMSE 0.0046, 22% in view)
E2E (RMSE 0.0029, 75% in view)
V_m error [p.u.]
AC (RMSE 0.0016, 98% in view)
Surrogate (RMSE 0.0047, 75% in view)
E2E (RMSE 0.0060, 46% in view)
V_m error [p.u.]
Density
AC (RMSE 0.07, 88% in view)
DC (RMSE 1.23, 7% in view)
Surrogate (RMSE 0.10, 75% in view)
E2E (RMSE 0.17, 51% in view)
V_a error [deg]
AC (RMSE 0.31, 75% in view)
DC (RMSE 1.24, 9% in view)
Surrogate (RMSE 0.31, 76% in view)
E2E (RMSE 0.41, 59% in view)
V_a error [deg]
AC (RMSE 0.47, 75% in view)
DC (RMSE 1.28, 16% in view)
Surrogate (RMSE 0.47, 76% in view)
E2E (RMSE 0.72, 49% in view)
V_a error [deg]