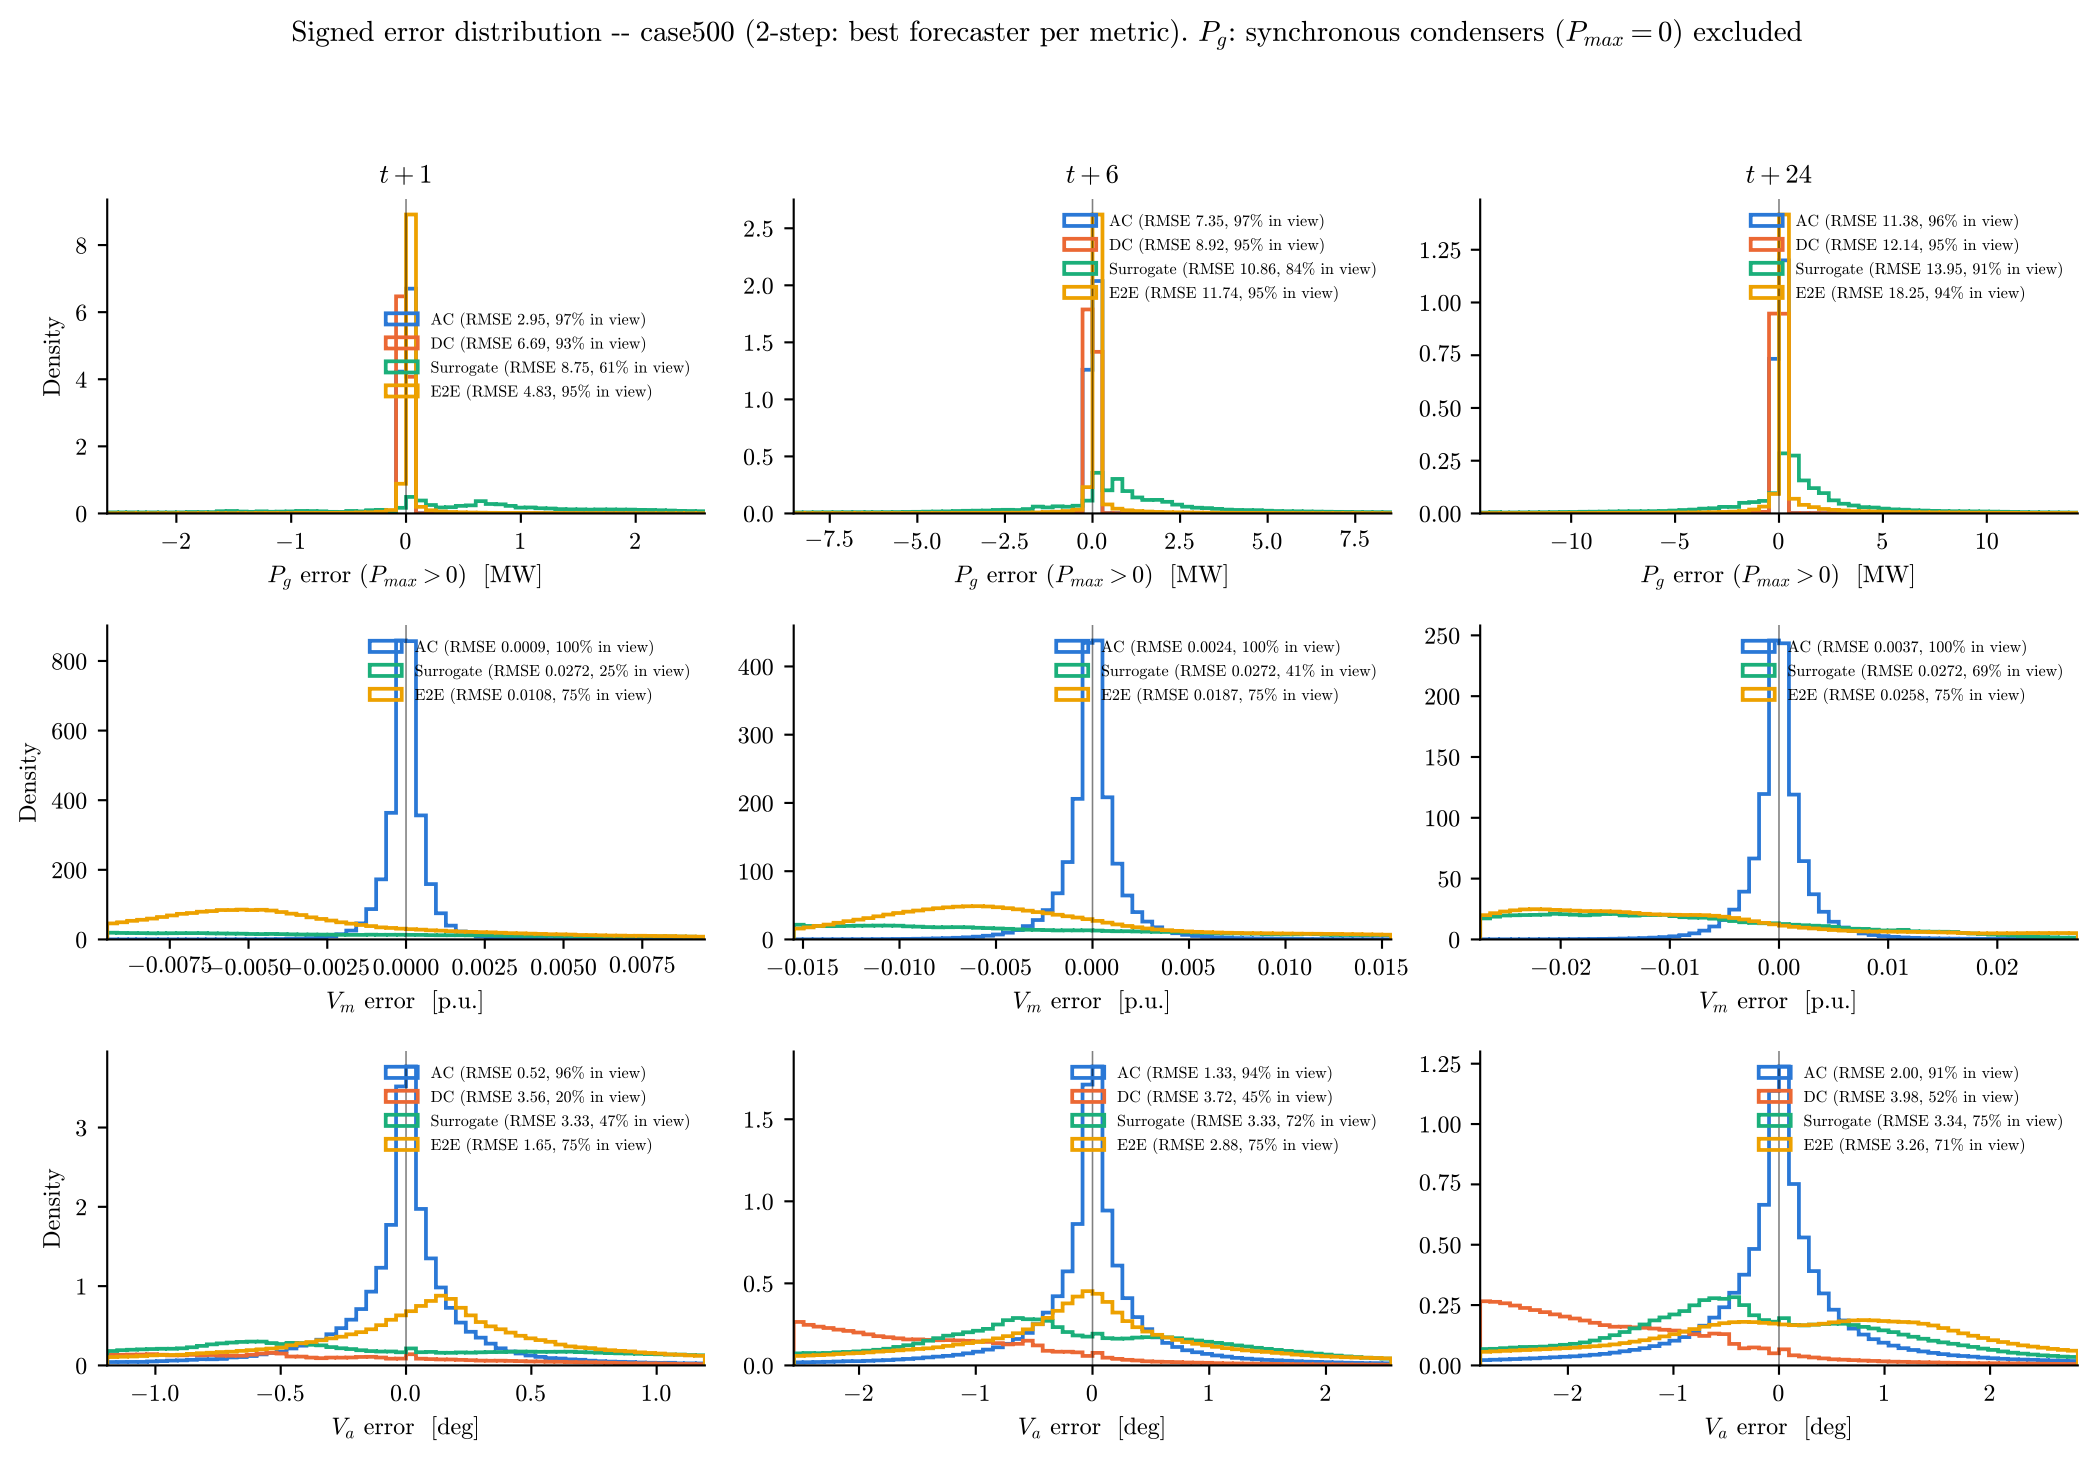

Signed error distribution -- case500 (2-step: best forecaster per metric). $P_g$: synchronous condensers ($P_{max} = 0$) excluded
$t+1$
$t+6$
$t+24$
Density
AC (RMSE 2.95, 97% in view)
DC (RMSE 6.69, 93% in view)
Surrogate (RMSE 8.75, 61% in view)
E2E (RMSE 4.83, 95% in view)
AC (RMSE 7.35, 97% in view)
DC (RMSE 8.92, 95% in view)
Surrogate (RMSE 10.86, 84% in view)
E2E (RMSE 11.74, 95% in view)
AC (RMSE 11.38, 96% in view)
DC (RMSE 12.14, 95% in view)
Surrogate (RMSE 13.95, 91% in view)
E2E (RMSE 18.25, 94% in view)
$P_g$ error ($P_{max} > 0$) [MW]
AC (RMSE 0.0009, 100% in view)
Surrogate (RMSE 0.0272, 25% in view)
E2E (RMSE 0.0108, 75% in view)
AC (RMSE 0.0024, 100% in view)
Surrogate (RMSE 0.0272, 41% in view)
E2E (RMSE 0.0187, 75% in view)
AC (RMSE 0.0037, 100% in view)
Surrogate (RMSE 0.0272, 69% in view)
E2E (RMSE 0.0258, 75% in view)
$V_m$ error [p.u.]
AC (RMSE 0.52, 96% in view)
DC (RMSE 3.56, 20% in view)
Surrogate (RMSE 3.33, 47% in view)
E2E (RMSE 1.65, 75% in view)
AC (RMSE 1.33, 94% in view)
DC (RMSE 3.72, 45% in view)
Surrogate (RMSE 3.33, 72% in view)
E2E (RMSE 2.88, 75% in view)
AC (RMSE 2.00, 91% in view)
DC (RMSE 3.98, 52% in view)
Surrogate (RMSE 3.34, 75% in view)
E2E (RMSE 3.26, 71% in view)
$V_a$ error [deg]