


```
1  FUNCTION_BLOCK fb_corretor_ph
2  VAR_INPUT
3
4      // bits para a entrada: 0 manual/automatico; 1 val_prod; 2 val_acida; 3
      val_alc; 4 m_mist; 5 val_desc; 6 liga; 7 desliga; 8 sens_min; 9 sens_max
5      sensor_ph : WORD ;
6  END_VAR
7  VAR_IN_OUT
8      comando_sensores : BYTE ;
9      comando_valvulas : BYTE ;
10 END_VAR
11
12 VAR_OUTPUT
13     status_clp : WORD ;
14     // bits de status dos sensores e valvulas: 0 val_prod; 1 val_acida; 2
      valv_alc; 3 m_mist; 4 val_desc; 5 status ligado/desligado
15     valor_ph : WORD ;
16     progresso_mistura : WORD ;
17 END_VAR
18 VAR
19     botao_liga : BOOL ;
20     selo_liga : BOOL ;
21     botao_desliga : BOOL ;
22
23     tp_valvula_acida : TP ;
24     tp_valvula_alcalina : TP ;
25     tp_motor_mistura : TP ;
26     maquinaEstado : fb_maquina_estados ;
27     estado_ph : WORD ;
28     progresso_mistura_real : REAL ;
29
30     modo_manual : BOOL ;
31     cmd_valvula_produto : BOOL ;
32     cmd_motor_mistura : BOOL ;
33     cmd_valvula_descarte : BOOL ;
34     cmd_valvula_acida : BOOL ;
35     cmd_valvula_alcalina : BOOL ;
36
37     sensor_nivel_minimo : BOOL ;
38     sensor_nivel_maximo : BOOL ;
39
40     motor_mistura : BOOL ;
41     valvula_produto : BOOL ;
42     valvula_descarte : BOOL ;
43     valvula_acida : BOOL ;
44     valvula_alcalina : BOOL ;
45 END_VAR
46
```



lvula_produto
— ()

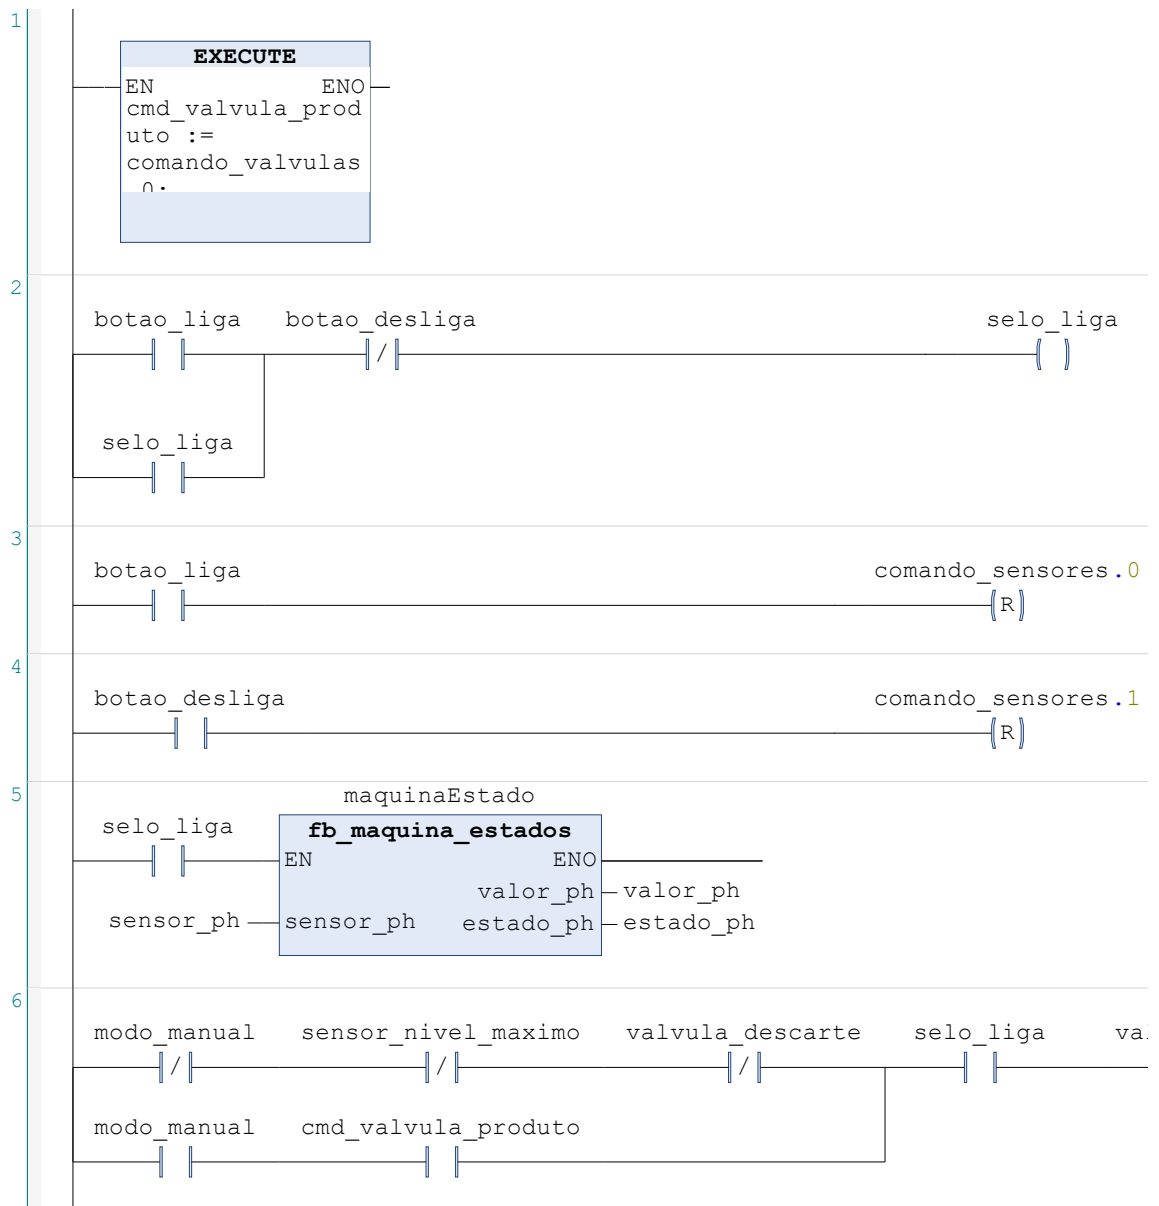