



```
1  PROGRAM PLC_PRG
2  VAR
3      start , emergencia , selo_start : BOOL ;
4      tanque_1 , tanque_2 , tanque_3 : FB_corretor_ph ;
5      sensor_ph_t1 , sensor_ph_t2 , sensor_ph_t3 : WORD ;
6      comando_val_t1 , comando_val_t2 , comando_val_t3 : BYTE ;
7      comando_sens_t1 , comando_sens_t2 , comando_sens_t3 : byte ;
8      status_clp_t1 , status_clp_t2 , status_clp_t3 : word ;
9      valor_ph_t1 , valor_ph_t2 , valor_ph_t3 : WORD ;
10     progresso_mistura_t1 , progresso_mistura_t2 , progresso_mistura_t3 :
11     WORD ;
12 END_VAR
13
```

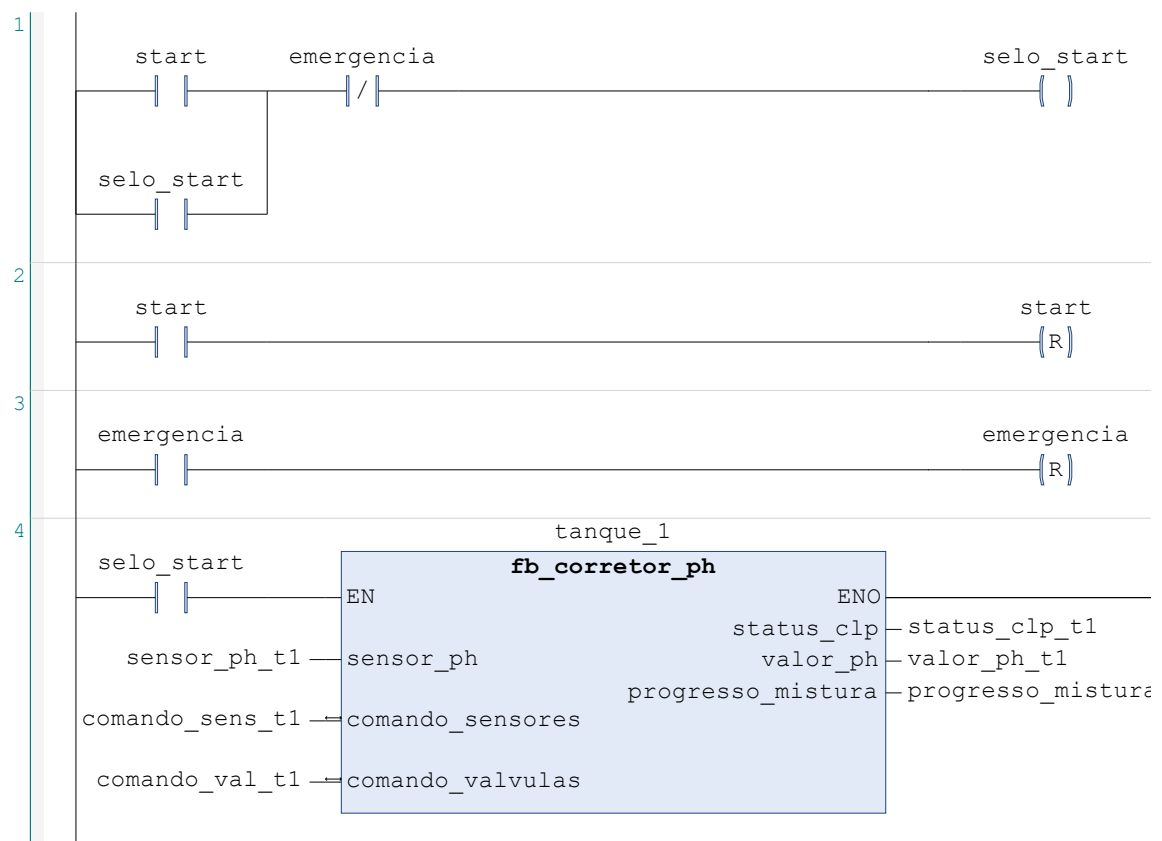

i_t1

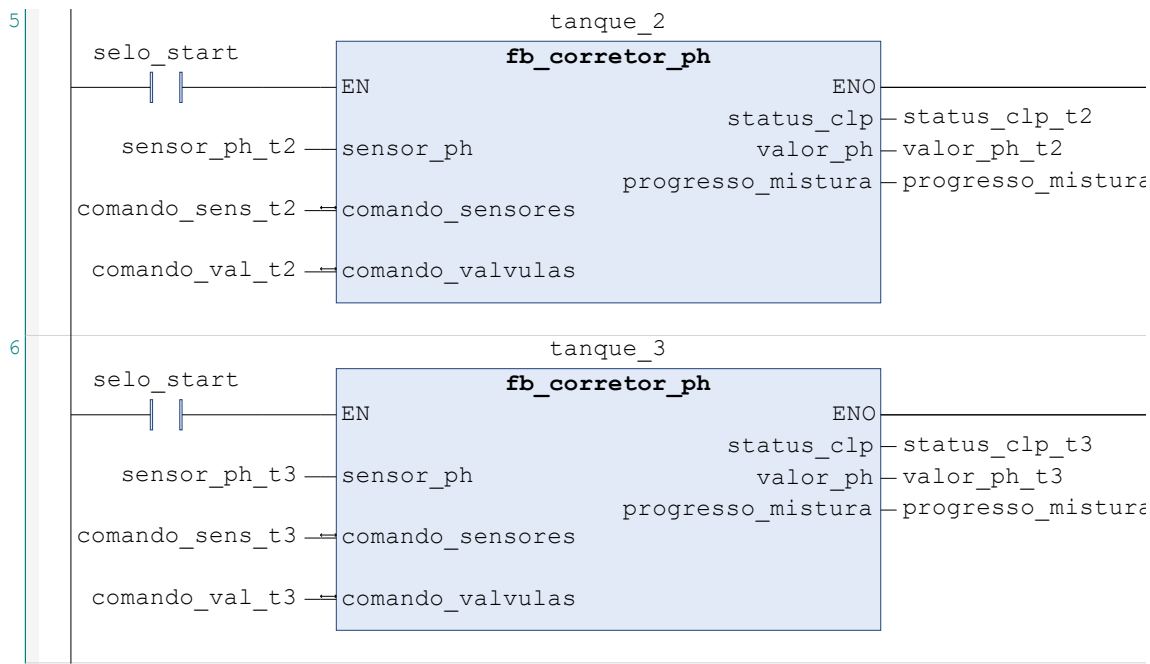

i_t2

i_t3
