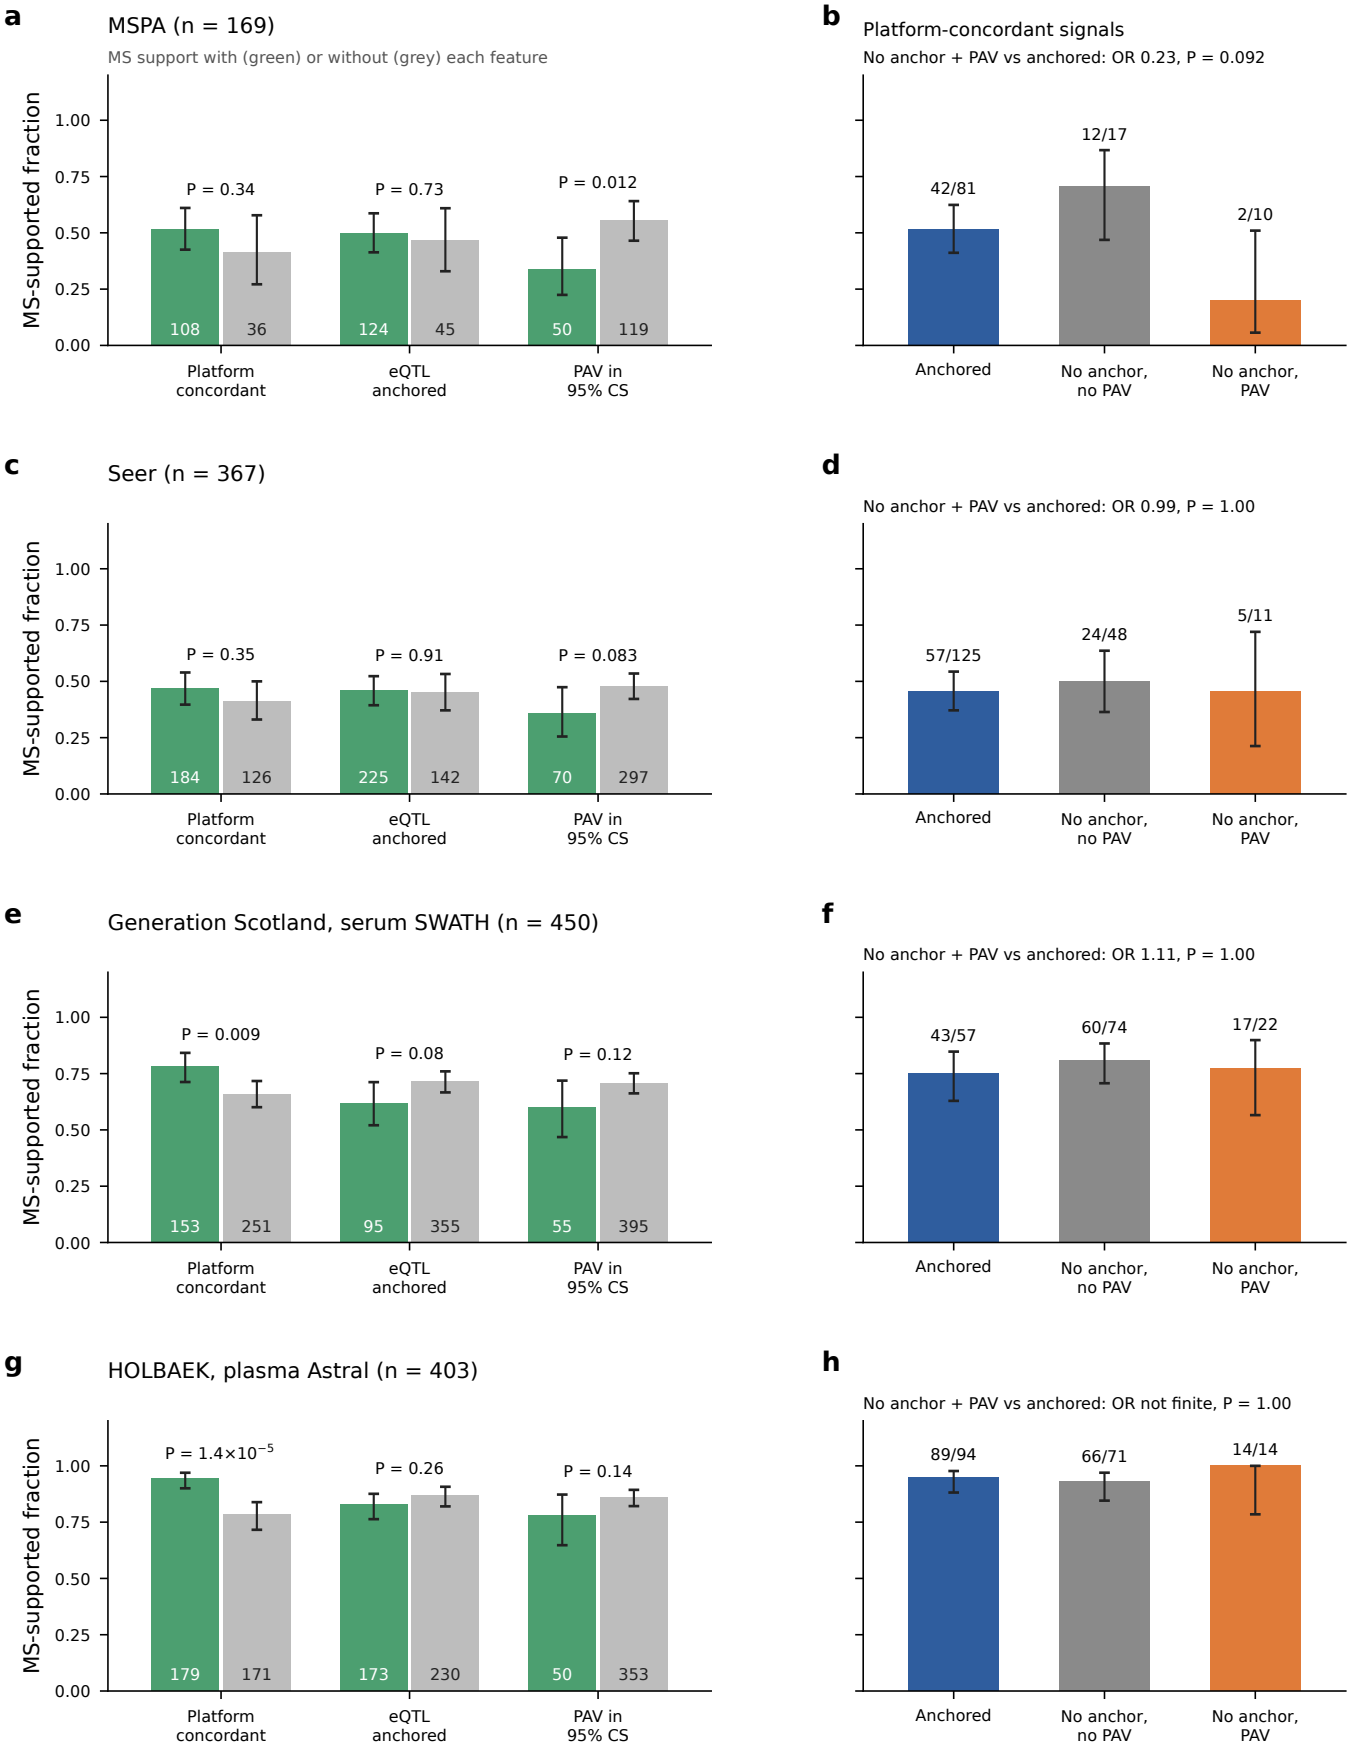
a
MSPA (n = 169)
MS support with (green) or without (grey) each feature
MS-supported fraction
1.00
0.75
0.50
0.25
0.00
P = 0.34
P = 0.73
P = 0.012
108
36
124
45
50
119
Platform concordant
eQTL anchored
PAV in 95% CS
b
Platform-concordant signals
No anchor + PAV vs anchored: OR 0.23, P = 0.092
42/81
12/17
2/10
Anchored
No anchor, no PAV
No anchor, PAV
c
Seer (n = 367)
MS-supported fraction
P = 0.35
P = 0.91
P = 0.083
184
126
225
142
70
297
Platform concordant
eQTL anchored
PAV in 95% CS
d
No anchor + PAV vs anchored: OR 0.99, P = 1.00
57/125
24/48
5/11
Anchored
No anchor, no PAV
No anchor, PAV
e
Generation Scotland, serum SWATH (n = 450)
MS-supported fraction
P = 0.009
P = 0.08
P = 0.12
153
251
95
355
55
395
Platform concordant
eQTL anchored
PAV in 95% CS
f
No anchor + PAV vs anchored: OR 1.11, P = 1.00
43/57
60/74
17/22
Anchored
No anchor, no PAV
No anchor, PAV
g
HOLBAEK, plasma Astral (n = 403)
MS-supported fraction
P = 1.4×10⁻⁵
P = 0.26
P = 0.14
179
171
173
230
50
353
Platform concordant
eQTL anchored
PAV in 95% CS
h
No anchor + PAV vs anchored: OR not finite, P = 1.00
89/94
66/71
14/14
Anchored
No anchor, no PAV
No anchor, PAV