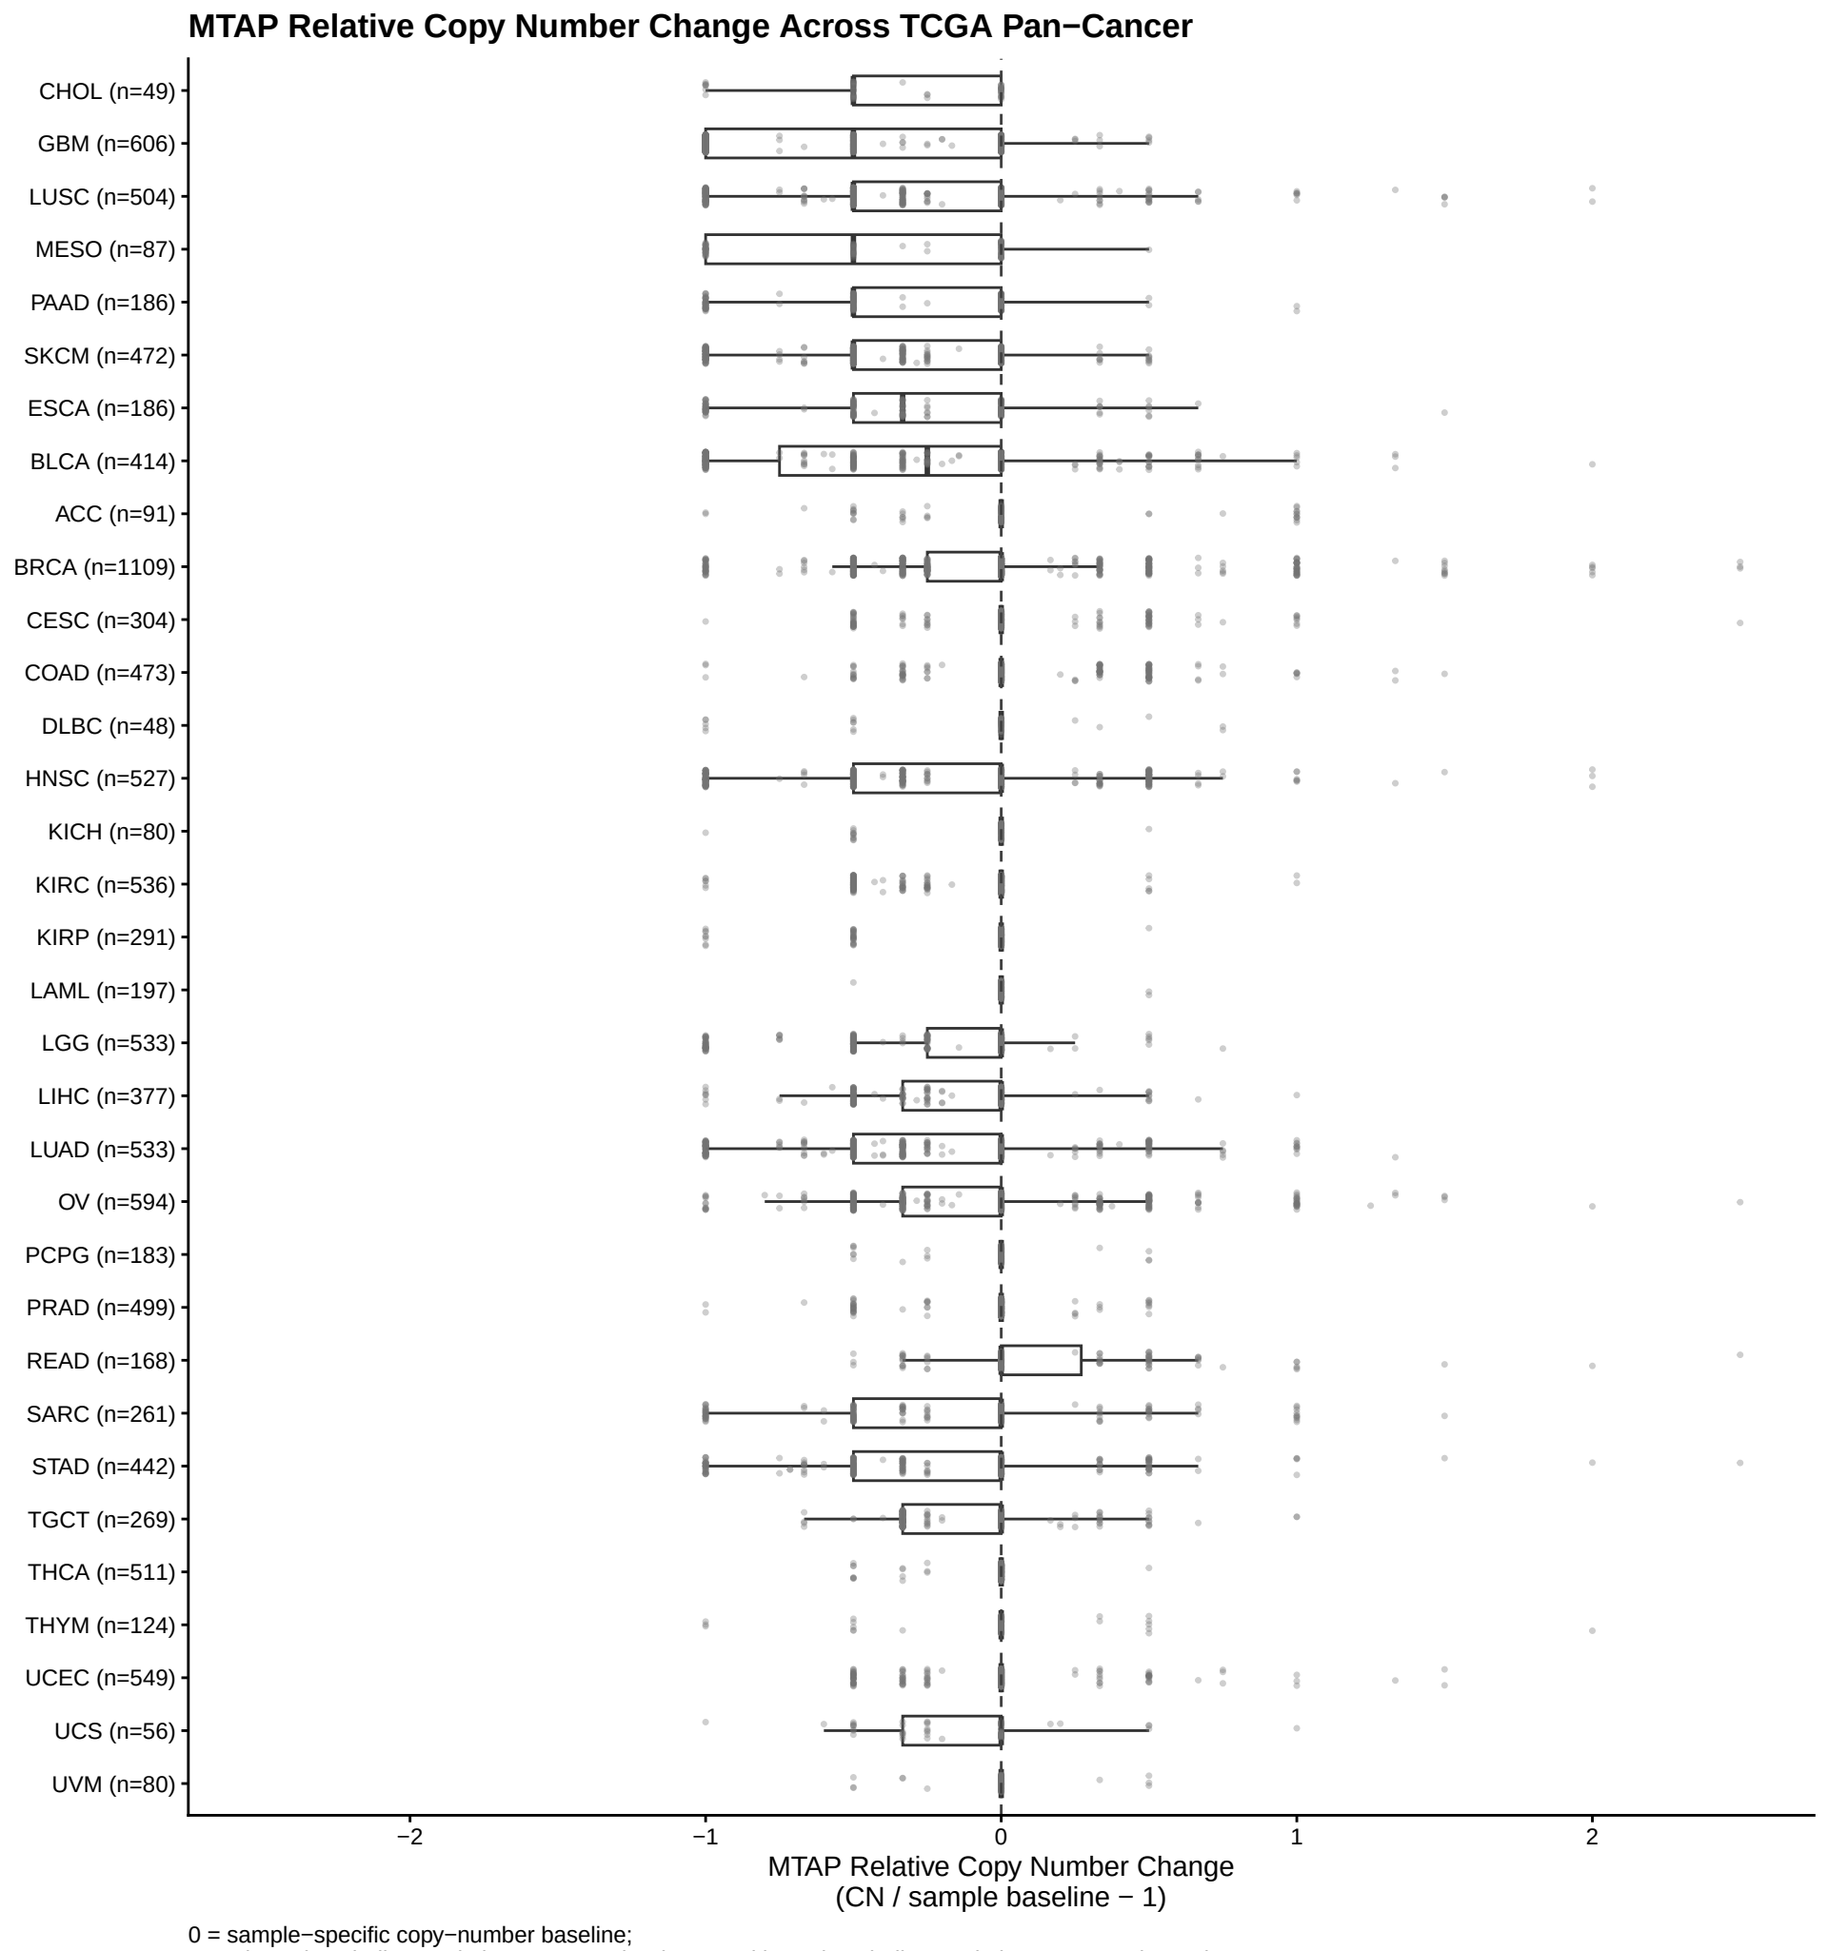


0 = sample−specific copy−number baseline;
negative values indicate relative copy−number loss; positive values indicate relative copy−number gain.
Analysis−derived change; each point represents one TCGA tumor sample.