


ENO1 → ENO2 CN threshold sensitivity

Analysis-defined CN_log thresholds; * BH-FDR < 0.05

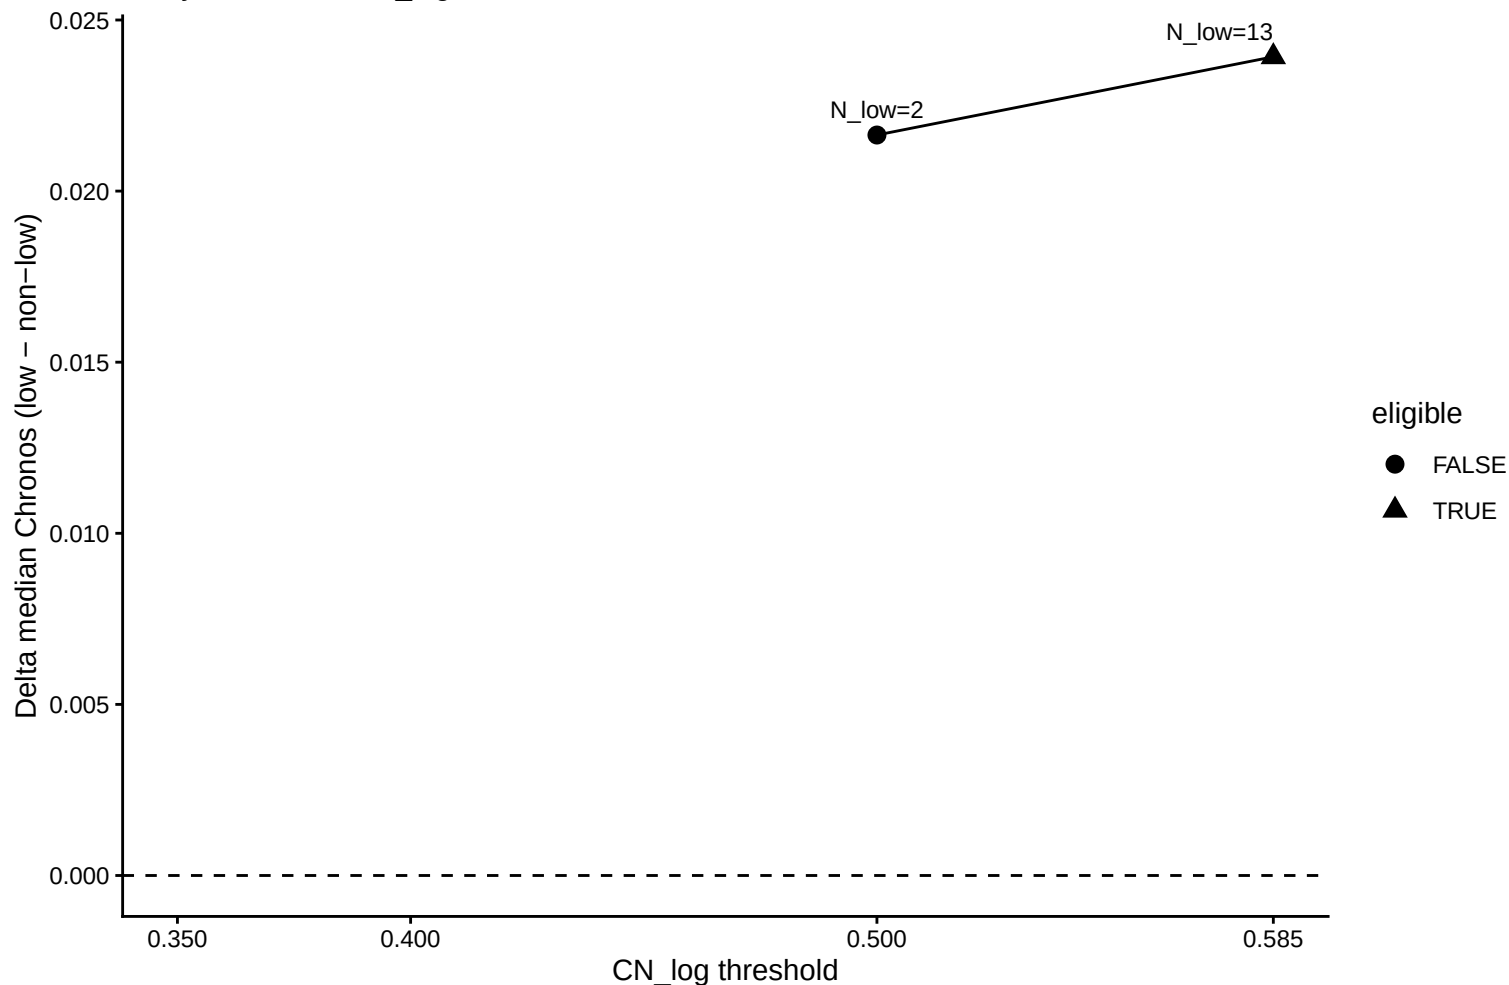

Not tested: threshold 0.5 (N_low=2, N_nonlow=856); threshold 0.4 (N_low=0, N_nonlow=858); threshold 0.35 (N_low=0, N_nonlow=858)