TOWN OF WINCHESTER / DEPARTMENT OF PUBLIC WORKS

Article 14 / WATER AND SEWER CAPITAL REQUESTS



*Image taken from film Water, Water Everywhere: https://vimeo.com/878776241

$600,000 • Water & Sewer retained earnings

Raw Water Pump Building repairs

Protecting the raw-water pump building

Building-envelope repairs needed to protect equipment serving the reservoir system.




FY2028 REQUEST

$600,000


Proposed work

- Roof and façade
- Brick-wall repairs
- Doors and related improvements

Current condition: exterior deterioration

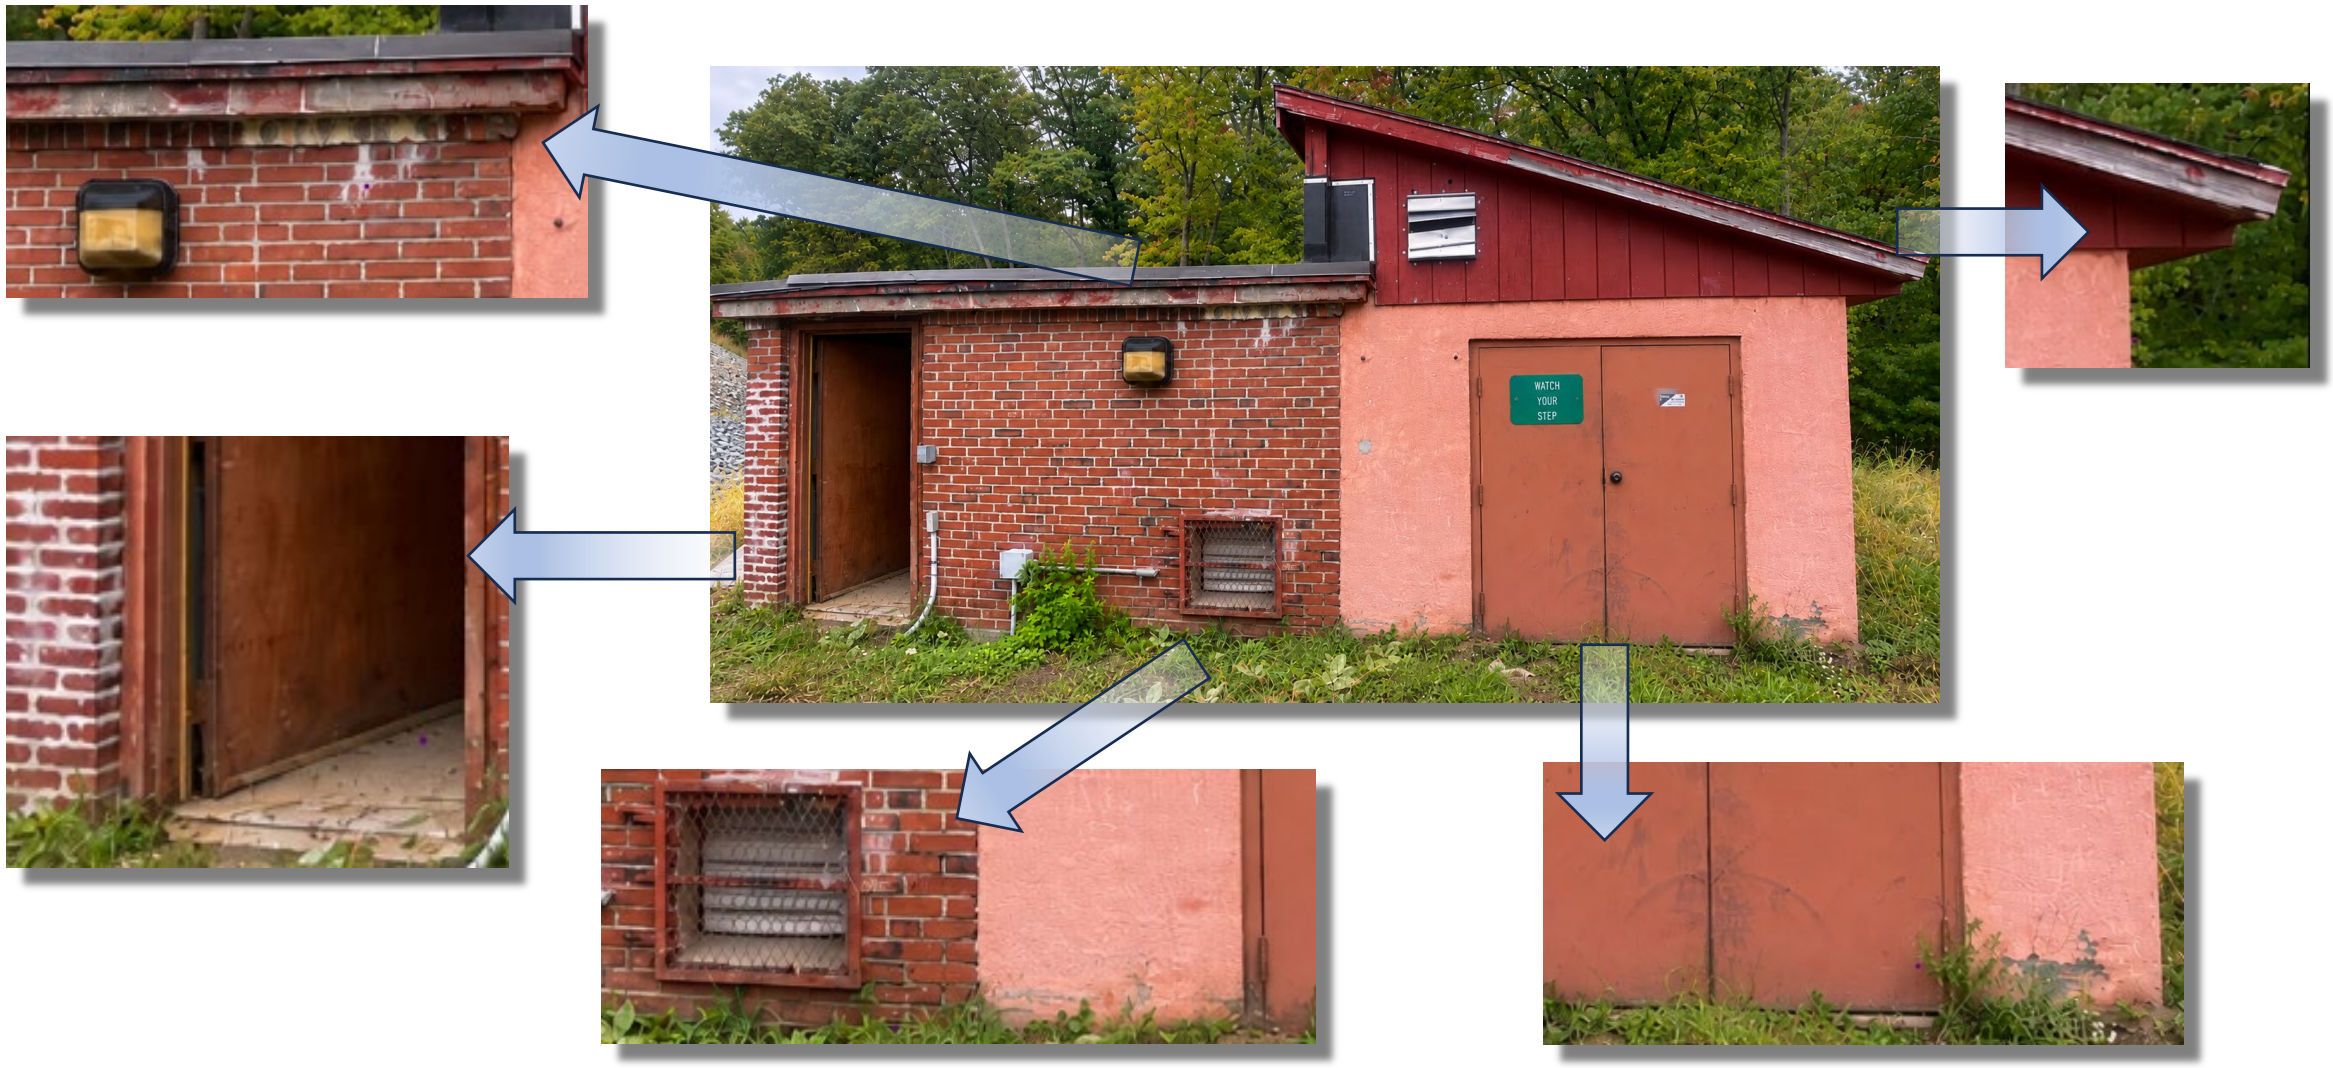


Current condition: interior deterioration

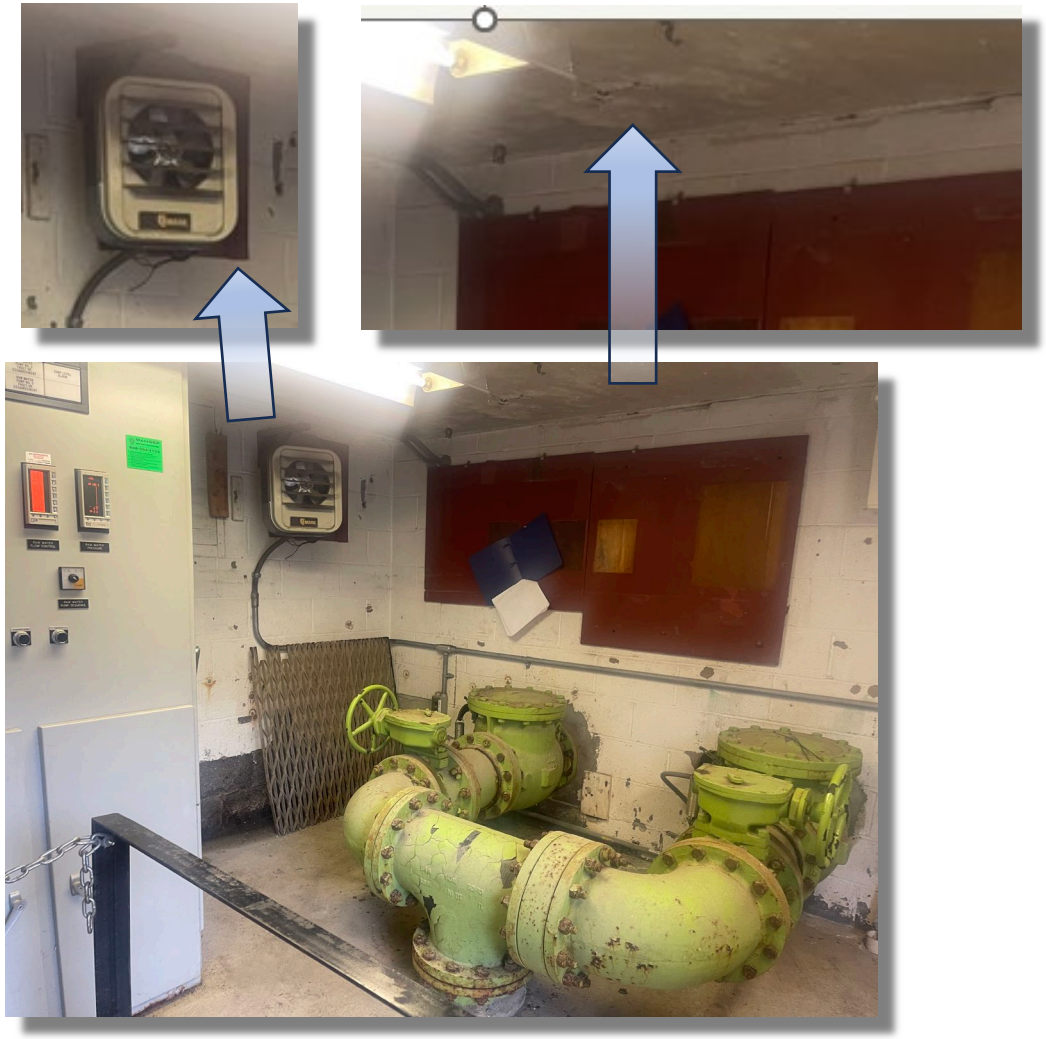



From reservoir to tap: RWP pumps water for treatment

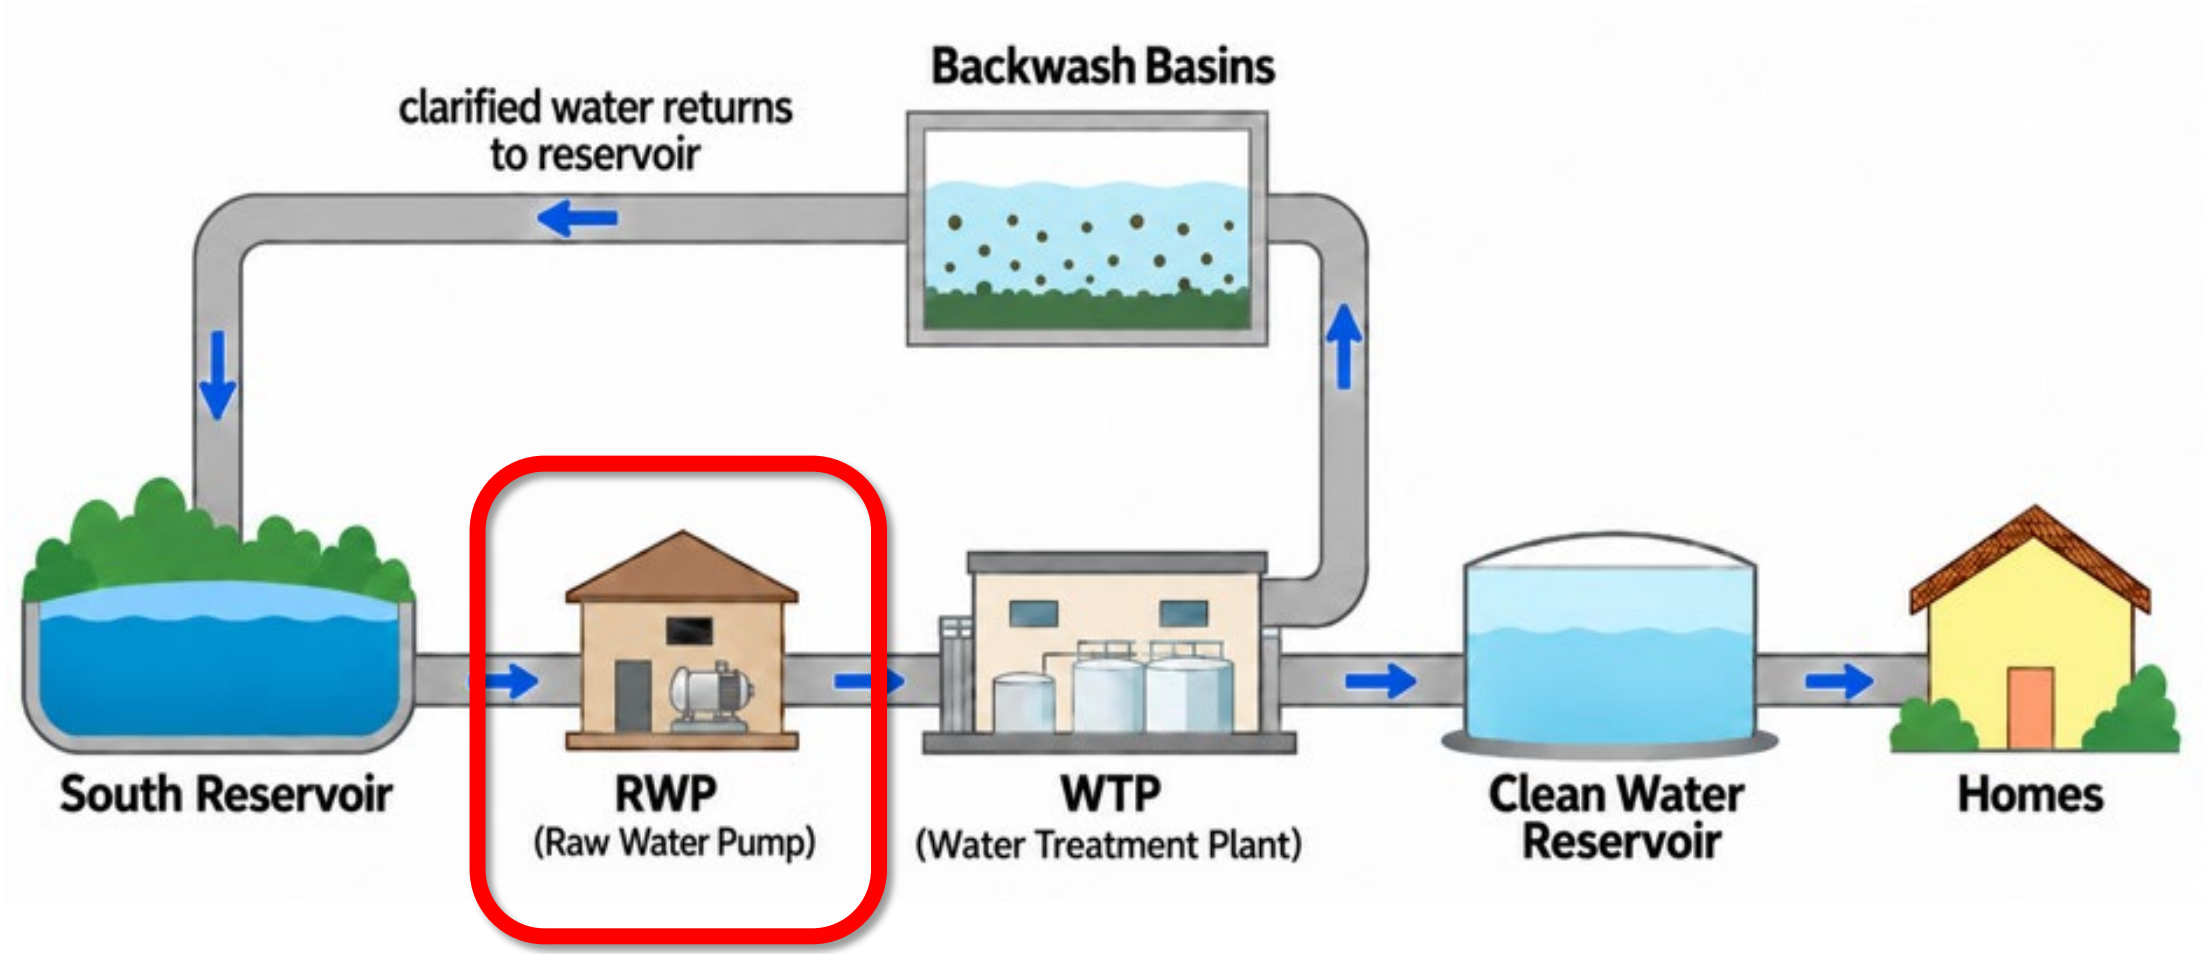

TOWN OF WINCHESTER / DEPARTMENT OF PUBLIC WORKS

Article 14 / WATER & SEWER CAPITAL REQUESTS



$100,000 • Water & Sewer retained earnings

Water Treatment Plant backwash basin design

Design of treatment plant backwash basins

Request for backwash basins lining design. Goal: make backwash basins more maintainable and efficient.





FY2028 REQUEST

$100K

Backwash basin design

Develop an engineered solution


FY2029 PLAN

$500K

Backwash basin construction

Future-year capital estimate

Sediment excavation deepens lagoon and makes it less effective

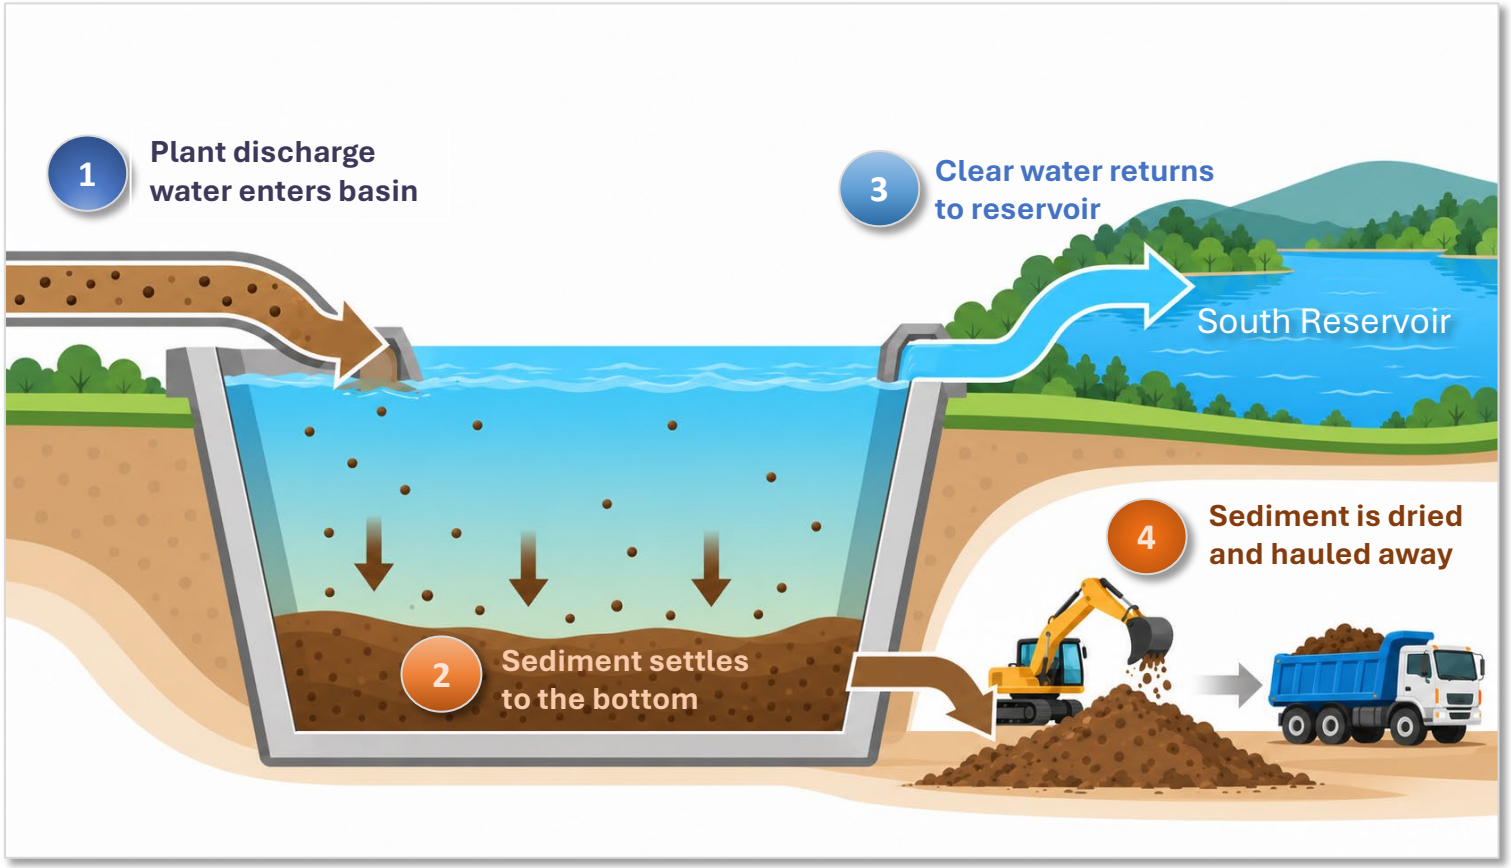

Benefits of lining:

- Easier and more predictable sediment excavation
- Less digging into basin sides and bottoms increases water recovery

Backwash basins recover on average 110,000 gallons of water daily

