September 24, 2019

San Jerardo Cooperative, Inc.
c/o Horacio Amezquita
24500 Calle El Rosario
Salinas, CA 93908
Email: horacioamezquita@yahoo.com

Sent via Electronic Mail

Dear San Jerardo Cooperative, Inc.:

SAN JERARDO WASTEWATER TREATMENT PLANT, 24401 CALLE EL ROSARIO, SALINAS, MONTEREY COUNTY – NOTICE OF APPLICABILITY, ENROLLMENT IN ORDER NO. WQ 2014-0153-DWQ GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS AND TRANSMITTAL OF MONITORING AND REPORTING PROGRAM ORDER NO. R3-2019-0093

Central Coast Regional Water Quality Control Board (Central Coast Water Board) staff reviewed the June 11, 2019 Report of Waste Discharge and associated material submitted by Nilsen and Associates on behalf of San Jerardo Cooperative, Inc. (San Jerardo Cooperative) for the San Jerardo Wastewater Treatment Plant (WWTP, facility). According to the information provided, the discharge meets the conditions of Order No. WQ-2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems (General Order). This letter serves as a notice of applicability for enrollment in the General Order but San Jerardo Cooperative is not required to comply with the conditions in the General Order until the Central Coast Water Board approves the termination of the WWTP's enrollment in the existing Order No. R3-2003-0054[1]. Therefore, San Jerardo Cooperative's effective date for enrollment in the General Order will be the date existing Order No. R3-2003-0054 is terminated. Until the existing Order No. R3-2003-0054 is formally terminated by the Central Coast Water Board, San Jerardo Cooperative must continue to comply with the conditions of existing Order No. R3-2003-0054.

This letter is San Jerardo Cooperative's notice of applicability for enrollment in the General Order and includes site-specific requirements and facility information (Attachment 1), facility and disposal area location (Attachment 2), and your monitoring and reporting requirements (Attachment 3).

[1] Termination of R3-2003-0054 is scheduled for the December 12-13, 2019 Central Coast Water Board meeting.

As of the effective date of San Jerardo Cooperative enrollment in the General Order, San Jerardo Cooperative must comply with the following:

1. **General Order** – San Jerardo Cooperative must comply with all conditions and requirements of the General Order and the requirements specified in this notice of applicability (Attachment 1) . As described in the General Order, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Order can be found electronically at the following link:

   https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – San Jerardo Cooperative must comply with the requirements of the Monitoring and Reporting Program (MRP) No. R3-2019-0093 (Attachment 3) as of the effective date for enrollment in the General Order.

   San Jerardo Cooperative is required to submit reports in a searchable PDF format and laboratory data in EDF format electronically via GeoTracker (see Attachment 3 for instructions). Each monitoring report must include the transmittal sheet found at the link below as the cover page:

   https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

3. **Fees** – San Jerardo Cooperative paid their annual fee ($2,286 on December 14, 2018) for coverage under the existing site-specific Order No. R3-2003-0054. San Jerardo Cooperative must continue to pay an annual fee to maintain coverage in the General Order. Annual fees are determined by the State Water Resources Control Board's fee program. A copy of the current state fee schedule is available electronically at the following link:

   https://www.waterboards.ca.gov/resources/fees/water_quality/docs/fy1819_fee_schedule.pdf

4. **Termination** –Termination of R3-2003-0054 is scheduled for the December 12-13, 2019 Central Coast Water Board meeting. Meeting agendas and information are available on our website at:

   http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, San Jerardo Cooperative must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the

treated wastewater, you must notify the Central Coast Water Board immediately of such changes.

6. **Responsible Party** – San Jerardo Cooperative is responsible for the management and disposal of wastewater in compliance with the conditions of the General Order. Any noncompliance with this General Order constitutes a violation of the California Water Code, and subjects San Jerardo Cooperative to enforcement action, and/or termination of enrollment under this General Order.

7. **Change in Ownership** - In the event of any change in control or ownership of the property, San Jerardo Cooperative must notify the succeeding owner or operator of the existence of this General Order by letter. A copy of the letter shall be immediately forwarded to the Central Coast Water Board's Executive Officer so that the new owner or operator can be enrolled in the General Order and your enrollment in the General Order can be terminated.

8. **Certified Operator** –The San Jerardo Cooperative is required to comply with the operator certification requirements[2] administer by the Office of Operator Certification, which currently require a Class I certified operator onsite to maintain and operate the treatment system.

If you have any questions regarding this letter, please contact Central Coast Water Board staff **Kristina Olmos at (805) 549-3121, or by email at Kristina.Olmos@waterboards.ca.gov**, or Jennifer Epp at (805) 594-6181, or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Digitally signed by Thea Tryon
Date: 2019.09.24 10:09:14 -07'00'

for John M. Robertson
Executive Officer

Attachments:

1. Site-Specific Requirements and Facility Information
2. Location of Facility and Disposal Area
3. Monitoring and Reporting Program Order No. R3-2019-0093 for San Jerardo WWTP

[2] Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

cc:

Nilsen & Associates, Nilsen and Associates, nilsenbollin@yahoo.com
Horacio Amezquita, San Jerardo Coop, horacioamezquita@yahoo.com
Miles Farmer, Cypress Water Services, miles@cypresswaterservices.com
Matthew Keeling, Central Coast Water Board, Matthew.Keeling@waterboards.ca.gov
Kristina Olmos, Central Coast Water Board, Kristina.Olmos@waterboards.ca.gov
Jennifer Epp, Central Coast Water Board, Jennifer.Epp@waterboards.ca.gov
Sheila Soderberg, Central Coast Water Board, Sheila.Soderberg@waterboards.ca.gov
RB3-WDR@waterboards.ca.gov

WDR Program
ECM/CIWQS = CW-255306
GeoTracker ID = WDR100035146
Subject: San Jerardo WWTP NOA WQ-2014-0153-DWQ for Small Domestic Wastewater Systems
\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\San Jerardo WWTP\NOA&MRP\NOA_MRP_Sept_24_2019.docx

ATTACHMENT 1

SITE-SPECIFIC REQUIREMENTS AND FACILITY INFORMATION

1. SITE-SPECIFIC REQUIREMENTS AND LIMITS

The San Jerardo Cooperative must operate San Jerardo Wastewater Treatment Plant (WWTP) in accordance with the General Order[3] and this notice of applicability[4].

a. **Influent and Effluent Limits:** San Jerardo Cooperative must comply with the site-specific limits listed in Table 1.

Table 1. Wastewater Limits for San Jerardo WWTP

Constituent	Limit	Point of Compliance
Flow (peak)	40,000 gallons per day (gpd)	Influent
Five-Day Biochemical Oxygen Demand (BOD_5)	90 milligrams per liter (mg/L)	Effluent
Total Nitrogen	50% reduction	Effluent

b. **Groundwater Objectives:** San Jerardo Cooperative must manage the facility to comply with the Water Quality Control Plan for the Central Coastal Basin (Basin Plan).[5] Specifically, you must comply with section 3.3.4 Objectives for Groundwater, which currently includes:

i. General objectives for taste, odors, and radioactivity for all groundwaters.

ii. Objectives for municipal and domestic supply including bacteria, organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water Maximum Contaminant Levels (MCLs) as defined in California Code of Regulations title 22 division 4 chapter 15[6].

iii. Objectives for agricultural supply, including a pH limit between 6.5 to 8.4.

[3] General Order sections B.2, B.3, and B.4 are not applicable for this facility.
[4] General Order section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Order, effluent limits in the General Order, and compliance with site-specific limits set forth in this Notice of Applicability.
[5] Current edition, June 2019: https://www.waterboards.ca.gov/centralcoast/publications_,forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf. San Jerardo Cooperative must comply with the current edition of the Basin Plan
[6] A copy of the MCLs is available here: https://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/MCLsandPHGs.html

iv. Specific objectives for the groundwater basin where the discharge occurs. This facility discharges into the Salinas Valley Groundwater Basin, Eastside Aquifer Subbasin. The Basin Plan does not contain median groundwater objectives for the Eastside Aquifer Subbasin; however, the Eastside Aquifer is adjacent and has connectivity to the 180-foot aquifer, and those Basin Plan's groundwater objectives are included in Table 2.

Table 2. Basin Plan, Median Groundwater Objectives (mg/L)

Constituent	Median Groundwater Objective for 180-foot aquifer
Total Dissolved Solids (TDS)	1,500
Sodium	250
Chloride	250
Sulfate	600
Boron	0.5
Total Nitrogen as N	1

mg/L = milligrams per liter

2. WWTP FACILITY INFORMATION

Facility background is summarized in Table 3.

Table 3. Background Information

Location	24500 Calle El Rosario, Salinas, California 93908
APN	149-031-023
LAT/LONG	36.642207, -121.538239
Owner & Discharger	San Jerardo Cooperative, Inc.
Agent for Service of Process	Horacio Amezquita at 24500 Calle El Rosario, Salinas, California, is registered with the State of California Secretary of State as the agent for service of process.
Operator	Cypress Water Services (contracted)
Service Area	66-unit farm-worker housing community with a total of 450 residences, a community center, childcare center, and school.
Supply water source	Offsite supply well located 2 miles northwest off Zabala Road, Water System No. CA2701904.
Flow, daily average	25,500 gpd
Flow, peak daily	35,000 gpd

a. The treatment facility consists of a duplex grinder pump; a lined, aerated Pond 1; followed by two unlined polishing/disposal ponds (Pond 2 and Pond 3) in series; and a leachfield. The design flow capacity of the ponds is 40,000 gpd. See Attachment 2 for a map and Table 4 for plant design parameters.

Table 4. WWTP Design Parameters

Parameter	Treatment Pond	Polishing/Disposal Ponds	Disposal/Leachfield
Number	Pond 1	Pond 2 and Pond 3	3 areas
Total Volume	1.4 million gallons (MG)	0.72 MG	NA*
Total Infiltrative Area	None, lined	24,000 ft^2	11,220 ft^2

b. Between July 2014 and the end of 2015, San Jerardo Cooperative completed significant improvements to the wastewater treatment system including solids removal from the treatment ponds, expansion and lining of Pond 1, and construction of a leachfield.

c. June 2016 to December 2017 wastewater quality monitoring data are included in Table 5.

Table 5. Average Influent and Effluent Concentrations

Pollutant	Influent Concentration (mg/L)	Effluent Concentration (mg/L)
BOD_5	302	29
Total Nitrogen (as N)	52	9.4
TDS	--[b]	900[a]
Chloride	--	328
Sulfate	--	50
Boron	--	0.52
Sodium	--	232

a. Excludes September 2017 results as results are recorded in error.

b. Values not included because discharger did not monitor and report, as shown with a "- -"

- Detections of 1,2,3-trichloropropane (TCP) and nitrate in groundwater led to the abandonment of the supply well upgradient of Pond 1 in 2010. San Jerardo Cooperative, with grant funding, updated the water and wastewater systems, installed monitoring wells, and investigated water quality impacts. No definitive source of the 1,2,3-TCP has been found; the investigation concluded that agriculture pesticide leaching or historical use in the area prior to the wastewater facility construction, or leaching from the previously unlined wastewater ponds, or a combination of either, could be the source of 1,2,3-TCP.

- Groundwater quality is generally elevated in nitrate in the Salinas Groundwater Basin and the Eastside Aquifer Subbasin primarily from longterm agricultural production.

- First-encountered, perched groundwater was found 26 to 30 feet below ground surface (bgs), with a second water-bearing zone at 36 to 48 feet below ground surface.

- San Jerardo Cooperative installed four groundwater monitoring wells (MW) screened 40 to 50 feet bgs in May of 2017. Generally, MW-1 is 100 feet upgradient of the disposal area, MW-2 is directly adjacent to the disposal area, MW-3 is downgradient and within irrigated agricultural land, and MW-4 is side-gradient. Groundwater quality for June 2018[7] is summarized in Table 6.

Table 6: Groundwater Quality

Parameter	MW-1	MW-2	MW-3	MW-4
Depth to groundwater (ft bgs)	29.74	24.6	34.6	19.45
Nitrate (as N) (mg/L)	73	1.2	98	64
TDS (mg/L)	1,200	1,400	1,400	1,300
Chloride (mg/L)	190	320	170	240
Sulfate (mg/L)	180	130	150	220
Boron (mg/L)	0.1	0.22	<0.1	0.19
Sodium (mg/L)	140	200	140	210
1,2,3-TCP micrograms per liter (µg/L)	0.027	<0.0015	0.051	0.0035

[7] https://geotracker.waterboards.ca.gov/esi/uploads/geo_report/3713705658/WDR100035146.PDF

ATTACHMENT 2

LOCATION OF FACILITY AND DISPOSAL AREA

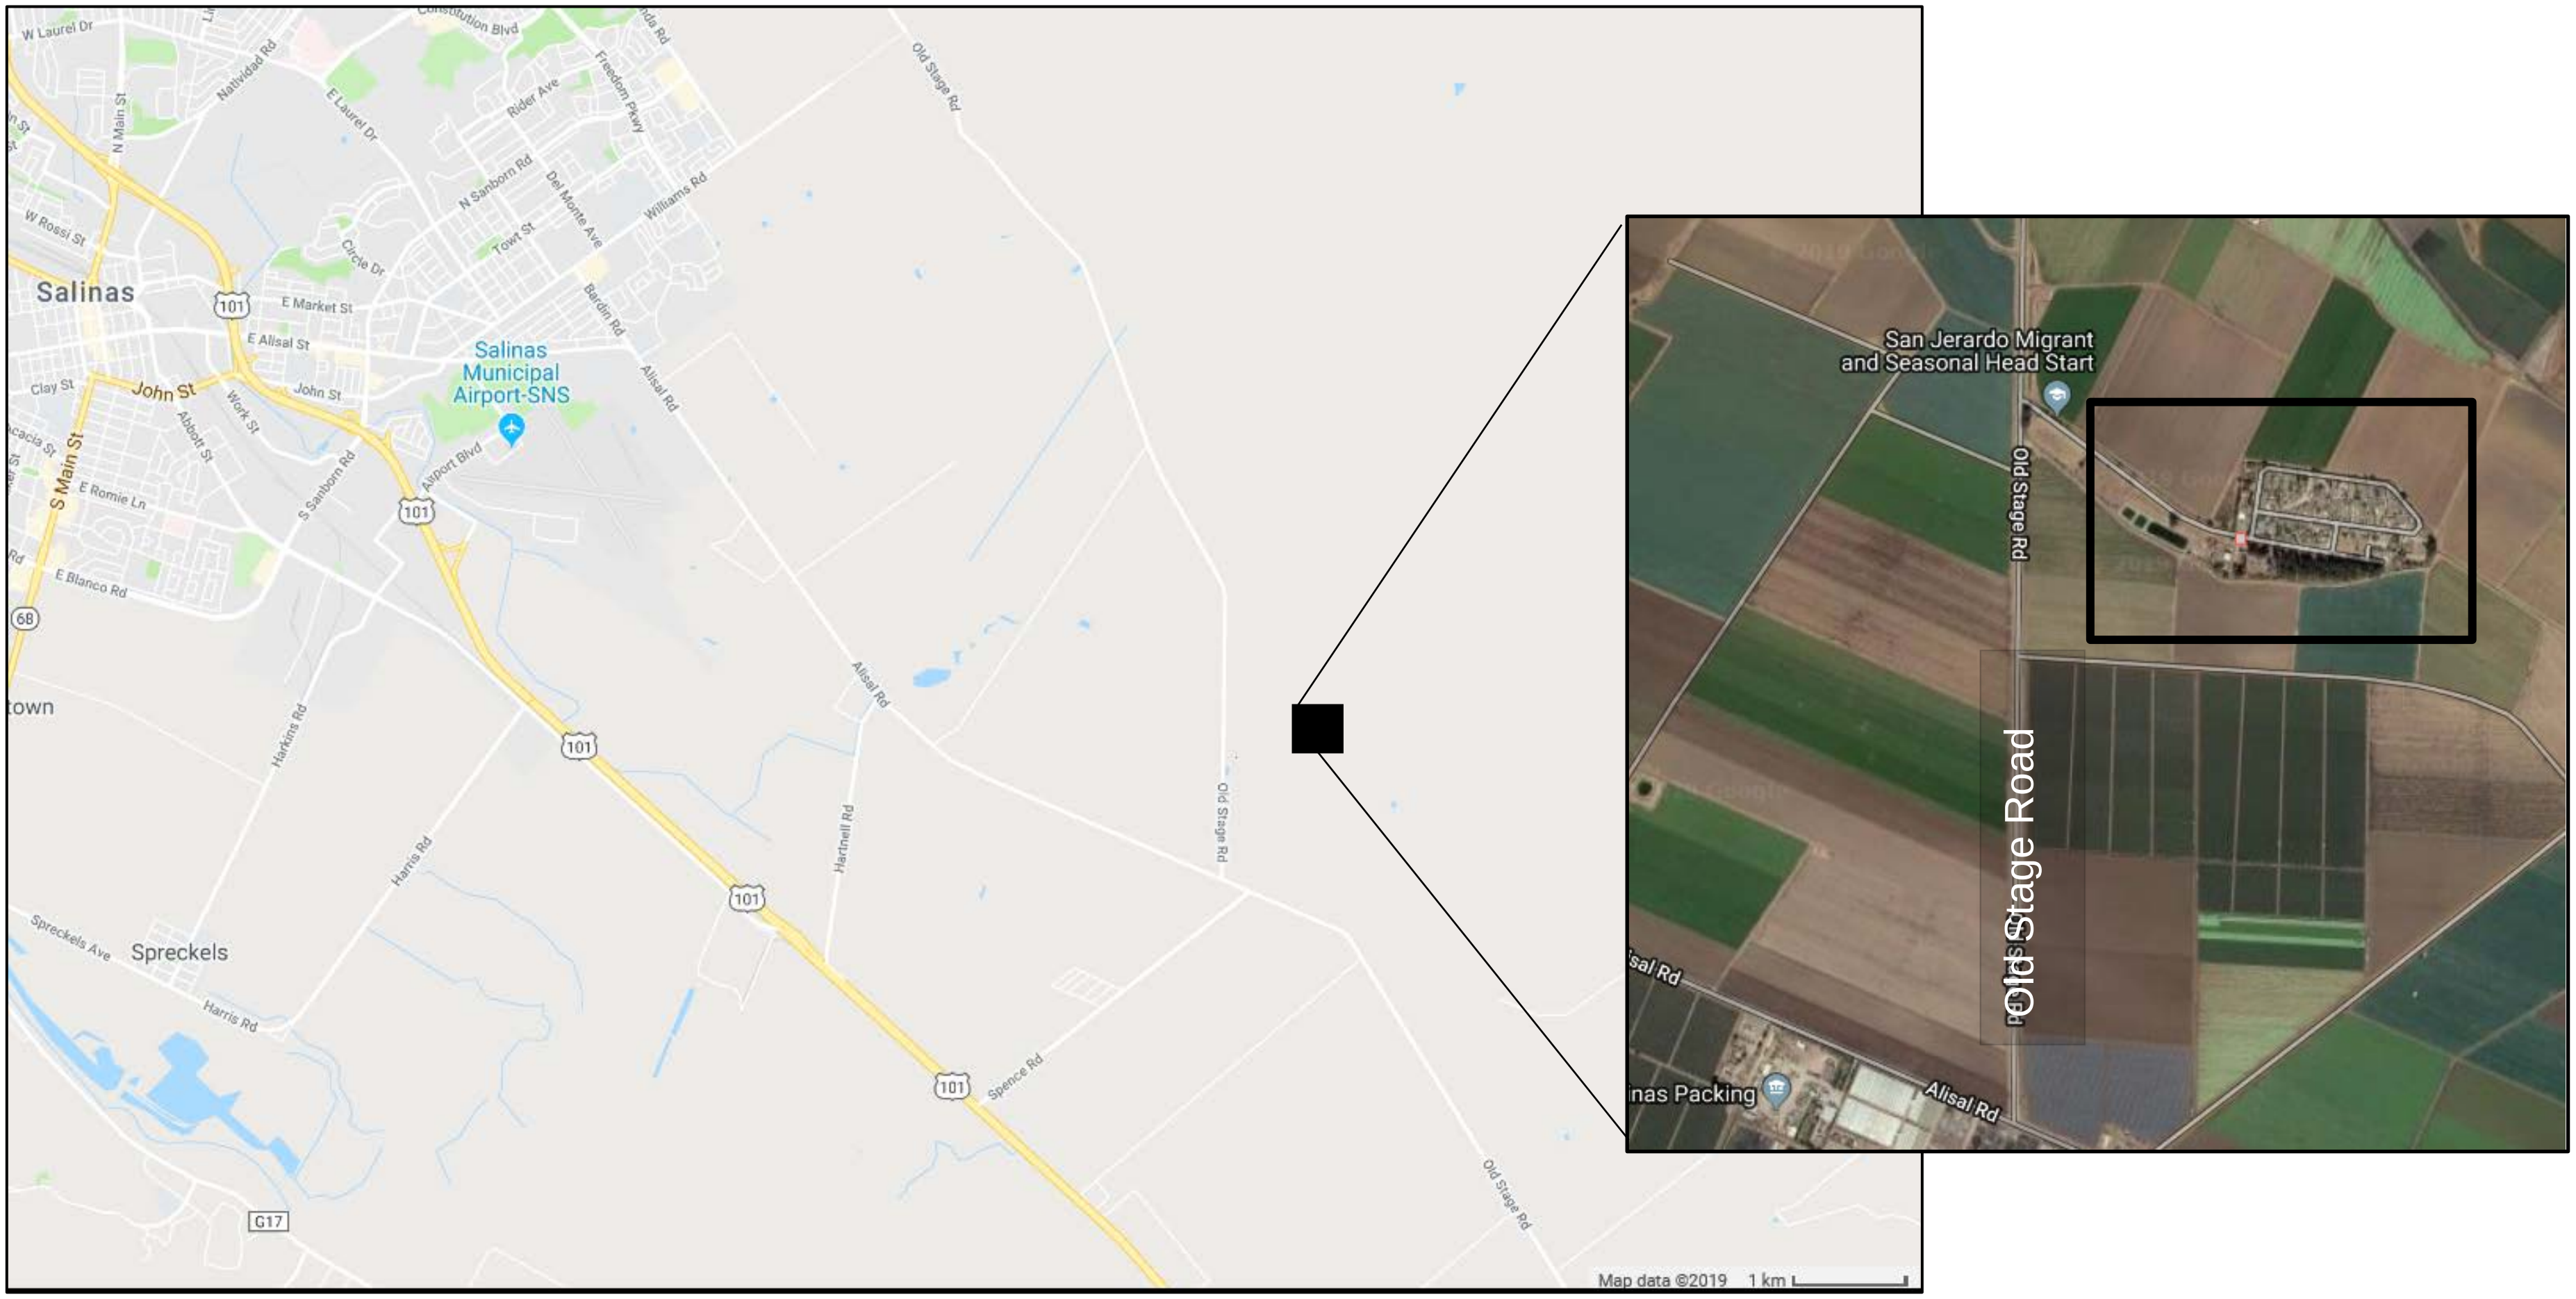

Figure 1: San Jerardo, South of Salinas

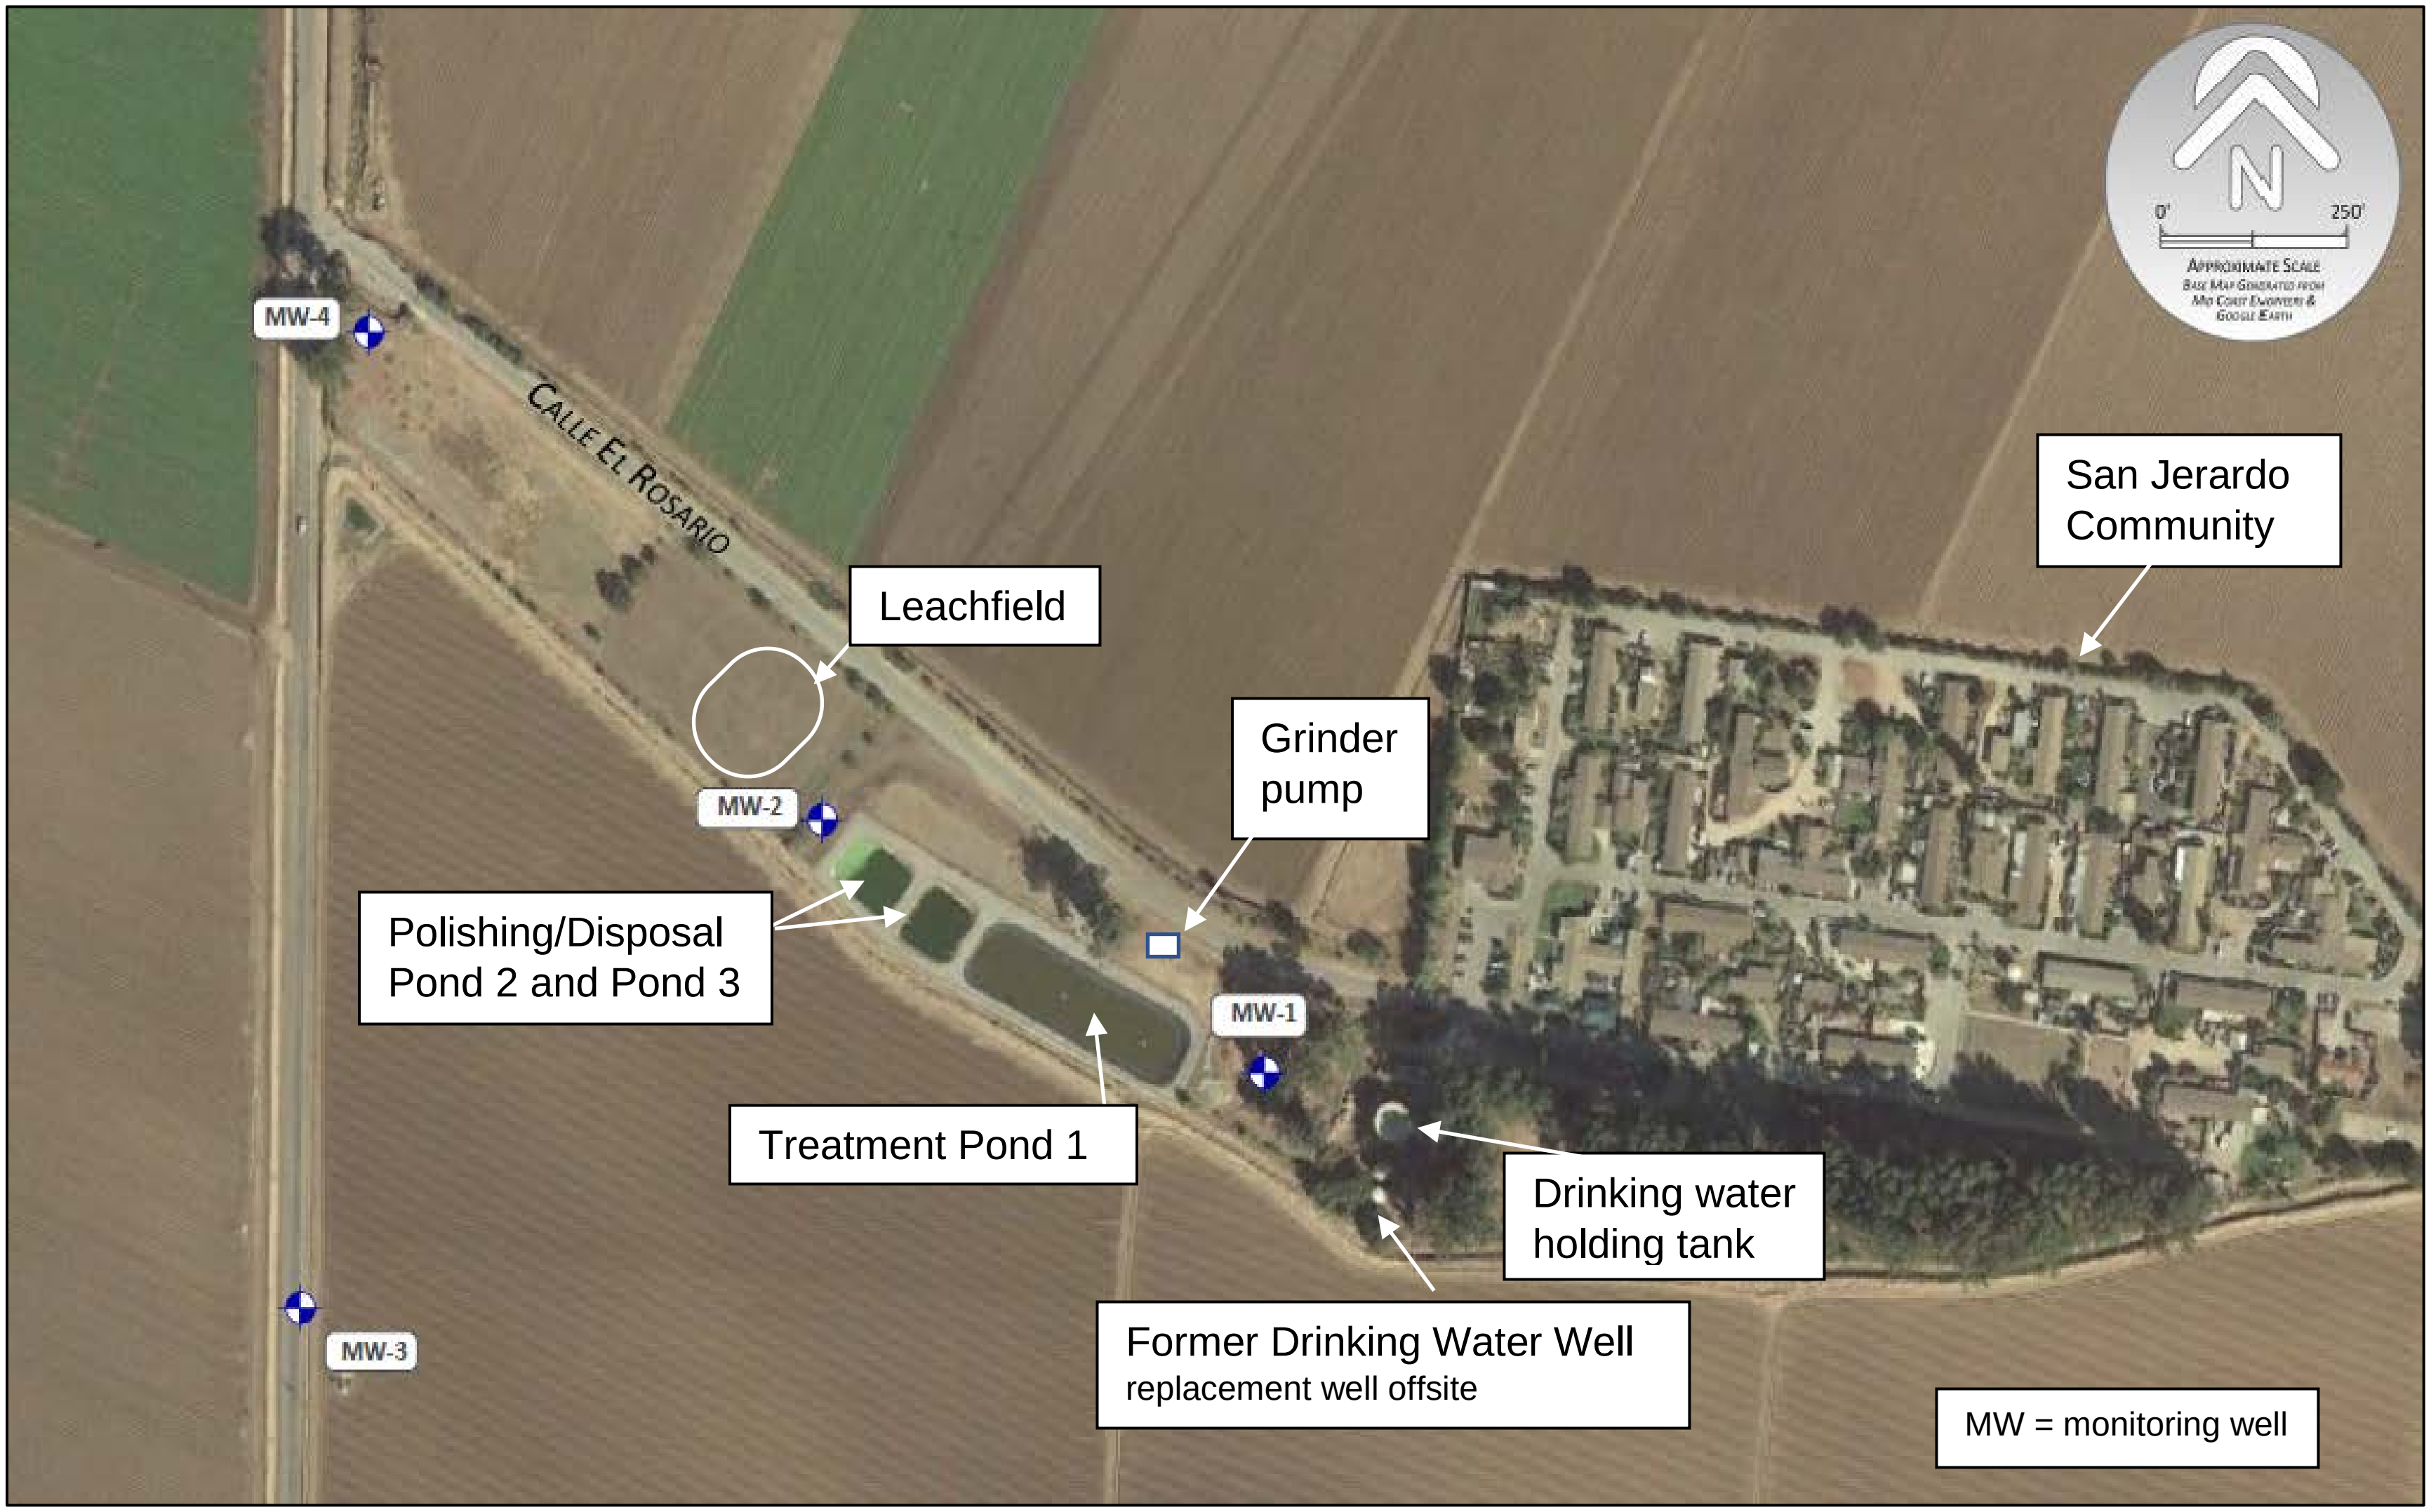

Figure 2: San Jerardo Community and Wastewater Treatment Facility

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION
895 Aerovista Place, Suite 101
San Luis Obispo, California 93401

MONITORING AND REPORTING PROGRAM NO. R3-2019-0093

for
SAN JERARDO WASTEWATER TREATMENT PLANT
MONTEREY COUNTY

This Monitoring and Reporting Program (MRP) describes requirements for monitoring a wastewater treatment system for San Jerardo Wastewater Treatment Plant (WWTP). This MRP is issued pursuant to Water Code section 13267. San Jerardo Cooperative, Inc. (hereafter, “Discharger”) must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Water Quality Control Board (Central Coast Water Board) Executive Officer.

The Discharger owns and operates the wastewater treatment system that is subject to the notice of applicability of Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems (General Order).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by Central Coast Water Board staff. Unless otherwise specified below, sampling shall be performed as follows:

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	March, June, September and December
Semiannual	March and September
Annual	September
Every two years	September, even years (2020, 2022, etc.)
Every five years	September 2020, 2025, etc.

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board California Environmental Laboratory Accreditation Program (ELAP) accredited laboratory, or:

A. The user is trained in proper use and maintenance of the instruments;

B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
D. Field calibration reports are maintained and available for at least three years.

2. MONITORING LOCATION DESCRIPTIONS

An influent sample (IS) and effluent samples (ES) must be collected at the locations described in the process flow diagram and Table 2.

Table 2. Sampling Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	collected within grinder pump station
Effluent Sample – 1	ES-1	collected near Pond 2 effluent pipe
Effluent Sample – 2	ES-2	collected near Pond 3 effluent pipe

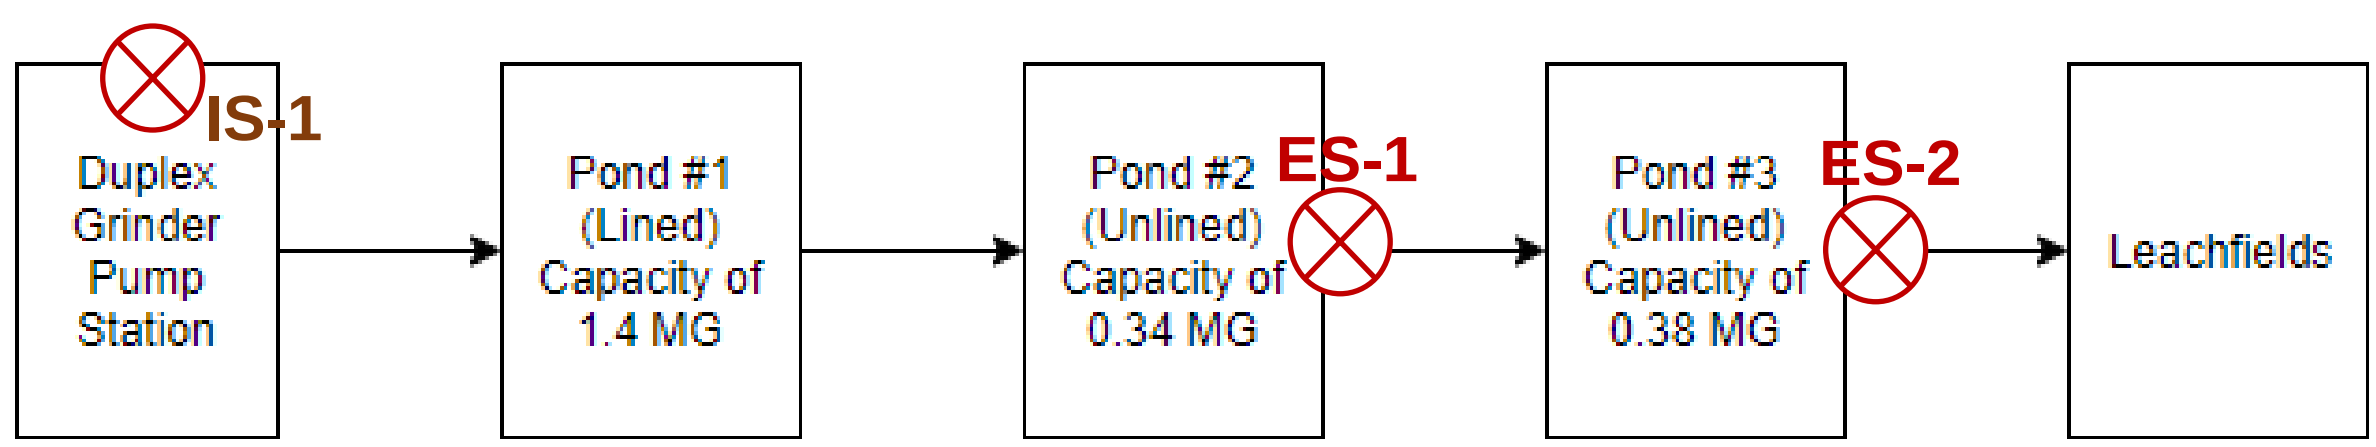

Figure 1. Process Flow Diagram

3. WATER SUPPLY MONITORING

The Discharger collects samples of the water supply that services the community of San Jerardo (users of the WWTP) in accordance with Division of Drinking Water and Monterey County Health Department requirements. The Discharger must evaluate and summarize the water supply well data it collects each year and provide it with their annual report. At a minimum, the Discharger must report concentrations for the following constituents, and any other constituent that has a published maximum contaminant level (MCL) that is detected above its reporting limit.

Table 3. Water Supply Monitoring (WSW-1)

Constituent	Units
Bicarbonate	mg/L
Calcium	mg/L
Carbonate Alkalinity	mg/L
Chloride	mg/L
Iron	mg/L
Magnesium	mg/L
Nitrate (as N)	mg/L

Constituent	Units
pH	pH Units
Sodium	mg/L
Sulfate	mg/L
Total Dissolved Solids (TDS)	mg/L
Total Hardness as $CaCO_3$	mg/L
1,2,3 Trichloropropane (TCP)	µg/L

mg/L = milligram per liter
µg/L = micrograms per liter

4. INFLUENT & EFFLUENT MONITORING

The Discharger must monitor flow at the influent as described in Table 4. Flow rate may be metered or estimated based on potable water supply meter readings or other Central Coast Water Board staff approved method.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	gpd	Metered	Daily
Maximum Daily Flow	gpd	Metered	Monthly
Mean Daily Flow	gpd	Calculated	Monthly

gpd = gallons per day

Representative grab samples of the influent into the treatment pond (prior to treatment) and effluent in Pond 2 and Pond 3 must be collected and analyzed as follows:

Table 5. Influent and Effluent Pollutant Monitoring

Pollutant	Units	Influent IS-1	Effluent Pond 2 ES-1	Effluent Pond 3 ES-2
Biochemical Oxygen Demand, 5-day (BOD_5)	mg/L	Quarterly	Quarterly	Quarterly
Total Suspended Solids (TSS)	mg/L	Quarterly	Quarterly	Quarterly
pH	pH units	Quarterly	Quarterly	Quarterly
TDS	mg/L	Semiannually	Semiannually	Semiannually
Nitrate (as N) or Nitrite + Nitrate (as N)	mg/L	Semiannually	Semiannually	Semiannually
Total Kjeldahl Nitrogen (as N)	mg/L	Semiannually	Semiannually	Semiannually
Total Nitrogen (as N)	mg/L	Semiannually	Semiannually	Semiannually
Sodium	mg/L	Not Required	Not Required	Semiannually

Chloride	mg/L	Not Required	Not Required	Semiannually
Boron	mg/L	Not Required	Not Required	Semiannually
Sulfate	mg/L	Not Required	Not Required	Semiannually
1,2,3 TCP	mg/L	Not Required	Not Required	Annually
Carbonate	mg/L	Not Required	Not Required	Every two years
Bicarbonate	mg/L	Not Required	Not Required	Every two years
Calcium	mg/L	Not Required	Not Required	Every two years
Magnesium	mg/L	Not Required	Not Required	Every two years
Potassium	mg/L	Not Required	Not Required	Every two years
Metals[a]	mg/L	Not Required	Not Required	Every 5 years
Chromium VI	mg/L	Not Required	Not Required	Every 5 years

a. California Code of Regulations (CAM 17) Metals (dissolved): Antimony (Sb), Arsenic (As), Barium (Ba), Beryllium (Be), Cadmium (Cd), Chromium (Cr), Cobalt (Co), Copper (Cu), Lead (Pb), Mercury (Hg), Molybdenum (Mo), Nickel (Ni), Selenium (Se), Silver (Ag), Thallium (Tl), Vanadium (V) and Zinc (Zn).

5. POND MONITORING

Representative samples of the wastewater contained in each treatment and disposal pond must be collected and analyzed as follows:

Table 6. Pond Monitoring

Constituent	Units	Sample Type	Sampling Frequency
pH	pH Units	Grab[a]	Weekly
Dissolved Oxygen	mg/L	Grab	Weekly
Freeboard	feet or inches	Measured	Weekly

a. Grab samples to be taken at 1-foot depth

If additional pond sampling is required by Monterey County Health Department, the Discharger must submit that data with their annual reports.

6. SUBSURFACE DISPOSAL AREA & FACILITY INSPECTION

The Discharger must inspect the treatment and disposal areas (leachfield) at least bi-weekly, and after rain events, and note any issues or compliance concerns. Inspections of the disposal area must evaluate if wastewater is evenly applied, the disposal area is not saturated, burrowing animals and/or deep-rooted plants are not present, and odors are not present. Inspection of dosing pump controllers is required to maintain optimum dispersal and treatment. A log of these inspections must be maintained, and the Discharger must submit a summary of observations made during the inspections with each monitoring report.

7. GROUNDWATER MONITORING

Representative samples from all monitoring wells (MW-1, MW-2, MW-3, and MW-4) must be collected and analyzed as described in Table 7. The Discharger must measure depth to groundwater (to 0.1 feet accuracy) in each monitoring well before it is purged and sampled. The Discharger must record and submit field sheets documenting purge methods. Before sampling, purge three well volumes from each well, or purge until measurements of temperature, pH, specific conductance, turbidity, and dissolved oxygen have stabilized. The Discharger must collect groundwater samples from each well after the groundwater levels in the well have recovered sufficiently to ensure the collection of representative groundwater samples.

Table 7. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Depth to groundwater	0.01 Feet	Measure	Semiannually
pH	pH Units	Field Measurement	Semiannually
Dissolved Oxygen	mg/L	Field Measurement	Semiannually
Nitrate (as N) or Nitrate + Nitrite (as N)	mg/L	Grab	Semiannually
Total Dissolved Solids	mg/L	Grab	Semiannually
Sodium	mg/L	Grab	Semiannually
Chloride	mg/L	Grab	Semiannually
Boron	mg/L	Grab	Semiannually
Sulfate	mg/L	Grab	Semiannually
Fecal Coliform Organisms[a]	MPN[b]/100 mL	Grab	Every two years
1,2,3-TCP (MW-3 only)	mg/L	Grab	Every two years
Carbonate	mg/L	Grab	Every two years
Bicarbonate	mg/L	Grab	Every two years
Calcium	mg/L	Grab	Every two years
Magnesium	mg/L	Grab	Every two years
Potassium	mg/L	Grab	Every two years

a. using a minimum of 15 tubes or three dilutions.
b. MPN = most probable number

8. SOLIDS MONITORING

The Discharger must record the name/contact information for the hauling company, the type and amount of sludge or solids transported, the date removed, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. If no solids are removed during a given year, the Discharger does not need to perform this monitoring. Reporting must indicate why solids were not removed.

9. REPORTING

The quarterly and annual monitoring reports are due as described in Table 8. Every report must include the Central Coast Water Board's transmittal sheet[8] and bear the certification and signature of the Discharger's authorized representative.

Table 8. Reporting

Report	Monitoring Period	Report Due Date
First Quarter	January 1 to March 31	May 1
Second Quarter	April 1 to June 30	August 1
Third Quarter	July 1 to September 31	November 1
Fourth Quarter	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

A. QUARTERLY REPORTING

At a minimum, the quarterly reports must include:

1. Results of all required monitoring in tabular format.
2. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
3. A comparison of monitoring data to the discharge specifications, applicable effluent limits, disclosure of any violations of the notice of applicability and/or General Order, and an explanation of any violation of those requirements (data shall be presented in tabular format).
4. Copies of laboratory analytical report(s) and chain of custody form(s).
5. Copies of groundwater monitoring well field sheets with purge methods and logs.

B. ANNUAL REPORTING

At a minimum, the annual reports must include:

1. **Facility Information and Description**
   Briefly describe your facility, treatment process, and disposal process with reference to figures.
2. **Data Tables and Graphs**
   Tabular and graphical summaries of all monitoring data (water supply influent, effluent, groundwater, sludge data) collected during the year. Compare influent and effluent concentrations over time for the main pollutants, along with effluent limits, as appropriate.
3. **Compliance and Performance Discussion**
   - A discussion of compliance and any corrective action(s) taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the notice of applicability and/or General Order.

[8] https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

- An evaluation of treatment facilities' performance, including percent removal of the main pollutants (BOD_5, TSS, total nitrogen) over time, nuisance conditions, system problems, etc.
- Note any changes or upgrades that were made over the past year (or need to be made) to the treatment plant to improve performance.
- An evaluation of groundwater elevation and groundwater quality data over time.
- Comparison of groundwater quality up and downgradient of the facility.
- Comparison of groundwater quality data to maximum contaminant levels and Basin Plan Median Groundwater Objectives.
- If required by Central Coast Water Board staff, provide a groundwater monitoring report prepared by a California licensed professional that contains groundwater elevation maps, flow direction and concentration contours.

4. **Flow Evaluation (treatment plant capacity)**
A summary in tabular format of the peak and average flows for each month and note the maximum permitted flows. A flow rate evaluation as described in the General Order (Provision E.2.c) shall also be submitted.
5. **Operator Certification**
The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.
6. **Operation and Maintenance Manual**
The date the facility's Operation and Maintenance Manual was last revised, and whether the manual is complete for the current facility.
7. **Laboratory Information**
A table of the laboratories used, their address, and ELAP accreditation.
8. **Sludge Management**
A table of the name/contact information for the hauling company, the type and amount of sludge or solids transported, the date removed, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste.
9. **Pretreatment**
State if the facility has a pretreatment program, and if it does, evaluate the effectiveness of the pretreatment program using the EPA's Guidelines[9] or other applicable guidelines or standards.
10. **Salt and Nutrient Management**
A summary of efforts to reduce salts and nutrients in the waste discharge, including any participation in a basin-wide salt and nutrient management plan.
11. **Collection System Management Plan**
Provide the date of collection system management plan(s), or reference reports submitted under separate cover as required by separate sanitary sewer requirements.
12. **Data Gaps**

[9] http://www.epa.gov/npdes/pubs/pretreatment_program_intro_2011.pdf

A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.

13. **Figures**
A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map with treatment components, discharge locations, monitoring locations, groundwater wells, storage locations (e.g. chemical, sludge, emergency overflow ponds, etc.), buildings, etc.

C. Technical Reports

In accordance with General Order Section E. Provisions the Discharger must prepare and implement the following reports **within 90 days of the date of this notice of applicability and MRP.** The reports must be maintained at the treatment facility and shall be presented to Central Coast Water Board staff upon request.

1. Spill Prevention and Emergency Response Plan.
2. Sampling and Analysis Plan (SAP). Anyone performing sampling on behalf of the Discharger shall be familiar with the SAP.
3. Sludge Management Plan.

10. ELECTRONIC SUBMITTAL

The Discharger must submit all reports/documents and laboratory data to the State Water Resources Control Board's GeoTracker[10] database for the San Jerardo WWTP in Monterey County (GeoTracker No. WDR100035146) over the internet at:

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml

Table 9 summarizes all the electronic reporting requirements. Staff may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the facility.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this Order and for other documents when requested by Central Coast Water Board staff.

[10] Information for first-time GeoTracker users is available here:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

Electronic Submittal	Description of Action	Action	Frequency
Laboratory data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Direct your State Certified Laboratory staff to upload all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Location Data (Geo XY)	Survey and mark all permanent sampling locations (i.e., monitoring wells, drinking water wells, and permanent influent/effluent sampling locations). These data points are required prior to laboratory data uploads	Upload the survey data to the GeoTracker GEO_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Survey and mark the elevation at the top of the groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file	One-time, for all groundwater monitoring wells
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

11. LEGAL REQUIREMENTS

Water Code section 13267 states, in part:

> "In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports."

Water Code section 13268 states, in part:

> "(a) Any person failing or refusing to furnish technical or monitoring reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).
>
> (b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars ($1,000) for each day in which the violation occurs."

The burden and cost of preparing the reports is reasonable and consistent with the interest of the state in maintaining water quality. The reports are necessary to ensure that the Discharger complies with the notice of applicability and General Order. Pursuant to Water Code section 13267, the Discharger must implement this MRP and must submit the monitoring reports described herein.

The Discharger must implement the above monitoring program as of the effective date of enrollment in the General Order. The executive officer may rescind or modify the MRP at any time.

Ordered by:

Digitally signed by Thea Tryon
Date: 2019.09.24 10:09:52 -07'00'

Water Boards

for John M. Robertson
Executive Officer