CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 89-177

WASTE DISCHARGE REQUIREMENTS
FOR
LINDEN COUNTY WATER DISTRICT
TREATMENT PLANT
SAN JOAQUIN COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds:

1. Linden County Water District Treatment Plant (hereafter Discharger) submitted a Report of Waste Discharge, dated 24 April 1987, and site evaluation report, dated 25 March 1987.

2. The Board, on 14 April 1967, adopted Resolution No. 67-109 which prescribed requirements for a discharge from Linden County Water District to Mormon Slough and to land for irrigation. However, discharge has been to land only.

3. The Discharger discharges an average of 122,000 gallons per day of domestic waste and proposes to discharge a maximum of 220,000 gallons per day of domestic waste to land with no irrigation or surface water discharge. The treatment facility includes a 0.55-acre aerated pond with two 10 Hp floating aerators, two existing evaporation/percolation ponds having a combined area of approximately 5.5 acres, and two new evaporation/percolation ponds having a combined area of approximately 5.1 acres.

4. Present waste discharge requirements established by the Board are neither adequate nor consistent with plans and policies of the Board.

5. The Report of Waste Discharge and monitoring reports describe the discharge as follows:

   Existing Flow: 0.122 million gallons per day (mgd)
   Proposed Maximum Flow: 0.220 mgd

Constituent	Influent (mg/l)	Effluent (mg/l)
BOD	110	24
SS	171	43

6. The treatment plant is in the southwest corner of Section 14, T2N, R8E, MDB&M, with surface water drainage to Mormon Slough. (See attached map made part of this Order.) The property (Assessor's Parcel No. 105-18-06) is owned by Linden County Water District.

7. The beneficial uses of Mormon Slough are municipal, industrial, and agricultural supply; recreation; aesthetic enjoyment; navigation; ground water recharge; fresh water replenishment; hydroelectric power generation; and preservation and enhancement of fish, wildlife and other aquatic resources.

8. The beneficial uses of the ground water are domestic, municipal, and agricultural supply. Ground water monitoring is necessary to assess the potential impact of the waste disposal ponds.

9. The Board, on 25 July 1975, adopted a Water Quality Control Plan (Basin Plan) for the Sacramento-San Joaquin River Basin (5B) which contains water quality objectives for all waters of the Basin. These requirements are consistent with that Plan.

10. The action to revise waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Code of Regulations (CCR).

11. This discharge is exempt from the requirements of Subchapter 15, Chapter 3, Title 23, of the CCR, pursuant to Section 2511(b) because the Board has issued waste discharge requirements, the discharge is in compliance with the Basin Plan, and the wastewater is not a 'hazardous waste' according to Chapter 30, Division 4, Title 22, CCR.

12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge, and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.

13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Resolution No. 67-109 be rescinded, and that Linden County Water District Treatment Plant, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. **Discharge Prohibitions:**

1. The direct discharge of wastes or effluent to surface waters or surface water drainage courses is prohibited.

2. The by-pass or overflow of untreated or partially treated waste is prohibited.

B. **Effluent Limitations:**

1. The discharge of effluent from the aerated pond in excess of the following is prohibited:

Constituent	Units	30-Day Average	Daily Maximum
BOD (1)	mg/l	50	90
Suspended Solids	mg/l	50	90
Settleable Solids	ml/l	--	0.2

(1) 5-day, 20°C Biochemical Oxygen Demand

C. **Discharge Specifications:**

1. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code, Section 13050.

2. The discharge shall not cause degradation of any water supply.

3. The discharge shall remain within the designated disposal area at all times.

4. The 30-day average daily dry weather discharge flow shall not exceed 0.22 million gallons.

5. Sludges and other solids removed from liquid wastes shall be disposed of in accordance with CCR, Title 23, Chapter 3, Subchapter 15.

6. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.

7. Wastewater ponds shall maintain a minimum of two feet of freeboard at all times.

D. **Provisions:**

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.

2. The Discharger shall submit a ground water monitoring proposal to include a minimum of three ground water monitoring wells. Prior to construction, plans and specifications shall be approved by Board staff. The Discharger shall submit the proposal including a time schedule for implementation within 60 days of adoption of this Order.

3. The Discharger shall comply with the attached Monitoring and Reporting Program No. 89-177, as ordered by the Executive Officer.

4. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 September 1985, which are a part of this Order.

5. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.

6. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.

7. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 September 1989.

William H. Crooks

WILLIAM H. CROOKS, Executive Officer

TLL:ej 8/23/89

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 89-177

FOR
LINDEN COUNTY WATER DISTRICT
TREATMENT PLANT
SAN JOAQUIN COUNTY

INFLUENT MONITORING

Samples shall be collected at the same frequency and at approximately the same time as effluent samples and should be representative of the influent for the period sampled.

The following shall constitute the influent monitoring program:

Constituents	Units	Type of Sample	Frequency
BOD	mg/l	24-hour Composite	Weekly
Suspended Solids	mg/l	24-hour Composite	Weekly
Flow	mgd	Continuous	Daily

EFFLUENT MONITORING

Samples shall be collected at the outlet of the aeration pond before going into the percolation/evaporation ponds and shall be representative of the effluent for the period sampled.

Constituents	Units	Type of Sample	Frequency
BOD	mg/l	24-hour Composite	Weeky
Suspended Solids	mg/l	24-hour Composite	Weeky
Settleable Solids	mg/l	Grab	Weeky
TDS	mg/l	24-hour Composite	Quarterly
Nitrates	mg/l	24-hour Composite	Quarterly

EVAPORATION/PERCOLATION POND MONITORING

Constituents	Units	Type of Sample	Frequency	Location
Dissolved Oxygen	mg/l	Grab	Weeky	Each Pond
Pond Freeboard	feet	--	Weekly	Each Pond

GROUND WATER MONITORING

At least one monitoring well shall be located upgradient of the wastewater treatment area, and at least two monitoring wells shall be located downgradient of the wastewater treatment area. Prior to construction, plans and specifications for ground water monitoring wells shall be submitted to Board staff for review and approval. These wells shall be monitored for the following:

Constituents	Units	Frequency
Total Dissolved Solids	mg/l	Quarterly
Nitrates	mg/l	Quarterly
Total Coliform Organisms	MPN/100ml	Quarterly

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the municipal water supply can be obtained. The following shall constitute the water supply monitoring program:

Constituents	Units	Sampling Frequency
Standard Minerals[1]	mg/l	Quarterly

[1]Standard Minerals include Total Dissolved Solids, Electrical Conductivity, Chloride Sulfate, Nitrate, Bicarbonate Alkalinity, Carbonate Alkalinity, Calcium, Magnesium, Potassium, Sodium, pH, Hardness

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by William H. Crooks
WILLIAM H. CROOKS, Executive Officer

22 September 1989
(Date)

TLL:ej 8/23/89

LINDEN COUNTY WATER DISTRICT
WASTEWATER TREATMENT PLANT
SAN JOAQUIN COUNTY

Section 14, T2N, R8E, MDB&M
Scale: 1 inch = 2,000 feet N
1 cm = 240 meters

ATTACHMENT 1

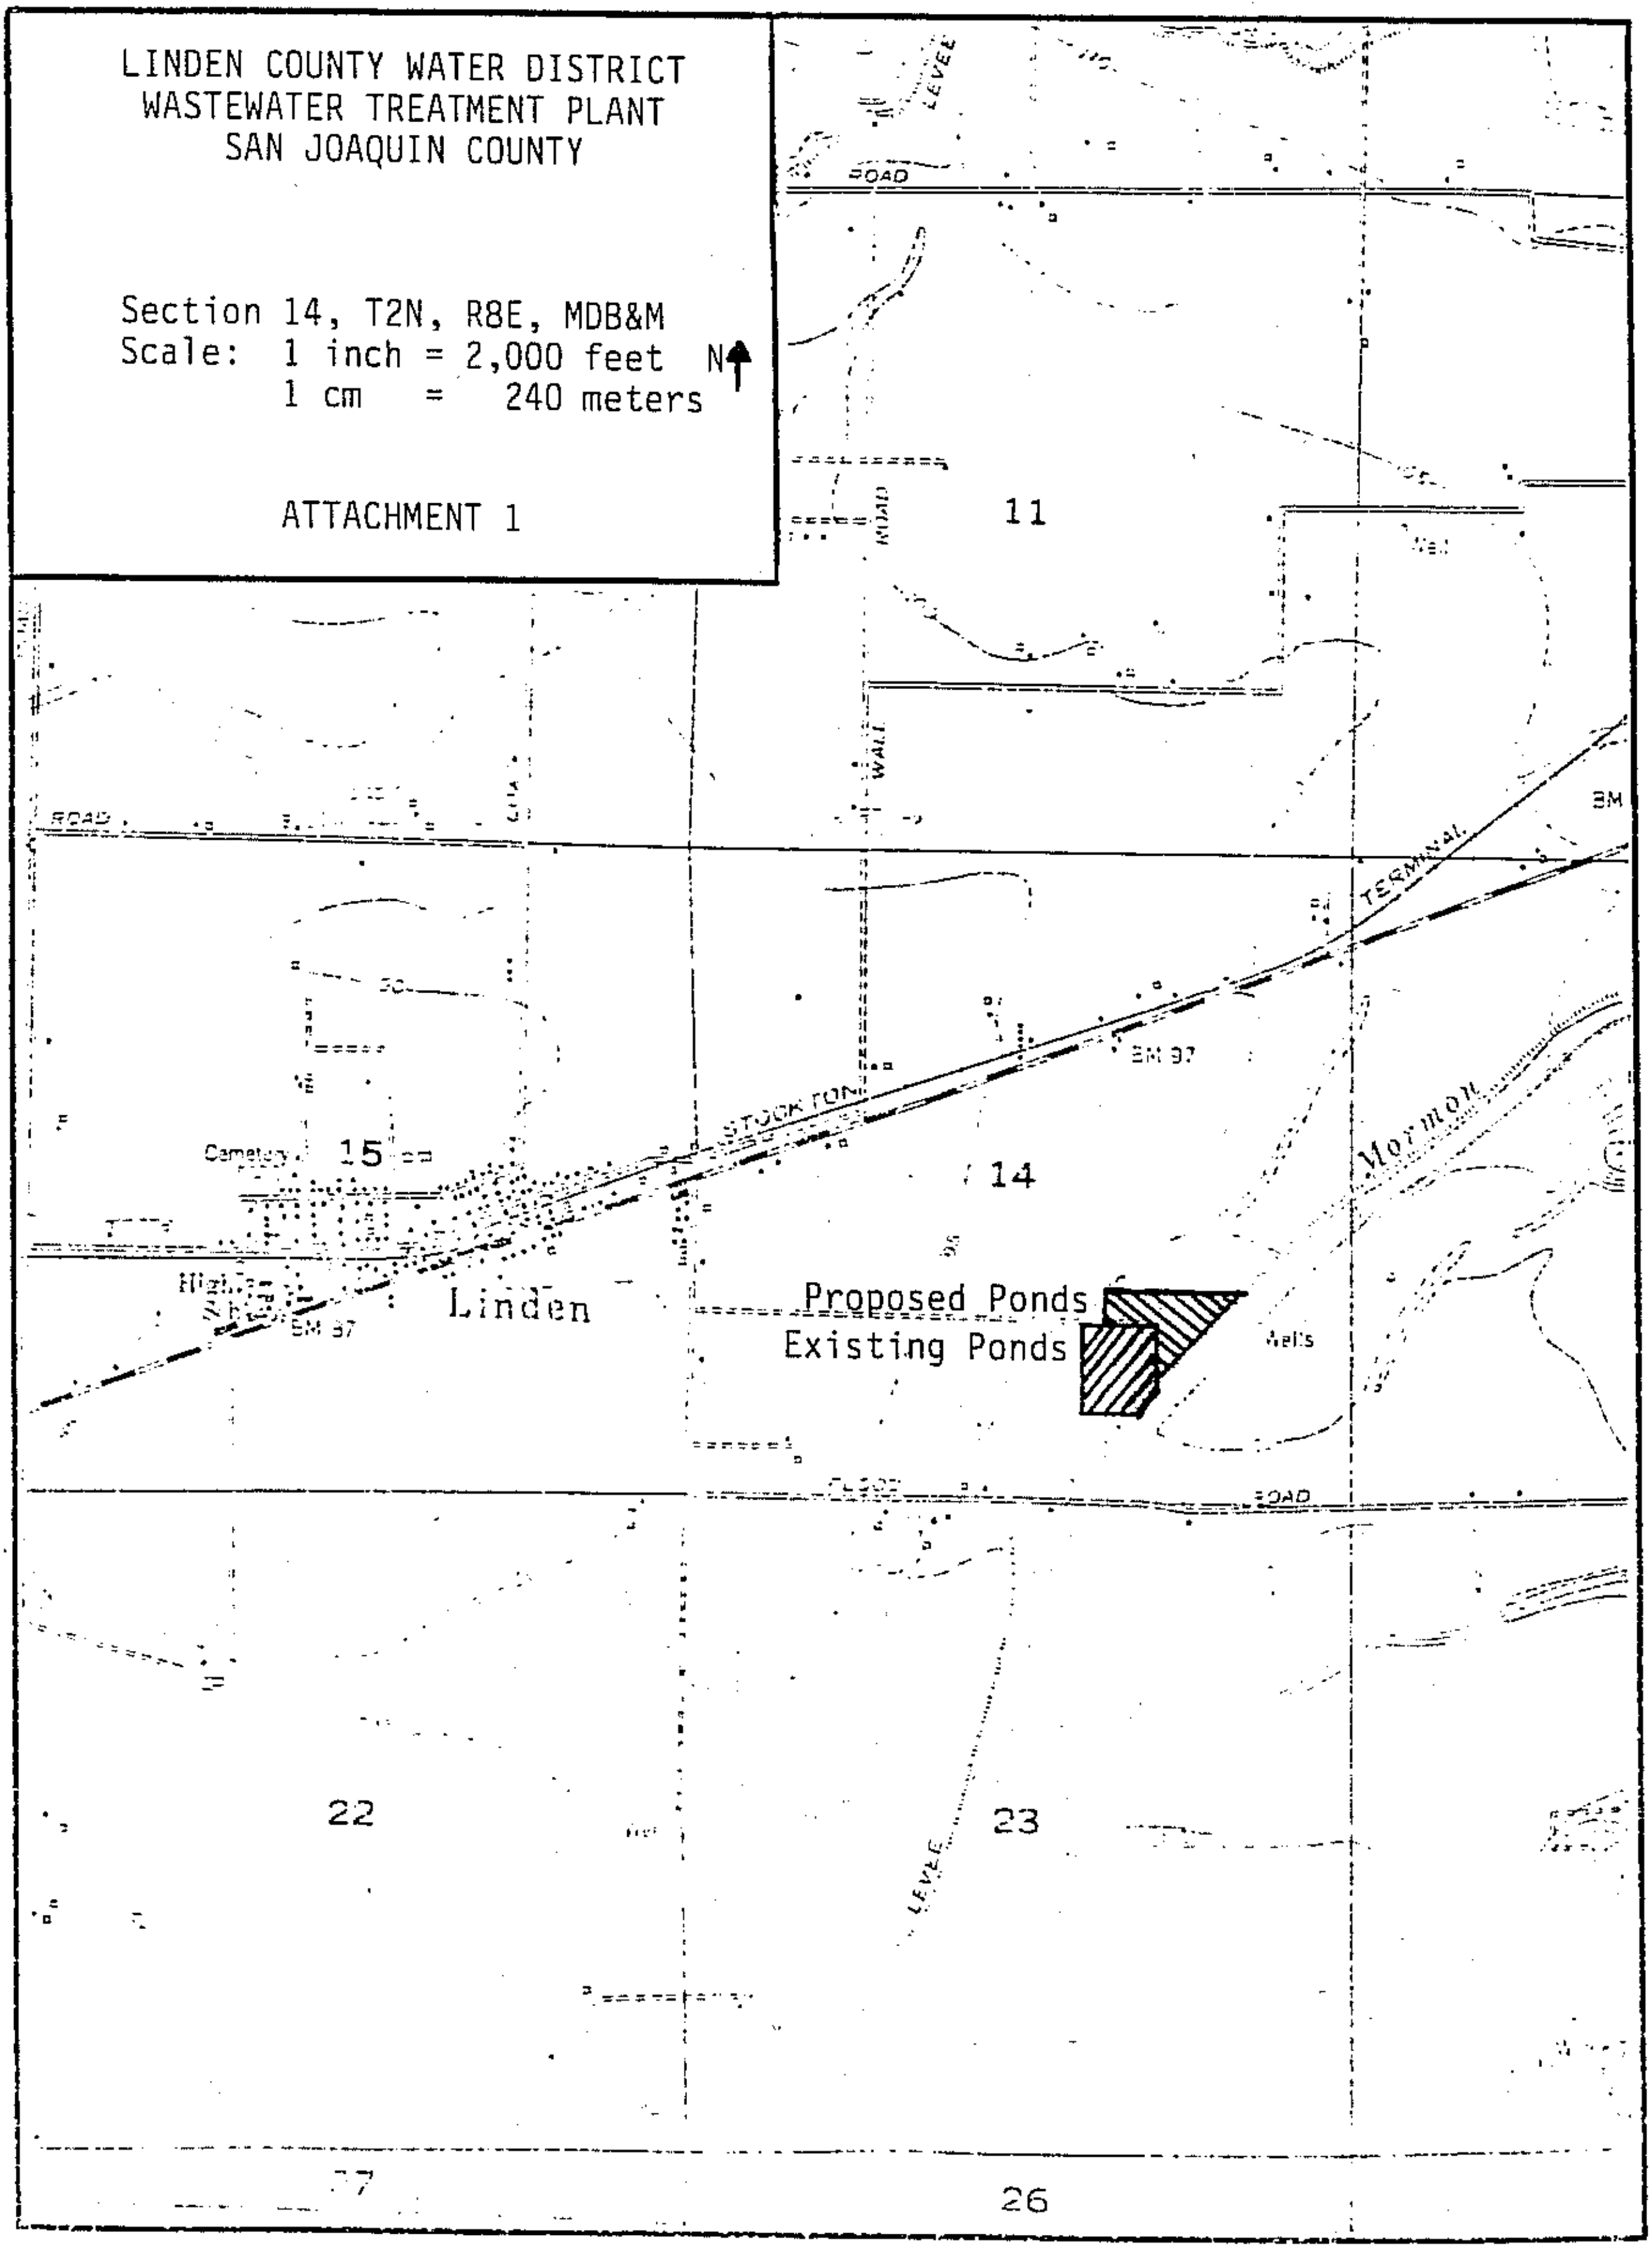

INFORMATION SHEET

LINDEN COUNTY WATER DISTRICT
TREATMENT PLANT
SAN JOAQUIN COUNTY

Linden County Water District discharges 122,000 gallons per day of domestic wastewater into an aeration pond followed by two evaporation/percolation (E/P) ponds (combined area of 5.5 acres). Resolution No. 67-109 prescribed requirements for discharge to Mormon Slough and to land for irrigation. However, discharge to surface water was never used; current discharge is to land only. The ponds are adjacent to Mormon Slough, southeast of Linden. Surface water drainage is to Mormon Slough.

The District proposes to increase its capacity to a maximum of 220,000 gallons per day by installing two more E/P ponds (combined area of 5.1 acres for a total E/P pond area of 10.6 acres). The design flow capacity, including the two new ponds, would be 240,000 gallons per day.

Soils in the vicinity consist of clays and silts. An assumed rate of percolation used for analysis was 0.60 gpd/sq.ft. which approximates actual rates for the ponds. Annual precipitation is near 17.5 in/year. Board staff has reviewed calculations based on flow, pond area, percolation, precipitation, and evaporation, and has determined there is adequate treatment and storage capacity.

Effluent limits of 50 mg/l for BOD and suspended solids are intended to prevent odors and ground water degradation. Settleable solids limit of 0.2 mg/l is intended to prevent clogging of percolation ponds. Limits are based on similar sites and requirements.

A ground water monitoring program will be implemented because there is local domestic use of ground water.

TLL:ej