Central Coast Regional Water Quality Control Board

June 15, 2022

Sent Via Electronic Mail

Jeffrey Lindgren
Santa Barbara County
123 E. Anapamu Street, Second Floor
Santa Barbara, CA 93101
Email: jlindgren@sbparks.org

Dear Jeffrey Lindgren,

CACHUMA LAKE RECREATION AREA WASTEWATER TREATMENT PLANT, 579 SAN MARCOS PASS ROAD, SANTA BARBARA, CA 93105, SANTA BARBARA COUNTY:

- **NOTICE OF APPLICABILITY FOR SANTA BARBARA COUNTY ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0042**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. 98-10**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the notice of intent serving as an application (also referred to as a report of waste discharge) received on March 18, 2022, and available documents associated with the domestic wastewater treatment system at Cachuma Lake Recreation Area owned by Santa Barbara County. The wastewater system is currently regulated pursuant to Order No. 98-10. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 98-10.

This letter serves as a notice of applicability for enrollment in the General Permit for the discharge of wastewater from Cachuma Lake Recreation Area Wastewater Treatment Plant (WWTP).

This letter also includes a wastewater system operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Santa Barbara County must comply with the following:

1. **General Permit** – Santa Barbara County must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

   https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

1. **Monitoring and Reporting Program** – Santa Barbara County must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0042, enclosed with this letter (Attachment 3) beginning August 1, 2022. Your first semiannual report is due on **February 1, 2023.**

   Monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

   https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

   Santa Barbara County must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker[1,2] database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100035711 at:

   https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

   The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

2. **Fees** – Santa Barbara County paid an annual fee on January 25, 2022 for coverage in the existing individual permit, Order No. 98-10. This payment covers permit fees for the 2021-2022 fiscal year.

   Santa Barbara County must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee

[1] Information for first-time GeoTracker users is available at:
https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

[2] Additional information available at: http://geotracker.waterboards.ca.gov/

program and cover the state fiscal year of July 1 through June 30. Beginning July 1, 2022, the annual fee will be $11,891.50. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

3. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on August 25-26, 2022. Details about that meeting are available on our website at:

   http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

4. **Termination of Existing Permit** – Pursuant to Order No. R3-2021-0008, the existing permit, Order No. 98-10, is hereby terminated, except for enforcement purposes. Santa Barbara County is responsible for compliance with the Order No. 98-10 prior to the date of this letter. Order No. 98-10 is listed in Attachment 1 of Order No. R3-2021-0008 as an existing permit that may be appropriately regulated under a General Permit.

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.

6. **Responsible Party** – Santa Barbara County is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Santa Barbara County to enforcement action and termination of enrollment under this General Permit.

7. **Change in Ownership** – In the event of any change in control or ownership of the property, Santa Barbara County must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.

8. **Certified Operator** – Santa Barbara County is required to comply with the operator certification requirements[3] administered by the State Water Board's Office of Operator Certification, which currently requires a Class III certified operator onsite to maintain and operate the treatment system.

If you have any questions, please contact **Cecile Blancarte at (805) 542-4782 or by email at Cecile.Blancarte@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp Digitally signed by Jennifer Epp
Date: 2022.06.15 12:46:41 -07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
Attachment 2: Figures
Attachment 3: Monitoring and Reporting Program No. R3-2022-0042

cc:

Thomas Drewes, tdrewes@countyofsb.org
Todd Stapien, tstepien@countyofsb.org
Scott Springer, sspringer@usbr.gov
Jason Johnston, jason.johnston@sbcphd.org
Todd Stanley, todd.stanley@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
Cecile Blancarte, Cecile.Blancarte@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-2124552
GeoTracker No. = GT- WDR100035711
Rev 5/4/22
Subject Name = Cachuma Sanitation – WWTP Wastewater Permit
\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Santa Barbara Co\Cachuma Lake WWTP\0153 Enrollment\NOA-MRP 2022\NOA 0153- Cachuma Sanitation-0622_final_signed.docx

[3] Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

ATTACHMENT 1

WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC REQUIREMENTS AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Santa Barbara County to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Cachuma Lake Recreation Area WWTP
Facility Address	579 San Marcos Pass Road Santa Barbara, CA 93105
Parcel Numbers	WWTP: 141-290-054 Recreation Area Parcels: 145-160-072 through 145-160-075 and 145-160-088 Individual Recreational Vehicle (RV) Site Parcels: 645-160-001 through 645-160-099, 645-161-000 through 645-161-009,
Parcel Ownership	United States Department of Interior Bureau of Reclamation Mid-Pacific Regional Office 2800 Cottage Way Sacramento, California 95825-1898 Contact: Scott Springer 916-978-5266\ Email: sspringer@usbr.gov Agreement Number 11-LV-20-0223 Expires March 14, 2037
Latitude/Longitude	34.578439/-119.979036
Onsite Manager	Todd Stepien
Owner of Facility	Santa Barbara County
Legally Responsible Official of Owner	Jeffrey Lindgren
Owner Mailing Address	123 E. Anapamu Street, Second Floor Santa Barbara, CA 93101
Billing Address	123 E. Anapamu Street, Second Floor Santa Barbara, CA 93101
Design Flow (gallons per day, gpd)	Maximum daily capacity (dry weather flow) 49,999

Baseline Flow (average annual flow) in gpd	17,850
Operators	Tom Drewes, Chief Plant Operator, Grade III There is no system control and data analysis (SCADA) system present.
Waste type and Service Area	110 RV wastewater sanitary hook-ups and 30 other domestic wastewater connections from public bathrooms, concessionaires, and cabins. There is a total of 140 connections.
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No

2. NEARBY SURFACE WATER BODIES

Hilton Canyon Creek, an intermittent tributary to the Santa Ynez River, is located adjacent to the western edge of the Land Application Area (LAA) and flows in a northwesterly direction. The nearest shoreline of the Cachuma Reservoir (a.k.a. Cachuma Lake) is approximately 650 feet northeast of the storage ponds and 500 feet northeast of the LAA.

3. WASTEWATER SYSTEM OPERATION SUMMARY

The treatment system is composed of sanitary sewer conveyance piping, three lift stations, solids screening, aerobic activated sludge treatment system, and a sludge dewatering containment area. Recent analysis of the wastewater system's influent and effluent for formaldehyde presents detectable levels ranging between 120 micrograms per liter (µg/L) to 450 µg/L.

A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Aerobic Activated Sludge Treatment & Land Application Area

Design Flows	Influent Daily Flow Maximum Design Capacity is 49,999 gallons gpd. Effluent Disposal Maximum Design Capacity is 220,000 gpd

Headworks/Preliminary Treatment	Bar Screen Rakings and Grit Removal
Treatment	Aerobic Conventional Activated Sludge with a Clarifier Tank System.
Disinfection	n/a
Effluent Storage	Two Clay Lined Evaporation Ponds. Total Volume is 4.5-acre feet.
Disposal	Evaporation ponds and land application area onto native ground cover.
Biosolids/Sludge Production and Handling	Solids are dewatered onsite in drying beds and hauled off-site by contractor.

4. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Santa Barbara County must operate the facility in accordance with the General Permit and this notice of applicability.[4] Santa Barbara County must operate the wastewater system to comply with the effluent limitations specified below in Tables 3 and 4.

Flow limitations are shown in Table 3. Effluent limitations are shown in Table 4.

Table 3. Flow Limitations

Constituent	Unit	Limit	Point of Compliance[1]
Flow	gpd	49,999 (maximum daily flow)	Effluent (ES-1)

[1] Refer to monitoring and reporting program for sampling locations

Table 4. Effluent Limitations

Constituent	Unit	Limit	Point of Compliance[1]
Total Suspended Solids (TSS)	mg/L	30 (monthly average) 45 (7-day average)	Effluent (ES-1)

[4] General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

Constituent	Unit	Limit	Point of Compliance[1]
Five-Day Biochemical Oxygen Demand (BOD_5)	mg/L	30 (monthly average) 45 (7-day average)	Effluent (ES-1)
Total N	% Influent versus Effluent	50% Removal	Effluent (ES-1)

[1] Refer to monitoring and reporting program for sampling locations

5. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Santa Barbara County must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).[5] These objectives include:

1) General objectives for taste and odors and radioactivity for all groundwaters.
2) General objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
3) Specific objectives for the groundwater basin where the discharge occurs. This facility overlies the Santa Ynez River Valley – Santa Ynez Sub-Area groundwater aquifer, and the Basin Plan's groundwater objectives are included in Table 5.

Table 5. Basin Plan, Median Groundwater Objectives (mg/L)

Constituent	Median Groundwater Objective for Santa Ynez Sub-Area
Total Dissolved Solids (TDS)	600
Sodium	20
Chloride	50
Sulfate	10
Boron	0.5
Total Nitrogen as N	1

[5] Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

mg/L = milligrams per liter

The Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time but may require installation of groundwater monitoring wells in the future.

ATTACHMENT 2

FIGURES

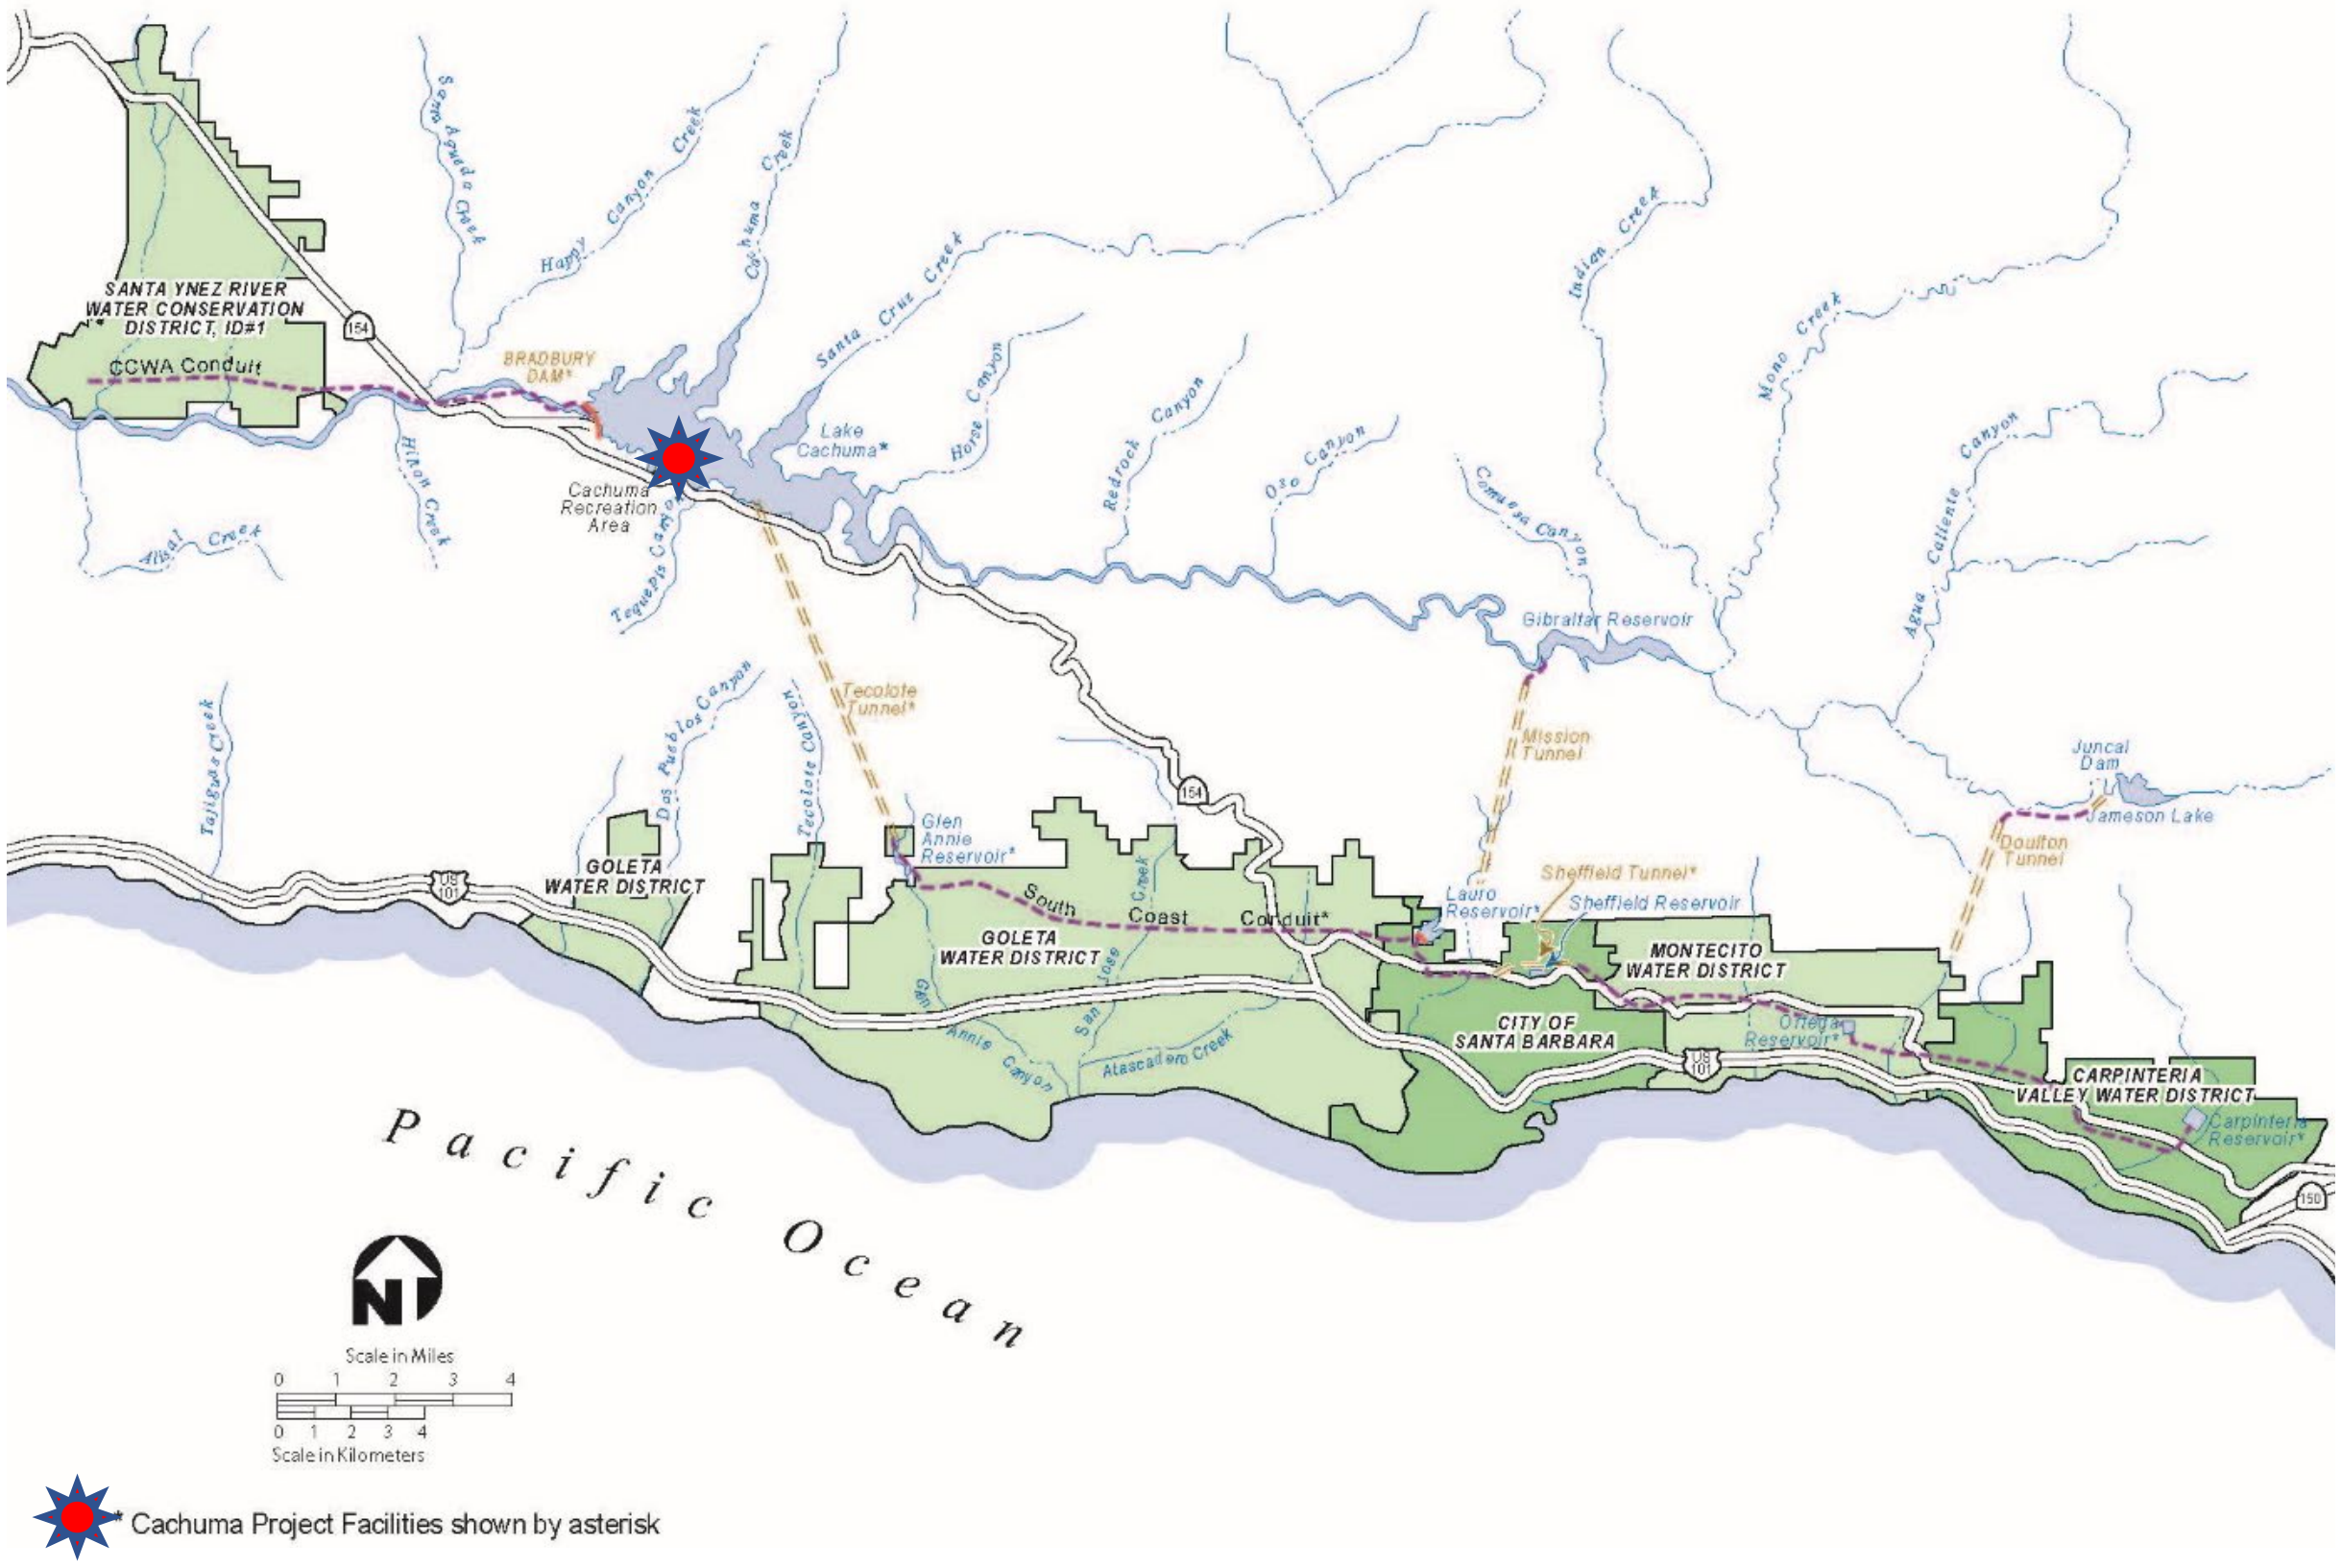

Figure 1. Site Location Map

Figure 2. Wastewater Treatment Area Map

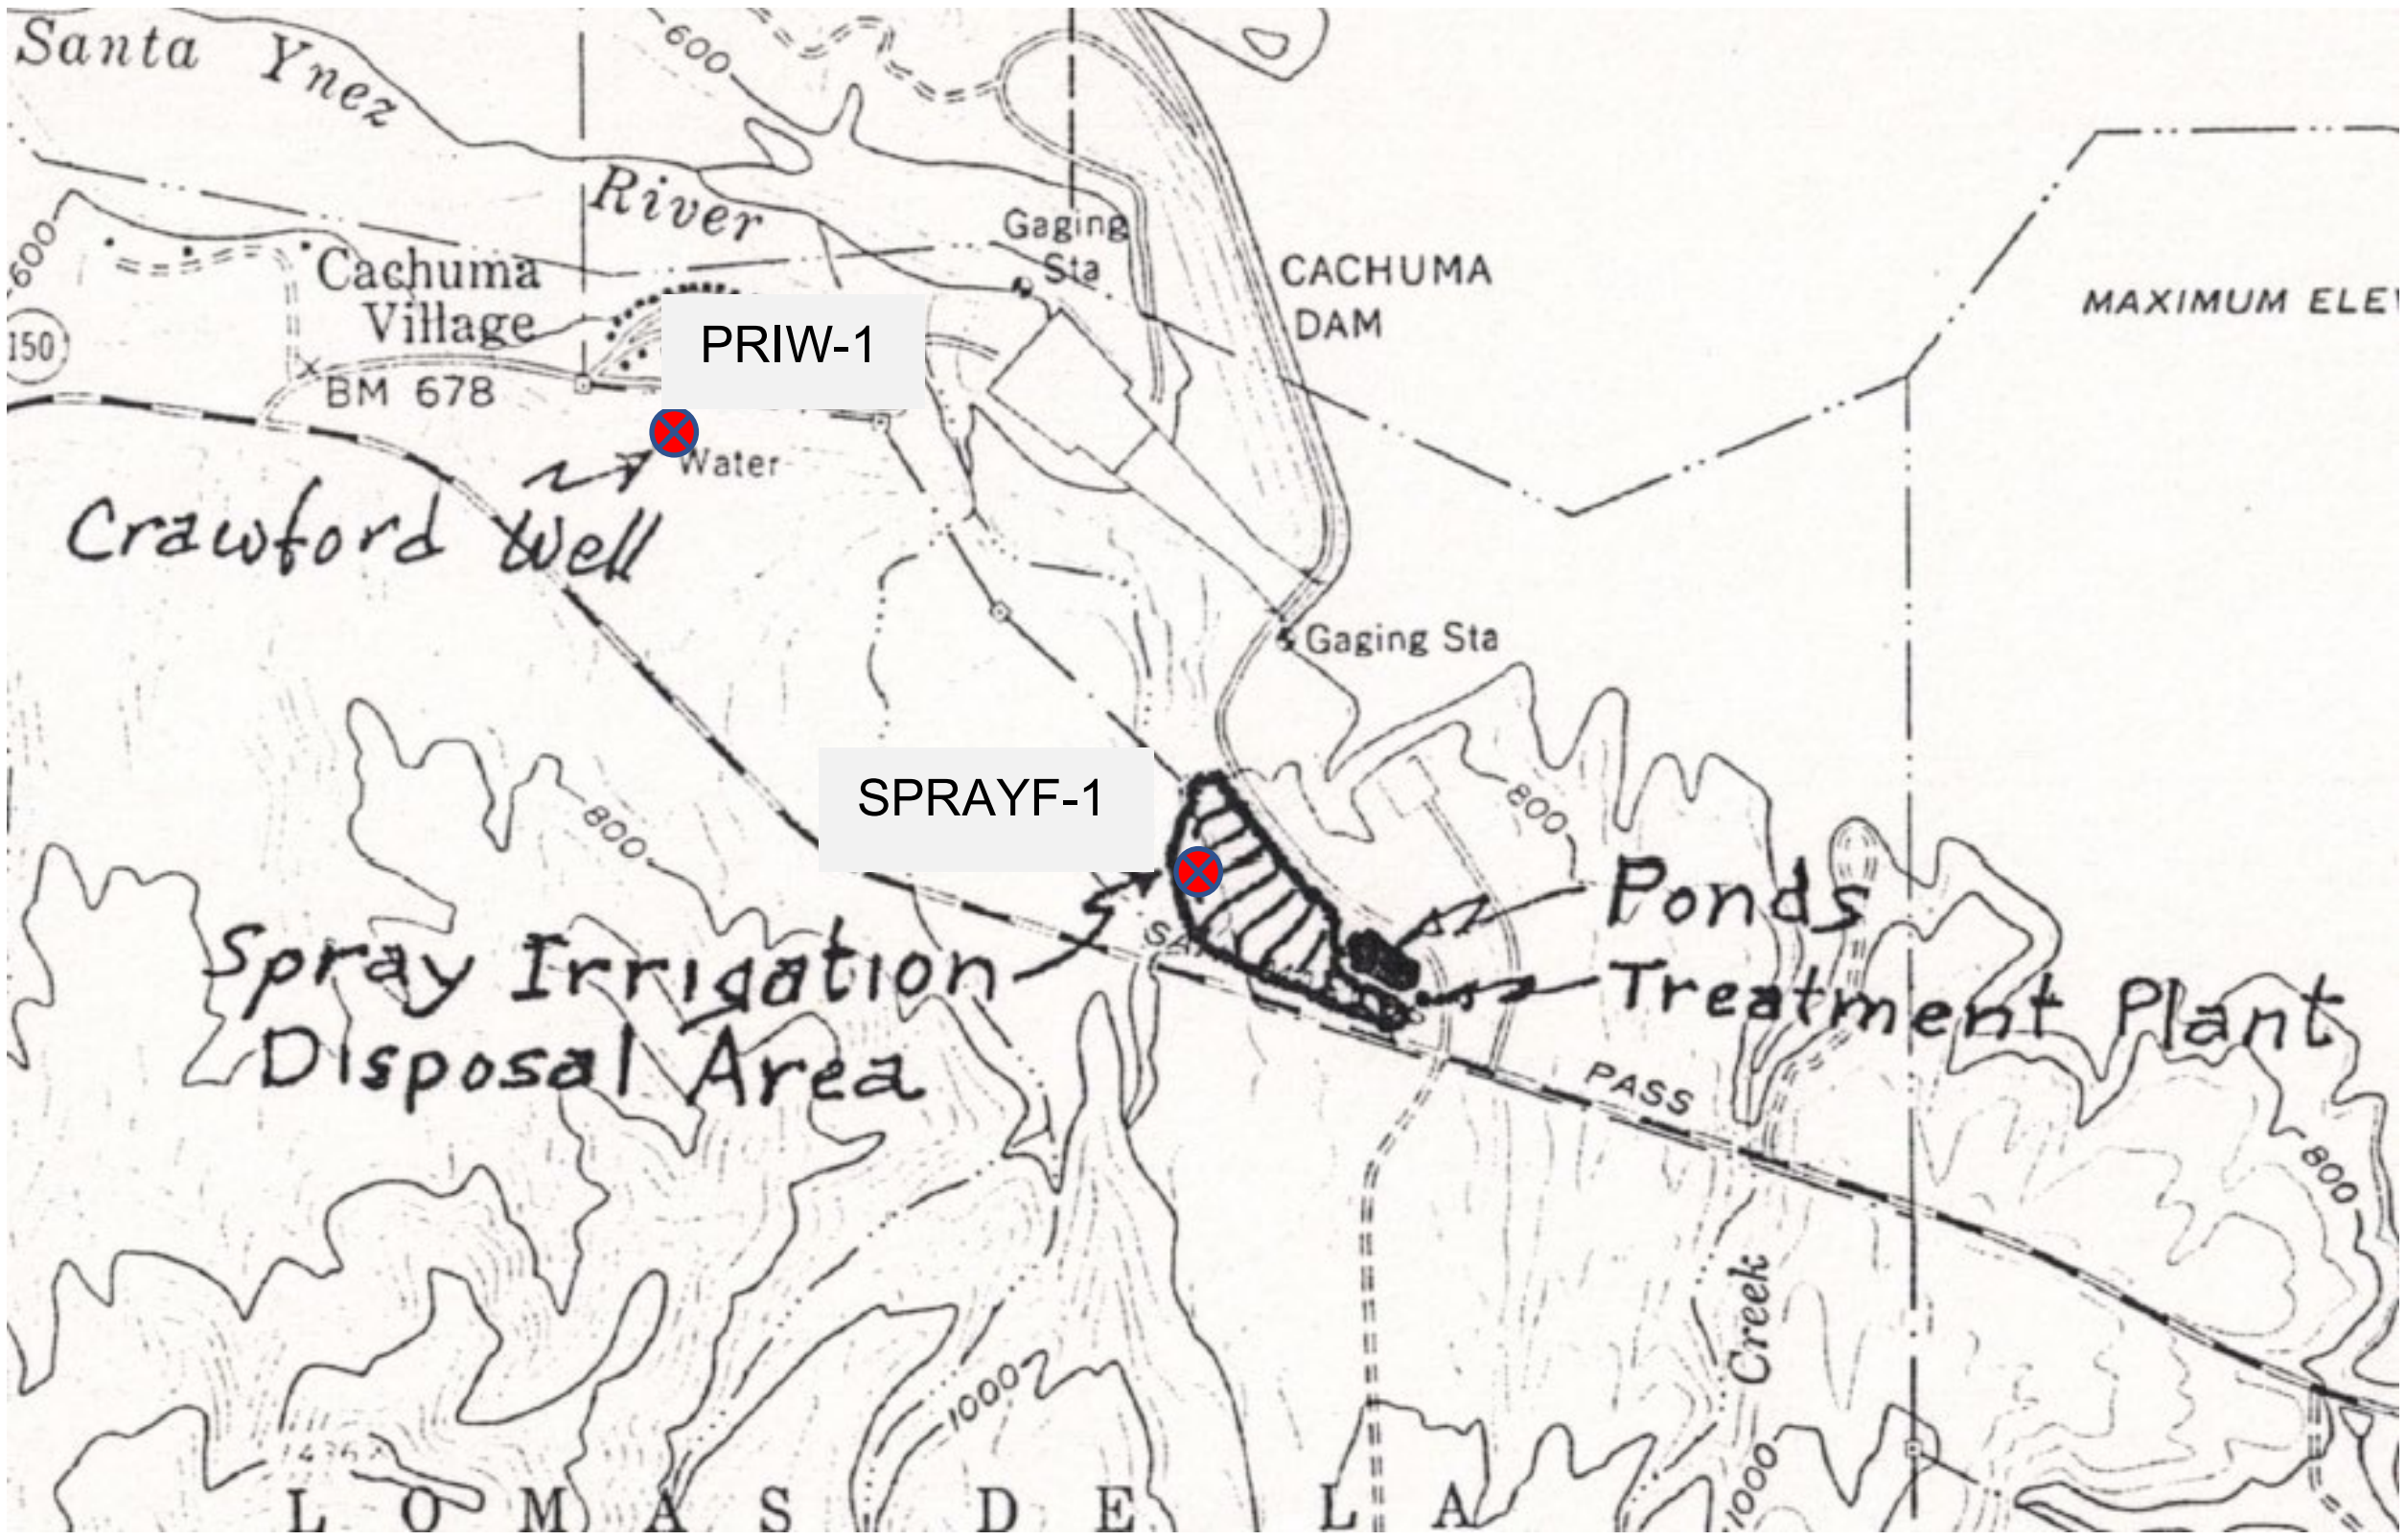

Figure 3. Land Application Area Map and Crawford Well

Figure 4a. Sanitary Sewer Collection Systems – Mohawk Area

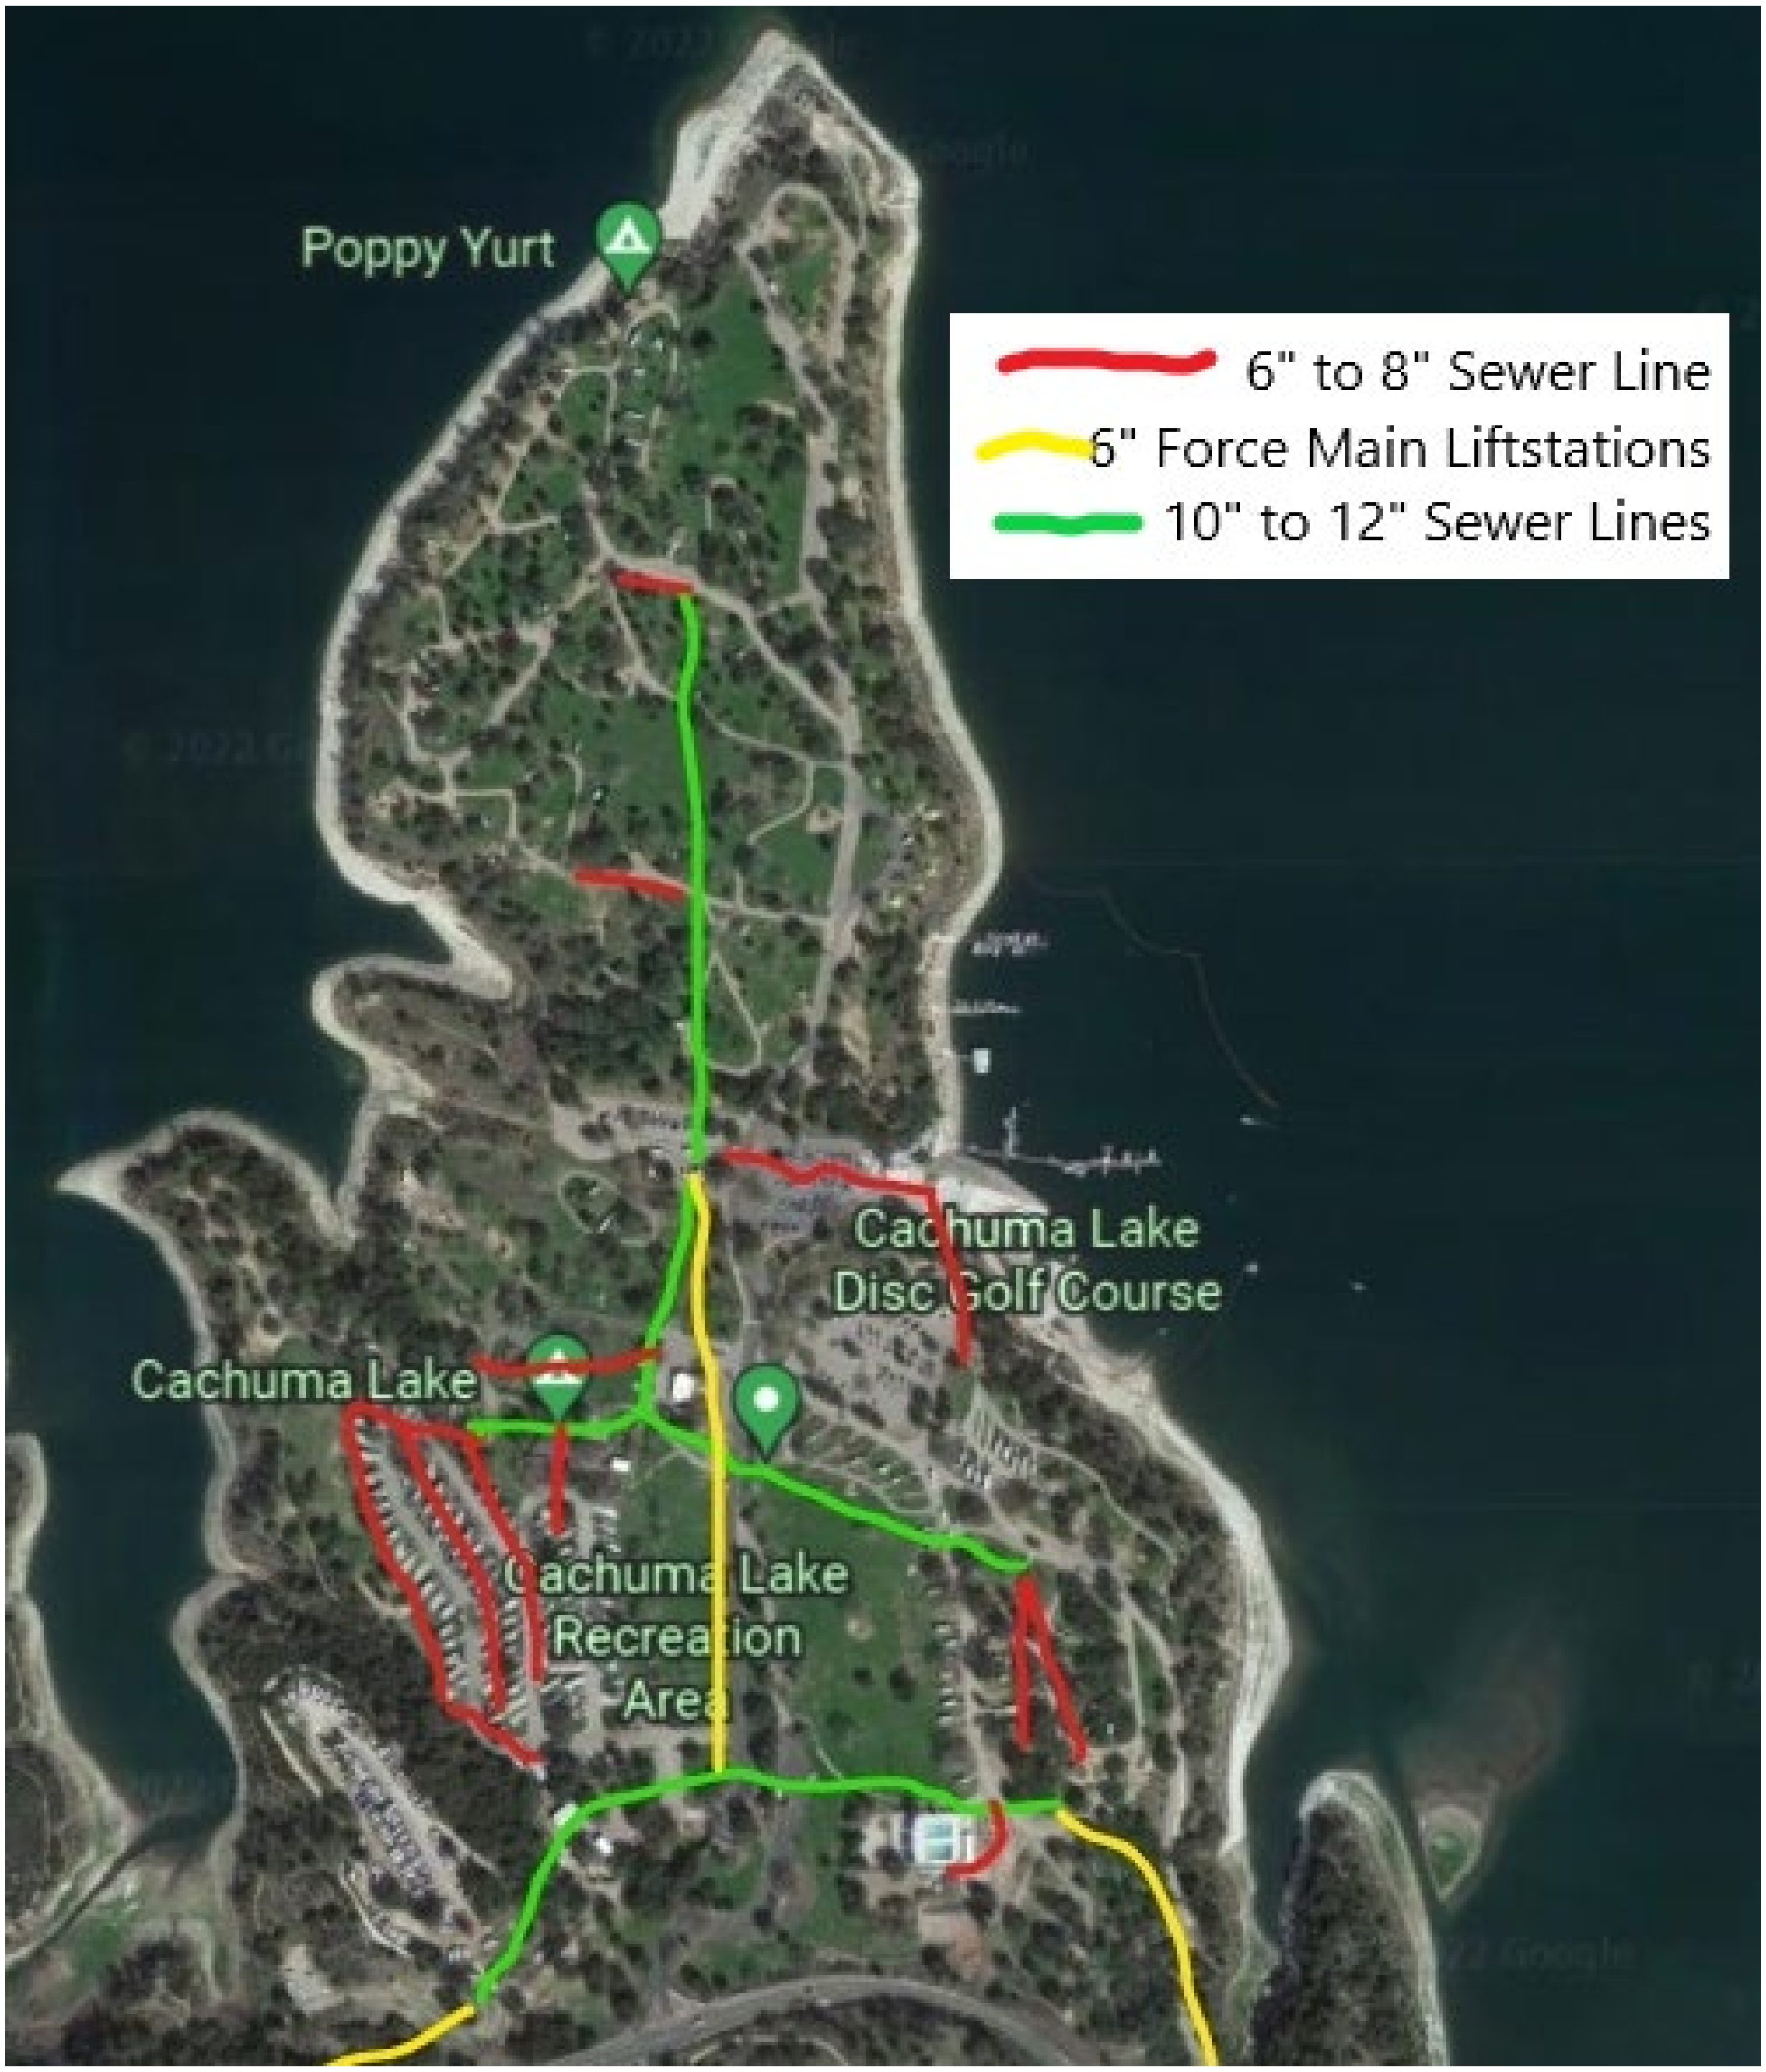

Figure 4b. Sanitary Sewer Collection System – Cachuma Lake Recreation Area

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION

MONITORING AND REPORTING PROGRAM NO. R3-2022-0042

for

CACHUMA LAKE RECREATION AREA WASTEWATER TREATMENT PLANT SANTA BARBARA COUNTY

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for the Santa Barbara County Cachuma Lake Recreation Area Wastewater Treatment Plant located at 579 San Marcos Pass Road in Santa Barbara, California 93105. Santa Barbara County must begin implementation of this monitoring and reporting program by August 1, 2022.

Santa Barbara County owns and operates the wastewater system that is subject to the notice of applicability dated June 15, 2022, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 2.

Table 2. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample after screening and before aeration tanks
Effluent Sample – 1	ES-1	Representative grab sample after clarifier and before evaporative ponds
Effluent Sample – 2	ES-2[1]	Representative grab sample after evaporation ponds and before spray irrigation.
Private Monitoring Well	PRIW-1[1]	Crawford Private Water Supply Well
Water Supply	RES-1	Water Supply Sample from LAKE CACHUMA - RAW (CA4200911_007_007)
Evaporation Pond -1	EP-1	Evaporation Pond 1
Evaporation Pond – 2	EP-2	Evaporation Pond 2
Land Application Area	SPRAYF	Land Application Area (a.k.a. spray disposal field)

1. Monitoring at this location is not currently required.

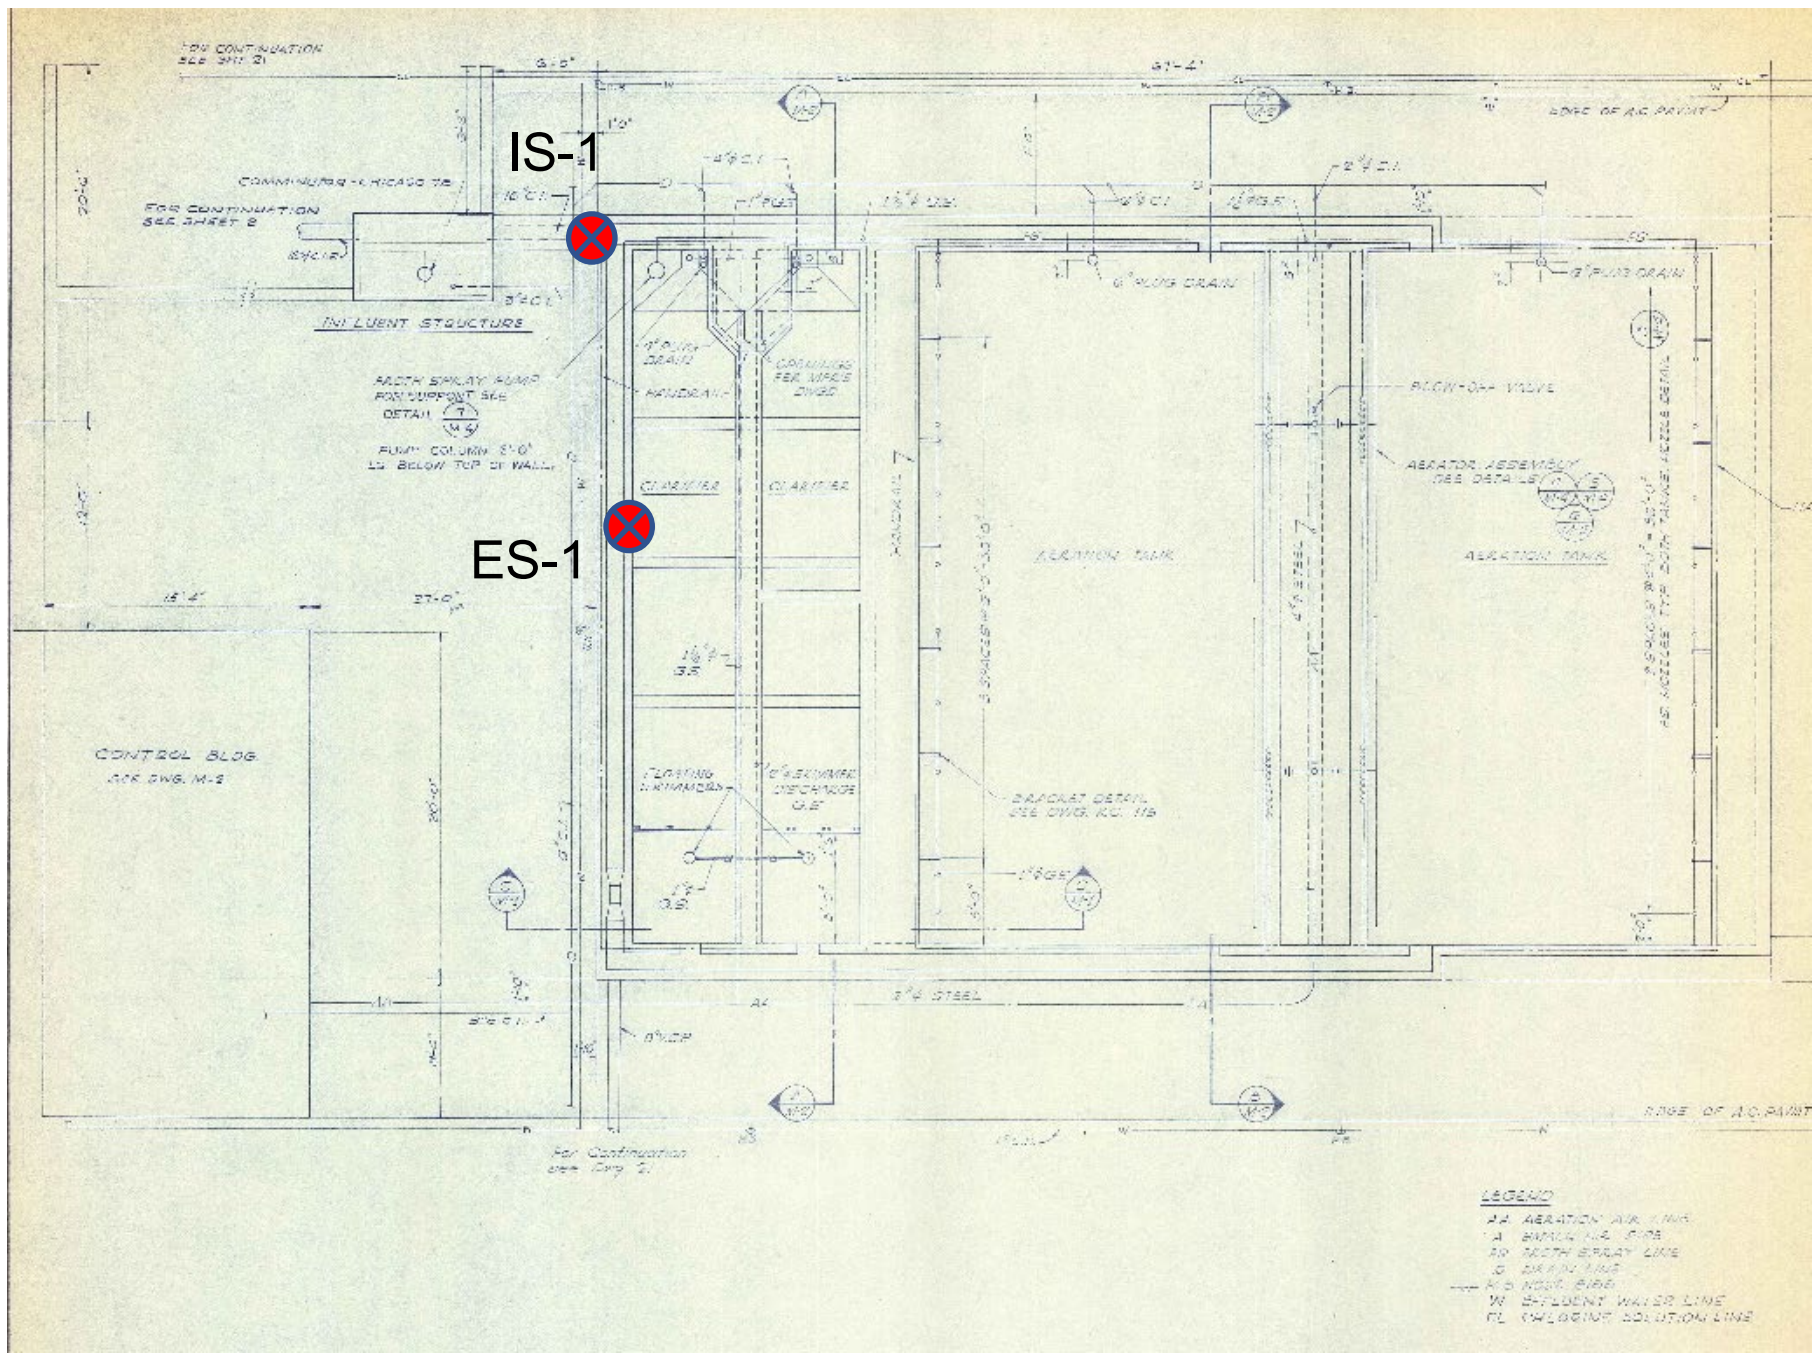

Figure 1. Treatment System Diagram with Sample Locations IS-1 and ES-1

Figure 2. Sample locations ES-2, EP-1, and EP-2

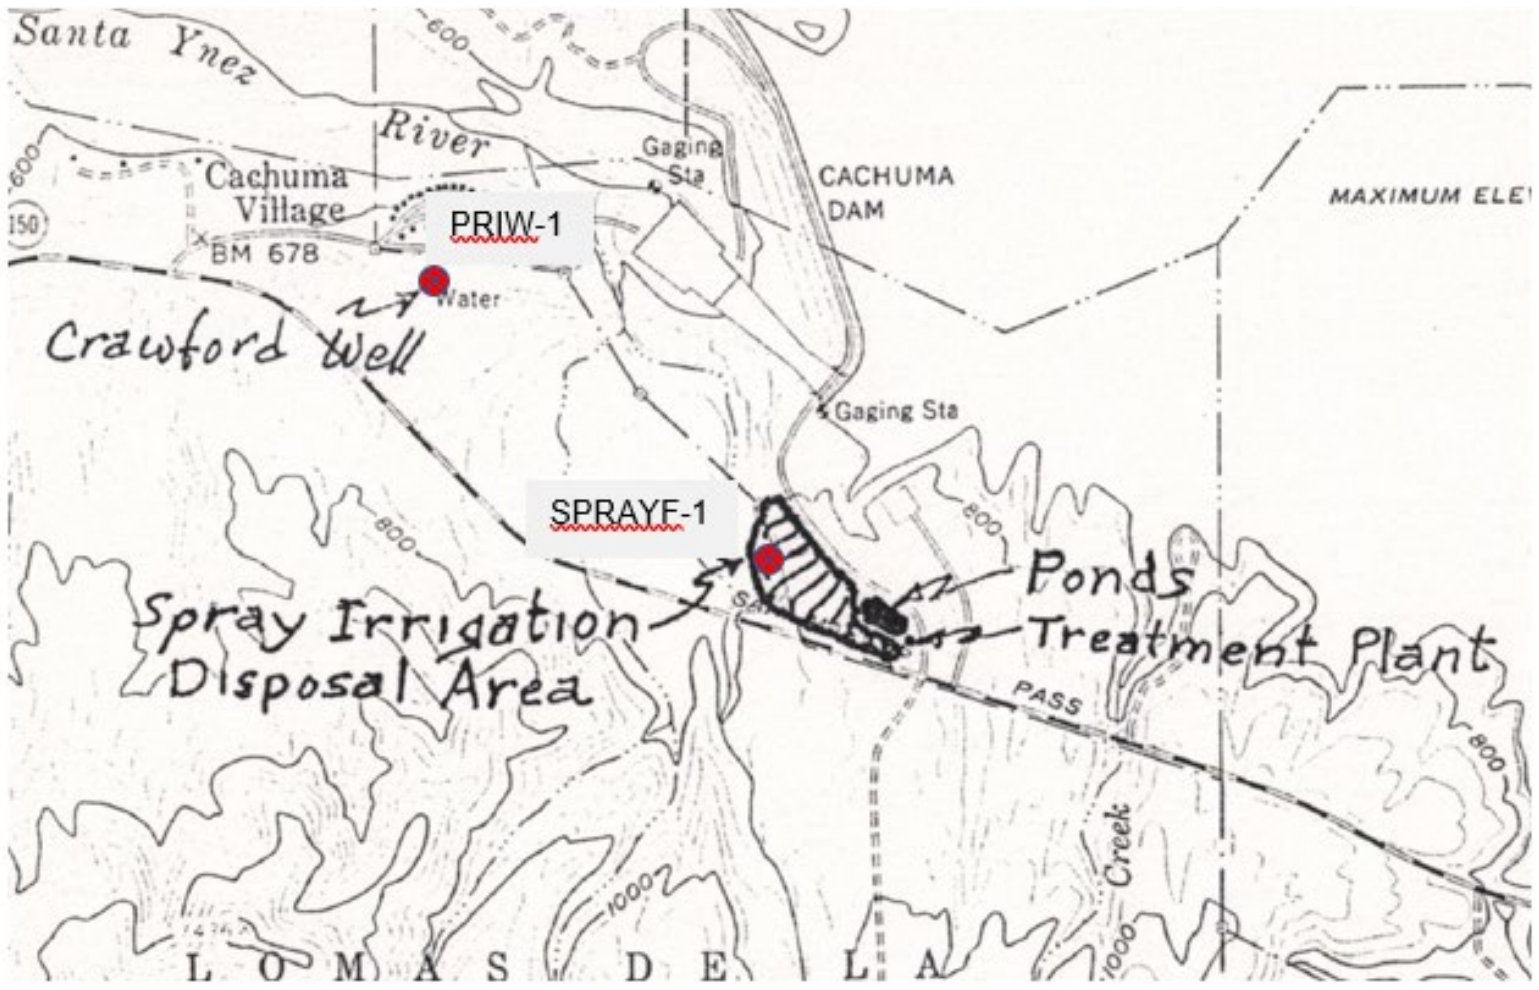

Figure 3. Sample locations PRIW-1 and SPRAYF-1

3. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 3 prior to any disinfection.

In lieu of the required water supply sampling, Santa Barbara County may request approval to submit a Water System Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Santa Barbara County must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Santa Barbara County must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 3. Water Supply Monitoring RES-1

Constituent	Units	Sample Type	Sampling Frequency
pH	pH Units	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Total Dissolved Solids (TDS)	mg/L	Grab	Annually
Total Nitrogen	mg/L	Grab	Annually
Formaldehyde	µg/L	Grab	Annually
Fecal Coliforms	MPN/100 mL	Grab	Annually

mg/L = milligram per liter
µg/L = micrograms per liter
MPN/100 mL = Most Probable Number per 100 milliliters

4. AEROBIC ACTIVATED SLUDGE TREATMENT UNIT MONITORING

a. Flow Monitoring

Santa Barbara County must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at sample location ES-1 after the clarifier.

Table 4. Flow Monitoring ES-1

Parameter	Units	Sample Type	Reporting Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

b. Influent and Effluent Constituent Monitoring

Representative samples of Cachuma Lake Recreation Area WWTP's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must use the "grab" sample method.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
pH	pH units	Quarterly	Monthly
Biochemical Oxygen Demand, 5-Day	mg/L	Monthly	Monthly
Total Suspended Solids	mg/L	Monthly	Monthly
Settleable Solids	ml/L	Monthly	Monthly
Total Dissolved Solids	mg/L	Quarterly	Quarterly
Total Nitrogen	mg/L	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species[1]	mg/L	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly
Ammonia	mg/L	Quarterly	Quarterly
Chloride	mg/L	Quarterly	Quarterly
Sodium	mg/L	Quarterly	Quarterly
Sulfate	mg/L	Quarterly	Quarterly
Formaldehyde	mg/L	Monthly	Monthly

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Phenolic Compounds	mg/L	Monthly	Monthly
Boron	mg/L	Not applicable	Semiannually
Sulfate	mg/L	Not applicable	Semiannually

ml/L = milliliter per liter

5. POND MONITORING

Representative samples of the wastewater contained in the evaporative ponds must be collected and analyzed as follows:

Table 6. Pond Monitoring EP-1 and EP-2

Constituent	Units	Sample Type	Sampling Frequency
Dissolved Oxygen	mg/L	Grab[a]	Monthly
Freeboard	feet or inches	Measured	Weekly

a. Grab samples to be taken at 1-foot depth

6. LAND APPLICATION AREA MONITORING

Santa Barbara County shall monitor the land application area when wastewater is applied. If wastewater is not applied during a reporting period, the monitoring report shall so state. Land application area monitoring shall include the parameters listed in Table 7.

Table 7. Land Application Area Monitoring SPRAYF

Parameters	Units	Sample Type	Sampling Frequency	Reporting Frequency
Supplemental Irrigation	gpd	Meter[a]	Monthly	Quarterly
Wastewater Flow	gpd	Meter[a]	Monthly	Quarterly
Local Rainfall	Inches	Weather Station[b]	Monthly	Quarterly
Acreage Applied[c]	Acres	Calculated	Monthly	Quarterly
Application Rate	gal/acre/mo[d]	Calculated	Monthly	Quarterly
Soil Erosion Evidence	--	Observation	Monthly	Quarterly
Containment Berm Condition	--	Observation	Monthly	Quarterly
Soil Saturation/Ponding	--	Observation	Monthly	Quarterly

Parameters	Units	Sample Type	Sampling Frequency	Reporting Frequency
Nuisance Odors/Vectors	--	Observation	Monthly	Quarterly
Discharge Off-Site	--	Observation	Monthly	Quarterly

a. Meter requires meter reading, a pump run time meter, or other approved method
b. Weather station may be site-specific or nearby governmental weather reporting station
c. Acreage applied denotes the acreage to which wastewater is applied
d. Application rate may also be reported as inch/acre/month

7. SOLIDS DISPOSAL MONITORING

Santa Barbara County must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

8. REPORTING

A. SEMIANNUAL MONITORING REPORTS

The semiannual monitoring reports are due as described in Table 8.

Table 8. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description --** Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables --** Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion –**
    - Disclosure of any noncompliance (violations) with the notice of applicability and/or General Permit requirements, including a description, it’s cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.

  - An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD_5, TSS, Total Nitrogen) over time, nuisance conditions, system problems, etc.
  - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Disposal Area Inspection --** Report the results of the land application area inspections, as described in Section 6.
- **Solids Disposal --** If solids are disposed of offsite, comply with the reporting in Section 7.
- **Operator Information --** List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation --** A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures --** A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets --** Copies of laboratory analytical report(s) and chain of custody form(s).

9. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Santa Barbara County must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker[6,7] database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number WDR100035711 at:

https://geotracker.waterboards.ca.gov/esi/login

Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

---

[6] Information for first-time GeoTracker users is available at:
https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf
[7] Additional information available at:
https://geotracker.waterboards.ca.gov/

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the wastewater system.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.

Electronic Submittal	Description of Action	Action	Frequency
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

10. TECHNICAL REPORTS

Santa Barbara County must submit to GeoTracker the reports listed in Table 10. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date[1]
First Encountered Groundwater Investigation Report	60-days from date of General Permit enrollment
Spill Prevention & Emergency Response Plan[2]	90 days from date of General Permit enrollment
Sampling and Analysis Plan[2]	90 days from date of General Permit enrollment
Sludge Management Plan[2]	90 days from date of General Permit enrollment
Wastewater Treatment Plant Facilities Evaluation Report [3]	July 1, 2023
Compliance Plan [4]	July 1, 2023
Capital Improvement Schedule	July 1, 2023

1. The date of General Permit enrollment is June 15, 2022
2. See General Permit Provisions E.1 for a description of these report requirements
3. Required when wastewater treatment facility does not have an Engineering Report on file or existing one is incorrect or incomplete.
4. Required because Santa Barbara County anticipates additional time is needed to comply with the General Permit effluent limitations.

1. **Wastewater Treatment Plant Facilities Evaluation Report –** Santa Barbara County must prepare a Wastewater Treatment Plant Facilities Evaluation Report that provides a detailed analysis of the current operating conditions at the plant. The analysis must include current process evaluations of the headworks, aeration tanks, clarifier, sludge handling, evaporation ponds, and spray disposal areas. This report shall present overall plant process reliability, current plant performance, current flow demand, final recommendations, and timing of recommended improvements.

2. **Compliance Plan -** Santa Barbara County anticipates that additional time is needed to achieve compliance with the effluent limitations therefore, Santa Barbara County must prepare and submit for Central Coast Water Board review and approval, a compliance plan. At a minimum, the compliance plan must address the following:
   i. Comparison of the current effluent quality to the effluent and groundwater limitations in this General Permit.
   ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.
   iii. Justification of the need for additional time to achieve the in this General Permit.
   iv. A detailed schedule of specific actions Santa Barbara County will take to achieve compliance.
   v. A demonstration that the schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the permit requirements.
   vi. If the requested schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:
      a. Effluent limitation(s) for the pollutant(s) of concern.
      b. Actions, measurable milestones, and tangible products leading to compliance with the General Permit requirements.

3. **Capital Improvement Schedule** – Santa Barbara County must prepare and submit a Capital Improvement Schedule. Capital Improvement Schedule will present a timeline of when capital improvements will be made at the wastewater system to comply with General Permit requirements.

11. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Santa Barbara County submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to section 13267 of the California Water Code. Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Santa Barbara County to enforcement action pursuant to section 13268 of the Water Code.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Santa Barbara County is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

Santa Barbara County must implement the above monitoring program as of the date of this monitoring and reporting program. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Santa Barbara County must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

Jennifer Epp Digitally signed by Jennifer Epp Date: 2022.06.15 12:46:10 -07'00'

Water Boards

for Matthew T. Keeling
Executive Officer