Central Coast Regional Water Quality Control Board

October 2, 2025

Jim Doran
California Department of Parks and Recreation
California State Parks Pfeiffer Big Sur WWTP
2211 Garden Rd
Monterey, CA 93940

Email: Jim.Doran@parks.ca.gov

Sent Via Electronic and Certified Mail
7020 1810 0002 0767 9770

Dear Jim Doran,

CALIFORNIA STATE PARKS PFEIFFER BIG SUR WASTEWATER TREATMENT PLANT, 47177 HWY 1, BIG SUR, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM R3-2025-0061**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER 98-62**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the May 2023 Notice of Intent and available documents associated with the domestic wastewater treatment system at California State Parks Pfeiffer Big Sur Wastewater Treatment Plant (Wastewater System) owned by California Department of Parks and Recreation. The Wastewater System is currently regulated pursuant to Order 98-62. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order 98-62.

This letter serves as a notice of applicability for the California Department of Parks and Recreation's enrollment in the General Permit for the discharge of wastewater from California State Parks Pfeiffer Big Sur Wastewater System.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

California Department of Parks and Recreation must comply with the following:

1. General Permit

California Department of Parks and Recreation must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. Monitoring and Reporting Program

California Department of Parks and Recreation must comply with the requirements of Monitoring and Reporting Program R3-2025-0061, enclosed with this letter (Attachment 3). California Department of Parks and Recreation must start implementing the monitoring on **October 2, 2025**. California Department of Parks and Recreation must comply with the previous monitoring and reporting program until **October 2, 2025**. Your first quarterly report is due on **February 1, 2026** and the next annual report is due March 1, 2026.

2.1. Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/wdr-transmittal-sheet.pdf

2.2. The transmittal sheet describes who can sign reports. To authorize someone to sign and submit reports on your behalf, you must submit the "designation of duly authorized representatives form" found at the link below to the Central Coast Water Board.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/

2.3. California Department of Parks and Recreation must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker[1,2] database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100027053 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

2.4. The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. Fees

California Department of Parks and Recreation paid an annual fee on January 10, 2025 for coverage in the existing individual permit, Order 98-62. This payment covers permit fees for the 2024-2025 fiscal year.

3.1. California Department of Parks and Recreation must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently $8,878. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 3B.

3.2. A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. Notification

The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on December 11-12, 2025. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. Future Discharge Modifications

Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume

[1] Information for first-time GeoTracker users is available at: https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

[2] Additional information available at: http://geotracker.waterboards.ca.gov/

or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.

6. Responsible Party

California Department of Parks and Recreation is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects California Department of Parks and Recreation to enforcement action and termination of enrollment under this General Permit.

7. Change in Ownership

In the event of any change in control or ownership of the property, California Department of Parks and Recreation must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.

8. Certified Operator

California Department of Parks and Recreation is required to comply with the operator certification requirements[3] administered by the State Water Board's Office of Operator Certification, which currently requires a Grade III certified operator onsite to maintain and operate the treatment system. California Department of Parks and Recreation must:

8.1. Keep a current Wastewater Treatment Plant Classification Form on file with the Office of Operator Certification and update the form when modifications to the wastewater system treatment processes occur.

8.2. Provide the Office of Operator Certification with a Chief Plant Operator Acknowledgement Form and update this information within 30 days of a change of Chief Plant Operator.

[3] Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration. https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

8.3. If a contractor operator is used, the contract operator must register with the Office of Operator Certification and obtain a contract operator certificate for the wastewater system.

Forms are available at the following link: https://www.waterboards.ca.gov/water_issues/programs/operator_certification/form.html

9. Disposal Area

Discharge to areas other than the designated leachfield disposal areas shown in Figure 2 and Figure 6 of Attachment 2 is prohibited.

10. Termination of Permit – The existing individual permit, Order 98-62 is terminated, except for enforcement purposes. California Department of Parks and Recreation is responsible for compliance with Order 98-62 prior to the date of this letter.

Additional Central Coast Water Board Program Requirements

Enrollment in the State Water Resources Control Board Sanitary Sewer Systems General Permit – Enrollment in Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems (Sanitary Sewer System General Permit) is required for a state agency, municipality, special district, or other public entity that owns and/or operates one or more sanitary sewer systems that is a) greater than one (1) mile in length (each individual sanitary sewer system) **or** b) one (1) mile or less in length where the State Water Board or a Regional Water Board requires regulatory coverage in the Sanitary Sewer System General Permit. Central Coast Water Board staff confirmed that the sanitary sewer system connected to Pfeiffer State Park is not enrolled under the Sanitary Sewer Systems General Permit but meets the criteria to be enrolled and therefore must submit an application.

For additional information on the Sanitary Sewer System Permit and to complete an application (Attachment B of the Sanitary Sewer System Permit), please visit the State Water Board's Program page Sanitary Sewer Systems General Order | California State Water Resources Control Board. Please contact the State Water Board at SanitarySewer@waterboards.ca.gov to submit the application package and enroll this system under the Sanitary Sewer Systems Permit.

If you have any questions, please contact **Kathy Truong Krebs at (805) 549-3293 or by email at Kathy.Truong-Krebs@waterboards.ca.gov**, or Jennifer Epp at jennifer.epp@waterboards.ca.gov.

Sincerely,

for Ryan E. Lodge
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
Attachment 2: Figures
Attachment 3: Monitoring and Reporting Program R3-2025-0061

cc:

Ryan Palafox, ryan.palafox@parks.ca.gov
Christopher Fridrich, christopher.fridrich@parks.ca.gov
Dylan Barclift, Dylan.barclift@parks.ca.gov
Kathy Truong Krebs, kathy.Truong-krebs@waterboards.ca.gov
Connor Cappi, cappic@countyofmonterey.gov
Todd Stanley, todd.stanley@waterboards.ca.gov
Jennifer Epp, jennifer.epp@Waterboards.ca.gov
Office of Operator Certification, wwopcertprogram@waterboards.ca.gov
WDR Program, rb3-wdr@waterboards.ca.gov

ECM/CIWQS = CW-248169
GeoTracker = GT- WDR100027053
Rev 4/23/24
Subject Name = Pfeiffer Big Sur State Park WWTP Wastewater Permit

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Pfeiffer Big Sur State Park\1_Permit\2025 Permit Update\NOA and MRP\Pfeiffer Big Sur NOA_final_10_02_2025.docx

ATTACHMENT 1

WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC REQUIREMENTS AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

1.1. Ownership and facility information submitted by Department of Parks and Recreation to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater System Information

Facility Name	California State Parks Pfeiffer Big Sur WWTP
Facility Address	47177 Hwy 1 Big Sur, CA 93920
Parcel Numbers	419-031-002-000
Latitude/Longitude	36.257535, -121.787878
Owner of Facility	California Department of Parks and Recreation
Legally Responsible Official of Owner	Jim Doran
Owner Mailing Address	2211 Garden Rd Monterey, CA 93940
Billing Address	2211 Garden Rd Monterey, CA 93940
Permitted Design Flow, Max Average Monthly (gallons per day, gpd)	80,000
Baseline Flow (average annual flow) in gpd	55,000
Operators	Ryan Palafox, Interim Chief Plant Operator, Grade III Operator No. 31208 Supervisory control and data acquisition (SCADA) system present
Waste type and Service Area	The California State Parks Pfeiffer Big Sur Wastewater System provides services for: • 189 RV and tent campground sites with no RV hook-ups • One cabin • 18 comfort stations • One RV dump station • 62-cottage style room lodge (some with kitchenettes)

	• A large restaurant and coffee bar that serves camping, lodging, and wedding event guests • 37 full-time and seasonal employee units, 1 seasonal dormitory • Two full hook-up RV sites for full-time employees • Receives approximately 500 gallons per week from nearby campground temporary sanitary facilities and two holding tanks • 1 combination restroom/shower building consisting of three lavatories and three showers permitted per future Pfeiffer Cabin project
Threat to Water Quality	3
Complexity	B
For Internal Use	
Fee Code	58
Fees Received	Yes
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

NAVIGABLE, GROUNDWATER AND OCEAN WATERS SUSCEPTIBLE TO WASTEWATER POLLUTION

The Big Sur River is a water of the United States. The Big Sur River is the nearest surface water located approximately 100 feet west of the wastewater disposal leach fields. The Big Sur River joins the Pacific Ocean approximately 4 miles north-west of the facility and leach fields. First-encountered groundwater is approximately 1-10 feet below ground surface.

WASTEWATER SYSTEM OPERATION SUMMARY

1. The Wastewater System is composed of conveyance piping, lift stations, solids screening and grinding, grit removal, two activated sludge aeration tanks, three clarifiers, two radial filter units, aerobic solids digester, and SCADA. California

Department of Parks and Recreation reports that they own and operate a 650-gallon pumper truck for transporting wastewater from neighboring campgrounds' temporary sanitary facilities including Andrew Molera, Point Sur, and JP Burns. The pumper truck is operated on a weekly basis and historically has added 650 gallons per week of additional flow to the system. Starting June 30, 2025, a few of these locations are pumped, hauled by a contractor, and not disposed of at the Wastewater System. California Department of Parks and Recreation will continue to service Andrew Molera State Reserve (4 chemical toilets) and a portion of Point Sur Lighthouse (2 chemical toilets) due to the remote locations. There will be approximately 500 gallons disposed of at the Wastewater System weekly from these offsite sources.

The Wastewater System's backup power supply system consists of a 100-kilowatt industrial generator, an automatic transfer switch, and a 1,000-gallon propane fuel tank. In the event of a power outage, the industrial generator and automatic transfer switch are instantaneously activated for continued Wastewater System operation. The backup power supply system is on a weekly automated test schedule to ensure proper operation. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Activated Sludge Treatment, Disposal Technologies, and Capacity

Design Flows	Influent Maximum Daily Flow: 92,800 gallons per day (gpd) Average Monthly Flow: 80,000 gpd
Grease Trap	Restaurant grease waste is separated via a grease trap located at the lodge, which is maintained by a concessionaire. The grease interceptor is 2500 gallons with a 100-gallon pump vault. The restaurant empties the interceptor when it gets full. The restaurant has the grease interceptor pumped every 4 months on average. Matthew Wilkins is the contact person for operation and maintenance of the grease trap: matthew.wilkins@guestservices.com.

Headworks/Preliminary Treatment	Preliminary treatment consists of a JWC Auger Monster System Model No. AGD 1800-285 that grinds, screens, washes, and transports inorganic solid to a bagged disposal unit. The JWC Auger Monster's maximum capacity to screen is 250 gallons per minute (gpm) with an influent suspended solids concentration of 300 milligrams per liter (mg/l). At the headworks, there is a secondary channel parallel to the main channel that is used for bypassing the preliminary treatment system and inspecting and maintaining the preliminary treatment equipment. After major solids removal, the wastewater is directed through a trapezoidal flume for continuous volumetric flow measurement (flow range up to 600 gpm) and then pumped through a Eutek TeaCup cyclonic separator grit removal system with a design capacity of 200 gpm.

Secondary Treatment	Secondary treatment begins within two 43,000 gallon extended aeration basins (AB1 and AB2) operated in parallel. Aeromod ClarAtors clarifiers (Clarifier 1 and Clarifier 2) are centered inside each of the two aeration basins to perform primary clarification after aeration. Each primary clarifier can treat a daily average of 14,280 gpd and a maximum of 46,560 gpd. Effluent from both primary clarifiers combine and flow to an Aeromod Split ClarAtor, Model 16320 secondary clarifier (Clarifier 3) for further treatment. The Split ClarAtor clarifier's average design treatment capacity is 28,800 gpd and a maximum design capacity of 92,800 gpd. Wasted activated sludge from both primary clarifiers is pumped to the digester. Return activated sludge is captured out of the secondary clarifier and split to be reintroduced into each of the two aeration basins. Post clarifier filtering consists of four RF-400-CW radial filter units. The filters operate in parallel but only one is on at anytime. The non-operating radial filter comes online once the operating filter goes offline to initiate the backwash cycle. Backwash is initiated automatically every 24 hrs or by head loss across the radial filter unit. Backwash effluent is redirected back to the aeration basins. The average design flow rate for each radial filter is 25,000 gpd for a total possible filtering capacity of 100,000 gpd. The radial filter performance meets title 22 California Code of Regulations §60301.320 definition of *filtered wastewater*, which is requirement of a disinfected recycled water but the effluent is not disinfected and is not used as recycled water.
Disposal	Effluent wastewater is disposed in a leach field with a 100% replacement zone. The leach field has seven zones, separated by isolation valves at the start of each zone. The zones are rotated every 6 months, resulting in six online zones and one offline zone.

Biosolids/Sludge Production and Handling	Solids produced at the headworks are bagged for hauling offsite by Monterey Regional Waste Management District (831-384-5313) and disposal at the Marina Landfill in Monterey County. Wasted activated sludge is pumped into the aerobic digester with a storage capacity of 13 days at average daily flow and four days at maximum daily flow. Digested sludge is directed to either one of two sandbeds or through a belt press for dewatering. Solids are collected and taken offsite for final disposal by Waste Management at the Marina Landfill in Monterey County.
Wastewater Effluent Design Goals[1]	BOD and TSS < 30 mg/L Total Nitrogen < 20-50 mg/L

1 These are design goals and should be used to evaluate system performance.

WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

California Department of Parks and Recreation must operate the facility in accordance with the General Permit and this notice of applicability.[4] California Department of Parks and Recreation must operate the extended aeration, activated sludge, tertiary filtration treatment system to comply with the effluent limits below.

A. Effluent limits

California Department of Parks and Recreation must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits for Activated Sludge Treatment

Constituent	Unit	Limit	Point of Compliance[1]
Flow	gpd[2]	80,000 (monthly average)[4]	Influent (IS-1)
Total Suspended Solids (TSS)	mg/L[3]	5 (monthly average) 10 (7-day average)	Effluent after Radial Filters (ES-1)
Five-Day Biochemical Oxygen Demand (BOD_5)	mg/L	30 (monthly average) 45 (7-day average)	Effluent after Radial Filters (ES-1)

[4] General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

Constituent	Unit	Limit	Point of Compliance[1]
Total Nitrogen (as N)	mg/L	10	Effluent after Radial Filters (ES-1)
Formaldehyde	mg/L	0.10	Effluent after Radial Filters (ES-1)
E. coli[5]	MPN/100 mL	Non-detect	Effluent after disinfection system

[1] Refer to monitoring and reporting program for sampling locations
[2] Denotes gallons per day
[3] Denotes milligrams per liter
[4] Average flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month
[5] MPN/100 mL denotes most probable number per 100 mL sample.

GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge (effluent) must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, California Department of Parks and Recreation must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).[5] These objectives include:

1) General objectives for taste and odors and radioactivity for all groundwaters.
2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
3) Specific objectives for the groundwater basin where the discharge occurs. The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

The current depth to groundwater (1-10ft) is defined as shallow groundwater in Attachment 1 of the General Permit. To demonstrate no impact to groundwater quality, the Central Coast Water Board has determined that California Department of Parks and Recreation must conduct groundwater and surface water monitoring.

[5] Current edition, June 2019 is available at: https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

SETBACK REQUIREMENTS

General Permit Section B.1.I Table 3 includes setback requirements. According to Google Earth imaging, California Department of Parks and Recreation's wastewater disposal leach fields are within the 100-foot setback requirement to the high-water mark of the Big Sur River. The General Permit states, "Noncomplying facilities may be permitted, if nuisance conditions do not result from the noncompliance. Expansion of a noncomplying Wastewater System shall trigger further evaluation of the setbacks." Therefore, California Department of Parks and Recreation must not expand or add additional wastewater flow) to the Wastewater System without notifying the Central Coast Water Board and receiving Central Coast Water Board approval considering an evaluation of the setbacks.

RECREATIONAL VEHICLE SIGNAGE REQUIREMENTS

To comply with Senate Bill 317, Section 25210.2 d, California Department of Parks and Recreation, as an owner or operator of a recreational vehicle park or campground that utilizes a septic system, onsite wastewater treatment system, or subsurface disposal system to dispose of recreational vehicle wastewater must post in a conspicuous location a notice stating the following:

"The State of California prohibits the use of products in RV holding tanks, including deodorizers, that contain bronopol, dowicil, formalin, formaldehyde, glutaraldehyde, paraformaldehyde, para-dichlorobenzene, benzene, toluene, xylene, ethylene glycol, 1,1,1-trichloroethane, trichloroethylene, and or perchloroethylene. These chemicals can inhibit biological activity in onsite wastewater treatment systems and threaten groundwater and drinking water wells and are strictly forbidden. Please use bacteria- or enzyme-based products."

At a minimum, the signs must be placed at the RV dump station and at the full hook-up RV sites with educational material provided to users of those facilities (e.g., when campers check in).

ATTACHMENT 2
FIGURES

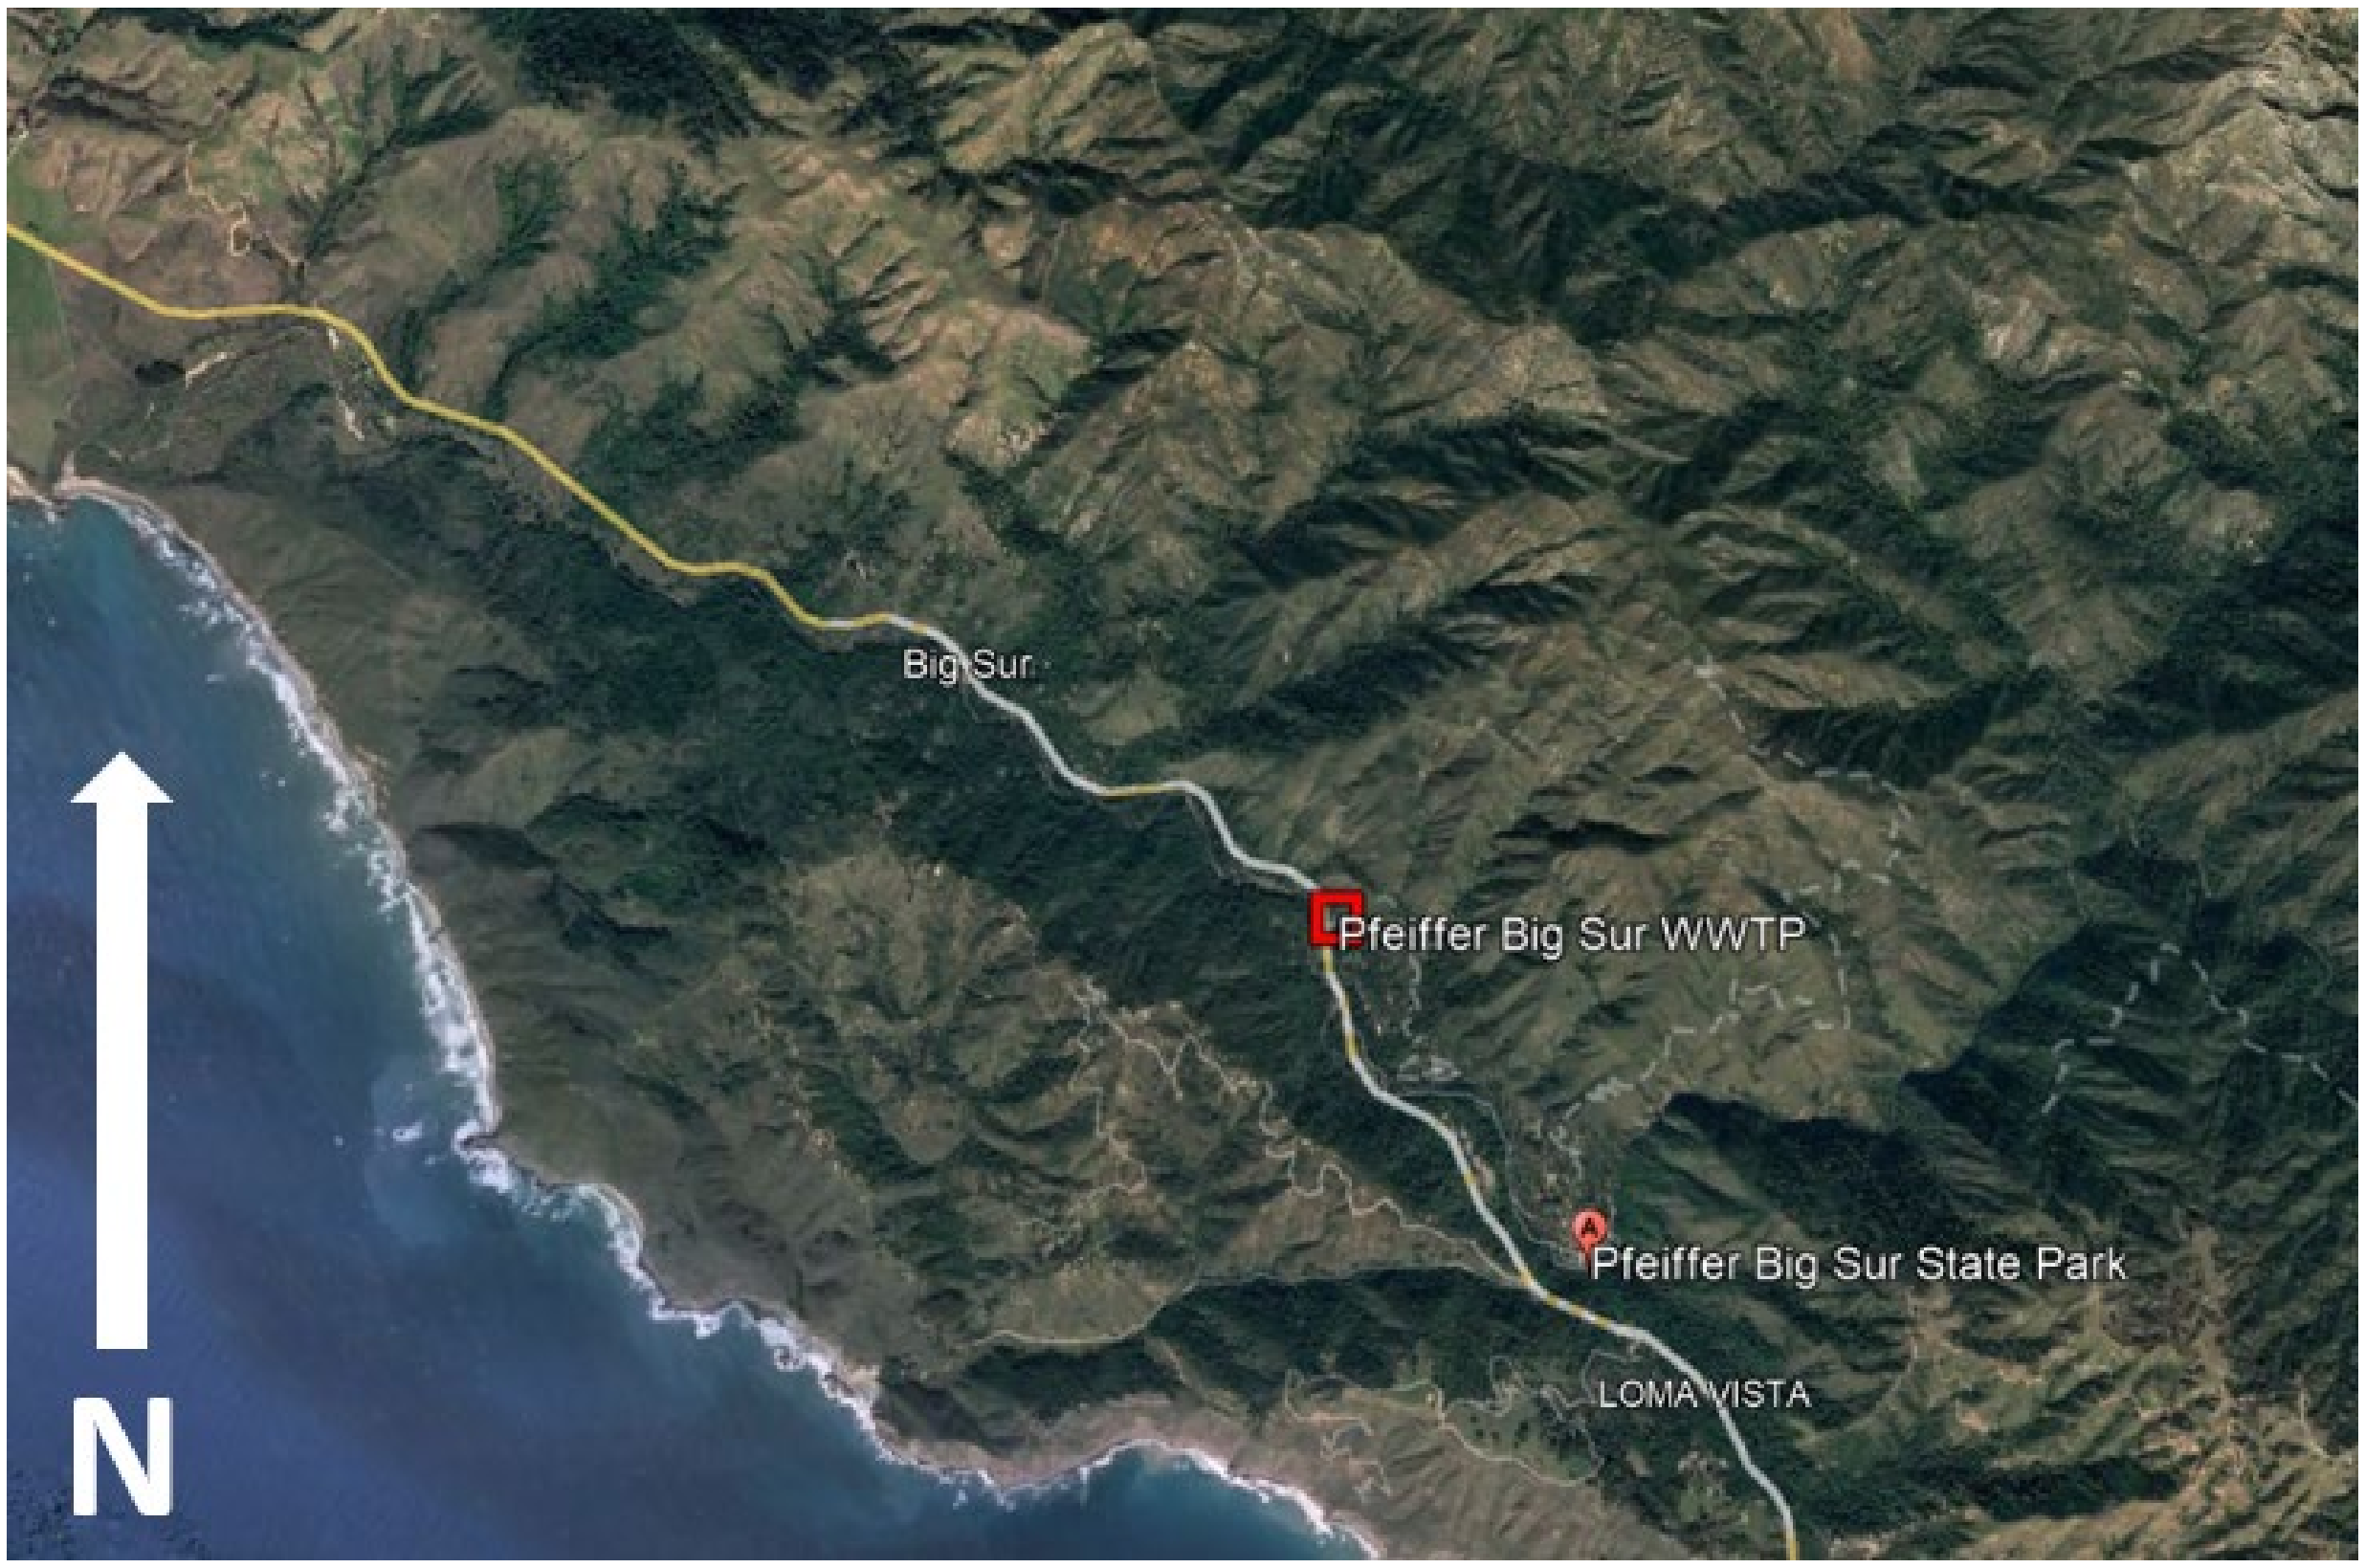

Figure 1. Site Location Map (Adapted from Google Earth)

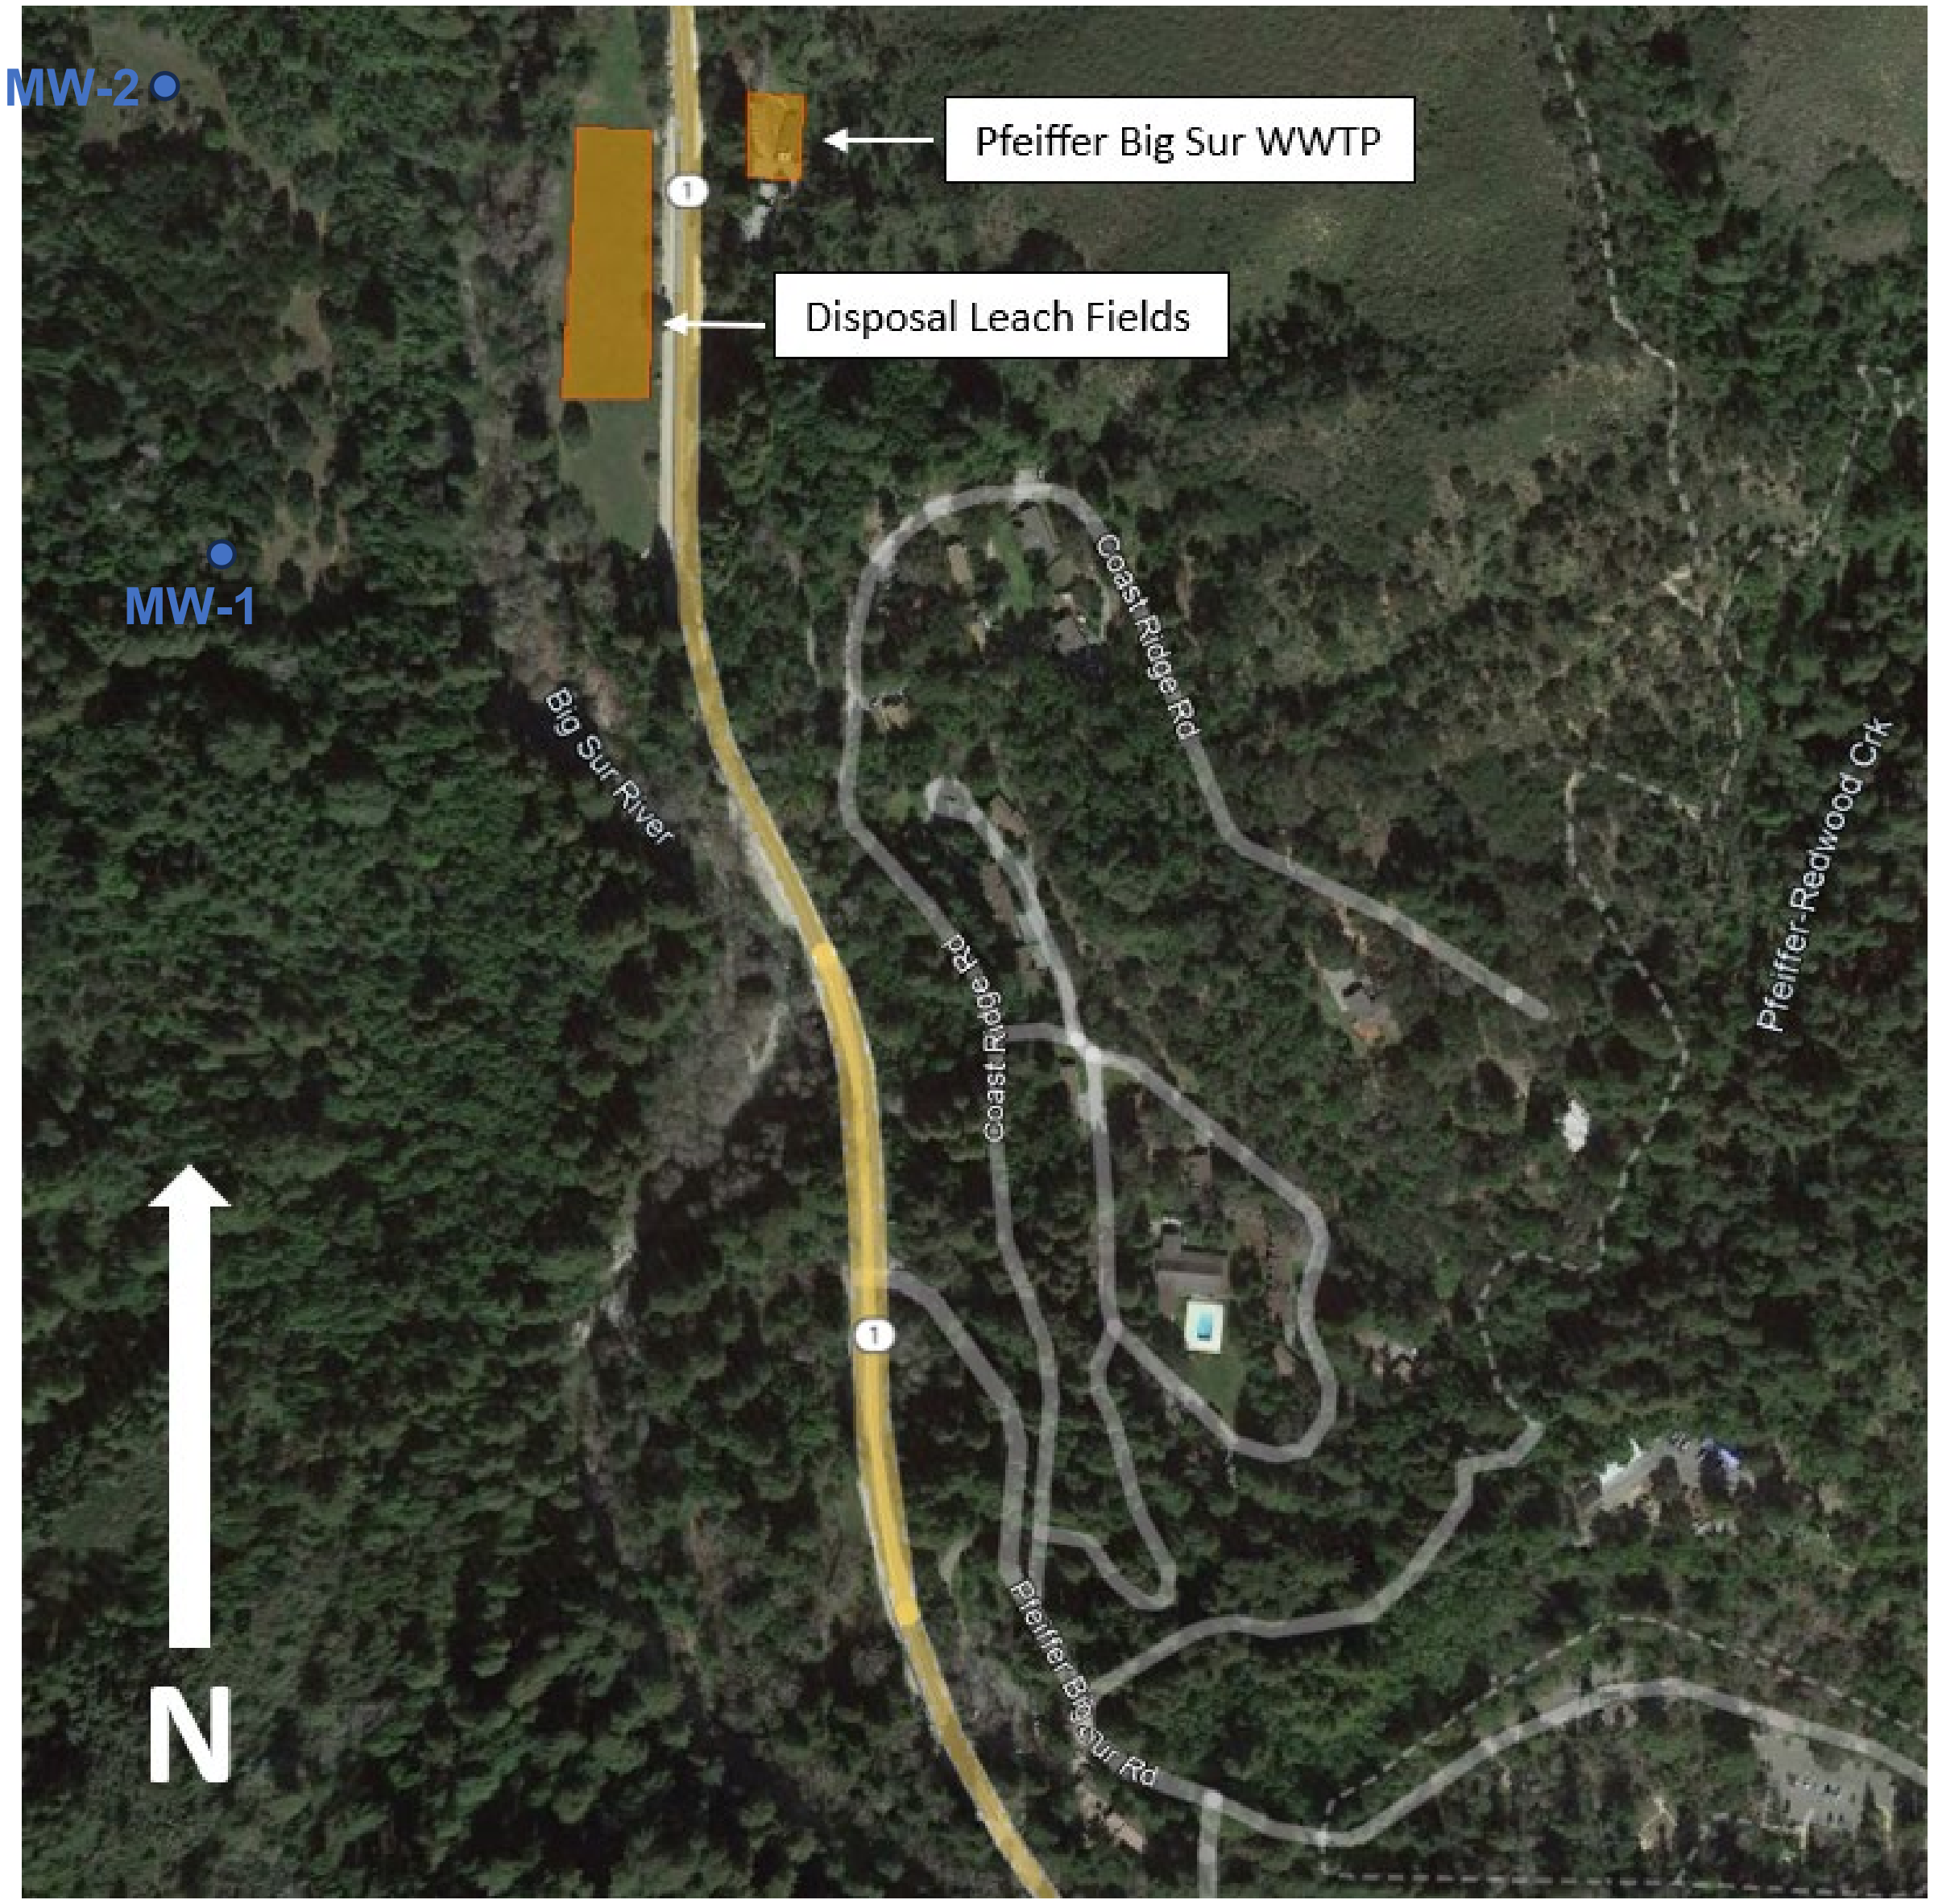

Figure 2. Site Map (Adapted from Google Earth)

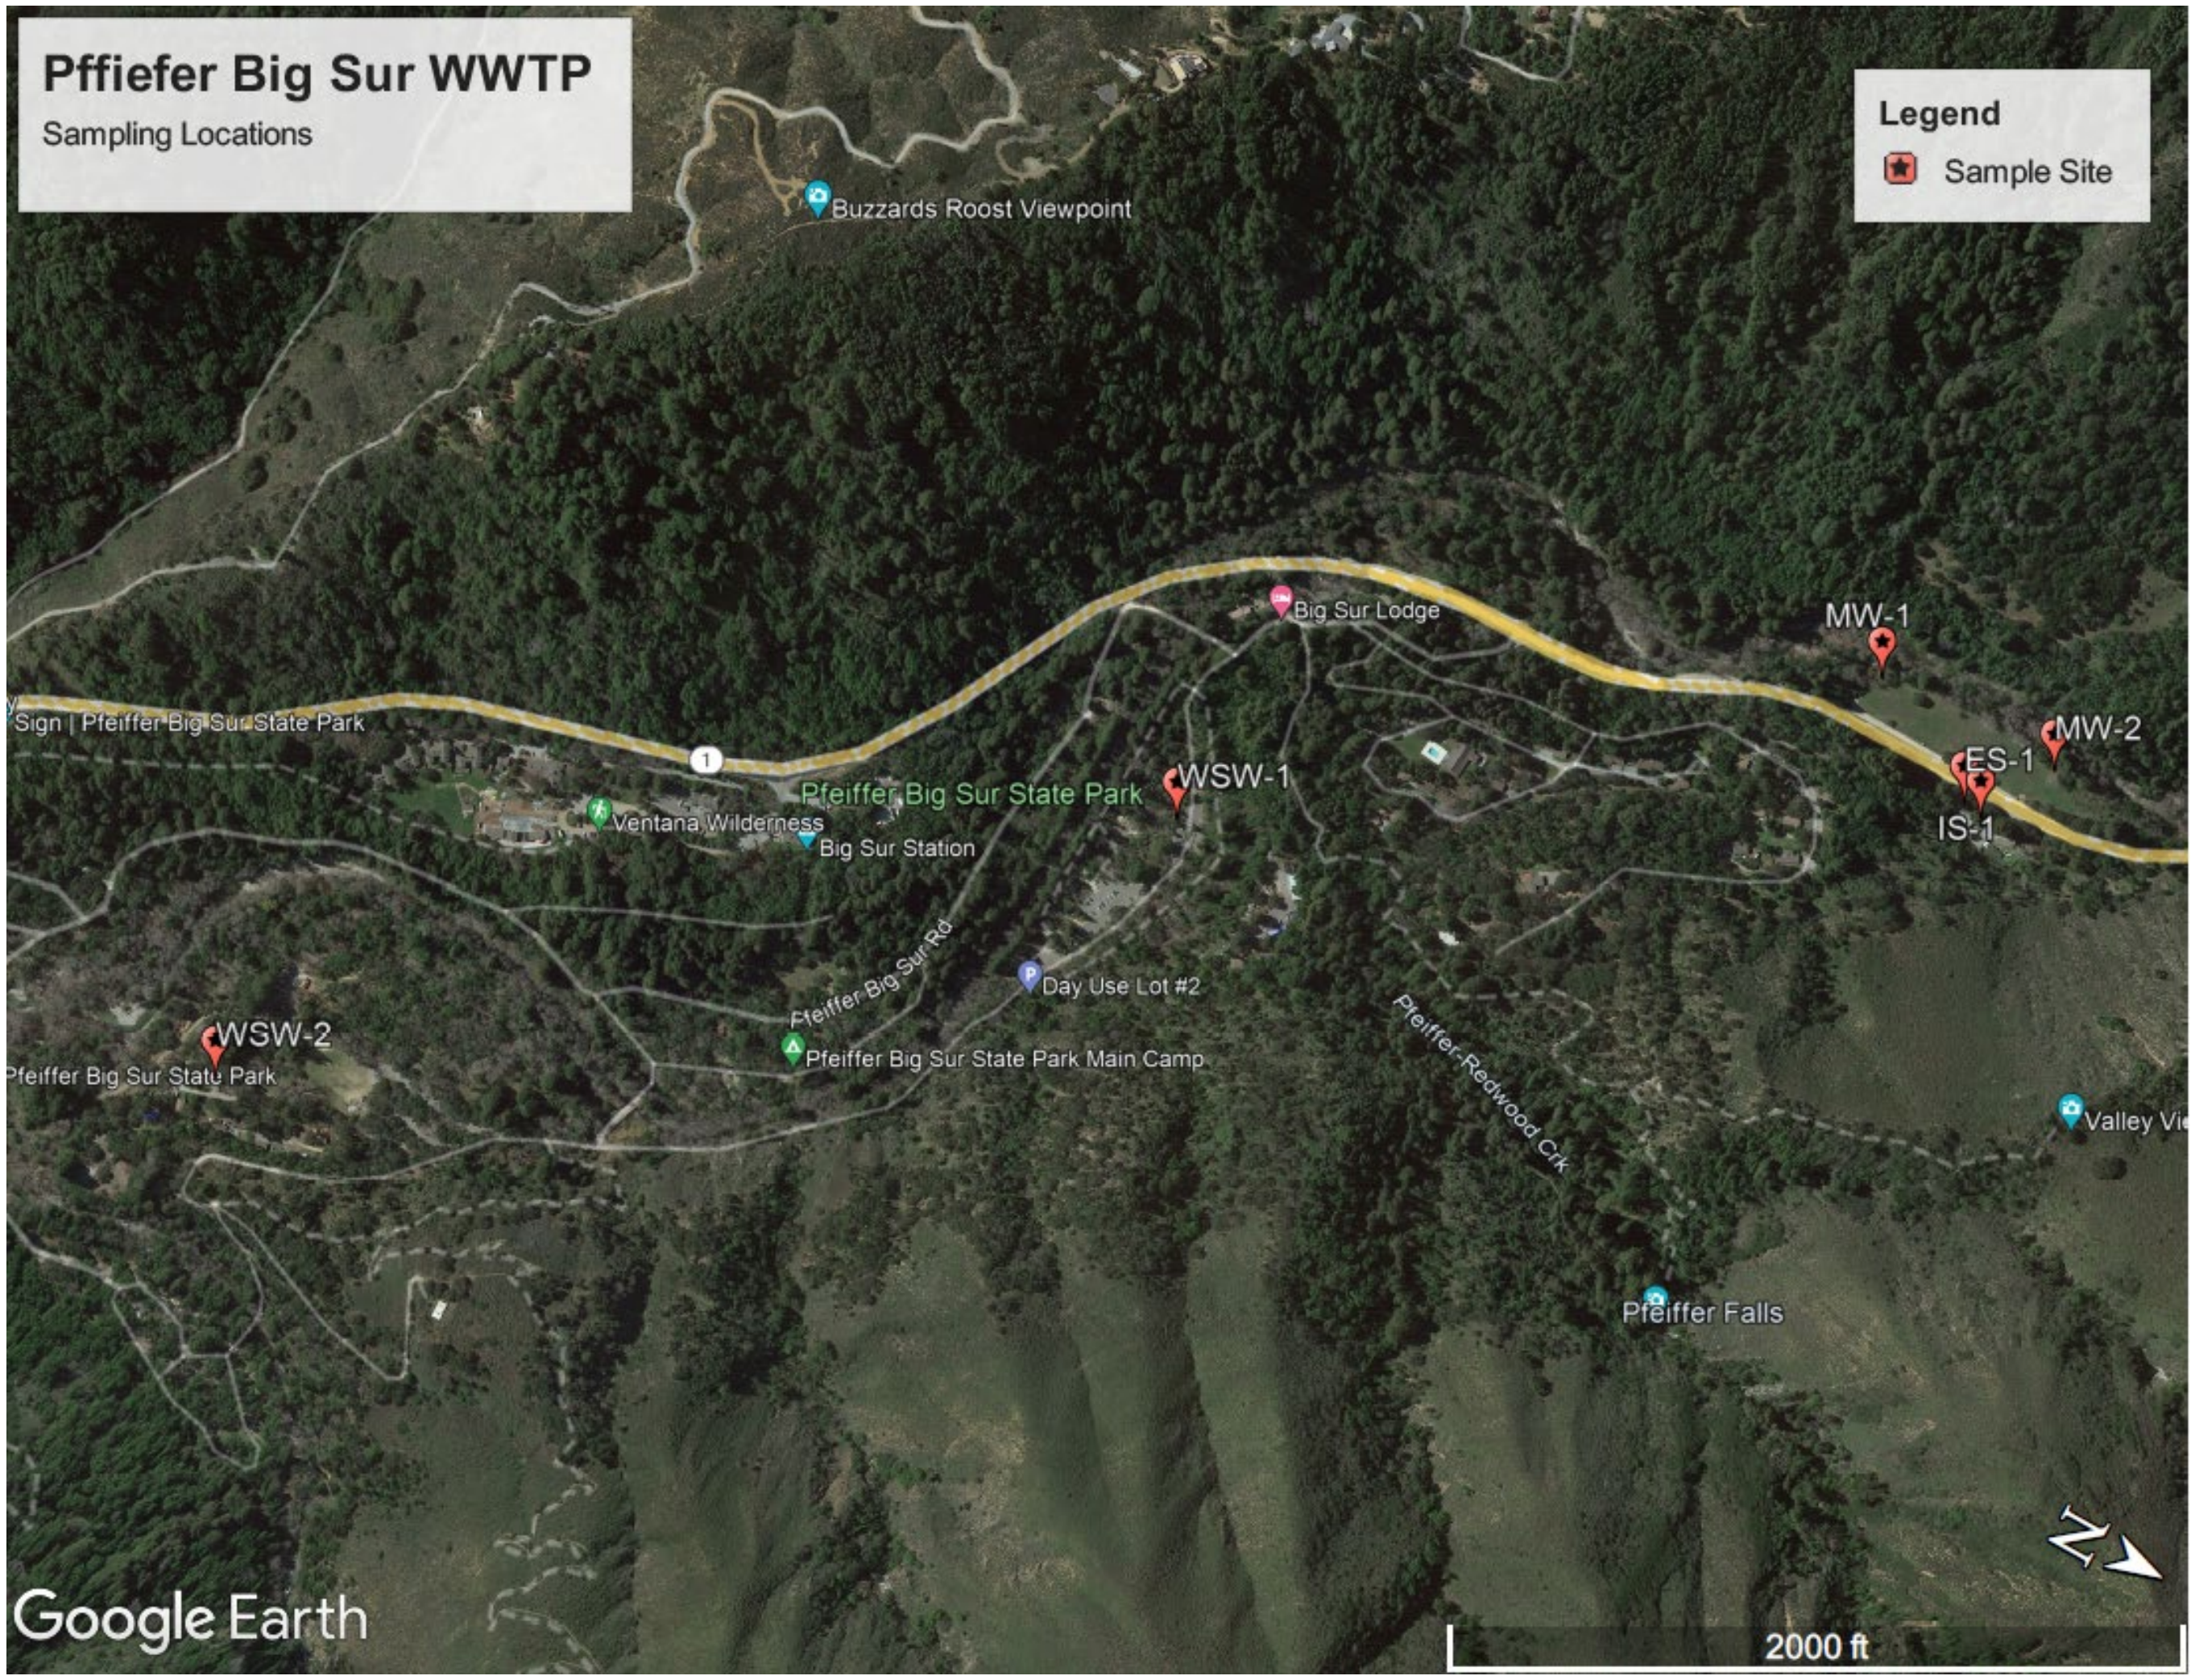

Figure 3. Sampling Locations Provided by California Department of Parks and Recreation (Adapted from Google Earth)

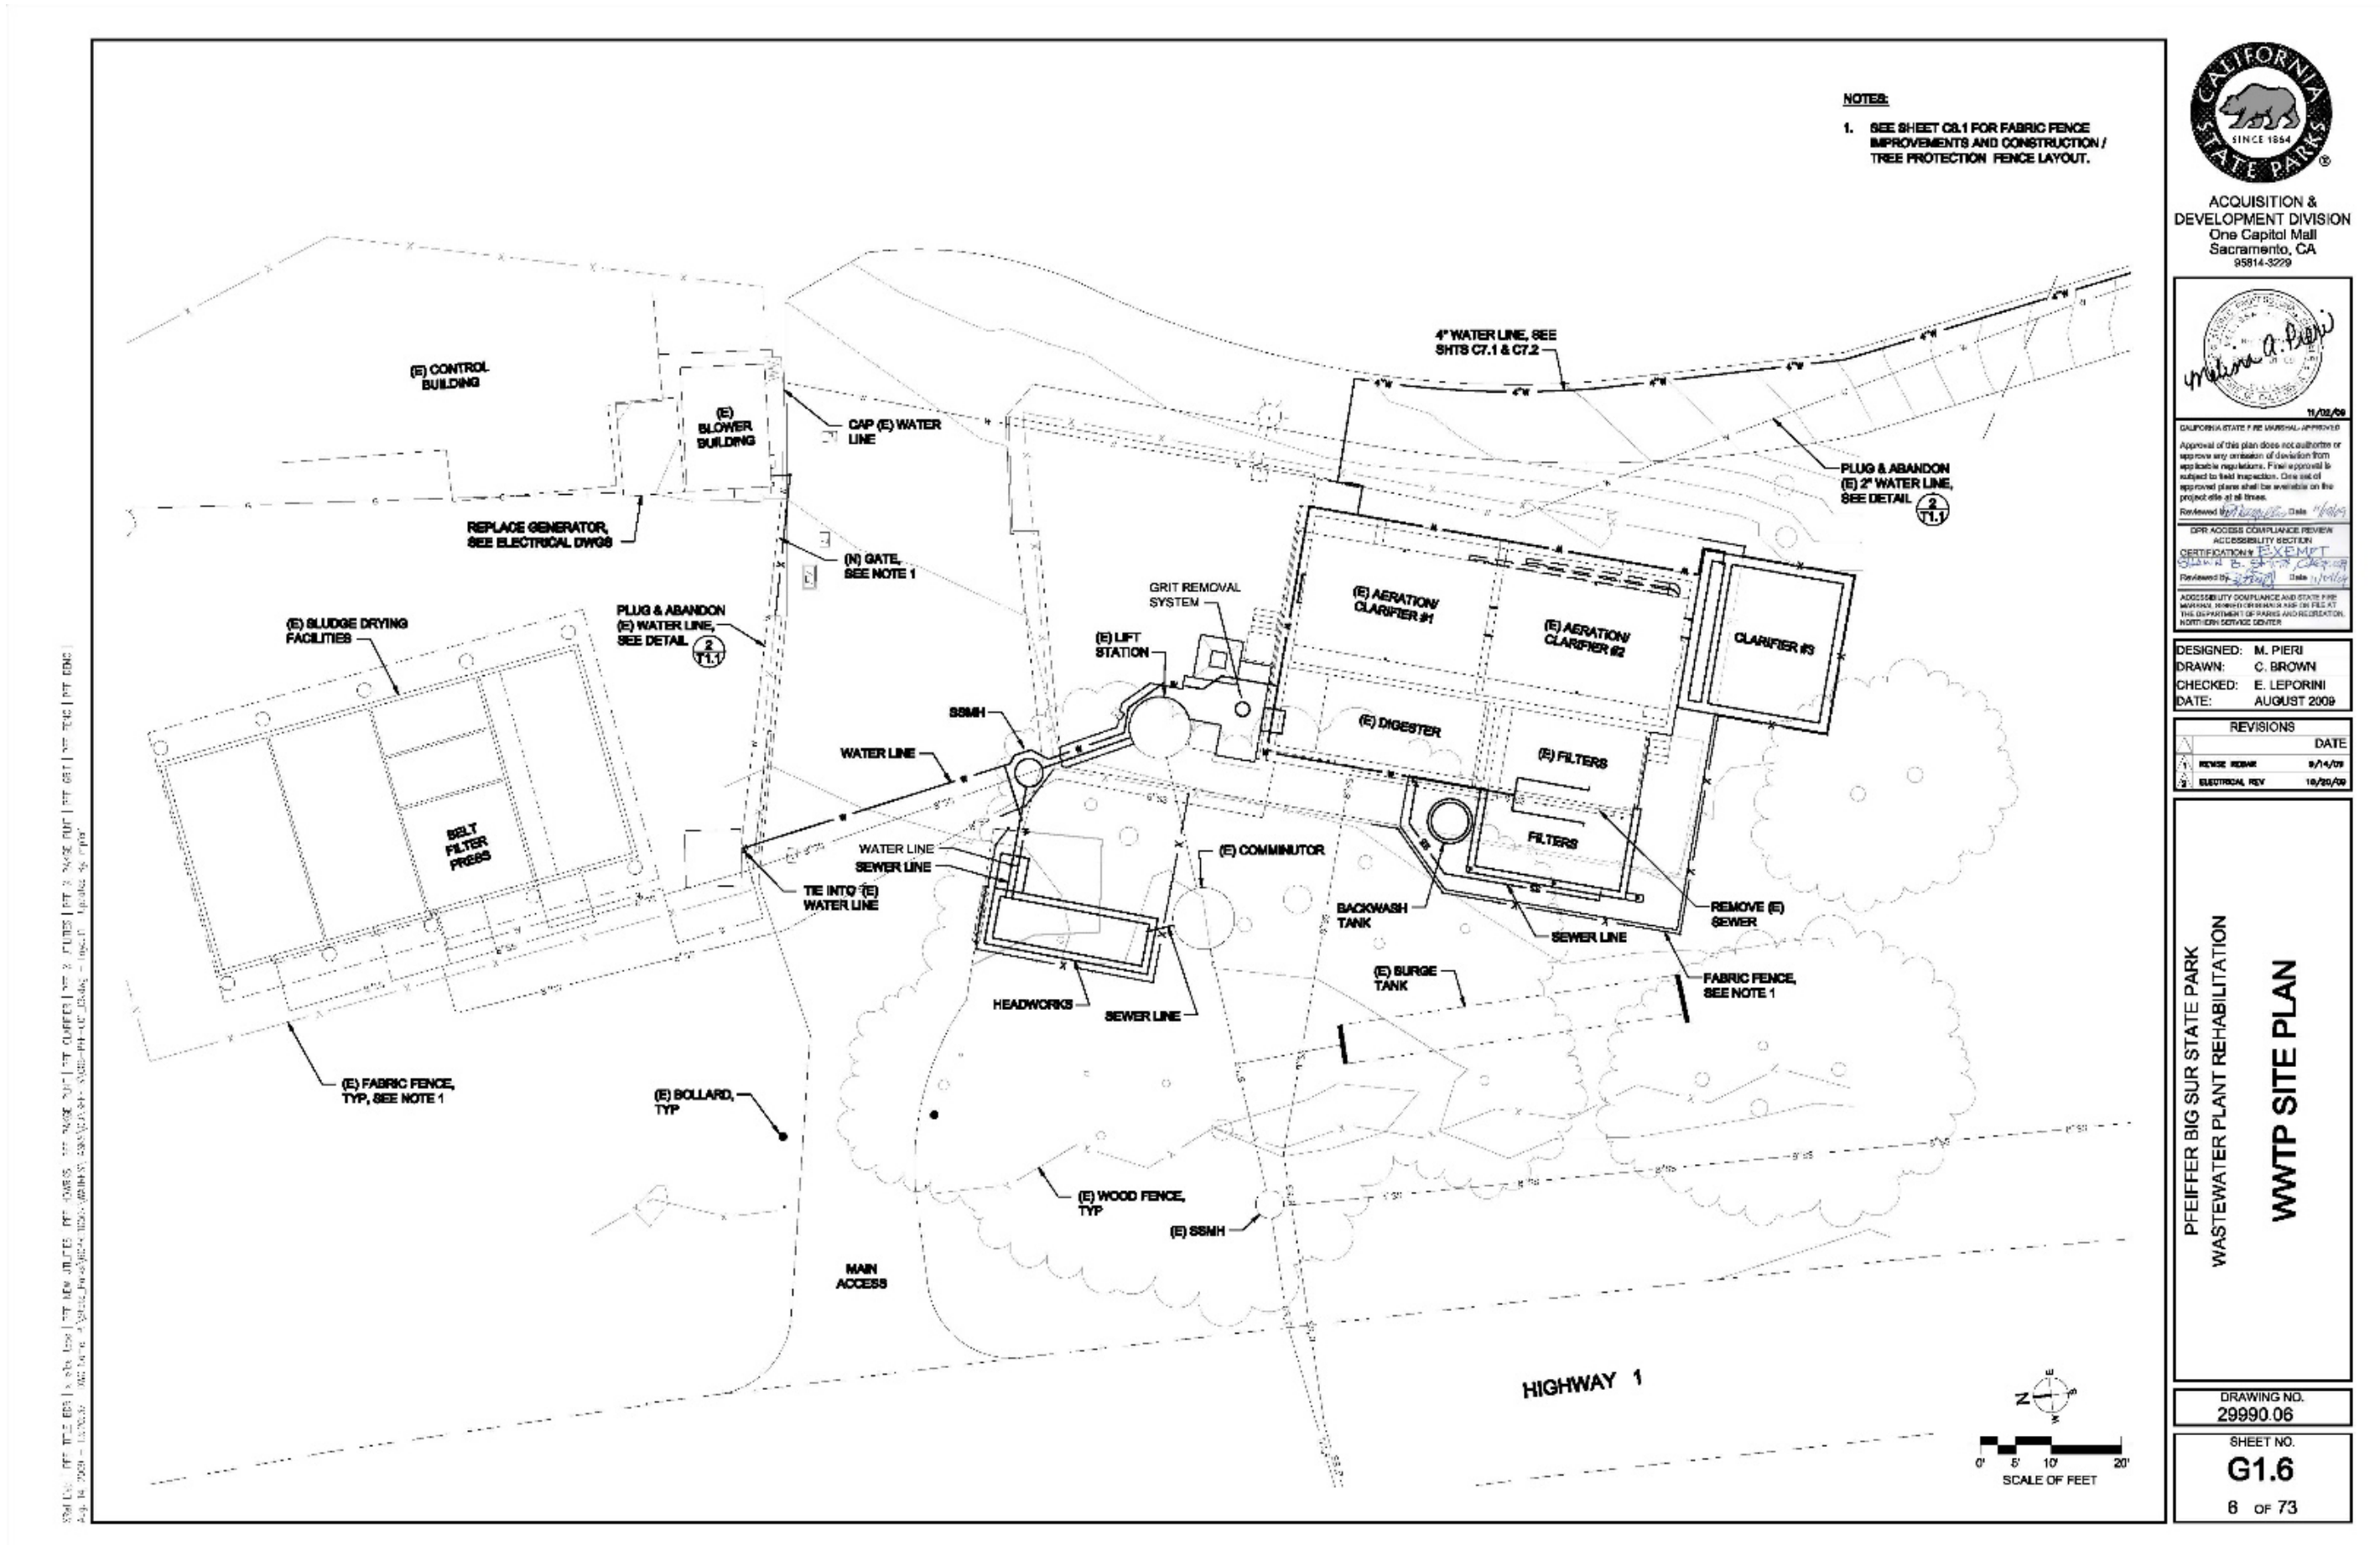

Figure 4. Wastewater System Site Plan

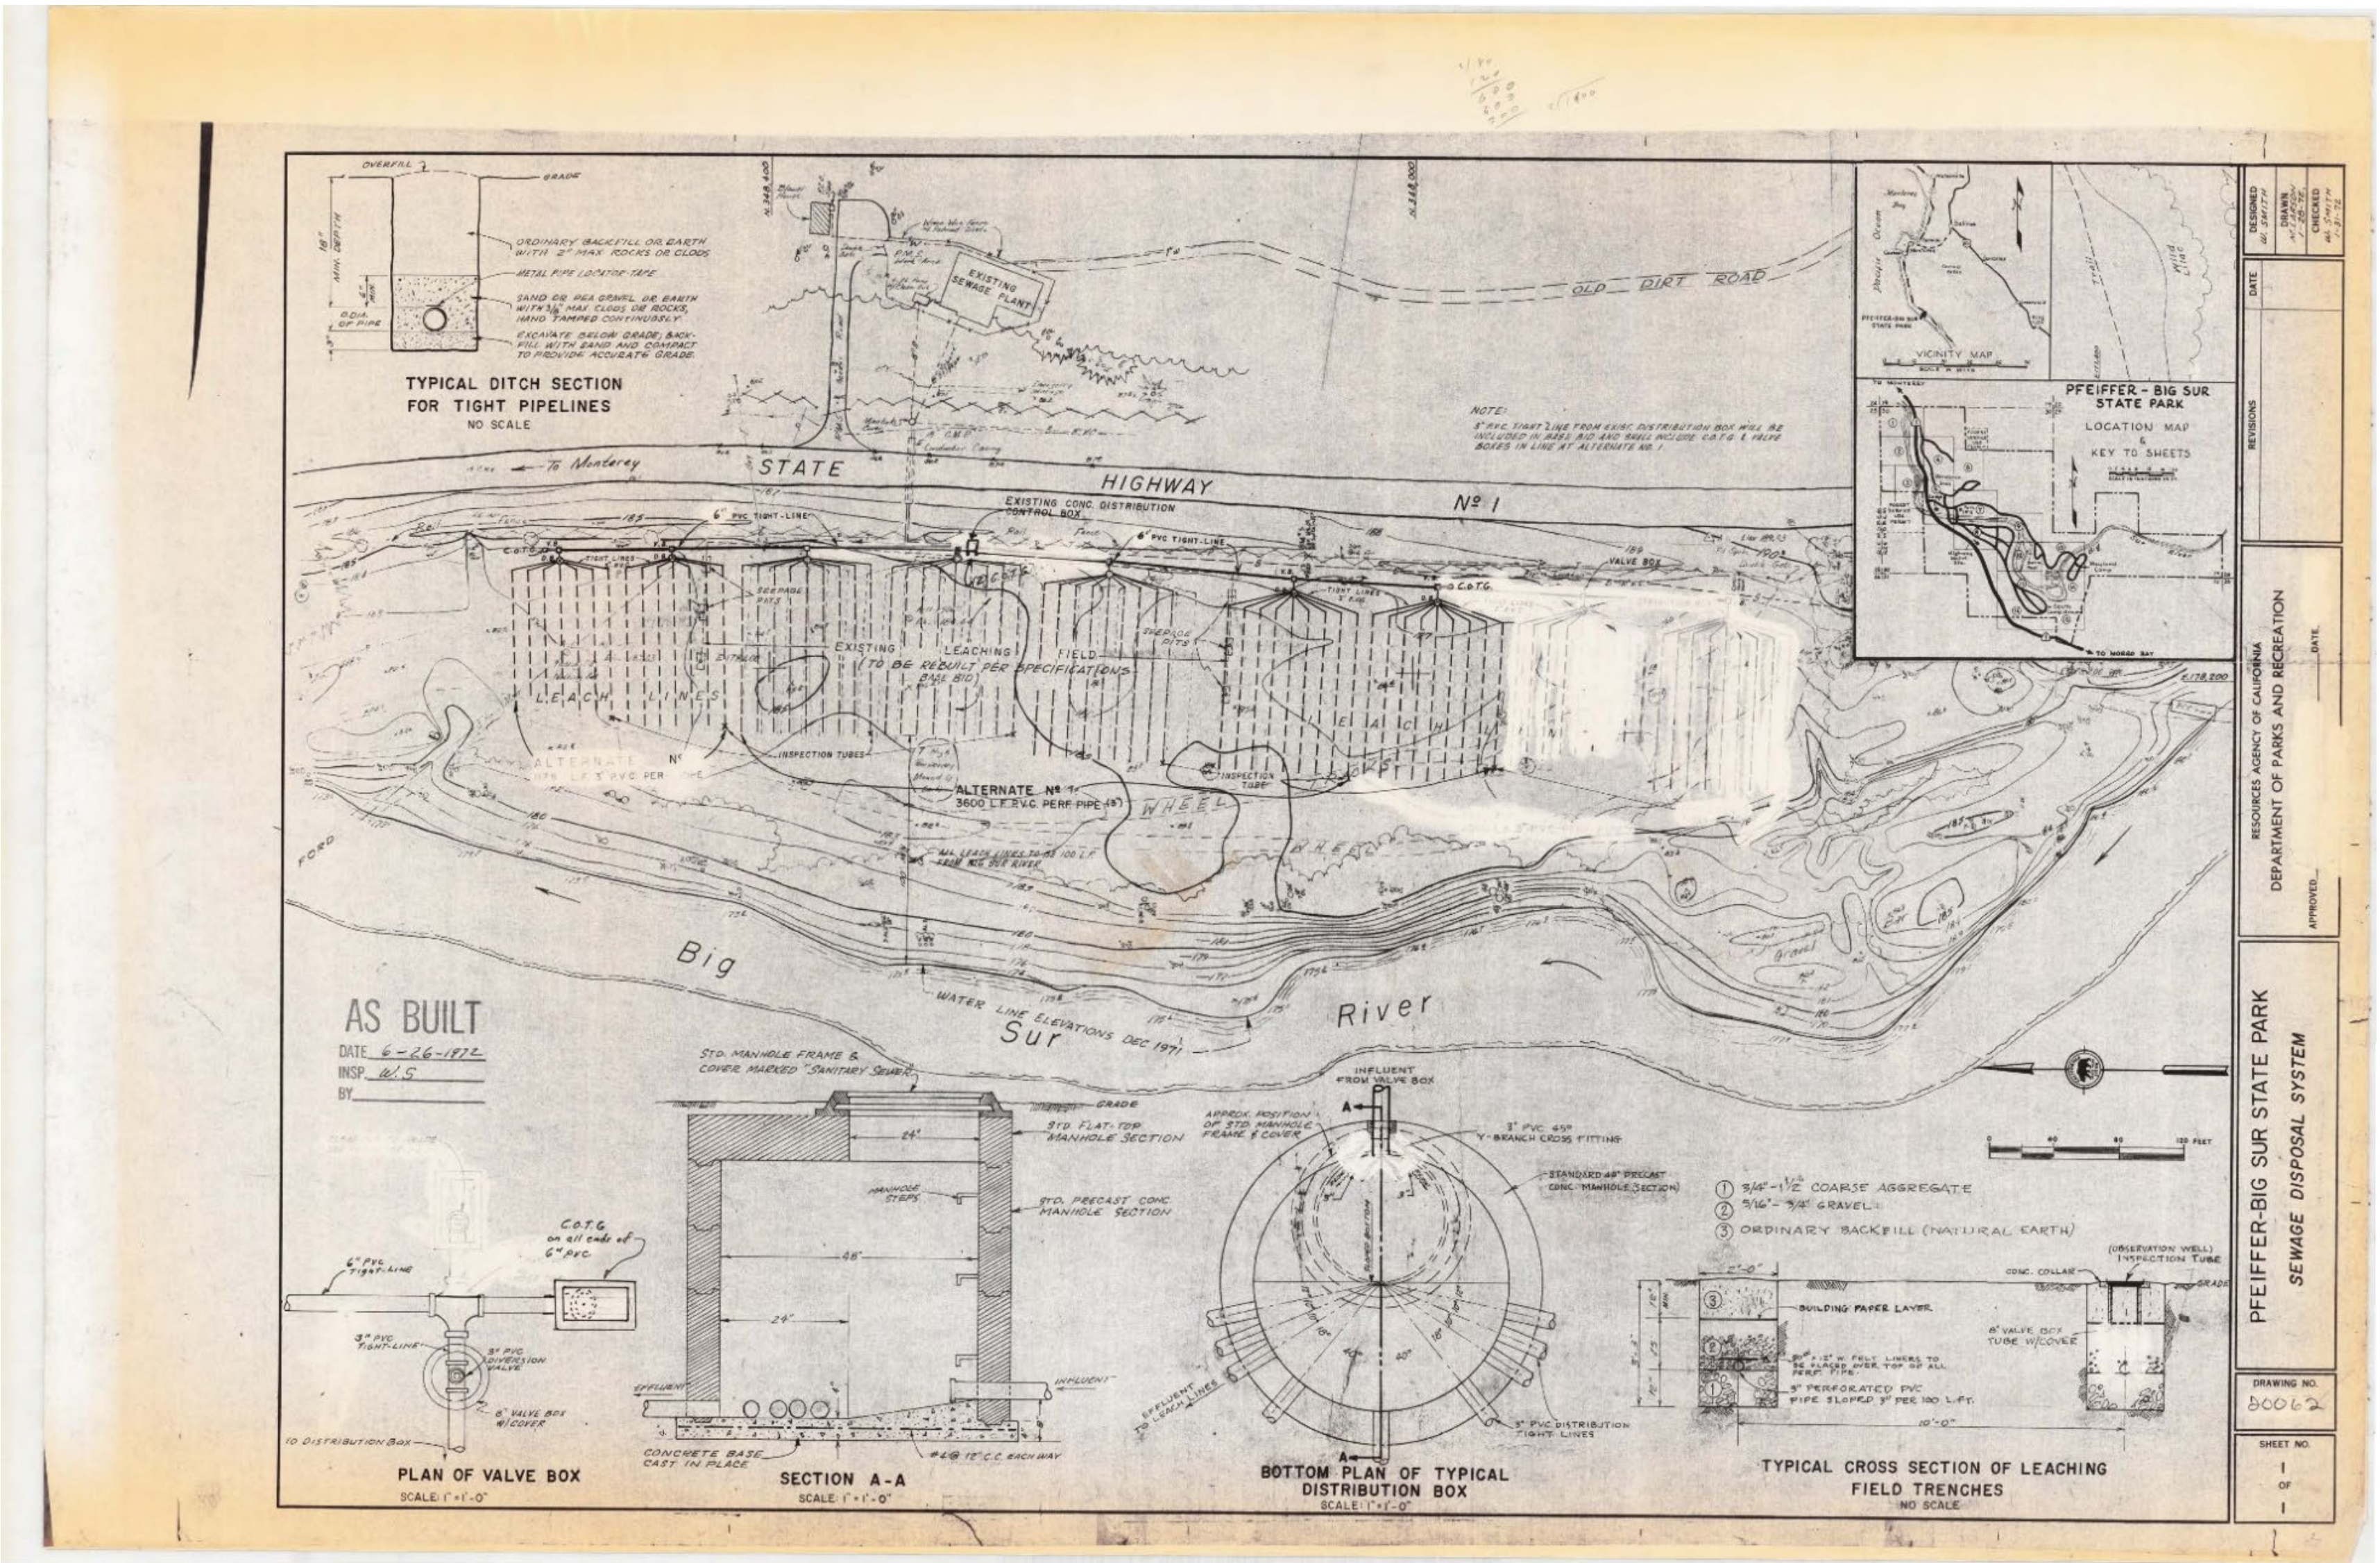

Figure 5. Dispersal System Layout Provided by California Department of Parks and Recreation

Figure 6. Aerial Image of Disposal Zones and Sampling Locations Provided by California Department of Parks and Recreation (Adapted from Google Earth)

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM R3-2025-0061

OCTOBER 2, 2025

FOR

CALIFORNIA STATE PARKS PFEIFFER BIG SUR WWTP
BIG SUR, MONTEREY COUNTY

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system at California State Parks Pfeiffer Big Sur Wastewater Treatment Plant (Wastewater System) owned by California Department of Parks and Recreation located in Big Sur.

California Department of Parks and Recreation owns and operates the Wastewater System that is subject to the notice of applicability dated October 2, 2025, issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board) for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be approved by the Central Coast Water Board. Unless otherwise specified below, sampling must be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

A. The user is trained in proper use and maintenance of the instruments;
B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
D. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2.

In lieu of the required water supply sampling, California Department of Parks and Recreation may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. California Department of Parks and Recreation must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. California Department of Parks and Recreation must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually
Chloride	mg/L	Grab	Annually	Annually
Sodium	mg/L	Grab	Annually	Annually
Sulfate	mg/L	Grab	Annually	Annually
Boron	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database and in reports (described below), is shown in Table 3. The field point code and latitude and longitude of all monitoring locations, except supply wells, must be loaded to GeoTracker once. (See Section 10, Electronic Submittal, below.)

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code (Sample ID)	Sample Description
Water Supply Well	WSW-1	Representative sample of water supply prior to treatment
Influent Sample – 1	IS-1	Representative grab sample after headworks prior to aeration tank
Effluent Sample – 1	ES-1	Representative grab sample from radial filters effluent prior to disposal
River Sample – 1	RIV-1	Representative grab sample from Big Sur River, upstream of leach field disposal field
River Sample – 2	RIV-2	Representative grab sample from Big Sur River, downstream of leach field disposal field
Monitoring Well – 1	MW-1	Groundwater monitoring well around leach fields
Monitoring Well – 2	MW-2	Groundwater monitoring well around leach fields
Monitoring Well – 3	MW-3	Groundwater monitoring well around leach fields
Monitoring Well - 4	MW-4	Groundwater monitoring well around leach fields

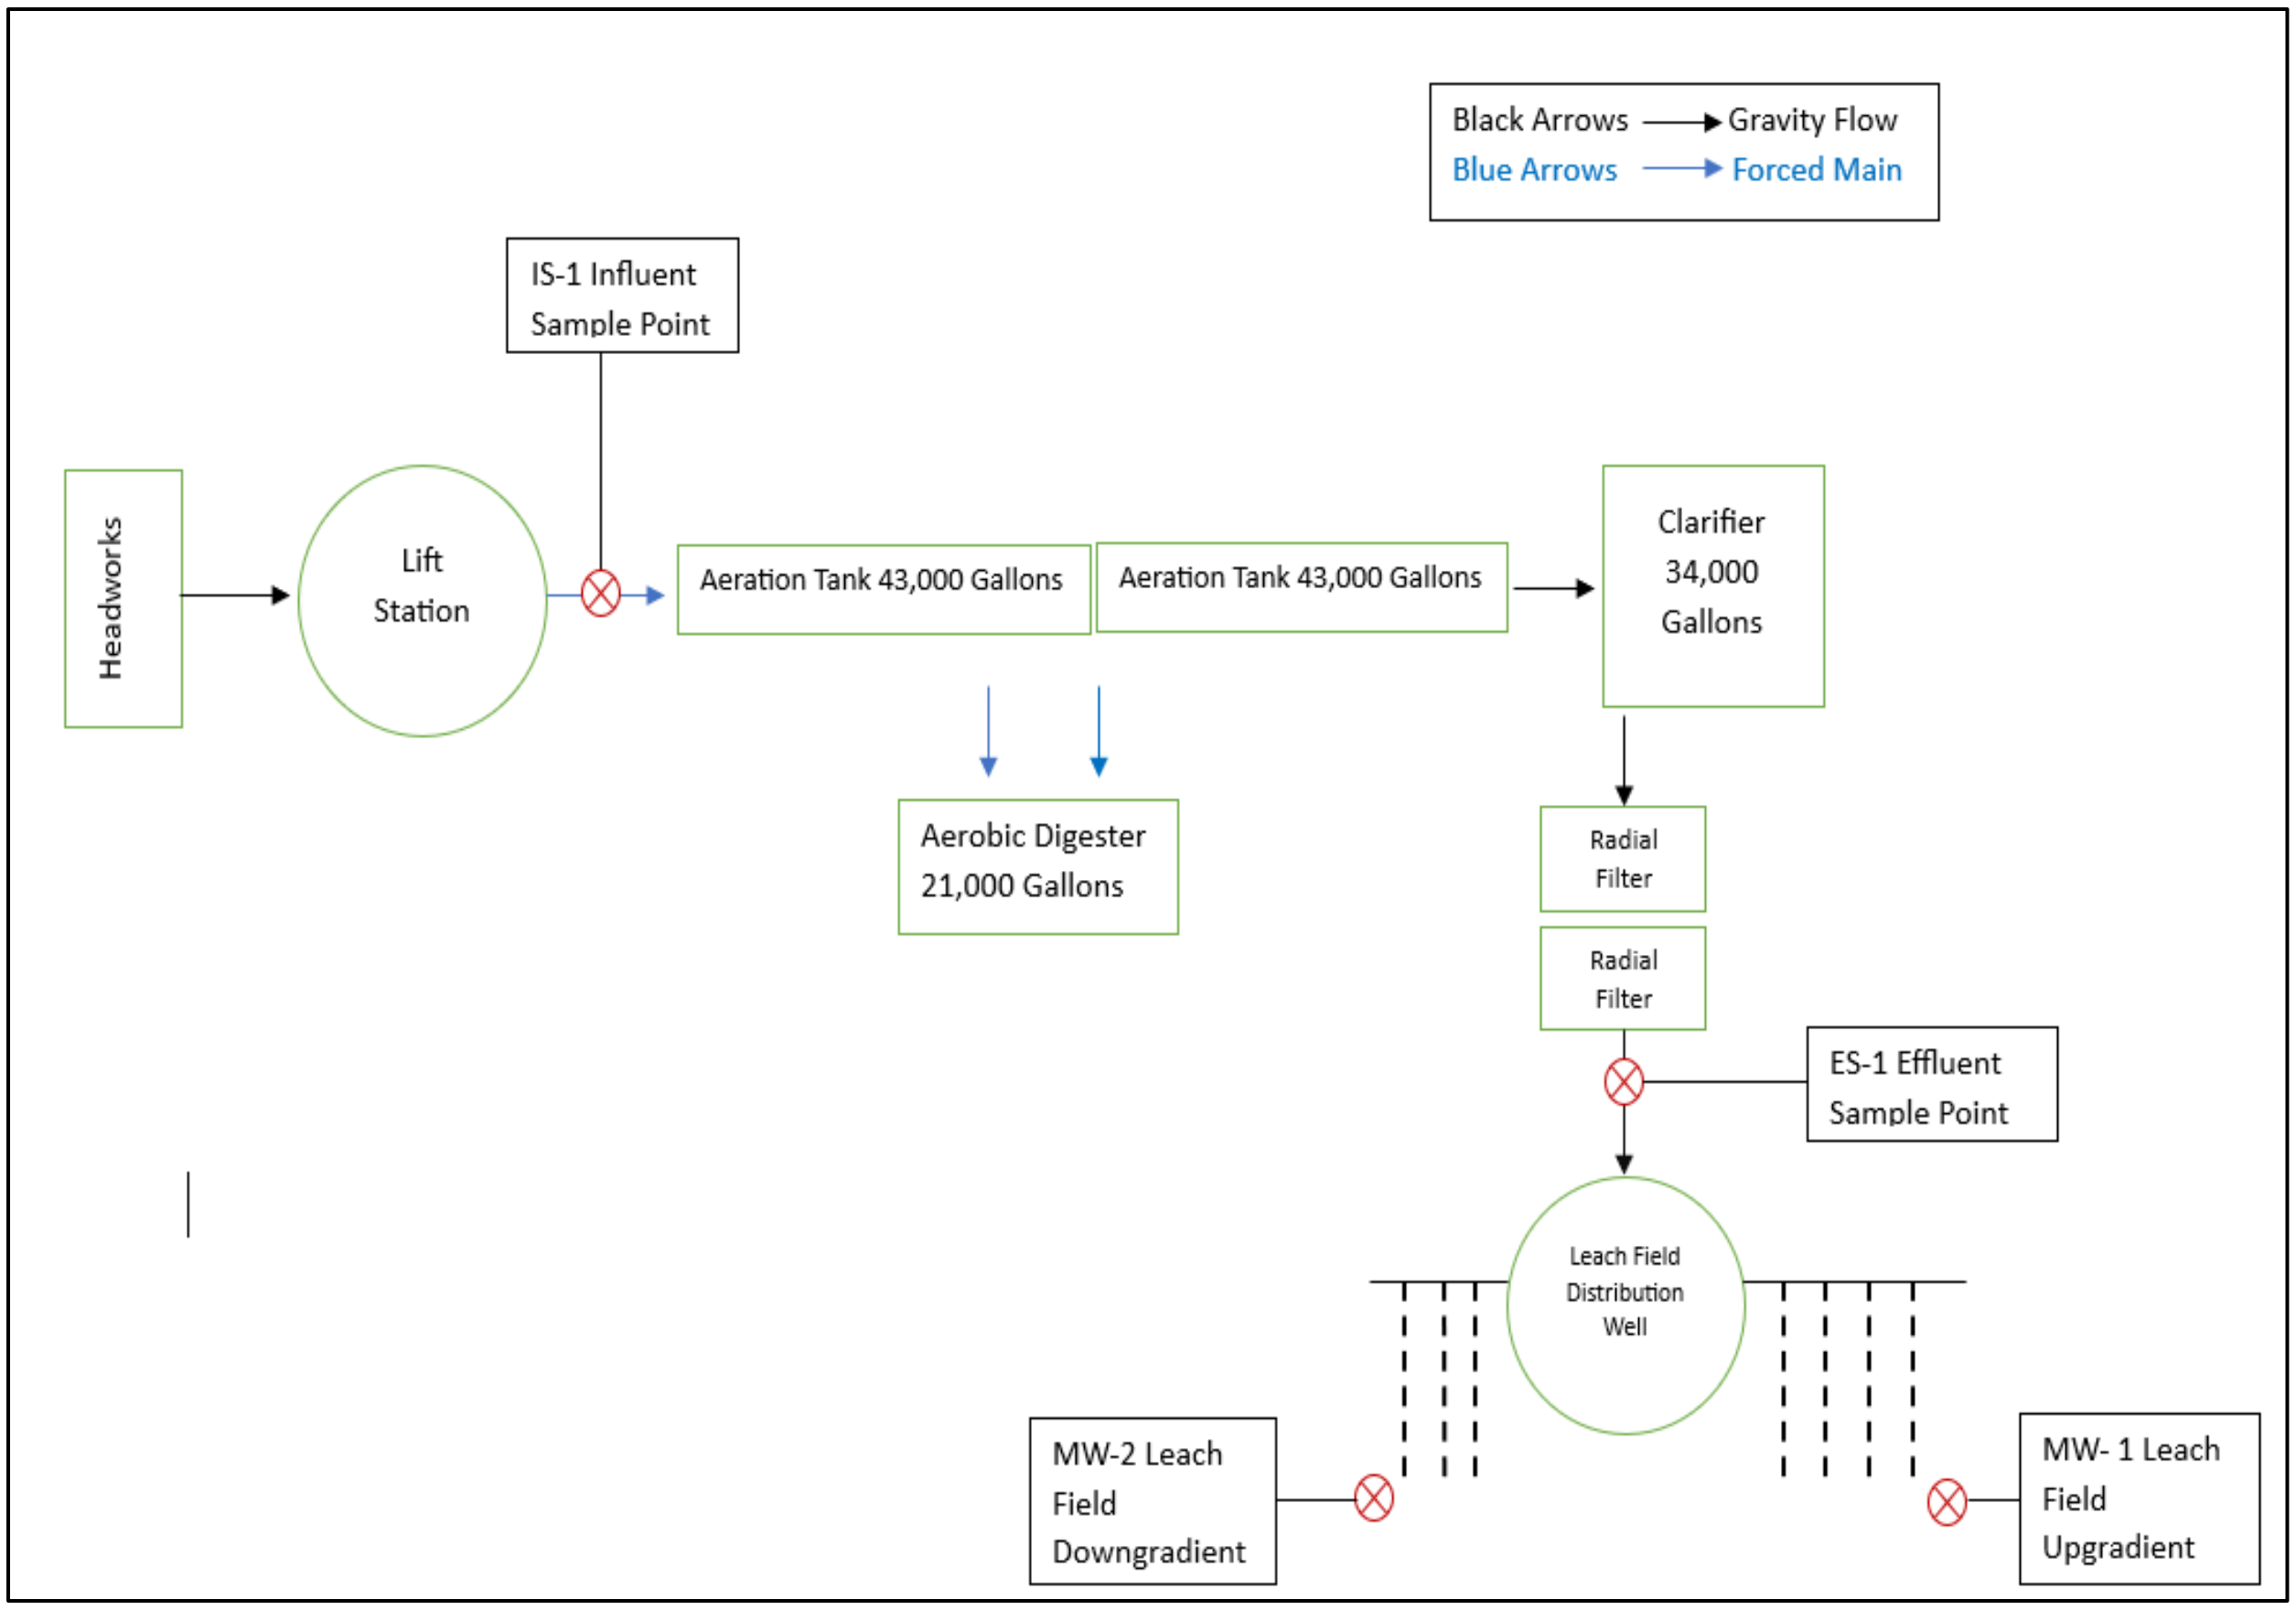

Figure 1. Process Flow Diagram with Sampling Locations Provided by California Department of Parks and Recreation

4. ACTIVATED SLUDGE TREATMENT UNIT MONITORING

A. Flow Monitoring

California Department of Parks and Recreation must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at IS-1 following grinding and screening.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow [1]	Gallons per day	Metered	Monthly
Monthly Average Flow [2]	Gallons per day	Calculated	Monthly

[1] Maximum daily flow is the maximum daily flow that occurs during the calendar month
[2] Monthly average flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month

B. Influent and Effluent Constituent Monitoring

Representative samples of California State Parks Pfeiffer Big Sur Wastewater System's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be collected as a grab sample.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day (BOD_5)	mg/L	Monthly	Monthly
Total Suspended Solids	mg/L	Monthly	Monthly
pH	pH units	Not Required	Monthly
Total Nitrogen	mg/L	Quarterly	Monthly[3]
Nitrate (as N) + Nitrite (as N) or separate species[1]	mg/L	Quarterly	Monthly[3]
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Monthly[3]
Ammonia (as N)	mg/L	Quarterly	Monthly[3]
Zinc	mg/L	Quarterly	Monthly[3]
Phenol	mg/L	Quarterly	Monthly[3]
Formaldehyde	mg/L	Quarterly	Monthly[3]
Total Dissolved Solids	mg/L	Not Required	Semiannually
Chloride	mg/L	Not Required	Semiannually
Sodium	mg/L	Not Required	Semiannually
Sulfate	mg/L	Not Required	Semiannually
Boron	mg/L	Not Required	Semiannually
Total Coliform Organisms[2]	MPN/ 100ml	Not Required	Quarterly

mg/L = milligram per liter MPN = most probably number

[1] Nitrate and nitrite sample may be combined

[2] using a minimum of 15 tubes or three dilutions

[3] after 24 months, California Department of Parks and Recreation may request the Central Coast Water Board revise the monitoring and reporting program for a reduced monitoring frequency

5. SUBSURFACE DISPOSAL AREA INSPECTIONS

California Department of Parks and Recreation must walk the disposal areas to inspect all items in Table 6 at least weekly and after rain events. All pump controllers and automatic distribution valves must be inspected for proper operation as recommended by the manufacturer. Shallow-rooted plants are generally desirable, deep-rooted plants such as trees must be removed as necessary. Evidence of animals burrowing must be immediately investigated, and burrowing animal populations controlled as necessary. Disposal areas must be inspected to ensure they are allowing wastewater to infiltrate as designed, there is no surfacing, and soils are not saturated.

Table 6. Subsurface Disposal Area Monitoring

Parameter	Inspection Frequency	Reporting Frequency
Pump controllers, automatic valves	Weekly	Semiannually
Nuisance Odor Condition	Weekly	Semiannually
Saturated Soil Condition	Weekly	Semiannually
Plant Growth	Weekly	Semiannually
Vectors or Animals Burrowing	Weekly	Semiannually
Disposal Area Condition	Weekly	Semiannually

A log of these inspections must be maintained onsite in a logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded. California Department of Parks and Recreation must submit a summary of violations found during the inspections with each subsequent monitoring report, or a note that there were no violations.

6. GROUNDWATER MONITORING

California Department of Parks and Recreation’s previous permit (Order 98-62) required groundwater monitoring. In consideration of Pfeiffer Big Sur Wastewater System’s repeated effluent violations for excess nitrate and shallow groundwater, the Central Coast Water Board has determined that groundwater monitoring is required.

California Department of Parks and Recreation must implement a groundwater monitoring program to demonstrate compliance with the General Permit. Groundwater monitoring reports, workplans, and other technical reports that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

Representative samples from all monitoring wells (MW-1 and MW-2) must be collected and analyzed as described in Table 7. California Department of Parks and Recreation must measure depth to groundwater (to 0.1 feet accuracy) in each monitoring well before it is purged and sampled. California Department of Parks and Recreation must record and submit field sheets documenting purge methods. California Department of Parks and Recreation must collect groundwater samples from each well after the groundwater levels in the well have recovered sufficiently to ensure the collection of representative groundwater samples.

Table 7. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation [1]	0.01 ft msl	Calculated	Quarterly
Depth to Groundwater [1]	0.01 ft bgs	Measurement	Quarterly
Total Nitrogen[2]	mg/L	Calculated	Quarterly
Nitrate (as N)	mg/L	Grab	Quarterly
Ammonia (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Sulfate	mg/L	Grab	Quarterly
Boron	mg/L	Grab	Quarterly
Total Coliform Organisms[3]	MPN/100 mL	Grab	Quarterly
Formaldehyde	mg/L	Grab	Semiannually

[1] ft.msl denotes feet above average sea level and ft bgs denotes feet below ground surface.
[2] Calculations must be prepared by, or under the responsible charge of, a California licensed Civil Engineer or geologist.
[3] MPN/mL denotes most probable number per milliliter

7. SOLIDS DISPOSAL MONITORING

California Department of Parks and Recreation must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the Wastewater System, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

If solids are not removed during the year, California Department of Parks and Recreation must explain the absence of this monitoring in the annual report.

8. COLLECTION SYSTEM MAINTENANCE

California Department of Parks and Recreation must submit records of any maintenance performed on the sewer collection system within the past year.

9. REPORTING

A. The monitoring reports must be submitted in accordance with Table 8.

Table 8. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Report	January 1 to March 31	May 1
Second Quarter Report	April 1 to June 30	August 1
Third Quarter Report	July 1 to September 30	November 1
Fourth Quarter Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

B. Quarterly Reports – At a minimum, the quarterly reports must include:

- i. Facility Information and Description
  - i. Briefly describe your facility, treatment process, and disposal process with references to figures. Description must include a wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing
- ii. Data Tables
  - i. Tabular summaries of all monitoring data (influent and effluent) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- iii. Compliance and Performance Discussion
  - i. Disclosure of any noncompliance (violations) with the notice of applicability and/or General Permit requirements, including a description, its cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
  - ii. An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD_5, TSS, total nitrogen, total coliforms, formaldehyde) over time, nuisance conditions, and system problems.
  - iii. A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- iv. Recreational Vehicle Signage and Education Requirements

   i. Certify compliance with the Senate Bill 317 directive in the first quarterly report (e.g. photographs of posted signage and their respective on-site locations).
   ii. Report on actions undertaken to educate RV customers about RV holding tank chemicals and a discussion about the success of these actions (i.e., does the formaldehyde testing show that the actions are working to prevent the discharge of chemicals from RV holding tanks at the facility or are additional educational efforts needed).

v. Flow Evaluation
   i. A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.

vi. Laboratory Sheets
   i. Copies of laboratory analytical report(s) and chain of custody form(s).

C. Annual Reports – At a minimum, the Annual Reports must include:

i. Tabular and graphical summaries of all monitoring data (groundwater, flow, effluent, and water supply) collected during the year. These summaries shall contain applicable effluent and groundwater limits.

ii. An evaluation of the performance of the wastewater treatment facility, including discussion of capacity issues, nuisance conditions, system problems, and a forecast of the flows anticipated in the next year. A flow rate evaluation as described in the General Permit (Provision E.2.c) shall also be submitted.

iii. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the notice of applicability and/or General Permit

iv. Installation and Operations Report
   i. If any wastewater system installations occur during the year, a report of the construction inspections certified by a qualified professional (e.g., licensed engineer, environmental health specialist) that the wastewater treatment and disposal systems are installed per design. Include a report of the inspection and final testing of the systems in operation

v. Solids Disposal
   i. If solids are disposed of offsite, comply with the reporting in Section 7.

vi. Disposal Area Inspection
   i. Report on the results of the disposal area inspections, as described in Section 5.

vii. Collection System Maintenance
   i. Records of any collection system maintenance performed on the sewer collection system during the reporting period.

10. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

California Department of Parks and Recreation must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker[1,2] database consistent with applicable Electronic Submittal of Information (ESI) requirements under a Wastewater System-specific global identification number **WDR100027053** at:

https://geotracker.waterboards.ca.gov/esi/login

Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other documents related to the wastewater system.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water quality samples from the laboratory, field monitoring not required.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report

[1] Information for first-time GeoTracker users is available at: https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf
[2] Additional information available at: https://geotracker.waterboards.ca.gov/

Electronic Submittal	Description of Action	Action	Frequency
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points (excluding supply wells). Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

11. TECHNICAL REPORTS

California Department of Parks and Recreation must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 10. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	January 5, 2026
Sampling and Analysis Plan	January 5, 2026
Sludge Management Plan	January 5, 2026
Time Schedule Compliance Plan	March 28, 2027

A. Time Schedule Compliance Plan

i. California Department of Parks and Recreation must provide a report that evaluates the data collected in the sampling events from October 2025 through October 2026 and compare it with the effluent limits described in the notice of applicability Table 3 Wastewater Limits for Activated Sludge Treatment. If effluent is not meeting the effluent limitations, California Department of Parks and Recreation must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:

   i. Comparison of the current effluent quality to the effluent limits shown in notice of applicability Table 3 Wastewater Limits for Activated Sludge Treatment and comparison of the current groundwater quality to the water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).

   ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.

   iii. Justification of the need for additional time to achieve the effluent limitations in notice of applicability Table 3 Wastewater Limits for Activated Sludge Treatment and water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).

   iv. A detailed time schedule of specific actions California Department of Parks and Recreation will take to achieve the effluent limitations, assessment of groundwater wells MW-3 and MW-4, updated figure on MW-3 and MW-4 locations, disinfection system, and documentation supporting the decommissioning of the seven seepage pits.

v. An assessment of the percolation rates of the disposal area and the disposal capacity of the disposal areas by a California licensed or credentialed professional.

vi. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).

vii. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:

I. Effluent limitation(s) for the pollutant(s) of concern.

II. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).

12. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that California Department of Parks and Recreation submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to section 13267 of the California Water Code. Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject California Department of Parks and Recreation to enforcement action pursuant to section 13268 of the California Water Code.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. California Department of Parks and Recreation is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

California Department of Parks and Recreation must implement the above monitoring program on October 2, 2025. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. California Department of Parks and Recreation must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

for Ryan E. Lodge
Executive Officer