Central Coast Regional Water Quality Control Board

September 20, 2022 **Sent Via Electronic Mail**

Randy Ishii, MS, PE, TE, PTOE
Director of Public Works, Facilities & Parks
Monterey County Department of Public Works, Facilities & Parks
1441 Schilling Place, 2nd Floor
Salinas, CA, 93901
E-mail: IshiiR@co.monterey.ca.us

Dear Randy Ishii:

CHUALAR WASTEWATER TREATMENT PLANT, CHUALAR DUMP ROAD, SALINAS, CA, 93901, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0022; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER NO. 01-038 FOR CHUALAR WASTEWATER TREATMENT PLANT.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) staff reviewed the December 10, 2021 notice of intent and available documents associated with Monterey County Department of Public Works, Facilities & Parks' (hereby Monterey County) domestic wastewater treatment facility (Wastewater System) located at Chualar Dump Road in Chualar, California. The Wastewater System, owned by Monterey County, is currently regulated pursuant to *Waste Discharge Requirements Order No. 01-038 for Chualar Wastewater Treatment Plant, Monterey County Service Area No. 75* (Order No. 01-038).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit*).*

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and limitations (Attachment 1); a site map and disposal location map (Attachment 2); and contains Monterey County's monitoring and reporting program requirements (Attachment 3).

Monterey County is developing the Chualar Master Plan. The master plan, along with all files related to the facility, will be posted on the GeoTracker website, under the "Site Maps/Documents" tab.

https://geotracker.waterboards.ca.gov/profile_report.asp?global_id=WDR100033604

This letter also serves as a notice of termination of Monterey County's coverage in existing individual permit, Order No. 01-038.

Monterey County must comply with the following:

1. **General Permit** – Monterey County must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

   https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – Monterey County must comply with the requirements of the monitoring and reporting program enclosed with this letter (Monitoring and Reporting Program No. R3-2022-0022, Attachment 3). Montery County must start implementing the monitoring on **October 1, 2022**. The first quarterly monitoring report is due **February 1, 2023**, the first annual report is due **March 1, 2023,** and the annual volumetric data[1] submission must be uploaded annually to the State Water Board's GeoTracker database by **April 30th**.

   Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

   https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

   All annual reports must be formatted and completed as specified in the annual report template found at the following link:

[1] See: Volumetric Annual Reporting | California State Water Resources Control Board

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

Monterey County must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker[2,3] database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system – specific global identification **WDR100033604** number over the internet at:

https://geotracker.waterboards.ca.gov/esi/login.asp

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – Monterey County paid an annual fee of $23,783 on March 15, 2022 for coverage in the individual permit, Order No. 01-038. This payment covers Monterey County's enrollment in the General Permit for the 2021-2022 fiscal year.

   Monterey County must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Monterey County's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

   https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification –** The Central Coast Water Board will be notified of Monterey County's enrollment at a regularly scheduled public meeting on December 8-9, 2022. Details about that meeting are available on our website at:

   https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Monterey County must inform the Central Coast Water Board at least 120

[2] See: Information for first-time GeoTracker users

[3] Additional information available at: http://geotracker.waterboards.ca.gov/

days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Monterey County must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at Chualar Dump Road, Chualar, California 93925. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Monterey County must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

6. **Responsible Party** – Monterey County is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Monterey County to enforcement action, and termination of enrollment under this General Permit.

7. **Change in Ownership** - In the event of any change in control or ownership of the property, Monterey County must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Monterey County' enrollment in the General Permit can be terminated.

8. **Certified Operator** – Monterey County is required to comply with the operator certification requirements[4] administered by the State Water Board's Office of Operator Certification, which currently requires a Class II certified operator onsite to maintain and operate the Wastewater System.

9. **Termination of Permit** - The existing individual permit, Order No. 01-038 is terminated except for enforcement purposes.[5] Monterey County is responsible for compliance with Order No. 01-038 prior to the date of this letter.

10. **Compliance Schedule -** The Central Coast Water Board generally concurs with Monterey County's plan to conduct a feasibility study to determine whether significant system upgrades will be made or consolidation with a neighboring wastewater treatment plant. As required in the attached monitoring and reporting

---

[4] Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

[5] The General Permit states "…where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

program, Monterey County must request a time schedule order 12 months from the date of this notice of applicability pursuant to Water Code section 13300, which must include more details, milestones, and a schedule for upgrades.

If you have any questions, please contact **Kathy Truong at (805) 549-3293 or by email at Kathy.Truong@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp Digitally signed by Jennifer Epp
Date: 2022.09.19 14:39:31
-07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations
Attachment 2: Site Map and Disposal Location Map
Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0022

cc:
Tom Moss, Monterey County, mosst@co.monterey.ca.us
Lynette Redman, Monterey County, RedmanL@co.monterey.ca.us
John Rauber, Monterey County, RauberJ@co.monterey.ca.us
Michael Lane, Cal Rural Water, mlane@calruralwater.org
Kari Wagner, Wallace Group, KARIW@wallacegroup.us
Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov
Jesse Woodard, Central Coast Water Board, Jesse.Woodard@Waterboards.ca.gov
Kathy Truong, Central Coast Water Board, Kathy.Truong@Waterboards.ca.gov
Matthew Chambers, State Water Board DFA, Matthew.Chambers@Waterboards.ca.gov
Kristina Olmos, Central Coast Water Board, Kristina.Olmos@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-241305
GeoTracker No. = GT- WDR100033604
Rev 9/24/2021

ECM Subject Name = Chualar Wastewater Treatment Plant NOA for R3-2020-2020
\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Chualar WWTP\0020 Enrollment\NOA_MRP\R3-2020-0020 NOA Chualar_Final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS, AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by Monterey County to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Chualar Wastewater Treatment Plant
Physical Address	Chualar Dump Road Chualar, CA, 93925
Latitude	36.5518775°N
Longitude	121.5419360°W
Mailing Address	1441 Schilling Place, 2nd Floor Salinas, CA, 93901
Owner	Monterey County
Operator	Monterey County Phone: (831) 796-6038 E-mail: mlane@calruralwater.org
Legally Responsible Official	Randy Ishii Phone: (831) 755-4800 E-mail: IshiiR@co.monterey.ca.us
Raw Wastewater Characteristics	Sewer Connections: 173 Population Served: 1,185 Domestic (%): 100%
Average Monthly Permitted Design Flow (gallons per day, gpd)	80,000
Baseline Flow (average monthly flow) in gpd	60,000
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory Measure Type	Enrollee - WDR
Reclamation Included	No

2. WASTEWATER SYSTEM OPERATION SUMMARY

Chualar wastewater treatment facility (Wastewater System) is a Class II wastewater system. Monterey County must staff a Class II or higher chief plant operator for proper operation of the Wastewater System. The current plant operators are Dennis Longhofer, Grade V, License 3784 and Michael Lane, Grade V, License 9776.

The Wastewater System was originally designed to treat 100,000 gallons per day (annual average daily flow) to a secondary treatment level and has a disposal capacity of 100,000 gallons per day. Currently, the Wastewater System is not consistently achieving secondary treatment level standards. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2. The Central Coast Water Board is permitting the operation and disposal of the wastewater system as described below. Monterey County must not change operation or disposal without Central Coast Water Board notification, and review.

Table 2. Treatment Technology and Capacity

Headworks/Preliminary Treatment	The wastewater system has a pretreatment headworks with vertical bar screens that are cleaned manually. Solid waste cleaned from bar screens is stored on site until transferred to a disposal facility.
	Headworks capacity (gpd): 100,000 (annual average daily flow) as indicated in old permit.
Primary Treatment	From the headworks, sewage flows into pond 2A where solids settle out. Wastewater from pond 2A flows through a low-flow weir to Pond 2 where primary treatment is accomplished. Wastewater can also be routed directly from the headworks to Pond 1 or 3 for primary and secondary treatment.
	Primary treatment capacity (gpd): 100,000 (annual average daily flow) as indicated in old permit.
Secondary Treatment	From Pond 2, treated flow goes into Pond 1 or 3 where a SolarBee aerator (currently not in use) increases the available dissolved oxygen in the water, improves the biological treatment process, and reduces undesirable gas. Pond 4 is utilized as an overflow pond and receives very little flow.
	Secondary treatment capacity (gpd): 100,000 (annual average daily flow) as indicated in old permit.
Wastewater Disposal Method	Wastewater is disposed of via evaporation/percolation in 5 ponds that have a total surface area of approximately 6.4 acres. Depth of ponds, total disposal capacity, percolation information is unknown.
	Disposal capacity (gpd): 100,000

Solids Production and Handling	The pretreatment headworks include vertical bar screens. Solid waste is manually cleaned from the bar screens, stored in a garbage can located adjacent to the headworks, and transported to a landfill on a quarterly basis.
	Annual production of biosolids: 0.25 tons
	The ultimate destination of biosolids produced is Clean Harbors Environmental located at 1010 Commercial Street in San Jose.

A summary of historic and recent average effluent concentrations is included in Table 3, which were reported in Monterey County quarterly monitoring reports. The Central Coast Water Board used reported effluent water quality data to establish the effluent and groundwater limitations in section 3.

Table 3. Effluent Water Quality for Select Constituents

Constituents	Units	Historical Average[2]	Annual Average for 2020[3]
Biochemical Oxygen Demand, 5-Day	mg/L	143	153
Total Suspended Solids	mg/L	157	141
Total Dissolved Solids	mg/L	617	709
Chloride	mg/L	106	114
Sodium	mg/L	132	126
Sulfate	mg/L	51 [4]	13
Boron	mg/L	0.37	0.38
Total Nitrogen	mg/L	50	47
Nitrate as Nitrogen	mg/L	<0.2	<0.2

[1] mg/L denotes milligrams per liter
[2] Based on water quality data reported by Monterey County in the 2015 to 2019 monitoring reports.
[3] Based on water quality data reported by Monterey County in the 2020 monitoring reports.
[4] Based on water quality data reported by Monterey County in the 2004 to 2020 monitoring reports.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

Monterey County must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Monterey County must comply with the wastewater system-specific limitations specified in Table 4 through Table 8.

A. Flow Limitations:

Daily wastewater flow averaged over each month shall not exceed 80,000 gpd, until facility improvements are complete (with design capacity supported by sufficient documentation) and approved by the Central Coast Water Board (through a revised notice of applicability). See Section VIII in the Monitoring and Reporting Program for the Interim Wastewater Treatment Improvement Workplan and Report requirements.

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily	Gallons per day	130,000	Influent
Mean Monthly Flow	Gallons per day	80,000	Influent

B. Effluent Limitations:

Based on a review of recent effluent quality data, the Central Coast Water Board has determined the Wastewater System is unable to consistently achieve secondary treatment level standards at the time of enrollment (see Table 3). Therefore, Monterey County must immediately comply with interim effluent limitations specified in this notice of applicability upon issuance. In accordance with the General Permit, the interim effluent limitations are based on the effluent limitations specified in Monterey County pre-existing individual permit, Order No. 01-038. The individual permit only has effluent limits for pH, so the only constituent that has an interim limit is pH. This interim effluent limitation is effective upon the date of issuance of this notice of applicability and will remain in effect for a maximum of 24 months.

Table 5. Interim Effluent Limitations: Treatment Ponds

Constituent	Units	30-Day Average
pH	Not Applicable	Between 6.5 and 8.4

Based on existing water quality, **Table 6 effluent limits are immediately attainable and therefore apply as of the date of this notice of applicability**.

Table 6. _Effluent Limitations
Based on - Salinas Valley 180 foot Aquifer Objectives

Constituents	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L	1500
Chloride	mg/L	250
Sodium	mg/L	250
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	NA[1]

[1] In 24 months from the date of this notice of applicability, an effluent limit of 10 mg/L will apply at the disposal ponds, or in groundwater. Monterey County must propose a point of compliance in groundwater and monitor groundwater in the compliance work plan.

C. Effluent Limitations:

In accordance with the General Permit, Monterey County must comply with effluent limitations specified in this notice of applicability (Table 7 and Table 8) no later than 24 months following this issuance of this notice of applicability.

Where Monterey County believes that additional time (more than 24 months) is needed to achieve compliance with the effluent limitations (as specified in Table 7 and 8 of this notice of applicability), Monterey County must notify the Central Coast Water Board and refer to this General Permit to determine an appropriate path forward (e.g., request a time schedule order pursuant to Water Code section 13300 for consideration by the Central Coast Water Board, adoption of groundwater limitations and implementation of a groundwater monitoring program, etc.).

Table 7. Effluent Limitations: Treatment Ponds (in 24 months)

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L[1]	45	65	Not Applicable
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L[2]	0.3	Not Applicable	0.5
pH	Not Applicable	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mg/L denotes milligrams per liter
[2] mL/L milliliters per liter

Table 8. Effluent Limitations (in 24 months)
Based on Salinas Valley 180 foot Aquifer

Constituents	Units	25-Month Rolling Median[2]
Total Dissolved Solids	mg/L[1]	1500
Chloride	mg/L	250
Sodium	mg/L	250
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	10

[1] mg/L denotes milligrams per liter
[2] Rolling Median is the median from all data collected over the most recent 25 months

The above limits will apply in two years if Monterey County chooses the point of compliance as the disposal pond. Alternatively, Monterey County could choose the point of compliance in groundwater and monitor groundwater.

GROUNDWATER LIMITS

Based on review of historical effluent water quality (see Table 3), Monterey County is unable to consistently comply with the General Permit effluent limitations for total nitrogen, thus the point of compliance for this constituent is underlying groundwater.

Table 9. Groundwater Limitations
Salinas Valley 180 foot Aquifer

Constituents	Units	25-Month Rolling Median[2]
Total Dissolved Solids	mg/L[1]	1500
Chloride	mg/L	250
Sodium	mg/L	250
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	10

[1] mg/L denotes milligrams per liter
[2] Rolling Median is the median from all data collected over the most recent 25 months
Because Monterey County can achieve these limits in the effluent, groundwater monitoring is not required at that time.

ATTACHMENT 2
SITE MAP AND DISPOSAL LOCATION MAP

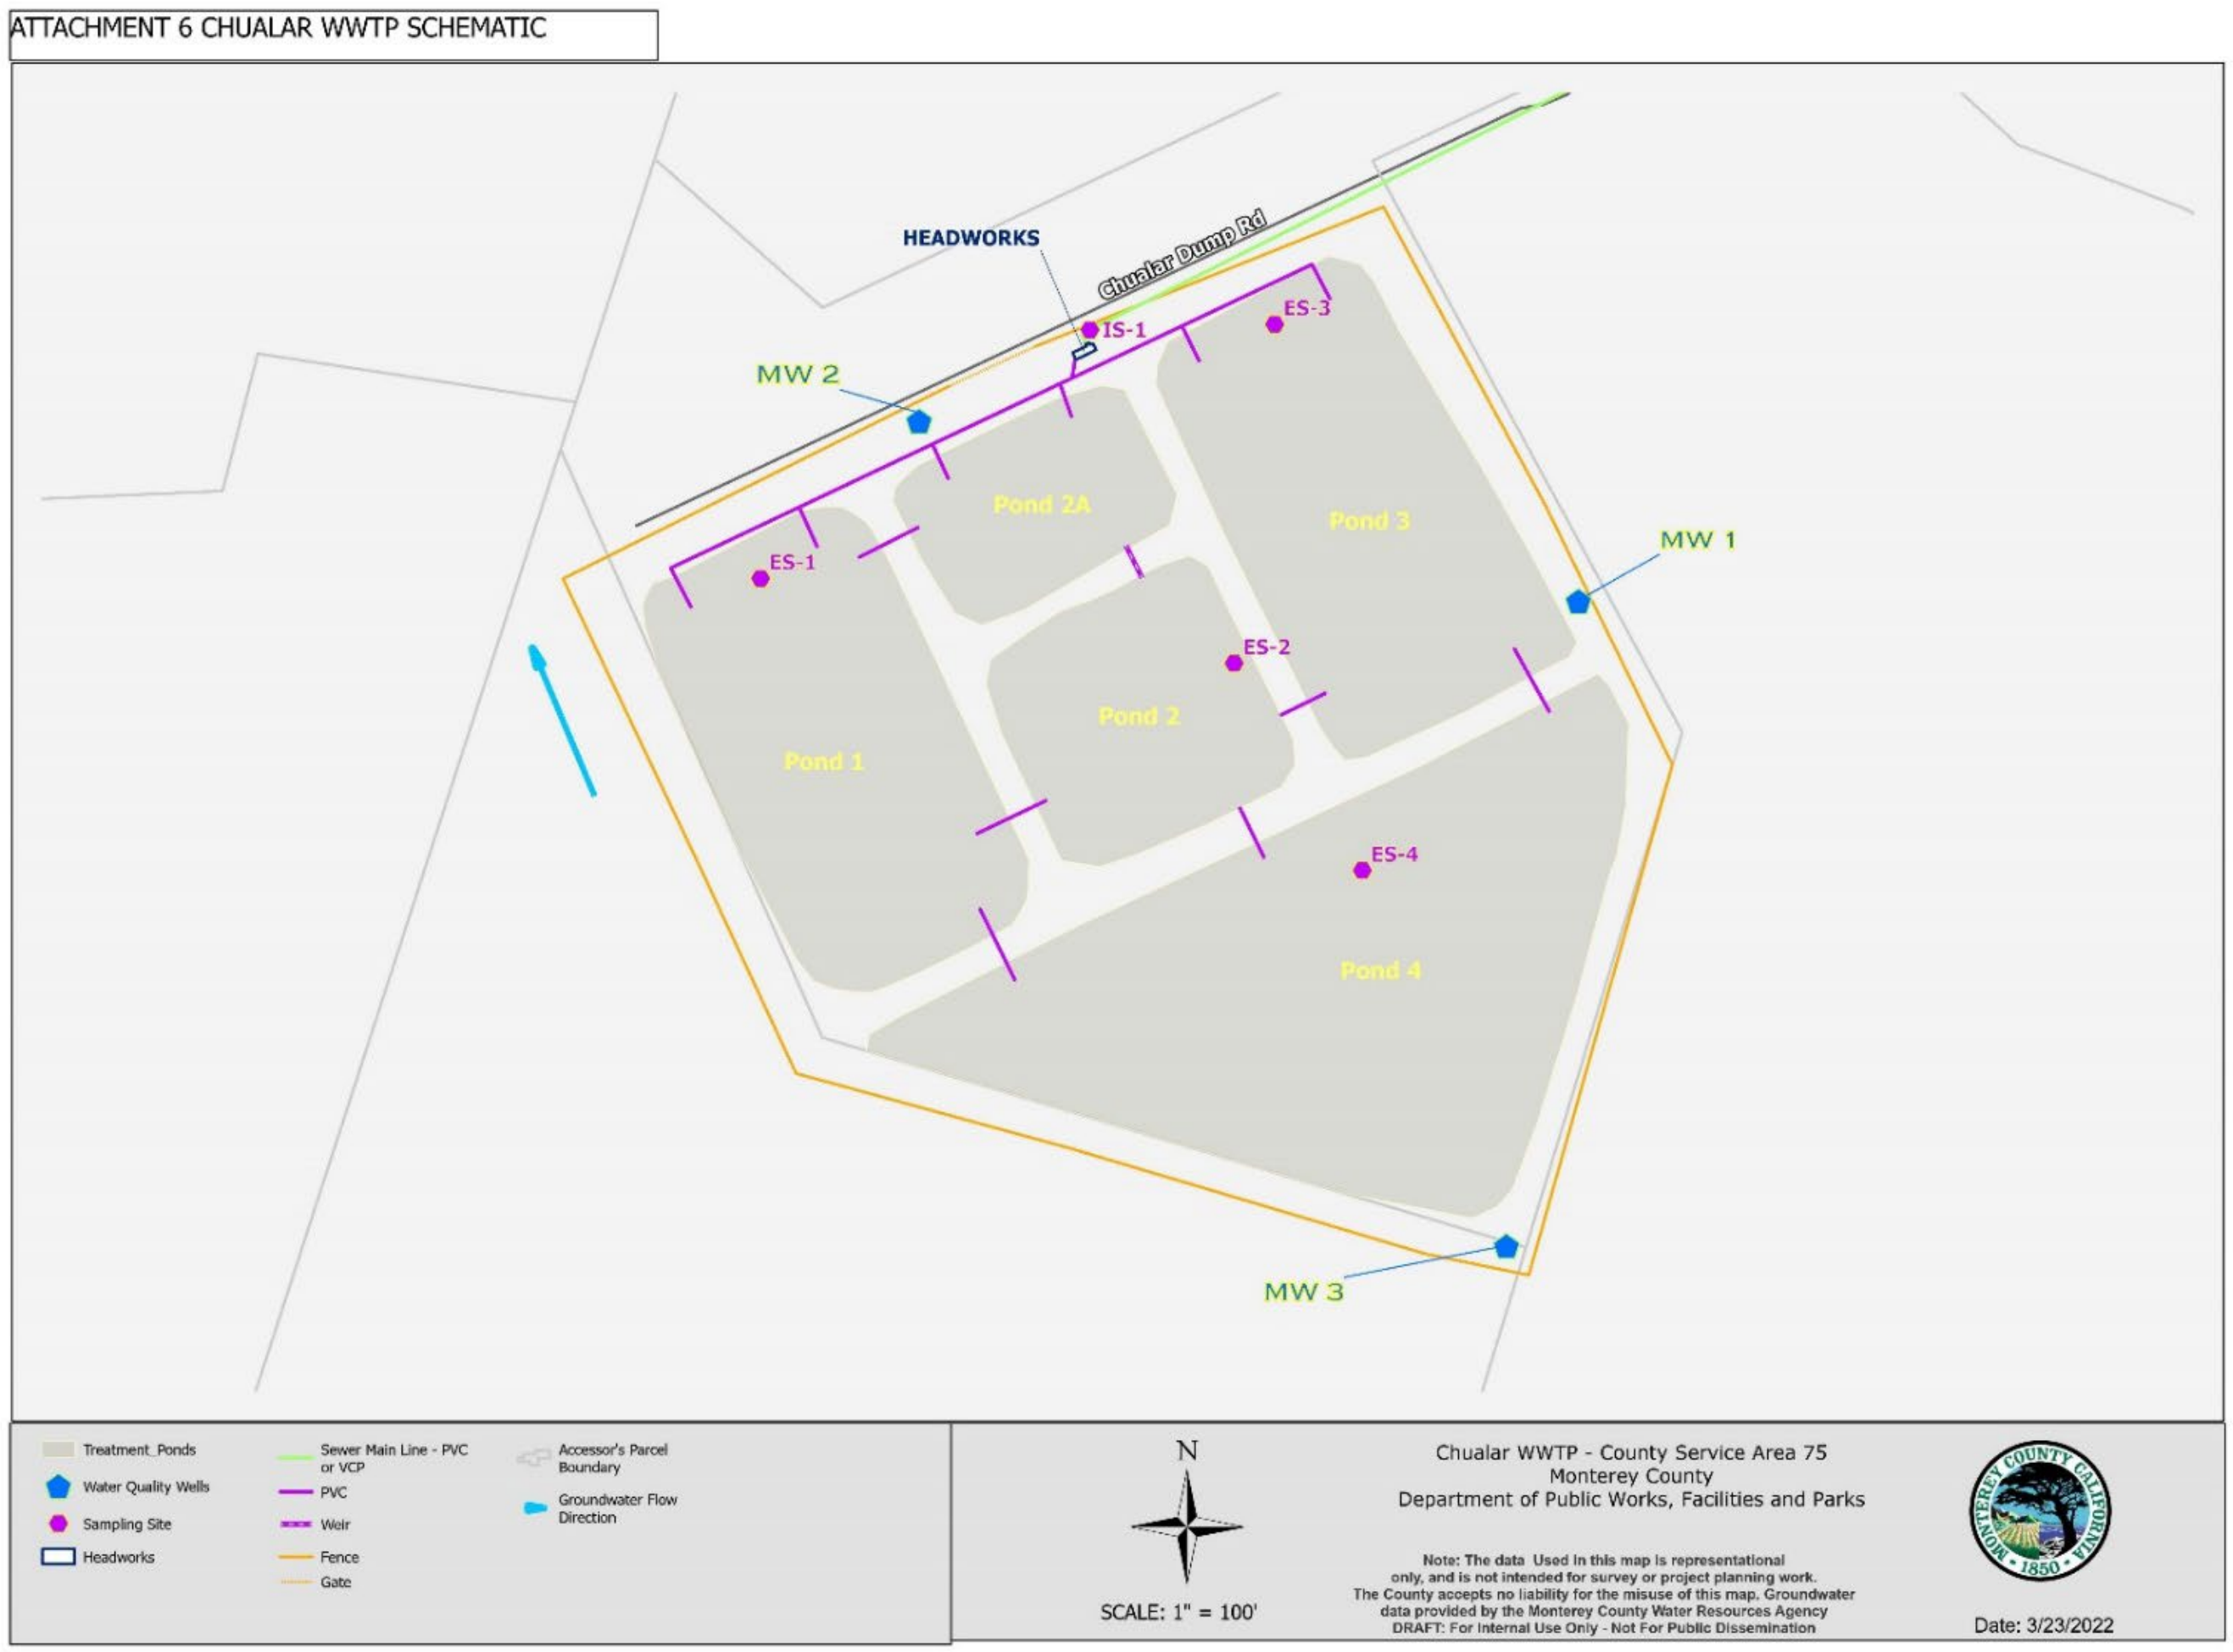

Figure 1. Facility Layout with sampling locations and Monitoring Historical Well Locations (County cannot locate all wells)

Figure 2. Aerial Facility Layout with sampling locations and Monitoring Historical Well Locations

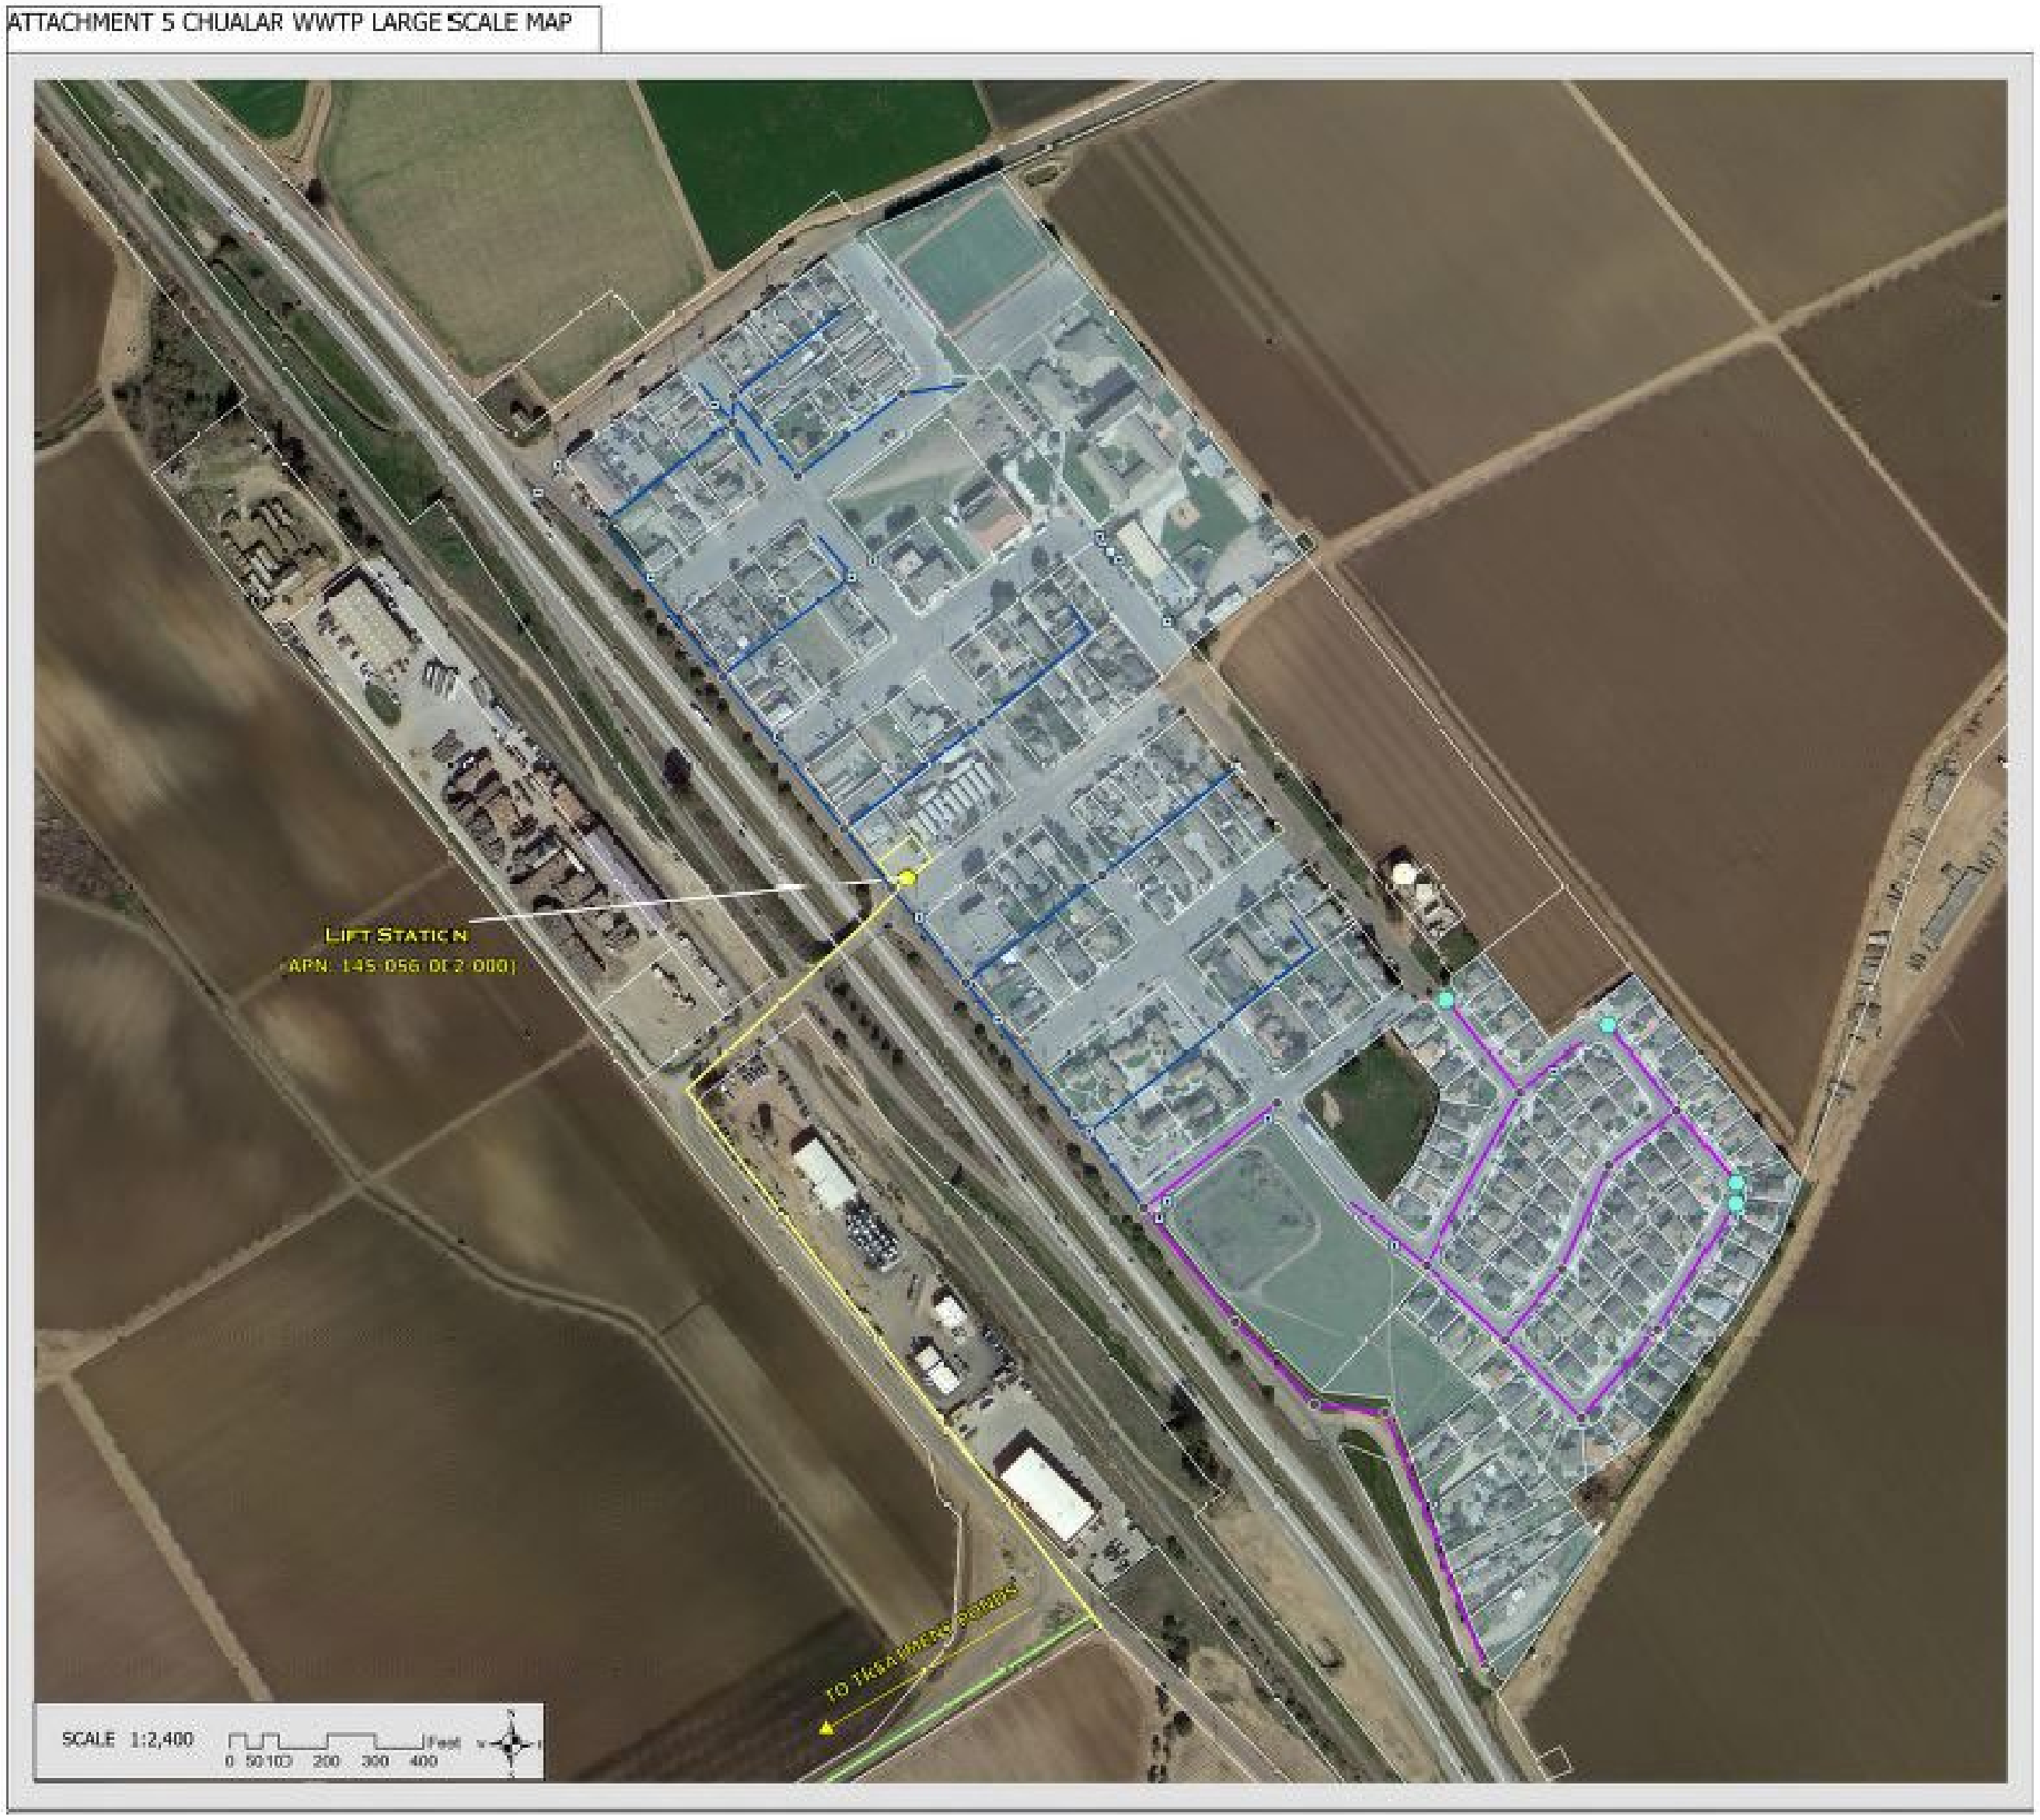

Figure 3. Chualar WWTP Large Scale Map

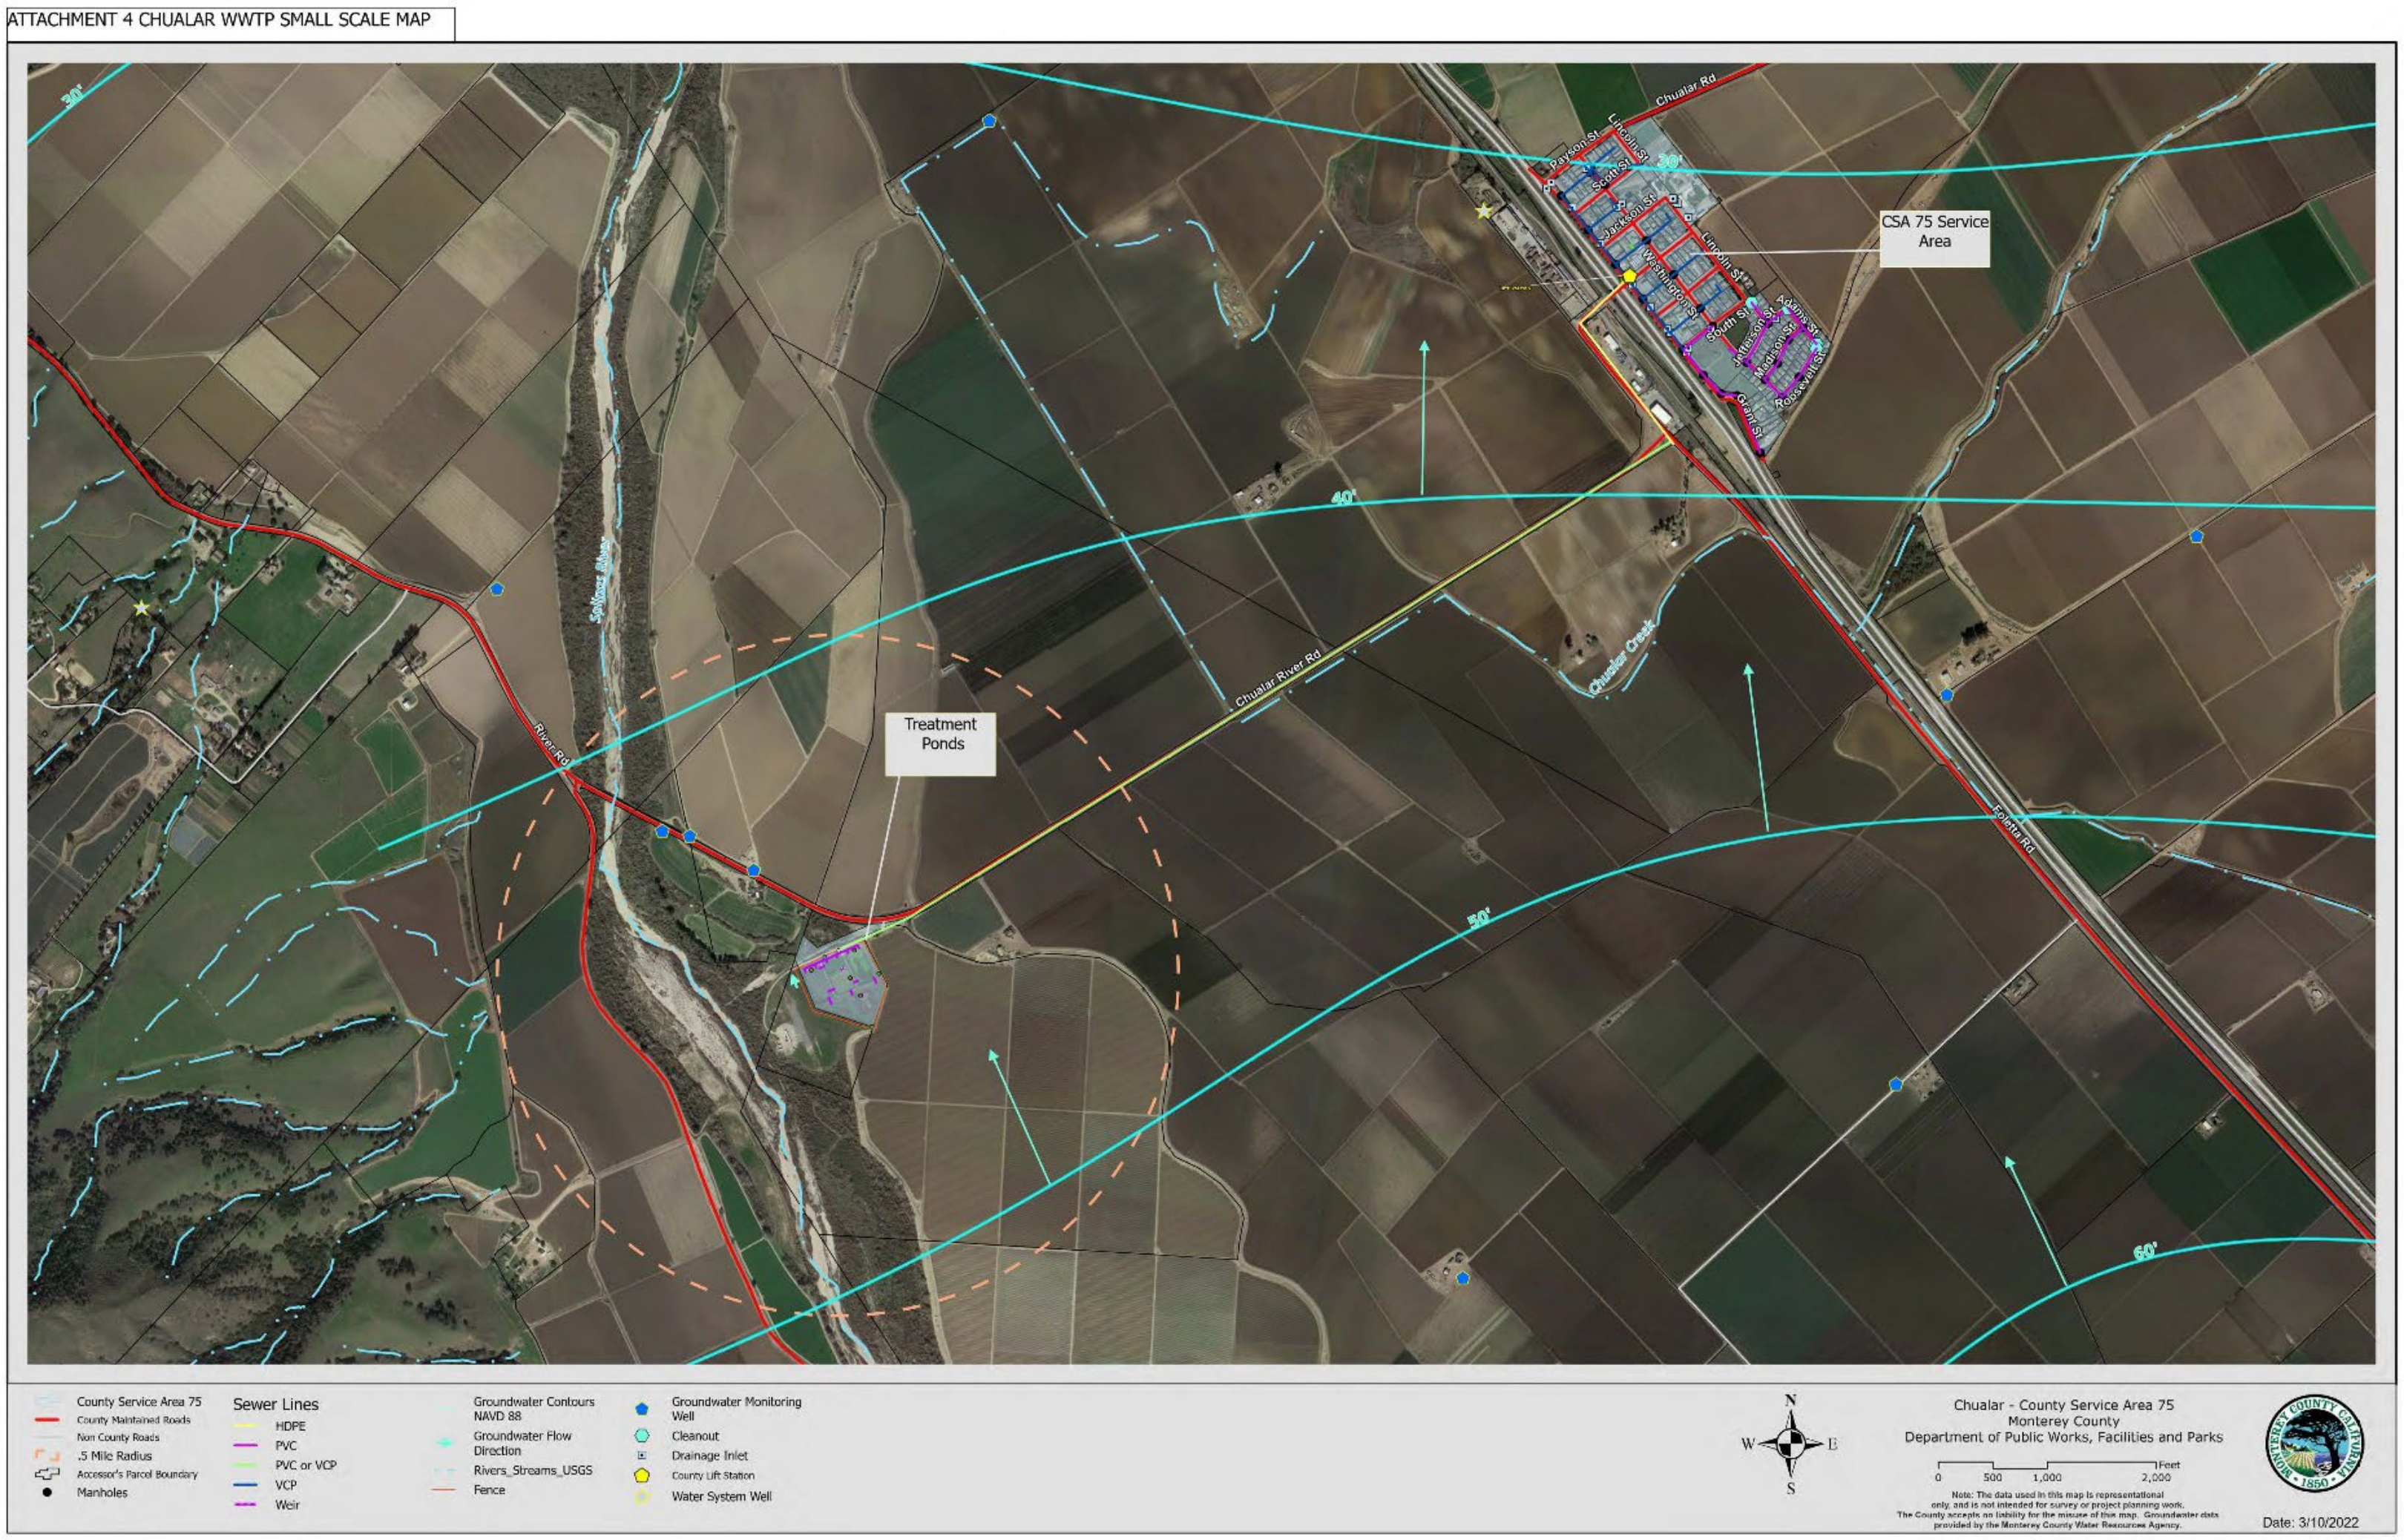

Figure 4. Chualar WWTP Small Scale Map

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM ORDER NO. R3-2022-0022
(MODIFICATION OF MRP ORDER NO. R3-2020-0020)
FOR
CHUALAR WASTEWATER SYSTEM
SALINAS, MONTEREY COUNTY

This Monitoring and Reporting Program (MRP) applies to the monitoring and reporting requirements for Chualar Wastewater Treatment Plant] (Wastewater System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Monterey County Department of Public Works, Facilities & Parks' (Monterey County or Discharger) owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. The Discharger must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The MRP directs the Discharger to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see MRP section VII.C).

I. SAMPLING AND ANALYSIS

The Discharger must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge, etc.) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

A. Sampling Schedule – Unless otherwise specified below, sampling must be performed in accordance with Table 1,

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity, etc.) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

B. Monitoring Location Descriptions – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW), etc. must be collected at the locations described in Table 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. The Discharger must upload the GeoTracker field point information once for each sampling location in the GeoTracker database (see Table 10).

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks
Effluent Sample	ES-1	Treated wastewater sample collected from Pond 1
Effluent Sample	ES-2	Treated wastewater sample collected from Pond 2
Effluent Sample	ES-3	Treated wastewater sample collected from Pond 3
Effluent Sample	ES-4	Treated wastewater sample from overflow pond Pond 4

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Monitoring Well 1	MW-1	Currently cannot be located [1]
Monitoring Well 2	MW-2	North of Pond 2A
Monitoring Well 3	MW-3	Southeast of Pond 4 (installed in 2015)

[1] Monitoring well cannot be located according to Monterey County staff and the 2020 Annual Report. Sampling will not be required at this time but is required if the well is found.

II. WATER SUPPLY MONITORING

Representative samples of the Discharger's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, the Discharger may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified Table 3. The Discharger must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. The Discharger must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

The Discharger must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units[1]	Sample Type	Sampling Frequency[2]
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – The Discharger must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See MRP section VII.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

		INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	**Units**	**Sample Type**	**Reporting Frequency**	**Sample Type**	**Reporting Frequency**
Daily Flow [1]	Gallons per day	Metered	Daily	Metered/Estimated [2]	Daily
Maximum (Peak) Daily Flow	Gallons per day	Metered	Monthly	Metered/Estimated [2]	Monthly
Average Daily Flow	Gallons per day	Calculated	Monthly	Calculated	Monthly

[1] The General Permit notice of applicability specifies the Wastewater System's permitted flow. In the monitoring reports, the Discharger must evaluate and provide a comparison of monitored flow to the permitted flow.

[2] If the flow is estimated, the Discharger is required to provide an explanation (e.g., no meter-estimated using pump operations including rate and time, etc.) with each monitoring report.

B. Wastewater System Monitoring – Representative samples of the Discharger's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figure 1 and Table 2 for the location of samples and GeoTracker field points.

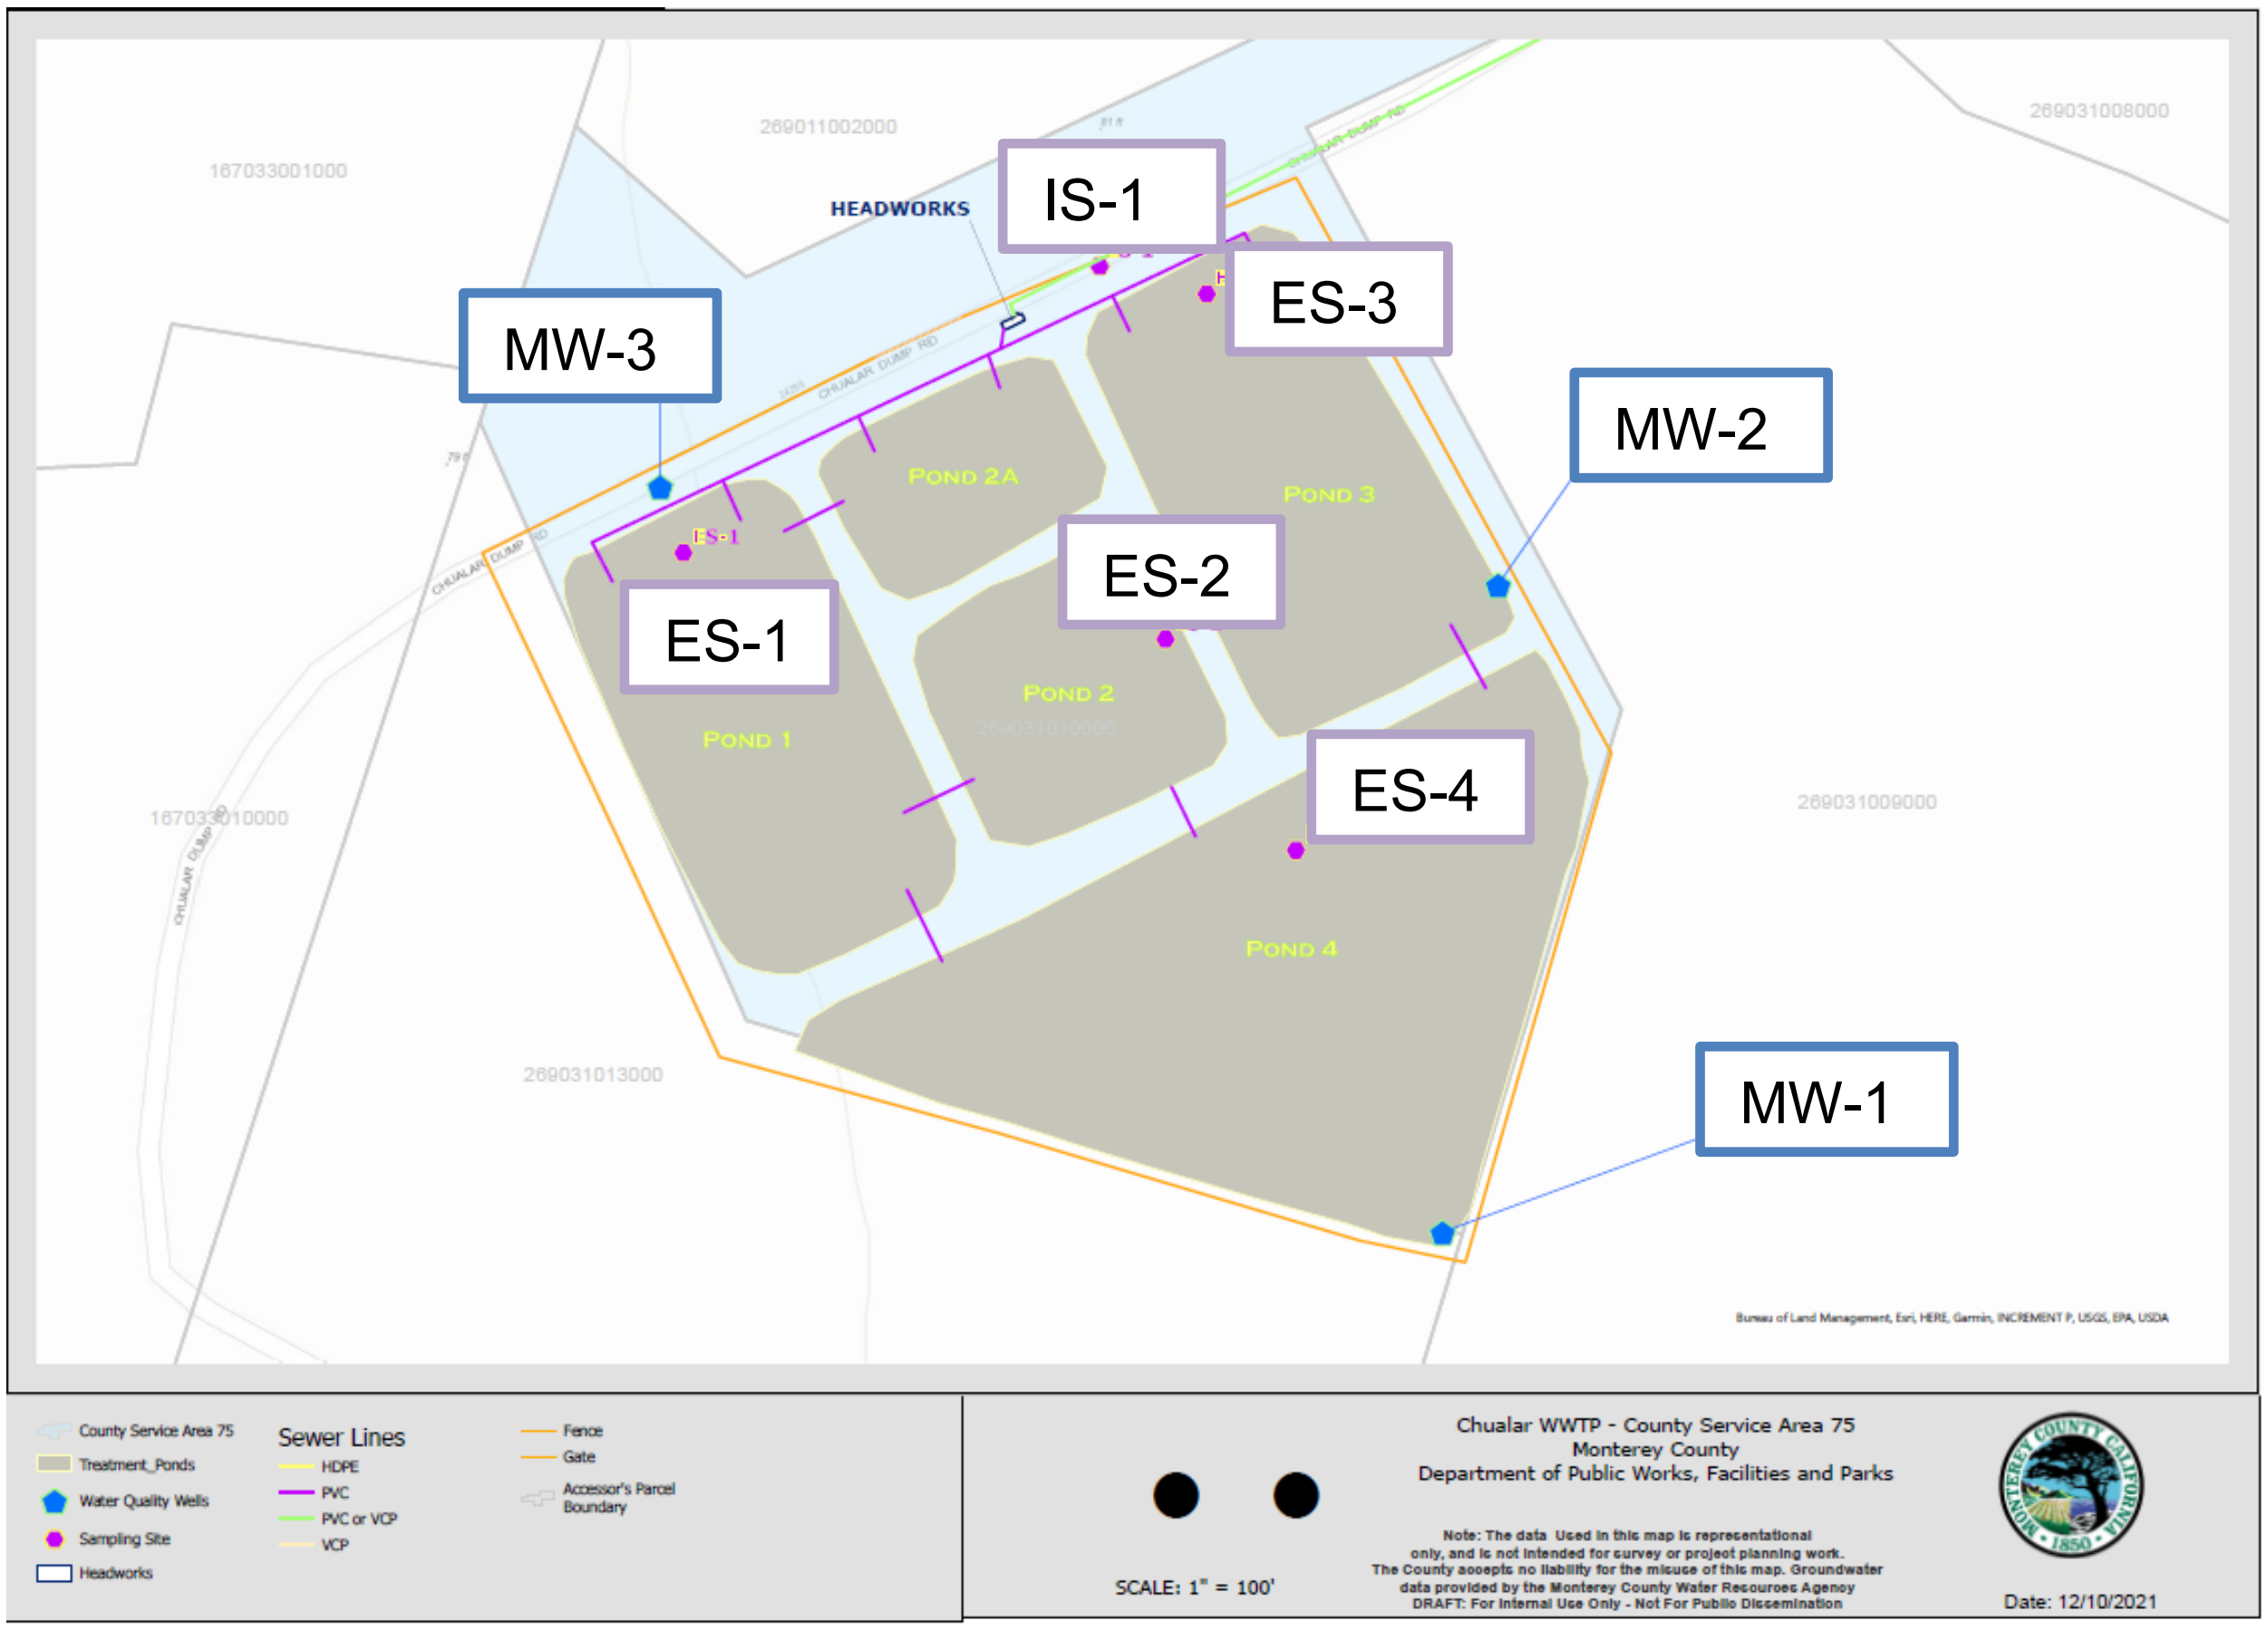

Figure 1. Process Flow Diagram and Sample Locations Referenced in Table 3

C. Pond System Monitoring

i. Required Pond Monitoring – All wastewater treatment and disposal ponds (unlined) must be monitored as specified in Table 5.

Table 5. Wastewater Treatment/ Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
Sludge Depth	0.1 feet	Measured	Annually

ii. Influent and Effluent Monitoring – At a minimum, influent and effluent constituent monitoring for pond treatment systems must be monitored as specified in Table 6.

Table 6. Influent and Effluent Monitoring for Pond Treatment Systems

		INFLUENT (IS)	INFLUENT (IS)	EFFLUENT (ES)	EFFLUENT (ES)
Parameter/ Constituent	**Units [1]**	**Sample Type**	**Sampling Frequency**	**Sample Type**	**Sampling Frequency**
pH	units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Suspended Solids	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Settleable Solids	mg/L	Not required	Not Required	Grab	Weekly
Total Nitrogen[2]	mg/L	Calculated	Quarterly	Calculated	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Dissolved Solids	mg/L	Not required	Not required	Grab	Quarterly
Chloride	mg/L	Not required	Not required	Grab	Quarterly
Sodium	mg/L	Not required	Not required	Grab	Quarterly
Sulfate	mg/L	Not required	Not required	Grab	Quarterly
Boron	mg/L	Not required	Not required	Grab	Quarterly
Carbonate	mg/L	Not required	Not required	Grab	Semiannually
Bicarbonate	mg/L	Not required	Not required	Grab	Semiannually
Calcium	mg/L	Not required	Not required	Grab	Semiannually
Potassium	mg/L	Not required	Not required	Grab	Semiannually
Magnesium	mg/L	Not required	Not required	Grab	Semiannually

[1] mg/L denotes milligrams per liter

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

IV. WASTEWATER DISPOSAL MONITORING

The Discharger must monitor all wastewater disposal areas (e.g., land application areas, percolation ponds, etc.) when wastewater is applied. Inspections must be conducted and documented at least weekly during operation and during and after rain events. Notations must be made in a bound logbook and include observations of bank/soil erosion, excessive odors, insects, or other potential nuisance conditions that may be present. Any problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon inspection.

The Discharger must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, etc. with each monitoring report. Wastewater disposal monitoring must be consistent with Table 7.

Table 7. Wastewater Disposal Monitoring

Constituent	Units	Sample Type	Monitoring Frequency
Local Precipitation	Inches/day	Weather Station [2]	Each precipitation event
Acreage Applied [3]	Acres	Measured	Daily
Application or Disposal Rate	Gallons per day	Metered/Estimated [1]	Daily
Average Monthly Biochemical Oxygen Demand, 5-Day (BOD) Applied [4] [5]	lbs/acre/day	Calculated	Quarterly
Total Nitrogen Applied [4] [5]	lbs/acre/day	Calculated	Quarterly
Soil Erosion Evidence	Not Applicable	Observation	Weekly
Containment Berm Condition	Not Applicable	Observation	Weekly
Soil Saturation/Ponding	Not Applicable	Observation	Weekly
Nuisance Odors/Vectors	Not Applicable	Observation	Weekly
Discharge Offsite	Not Applicable	Observation	Weekly

[1] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, the Discharger is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

[2] The Discharger must have a rain gauge or use a NOAA or USGS rain station, such as http://scacis.rcc-acis.org/.

[3] Acreage applied denotes the acreage to which wastewater is applied, the footprint of the ponds.

[4] The total nitrogen and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X\ [\text{mg/L}] \times Q\ [\text{million gallons per day}] \times 8.34\ [(\text{conversion from mg/L to pounds/million gallons per day}\ ]}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen or BOD concentration
Where Q = Application Rate (often effluent flow rate)

[5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables (Tables 4 and 6).

V. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

The Discharger must report the handling and disposal of all sludge/biosolids generated in the treatment ponds. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

The Discharger must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, the Discharger must explain the absence of this monitoring in the annual report.

VI. GROUNDWATER MONITORING

The Discharger must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the NOA and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, etc., that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

Monterey County must monitor **MW-2 and MW-3** consistent with Table 8[1]. (MW-1 must be monitored if found.)

---

[1] Additional monitoring wells and a hydrogeologic assessment and work plan may be required in the future, depending on Monterey County's feasibility assessment and time schedule compliance plan.

Prior to sampling, depth to groundwater must be measured and groundwater elevations[2] must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable if they are described in the Central Coast Water Board approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician, etc.) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

The Discharger must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation	0.01 feet	Calculated	Quarterly
Depth to Groundwater	0.01 feet	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly
Groundwater Flow Direction [4]	degrees	Calculated	Quarterly
Total Nitrogen[5]	mg/L[1]	Calculated	Quarterly
Nitrate (as N) + Nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Sulfate	mg/L	Grab	Quarterly

[2] The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Constituent	Units	Sample Type	Sampling Frequency
Boron	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually
pH	pH Units	Metered	Quarterly
Dissolved Oxygen	mg/L	Metered	Quarterly
Electrical Conductivity	μS/cm [2]	Metered	Quarterly
Oxidation Reduction Potential	mV [3]	Metered	Quarterly
Temperature	degrees Celsius	Metered	Quarterly

[1] mg/L denotes milligrams per liter
[2] μS/cm denotes microsiemens per centimeter
[3] mV denotes millivolts
[4] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.
[5] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

VII. REPORTING REQUIREMENTS

A. Quarterly and Annual Monitoring Reports -- Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

Report	Monitoring Period	Report Due Date
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting –** At a minimum, the quarterly reports must include:

   i. Results of all required monitoring in tabular format.

   ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.

   iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **The Discharger must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.

   iv. Copies of laboratory analytical report(s) and chain of custody form(s).

   v. An updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, water quality data, etc.

   vi. Copies of groundwater monitoring well field sheets with purge methods and data.

2. **Annual Reporting –** The Discharger must submit annual reports in compliance with Standard Provisions 2013[3], (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

   The current annual report template can be found here:

   https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

[3] See Attachment E, Standard Provisions, 2013: https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

3. **State Water Board Volumetric Annual Reporting** – The Discharger must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database[4].

   The following information is required:

   i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
   ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
   iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website[5].

B. VERBAL NON-COMPLIANCE REPORTING -- The Discharger must verbally notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

C. ELECTRONIC GEOTRACKER SUBMITTAL -- All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

The Discharger must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker[6,7] database consistent with applicable Electronic

---

[4] See: https://geotracker.waterboards.ca.gov/
[5] See: Volumetric Annual Reporting | California State Water Resources Control Board
[6] Information for first-time GeoTracker users is available at: https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf
[7] Additional information available at: https://geotracker.waterboards.ca.gov/

Submittal of Information (ESI) requirements under a Wastewater System-specific global identification number WDR100033604 over the internet at:

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml.

For general questions, please contact the GeoTracker Help Desk at: Geotracker@waterboards.ca.gov.

Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 10. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY)[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z)[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.
Volume of Wastewater and Recycled Water	Monthly volume of wastewater influent, wastewater produced (treated), and effluent (discharged by the wastewater system). Level of treatment and discharge type. Monthly volume of recycled water distributed, annual volume of treated wastewater distributed for beneficial use, and category of reuse.	Submit relevant volumetric and treatment data electronically.	On or before the due date of the required annual monitoring report (see State Water Board Volumetric Annual Reporting).

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. The Discharger must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

VIII. TECHNCIAL REPORTS

The technical reports are due as described in Table 11.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date [1]
Interim Wastewater Treatment Improvement Workplan	120 days
Interim Wastewater Treatment Improvement Report	Prior to Central Coast Water Board approval of increased flow rate
Operations and Maintenance Manual	12 months
Climate Change Adaptation Plan	24 months
Time Schedule Compliance Plan	12 months

[1] Reports are due within the time specified after issuance of notice of applicability to the Discharger (September 20, 2022)

A. Interim Wastewater Treatment Improvement Workplan -- In the notice of applicability, the Central Coast Water Board limited the influent flow to 80,000 gpd because the effluent water quality is elevated in BOD and TSS (average greater than 140 mg/L for both pollutants). Monterey County had requested a higher permitted flow rate, and sewer service expansion. To request an increase in the permitted flow greater than 80,000 gpd, Monterey County must develop an interim engineering workplan to improve their current BOD and TSS loading. The workplan, at a minimum, must contain the following:

1. Wastewater system upgrades Monterey County proposes to complete to improve treatment (i.e. timeline to install aeration and sludge removal)
2. The anticipated effluent water quality, and overall BOD and TSS loading rates after upgrades are completed.
3. Evaluation and confirmation of sufficient disposal capacity to handle the flow increase.
4. A proposed daily maximum and monthly average flow rate.

B. Interim Wastewater Treatment Improvement Report – This report must provide information demonstrating that Monterey County is implementing the components of the Interim Wastewater Treatment Improvement Workplan and producing measurable and successful efforts to reduce BOD and TSS and maintain adequate storage and disposal capacity. The report, at a minimum, must contain the following:

1. Summary of upgrades Monterey County has completed to reduce BOD and TSS effluent water quality, with a timeline of when the upgrades were completed.

2. Demonstration of improved water quality, including comparison of BOD and TSS effluent data and loading rates before and after upgrades.
3. Any changes to the proposed daily maximum and monthly average flow rate.

C. Operations and Maintenance Manual – In addition to the required components specified in Standard Provisions[8] A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.

i. **Sampling and Analysis Plan –** The Discharger's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of the Discharger must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:

a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds, etc.), buildings, etc. (if the Discharger needs to update Figure 1 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
c. Sample chain-of-custody procedures and documentation.
d. Sample handling/preservation procedures.
e. A description of the analytical methods.
f. A description of sample containers, preservatives, and holding times.
g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report, etc.).

[8] See Attachment E, Standard Provisions, 2013: https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

h. For groundwater monitoring, a description of the well purging and field methods.

ii. **Sludge Management Plan –** The Discharger's Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:

a. An estimated volume/amount and quality of pond sludge and/or scum that will be generated.
b. How sludge will be stored and disposed of to protect groundwater quality.
c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
d. Procedures for cleaning of the ponds and the treatment and disposal of the pond sludge. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.

iii. **Wastewater Disposal Management Plan –** The Discharger's Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:

a. A description of the wastewater disposal area and a map denoting acreage.
b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
c. A description of wastewater disposal and water quality protection practices.

iv. **Spill Prevention and Emergency Response Plan –**The Discharger's Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:

a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.

c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.

d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.

e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.

f. Notification Procedures - Coordination procedures with fire, police, Governor’s Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.

v. **Training Records Log –** The Discharger’s Operation and Maintenance Manual must contain updated training records logs that demonstrates the Discharger is complying with General Permit section VI.B.3.

D. Climate Change Adaptation –The Climate Change Adaptation Plan must, at a minimum, include the following components:

i. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt[9], Sea-Level Rise Guidance from

[9] Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of

Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.

b. Precipitation Pattern Changes.

I. Drought – Decreased influent quantity and quality.

II. Peak Events – Flooding and increased influent quantity.

c. Temperature fluctuations and extremes.

d. Increased wildfires.

e. Increased power outages.

ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

E. Time Schedule Compliance Plan - As set forth in General Permit sections V.A and VI.A.5, the Discharger must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:

i. Data demonstrating the current quality wastewater discharge in terms of the effluent limitations or groundwater limitations in General Permit Tables 3-6.

ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.

iii. A proposed point of compliance for each pollutant, either effluent or groundwater.

iv. Justification of the need for additional time to achieve the effluent limitations or groundwater limits in the General Permit.

---

needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

v. A detailed time schedule of specific actions the Discharger will take to achieve the effluent limitations or groundwater limitations.

vi. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).

vii. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:

a. Effluent limitation(s) for the pollutant(s) of concern.

b. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).

IX. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that the Monterey County submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to section 13267 of the California Water Code. Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Monterey County to enforcement action pursuant to section 13268 of the California Water Code. Pursuant to section 13268 of the Water Code, a violation of a request made pursuant to section 13267 may subject Monterey County to civil liability assessment of up to $1,000 per day in which the violation occurs.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Monterey County is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Monterey County must implement the above monitoring program on October 1, 2022. The Central Coast Water Board may rescind or modify this monitoring and reporting program at any time.

Ordered By:

Jennifer Epp Digitally signed by Jennifer Epp
Date: 2022.09.19 14:40:02 -07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Chualar WWTP\0020 Enrollment\NOA_MRP\Big Order_MRP_Chualar_Final.docx
Last modifed: 01/10/2022