Central Coast Regional Water Quality Control Board

January 15, 2026 **Sent Via Electronic Mail**

Kelly Dodds
General Manager
San Miguel Community Services District
1765 Bonita Place
San Miguel CA 93451
e-mail: kelly.dodds@sanmiguelcsd.org

Dear Kelly Dodds:

MACHADO WASTEWATER TREATMENT FACILITY, 1765 BONITA PLACE, SAN MIGUEL CA 93451, SAN LUIS OBISPO COUNTY:

- **REVISED NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY; AND**
- **TRANSMITTAL OF REVISED MONITORING AND REPORTING PROGRAM R3-2026-0010**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the October 13, 2025, *San Miguel Community Services District Wastewater Treatment Facility Emergency Disposal Request* submitted by San Miguel Community Services District with additional information received October 31, 2025 and November 20, 2025, and available documents associated with San Miguel Community Services District's Machado Wastewater Treatment Facility (Wastewater System) located at 1765 Bonita Place in San Miguel, California. The Wastewater System, owned by San Miguel Community Services District is currently regulated pursuant to *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

This letter serves as a **revised** notice of applicability for enrollment in the General Permit. This letter includes: wastewater site-specific requirements, limitations, and wastewater system operation summary (Attachment 1); **revised** figures (Attachment 2);

and San Miguel Community Services District's **revised** monitoring and reporting program requirements (Attachment 3).

The initial notice of applicability was issued on December 7, 2023. This revised notice of applicability includes the following key revisions:

- Updates to the permitted treatment and disposal technologies in Attachment 1, Table 3.
- Addition of emergency disposal spray field and emergency disposal bed, and requirements associated with the operation of the emergency spray field and disposal bed.
- Monitoring and reporting requirements for the emergency disposal field and disposal bed.

Discharge to any areas not identified in this revised notice of applicability is prohibited.

The revised notice of applicability and revised monitoring and reporting program is effective immediately and supersedes and replaces the December 7, 2023, notice of applicability and monitoring and reporting program. San Miguel Community Service District must comply with the following:

1. **General Permit** – San Miguel Community Service District must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

   https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – San Miguel Community Service District must comply with the requirements of the revised monitoring and reporting program enclosed with this letter (monitoring and reporting program R3-2026-0010, Attachment 3). San Miguel Community Service District is required to submit quarterly monitoring reports and annual reports to the Central Coast Water Board and comply with annual volumetric reporting requirements[1] established by the State Water Resources Control Board (State Water Board). The next quarterly monitoring report is due **March 1 2026**, the next annual report is due **March 1, 2026,** and the next annual volumetric data submission must be uploaded to the State Water Board GeoTracker database by **April 30, 2026**.

   Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

[1] See: Volumetric Annual Report of Wastewater and Recycled Water | California State Water Resources Control Board

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

San Miguel Community Service District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker[2,3] database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number **WDR100035519** over the internet at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – San Miguel Community Service District paid an annual fee of $28,205 on December 10, 2025, this payment covers San Miguel Community Service District's enrollment in the General Permit for the 2025-2026 fiscal year.

   San Miguel Community Service District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is $28,205. A copy of the current state fee schedule is available electronically at the following link:

   https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

   San Miguel Community Service District's Wastewater System is currently assigned a threat and complexity rating of 2B.

[2] Information for first-time GeoTracker users is available at: https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

[3] Additional information available at: https://geotracker.waterboards.ca.gov/

4. **Notification –** The Central Coast Water Board was notified of San Miguel Community Service District's enrollment at a public meeting on February 15, 2024. Details about that meeting are available on our website at:

   https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, San Miguel Community Service District must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, San Miguel Community Service District must notify the Central Coast Water Board immediately of such changes.

   Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 1765 Bonita Place, San Miguel CA 93451. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, San Miguel Community Service District must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

6. **Responsible Party** – San Miguel Community Service District is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects San Miguel Community Service District to enforcement action, and termination of enrollment under this General Permit.

7. **Change in Ownership** - In the event of any change in control or ownership of the property, San Miguel Community Service District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and San Miguel Community Service District's enrollment in the General Permit can be terminated.

8. **Disposal Area -** Discharge to any areas not identified in this revised notice of applicability is prohibited. The permanent percolation ponds (percolation ponds 1 through 3) are shown on Figures 2 and 3 of Attachment 2. Figure 3 of Attachment 2 shows the emergency spray field and emergency disposal bed. Discharge to the emergency disposal areas is temporarily approved through **June 30, 2026.** San Miguel Community Services District must obtain Central Coast Water Board staff approval via email prior to discharging to the emergency disposal areas after this date. Please provide at least 30 days for the Central Coast Water Board to review any extension requests. The Central Coast Water Board may notify San Miguel Community Services District at any time to remove

the authority to use the emergency disposal methods including the spray field and disposal bed.

If you have any questions, please contact **Julie Avanto at (805) 549-3372 or by email at** julie.avanto@waterboards.ca.gov or Jennifer Epp at (805) 594-6181 or by email at jennifer.epp@waterboards.ca.gov.

Sincerely,

for Ryan E. Lodge
Executive Officer

Attachments:

Attachment 1: Site-specific requirements, limitations, and wastewater system operation Summary
Attachment 2: Figures
Attachment 3: Monitoring and Reporting Program Order R3-2026-0010

cc:
Heather Freed, Water Systems Consulting, hfreed@wsc-inc.com
Joshua Reynolds, Water Systems Consulting, jreynolds@wsc-inc.com
Julie Avanto, Central Coast Water Board, julie.avanto@waterboards.ca.gov
Jennifer Epp, Central Coast Water Board, jennifer.epp@waterboards.ca.gov
Todd Stanley, Central Coast Water Board, todd.stanley@waterboards.ca.gov
WDR Program, *GeoTracker* RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-255430
GeoTracker = GT- WDR100035519
ECM Subject Name = San Miguel CSD Machado Wastewater Treatment Facility Revised NOA for R3-2020-2020
\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\San Miguel Community Services District\1- Permit\2023 Large Domestic Order Enrollment\Revised NOA_MRP_Emergency_Disposal\San Miguel NOA MRP Jan 2026_final.docx

ATTACHMENT 1
SITE-SPECIFIC REQUIREMENTS, LIMITATIONS, AND WASTEWATER SYSTEM OPERATION SUMMARY

1. Ownership and Wastewater System Information

Ownership and wastewater system information submitted by San Miguel Community Service District to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Machado Wastewater Treatment Facility
Physical Address	1765 Bonita Place San Miguel CA 93451
Facility Latitude	35.75894
Facility Longitude	-120.69361
Discharge Latitude	35.759824
Discharge Longitude	-120.693055
Mailing Address	PO Box 180 San Miguel CA 93451
Owner	San Miguel Community Service District
Operator	San Miguel Community Service District phone: 805-467-3388 e-mail: kelly.dodds@sanmiguelcsd.org
Legally Responsible Official	Kelly Dodds phone: 805-467-3388 e-mail: kelly.dodds@sanmiguelcsd.org
Raw Wastewater Characteristics	Sewer Connections: 823 Population Served: 2653 Domestic (%): 100% Industrial (%): 0%
Mean Monthly Design Flow[1] (gallons per day, gpd)	200,000
Baseline Flow (mean monthly flow) in gpd	175,000
Threat to Water Quality	2
Complexity	B

[1] Mean monthly is the sum of the daily flows during each day of a calendar month divided by the number of days in the month.

2. Wastewater System Operation Summary

Machado Wastewater Treatment Facility (Wastewater System) consists of four partially-mixed aerated lagoons connected in series. After the fourth pond, wastewater is discharged to three percolation basins for disposal. Sludge is dried on site and the dried biosolids are periodically hauled away to an authorized disposal facility[4]. The wastewater system was upgraded in the late 1990s with the addition of two additional ponds (Pond 1 and Pond 2) which brought the treatment capacity up to 200,000 gpd. The San Miguel Community Service District is aware that the existing wastewater system is approaching treatment capacity and is actively working towards replacing the existing system with a membrane bioreactor and producing recycled water for irrigation uses.

San Miguel Community Service District is also responsible for operation and maintenance of the collection system that serves the community of San Miguel. The collection system is enrolled in State Water Board Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems.

The wastewater system is a Class I wastewater system. San Miguel Community Service District must staff a Grade I chief plant operator for proper operation of the Wastewater System. Operator names, grades, and license numbers are shown in Table *2*.

Table 2. Wastewater System Operators

Operator Name	Grade	License Number
Kelly Dodds	2	28693
Dustin Pittman	2	53462
Trevor Paslay	1	59082

The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 3.

Table 3. Treatment Technology and Capacity

Headworks/Preliminary Treatment	There is no existing headworks treatment at this plant.
	Headworks capacity (gpd): not applicable
Primary Treatment	This plant uses aerated ponds to provide primary treatment
	Primary treatment capacity (gpd): 200,000
Secondary Treatment	This plant uses aerated and non-aerated ponds to provide secondary treatment
	Secondary treatment capacity (gpd): 200,000
Tertiary Treatment	NONE
	Tertiary treatment capacity (gpd): not applicable

[4] Central Coast Water Board staff notified San Miguel Community Services District in the January 14, 2026 notice of violation that their sludge drying bed does not comply with General Permit requirements.

Disinfection	NONE
	Disinfection Capacity (gpd): not applicable
Wastewater Disposal Method	Effluent is piped to percolation ponds at the wastewater facility which percolate the entire plant flow. Three percolation ponds are available and are rotated as needed.
	Disposal capacity (gpd): 200,000
Emergency Wastewater Disposal (Spray Field and Disposal Bed)	Discharge to the emergency disposal areas is temporarily approved through **June 30, 2026.** San Miguel Community Services District must obtain Central Coast Water Board staff approval via email prior to discharging to the emergency disposal areas after this date. The Central Coast Water Board may notify San Miguel Community Services District at any time to remove the authority to use the emergency disposal methods including the spray field and disposal bed. The emergency spray field is approximately 4.95 acres and is located to the north of the facility on San Miguel Community Services District -owned property. The emergency disposal bed is approximately 0.46 acre and is located at the southeast corner of the facility property. See section 3.F below for use requirements for the emergency spray field and disposal bed.
	San Miguel Community Services District must monitor and report on disposal to the emergency spray field and emergency disposal bed in compliance with Monitoring and Reporting Program R3-2026-0010.
Biosolids/Sludge Production and Handling	Solids are pumped to a drying bed, once sufficently dried they are hauled to either a landfill or composting facility. Hauling of sludge is not an annual event.
	Annual production of biosolids: 50 tons
	Biosolids are disposed at Paso Robles Landfill (in Paso Robles California), or occasionally Chicago Grade landfill (in Templeton California) or Liberty Compost (in Lost Hills California).
Non-Potable Recycled Water	No, wastewater system does NOT produce non-potable recycled water

3. Wastewater System Specific Requirements and Limitations

All dischargers enrolled in the General Permit must comply with groundwater limits described in the General Permit, regardless of the compliance pathway chosen. Because San Miguel Community Service District already has groundwater monitoring wells and monitors groundwater as part of their previous permit requirements, groundwater monitoring is required.

San Miguel Community Service District must operate the Wastewater System in accordance with the General Permit and this notice of applicability. San Miguel Community Service District must comply with the wastewater-specific flow and effluent limitations specified in Table 4 and Table 5, respectively.

A. Flow Limitations:

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily[1]	Gallons per day	225,000	Influent
Mean Monthly[1,2]	Gallons per day	200,000	Influent
Mean Monthly (to disposal area)[1,2]	Gallons per day	225,000	Effluent

[1] Based on the Report of Waste Discharge submitted in February, 1999, by John Wallace and Associates on behalf of San Miguel Community Services district.
[2] Mean monthly is the sum of the daily flows during each day of a calendar month divided by the number of days in the month.

B. Effluent Limitations:

Table 5. Effluent Limitations: Pond Systems

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L[1][2]	45	65	Not Applicable
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L[3]	0.3	Not Applicable	0.5
pH	Not Applicable	Between 6.5 and 8.4	Not Applicable	Not Applicable

C. Groundwater Limitations:

As stated in the General Permit, Section III, Prohibitions, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, San Miguel

Community Service District must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).[5] These objectives include:

1) General objectives for taste and odors and radioactivity for all groundwaters.
2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
3) Cause groundwater to contain concentrations of chemicals in amounts that adversely affect the agriculture beneficial use provided in Tables 3-1 and 3-2 of the Basin Plan.
4) Groundwater limitations for the groundwater basin where the discharge occurs. This facility discharges into the Paso Robles Area, San Miguel subbasin and must comply with the limitations for designated groundwater basins in Table 6.

D. Groundwater Monitoring Requirements

Through groundwater monitoring, San Miguel Community Service District must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 6.

Currently, San Miguel Community Services District only has two groundwater monitoring wells. To demonstrate compliance in groundwater, by December 6, 2025, San Miguel Community Service District must install a third monitoring well and it must be located downgradient from the wastewater disposal ponds. The third well is needed for evaluating groundwater flow direction and gradient and for more accurately assessing the impact of wastewater disposal on groundwater quality. Before constructing the well, the San Miguel Community Services District must submit the groundwater monitoring workplan described in section 6 of monitoring and reporting program R3-2026-0010 and receive approval on the design and location of the well from the Central Coast Water Board.

Table 6. Groundwater Limitations for Designated Groundwater Basins – *Paso Robles Area, San Miguel*

Constituents	Units	25-Month Rolling Median[2]
Total Dissolved Solids	mg/L[1]	750
Chloride	mg/L	100
Sodium	mg/L	105

[5] Current edition, June 2019 is available at: https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

Constituents	Units	25-Month Rolling Median[2]
Sulfate	mg/L	175
Boron	mg/L	0.5
Total Nitrogen	mg/L	4.5

[1] mg/L denotes milligrams per liter
[2] Rolling Median is the median from all data collected over the most recent 25 months

E. Organic Loading Limitations

San Miguel Community Services District land applies treated wastewater to the percolation ponds and emergency disposal areas and thus organic loading limitations specified in Table 7 apply.

Table 7. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

F. Requirements for Emergency Spray Field and Disposal Bed

Emergency disposal at the spray field and disposal bed is permitted temporarily, and only when the permanent percolation ponds are not performing as designed, and influent flows exceed disposal capacity. Discharge to the emergency disposal areas is temporarily approved through **June 30, 2026.** San Miguel Community Services District must obtain Central Coast Water Board staff approval via email prior to discharging to the emergency disposal areas after this date. The Central Coast Water Board may notify San Miguel Community Services District at any time to remove the authority to use the emergency disposal methods including the spray field and disposal bed.

Disposal to the emergency spray field and disposal bed are only permitted under the following conditions.

1. San Miguel Community Services District must comply with General Permit Section IV.B. Pond Systems (Treatment, Storage, and Disposal) for the emergency disposal bed.
2. San Miguel Community Services District must comply with General Permit Section IV.C. Land Application by Spray or Drip Methods for the emergency spray field.
3. San Miguel Community Services District can only discharge to the emergency disposal areas shown in Attachment 2, Figure 3.
4. San Miguel Community Services District must operate and maintain the emergency disposal areas as proposed in the October 13, 2025, *Emergency Disposal Request* (with additional information provided on October 31, 2025 and November 20, 2025), including:

   a. Disposal of treated effluent wastewater shall only occur during facility operating hours when operations staff are on duty.
   b. Visual inspections for leaks erosion, ponding, runoff and inspections of properly functioning berms, pumps, piping and sprinkler heads.
5. San Miguel Community Services District must continue to progress towards improving disposal capacity in the percolation ponds.

ATTACHMENT 2
FIGURES

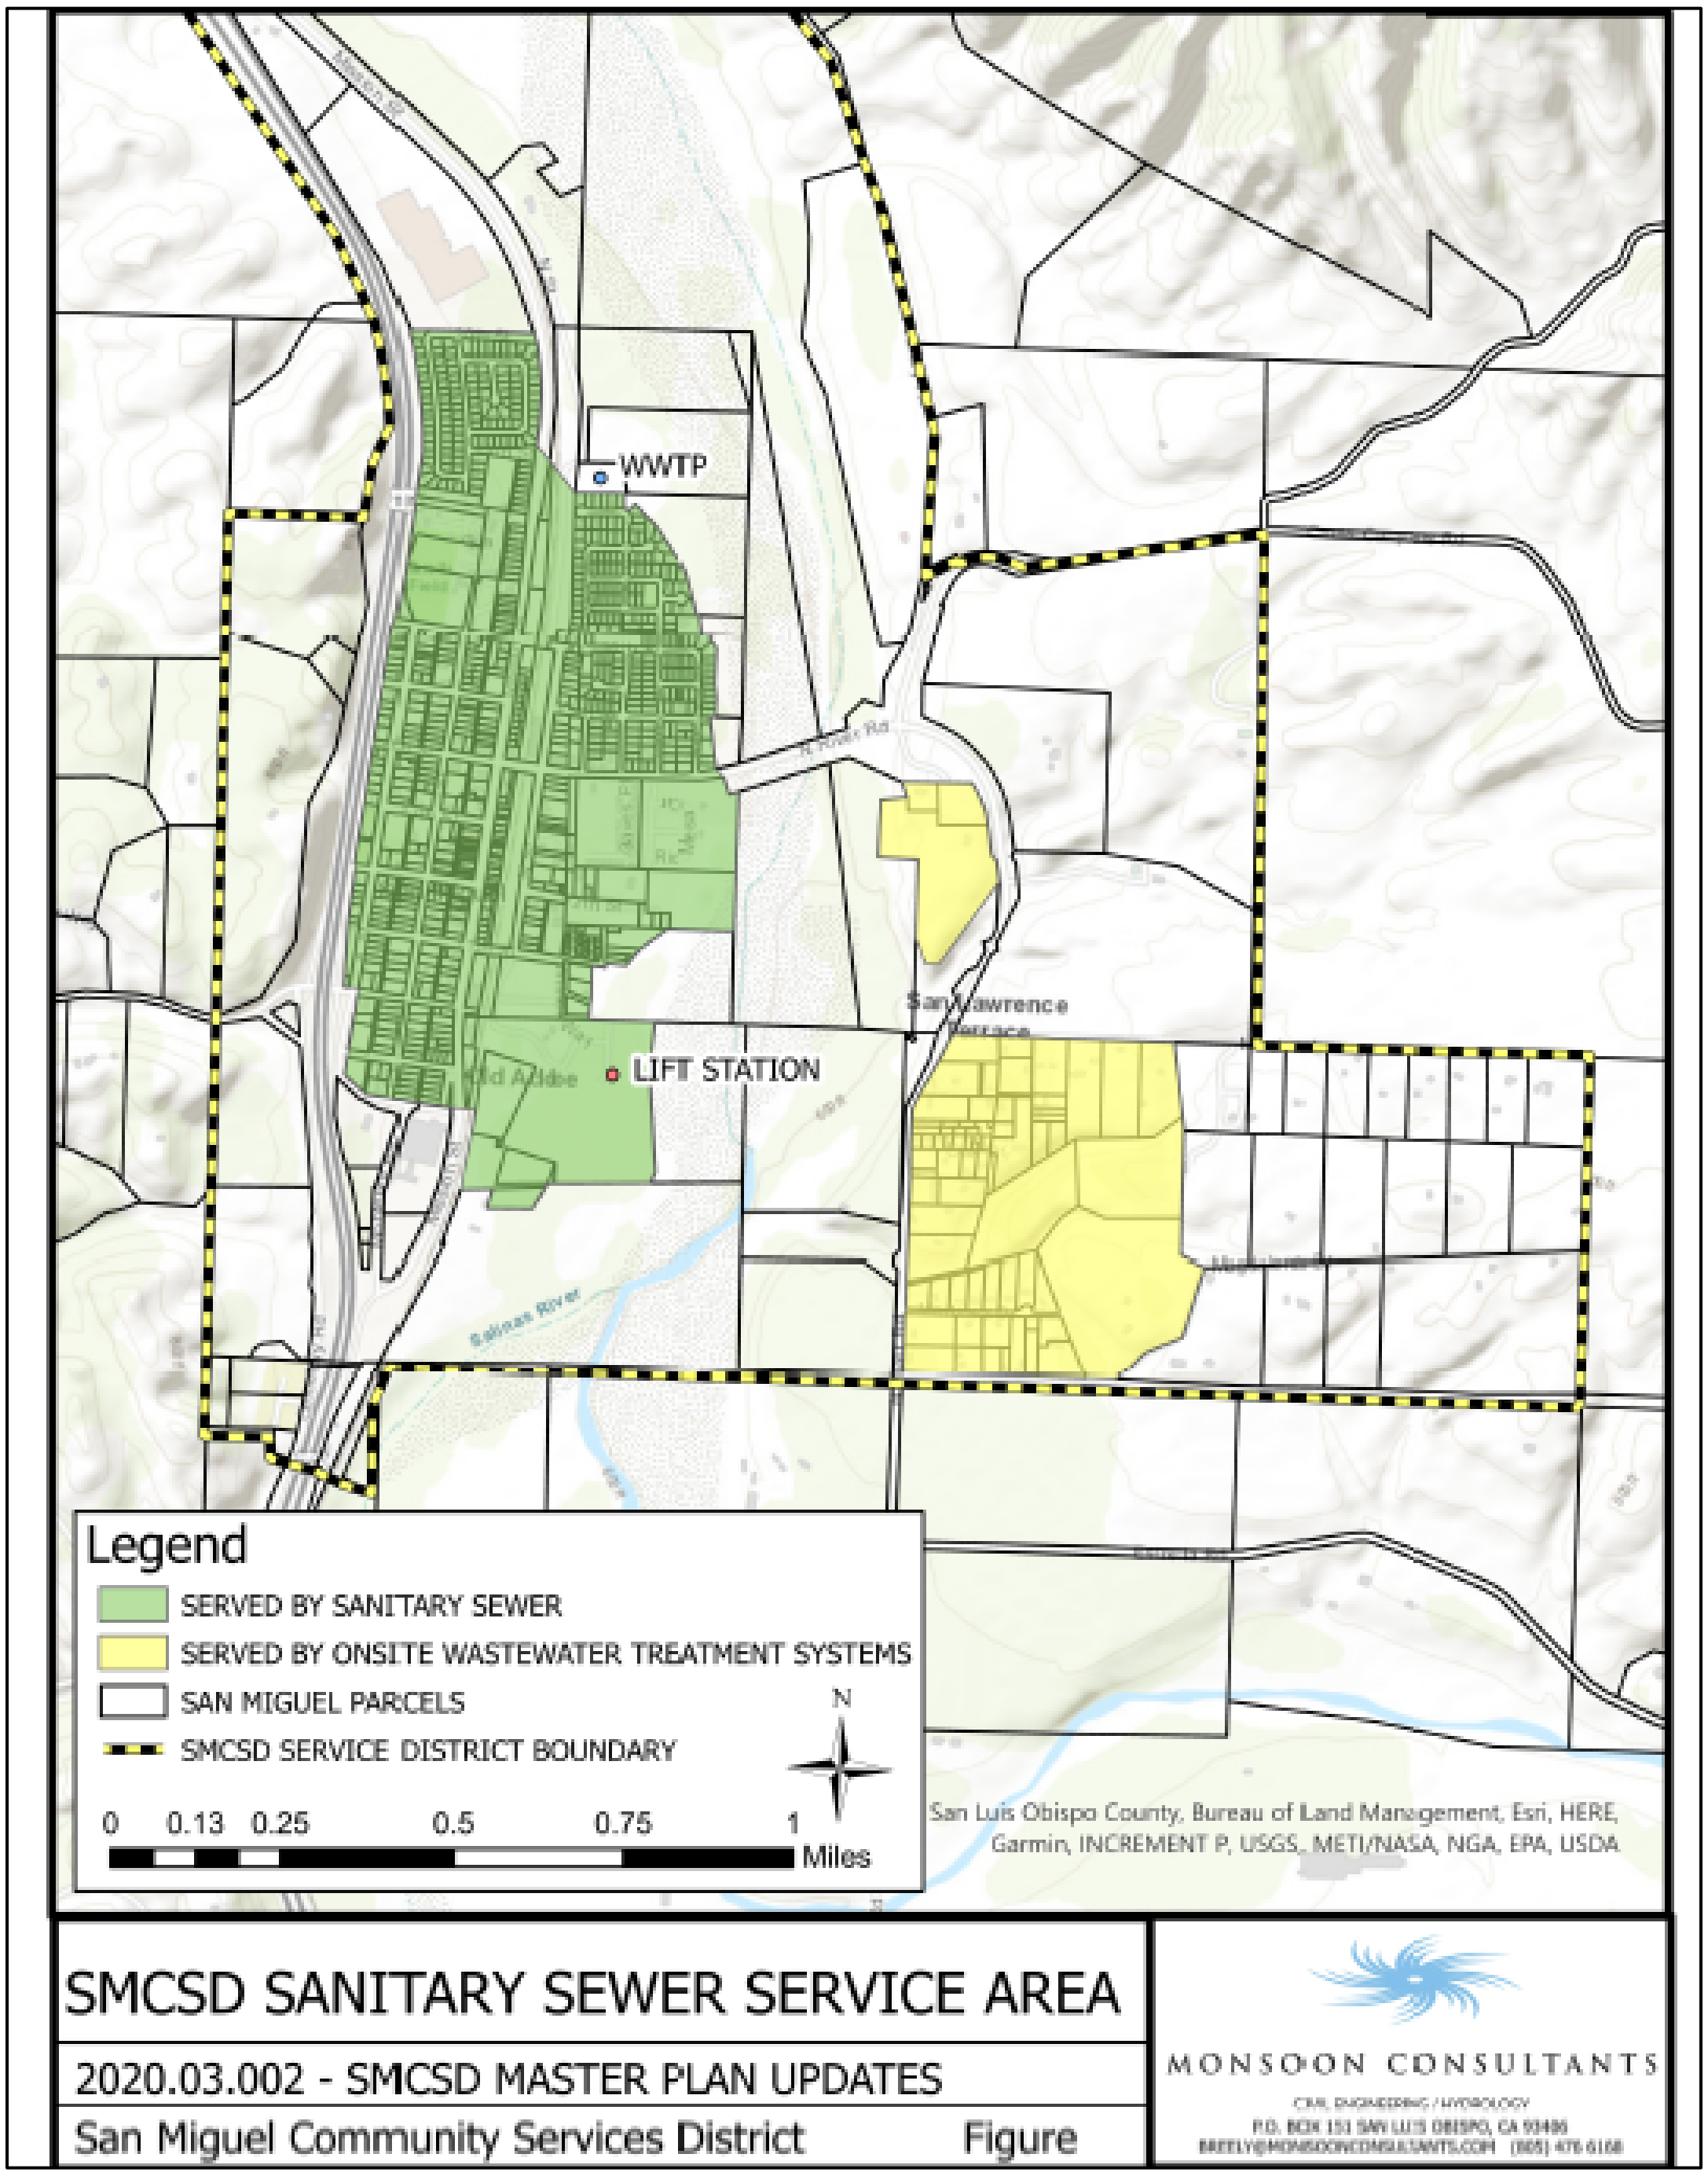

Figure 1. Site location map.

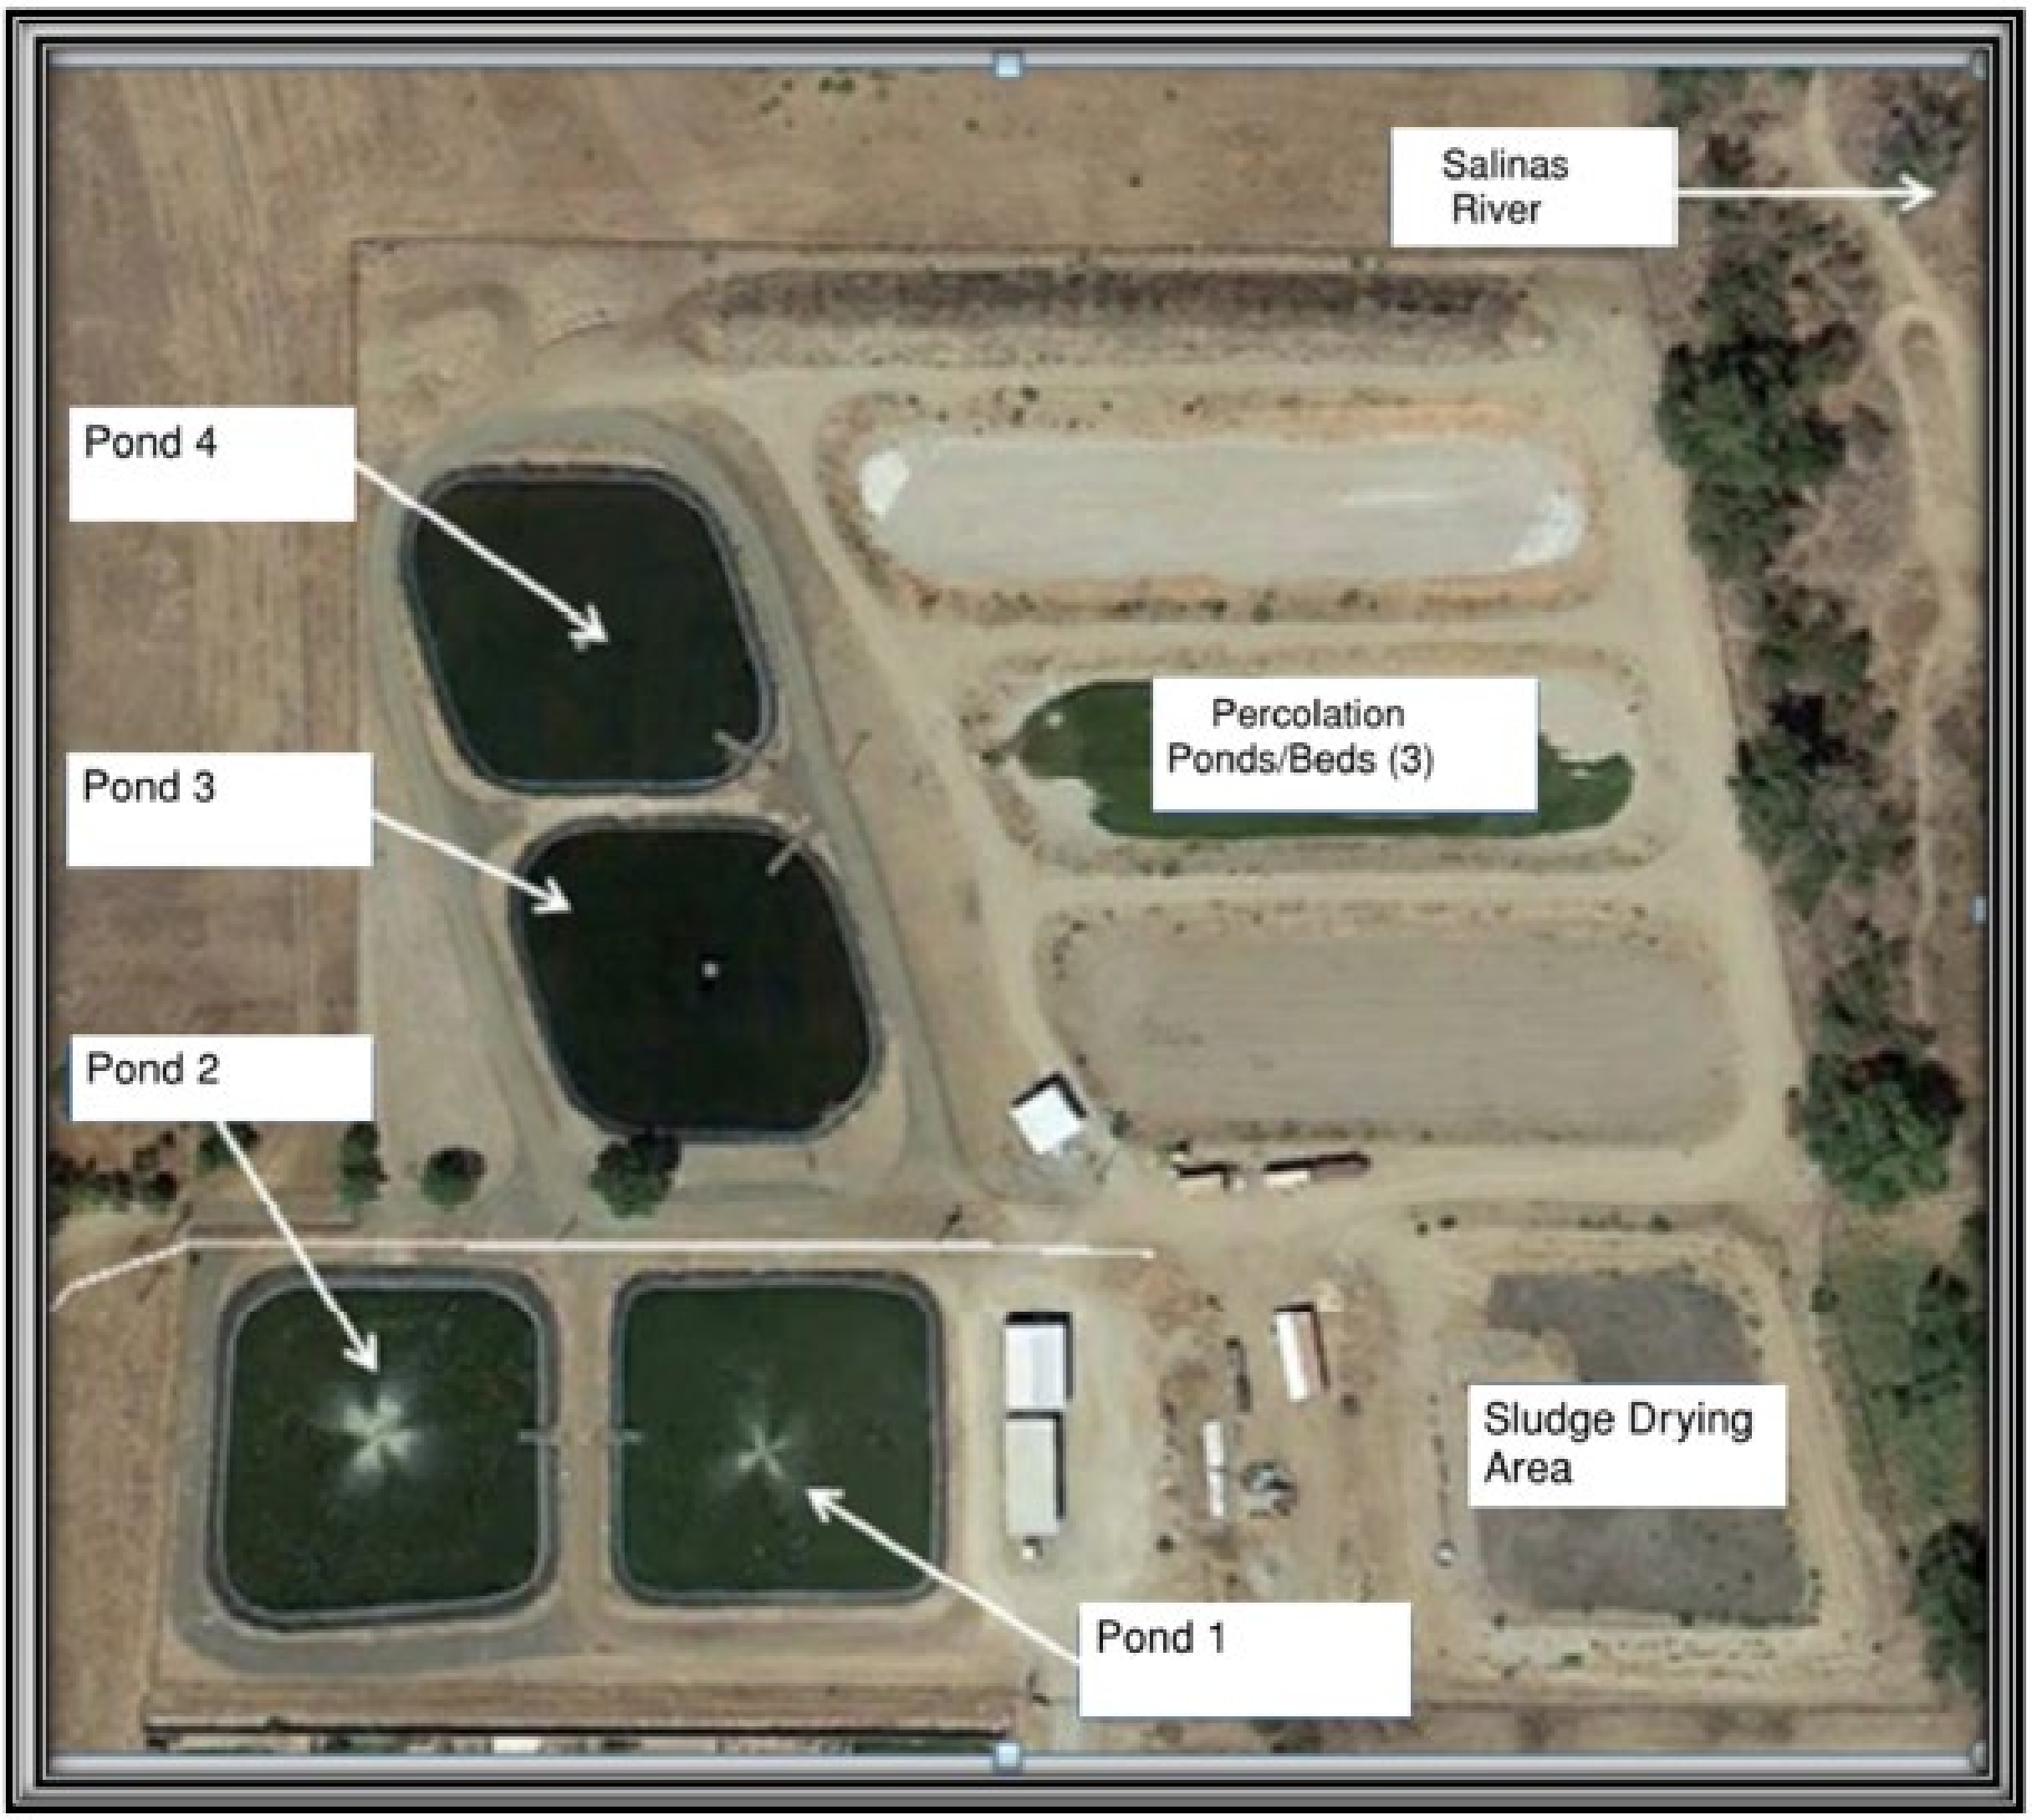

Figure 2. Machado Wastewater Treatment Facility

Note: As identified in the January 14, 2026 notice of violation, the area labeled as a sludge drying area does not conform with General Permit Sections IV.E.2 and IV.E.3 for sludge/solids/biosolids disposal and placement/storage of sludge.

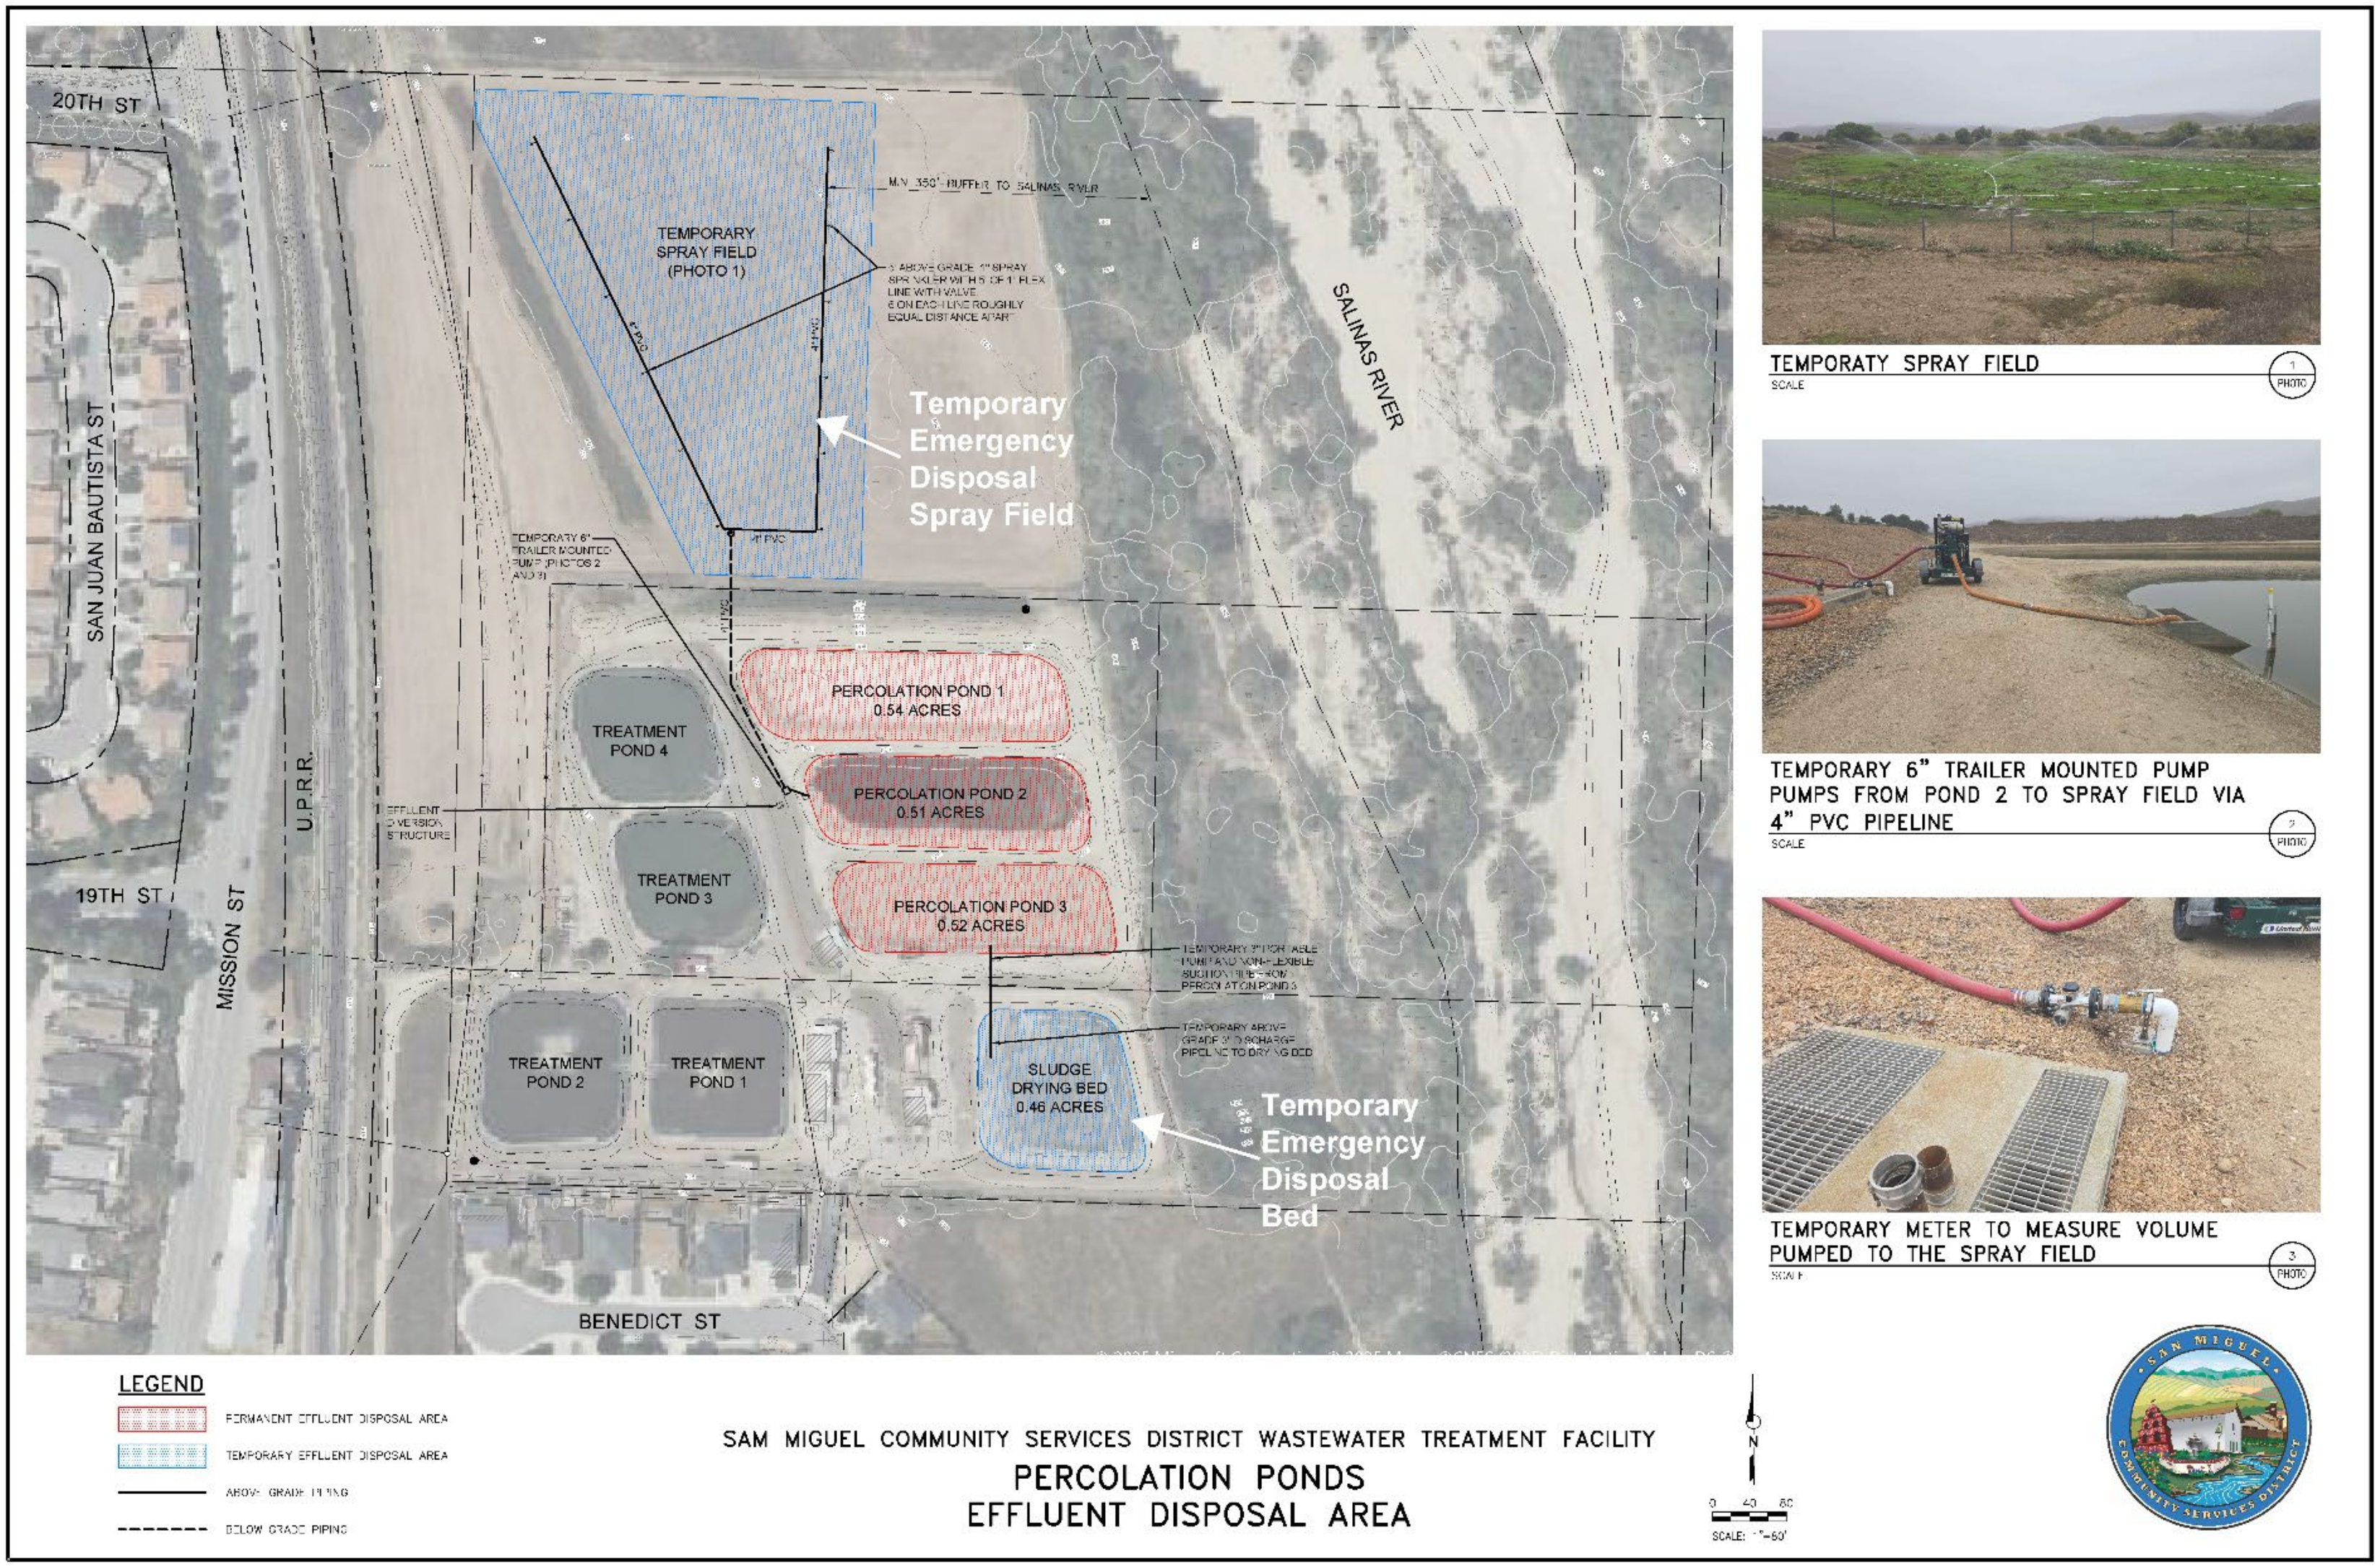

Figure 3. Emergency Disposal Areas

Note: As identified in the January 14, 2026 notice of violation, the area labeled as a sludge drying bed does not conform with General Permit Sections IV.E.2 and IV.E.3 for sludge/solids/biosolids disposal.

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM R3-2026-0010
JANUARY 15, 2026

This Monitoring and Reporting Program contains monitoring and reporting requirements for San Miguel Community Service District's Machado Wastewater Treatment Facility (Wastewater System) enrolled in *General Waste Discharge Requirements Order R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

The San Miguel Community Service District owns and operates the Wastewater System that is subject to the General Permit and notice of applicability.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs San Miguel Community Service District to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section 7).

1. SAMPLING AND ANALYSIS

San Miguel Community Service District must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Regional Water Quality Control Board (Central Coast Water Board). All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board review and approval.

A. Sampling Schedule

Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Monthly	Each month of the year
Quarterly	January, April, July, and October
Semiannually	April and October
Annually	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

B. Monitoring Location Descriptions

All samples including influent samples (IS), effluent samples (ES), and groundwater monitoring wells (MW) must be collected at the locations described in Table 2 and shown in Figure 1. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. San Miguel Community Service District must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 10).

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description and Location (Latitude, Longitude)
Influent Sample	IS-1	Raw wastewater sample collected at the influent pump station. (35.759303, -120.692954)

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description and Location (Latitude, Longitude)
Effluent Sample	ES-1	Treated wastewater sample collected prior to the percolation pond distribution box. (35.759802, -120.693092)
Upgradient Monitoring Well	MW-1	Southwest corner of Pond 2 (35.758701, -120.694234)
Downgradient Monitoring Well 1	MW-2	Northeast corner of treatment plant boundary (35.760334, -120.692081)
Downgradient Monitoring Well 2	MW-3	Well not yet installed - location to be decided
Water Supply	WSW-1[1]	Representative sample from potable water serving the wastewater service area.

[1] Water supply sample data should be included in the annual report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section below.

2. WATER SUPPLY MONITORING

Representative samples of San Miguel Community Service District's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, San Miguel Community Service District may request Central Coast Water Board approval to submit a Well Identification Number and/or the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. San Miguel Community Service District must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. San Miguel Community Service District must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

San Miguel Community Service District must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually

Constituent	Units[1]	Sample Type	Sampling Frequency
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

3. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring

San Miguel Community Service District must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See monitoring and reporting program section 7 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	**Sample Type**	**Sampling Frequency**	**Sample Type**	**Sampling Frequency**
Daily Flow	Metered	Daily	Measured/Estimated[1]	Daily
Maximum Daily Flow	Metered	Monthly	Measured/Estimated[1]	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly
Percent of Permitted Flow [2]	Calculated	Quarterly	N/A	N/A

[1] The Central Coast Water Board understands that San Miguel Community Service District does not currently have an influent flow meter and instead estimates flow using pump operations using rate and time. Central Coast Water Board understands an upgraded facility is being designed. The upgraded facility must contain an influent flow meter to measure flow.

[2] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, San Miguel Community Service District must evaluate and provide a comparison of monitored flow to the permitted flow.

B. Wastewater System Monitoring

Representative samples of San Miguel Community Service District's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figure 1 for the location of samples and GeoTracker field points.

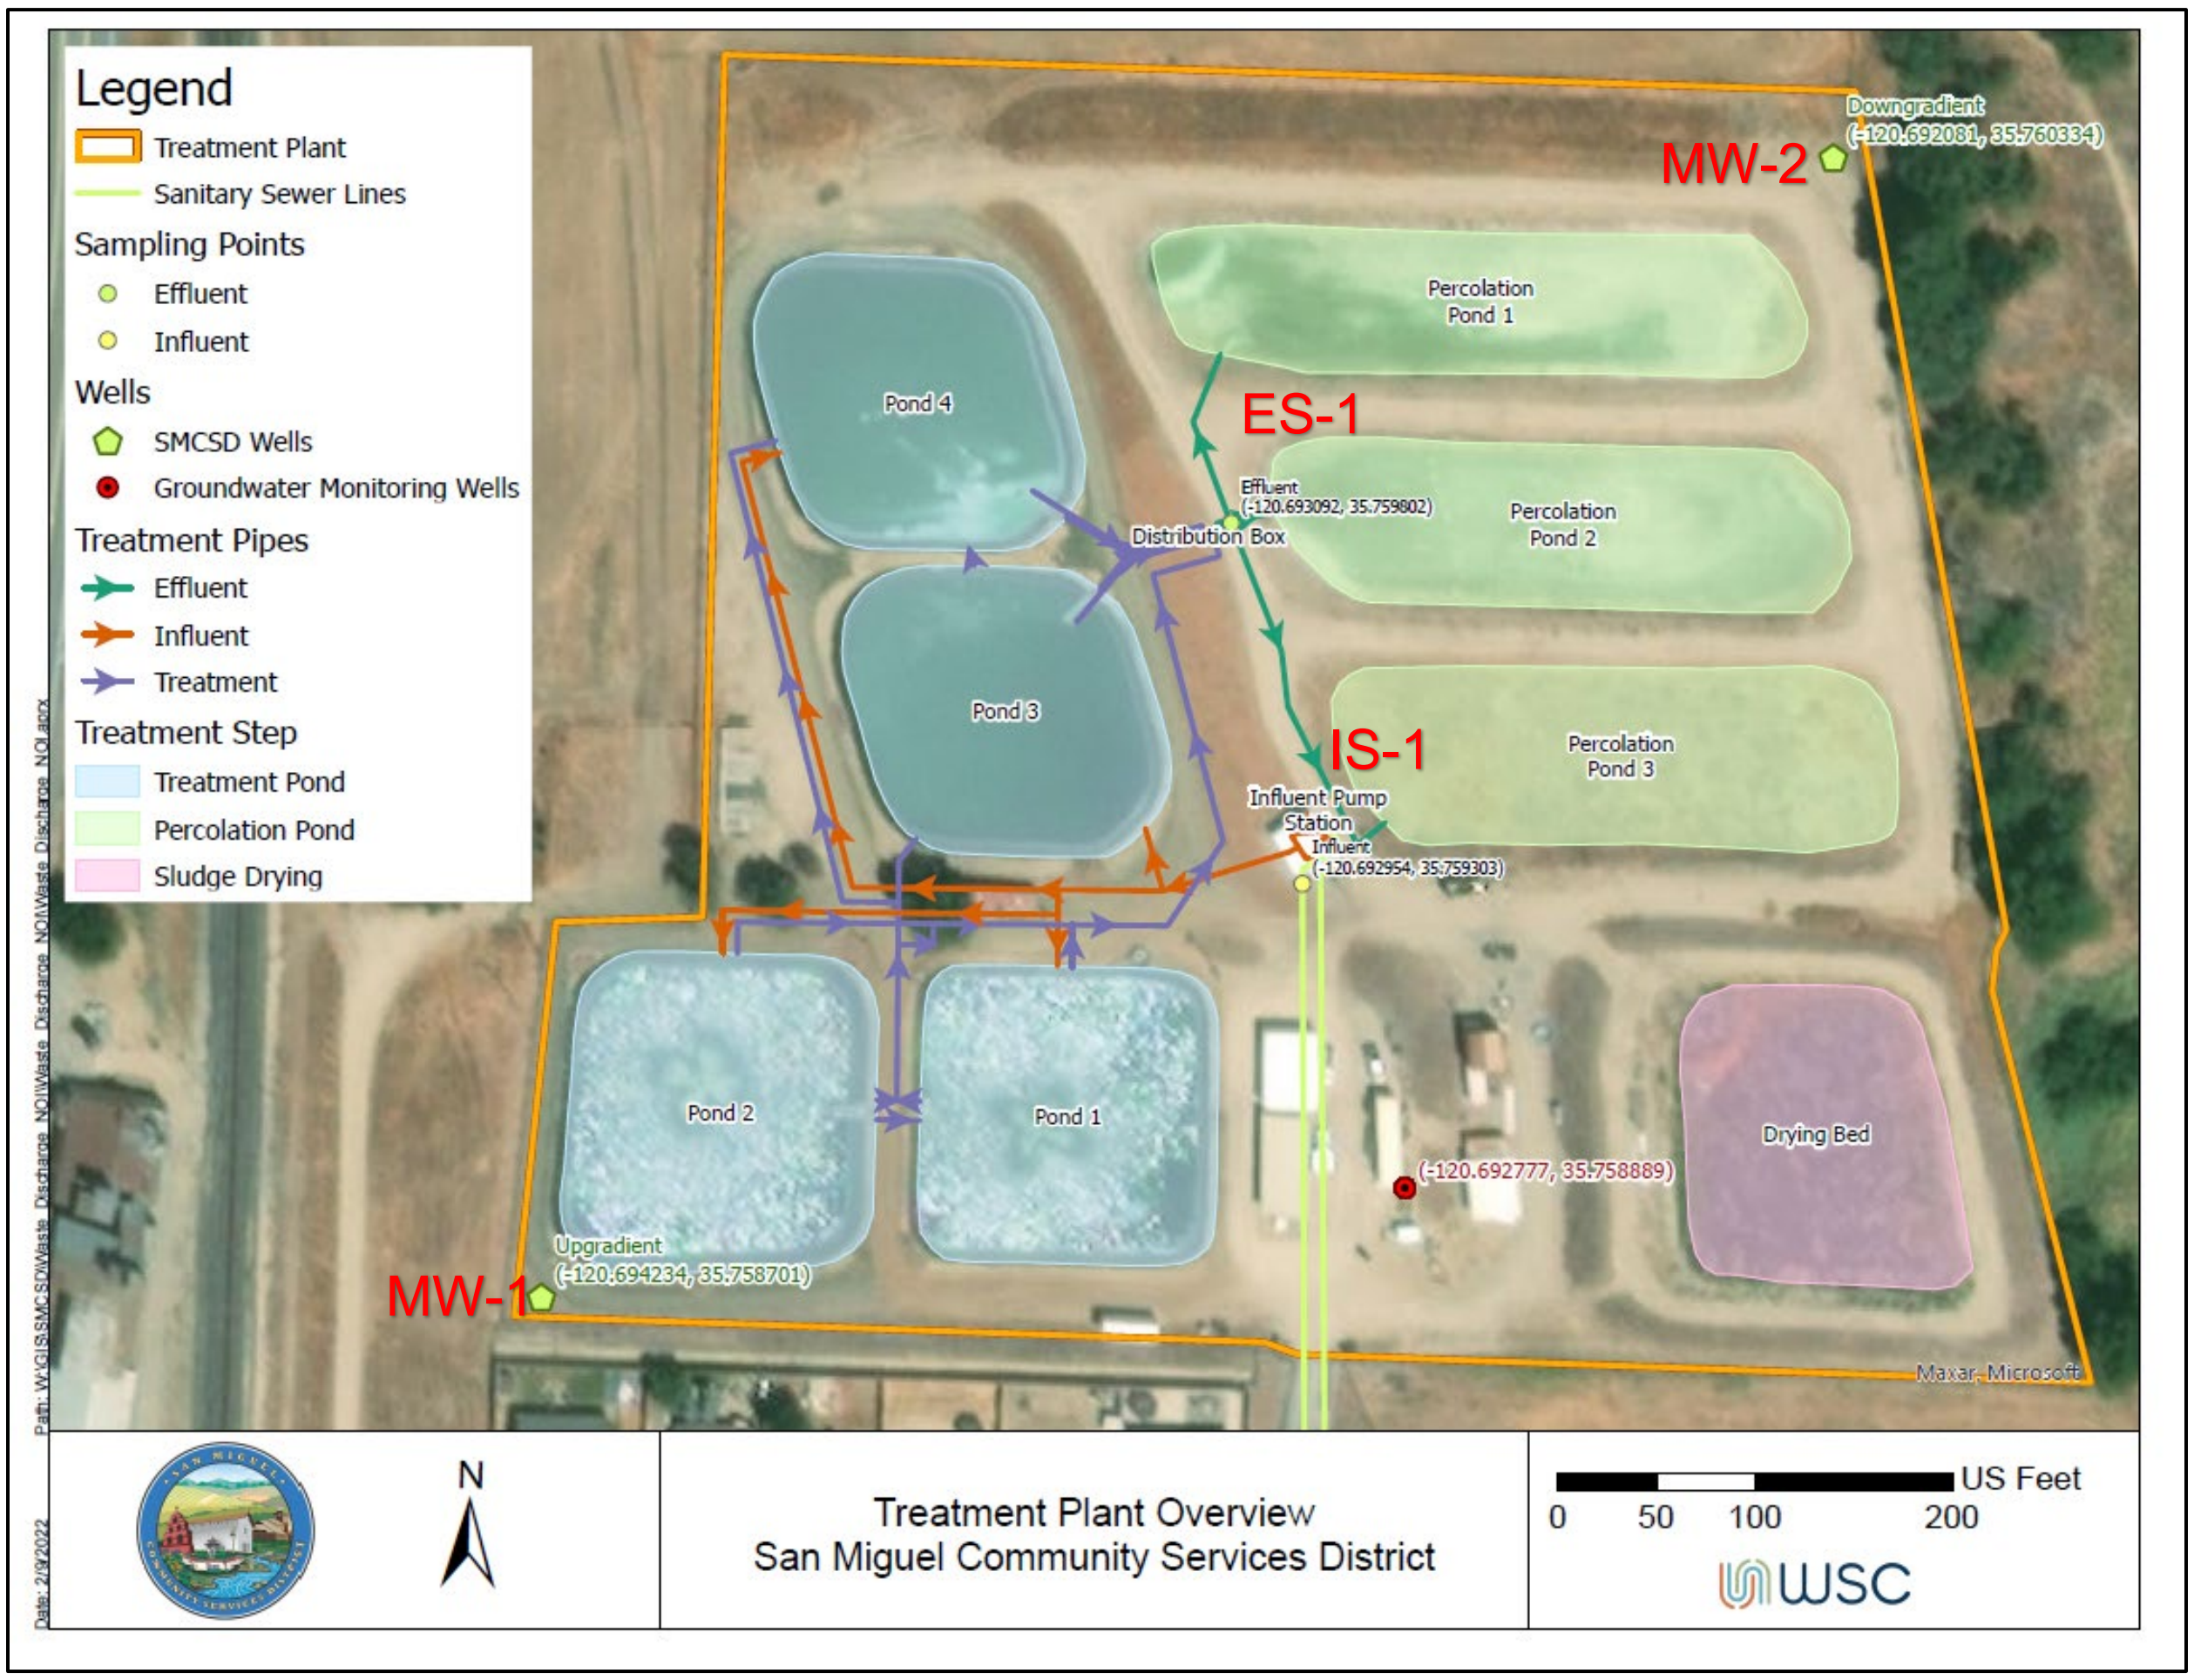

Figure 1. Process Flow Diagram and Sample Locations Referenced in Table 2.

Notes: The red circle labeled as a monitoring well is not used.

As identified in the January 14, 2026 notice of violation, the pink shaded area labeled as a drying bed does not conform with General Permit Sections IV.E.2 and IV.E.3 for sludge/solids/biosolids disposal.

C. Pond System Monitoring

a. Required Pond Monitoring – All wastewater treatment and treated wastewater storage/disposal ponds/emergency disposal bed (lined and unlined) must be monitored as specified in Table 5. The emergency disposal bed must be monitored and reported only when in use. Sampling for pH and dissolved oxygen must be a grab sample taken from 1 foot below pond surface.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 5. Wastewater Treatment/Storage/Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	pH Units	Grab	Weekly
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Color	Not applicable	Observation	Monthly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly
Berm condition	Not Applicable	Observation	Monthly
Precipitation	inches/day and date	Measured [1]	Each precipitation event [2]

[1] San Miguel Community Service District may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as http://scacis.rcc-acis.org/.
[2] A precipitation event is one producing precipitation of ½ inch or more.

b. Influent and Effluent Monitoring – At a minimum, influent and effluent constituent monitoring for pond treatment systems must be monitored as specified in Table 6.

Table 6. Influent and Effluent Monitoring for Pond Treatment Systems

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-1)
Parameter/ Constituent	**Units [2]**	**Sample Type**	**Sampling Frequency**	**Sample Type**	**Sampling Frequency**
pH	units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Suspended Solids	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Settleable Solids	ml/L	Not Applicable	Not Applicable	Grab	Weekly
Total Nitrogen[1]	mg/L	Calculated	Quarterly	Calculated	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Ammonia (as N)	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Total Dissolved Solids	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Chloride	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Sodium	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Sulfate	mg/L	24-hour composite	Quarterly	Grab	Quarterly
Boron	mg/L	Not Applicable	Not Applicable	Grab	Quarterly
Carbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Potassium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.
[2] ml/L denotes milliliters per liter.

4. WASTEWATER DISPOSAL MONITORING OF PERCOLATION PONDS AND EMERGENCY DISPOSAL AREAS

San Miguel Community Service District must monitor all wastewater disposal areas (e.g., percolation ponds, emergency spray field, and emergency disposal bed) when wastewater and/or supplemental irrigation water is applied. Inspections (observations) must be conducted as described in Table 7. Notations must be made in a bound logbook and problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon request. Observations do not need to be reported in the monitoring reports unless a violation of permit conditions or issues are observed. If violations are observed, planned and implemented mitigation measures to address the violations must be reported.

Emergency disposal areas must be monitored and reported only when in use. San Miguel Community Services District must visually inspect the emergency disposal areas to monitor for leaks, erosion, ponding, and runoff at least twice per day when in use.

San Miguel Community Service District must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, with each monitoring report.

If wastewater and/or supplemental irrigation water is not discharged to land during a reporting period, the monitoring report must still be submitted and indicate that there was no discharge during the reporting period.

Table 7. Wastewater Disposal Monitoring at Percolation Ponds and Emergency Disposal Areas

Constituent	Units	Sample Type	Monitoring Frequency
Local Precipitation	Inches/day	Weather Station [1]	Each precipitation event
Acreage Applied [2]	Acres	Measured	Daily
Application Rate	Gallons per day	Metered/Estimated [3]	Daily
Average Monthly Biochemical Oxygen Demand, 5-Day (BOD) Applied [4] [5]	lbs/acre/day	Calculated	Monthly
Maximum Daily BOD_5 Applied[5]	lbs/acre/day	Calculated	Daily
Total Nitrogen Applied [4] [5]	lbs/acre/day	Calculated	Monthly
Salts Applied [4] [5] (total dissolved solids, sodium, chloride, sulfate, boron)	lbs/acre/day	Calculated	Monthly

Constituent	Units	Sample Type	Monitoring Frequency
Containment Berm Condition	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

[1] San Miguel Community Service District may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as http://scacis.rcc-acis.org/.
[2] Acreage applied denotes the acreage to which wastewater is applied.
[3] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, San Miguel Community Service District is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.
[4] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X\ [\text{mg/L}] \times Q\ [\text{million gallons per day}] \times 8.34\ [(\text{conversion from mg/L to pounds/million gallons per day}]}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration
Where Q = Application Rate (often effluent flow rate)

[5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables (Table 6).

5. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

San Miguel Community Service District must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

San Miguel Community Service District must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, San Miguel Community Service District must explain the absence of this monitoring in the annual report.

6. GROUNDWATER MONITORING

San Miguel Community Service District must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the notice of applicability and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, and other technical reports that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

San Miguel Community Service District must:

1. **By April 8, 2024** submit a groundwater monitoring workplan and preliminary hydrogeologic conceptual site model for Central Coast Water Board approval. At a minimum, the workplan must describe how the monitoring program will be able to evaluate the impacts of wastewater discharge on ambient groundwater quality. Well depths and screened intervals must be included in the work plan. The workplan must include plans to install a third groundwater monitoring well downgradient from the disposal ponds. The third well must be installed within 24 months from the date of this monitoring and reporting program, unless additional time is authorized by a time schedule order signed by the Central Coast Water Board Executive Officer.

2. Monitoring wells must be, at a minimum, sampled and analyzed as specified in Table 8 and the Central Coast Water Board approved sampling and analysis plan (see section VI.A.2.i of the General Permit).

3. Prior to sampling, depth to groundwater must be measured and groundwater elevations[6] must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

   San Miguel Community Service District must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

[1] The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation [1]	0.01 ft msl	Calculated	Quarterly
Depth to Groundwater [1]	0.01 ft bgs	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly
Groundwater Flow Direction [2]	degrees	Calculated	Quarterly
pH	pH Units	Metered	Quarterly
Dissolved Oxygen	mg/L	Metered	Quarterly
Electrical Conductivity	µS/cm [3]	Metered	Quarterly
Oxidation Reduction Potential	mV [4]	Metered	Quarterly
Temperature	degrees Celsius	Metered	Quarterly
Total Nitrogen[5]	mg/L	Calculated	Quarterly
Nitrate (as N)	mg/L	Grab	Quarterly
Nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Quarterly
Ammonia (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Quarterly
Chloride	mg/L	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Sulfate	mg/L	Grab	Quarterly
Boron	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually

[1] ft.msl denotes elevation relative to the mean sea level tidal datum and ft bgs denotes feet below ground surface.

[2] Calculations must be prepared by, or under the responsible charge of, a California licensed professional.
[3] µS/cm denotes microsiemens per centimeter
[4] mV denotes millivolts
[5] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

7. REPORTING REQUIREMENTS

A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	June 1
Second Quarter Monitoring Report	April 1 to June 30	September 1
Third Quarter Monitoring Report	July 1 to September 30	December 1
Fourth Quarter Monitoring Report	October 1 to December 31	March 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting –** At a minimum, the quarterly reports must include:

   i. Results of all required monitoring in tabular format.

   ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.

   iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **San Miguel Community Service District must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.

   iv. Copies of laboratory analytical report(s) and chain of custody form(s).

v. Copies of groundwater monitoring well field sheets with purge methods and data.

2. **Annual Reporting –** San Miguel Community Service District must submit annual reports in compliance with Standard Provisions 2013[7], (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

   The current annual report template can be found here:

   https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

   The Annual report must also include an updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, and water quality data.

   San Miguel Community Service District must include the following operator information with the annual report:

   i. The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.

   ii. A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.

   iii. A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.

   iv. If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.

3. **State Water Board Volumetric Annual Reporting** – San Miguel Community Service District must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database.[8]

   The following information is required:

   v. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e., total monthly influent volume).

[7] See Attachment E, Standard Provisions, 2013: https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf
[8] See: https://geotracker.waterboards.ca.gov/

vi. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.

vii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website[9].

B. NON-COMPLIANCE REPORTING:

San Miguel Community Service District must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

C. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

San Miguel Community Service District must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker[10,11] database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100035519 at:

https://geotracker.waterboards.ca.gov/esi/login

For general questions, please contact the GeoTracker Help Desk at: Geotracker@waterboards.ca.gov.

Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

---

[9] See: Volumetric Annual Reporting | California State Water Resources Control Board

[10] Information for first-time GeoTracker users is available at: https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

[11] Additional information available at: https://geotracker.waterboards.ca.gov/

Table 10. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Field Points, Location Data (Geo XY)[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data." These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.

Electronic Submittal	Description of Action	Action	Frequency
Elevation Data (Geo Z)[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. San Miguel Community Service District must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

8. TECHNICAL REPORTS

The technical reports are due as described in Table 11.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Operations and Maintenance Manual	December 6, 2024
Climate Change Adaptation Plan	December 6, 2025
Groundwater Monitoring Workplan	April 8, 2024
Capital Improvement Plan	December 6, 2024

A. Pretreatment Program Plan

A Pretreatment Program is not required at this time. If the Central Coast Water Board notifies San Miguel Community Service District that development of a Pretreatment Program Plan is required, submit a plan that meets the requirements specified in General Permit section IV.F.2.i and General Permit section VI.A.1. The plan must contain an implementation schedule and identification of adequate funding to implement the plan.

B. Operations and Maintenance Manual

In addition to the required components specified in Standard Provisions[12] A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.

i. **Sampling and Analysis Plan –** San Miguel Community Service District's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of San Miguel Community Service District must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:

a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations, monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds), and buildings. If San Miguel Community Service District needs to update Figure 1 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report.

b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.

c. Sample chain-of-custody procedures and documentation.

d. Sample handling/preservation procedures.

e. A description of the analytical methods.

f. A description of sample containers, preservatives, and holding times.

g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).

h. For groundwater monitoring, a description of the well purging and field methods.

ii. **Sludge Management Plan –** San Miguel Community Service District's Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General

[12] See Attachment E, Standard Provisions, 2013: https://www.waterboards.ca.gov/centralcoast/board_decisions/do-cs/wdr_standard_provisions_2013.pdf

Permit and the notice of applicability. At a minimum, the plan must describe the following:

a. An estimated volume/amount and quality of sludge and scum that will be generated.

b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.

c. If sludge will be subject to further treatment, describe the treatment and storage requirements.

d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.

iii. **Wastewater Disposal Management Plan –** San Miguel Community Service District's Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:

a. A description of the wastewater disposal area and a map denoting acreage.

b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.

c. A description of wastewater disposal and water quality protection practices.

iv. **Spill Prevention and Emergency Response Plan –**San Miguel Community Service District's Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:

a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.

c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order WQ 2022-0103-DWQ, Statewide Waste Discharge Requirements General Order for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order WQ 2022-0103-DWQ satisfy this requirement.

d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.

e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.

f. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.

v. **Training Records Log –** San Miguel Comm if unity Service District's Operation and Maintenance Manual must contain updated training records logs that demonstrates San Miguel Community Service District is complying with General Permit section VI.B.3.

C. Climate Change Adaptation

The Climate Change Adaptation Plan must, at a minimum, include the following components:

vi. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt[13], Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California

[13] Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
b. Precipitation Pattern Changes.
    I. Drought – Decreased influent quantity and quality.
    II. Peak Events – Flooding and increased influent quantity.
c. Temperature fluctuations and extremes.
d. Increased wildfires.
e. Increased power outages.

vii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

D. <u>Capital Improvement Plan</u>

San Miguel Community Service District must prepare and submit a Capital Improvement Plan. The Capital Improvement Plan must contain all significant capital projects, equipment purchases, and major studies for operating the San Miguel Community Service District's Wastewater System. In general, the Capital Improvement Plan will include the following elements:

i. Estimated overall cost of each project
ii. Estimated operational and maintenance cost for each project
iii. Estimated project timelines
iv. Funding sources
v. Project prioritization

9. LEGAL REQUIREMENTS

The Central Coast Water Board requires San Miguel Community Service District to submit the technical and monitoring reports described in this monitoring and reporting program pursuant to California Water Code section 13267. Failure to submit reports in accordance with the schedules established by the Permit or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject San Miguel Community Service District to enforcement action pursuant to California Water Code section 13268.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the Permit and to protect water quality. San Miguel Community Service District is required to submit this information because it is subject to the Permit and is responsible for the discharge.

San Miguel Community Service District must implement the above revised monitoring program on January 15, 2026. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. San Miguel Community Service District must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered By:

for Ryan E. Lodge
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\San Miguel Community Services District\1- Permit\2023 Large Domestic Order Enrollment\Revised NOA_MRP_Emergency_Disposal\San Miguel NOA MRP Jan 2026_final.docx