
Central Coast Regional Water Quality Control Board

August 12, 2022

Sent Via Electronic Mail

Randell Ishii
County of Monterey
Lake San Antonio Recreation Area South Shore Wastewater Facilities
1441 Schilling Place
Salinas, CA, 93901
Email: ishiiR@co.monterey.ca.us

Dear Randell Ishii,

LAKE SAN ANTONIO RECREATION AREA SOUTH SHORE WASTEWATER FACILITIES, 2610 SAN ANTONIO RD., BRADLEY, CA, 93426, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR MONTEREY COUNTY'S ENROLLMENT IN ORDER WQ 2014-0153-DWQ, *GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0053**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. R3-2001-0131**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200 Revised Report of Waste Discharge (received on March 1, 2022), and available documents associated with the domestic wastewater treatment system at Lake San Antonio Recreation Area South Shore owned by the County of Monterey. The wastewater system is currently regulated pursuant to Order No. R3-2001-0131. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. R3-2001-0131.

This letter serves as a notice of applicability for County of Monterey's enrollment in the General Permit for the discharge of wastewater from at Lake San Antonio Recreation Area South Shore Wastewater Facilities.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

The County of Monterey must comply with the following:

1. **General Permit** – The County of Monterey must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – The County of Monterey must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0053, enclosed with this letter (Attachment 3). Your first semiannual report is due on **February 1, 2023**.

Monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

The County of Monterey must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100033596 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – On December 8, 2021, Lake San Antonio Recreation Area South Shore Wastewater Facilities was sent their invoice for the 2021-2022 fiscal year. **This bill is past due.**

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

The County of Monterey must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$23,783. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B. If data from the facility demonstrates in the annual reports that the effluent water quality likely isn't causing violations of water quality objectives, the County may request a modification to their threat to a lower associated annual fee.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on October 13-14, 2022. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – The County of Monterey is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects the County of Monterey to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, the County of Monterey must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.

- 8. Certified Operator** – The County of Monterey is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade II certified operator onsite to maintain and operate the treatment system.

If you have any questions, please contact **Mark Lemus at (805) 549-3703 or by email at Mark.Lemus@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0053

cc:

Nathaniel Merkle, MerkleN@co.monterey.ca.us

Michael Lane, mlane@calruralwater.org

Roger VanHorn, vanhornrw@co.monterey.ca.us

Mark Lemus, Mark.Lemus@Waterboards.ca.gov

Kristina Olmos, Kristina.Olmos@Waterboards.ca.gov

Jesse Woodard, Jesse.Woodard@Waterboards.ca.gov

Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov, GeoTracker

ECM/CIWQS = CW-236252

GeoTracker No. = GT- WDR100033596

Rev 3/2/22

Subject Name = Lake San Antonio South Shore Wastewater Permit

R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\Monterey Co. Parks, San Antonio Lake South\2022\Final\Lake San Antonio Recreation Area South Shore WWTP NOA.docx

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by the County of Monterey to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Lake San Antonio Recreation Area South Shore Wastewater Facilities
Facility Address	2610 San Antonio Rd., Bradley, CA, 93426
Parcel Numbers	424-071-028-000
Latitude/Longitude	35°49'0.90"N/120°57'32.88"W
Onsite Manager	Nathanial Merkle
Owner of Facility	Monterey County
Legally Responsible Official of Owner	Randell Ishii
Owner Mailing Address	1441 Schilling Place Salinas, CA, 93901
Billing Address	1441 Schilling Place Salinas, CA, 93901
Permitted Design Flow (gallons per day, gpd)	Maximum daily capacity (dry weather flow) 100,000
Baseline Flow (average annual flow) in gpd	1,200
Operators	Michael Lane, Chief Plant Operator, Grade 5
Waste type and Service Area	Domestic wastewater from 50,000 annual transients (campground guests, day use guests). A total of 30 connections (low use campground restrooms, 3 fulltime, park-owned residences).
Nearest Surface Water Bodies	An unnamed ephemeral drainageway/creek borders the eastern and southern border of the facility drains into the San Antonio River approximately three quarters of a mile south. The San Antonio River drains into San Antonio Lake.

Groundwater	The Facility sits in the southern portion of the Lockwood Valley Groundwater Basin (DWR 3-006) depth to groundwater is undetermined at the facility location.
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee – WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

2. WASTEWATER SYSTEM OPERATION SUMMARY

Table 2. Permitted Treatment & Disposal Technologies and Capacity

Design Flows	Design Influent Maximum Daily Flow 100,000 gallons per day
Primary Treatment	A 50,000 gallon digester tank removes settleable solids.
Secondary Treatment	Primary effluent enters two facultative ponds that can be operated in series or parallel. When there is sufficient flow, facultative pond effluent from pond 1 can be diverted to the trickling filter for additional treatment before being recirculated to pond 2.
Disposal	The facility was designed to dispose of effluent via onsite spray irrigation field, but currently percolates and evaporates effluent in their unlined effluent disposal pond (Pond 3). The system is permitted to discharge to Pond 3, if the flow increases and spray disposal is needed, the County of Monterey may request a change via writing to Central Coast Water Board staff for review and approval.
Biosolids/Sludge Production and Handling	Solids are pumped from former digester tank and disposed off site via third party vendor.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

The County of Monterey must operate the facility in accordance with the General Order⁴ and this notice of applicability.⁵ The County of Monterey must operate the system to comply with the effluent limits below.

A. Effluent limits

The County of Monterey must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits

Constituent	Unit	Limit	Point of Compliance	Sample Location ¹
Flow	gpd	100,000 (maximum daily flow)	Influent	ES-1
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90	Effluent	ES-1

¹ Refer to monitoring and reporting program for sampling locations

B. Groundwater Limits

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, the County of Monterey must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁶ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Because the receiving groundwater has a designated use of municipal and domestic supply, objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

⁴ General Order sections B.2, B.3, B.4 B.6, and B.7 are not applicable for this facility.

⁵ General Order section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the

⁶ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

Based on the existing effluent water quality, the Central Coast Water Board does not require first-encountered groundwater monitoring wells. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

ATTACHMENT 2
FIGURES

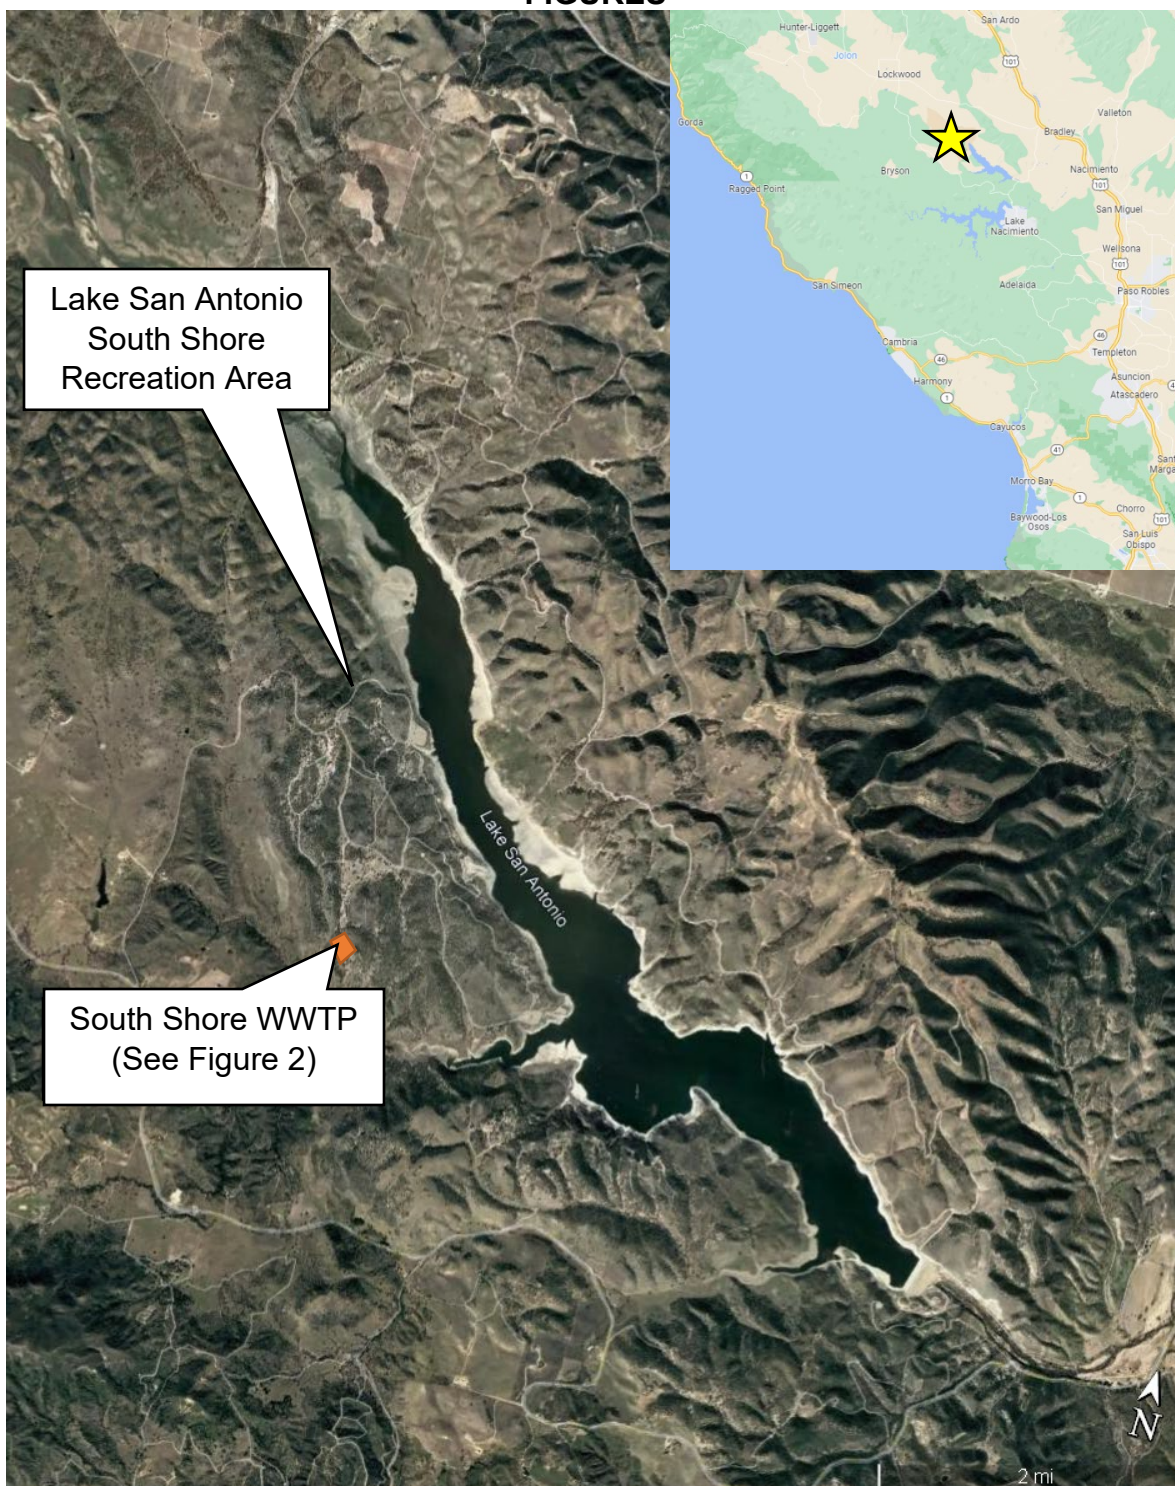


Figure 1. Site Location Map



Figure 2. Facility Map

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2022-0053

for

**LAKE SAN ANTONIO RECREATION AREA SOUTH SHORE WASTEWATER
FACILITIES
MONTEREY COUNTY**

This monitoring and reporting program (MRP) describes requirements for monitoring a wastewater treatment system for Lake San Antonio Recreation Area South Shore Wastewater Facilities located at 2610 San Antonio Rd. in Bradley, CA, 93426.

The County of Monterey owns and operates the wastewater system that is subject to the notice of applicability (NOA) dated August 12, 2022, for coverage in Order WQ 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- A. The user is trained in proper use and maintenance of the instruments;
- B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- D. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, The County of Monterey may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. The County of Monterey must report the results of any constituent monitored more frequently than is required by the monitoring program shown Table 2. The County of Monterey must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually ¹	Annually ¹
Nitrate and Nitrite (as N)	mg/L	Grab	Annually ¹	Annually ¹

mg/L = milligrams per liter

¹Or on a sampling and reporting frequency to coincide with drinking water sampling requirements for potable water supply well.

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample at Digester tank inlet.
Effluent Sample – 1	ES-1	Representative grab sample from at aeration pond's outlet to the disposal pond.

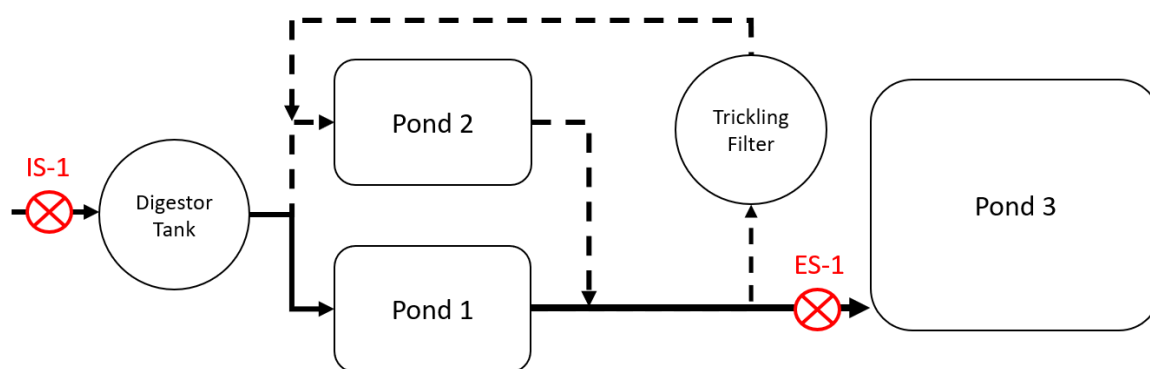


Figure 1. Process Flow Diagram with Sampling Locations

4. TREATMENT SYSTEM MONITORING

A. Flow Monitoring

The County of Monterey must monitor and report flow, as described in Table 4, with each monitoring report. If there is insufficient flow to discharge into the disposal pond, so shall the report state. Flow is monitored at sample location IS-1 before the Digester tank, and effluent flow is approximately equal to influent flow.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Reporting Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

B. Influent and Effluent Constituent Monitoring

Representative samples of Lake San Antonio Recreation Area South Shore Wastewater Facilities's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab. If there are few recreational area visitors resulting in no flow into Pond 3 during the entire monitoring period, the County of Monterey is not required to collect an effluent sample. The County of Monterey must attempt to collect samples during the highest anticipate flow during a monitoring period.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Monthly	Monthly
Total Suspended Solids	mg/L	Monthly	Monthly
Total Nitrogen	mg/L	Semi-annually	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Semi-annually	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Semi-annually	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semi-annually ^[2]
Chloride	mg/L	Not Required	Semi-annually ^[2]
Sodium	mg/L	Not Required	Semi-annually ^[2]
Sulfate	mg/L	Not Required	Semi-annually ^[2]

mg/L = milligram per liter MPN = most probably number

¹ Nitrate and nitrite sample may be combined

² May be reduced to annually upon written request

C. Wastewater Pond Monitoring

All wastewater treatment ponds, storage and disposal ponds must be monitored consistent with Table 6. The County of Monterey must inspect the ponds weekly and notations must be made in a bound logbook and include “observations” of the items in Table 4. Any problems must be promptly corrected and recorded. The bound logbook of these observations must be maintained onsite and made available to the Central Coast Water Board upon inspection. Only violations and mitigation measures must be included in the subsequent monitoring report.

Table 6. Wastewater Pond Monitoring

Parameter	Units	Sample Type	Sample Frequency
Dissolved Oxygen	mg/L	Grab ¹	Weekly
pH	Std. units	Grab ¹	Weekly
Evaporation	Inches	Weather station ²	Weekly
Freeboard	0.1 feet	Measurement	Weekly
Odors	--	Observation	Weekly
Berm Condition	--	Observation	Weekly
Plant Growth	--	Observation	Weekly
Vectors or Animals Burrowing	--	Observation	Weekly

mg/L denotes milligrams per liter

¹ Grab samples can be collected via handheld probe, see section 1 of this MRP² Weather station may be site-specific station, onsite evaporation pan, or nearby governmental weather reporting station

5. SOLIDS DISPOSAL MONITORING

The County of Monterey must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

6. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 7.

Table 7. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the

results of any pollutant or parameter monitored more frequently than is required by this monitoring program.

- **Compliance and Performance Discussion** -- Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Order requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.

An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen,) over time, nuisance conditions, system problems, etc.

A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.

- **Pond Observations** -- Report the results of the observations, as described in Section 4.C.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 5.
- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

7. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiiting/docs/transmittal_sheet.pdf

The County of Monterey must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number over the internet at:

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml.

Table 8 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 8. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.

Electronic Submittal	Description of Action	Action	Frequency
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

8. TECHNICAL REPORTS

The County of Monterey must submit to GeoTracker the three reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 9. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	90 days from date of General Permit enrollment ¹
Sampling and Analysis Plan	90 days from date of General Permit enrollment ¹
Sludge Management Plan	90 days from date of General Permit enrollment ¹
Trickling Filter Start-up and Operation Plan	180 days from date of General Permit enrollment ¹

1. The date of General Permit enrollment is August 12, 2022

A. Trickling Filter Start up and Operation Plan

The Lake San Antonio Recreation Area South Shore Wastewater Facility has a trickling filter, not in current use, that can provide additional treatment. Care must be taken to start up and operate the trickling filter to treat wastewater as originally designed and intended. The County of Monterey will conduct an analysis of the trickling filter operation requirements and develop a start up plan and submit this information determined in a technical report due 180 days of the General Permit Enrollment (NOA). The Analysis and Technical Report must contain at a minimum:

- I. Expected dates and duration of trickling filter operation
- II. Flow required to start and maintain operation of the trickling filter as designed
- III. Detailed instructions on how staff will start up the trickling filter to develop the zoogeal mass needed for treatment

9. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that the County of Monterey submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject the County of Monterey to enforcement action pursuant to [section 13268 of the Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. The County of Monterey is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

The County of Monterey must implement the above monitoring program as of the date of this monitoring and reporting program. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. The County of Monterey must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

for Matthew T. Keeling
Executive Officer