

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. 6-00-94
WDID NO. 6B150118001

REVISED WASTE DISCHARGE REQUIREMENTS

FOR

THE CITY OF CALIFORNIA CITY
WASTEWATER TREATMENT FACILITY

Kern County

The California Regional Water Quality Control Board, Lahontan Region, (Regional Board) finds:

1. Discharger

The City of California City submitted a complete revised Report of Waste Discharge for an expansion to the California City Wastewater Treatment Facility on July 24, 2000. For the purposes of this Regional Board Order (Order), the City of California City is referred to as the "Discharger."

2. Facility

The California City Wastewater Treatment Facility collects, treats, disposes and recycles domestic wastewater from the Discharger. For the purposes of this Order, the California City Wastewater Treatment Facility is referred to as the "Facility."

3. Order History

The Regional Board previously established Waste Discharge Requirements (WDRs) for the Facility under Board Order No. 6-85-121, which was adopted on October 21, 1985 and Board Order No. 6-93-76, which was adopted on August 12, 1993.

4. Reason for Action

The Regional Board is revising this Order to allow an expansion of the treatment facilities and revise the monitoring program.

5. Facility Location

The Facility is located in Section 18 of T32S, R38E, MDB&M of the USGS California City North Quadrangle. The Facility is located on Nelson Drive approximately two (2.0) miles northeast of the California City Business District, California City, Kern County, as shown on Attachment "A", which is made part of this Order.

6. Description of Facility and Discharge

The existing Facility is designed to treat an average flow of 1.0 million gallons per day (mgd) and a peak flow of 2.0 mgd. Currently, the average influent flow is 0.3 mgd of domestic wastewater. The present treatment processes include an influent pump station, head works consisting of a parshall flume, mechanical bar screen, and communitors, secondary treatment consisting of one extended aeration activated sludge basin, (split into two cells) two clarifiers and a return activated sludge (RAS)/waste activated sludge (WAS) pump station and tertiary treatment facilities consisting of a filter influent pump station, a chemical mixing flocculation tank, upflow sand filtration filters, disinfection in a chlorine contact chamber, a tertiary effluent storage pond and chemical storage facilities for alum, ploymer and chlorine.

7. Disposal and Recycling Area

Secondary treated wastewater, in excess of recycled water use demand, is disposed in seven percolation ponds. Normally, tertiary treated effluent is delivered to the Central Park Lake for storage as a recreational non-contact impoundment and subsequent irrigation of Central Park and the City's Municipal Course (Tierra del Sol). The disposal and recycling sites are shown in Attachment "A", which is made part of this Order. The percolation ponds are also used for disposal when the tertiary facilities are unable to meet recycled water use criteria.

8. Sludge Treatment and Disposal

The WAS is conveyed to 10 lined sand type sludge drying beds for dewatering. The sludge drying beds, with a total area of 15,000 square feet, are located east of the percolation ponds. Dried sludge is removed and disposed at an authorized site, currently a landfill.

9. Expansion

Wastewater from a newly constructed prison will be conveyed to the Facility. In order to accommodate the increased flows from the new prison, the Discharger is implementing a Facility expansion. The expansion involves modifications and improvements of the individual unit processes to achieve a design flow of 1.5 mgd and peak flow of 3.0. mgd.

Based on a recommended capacity evaluation report, the following upgrades are proposed:

- a. replace the influent pumps to be capable of pumping the peak 3.0 mgd flow;
- b. upgrading the power section of the aeration basin aerators;
- c. adding new RAS/WAS pumps;
- d. adding nine similar sludge drying beds with an increase of 27,000 square feet to an approximate total of 42,000 square feet drying area;

- e. replacing the filter influent pumps;
- f. adding two new filter cells for a total operating arrangement of 5+1. Since the existing filters can handle 1.1 mgd and current flow is 0.3 mgd, the new filters will be added when average daily flows are 0.88 mgd (80% capacity); and
- g. increase the chlorine contact chamber when average daily flows are 0.88 mgd.

Until items f and g (above) are completed to reach the total 1.5 mgd capacity in the tertiary treatment train, secondary treated flows in excess of 1.1 mgd will be disposed in the percolation ponds. Construction completion is expected to take approximately one year or less.

10. Authorized Disposal Recycling Sites

The percolation ponds are the only authorized disposal sites and Central Park Lake, Central Park, and the Tierra del Sol Golf Course are the only authorized recycling sites for wastewater effluent.

11. Recycling Regulations

The State Department of Health Services has established statewide recycling criteria for the use of recycled water for landscape irrigation as specified in Chapter 3, Division 4, Title 22 of the California Code of Regulations.

In accordance with Section 13523 of the California Water Code, the Regional Board consulted with and received the recommendations of the State Department of Health Services concerning recycling requirements which are incorporated within this Order.

12. Site Geology

The Facility is located in the Fremont Valley in the northwest portion of the Mojave Desert. Fremont Valley is a deep structural depression in the overlap of the east and west strands of the Garlock fault. More than 3,200 feet of unconsolidated and moderately consolidated sediments underlie Fremont Valley with the thickness of unconsolidated sediments changing locally across faults. In general, the upper soils of the Discharger's area consist of a thick alluvial sequence of gravel, sand, silt, and clay, which have eroded from the surrounding hills. The thick alluvial sequence within the site vicinity is underlain by Tertiary volcanic and sedimentary rocks which are underlain by a pretertiary basement complex of granitic rock. The subsurface conditions consist of loose to medium-dense silt and sand with gravel.

13. Site Hydrology

Surface drainage flows to Koehn Dry Lake which is about 10 miles north-northeast of the Facility. The underlying ground water aquifer is generally unconfined, with ground water movement toward the Koehn Dry Lake. The Koehn Hydrologic Area receives subsurface inflow from the Antelope Valley to the south and east. Since there is no known outflow, the ground water basin is considered to be closed. Depth to ground water at the Facility is approximately 200 to 250 feet.

14. Receiving Waters

The receiving waters are the ground waters of the Koehn Hydrologic Area (DWR# 625.40) of the Fremont Hydrologic Unit.

15. South Lahontan Basin Plan

The Regional Board adopted a Water Quality Control Plan for the South Lahontan Region (Basin Plan) which became effective on March 31, 1995. This Order implements the Basin Plan, as amended.

16. Ground Water Beneficial Uses

The beneficial uses of the ground waters of the Koehn Hydrologic Area of the Fremont Hydrologic Unit (also known as the Fremont Valley Ground Water Basin, DWR #6-46) as set forth and defined in the Basin Plan are as follows:

- a. Municipal and Domestic supply (MUN);
- b. Agricultural Supply (AGR);
- c. Industrial Service Supply (IND); and
- d. Freshwater Replenishment (FRSH).

17. California Environmental Quality Act (CEQA) Compliance

The Discharger has certified a final Negative Declaration for expansion dated May 16, 2000, in accordance with the CEQA (Public Resources Code Section 21000 et seq.). The project, as approved by the Discharger, will not have a significant effect on water quality.

18. Nondegradation

State Water Resources Control Board Resolution No. 68-16 (Statement of policy with respect to maintaining high quality of waters in California) is called the nondegradation objective in the Basin Plan. This objective requires maintenance of existing high quality in surface waters, ground waters, or wetlands. Whenever the existing quality of water is better than the quality of water established in the basin plan, such existing quality shall be maintained unless appropriate findings are made under Resolution No. 68-16.

Discharges of wastewater, through percolation from the disposal ponds and irrigation of the golf course will result in some degradation of ground water locally over time. This degradation will primarily by an increase in total dissolved solids, nitrate and some other inorganic constituents in areas of percolation. The Regional Board acknowledges that some local degradation will occur to ground water underlying the percolation ponds and irrigation areas. Currently, most of the effluent is used for irrigation and will not result in deep percolation to ground water. This degradation is expected to be minor and no adverse effects on present and future beneficial uses are anticipated.

19. Notification of Interested Parties

The Regional Board has notified the Discharger and interested parties of its intent to revise WDRs for the discharge.

20. Consideration of Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent /Discharge Limitations

1. The total average effluent flow of wastewater during a 24-hour period shall not exceed 1.0 million gallons and, following expansion, 1.5 million gallons.

The current maximum peak instantaneous flow rate of wastewater shall not exceed 2.0 mgd. Following completion of expansion, the maximum peak instantaneous flow rate of wastewater shall not exceed 3.0 mgd.

2. All wastewater discharged to the authorized disposal/recycling sites shall not contain concentrations of parameters in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Maximum</u>
BOD ²	mg/L	30	45
Methylene Blue Active Substances	mg/L	1.0	2.0

3. All wastewater made available to the authorized disposal/recycling sites shall have a pH of not less than 6.0 pH units nor more than 9.0 pH units.
4. All wastewater discharged to the authorized disposal/recycling sites shall have a dissolved oxygen concentration not less than 1.0 mg/l.

B. Receiving Water Limitation

This discharge shall not cause a violation of any applicable water quality standards for receiving water adopted by the Regional Board or the State Water Resources Control Board (SWRCB). The discharge shall not cause the presence of the following substances or conditions in ground or surface waters or wetlands of the Koehn Hydrologic Area of the Fremont Hydrologic Unit.

1. Ground Waters

- a. Bacteria - In Ground waters, the median concentration of coliform organisms over any seven-day period shall be less than 1.1/100 milliliter.

b. Chemical Constituents

Ground waters shall not contain concentrations of chemical constituents in excess of the maximum contaminant level (MCL) or secondary maximum contaminant level (SMCL) based upon drinking water standards specified in the following provisions of Title 22 of the California Code of Regulations: Table 64431-A of Section 64431 (Inorganic Chemicals), Table 64431-B of Section 64431 (Fluoride), Table 6444-A of Section 64444 (Organic Chemicals), Table 64449-A of Section 64449 (SMCLs - Consumer Acceptance Limits), and Table 64449-B of Section 64449 (SMCLs - Ranges). This incorporation-by-reference is prospective including future changes to the incorporated provisions as the changes take effect.

Waters designated as AGR shall not contain concentrations of chemical constituents in amounts that adversely affect the water for beneficial uses (i.e., agricultural purposes).

Ground waters shall not contain concentrations of chemical constituents that adversely affect the water for beneficial uses.

- c. Radioactivity - Radionuclides shall not be present in concentrations that are deleterious to human, plant, animal, or aquatic life, or that result in the accumulation of radionuclides in the food chain to an extent that it presents a hazard to human, plant, animal, or aquatic life. Waters shall not contain concentrations of radionuclides in excess of limits specified in the California Code of Regulations, Title 22, Chapter 15, Article 5, Section 64443.
- d. Taste and Odors - Ground waters shall not contain taste or odor-producing substances in concentrations that cause nuisance or that adversely affect beneficial uses. For ground waters designated as MUNs at a minimum, concentrations shall not exceed adopted SMCLs specified in Table 64449-A of Section 64449 (SMCLs - Ranges), and

Table 64449-B of Section 64449 (SMCLs - Ranges) of Title 22 of the California Code of Regulations, including future changes as the changes take effect.

C. Recycling Requirements

1. All effluent made available for recycling shall comply with the standard Department of Health Services reclamation requirements as specified in §60301 Chapter 3, Division 4, Title 22 of the California Code of Regulations.
2. Recycled water used as a source of supply for Central Park Lake shall be at all times an adequately disinfected, oxidized, clarified, filtered wastewater. The wastewater shall be considered disinfected if at some location in the treatment process the median number of coliform organisms does not exceed 2.2 MPN per 100 milliliters and the number of coliform organisms does not exceed 23 MPN per 100 milliliters in more than one sample within any 30-day period. The median value shall be determined from the bacteriological results of the last seven (7) days for which analyses have been completed.
3. Recycled water shall not exceed an average operating turbidity of two (2) turbidity units and five (5) turbidity units for more than five percent of the time during any 24-hour period.
4. Flows of tertiary treated effluent delivered to the recycling areas shall be limited to 1.1 mgd until certification is provided, signed by a California registered Civil Engineer, that the tertiary plant is capable of handling increased flows.

D. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent from the authorized disposal/recycling sites to adjacent land areas or surface waters is prohibited.
3. The freeboard at the lowest point of a pond or lake containing treated effluent shall not be less than two (2.0) feet.
4. The discharge shall not cause a pollution as defined in Section 13050 of the California Water Code, or a threatened pollution.
5. Neither the treatment nor the discharge shall cause a nuisance as defined in Section 13050 of the California Water Code.

6. The discharge of wastewater except to the authorized disposal/recycling sites is prohibited.
7. The discharge of waste, as defined in the California Water Code, which causes violation of any narrative water quality objective contained in the Basin Plan, including the Nondegradation Objective, is prohibited.
8. The discharge of waste which causes violation of any numeric water quality objective contained in the Basin Plan is prohibited.
9. Where any numeric or narrative water quality objective contained in the Basin Plan is already being violated, the discharge of waste which causes further degradation or pollution is prohibited.
10. The Discharger shall comply with all existing federal and state laws and regulations that apply to sewage sludge use and disposal practices.
11. Prior to construction, 80 percent design drawings shall be provided to the Regional Board signed by a California registered Civil Engineer. Within 60 days of completing construction activities that provide for a 1.5 mgd design flow (3.0 mgd peak flow) as-built drawings and certification shall be provided to the Regional Board signed by a California registered Civil Engineer.
12. All sludge drying beds shall be lined to effectively prevent leaching. If synthetic liners are used, the liners shall comply with the flexible membrane liner (FML) standards provided in Title 27, California Code of Regulations for subgrade preparation, thickness, type and construction.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Board Order No. 6-93-76 is hereby rescinded.

B. Operator Certificates

The Discharger's wastewater treatment shall be supervised by persons possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to Chapter 3, Subchapter 14, Title 23, California Code of Regulations.

C. Standard Provisions

The Discharger shall comply with the "Standard Provisions for Waste Discharge Requirements", dated September 1, 1994, in Attachment "B", which is made part of this Order.

D. Monitoring and Reporting

1. Pursuant to Section 13267(b), the Discharger shall comply with the Monitoring and Reporting Program No. 00-94 as specified by the Executive Officer.
2. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made a part of the Monitoring and Reporting Program.


I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on November 15, 2000.



HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: A. Location Map
B. Standard Provisions for Waste Discharge Requirements

-
- 1 The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days.
 - 2 Biochemical Oxygen Demand (5 day, 20°C) of a filtered sample using a No.1 Whatman filter or equivalent and reseeded with an unfiltered sample.

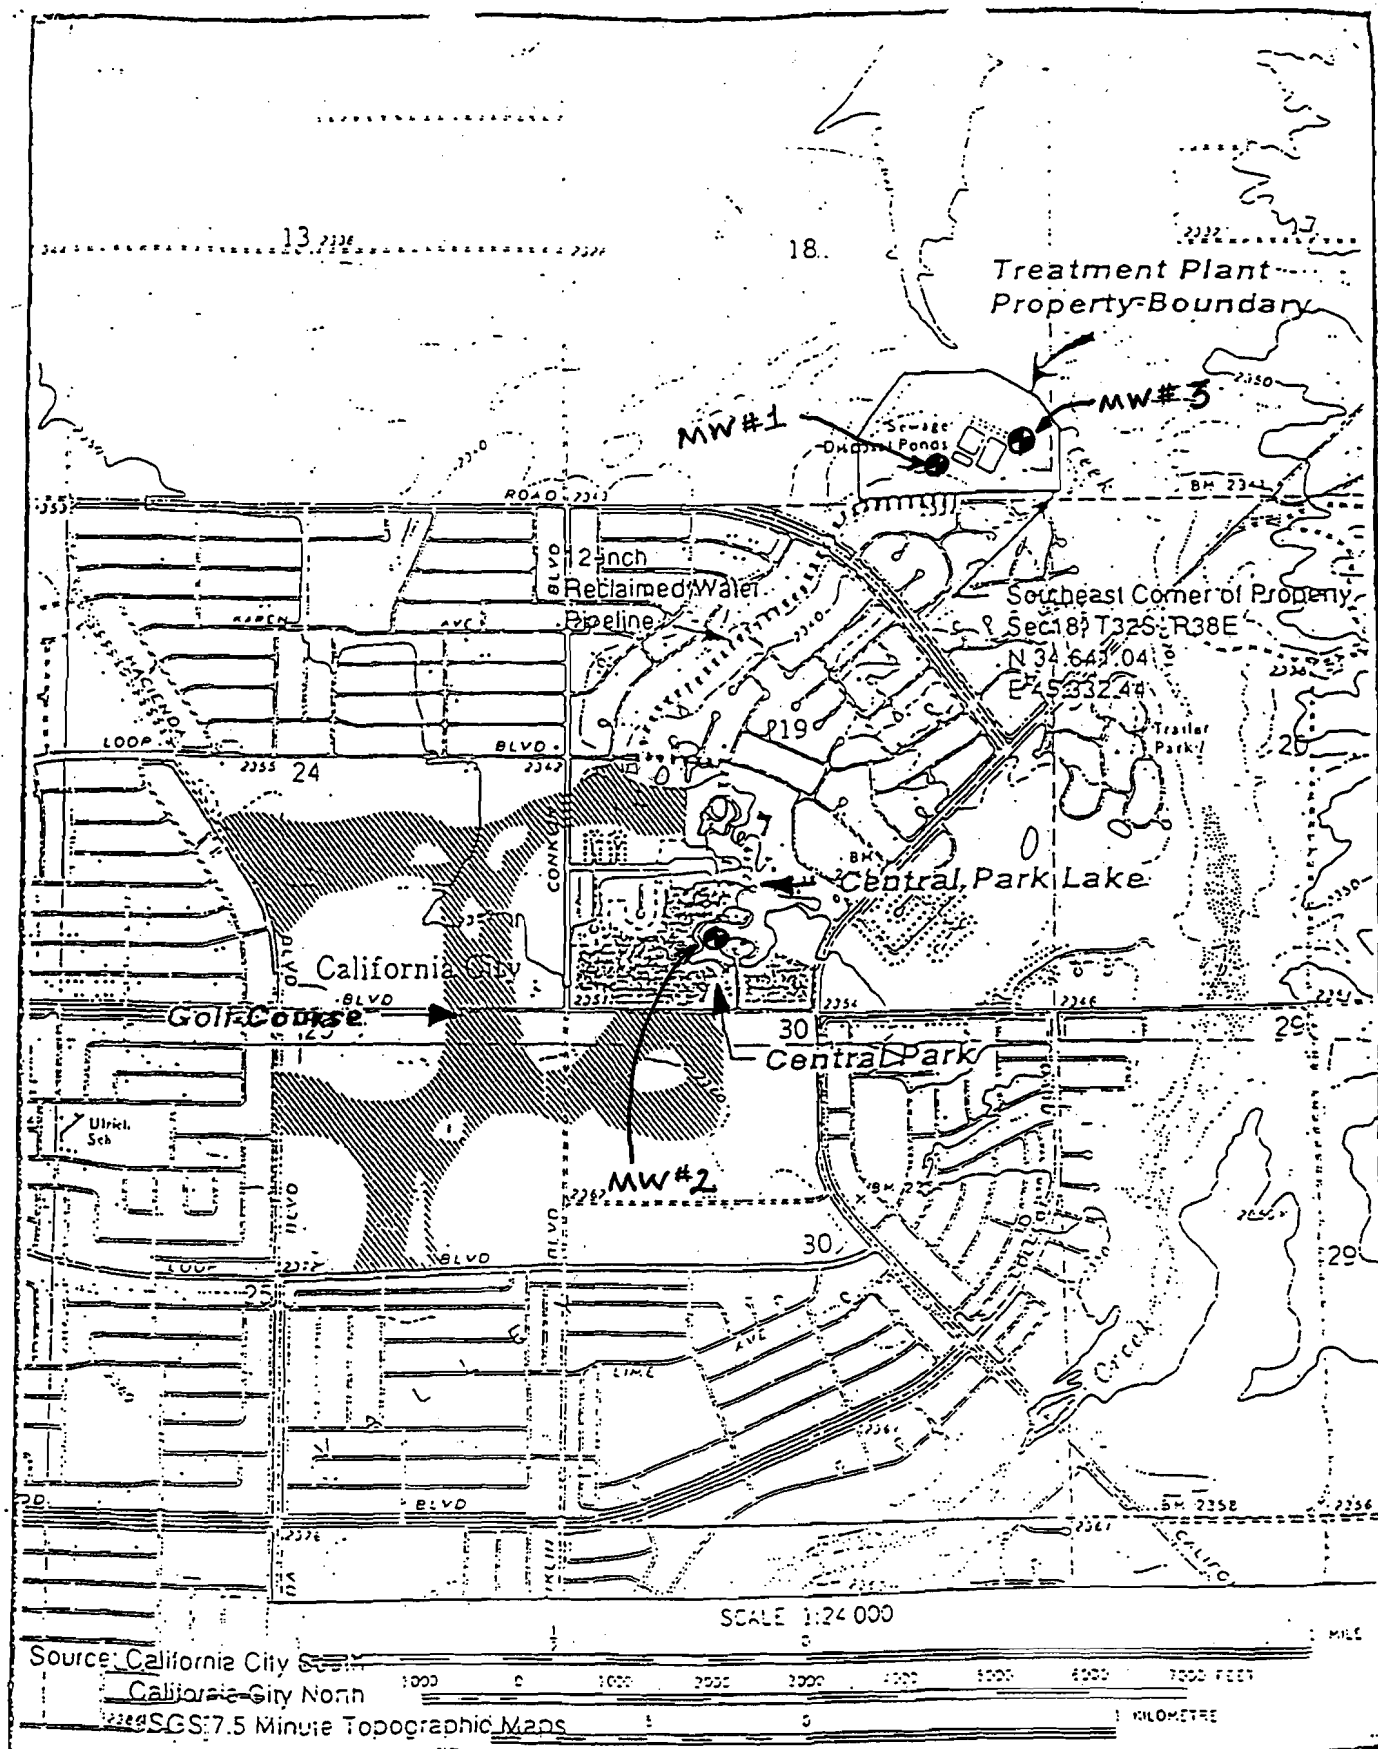

ATTACHMENT "A"
LOCATION MAP

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD

STANDARD PROVISIONS FOR WASTE DISCHARGE REQUIREMENTS

ATTACHMENT B

1. Inspection and Entry

The Discharger shall permit Regional Board staff:

- a. to enter upon premises in which an effluent source is located or in which any required records are kept;
- b. to copy any records relating to the discharge or relating to compliance with the Waste Discharge Requirements;
- c. to inspect monitoring equipment or records; and
- d. to sample any discharge.

2. Reporting Requirements

- a. Pursuant to California Water Code 13267(b), the Discharger shall immediately notify the Regional Board by telephone whenever an adverse condition occurred as a result of this discharge; written confirmation shall follow within two weeks. An adverse condition includes, but is not limited to, spills of petroleum products or toxic chemicals, or damage to control facilities that could affect compliance.
- b. Pursuant to California Water Code Section 13260(c), any proposed material change in the character of the waste, manner or method of treatment or disposal, increase of discharge, or location of discharge, shall be reported to the Regional Board at least 120 days in advance of implementation of any such proposal. This shall include, but not limited to, all significant soil disturbances.
- c. The Owners/Discharger of property subject to Waste Discharge Requirements shall be considered to have a continuing responsibility for ensuring compliance with applicable Waste Discharge Requirements in the operations or use of the owned property. Pursuant to California Water Code Section 13260(c), any change in the ownership and/or operation of property subject to the Waste Discharge Requirements shall be reported to the Regional Board. Notification of applicable Waste Discharge Requirements shall be furnished in writing to the new owners and/or operators and a copy of such notification shall be sent to the Regional Board.
- d. If a Discharger becomes aware that any information submitted to the Regional Board is incorrect, the Discharger shall immediately notify the Regional Board, in writing and correct that information.
- e. Reports required by the Waste Discharge Requirements, and other information requested by the Regional Board, must be signed by a duly authorized representative of the Discharger. Under Section 13268 of the California Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation.

- f. If the Discharger becomes aware that their Waste Discharge Requirements (or permit) is no longer needed (because the project will not be built or the discharge will cease) the Discharger shall notify the Regional Board in writing and request that their Waste Discharge Requirements (or permit) be rescinded.

3. Right to Revise Waste Discharge Requirements

The Regional Board reserves the privilege of changing all or any portion of the Waste Discharge Requirements upon legal notice to and after opportunity to be heard is given to all concerned parties.

4. Duty to Comply

Failure to comply with the Waste Discharge Requirements may constitute a violation of the California Water Code and is grounds for enforcement action or for permit termination, revocation and reissuance, or modification.

5. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge in violation of the Waste Discharge Requirements which has a reasonable likelihood of adversely affecting human health or the environment.

6. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the Discharger to achieve compliance with the Waste Discharge Requirements. Proper operation and maintenance includes adequate laboratory control, where appropriate, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by the Discharger, when necessary to achieve compliance with the conditions of the Waste Discharge Requirements.

7. Waste Discharge Requirement Actions

The Waste Discharge Requirements may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for waste discharge requirement modification, revocation and reissuance, termination, or a notification of planned changes or anticipated noncompliance, does not stay any of the Waste Discharge Requirements conditions.

8. Property Rights

The Waste Discharge Requirements do not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

9. Enforcement

The California Water Code provides for civil liability and criminal penalties for violations or threatened violations of the Waste Discharge Requirements including imposition of civil liability or referral to the Attorney General.

10. Availability

A copy of the Waste Discharge Requirements shall be kept and maintained by the Discharger and be available at all times to operating personnel.

11. Severability

Provisions of the Waste Discharge Requirements are severable. If any provision of the requirements is found invalid, the remainder of the requirements shall not be affected.

12. Public Access

General public access shall be effectively excluded from disposal/treatment facilities.

13. Transfers

Providing there is no material change in the operation of the facility, this Order may be transferred to a new owner or operator. The owner/operator must request the transfer in writing and receive written approval from the Regional Board's Executive Officer.

14. Definitions

- a. "Surface waters" as used in this Order, include, but are not limited to, live streams, either perennial or ephemeral, which flow in natural or artificial water courses and natural lakes and artificial impoundments of waters. "Surface waters" does not include artificial water courses or impoundments used exclusively for wastewater disposal.
- b. "Ground waters" as used in this Order, include, but are not limited to, all subsurface waters being above atmospheric pressure and the capillary fringe of these waters.

15. Storm Protection

- a. All facilities used for collection, transport, treatment, storage, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

REVISED MONITORING AND REPORTING PROGRAM NO. 00-94
WDID NO. 6B150118001

FOR

THE CITY OF CALIFORNIA CITY
WASTEWATER TREATMENT FACILITY

Kern County

I. MONITORING

The Discharger shall monitor and report the following:

A. Flow Monitoring

1. The total volume, in million gallons, of wastewater flow to the Facility for each day.
2. The total volume, in million gallons, of wastewater flow to the Facility calculated for each month.
3. The maximum instantaneous flow rate, in million gallons per day (mgd), of wastewater to the treatment Facility that occurs each day.
4. The average flow rate, in mgd, of wastewater flow to the Facility to the calculated for each month.
5. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in a pond or lake) measured each month in each pond or lake when the pond is accessible. If the pond or lake does not contain wastewater, indicate that it is empty. If the ponds or lakes are inaccessible, indicate so and provide an explanation why they are inaccessible.
6. The total flow, in mgd, of tertiary treated effluent delivered to the Central Park Lake for each day.

B. Facility Effluent Monitoring

1. Grab samples of treated effluent discharged into the storage pond shall be collected prior to chlorination and analyzed to determine the magnitude of the following parameters. If treated effluent is discharged into the percolation ponds during the reporting period, a sample shall also be collected from the first pond in which percolation may occur.

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
BOD ¹	mg/L	Twice per month
Dissolved Oxygen	mg/L	Twice per month
pH	pH units	Twice per month
Methylene Blue Active Substances	mg/L	Twice per month
Oil & Grease	mg/L	Twice per month
Kjeldahl Nitrogen	mg/L as N	Monthly
Nitrate Nitrogen	mg/L as N	Monthly
Ammonia Nitrogen	mg/L as N	Monthly
Total Dissolved Solids (TDS)	mg/L	Semiannually
Chloride	mg/L	Semiannually
Sodium	mg/L	Semiannually
Sulfate	mg/L	Semiannually
Total Hardness	mg/L as CaCO ₃	Semiannually
Boron	mg/L	Semiannually
Fluoride	mg/L	Semiannually
Priority Pollutants ^{2/3}	µg/L	Annually
Methyl Teritary Butyl Ether	µg/L	Annually

2. Grab samples of chlorinated tertiary effluent discharged to recycling sites shall be collected and analyzed to determine the magnitude of the following parameter:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Total Coliform	MPN/100ml	Daily
Turbidity	NTU	Daily

C. Ground Water Monitoring

Beginning immediately, grab samples from monitoring wells 1, 2 and 3 shall be collected from the entire thickness or the upper 20 feet, whichever is less, of the uppermost ground water bearing zone and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Methylene Blue Active Substances	mg/L	Semiannually
Total Dissolved Solids	mg/L	Semiannually
Kjeldahl Nitrogen	mg/L as N	Semiannually
Nitrate Nitrogen	mg/L as N	Semiannually
Ammonia Nitrogen	mg/L as N	Semiannually
Priority Pollutants ^{2/3}	µg/L	Annually
Methyl Teritary Butyl Ether	µg/L	Annually

1. Field Parameters - Each time a ground water monitoring well is sampled, the following field parameters shall be monitored and reported.

Table 1

<u>Parameter</u>	<u>Units</u>
Standing Water Level (SWL)	Feet above msl
Electrical Conductivity (E _c)	µmhos/cm
Turbidity	NTU
pH	0-14
Temperature (T)	F° or C°

2. For each ground water sampling event, submit a map showing well locations and ground water contours. Include elevations from any adjacent wells that are sampled by the California City Wastewater Treatment Facility personnel.

D. Sludge Monitoring

1. Total quantity of sludge generated during the monitoring period.
2. Date and quantity of sludge removed off site, location of use, recipient (including name and address) and sludge disposal method (including crops grown if appropriate) for all sludge removed off site.
3. Cumulative total quantity of sludge currently stockpiled on site including the quantity of sludge added to the stock pile during this monitoring period.
4. For wastewater sludge removed from the drying beds, stockpiled on-site, or discharged off-site during the previous month, a representative sample shall be collected and analyzed for the following constituents:
 - a. total kjeldahl nitrogen (as N);
 - b. nitrate nitrogen (as N);

- c. ammonia nitrogen (as N);
- d. total phosphate (as P); and
- e. parameters listed in Section 66699 (b) and (c) of Chapter 30, Division 4, Title 22 of the California Code of Regulations.

The Discharger shall make a determination whether the analyses indicate that the sludge shall be considered a hazardous material.

E. Pretreatment

- 1. A summary of activities undertaken to monitor and regulate industrial wastewater sources shall be prepared and submitted with each annual report.
 - a. An inventory of significant industrial users, including names, addresses, categories, industrial pollutants, and volumes. A significant industrial user is either:
 - (1) an industrial user discharging more than 25,000 gallons per day to the treatment plant,
 - (2) is a categorical industrial user as defined in 40 CFR 400-471, or
 - (3) can pass through or cause interference to the wastewater treatment plant.
 - b. A discussion of upset, interference, or pass through incidents, if any, at the treatment plant which the Discharger knows or suspects was caused by industrial users.
 - c. A discussion of enforcement actions taken or proposed.
- 2. A summary of the pretreatment functions including, but not limited to:
 - a. necessary legal authorities;
 - b. pretreatment requirements; and
 - c. status of funding and personnel to implement the pretreatment program.

F. Off-site Disposal

The Discharger shall include in each monitoring report the volume and type of all waste hauled off-site for disposal. The person or company doing the hauling and the legal point of disposal shall also be recorded.

G. Operation and Maintenance

A brief summary of any operational problems and maintenance activities shall be submitted to the Regional Board with each monitoring report.

This summary shall discuss:

1. Any modifications or additions to the wastewater conveyance system, treatment facilities, or disposal facilities;
2. Any major maintenance conducted on the wastewater conveyance system, treatment facilities, or disposal facilities;
3. Any major problems occurring in wastewater conveyance system, treatment facilities, or disposal facilities; and
4. The calibration of any wastewater flow measuring devices.

II. REPORTING


A. General Provisions

1. In accordance with General Provisions 3.a., the Discharger shall make a compliance statement in each submitted monitoring report, noting each violation that occurred during the reporting period and actions taken and/or proposed to return into compliance.
2. Pursuant to General Provisions 1.d of the General Provisions for Monitoring and Reporting, the Discharger shall submit by **December 30, 2000**, a Sampling and Analysis Plan (SAP) to the Regional Board for approval. The SAP shall define methods for sample collection, monitoring well purging, preservation and analysis shipment protocol, field procedures, laboratory Quality Assurance/Quality Control and Data Quality for all constituents listed in this Order.

B. Submittal Periods

1. Monthly monitoring reports containing the above required information shall be submitted to the Regional Board beginning on **January 15, 2001**. Subsequent monitoring reports shall be submitted to the Regional Board by the **15th day following the end of each month**.
2. An annual monitoring report shall be submitted along with the quarterly monitoring report to the Regional Board by **January 15th of each year**.

Ordered by:



HAROLD J. SINGER
EXECUTIVE OFFICER

Dated: November 15, 2000

Attachments: A. List of Priority Pollutants from Appendix 4, Tables 2a, b, c and d of SWRCB Resolution 2000 – 015 (Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bay, and Estuaries of California)

B. General Provisions for Monitoring and Reporting Program

-
- 1 Biochemical Oxygen Demand (5 day, 20°C) of a filtered samples using a No. 1 Whatman filter or equivalent and reseeded with an unfiltered sample.
 - 2 Analysis shall be conducted for those substances included on the EPA list of Priority Pollutants (refer to Attachment A) and all other substances known to be discharged to the California City Area sewer system.
 - 3 Purgeable organics analysis shall be conducted in accordance with EPA method 601, 40 CFR part 136, Appendix A. Base/neutral/acid extractable organics analysis shall be conducted in accordance with EPA method 625, 40 CFR, part 136, Appendix A. Purgeable Aromatics analysis shall be conducted in accordance with EPA method 602, 40 CFR, part 136, Appendix A.

SWRCB Minimum Levels in ppb ($\mu\text{g/L}$)

The Minimum Levels (MLs) in this appendix are for use in reporting and compliance determination purposes in accordance with section 2.4 of this Policy. These MLs were derived from data for priority pollutants provided by State certified analytical laboratories in 1997 and 1998. These MLs shall be used until new values are adopted by the SWRCB and become effective. The following tables (Tables 2a - 2d) present MLs for four major chemical groupings: volatile substances, semi-volatile substances, inorganics, and pesticides & PCBs.

Table 2a - VOLATILE SUBSTANCES*	GC	GCMS
1,1 Dichloroethane	0.5	1
1,1 Dichloroethene	0.5	2
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
1,2 Dichlorobenzene (volatile)	0.5	2
1,2 Dichloroethane	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichlorobenzene (volatile)	0.5	2
1,3 Dichloropropene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Bromomethane	1.0	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromo-methane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Chloromethane	0.5	2
Dichlorobromo-methane	0.5	2
Dichloromethane	0.5	2
Ethylbenzene	0.5	2
Tetrachloroethene	0.5	2
Toluene	0.5	2
trans-1,2 Dichloroethylene	0.5	1
Trichloroethene	0.5	2
Vinyl Chloride	0.5	2

*The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
1,2 Benzanthracene	10	5		
1,2 Dichlorobenzene (semivolatile)	2	2		
1,2 Diphenylhydrazine		1		
1,2,4 Trichlorobenzene	1	5		
1,3 Dichlorobenzene (semivolatile)	2	1		
1,4 Dichlorobenzene (semivolatile)	2	1		
2 Chlorophenol	2	5		
2,4 Dichlorophenol	1	5		
2,4 Dimethylphenol	1	2		
2,4 Dinitrophenol	5	5		
2,4 Dinitrotoluene	10	5		
2,4,6 Trichlorophenol	10	10		
2,6 Dinitrotoluene		5		
2- Nitrophenol		10		
2-Chloroethyl vinyl ether	1	1		
2-Chloronaphthalene		10		
3,3' Dichlorobenzidine		5		
3,4 Benzofluoranthene		10	10	
4 Chloro-3-methylphenol	5	1		
4,6 Dinitro-2-methylphenol	10	5		
4- Nitrophenol	5	10		
4-Bromophenyl phenyl ether	10	5		
4-Chlorophenyl phenyl ether		5		
Acenaphthene	1	1	0.5	
Acenaphthylene		10	0.2	
Anthracene		10	2	
Benzidine		5		
Benzo(a) pyrene(3,4 Benzopyrene)		10	2	
Benzo(g,h,i)perylene		5	0.1	
Benzo(k)fluoranthene		10	2	
bis 2-(1-Chloroethoxyl) methane		5		
bis(2-chloroethyl) ether	10	1		
bis(2-Chloroisopropyl) ether	10	2		
bis(2-Ethylhexyl) phthalate	10	5		
Butyl benzyl phthalate	10	10		
Chrysene		10	5	
di-n-Butyl phthalate		10		
di-n-Octyl phthalate		10		
Dibenzo(a,h)-anthracene		10	0.1	
Diethyl phthalate	10	2		
Dimethyl phthalate	10	2		
Fluoranthene	10	1	0.05	
Fluorene		10	0.1	
Hexachloro-cyclopentadiene	5	5		

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
N-Nitroso diphenyl amine	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
Pentachlorophenol	1	5		
Phenanthrene		5	0.05	
Phenol **	1	1		50
Pyrene		10	0.05	

* With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1000, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1000.

** Phenol by colorimetric technique has a factor of 1.

Table 2c – INORGANICS*	FAA	GFAA	ICP	ICPMS	SPGFAA	HYDRIDE	CVAA	COLOR	DCP
Antimony	10	5	50	0.5	5	0.5			1000
Arsenic		2	10	2	2	1		20	1000
Beryllium	20	0.5	2	0.5	1				1000
Cadmium	10	0.5	10	0.25	0.5				1000
Chromium (total)	50	2	10	0.5	1				1000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1000
Cyanide								5	
Lead	20	5	5	0.5	2				10,000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1000
Selenium		5	10	2	5	1			1000
Silver	10	1	10	0.25	2				1000
Thallium	10	2	10	1	5				1000
Zinc	20		20	1	10				1000

* The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2d - PESTICIDES – PCBs*	GC
4,4'-DDD	0.05
4,4'-DDE	0.05
4,4'-DDT	0.01
a-Endosulfan	0.02
a-Hexachloro-cyclohexane	0.01
Aldrin	0.005
b-Endosulfan	0.01
b-Hexachloro-cyclohexane	0.005
Chlordane	0.1
d-Hexachloro-cyclohexane	0.005
Dieldrin	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
Lindane(g-Hexachloro-cyclohexane)	0.02
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

* The normal method-specific factor for these substances is 100, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

Techniques:

GC - Gas Chromatography

GCMS - Gas Chromatography/Mass Spectrometry

HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)

LC - High Pressure Liquid Chromatography

FAA - Flame Atomic Absorption

GFAA - Graphite Furnace Atomic Absorption

HYDRIDE - Gaseous Hydride Atomic Absorption

CVAA - Cold Vapor Atomic Absorption

ICP - Inductively Coupled Plasma

ICPMS - Inductively Coupled Plasma/Mass Spectrometry

SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)

DCP - Direct Current Plasma

COLOR - Colorimetric

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

GENERAL PROVISIONS
FOR MONITORING AND REPORTING

ATTACHMENT B

1. SAMPLING AND ANALYSIS

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes, EPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Regional Board. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The method used shall also be reported. If methods other than USEPA approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Regional Board prior to use.
- d. The Discharger shall establish chain-of-custody procedures to ensure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall ensure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book described in 2.b, below.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

2. OPERATIONAL REQUIREMENTS

a. Sample Results

Pursuant to California Water Code Section 13267(b), the Discharger shall maintain all sampling and analytical results including: strip charts; date, exact place, and time of sampling; date analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be obtained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.

b. Operational Log

Pursuant to California Water Code Section 13267(b), an operation and maintenance log shall be maintained at the facility. All monitoring and reporting data shall be recorded in a permanent log book.

3. REPORTING

- a. For every item where the requirements are not met, the Discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.
- b. Pursuant to California Water Code Section 13267(b), all sampling shall be made available to the Regional Board upon request. Results shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.
- c. The Discharger shall provide a brief summary of any operational problems and maintenance activities to the Regional Board with each monitoring report. Any modifications or additions to, or any major maintenance conducted on, or any major problems occurring to the wastewater conveyance system, treatment facilities, or disposal facilities shall be included in this summary.
- d. Monitoring reports shall be signed by:
 - i. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
 - ii. In the case of a partnership, by a general partner;

- iii. In the case of a sole proprietorship, by the proprietor;
 - iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
- i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number.
- f. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Under Section 13268 of the Water Code, any person failing or refusing to furnish technical or monitoring reports or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation under Section 13268 of the Water Code.