

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 92-017

WASTE DISCHARGE REQUIREMENTS
FOR
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Armona Community Services District (hereafter Discharger) submitted a complete Report of Waste Discharge, a technical report, and a wastewater management plan dated 2 April 1991, for a design average daily dry weather flow of 0.4 million gallons per day (mgd). The Discharger submitted complete plans and specifications for the Wastewater Treatment Facility (WWTF) on 13 September 1991. Construction of facilities began on 27 November 1991. The property on which the wastewater treatment facility (WWTF) and disposal areas (about 22 acres) are located is owned by the Discharger. The WWTF and disposal areas are south of the intersection of Oak and Hume Avenues in Armona, immediately south of Mussel Slough.
2. The Board, on 30 May 1986, adopted Order No. 86-107 which prescribes requirements for the discharge of 0.35 mgd of domestic wastewater. The treatment facility included a Parshall flume, a comminutor, an Imhoff tank, an aeration pond, and three evaporation-percolation ponds in series. Disposal was accomplished by irrigation of about 60 acres of silage corn and walnuts owned by Mr. Robert Bassett until 27 December 1990, when the wastewater reclamation contract between the Discharger and Mr. Bassett expired. In January 1991, the Discharger purchased 54 acres of farmland adjacent to the WWTF for reclamation and storage of wastewater.
3. The Discharger presently discharges approximately 0.27 mgd of domestic wastewater. The hydraulic capacity of the existing facility appear to be marginal at current flows. The Parshall flume has been inoperative for several years and treatment by the Imhoff tank has been subnormal.
4. The proposed project includes installment of new headworks complete with two bar racks, a grinder, a Parshall flume, a grit collector, and three centrifugal pumps; reconstruction of the existing aeration pond into four aeration ponds in series; installment of two additional 5 horsepower aerators into the existing aerated pond; conversion of one of the existing evaporation-percolation ponds to an aerated pond by installing three 5 horsepower aerators; conversion of the two remaining ponds to stabilization ponds; and construction of two additional evaporation-percolation ponds covering about 25.5 acres. Effluent will be reclaimed by surface irrigation of plum and peach trees on 20 acres of farmland owned by the Discharger. According to the wastewater

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-2-

- management plan, the Discharger cannot reclaim the wastewater on the entire 54 acres because the volume of wastewater produced exceeds the crop water demand.
5. The WWTF and the reclamation areas are in Section 4, T19S, R21E, MDB&M, with surface water drainage to Mussel Slough (a Valley Floor Water), as shown in Attachment A, which is attached hereto and made part of this Order by reference. The site lies within the Hanford-Lemoore Hydrologic Area (No. 551.90), as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.
 6. The Board adopted a Water Quality Control Plan for the Tulare Lake Basin (5D), (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
 7. The Basin Plan identifies beneficial uses of Valley Floor Waters as industrial and agricultural supply; recreation; aesthetic enjoyment; ground water recharge; and preservation and enhancement of fish, wildlife, and other aquatic resources.
 8. The beneficial uses of the ground water underlying this area are municipal, agricultural, and industrial supply. Ground water is about 19 to 22 feet below ground surface and flows southeasterly. Local quality of this aquifer is good (EC about 500 umhos/cm).
 9. The Basin Plan encourages reclamation. The Discharger investigated other reclamation opportunities to eliminate land disposal. No other feasible alternative for reclaiming wastewater is presently available.
 10. Digested sludge is dried and piled on-site. Dried sludge has been disposed of on-site as a soil amendment.
 11. Soils in the area consist of sandy silts underlain by silty sands with moderate to high permeability.
 12. The discharge for reclamation purposes is subject to reclamation criteria contained in Chapter 3, Division 4, Title 22, California Code of Regulations (CCR), hereafter Title 22.
 13. The Kings County Planning Commission adopted a Negative Declaration on 6 December 1990, in accordance with Section 15074 of the California Environmental Quality Act (Public Resource Code, Section 21000, et seq.), and State CEQA Guidelines. The project as approved will not have a significant effect on water quality.

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-3-

14. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
15. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 86-107 is rescinded and Armona Community Services District, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following at the above-described facility:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15 (Title 23, CCR, Section 2510, et seq.), is prohibited.

B. Discharge Specifications:

1. Subject to satisfaction of Provision E.15, the monthly average daily dry weather discharge flow shall not exceed 0.4 mgd.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. B.2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment and disposal facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. The effluent from the treatment ponds shall not contain constituents in excess of the following:

WASTE DISCHARGE REQUIREMENTS
 ARMONA COMMUNITY SERVICES DISTRICT
 WASTEWATER TREATMENT FACILITY
 KINGS COUNTY

-4-

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	40	80
Settleable Solids	ml/l	0.2	0.5

¹ Five-day, 20° Celsius biochemical oxygen demand.

6. The Discharge shall not have a pH less than 6.5 or greater than 9.5.
7. The maximum specific electrical conductivity (EC) of the discharge shall not exceed the average EC of the source water plus 500 μ mhos/cm, or a maximum of 1,000 μ mhos/cm, whichever is less.
8. Areas irrigated with reclaimed water shall be managed so as to prevent the breeding of mosquitos. More specifically:
 - a. Tail water must be returned and all irrigation water must infiltrate completely within a 48-hr period.
 - b. Ditches must be maintained free of emergent, marginal, and floating vegetation.
 - c. Low-pressure and unpressurized pipelines and ditches accessible to mosquitoes shall not be used to store reclaimed waters.
9. Ponds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
10. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
11. The evaporation-percolation ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-5-

on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than 1.5 feet (measured vertically).

12. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification B.11 above.
13. Storm water runoff from the irrigation fields shall not be discharged to any surface water drainage course within 30 days of the last wastewater application.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer at least 60 days in advance of the change.
3. Use and disposal of sewage sludge shall comply with existing federal and state laws and regulations, and with Clean Water Act (CWA) Section 405(d) technical standards when promulgated. If an applicable management practice or numerical limitation for pollutants in sewage sludge is promulgated under Section 405(d) of the CWA that is more stringent than the sludge pollutant limit or management practice specified in existing federal or state laws or regulations, the Discharger shall comply no later than the compliance deadline specified in the applicable regulations.

D. GROUND WATER LIMITATIONS

The Discharge, in combination with other sources, shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than receiving water limits, where specified below, or background water quality where not specified. (For purposes of comparison, background water quality shall be determined when background monitoring provides sufficient data. Quality determined in this manner establishes "water quality protection standards.")
2. Exceed an annual average incremental increase in specific electrical conductivity greater than 3 umhos/cm, based on the most recent five-year period.

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-6-

3. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in Title 22, CCR, Division 4, Chapter 15.
4. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
5. Exceed concentrations of radionuclides specified in Title 22, CCR, Division 4, Chapter 15.
6. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
7. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with the attached Monitoring and Reporting Program No. 92-017, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. The Discharger shall comply with the following time schedule to assure compliance with the specifications and provisions of this Order:

<u>Task</u>	<u>Compliance Date</u>
a. Complete construction	15 Aug 1992
b. Full compliance	30 Sep 1992

5. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-7-

off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.

6. Reclaimed wastewater shall meet the criteria contained in Title 22 and, if used in construction, the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes" published by the State Department of Health Services. Other uses for reclaimed water shall be subject to the approval of the Executive Officer and shall comply with Title 22.
7. The Discharger shall use the best practicable cost-effective control technique currently available to comply with salinity limits specified in this Order.
8. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
9. In addition to modification of this Order under circumstances described in Standard Provision A.3, this Order may be modified if sludge use or disposal practices change, if applicable management practices or numerical limitations for pollutants in sewage sludge necessitate it, if there is endangerment to human health or the environment, or if the Board elects to review and revise the Order on its own motion.
10. The Discharger shall submit a technical report at least 120 days in advance of any wastewater discharges by a categorical industrial user or other industrial user that has a potential to cause the Discharger to violate this Order. At a minimum, the technical report shall provide information on the character of the wastewater, the quality and quantity of the industrial wastewater introduced into the sewerage system, the anticipated impact of the change on the quantity or quality of effluent to be discharged from the sewerage system, and demonstrate that the effluent will be in compliance with the toxic and pretreatment effluent standards established pursuant to Sections 208(b), 301, 302, 304, and 307 of the Clean Water Act (CWA).
11. The Discharger shall implement, as more completely set forth in 40 CFR 403.5, the necessary legal authorities, programs, and controls to ensure that the following incompatible wastes are not introduced to the treatment system, where incompatible wastes are:

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-8-

- a. Wastes which create a fire or explosion hazard in the treatment works;
 - b. Wastes which will cause corrosive structural damage to treatment works, but in no case wastes with a pH lower than 5.0, unless the works is specially designed to accommodate such wastes;
 - c. Solid or viscous wastes in amounts which cause obstruction to flow in sewers, or which cause other interference with proper operation or treatment works;
 - d. Any waste, including oxygen demanding pollutants (BOD, etc.), released in such volume or strength as to cause inhibition or disruption in the treatment works, and subsequent treatment process upset and loss of treatment efficiency;
 - e. Heat in amounts that inhibit or disrupt biological activity in the treatment works, or that raise influent temperatures above 40°C (104°F), unless the treatment works is designed to accommodate such heat;
 - f. Petroleum oil, nonbiodegradable cutting oil, or products of mineral oil origin in amounts that will cause interference or pass through;
 - g. Pollutants which result in the presence of toxic gases, vapors, or fumes within the treatment works in a quantity that may cause acute worker health and safety problems; and
 - h. Any trucked or hauled pollutants, except at points predesignated by the Discharger.
12. The Discharger shall implement, as more completely set forth in 40 CFR 403.5, the legal authorities, programs, and controls necessary to ensure that indirect discharges do not introduce pollutants into the sewerage system that, either alone or in conjunction with a discharge or discharges from other sources:
- a. Flow through the system in quantities or concentrations that cause a violation of this Order, or
 - b. Inhibit or disrupt treatment processes, treatment system operations, or sludge processes, use, or disposal and either cause a violation of this Order or prevent sludge use or disposal in accord with this Order.

WASTE DISCHARGE REQUIREMENTS
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-9-

13. By 15 July 1992, the Discharger shall submit evidence sufficient to demonstrate to the satisfaction of the Executive Officer that it has complied fully with Provisions E.11 and E.12, above.
14. Prior to 15 September 1992, the Discharger shall submit the technical reports described in Standard Provision B.2 and a copy of the operation and maintenance manual for the facility.
15. Until the capacity of the inflow pump station is expanded to accommodate at least 0.4 mgd average flow, allowable flow is limited to an average dry weather flow of 0.30 mgd. This condition shall be satisfied when a registered civil engineer certifies in writing to the Board that the complete headworks has the capacity necessary to accommodate the specified dry weather flow and associated daily peak and wet weather flows.
16. The Discharger must comply with all conditions of this Order. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in modification or revocation of this Order.
17. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 24 January 1992.


WILLIAM H. CROOKS, Executive Officer

RA:cjs:1/24/92

Enclosures

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 92-017

FOR
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

EFFLUENT MONITORING

Effluent samples shall be collected just prior to discharge to the evaporation-percolation pond. Effluent samples should be representative of the volume and nature of the discharge. Samples collected from the outlet structure of treatment ponds will be considered adequately composited. Time of collection of a grab sample shall be recorded. Effluent monitoring shall include the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency¹</u>
Flow	mgd	Measured	Daily
pH	pH Units	Grab	Daily
Settleable Matter	ml/l	Grab	Daily
Specific Conductivity	umhos/cm	Grab	Weekly
Dissolved Oxygen ²	mg/l	Grab	Weekly
BOD ₅ ³	mg/l	Grab	Weekly

¹ If results of monitoring a pollutant appear to violate effluent limitations, but monitoring frequency is not sufficient to validate violation (e.g., the monthly mean for BOD), or indicate a violation and potential upset of the treatment process (e.g., less than minimum D.O.), the frequency of sampling shall be increased to confirm the magnitude and duration of violation, if any, and aid in identification and resolution of the problem.

² Samples shall be collected at a depth of one foot from each pond, opposite the inlet, and analyzed for dissolved oxygen. Samples shall be collected between 0800 and 0900 hours.

³ Five-day, 20° Celsius biochemical oxygen demand.

MONITORING AND REPORTING PROGRAM
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-2-

WATER SUPPLY MONITORING

A sampling station shall be established at each supply well where representative samples of the water supply can be obtained. Water supply monitoring shall include the following:

<u>Constituents</u> ¹	<u>Units</u>	<u>Sampling Frequency</u>
Specific Conductivity	umhos/cm	Quarterly

¹ Since the source water is from more than one well, constituents shall be reported as a weighted average (include copies of supporting calculations).

GROUND WATER MONITORING

By 1 April 1992, the Discharger shall submit a work plan for a ground water monitoring network consisting of one or more background monitoring wells and three or more downgradient wells. All well locations and construction features are subject to the prior approval of the Executive Officer and must be sufficient to monitor potential impacts of the disposal operation on the uppermost ground water aquifer. By 1 April 1993, the Discharger shall implement the approved monitoring network.

Samples shall be taken monthly from approved background monitoring well(s) for one year and analyzed for the parameters specified below. Data from these analyses shall be reported to the Board by 20 May 1994 for use in determining water quality protection standards.

If subsequent sampling of background monitoring wells indicates significant water quality changes due to either seasonal fluctuations or other reasons unrelated to waste disposal activities, the Discharger may request modification of the water quality protection standards.

The downgradient wells shall constitute "points of compliance (POC)". In conjunction with background monitoring, monitoring of POC's will enable one to determine the areal and vertical extent of noncompliance with water quality protection standards. **The ground water surface elevation (in feet and hundredths, M.S.L.) in all wells shall be measured on a quarterly basis and used to determine the gradient and direction of ground water flow.** This information shall be displayed on a water flow net diagram for the site. Water samples shall be collected from wells in the approved monitoring network and analyzed as follows:

MONITORING AND REPORTING PROGRAM
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-3-

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Specific Electrical Conductance @ 25° C.	umhos/cm	Grab	Quarterly
pH	pH units	Grab	Quarterly
Standard Minerals ^{1/}	mg/l	Grab	Quarterly

^{1/} Standard mineral analyses shall include calcium, carbonate, chloride, iron, magnesium, nitrate, potassium, sodium, sulfate, and total dissolved solids.

Following each sampling event, the discharger shall determine whether there is statistically significant increase over water quality protection standards for each parameter and constituent analyzed. If the Discharger or the Board finds there is a statistically significant increase in indicator parameters or waste constituents over the water quality protection standards at the POC's, the Discharger shall notify the Board, or acknowledge the Board's findings, and submit, within 90 days, either a technical report with a plan and time schedule for implementing a verification monitoring program or a report demonstrating water quality protection standards were not exceeded. The verification Monitoring Program must be designed to verify that water quality protection standards have been exceeded and the horizontal and vertical extent of the impact.


If the Discharger, through the verification monitoring program, or the Board verifies that water quality protection standards have been exceeded at or beyond the POC's, the Discharger shall notify the Board, or acknowledge the Board's findings, and submit a technical report within 90 days. The report must contain a plan and time schedule for implementing a corrective action program designed to achieve compliance with water quality protection standards.

SLUDGE MONITORING

A composite sample of sludge shall be collected annually in accordance with EPA's *POTW Sludge Sampling and Analysis Guidance Document*, August 1989, and tested for the following metals:

Cadmium	Copper	Nickel
Chromium	Lead	Zinc

Analytical results shall be submitted to the Executive Officer. Analysis of soluble concentrations of these specific metals shall also be included as

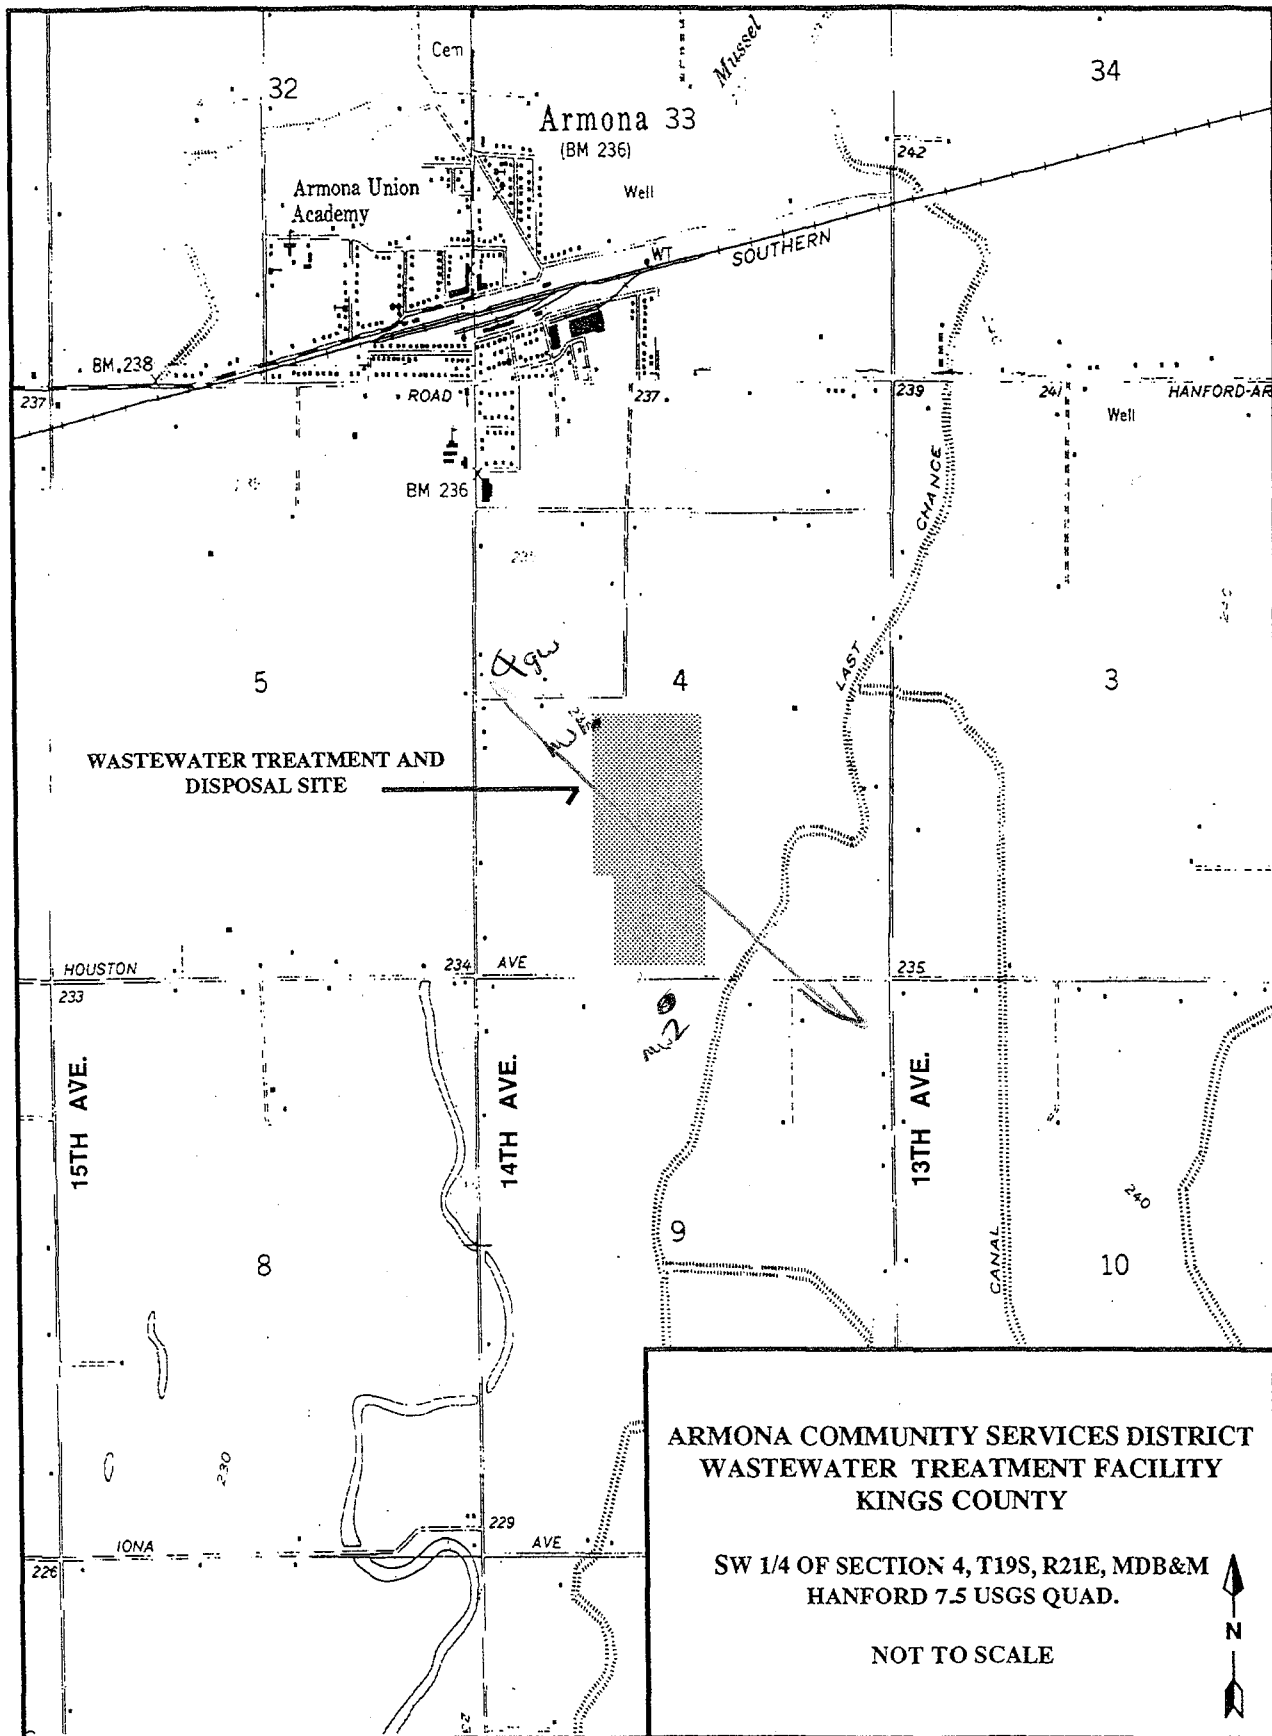

INFORMATION SHEET

ARMONA COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT FACILITY KINGS COUNTY

The Armona Community Services District (hereafter Discharger) owns and operates a wastewater treatment facility (WWTF) southeast of Armona in an agricultural area immediately south of Mussel Slough. The WWTF is presently regulated by Waste Discharge Requirements (WDRs) Order No. 86-107.

The existing treatment plant consists of a Parshall flume, a comminutor, an Imhoff tank, an aeration pond, and three evaporation-percolation ponds in series. The facility currently discharges about 0.27 mgd, which appears to be the hydraulic capacity of the existing facility. The Parshall flume has been inoperative for several years and the Imhoff tank clarifier is severely overloaded. Effluent settleable solids exceeded the 30-day average limit for about five months in 1990.

The WWTF was initially designed to treat 0.35 mgd. About 60 acres of silage corn and walnuts owned by Mr. Robert Bassett were irrigated with effluent until December 1990, when the contract between the Discharger and Mr. Bassett expired. Mr. Bassett's operation was regulated by Wastewater Reclamation Requirements Order No. 82-057.

The Discharger's Report of Waste Discharge included a geotechnical investigation and technical report proposing to expand the capacity of the existing WWTF to 0.4 mgd. The expansion project includes abandonment of the existing headworks and Imhoff tank, and reconstruction of the existing evaporation/percolation ponds into one aeration and two stabilization ponds. In January 1991, the District purchased 54 acres of farmland adjacent to the WWTF for wastewater reclamation and storage. Roughly 20 acres of this land will be used for reclamation by surface irrigation of peach and plum trees and the remaining land will be used to construct two additional evaporation-percolation ponds.

Subsurface soils in the area of the proposed evaporation and percolation ponds consist of sandy silts to depths ranging from about 5 to 7 feet below ground surface (bgs), underlain by silty sands to depths ranging from 9 to 10 feet bgs. The underlying soils have a moderate to high permeability. The depth to unconfined ground water is about 22 feet bgs. Ground water moves southeasterly and its quality is good.

Average annual rainfall in the area is about 6 inches and the average annual evaporation is about 60 inches.

The Kings County Planning Commission has adopted a Negative Declaration, in accordance with Section 15074 of the California Environmental Quality Act (Public Resource Code, Section 21000, et seq.), and CEQA Guidelines. The project as approved will not have a significant effect on water quality.

RA:cjs

MONITORING AND REPORTING PROGRAM
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-5-


The Discharger may also be requested to submit an annual report to the Board with tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

By 31 January of each year, the Discharger shall submit a written report to the Executive Officer containing the following:

- a. The names, titles, certificate grade and general responsibilities of persons operating and maintaining the wastewater treatment plant (Standard Provision E.1).
- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
- c. A certified statement of when the flow meter and other monitoring instruments and devices were last calibrated, including identification of who did the calibration (Standard Provision C.4).
- d. A statement whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last reviewed for adequacy.
- e. The total quantity of sludge disposed of during the previous year and ultimate disposal site(s).

All reports submitted in response to this Order shall comply with the signatory requirements in Standard Provision B.3.

The Discharger shall implement this monitoring program on the first day of the month following adoption of this Order.



WILLIAM H. CROOKS, Executive Officer

24 January 1992
(Date)

RA:cjs:1/24/92

MONITORING AND REPORTING PROGRAM
ARMONA COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
KINGS COUNTY

-4-

needed. If final sludge disposal is proposed to go to land, a technical report analyzing application rates and procedures relative to DHS's *Manual of Good Practices for Landspreading of Sewage Sludge*, EPA's *Process Design Manual for Land Application of Municipal Sludges*, and Title 23, CCR, Section 2511(f), shall be completed and submitted to the Executive Officer for approval.

POND MONITORING

The freeboard shall be monitored on the evaporation/percolation ponds in use to the nearest tenth foot. Pond water monitoring shall include the following:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Frequency</u>
Freeboard	feet	Observation	Weekly

By 15 August 1992, permanent markers shall be placed in the pond with calibrations indicating the water level at design capacity and available operational freeboard.

In addition, the Discharger shall inspect the condition of the ponds once per week and write visual observations in a bound log book. Notations shall include observations of whether weeds are developing in the water or along the bank, and their location; whether dead algae, vegetation, scum, or debris are accumulating on the pond surface and their location; whether burrowing animals or insects are present; and the color of the pond (e.g., dark sparkling green, dull green, yellow, grey, tan, brown, etc.). A copy of the entries made in the log during each month shall be submitted along with the monitoring report the following month. Where the O&M manual indicates remedial action is necessary, the Discharger shall briefly explain in the transmittal what action has been taken or is scheduled to be taken.

REPORTING

Monthly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in a manner that illustrates clearly whether the Discharger complies with waste discharge requirements, including calculation of all averages, etc.

If the Discharger monitors any pollutant at the locations designated herein more frequently than is required by this Order, the results of such monitoring shall be included in the discharge monitoring report.