

Central Coast Regional Water Quality Control Board

December 22, 2023

Sent Via Electronic Mail

David Morisoli
Little Bear Water Company, Inc.
Little Bear Water Company Wastewater Treatment Plant
51201 Pine Canyon Road
King City, CA 93930
Email: dmorisoli@hotmail.com

Dear David Morisoli,

**LITTLE BEAR WATER COMPANY, INC. WASTEWATER TREATMENT PLANT,
ROYAL DRIVE, ROYAL ESTATES PARK, KING CITY, CA 93930, MONTEREY
COUNTY - TRANSMITTAL OF REVISED MONITORING AND REPORTING
PROGRAM R3-2023-0072**

Please find attached **Revised** Monitoring and Reporting Program R3-2023-0072. On September 28, 2023, the Central Coast Regional Water Quality Control Board (Central Coast Water Board) enrolled Little Bear Water Company, Inc. (Little Bear) into an updated wastewater permit *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit) and an associated Monitoring and Reporting Program No. R3-2023-0072. The monitoring and reporting program contained an error, it excluded groundwater monitoring; therefore, the program is hereby revised to include *Section 9, Groundwater Monitoring*. Groundwater monitoring is required to evaluate the impacts from the wastewater discharge on underlying, first-encountered groundwater.

This revised monitoring and reporting program is effective April 1, 2024. Little Bear must comply with the previous monitoring and reporting program until March 31, 2024.

If you have any questions, please contact **Kristina Olmos at (805) 549-3293 or by email at Kristina.Olmos@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Ryan E. Lodge
Executive Officer

Attachment: Revised Monitoring and Reporting Program No. R3-2023-0072

cc:

Miles Farmer, Cypress Water Services, miles@cypresswaterservices.com

Nicole Fowler, Monterey County, nfowler@co.monterey.ca.us

Roger VanHorn, Monterey County, vanhornrw@co.monterey.ca.us

Kristina Olmos, Kristina.Olmos@Waterboards.ca.gov

Kathy Truong, Kathy.Truong@Waterboards.ca.gov

Jesse Woodard, Jesse.Woodard@waterboards.ca.gov

Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-237149

GeoTracker No. = GT- WDR100030866

Subject Name = Little Bear Revised Monitoring and Reporting Program

\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\monterey co\little
bear\1_permit\current\dec2023_revised_mrp_littlebear.docx

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM NO. R3-2023-0072

REVISED DECEMBER 22, 2023

FOR

**LITTLE BEAR WATER COMPANY WASTEWATER TREATMENT PLANT
MONTEREY COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for Little Bear Water Company, Inc.'s (Little Bear's) Wastewater Treatment Plant (WWTP) located at Royal Drive, in King City, California.

Little Bear owns and operates the wastewater system that is subject to the notice of applicability dated September 28, 2023 for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- A. The user is trained in proper use and maintenance of the instruments;

- B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- D. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Little Bear may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Little Bear must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Little Bear must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS


Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent – 1	IS-1	Grab sample from Pond 1 ^[1]
Effluent – 1	ES-1	Tap at the booster pumps located at Pond 3 polishing pond
Effluent – 2	ES-2	Tap below Sprayfield Pond after the filter
Effluent – 3	ES-3	Tap at junctions/valves for lower spray field areas
Effluent – 4	ES-4 ^[2]	Grab sample from Pond 2
Monitoring Well - 1	MW-1	Monitoring well at base of sprayfield parcel near entrance gate, formerly called Site A
Monitoring Well - 2	MW-2	Monitoring well between sprayfield parcel and Pine Canyon Creek Rd, formerly called Site B
Monitoring Well - 3	MW-3	Residential well at 54120 Pine Canyon Road, formerly called Site C
Monitoring Well - 4	MW-4	Residential well at 52045 Pine Canyon Road, formerly called Site D
Monitoring Well - 5	MW-5	Monitoring well off Pettit Road, formerly called Site E

^[1] This existing influent sample may not be representative of influent because treatment begins to occur in Pond 1. To demonstrate the permit requirement of total nitrogen 50% reduction between influent and effluent, Little Bear may propose an alternative influent sampling point with Central Coast Water Board approval.

^[2] ES-4 added during the 2023 General Permit enrollment and monitoring and reporting program revisions.

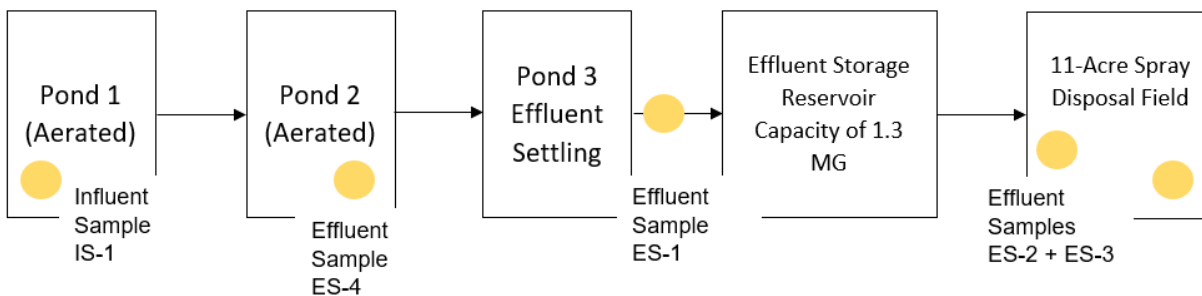

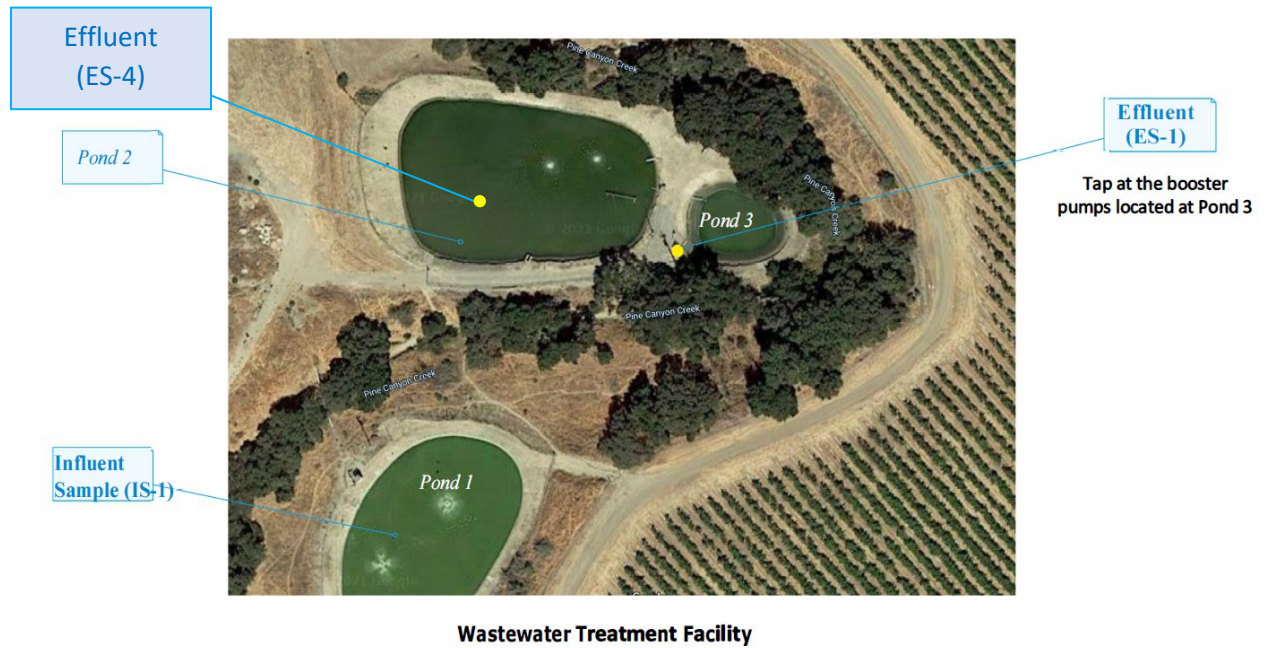


Figure 1. Process Flow Diagram with Sampling Locations

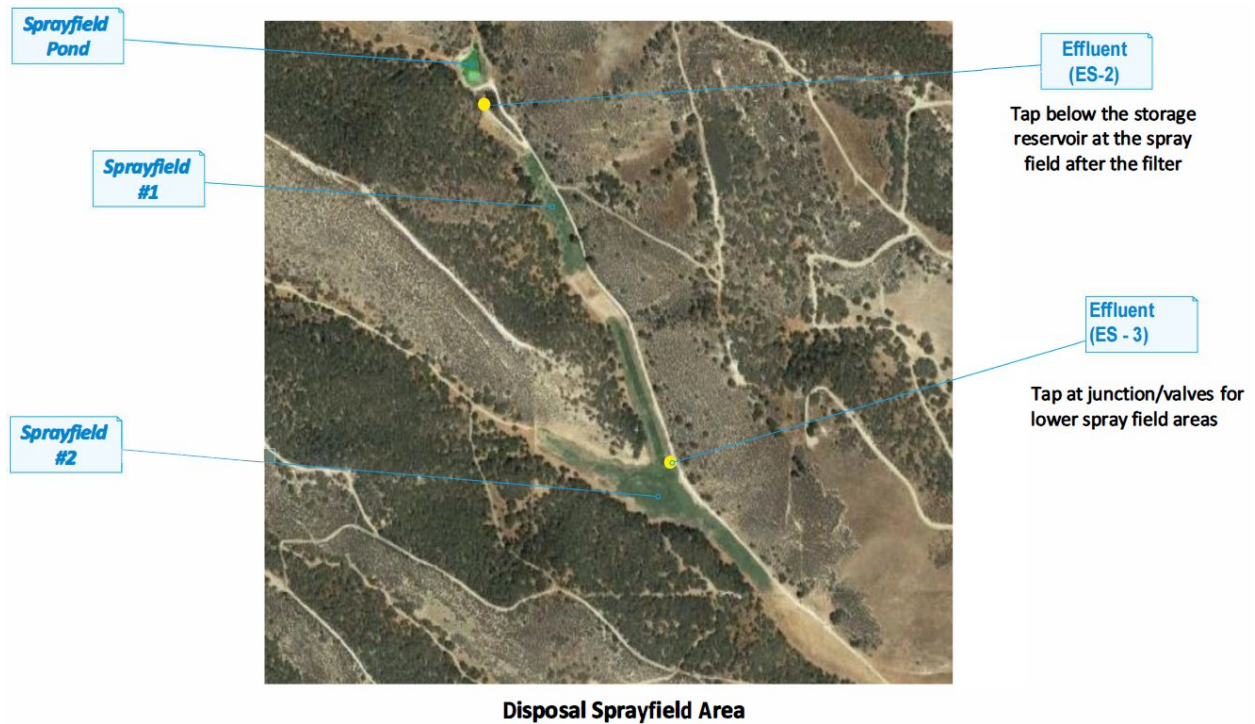


Figure 2. Little Bear Facility Maps with Sampling Locations

4. INFLUENT AND EFFLUENT TREATMENT UNIT MONITORING

A. Flow Monitoring

Little Bear must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored in the influent line as wastewater enters Pond 1.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

B. Influent and Effluent Constituent Monitoring

Representative samples of Little Bear WWTP's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 5. Influent and Effluent Constituent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Pond 1	EFFLUENT (ES-1) After Pond 3	EFFLUENT (ES-2 or ES-3) ¹ Sprayfield Area	EFFLUENT (ES-4) Pond 2
		Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency
Settleable Solids	mL/L	Weekly	Weekly	Not Required	Not Required
pH	pH units	Quarterly	Quarterly	Quarterly	Quarterly
Biochemical Oxygen Demand,	mg/L	Quarterly	Quarterly	Quarterly	Quarterly
Total Suspended Solids (TSS)	mg/L	Quarterly	Quarterly	Not Required	Not Required
Total Nitrogen (as N) ²	mg/L	Quarterly	Quarterly	Quarterly	Quarterly
Nitrate + Nitrite (as N) ³	mg/L	Quarterly	Quarterly	Quarterly	Quarterly

Parameter/ Constituent	Units	INFLUENT (IS-1) Pond 1	EFFLUENT (ES-1) After Pond 3	EFFLUENT (ES-2 or ES-3)¹ Sprayfield Area	EFFLUENT (ES-4) Pond 2
		Sampling Frequency	Sampling Frequency	Sampling Frequency	Sampling Frequency
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semiannually	Not Required	Not Required
Chloride	mg/L	Not Required	Semiannually	Not Required	Not Required
Sodium	mg/L	Not Required	Semiannually	Not Required	Not Required
Sulfate	mg/L	Not Required	Semiannually	Not Required	Not Required
Boron	mg/L	Not Required	Semiannually	Not Required	Not Required
Carbonate	mg/L	Not Required	Annually	Not Required	Not Required
Bicarbonate	mg/L	Not Required	Annually	Not Required	Not Required
Calcium	mg/L	Not Required	Annually	Not Required	Not Required
Magnesium	mg/L	Not Required	Annually	Not Required	Not Required
Potassium	mg/L	Not Required	Annually	Not Required	Not Required
Metals ⁴	mg/L	Not Required	Annually	Not Required	Not Required
Chromium VI	mg/L	Not Required	Annually	Not Required	Not Required

mg/l = milligram per liter

[1] Little Bear must sample one of the sprayfield locations where a majority of the flow is discharged to, per quarter. All reports must specify if the sample was taken at ES-2 or ES-3.

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[3] Nitrate and nitrite sample may be combined.

[4] California Code of Regulations (CAM 17) Metals (dissolved) including: Antimony (Sb), Arsenic (As), Barium (Ba), Beryllium (Be), Cadmium (Cd), Chromium (Cr), Cobalt (Co), Copper (Cu), Lead (Pb), Mercury (Hg), Molybdenum (Mo), Nickel (Ni), Selenium (Se), Silver (Ag), Thallium (Tl), Vanadium (V) and Zinc (Zn).

5. POND SYSTEM MONITORING

All wastewater treatment and storage ponds (Pond 1, Pond 2, Pond 3, and the Sprayfield Pond)) must be monitored as specified in Table 6. Grab samples must be collected at 1 foot below surface water depth. If additional pond sampling is required by Monterey County Health Department, Little Bear must submit that data with their annual reports.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 6. Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	pH Units	Grab ^[3]	Weekly
Dissolved Oxygen	mg/L	Grab ^[3]	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Odors	Not Applicable	Observation	Monthly
Color	Not Applicable	Observation	Monthly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly
Berm condition	Not Applicable	Observation	Monthly
Precipitation	inches/day and date	Measured ^[1]	Each precipitation event ^[2]

[1] Little Bear may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

[2] A precipitation event is one producing precipitation of ½ inch or more.

[3] Grab samples must be collected at 1 foot below surface water depth.

6. DISPOSAL AREA INSPECTIONS

Little Bear must inspect all items in Table 7 at least weekly and after rain events. All pump controllers and automatic distribution valves must be inspected for proper operation as recommended by the manufacturer. Shallow-rooted plants are generally

desirable, deep-rooted plants such as trees must be removed as necessary. Evidence of animals burrowing must be immediately investigated, and burrowing animal populations controlled as necessary. Disposal areas must be inspected to ensure they are allowing wastewater to infiltrate as designed, there is no surfacing, and soils are not saturated.

Table 7. Disposal Area Monitoring

Parameter	Inspection Frequency	Reporting Frequency
Pump controllers, automatic valves, etc.	Weekly	Quarterly
Nuisance Odor Condition	Weekly	Quarterly
Saturated Soil Condition	Weekly	Quarterly
Plant Growth	Weekly	Quarterly
Vectors or Animals Burrowing	Weekly	Quarterly
Sprayfield Condition	Weekly	Quarterly

A log of these inspections must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded. Little Bear must submit a summary of violations found during the inspections with each subsequent monitoring report, or a note that there were no violations.

7. SOLIDS DISPOSAL MONITORING

Little Bear must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Sludge removal must be in accordance with an Operations and Maintenance Plan. If solids are not removed during the year, Little Bear must explain the absence of this monitoring in the annual report.

8. COLLECTION SYSTEM MAINTENANCE

Little Bear must submit records of any maintenance performed on the sewer collection system within the past year.

9. GROUNDWATER MONITORING

Representative samples from all monitoring wells (MW-1 to MW-5) must be collected and analyzed as described in Table 8. Little Bear must measure depth to groundwater

(to 0.1 feet accuracy) in each monitoring well before it is purged and sampled. Little Bear must record and submit field sheets documenting purge methods. Before sampling, Little Bear must purge three well volumes from each well, or purge until measurements of temperature, pH, specific conductance, turbidity, and dissolved oxygen have stabilized. Little Bear must collect groundwater samples from each well after the groundwater levels in the well have recovered sufficiently to ensure collection of representative groundwater samples.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[1]	0.01 feet	Calculated	Quarterly
Depth to Groundwater	0.01 feet	Measured	Quarterly
Nitrate (as N) + Nitrite (as N)	mg/L	Grab	Quarterly
Total Dissolved Solids	mg/L	Grab	Semiannually
Sodium	mg/L	Grab	Semiannually
Chloride	mg/L	Grab	Semiannually
Boron	mg/L	Grab	Semiannually
Sulfate	mg/L	Grab	Semiannually
pH	units	Metered	Quarterly
Dissolved Oxygen	mg/L	Metered	Quarterly
Electrical Conductivity	µS/cm ^[3]	Metered	Quarterly
Temperature	Degrees Celsius	Metered	Quarterly
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Fecal Coliform Organisms ^[2]	MPN ^[4] /100 mL	Grab	Every two years

^[1] Groundwater elevation must be based on depth to water using a surveyed measuring point elevation on the well and a surveyed reference elevation.

^[2] Using a minimum of 15 tubes or three dilutions

^[3] $\mu\text{S}/\text{cm}$ = microsiemens per centimeter

^[4] MPN = most probable number

10. REPORTING REQUIREMENTS

The quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

A. Quarterly Reporting – At a minimum, the quarterly reports must include:

1. Results of all required monitoring in tabular format.
2. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
3. A comparison of monitoring data to the discharge specifications and applicable effluent limitations. Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.
4. Copies of laboratory analytical report(s) and chain of custody form(s).
5. Copies of groundwater monitoring well field sheets with purge methods and logs.

B. Annual Reporting – At a minimum, the annual reports must include:

1. **Facility Information and Description:** A description of Little Bear's facility, treatment process, and disposal process with reference to figures.
2. **Data Tables and Graphs:** Tabular and graphical summaries of all monitoring data (water supply, influent, effluent, etc.) collected during the reporting year. Compare influent and effluent concentrations over time for the main constituents, along with effluent limitations and/or design criteria, as appropriate.
3. **Flow Evaluation (wastewater treatment system capacity):** A summary, in tabular and graphical format, of the maximum (peak) and mean daily flows for each month and note the maximum permitted flow, in gallons per day.
4. **Pond Monitoring:** A summary of required pond monitoring data/information collected during the reporting year (dissolved oxygen and pH).
5. **Solids Disposal/Management:** A tabular summary of required solids disposal monitoring data/information collected during the reporting year.
6. **Compliance and Performance Discussion:**
 - a) A discussion of compliance and any corrective action(s) taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the General Permit.
 - b) An evaluation of the treatment plant performance, including percent removal of the main constituents (BOD, TSS, total nitrogen) over time, nuisance conditions, system problems, etc.
 - c) A summary of any changes or upgrades that were made over the past year (or need to be made) to the wastewater treatment system (including treatment and disposal) to improve performance.
7. **Operator Certification:**
 - a) The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.
 - b) A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.
 - c) A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.
 - d) If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.
8. **Operation and Maintenance Manual:** The date the Operation and Maintenance Manual was last revised, and whether the manual is complete for the current operations.

9. **Data Gaps:** A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.
10. **Figures:** A wastewater treatment system process flow diagram with a label for the monitoring locations and a scaled facility map with treatment components, discharge locations, monitoring locations, groundwater wells, storage locations (e.g. chemical, sludge, emergency overflow ponds, etc.), buildings, etc.

11. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Little Bear must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR1000030866** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 10 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 10. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water quality samples collected from the lab, field monitoring not required.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the Geo_XY for surveyed monitoring wells, and input the non-surveyed sampling locations.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.

12. TECHNICAL REPORTS

A. Technical Reports

Little Bear must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 11. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

B. Pond Liner Evaluation

In accordance with General Permit Section IV.B.1 all treatment, storage, and evaporation ponds must be lined to protect groundwater and associated beneficial uses. At this time, all three treatment ponds (Ponds 1, 2, and 3) are considered treatment **and disposal** ponds, and Little Bear must comply with effluent limits at the treatment and disposal ponds (ES-3 and ES-4 locations at Pond 2 and the Sprayfield Pond). Little Bear may submit to GeoTracker a Pond Liner Permeability Work Plan, and following Central Coast Water Board staff approval and completion of work, a Pond Liner Permeability Report. The reports must be prepared by a California licensed Professional Engineer or Professional Geologist and propose a method to evaluate pond permeability, and/or assessment of underlying groundwater quality to confirm the ponds do not leak. These are optional, and due before the Central Coast Water Board can evaluate removal of the effluent compliance locations at the treatment ponds.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	December 28, 2023
Sampling and Analysis Plan	December 28, 2023
Sludge Management Plan	December 28, 2023
Pond Liner Permeability Work Plan and Pond Liner Permeability Report	Optional, and due before Central Coast Water Board can evaluate the removal of treatment pond effluent compliance location.

13. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Little Bear submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Little Bear to enforcement action pursuant to [section 13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Little Bear is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Little Bear must implement the above monitoring program on April 1, 2024. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Little Bear must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

for Ryan E. Lodge
Executive Officer