

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 97-053

WASTE DISCHARGE REQUIREMENTS
FOR
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Le Grand Community Service District (hereafter Discharger) submitted a Report of Waste Discharge (RWD), dated 21 October 1996, and a site evaluation report, dated June 1996 in support of the modification of its wastewater treatment facility (WWTF), an increase in discharge flow, and an increase in the volume of effluent reuse. The Discharger provides sewerage service to the unincorporated community of Le Grand. The wastewater generated by Le Grand is from domestic and commercial sources. The property (Assessor's Parcel Nos. 068-120-034, -059, and -065) is owned by the Discharger.
2. Waste Discharge Requirements Order No. 87-079, adopted by the Board on 24 April 1987, prescribes requirements for a design monthly average discharge of 0.140 (million gallons per day) mgd of wastewater from an Imhoff tank followed by four evaporation/percolation ponds operated in series. Wastewater from the holding ponds is reused on 37 acres of alfalfa.
3. Order No. 87-079 is inadequate because it does not reflect the proposed volume of discharge flow or describe the modified WWTF and the increase in size of the effluent reuse area proposed by the Discharger.
4. The RWD indicates that the monthly average daily wastewater flows to the WWTF from May of 1995 through April of 1996 peaked at 0.207 mgd during August 1996, which is approximately 148% of design capacity. In addition, the RWD indicates that several of the Discharger's collection system manholes, sewer lines, and the existing WWTF lift station need to be replaced. The Discharger has observed surcharging in the sewer main and collapsed sewer collectors.
5. The Discharger proposes to modify the existing WWTF to increase its capacity to 0.35 mgd and to replace significant sections of the collection system. The existing headworks will be replaced with a mechanically cleaned bar screen and screenings press and the Imhoff tank will be abandoned. The WWTF lift station will be replaced. Existing evaporation/percolation pond Nos. 1 and 2 will be deepened to ten feet and converted to partially mixed, aerated lagoons by the addition of surface aerators. Existing pond No. 3 will be operated as a stabilization pond, but will be designed for surface aerators to allow

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-2-

for future increases in WWTF flow to 0.50 mgd. WWTF piping will be modified so that any one of pond Nos. 1-3 can be taken out of service for sludge removal or maintenance. Wastewater disposal will be accomplished by evaporation/percolation from existing pond No. 4 and by reuse on fiber, fodder, and seed crops grown in the 37 acre reuse area and on 15 acres of land immediately adjacent to the 37 acre reuse area and recently purchased by the Discharger (hereafter referred to as reuse areas). Wastewater application has been and will continue to be by flood or furrow irrigation. The northern property line of the 37-acre reuse area has a ten-foot wide berm and the southern edge of adjacent property to the north is bounded by a 24-foot wide oiled roadbed. Sludge removed from pond Nos. 1-3 may be applied on the reuse areas.

6. The WWTF is in Section 30, T8S, R16E, MDB&M, with surface water drainage by sheet flow to Deadman Creek, an indirect tributary to the San Joaquin River, as shown in Attachment A, which is attached hereto and part of this Order by reference. The site lies within the San Joaquin Valley Floor Hydrologic Unit, El Nido-Stevinson Hydrologic Area (No. 535.70), as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.
7. The RWD indicates that the effluent from pond No. 3 theoretically should have a five day Biochemical Oxygen Demand at 20°C (hereafter BOD₅) of approximately 20 mg/l.
8. The Board adopted a *Water Quality Control Plan, Third Edition, for the Sacramento River Basin and the San Joaquin River Basin* (hereafter Basin Plan), which contains water quality objectives and beneficial use designations for all waters of the Basin. These requirements implement the Basin Plan.
9. The beneficial uses of the San Joaquin River from Sack Dam to the mouth of the Merced River, and consequently Deadman Creek, are municipal and domestic supply, agricultural supply, industrial process supply, hydropower generation, water contact recreation, non-contact water recreation, warm freshwater habitat, migration of aquatic organisms; spawning, reproduction, and/or early development; and wildlife habitat.
10. The beneficial uses of underlying groundwater are municipal and domestic water supply, agricultural supply, industrial service supply, and industrial process supply.
11. The 1962 Soil Conservation Service Soil Survey of the Merced Area indicates that soils in the vicinity of the WWTF are San Joaquin sandy loams, Madera loams, and Marguerite loams. These soils are typically moderately to well drained although internal drainage may be restricted by hardpans at varying depths.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-3-

12. The RWD indicates that groundwater beneath the WWTF is approximately 120 feet deep. The Department of Water Resources (DWR) map entitled *Lines of Equal Elevation of Water in Wells, Unconfined Aquifer, Spring of 1995*, indicates that ground water flow is to the southwest. Groundwater monitoring data collected by DWR during September 1989 indicates that areal ground water is of good quality with a specific electrical conductivity at 25°C (hereafter conductivity) of 310 µmhos/cm.
13. The WWTF is bordered by agricultural land.
14. Both the WWTF and reuse areas are in the 100-year flood plains of Deadman Creek, and Dutchman Creek, as shown on the Federal Emergency Management Agency's Flood Insurance Rate Map No. 0647C0700 E (August 1995).
15. The approximate annual average precipitation near Le Grand is 10 inches and the approximate annual average pan evaporation is 65 inches.
16. The permitted discharge is consistent with the antidegradation provisions of State Water Resources Control Board Resolution 68-16. This Order provides for an increase in the volume and mass of pollutants discharged. The increase will not cause significant impacts on groundwater and surface waters or depletion of limited groundwater resources. The increase in the discharge allows wastewater utility service necessary to accommodate housing and economic expansion in the area, and is considered to be a benefit to the people of the State.
17. The California Department of Health Services (DHS) has established statewide water recycling criteria in Title 22, California Code of Regulations (CCR), Section 60301, et seq., (hereafter Title 22) for the use of recycled water and has developed guidelines for specific uses.
18. In February of 1996, a Memorandum of Agreement (MOA) was adopted between the State Water Resources Control Board (SWRCB) and DHS. The MOA provides coordinated review and approval of reclamation projects (now referred to as recycling projects) to assure that respective authorities of the two agencies are exercised cooperatively. Pursuant to the MOA, dischargers who recycle or propose to recycle water must file an engineering report with DHS that describes the recycling project and obtain approval from DHS prior to issuance of water recycling requirements by the Board. The Discharger submitted a water recycling report which was approved by DHS by letter dated 13 November 1996. Comments provided by DHS have been considered and incorporated in this Order.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-4-

19. The Le Grand Community Services District adopted a Negative Declaration on 7 November 1996 for the proposed project in accordance with the California Environmental Quality Act (CEQA) (Public Resources Code Section 21000, et seq.) and the State CEQA Guidelines. The Board has reviewed the negative declaration and concurs that the project as approved will not have a significant effect on water quality.
20. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
21. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 87-079 is rescinded and the Le Grand Community Services District, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following at the WWTF:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of wastes classified as 'hazardous' or 'designated', as defined in Title 23, California Code of Regulations (CCR), Section 2510 et seq., (Chapter 15), and specifically Sections 2521(a) and 2522(a), is prohibited.

B. Discharge Specifications:

1. **Until Provision No. F.4 is satisfied**, the monthly average dry weather discharge shall not exceed 0.140 mgd
2. **After Provision No. F.4 is satisfied**, the monthly average dry weather discharge shall not exceed 0.350 mgd.
3. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-5-

4. As a means of discerning compliance with Discharge Specification No. B.3, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
5. The WWTF, excluding reuse areas, shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency (See Provision No F.6 for compliance schedule).
6. Effluent discharged from the modified WWTF to pond No. 4 or the reuse areas shall not exceed the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	40	80
Settleable Solids	ml/l	0.2	0.5

¹ 5-day, 20°Celsius biochemical oxygen demand.

7. Pond No. 4 shall not have a pH less than 6.5 or greater than 9.5.
8. All ponds shall be managed to prevent breeding of mosquitos. In particular:
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
9. Public contact with wastewater shall be precluded through such means as fences and signs, or acceptable alternatives.
10. Pond No. 4 shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the winter. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns (See Provision No. F.4 for compliance schedule). Freeboard shall never be less than two feet in any pond (measured vertically).

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-6-

11. On or about 1 October of each year, available pond storage capacity shall be at least equal to the volume necessary to comply with Discharge Specification B.10.

C. Recycled Water Specifications:

1. Recycled water shall meet the criteria contained in Title 22, and if used in construction, the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes," published by DHS.
2. Recycled water shall remain in the designated reuse areas at all times.
3. The direct reuse of effluent shall be limited to construction purposes or the irrigation of fodder, fiber, and seed crops for nonhuman consumption as described in Finding No. 5. Other uses for recycled water shall be subject to the prior approval of the Executive Officer.
4. The Discharger shall maintain the following setback distances from areas irrigated with reused water:

<u>Setback Distance (feet)</u>	<u>To</u>
25	Property Lines ¹
30	Public Roads
50	Drainage Courses ²
100	Irrigation Wells
150	Domestic Wells

¹ Except north property line of 37-acre reuse area.

² Not less than 25 feet provided irrigation methods remain as in Finding No. 5 and that berms assure no discharge to the drainage course.

5. The perimeter of the reuse areas shall be graded to prevent ponding along public roads or other public areas.
6. Areas irrigated with recycled water shall be managed to prevent breeding of mosquitos. More specifically:
 - a. All applied recycled water and irrigation water shall infiltrate completely within a 48-hour period.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-7-

- b. Ditches not serving as wildlife habitat shall be maintained free of emergent, marginal, and floating vegetation.
 - c. Low-pressure and unpressurized pipelines and ditches accessible to mosquitos shall not be used to store wastewater.
- 7. Application of recycled water to the reuse areas shall be at reasonable rates (hydraulic and nutrient loading) considering the crops, soil, climate and use of other soil amendments (See Provision No. F.7 for compliance schedule).
 - 8. No physical connection shall exist between recycled water piping and any domestic water supply or domestic well, or between any recycled water piping and any irrigation well that does not have an air gap or reduced pressure principle device.
 - 9. All areas where recycled water is used shall be posted with conspicuous signs that present the following wording in size that can be clearly read by the public: "RECLAIMED WATER--DO NOT DRINK--WASH THOROUGHLY WITH SOAP AND DRINKING WATER IF CONTACT OCCURS." Where appropriate, bilingual signs shall be used.
 - 10. The Discharger shall not irrigate with recycled water while significant precipitation is occurring or is forecast to occur, or while soils in the reuse area are saturated.

D. Sludge Disposal Specifications:

- 1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with the Chapter 15 and approved by the Executive Officer.
- 2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer **at least 90 days in advance** of the change.
- 3. Use and disposal of sewage sludge shall comply with Merced County Sludge Ordinance #1505 and State laws and regulations.

E. Groundwater Limitations:

The discharge, in combination with other sources, shall not cause underlying groundwater to contain waste constituents in concentrations statistically greater than background groundwater quality.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-8-

F. Provisions:

1. The Discharger shall comply with Monitoring and Reporting Program No. 97-053, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall not allow pollutant-free wastewater to be discharged into the collection, treatment, and disposal system in amounts that significantly diminish the system's capability to comply with this Order. Pollutant-free wastewater means rainfall, groundwater, cooling waters, and condensates that without treatment are essentially free of pollutants.
3. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
4. For an increase in the volume of wastes discharge from 0.140 to 0.350 mgd, the Discharger shall comply with the following tasks and time schedule:

<u>Task</u>	<u>Compliance Date</u>	<u>Report Due</u>
a. Complete plans and specifications for modified WWTF and collection system.	15 Apr 97	30 Apr 97
b. Secure funding for modified WWTF.	15 May 97	30 May 97
c. Begin construction.	15 Jun 97	30 Jun 97
d. Complete construction of modified WWTF and collection system.	15 Dec 97	30 Dec 97
e. Submit engineering report certifying that modified WWTF is completed as designed for an average daily wastewater flow of 0.350 mgd and a hydrologic balance report substantiating the WWTF complies with Discharge Specification No. B.10.		30 Jan 98

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-9-

5. **At least 90 days** prior to sludge or solids removal from the WWTF, the Discharger shall submit a sludge production and disposal plan describing proposed sludge management/disposal practices and demonstrating how the proposed practices will achieve compliance with Sludge Disposal Specification Nos. D.1 through D.3. The report shall be prepared and signed by a California registered civil engineer experienced in waste treatment and disposal.
6. By **1 May 1997**, the Discharger shall provide a report concerning compliance with Discharge Specification No. B.5, and, if necessary, a time schedule for assuring compliance.
7. By **30 January 1998**, the Discharger shall submit a copy of the operation and maintenance manual for the WWTF. The operation and maintenance manual shall be prepared under the supervision of a California registered civil engineer and include descriptions of complete operational procedures for the WWTF that assure compliance with this Order. Further, the operation and maintenance manual must address the requirements of Standard Provision B.2.
8. Prior to **1 May 1997**, the Discharger shall submit to the Board a final irrigation management plan which demonstrates compliance with Recycled Water Specification Nos. C.1-C.10. The irrigation management plan shall include a water balance and a nitrogen balance, including the use of sludge and other nitrogen fertilizers, for current and projected flows. The water balance must incorporate design seasonal precipitation based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Further, it must demonstrate that reuse and disposal can be accomplished without exceeding the hydraulic loading rate in the reuse area or the crop water demand plus a reasonable leaching fraction. Similarly, the nutrient balance must demonstrate that the nutrient loading to the reuse area, including recycled water, sludge, and other soil amendments, will not exceed the crop demand. The plan shall be prepared by a California registered civil engineer experienced in wastewater treatment and disposal.
9. The Discharger shall submit to the Board on or before each report due date the specified document or, if an action is specified, a written report detailing evidence of compliance with the date and task. If noncompliance is being reported, the reasons for such noncompliance shall be stated, plus an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Board by letter when it returns to compliance with the time schedule.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-10-

10. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.


To assume operation under this Order, the succeeding owner or operator must apply in writing to the Executive Officer requesting transfer of the Order. The request must contain the requesting entity's full legal name, the State of incorporation if a corporation, the name and address and telephone number of the persons responsible for contact with the Board, and a statement. The statement shall comply with the signatory paragraph of Standard Provision B.3 and state that the proposed owner or operator assumes full responsibility for compliance with this Order. Failure to submit the request shall be considered a discharge without requirements, a violation of the California Water Code. Transfer shall be approved or disapproved by the Executive Officer.

11. The Discharger shall use the best practicable control technique available to comply with this Order.
12. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
13. Recycled water used for construction purposes shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes," published by the California Department of Health Services. Other uses of recycled water not specifically authorized herein shall be subject to revision of this Order and compliance with Title 22.
14. A copy of this Order shall be kept at the WWTF for reference by operating personnel. Key operating personnel shall be familiar with its contents.
15. The Board will review this Order periodically and will revise requirements when necessary.

WASTE DISCHARGE REQUIREMENTS
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-11-

I, JAMES R. BENNETT, Interim Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 28 March 1997.

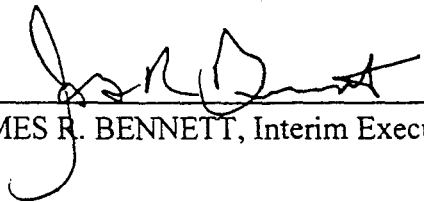

JAMES R. BENNETT, Interim Executive Officer

WDH:wdh/rac

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 97-053

FOR
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

Specific sample station locations shall be established with concurrence of the Board's staff. A description of the stations shall be submitted to Board and attached to this Program.

INFLUENT MONITORING

Influent samples shall be collected at the inlet of the headworks and at approximately the same time as effluent samples. Influent monitoring shall be conducted at the flow-proportioned frequency specified below and include at least the following constituents:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD ₅ ¹	mg/l	8-hr. Composite	Monthly ^{2,3}
Settleable Solids	ml/l	Grab	Monthly ^{2,3}

¹ Five day, 20°C BOD test.

² During non-consecutive weeks.

³ To be initiated following startup of the modified treatment units.

EFFLUENT MONITORING

Except for flow, which may be measured either at the headworks or outlet from the treatment system, effluent samples shall be collected just prior to discharge to the percolation ponds or the last pond in the treatment train that contains wastewater. Effluent samples shall be representative of the volume and nature of the discharge. Time of collection of a grab samples shall be recorded. Effluent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	mgd	Metered	Continuous ¹
Conductivity ²	µmhos/cm	Grab	Monthly
pH	pH Units	Grab	Monthly

MONITORING AND REPORTING PROGRAM
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-2-

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD ₅ ³	mg/l	Grab	Monthly ⁶
Settleable Solids	ml/l	Grab	Monthly
Total Kjeldahl Nitrogen	mg/l	Grab	Annually ^{5,6}
Nitrates as N	mg/l	Grab	Annually ^{5,6}
Standard Minerals ⁴	mg/l	Grab	Annually ^{5,6}

¹ Reported Daily.

² Specific Electrical Conductivity @ 25°C.

³ Five day, 20°C BOD test.

⁴ Standard Minerals shall include all major cations and anions and include a verification that the analysis is complete (i.e., a cation/anion balance).

⁵ August.

⁶ To be initiated following startup of the modified treatment units.

POND MONITORING

Ponds shall be monitored as follows:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Frequency</u>
pH	pH Units	Grab	Weekly
Freeboard	feet	Observation	Weekly
Dissolved Oxygen	mg/l	Grab ¹	Weekly ²

¹ Samples shall be collected at a depth of one foot, opposite the inlet. Dissolved Oxygen samples shall be collected between 0800 and 0900 hours.

² If results indicate a concentration of less than 1.0 mg/l or if offensive odors are noted, the frequency of monitoring shall be increased as necessary to characterize the period of non-compliance.

A permanent marker shall be placed in pond No. 4 with calibrations indicating the water level at design capacity and available operational freeboard. In addition, the Discharger shall inspect the condition of the ponds once per week and write visual observations in a bound log book. Notations shall include observations of whether weeds are developing in the water or along the bank, and their location; whether burrowing animals or insects are present; and the color of the pond (e.g. dark sparkling green, dull green, yellow, grey, tan, brown, etc.). A copy of the entries made in the log during each month shall be submitted along with the monitoring report the

MONITORING AND REPORTING PROGRAM
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-3-

following month. Where the Operation and Maintenance Manual indicates remedial action is necessary, the Discharger shall briefly explain in the transmittal what action has been taken or is scheduled to be taken.

SLUDGE MONITORING

The Discharger shall monitor the sludge production and quality in accordance with the sludge production and disposal plan as approved by the Executive Officer.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Conductivity ¹	µmhos/cm	Triennially ⁴
Total Dissolved Solids ²	mg/l	Triennially ⁴
Standard Minerals ³	mg/l	Triennially ⁴

¹ Specific Electrical Conductivity @ 25°C.

² Determined by EPA Methods 160.1 and 160.4

³ Standard Minerals shall include all major cations and anions and include a verification that the analysis is complete (i.e., a cation/anion balance).

⁴ Samples shall be collected in 1998 and triennially thereafter.

If the source water is from more than one source, the results shall be reported as a flow weighted average and include copies of supporting calculations.

REPORTING

Monitoring required at least monthly shall be submitted to the Board by the **20th day** of the month following sample collection. Annual monitoring data shall be submitted with the Annual Report described below.

MONITORING AND REPORTING PROGRAM
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-4-

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner that illustrates clearly whether the Discharger complies with waste discharge requirements, including calculation of all averages, etc. If the Discharger monitors any pollutant at the locations designated herein more frequently than is required by this Order, the results of such monitoring shall be included in the discharge monitoring report.

The Discharger may also be requested to submit an annual report to the Board with tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

By 31 January of each year, the Discharger shall submit a written Annual Report to the Executive Officer containing the following:

- a. The names, titles, certificate grade (if any), and general responsibilities of persons operating and maintaining the wastewater treatment plant.
- b. The names and telephone numbers of persons to contact regarding the WWTF for emergency and routine situations.
- c. A certified statement of when the flow meter and other monitoring instruments and devices were last calibrated, including identification of who did the calibration (Standard Provision C.4).
- d. A statement whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last reviewed for adequacy.
- e. The total quantity of sludge disposed of during the previous year and ultimate disposal site(s).


All reports submitted in response to this Order shall comply with the signatory requirements in Standard Provision B.3.

MONITORING AND REPORTING PROGRAM
LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-5-

The Discharger shall implement the above monitoring program on the first day of the month following adoption of this Order.


Ordered by: _____

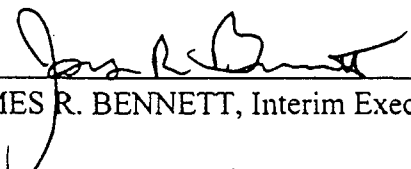
JAMES R. BENNETT, Interim Executive Officer

28 March 1997

(Date)

WDH:wdh/rac

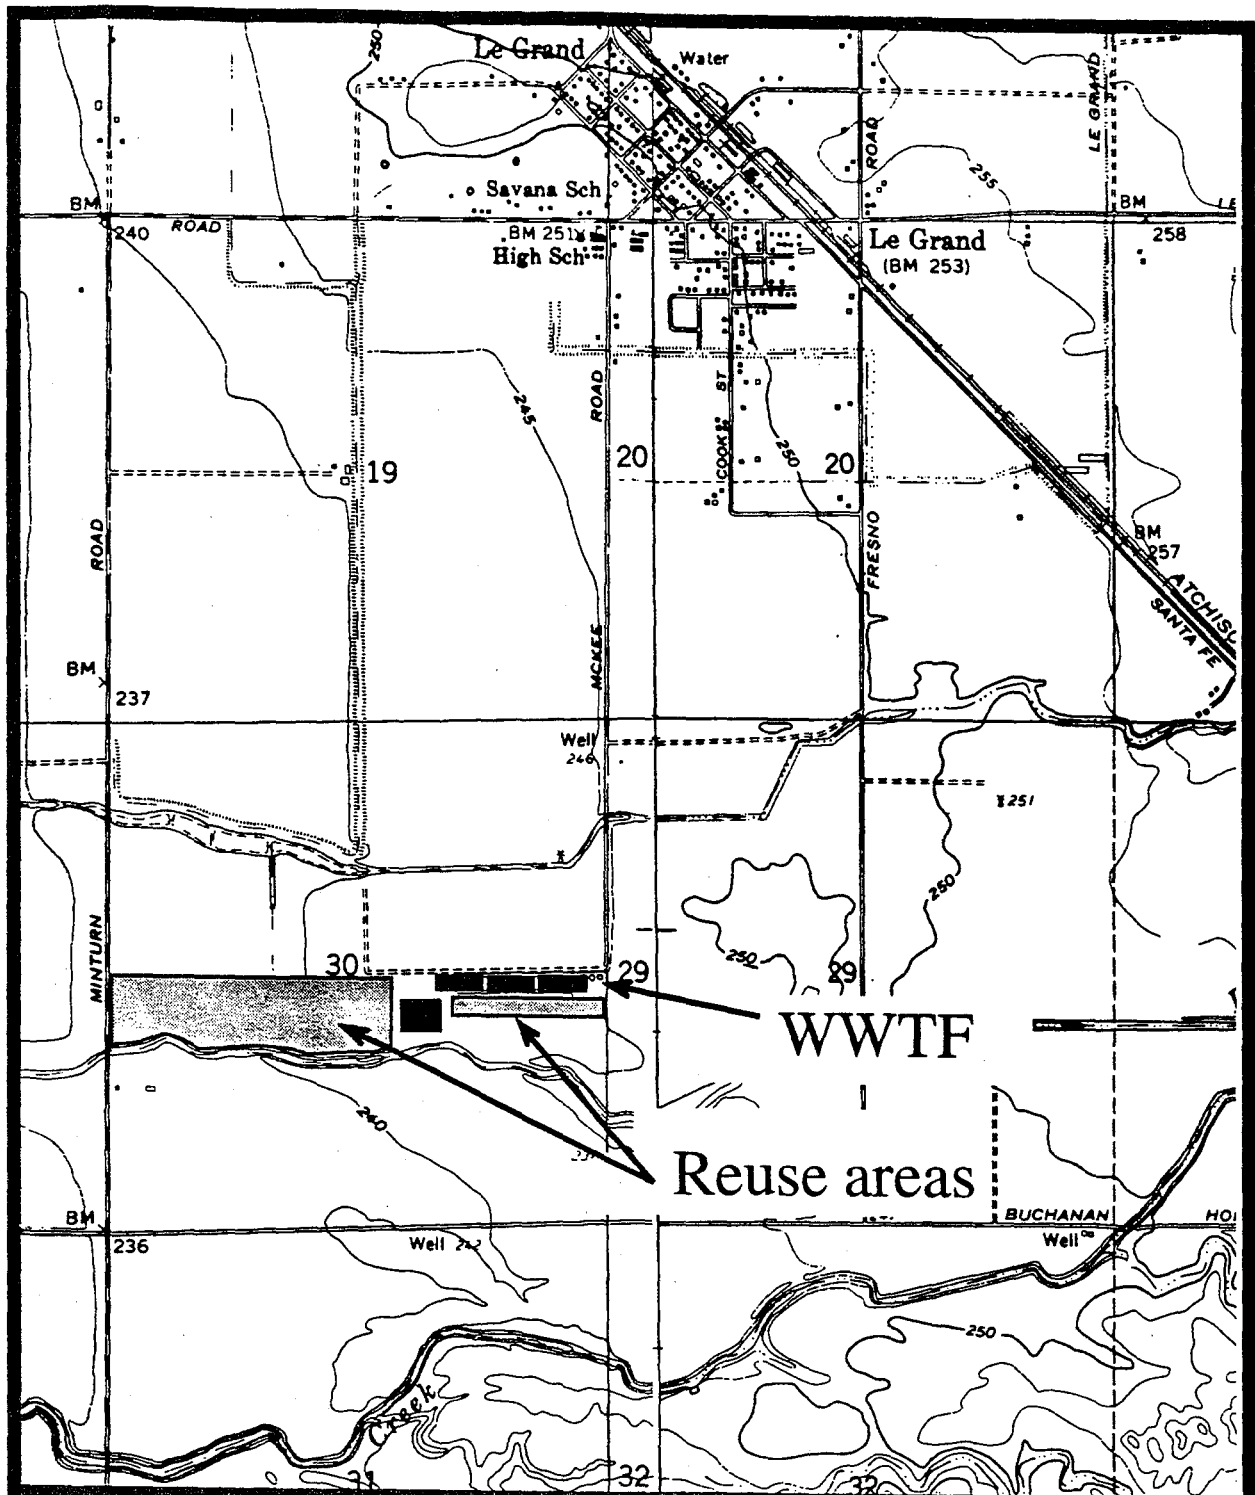

Scale: 1" = 2000'

ATTACHMENT A Vicinity Map

**LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY**

Section 30, T8S, R16E, MDB&M
Le Grand, 7.5' USGS Quad, 1981
Plainsburg, 7.5' USGS Quad, 1976

INFORMATION SHEET

LE GRAND COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT FACILITY MERCED COUNTY

The Le Grand Community Services District (hereafter Discharger) proposes to modify its existing wastewater treatment facility (WWTF) and collection system to increase the capacity to 0.35 mgd. The WWTF is operating at approximately 148% of its design capacity. The Discharger has implemented a voluntary building moratorium until the capacity of the WWTF can be increased. The proposed modifications to the WWTF will provide a long term solution to the Discharger's current capacity shortfall.

The Discharger proposes to abandon its Imhoff tank and install a mechanically operated bar screen. Existing pond Nos. 1 and 2 will be converted to partially mixed, aerated lagoons. Existing pond No. 3 will be operated as a stabilization pond but will be designed for surface aerators, to allow for future increases in WWTF flow to 0.50 mgd. WWTF piping will be modified so that any one of pond Nos. 1-3 can be taken out of service for sludge removal or maintenance. Wastewater disposal will be accomplished by evaporation/percolation from existing pond No. 4 and by reuse on fiber, fodder, and seed crops grown in the 37 acre reuse area and 15 acres of land recently purchased by the Discharger, adjacent to the WWTF. Sludge removed from pond Nos. 1-3 may be land applied on the reclamation areas. In conjunction with the WWTF modifications, the Discharger proposes to replace significant sections of the collection system, including the WWTF lift station. Following modification, the WWTF will be able to treat and dispose of effluent with a BOD₅ of approximately 20 mg/l. This Order limits the monthly average and daily maximum effluent BOD₅ concentrations to 40 mg/l and 80 mg/l, respectively. The limits reflect the relatively small volume of the waste discharge and the remote location of the WWTF.

Soils in the vicinity of the WWTF are San Joaquin sandy loams, Madera loams, and Marguerite loams. These soils are typically moderately to well drained although internal drainage may be restricted by hardpans at varying depths. Groundwater is approximately 120-150 deep and is of good quality. The WWTF is bordered by agricultural land and is within the 100-year flood plains of Deadman and Dutchman Creeks. Surface water drains to Deadman Creek.

The California Department of Health Services (DHS) has established statewide water recycling criteria in Title 22, California Code of Regulations (CCR), Section 60301, et seq., (hereafter Title 22) for the use of recycled water and has developed guidelines for specific uses. Title 22 requires any discharger who proposes to recycle wastewater to submit an engineering report to DHS for review and approval. Pursuant to a Memorandum of Agreement, the engineering report must be approved by DHS prior to issuance of water recycling requirements by the Board. By letter dated 13 November 1996, DHS approved the engineering report for the subject project. Any comments provided by DHS have been considered and incorporated in this Order.

INFORMATION SHEET

LE GRAND COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT FACILITY
MERCED COUNTY

-2-

The Le Grand Community Services District adopted a Negative Declaration on 7 November 1996 for the proposed project in accordance with the California Environmental Quality Act (CEQA) (Public Resources Code Section 21000, et seq.) and the State CEQA Guidelines.

WDH:wdh/rac:3/28/97