

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 90-055

WASTE DISCHARGE REQUIREMENTS
FOR
GOLD BEACH PARK
TOM M. PIETRZYK
EL DORADO COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Gold Beach Park, Tom M. Pietrzyk (hereafter Discharger) submitted a Report of Waste Discharge, dated 29 November 1989, and a site evaluation report, dated August 1989. The property is owned by Tom Pietrzyk.
2. The Board, on 28 January 1972, adopted Order No. 72-165, which prescribed requirements for a discharge from Gold Beach Park to septic tanks and an evaporation/percolation pond.
3. Gold Beach Park is a year-round resort community on the North Fork Cosumnes River just off Highway 49 north of the Amador County line. The facilities consist of 21 full-time mobile home spaces, 41 recreation vehicle spaces with full hookup services, 51 campsites with no hookup services, and two restroom buildings with showers.
4. Sewage treatment and disposal is accomplished by three septic tank/pump stations, a 1.5 acre-foot evaporation/percolation pond, and a 0.5 acre-foot overflow pond.
5. Present waste discharge requirements established by Order No. 72-165 are neither adequate nor consistent with plans and policies of the Board.
6. The Discharger discharges an average of about 4,000 gallons per day to the disposal system; peak daily summertime holiday discharge flows may reach 9,000 gallons.
7. Gold Beach Park is in Section 11, T8N, R10E, MDB&M, with surface water drainage to the North Fork Cosumnes River. See Attachment A, made part of this Order.
8. The beneficial uses of the Cosumnes River are industrial and agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
9. The beneficial use of the ground water is domestic supply.
10. The Board, on 25 July 1975, adopted a Water Quality Control Plan for the Sacramento-San Joaquin River Basin (5B) which contains water quality objectives for all waters of the Basin. These requirements are consistent with that Plan.

11. The action to adopt waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Title 14, California Code of Regulations (CCR).
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 72-165 is rescinded and Gold Beach Park, Tom M. Pietrzyk, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.
3. Resurfacing of wastewater percolating from the disposal ponds is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal area at all times.
4. The 30-day average daily dry weather discharge flow shall not exceed 5,000 gallons.
5. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
6. A 1.0 foot freeboard shall be maintained in all ponds at all times.
7. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.).
8. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 16 hours in any 24-hour period.


WASTE DISCHARGE REQUIREMENTS
GOLD BEACH PARK
TOM M. PIETRZYK
EL DORADO COUNTY

-3-

C. Provisions:

1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 90-055.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 February 1990, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.
6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 23 February 1990.



WILLIAM H. CROOKS, Executive Officer

1/25/90:RJB:gs

Attachments

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 90-055

FOR
GOLD BEACH PARK
TOM M. PIETRZYK
EL DORADO COUNTY

The Discharger shall submit quarterly monitoring reports which shall include, as a minimum, the following:

1. Monthly tabulation of minimum freeboard for each pond used in feet.
2. Monthly average daily discharge flow to the pond system in gallons.

The quarterly reports shall be submitted by the 15th day of the month following the end of the quarter.

The Discharger shall implement the above monitoring program as of the date of this Order.

Order by William H. Crooks
WILLIAM H. CROOKS, Executive Officer

23 February 1990

(Date)


1/25/90:RJB:gs

INFORMATION SHEET

GOLD BEACH PARK
TOM M. PIETRZYK
EL DORADO COUNTY

Gold Beach Park is a year-round resort community on the North Fork Cosumnes River just off Highway 49 in southwestern El Dorado County. There are 21 permanent mobile home spaces, as well as facilities for RV and tent camping. Sewage is treated by three large septic tank/pump stations prior to disposal in a dual evaporation/percolation pond system on a hill top approximately 800 feet east of the river and about 180 feet above the river. Surface water drainage is to the North Fork Cosumnes River.

1/25/90:RJB:gs

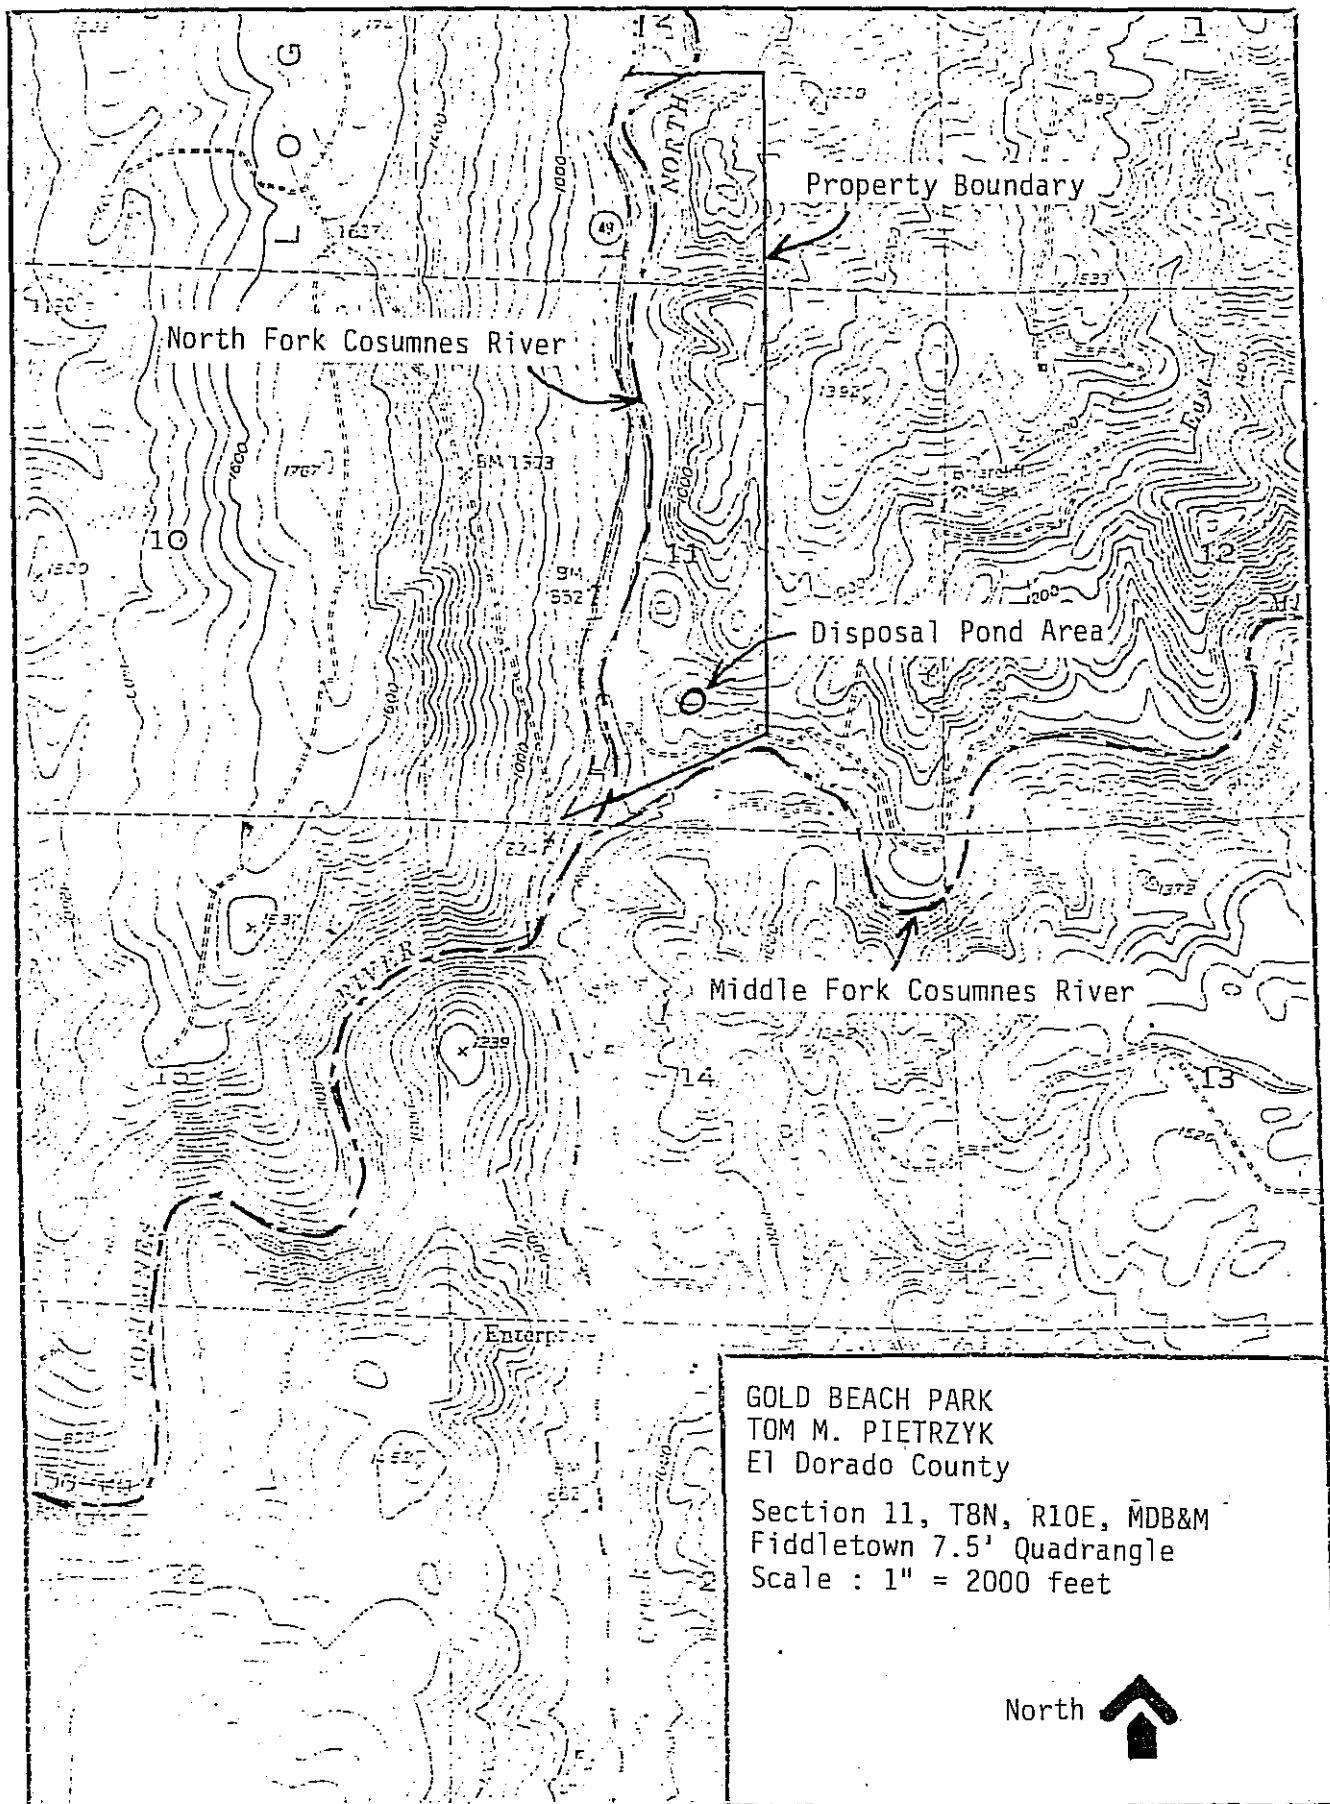

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

REVISED MONITORING AND REPORTING PROGRAM NO. 90-055

FOR
LARRY MORALES
GOLD BEACH PARK WASTEWATER TREATMENT FACILITY
EL DORADO COUNTY

This monitoring and reporting program (MRP) incorporates requirements for monitoring of the wastewater treatment and disposal system. This MRP is issued pursuant to Water Code Section 13267. The Discharger shall not implement any changes to this MRP unless and until a revised MRP is issued by the Executive Officer.

All wastewater samples should be representative of the volume and nature of the discharge. The time, date, and location of each grab sample shall be recorded on the sample chain of custody form. Process wastewater flow monitoring shall be conducted continuously using a flow meter and shall be reported in cumulative gallons per day.

Field test instruments (such as pH and dissolved oxygen) may be used provided that:

1. The operator is trained in the proper use of the instrument;
2. The instruments are field calibrated prior to each monitoring event;
3. Instruments are serviced and/or calibrated per manufacturer's recommended frequency; and
4. Field calibration reports are submitted as described in the "Reporting" section of this MRP.

SEPTIC TANK AND CONVEYANCE SYSTEM MONITORING

The Discharger shall monitor each septic tank and report this information in the annual reports. Septic tanks shall be inspected annually for the presence of scum and sludge as described below:

<u>Parameter</u>	<u>Units</u>	<u>Type of Measurement</u>	<u>Minimum Inspection</u>	<u>Reporting Frequency</u>
Sludge depth and scum thickness in each septic tank ¹	Feet	Staff Gauge	Annually	Annually
Distance between bottom of scum layer and bottom of outlet device ¹	Inches	Staff Gauge	Annually	Annually
Distance between top of sludge layer and bottom of outlet device ¹	Inches	Staff Gauge	Annually	Annually

¹ The Discharger shall visually inspect the tanks for signs of damages, leakage, or deterioration

If the septic tank(s) are pumped out and cleaned, the annual report shall describe how much sludge was removed from the septic tank(s), and the date that cleaning or repair occurred and by whom. In addition, a copy of the Liquid Waste Hauler manifests shall be submitted.

The septic tank visual alarm systems for each septic tank shall be inspected quarterly to ensure they are working correctly. Results of the inspections shall be reported in the monthly monitoring report for the month that the alarms were inspected.

The wastewater conveyance pipe that crosses the Consummes River shall be inspected daily for signs of leakage. Results of the daily inspection of the wastewater conveyance pipe shall be submitted in the monthly monitoring reports.

EFFLUENT MONITORING

The Discharger shall conduct effluent monitoring of the wastewater entering the evaporation/percolation ponds; samples shall be collected at a point prior to discharge into the evaporation/percolation ponds. Effluent monitoring shall include, at a minimum, the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Flow to the wastewater ponds	gpd	Meter	Weekly	Monthly
BOD ₅ ¹	mg/L	Grab	Monthly	Monthly
Total Dissolved Solids	mg/L	Grab	Monthly	Monthly
Nitrate as Nitrogen	mg/L	Grab	Quarterly	Quarterly ³
Total Kjeldahl Nitrogen	mg/L	Grab	Quarterly	Quarterly ³
Ammonia	mg/L	Grab	Quarterly	Quarterly ³
Zinc	mg/L	Grab	Quarterly	Quarterly ³
Total Phenols	mg/L	Grab	Quarterly	Quarterly ³
Formaldehyde	mg/L	Grab	Quarterly	Quarterly ³
Standard Minerals ²	mg/L	Grab	Annually	Annually ⁴

¹ 5-day, 20°C Biochemical Oxygen Demand.

² Standard Minerals shall include the following: boron, calcium, iron, manganese, magnesium, potassium, sodium, chloride, total alkalinity (including alkalinity series), and hardness.

³ To be reported in the March, June, September, and December monthly monitoring reports.

⁴ To be reported in the January monthly monitoring report.

POND MONITORING

Each of the evaporation/percolation ponds shall be monitored as specified below. Freeboard shall be measured vertically from the surface of the pond water to the lowest elevation of the surrounding levee and shall be measured to the nearest 0.1 feet.

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>	<u>Reporting Frequency</u>
Dissolved Oxygen ^{1,4}	mg/L	Grab	Weekly	Monthly
pH ⁴	pH units	Grab	Weekly	Monthly
Freeboard	0.1 feet	Observation	Weekly	Monthly

Berm Seepage ²	NA	Observation	Weekly	Monthly
Odors ³	--	Observation	Weekly	Monthly

¹ Samples shall be collected at a depth of one foot from each pond in use, opposite the inlet. Samples shall be collected between 0700 and 0900 hours.

² Reservoir containment levees shall be observed for signs of seepage or surfacing water along the exterior toe of the levees and dam. If surfacing water is found, then a sample shall be collected and tested for total coliform organisms and total dissolved solids.

³ The presence of strong or unusual odors shall be reported.

⁴ Hand held meter may be used.

SLUDGE MONITORING

In accordance with EPA's POTW Sludge Sampling and Analysis Guidance Document, August 1989, a composite sample of sludge shall be collected when removed from the evaporation/percolation pond and tested for the following metals:

Cadmium	Copper	Nickel
Chromium	Lead	Zinc

Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report.

REPORTING

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., process wastewater effluent, groundwater well, etc.), and reported analytical result for each sample are readily discernible. The data shall be summarized in such a manner to clearly illustrate compliance with waste discharge requirements and spatial or temporal trends, as applicable. The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported in the next scheduled monitoring report.

A. Monthly Monitoring Reports

Monthly reports shall be submitted to the Regional Board by the **1st day of the second month** following the end of the reporting period (i.e. the January monthly report is due by 1 March). The monthly reports shall include the following:

1. Results of the wastewater conveyance system, effluent and pond monitoring;
2. A comparison of monitoring data to the discharge specifications and an explanation of any violation of those requirements. Data shall be presented in tabular format;
3. If requested by staff, copies of laboratory analytical report(s); and
4. A calibration log verifying calibration of all hand held monitoring instruments and devices used to comply with the prescribed monitoring program;

B. Annual Monitoring Reports

An Annual Report shall be prepared as the December monthly monitoring report. The Annual Report shall be submitted to the Regional Board by **1 February of each year** and shall include the following:

1. The contents of the regular monthly monitoring report for the last month;
2. If requested by staff, tabular and graphical summaries of all data collected during the year;
3. Results of the septic tank and effluent annual monitoring;
4. An evaluation of the performance of the wastewater treatment system, as well as a forecast of the flows anticipated in the next year;
5. A statement regarding whether flow meter was calibrated during the year;
6. Verification of appropriate employee training for all personnel involved in operation and maintenance of wastewater treatment system;
7. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into full compliance with the waste discharge requirements; and
8. A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.

A letter transmitting the self-monitoring reports shall accompany each report. Such a letter shall include a discussion of requirement violations found during the reporting period, and actions taken or planned for correcting noted violations, such as operation or facility modifications. If the discharger has previously submitted a report describing corrective actions and/or a time schedule for implementing the corrective actions, reference to the previous correspondence will be satisfactory. The transmittal letter shall contain a statement by the discharger, or the discharger's authorized agent, under penalty of perjury, that to the best of the signer's knowledge the report is true, accurate and complete.

The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:

THOMAS R. PINKOS, Executive Officer

(Date)