



GAVIN NEWSOM
GOVERNOR



JARED BLUMENFELD
SECRETARY FOR
ENVIRONMENTAL PROTECTION

Central Valley Regional Water Quality Control Board

09 July 2019

Jon Bevan
California Department of Transportation
1604 South B Street
Stockton, CA 95206

CERTIFIED MAIL
91 7199 9991 7035 8420 3712

NOTICE OF APPLICABILITY

GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS ORDER WQ 2014-0153-DWQ

FOR

CALIFORNIA DEPARTMENT OF TRANSPORTATION WESTLEY SAFETY ROADSIDE REST AREAS STANISLAUS COUNTY

California Department of Transportation (Caltrans, hereafter "Discharger") submitted a Report of Waste Discharge (RWD) dated 11 January 2018 describing the Westley Safety Roadside Rest Area (SRRA) wastewater treatment plant (WWTP) in Stanislaus County. Additional information was submitted in November 2018, and February and May 2019. Based on the provided information, the wastewater treatment system and discharge are consistent with the requirements of the State Water Resources Control Board (State Water Board) *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems*, Order WQ 2014-0153-DWQ (General Order). This Notice of Applicability (NOA) provides notice that the General Order is applicable to the site as described below. You are hereby assigned Order WQ 2014-0153-DWQ-R5304 for the discharge. A copy of the General Order is enclosed and is also available at this link:

http://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

You should familiarize yourself with the entire General Order and its attachments, which describe mandatory discharge and monitoring requirements. The General Order contains operational and reporting requirements by wastewater system type. Sampling, monitoring, and reporting requirements applicable to your treatment and disposal methods must be completed in accordance with the appropriate treatment system sections of the General Order and the attached Monitoring and Reporting Program (MRP) 2014-0153-DWQ-R5304. The Discharger is responsible for all the applicable requirements that exist in the General Order and this NOA.

KARL E. LONGLEY ScD, P.E., CHAIR | PATRICK PULUPA, ESQ., EXECUTIVE OFFICER

11020 Sun Center Drive #200, Rancho Cordova, CA 95670 | www.waterboards.ca.gov/centralvalley

REGULATORY BACKGROUND

The Discharger proposes a new WWTP to replace the existing septic system. The Westley SRRAs are currently not regulated by the Central Valley Regional Water Quality Control Board (Central Valley Water Board). The wastewater discharge at the site will be unregulated until the Central Valley Water approves the *Construction Completion Report* for the new WWTP system pursuant to Provision 5 of this NOA.

EXISTING FACILITY AND DISCHARGE DESCRIPTION

The Westley SRRA WWTP is owned and operated by the Discharger and is located at Post Mile 27.0 along Interstate 5 in Stanislaus County as shown on Attachment A, which is attached hereto and is made part of this NOA by reference. The rest areas are located in an area without a regional wastewater collection system; therefore, wastewater is collected and treated on-site. The site plan is shown on Attachment B, which is attached hereto and is made part of this NOA by reference.

The Westley northbound (NB) and southbound (SB) SRRAs have provided public restrooms for the traveling public since 1967 without formal permitting of the waste discharge. Wastewater is generated from domestic use such as toilets and handwashing. The NB and SB SRRAs each have an existing onsite wastewater treatment system consisting of septic tanks and leach-field system. Total current septic tank capacity is 0.051 MG (million gallons). Several approximately six-foot deep observation wells used for visually checking if there is water present in the leach field are located in the northeast leach field.

FACILITY CHANGES

The Discharger proposes to abandon the septic and leach-field systems to construct a pond system WWTP with on-site disposal located at NB SRRA. The Discharger also proposes to construct a recreational vehicle (RV) disposal station at both the NB and SB SRRAs that will discharge into the proposed WWTP. RV waste has the potential to introduce additional compounds such as (but not limited to) formaldehyde, phenol, and zinc into the system. Gravity-fed lift stations equipped with chopper pumps will be located at both the NB and SB SRRAs.

Pond 1 and 2 will be facultative ponds lined with a high density 60-mil polyethylene (HDPE) or equivalently impermeable liner. Pond 1 will have aerators to promote oxygenation in the upper layer. Pond 2 is used for additional treatment as needed, and storm water will at times be discharged to Pond 2. Following treatment in Ponds 1 and 2, wastewater will gravity flow into Pond 3 for disposal via evaporation and percolation. Pond 3 is lined on the inner slopes only. Based on the RWD and supplemental data submitted by the Discharger, the proposed ponds will have the following estimated depth, surface area, and volume (omitting volume due to freeboard depth), where depth is the maximum allowed liquid depth, and surface area is at maximum allowed capacity:

Pond Name	Depth (feet)	Surface Area (acres)	Volume (MG)
Pond 1	8	0.46	0.72
Pond 2	6	0.63	0.66
Pond 3	5	0.91	1.24

During abandonment of the current leach fields and construction of the new pond system, the existing observation wells and the drainage swale running north to the existing leach field will be removed.

Construction is expected to begin Winter 2020, contingent on equipment delivery. The Westley SRRAs NB and SB will be closed to the public when construction starts. Once the SRRAs are

closed to the public, sanitation needs of the workers during construction will be addressed with the use of portable toilets.

FUTURE: Subsurface Drip System

In a future project, the Discharger plans to install subsurface drip irrigation systems at the NB and SB SRRAs. Treated wastewater with the option to supplement water with storm water will feed this irrigation system. The subsurface drip system may require an amended NOA prior to its construction, pending input from the California Department of Drinking Water.

GROUNDWATER

Groundwater was not encountered in previous subsurface investigations conducted in 1981 by the Discharger where test borings were completed to a depth of 30 feet below grade surface (bgs). Additional cone penetrometer test borings to a depth of 15 to 20 feet bgs conducted in 2017 by the Discharger resulted in no finding of groundwater presence.

SITE-SPECIFIC REQUIREMENTS AND EFFLUENT LIMITS

The General Order contains prohibitions and specifications that apply to all wastewater treatment systems as well as those that only apply to specific treatment and/or disposal systems. The specific requirements and effluent limits for your treatment system are summarized below.

The wastewater treatment operator must be certified and familiar with the requirements contained in the General Order, this NOA, and the MRP.

Requirements by Wastewater System Type, Section B of General Order

B.1 All Wastewater Systems

This applies in its entirety to the Westley SSRA WWTP with the following site-specific requirements.

B.1.a Influent flow limits (Section B.1.a of General Order)

Treatment Unit	Flow Limit (Monthly Average)
Treatment Pond 1	12,500 gallons per day (gpd)

B.1.l Wastewater system setbacks (Section B.1.l of General Order, "Impoundment (undisinfected secondary recycled water)", measured from the nearest high-water limit (bottom of freeboard).

Equipment or Activity: Wastewater Treatment and Disposal Pond

Domestic Well:	150 ft.
Flowing Stream:	150 ft.
Ephemeral Stream Drainage:	150 ft.
Property Line:	50 ft.
Lake or Reservoir:	200 ft

B.2 – B.4 Not applicable

B.5 Pond Systems

The WWTP utilizes a pond system; therefore Section B.5 of General Order applies in its entirety.

B.6 - B.7 Not applicable

B.8 Sludge/Solids Disposal

The WWTP consists of lift stations and ponds that may accumulate sludge; therefore Section B.8 of General Order applies in its entirety.

Effluent Limitations, Section D of General Order

This section applies in its entirety to the Westley SRRA WWTP and shall include the following site-specific limitations.

The following limits apply to effluent from Pond 2.

Treatment Pond 2 Effluent Limitations

Constituent	Limit
BOD (5-day biochemical oxygen demand)	90 mg/L

Effluent Limit Rationale

The pond treatment system is subject to technology performance effluent limits for biochemical oxygen demand (BOD) as specified in the General Order. The BOD effluent limit is based on data reported in the RWD.

Staff evaluated the need for a total nitrogen effluent limit using the method contained in the General Order and determined that a nitrogen effluent limit is not required because the monthly average flow will be less than 20,000 gpd and treatment Ponds 1 and 2 will be lined.

Technical Report Preparation Requirements, Section E.1 of General Order

PROVISIONS

The following technical reports shall be submitted as described below:

1. By **October 1, 2019** the Discharger shall submit a *Spill Prevention and Emergency Response Plan (Response Plan)* consistent with the requirements of General Order Provision E.1.a.
2. By **October 1, 2019** the Discharger shall submit a *Sampling and Analysis Plan* consistent with the requirements of General Order Provision E.1.b.
3. **At least 90 days** prior to any removal, drying, treatment, or disposal of sludge for pond maintenance, the Discharger shall submit a *Sludge Management Plan* consistent with the requirements of General Order Provision E.1.c.
4. **Prior to any discharge and within 60 days** of the completion of construction the Discharger shall submit a *Pond Liner Construction Quality Assurance Workplan and Pond Liner Construction Quality Assurance Report*.
5. **Prior to any discharge and within 60 days** of the completion of construction, the Discharger shall submit a *WWTP Construction Completion Report* for Central Valley Water Board approval prior to commencing discharge.

MONITORING AND REPORTING PROGRAM

The Discharger shall comply with MRP 2014-0153-DWQ-R5304, which is attached hereto and made part of this NOA by reference.

ENFORCEMENT

Please review this NOA carefully to ensure that it completely and accurately reflects the discharge. Discharge of wastes other than those described in this NOA is prohibited. Prior to allowing changes

to the wastewater strength or generation rate, or to the method of waste disposal, you must contact the Central Valley Water Board to determine if submittal of an RWD is required.

California Department of Transportation will generate the waste subject to the terms and conditions of WQ 2014-0153-DWQ-R5304 and will maintain exclusive control over the discharge. As such, California Department of Transportation is primarily responsible for compliance with this NOA, MRP, and General Order, with all attachments. Failure to comply with the requirements in the General Order or this NOA could result in an enforcement action as authorized by provisions of the California Water Code.

ANNUAL FEES

The annual fee is based on the discharge's threat to water quality and complexity rating of 3-C, currently \$2,286. The fee is due and payable on an annual basis until coverage under the General Order is formally rescinded. Please note that the annual fees are reviewed each year and may change. Written notice must be provided from the Discharger if and when the wastewater discharge ceases, so that we can terminate coverage under the General Order and cancel future invoices.

DOCUMENT SUBMITTAL

All monitoring reports and other correspondence should be converted to searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50 MB should be emailed to: centralvalleysacramento@waterboards.ca.gov.

To ensure that your submittal is routed to the appropriate staff person, the following information should be included in the body of the email or any documentation submitted to the mailing address for this office:

Facility Name: Westley Safety Roadside Rest Areas, Stanislaus County


Program: Non-15 Compliance Order: 2014-0153-DWQ-R5304

CIWQS Place ID: 820261

Documents that are 50 MB or larger should be copied to a CD, DVD, or flash drive and mailed to:


Central Valley Regional Water Quality Control Board
ECM Mailroom
11020 Sun Center Drive, Suite 200
Rancho Cordova, CA 95670

Now that the Notice of Applicability has been issued, the Board's Compliance and Enforcement section will take over management of your case. Guy Childs is your new point of contact for any questions about compliance with the General Order. If you find it necessary to make a change to your permitted operations, Guy will direct you to the appropriate Permitting staff. You may contact Guy at (916) 464-4648 or at guy.childs@waterboards.ca.gov.

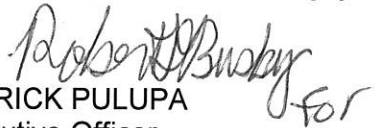
PATRICK PULUPA
Executive Officer

enc: Water Quality Order WQ 2014-0153-DWQ
Monitoring and Reporting Program 2014-0153-DWQ-R5304
Attachment A, Site Location Map
Attachment B, Site Plan
Attachment C, Wastewater Treatment System Schematic

cc w/out enc: Timothy O'Brien, State Water Resources Control Board, Sacramento
Stanislaus County Environmental Resources Department, Modesto
Gerhard Panuschka, Caltrans, Sacramento
Guy Childs, CVWQCB, Rancho Cordova

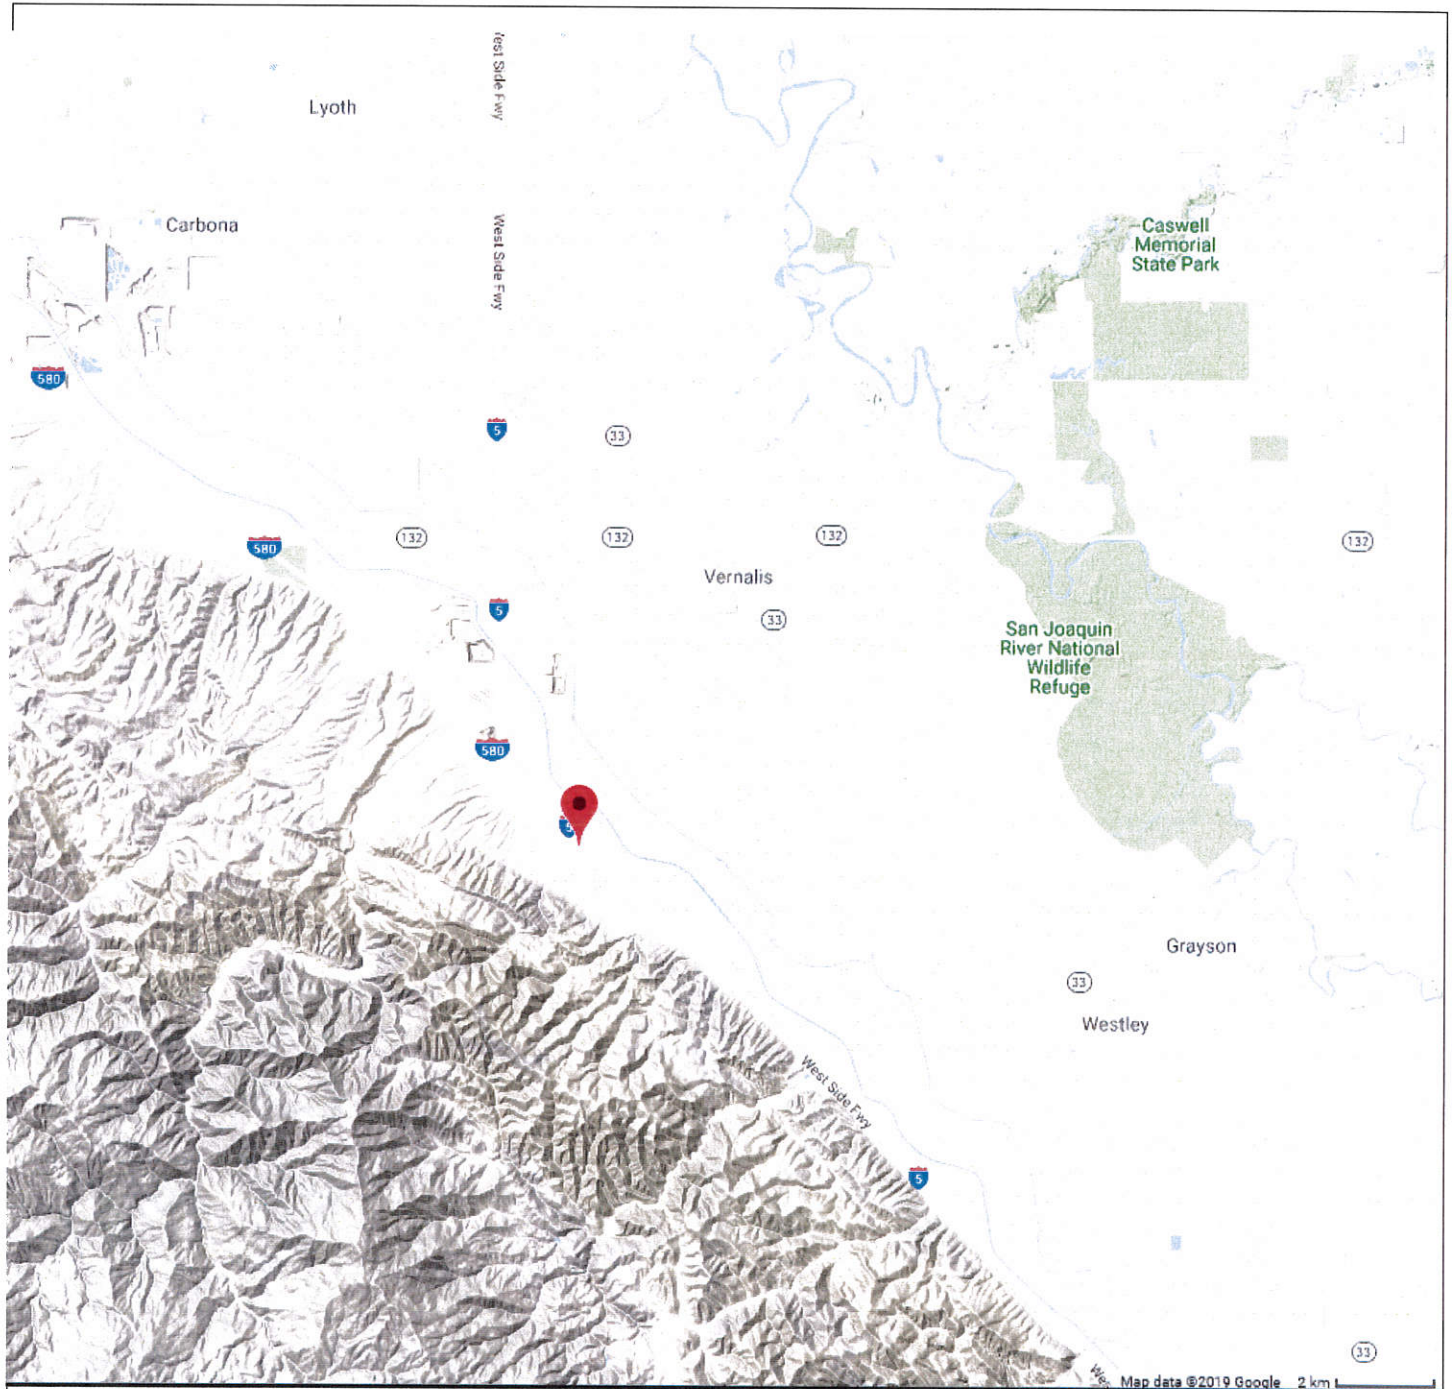

Source:
GeoTracker base map

SITE LOCATION MAP

CA DEPARTMENT OF TRANSPORTATION

WESTLEY SRRA

STANISLAUS COUNTY




approx. scale:
1 inch = 2.5 miles



SITE PLAN
CALIFORNIA DEPARTMENT OF TRANSPORTATION
WESTLEY SRRA
STANISLAUS COUNTY

scale not preserved



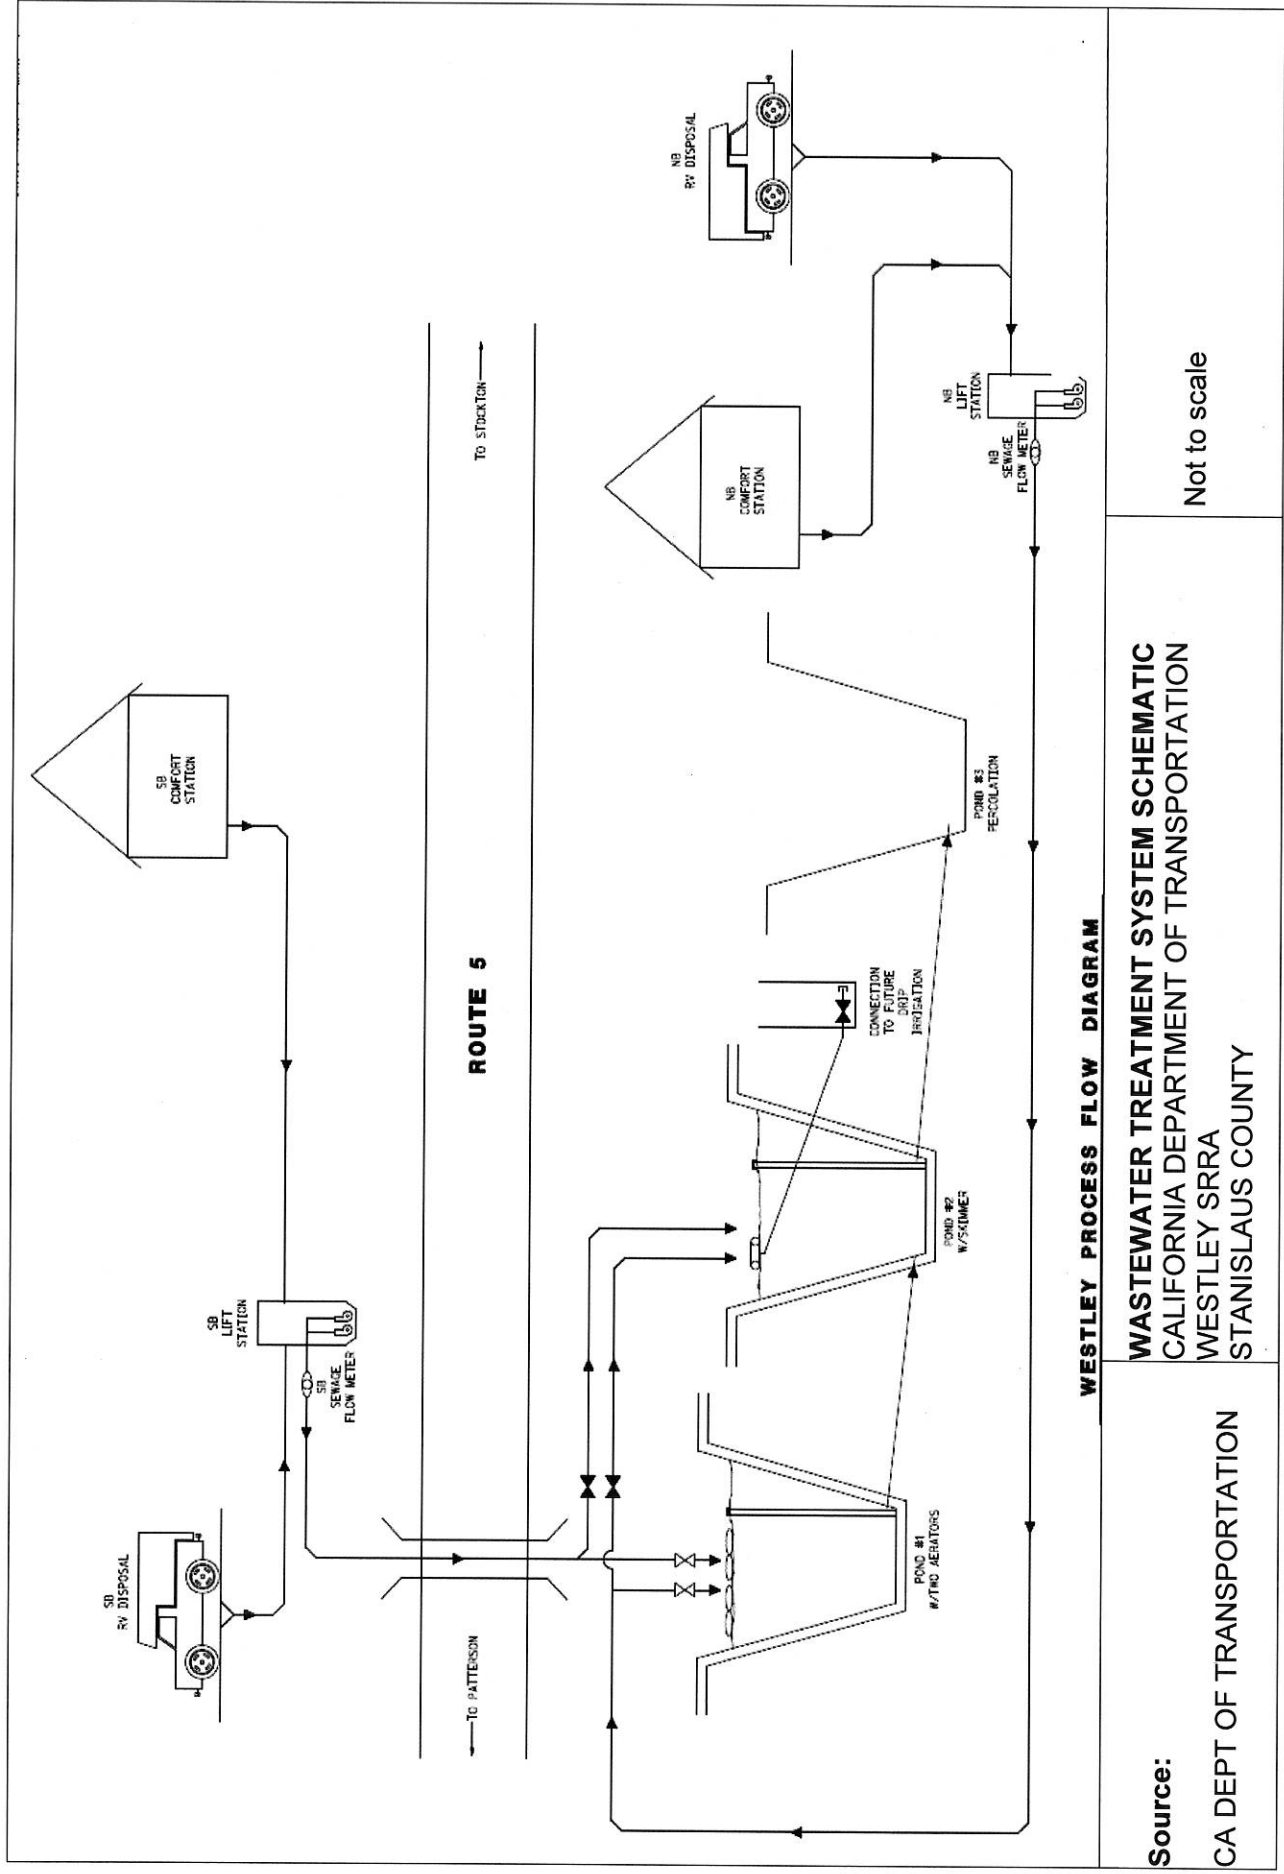

Source:
CA DEPT OF TRANSPORTATION

WASTEWATER TREATMENT SYSTEM SCHEMATIC
CALIFORNIA DEPARTMENT OF TRANSPORTATION
WESTLEY SRRA
STANISLAUS COUNTY

Not to scale

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM WQ 2014-0153-DWQ-R5304

FOR

CALIFORNIA DEPARTMENT OF TRANSPORTATION
WESTLEY SAFETY ROADSIDE REST AREA WWTP
STANISLAUS COUNTY

This Monitoring and Reporting Program (MRP) describes requirements for monitoring a wastewater treatment system at the Westley Safety Roadside Rest Area (SRRA) WWTP. This MRP is issued pursuant to Water Code section 13267. The Discharger shall not implement any changes to this MRP unless and until a revised MRP is issued by the Regional Water Quality Control Board, Central Valley Region (Central Valley Water Board) or Executive Officer.

Water Code section 13267 states, in part:

"In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports and shall identify the evidence that supports requiring that person to provide the reports."

Water Code section 13268 states, in part:

"(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs."

The Westley Safety Roadside Rest Area WWTP discharge is regulated by the Notice of Applicability (NOA) to Water Quality Order 2014-0153-DWQ and is owned and operated by California Department of Transportation (Caltrans). Pursuant to Water Code section 13267, the Discharger shall implement this MRP and submit the monitoring reports described herein. The reports are necessary to ensure that the Discharger complies with the NOA and General Order.

All samples shall be representative of the volume and nature of the discharge or matrix of material sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by Central Valley Water Board staff.

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board, Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

Laboratory analytical procedures shall comply with the methods and holding times specified in the following (as applicable to the medium to be analyzed):

- *Methods for Organic Chemical Analysis of Municipal and Industrial Wastewater* (EPA);
- *Test Methods for Evaluating Solid Waste* (EPA);
- *Methods for Chemical Analysis of Water and Wastes* (EPA);
- *Methods for Determination of Inorganic Substances in Environmental Samples* (EPA);
- *Standard Methods for the Examination of Water and Wastewater* (APHA/AWWA/WEF); and
- *Soil, Plant and Water Reference Methods for the Western Region* (WREP 125).

Approved editions shall be those that are approved for use by the United States Environmental Protection Agency (EPA) or the California Department of Public Health's Environmental Laboratory Accreditation Program (ELAP). The Discharger may propose alternative methods for approval by the Executive Officer. Where technically feasible, laboratory reporting limits shall be lower than concentrations that implement applicable water quality objectives/limits for the constituents to be analyzed.

A glossary of terms used in this MRP is included on the last page.

POND MONITORING

Influent Flow Monitoring

Influent flow shall be monitored upstream of the treatment system Pond 1 at the location shown in Attachment C as specified below:

Parameter	Units	Type of Sample	Monitoring Frequency	Reporting Frequency
Influent Flow	gpd	Meter Observation	Daily	Quarterly
¹ Measured monthly to calculate the average daily flow for the month.				

Wastewater Pond Monitoring

All wastewater and treated wastewater storage ponds (lined and unlined) shall be monitored as specified below.

Parameter	Units	Type of Sample	Monitoring Frequency	Reporting Frequency
Freeboard ¹	0.1 feet	Staff Gage	Weekly	Quarterly
Berm Condition	--	Observation	Weekly	Quarterly
Seepage ²	--	Observation	Weekly	Quarterly
Odors	--	Observation	Weekly	Quarterly
Dissolved Oxygen ³	mg/L	Grab	Monthly	Quarterly
Pond Liner Condition ⁴	--	Observation	Every 5 years	Every 5 Years
¹ Freeboard shall be measured vertically from the surface of the pond water to the lowest elevation of the surrounding berm and shall be measured to the nearest 0.1 feet. ² Pond containment berms shall be observed for signs of seepage or surfacing water along the exterior toe. If surfacing water is found, then a sample shall be collected and tested for total coliform organisms and total dissolved solids. ³ Dissolved oxygen shall be monitored at each pond that contains at least one foot of standing water. The report shall state how much water was in the pond if dissolved oxygen was not monitored. Samples shall be collected opposite the pond inlet at a depth of one foot. ⁴ The pond liner condition and a determination of whether the liner is leak-free shall be performed for each pond lined with a geosynthetic liner, starting no later than 5 years from the date of the Pond Liner Construction Quality Assurance Report.				

Effluent Monitoring

Effluent samples shall be collected from Pond 2 prior to disposal to Pond 3 or other means of disposal (e.g. subsurface disposal) as shown in Attachment C. At a minimum, the Discharger shall monitor effluent as specified below:

Parameter	Units	Type of Sample	Monitoring Frequency	Reporting Frequency
BOD ₅	mg/L	Grab	Monthly	Quarterly
Zinc	µg/L	Grab	Quarterly	Quarterly

Parameter	Units	Type of Sample	Monitoring Frequency	Reporting Frequency
Phenol	µg/L	Grab	Quarterly	Quarterly
Formaldehyde	µg/L	Grab	Quarterly	Quarterly

SOLIDS DISPOSAL MONITORING

The Discharger shall report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, etc.) generated at the wastewater system. Records shall include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. In those years when solids handling or disposal occurs, records shall be submitted as part of that year's annual monitoring report.

GROUNDWATER MONITORING

Due to this being a low-flow discharge, expected to attenuate with depth, and the depth to water being greater than 100 feet bgs, groundwater monitoring is not required at this time.

REPORTING

All monitoring reports should be converted to a searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50MB should be emailed to: centralvalleysacramento@waterboards.ca.gov.

Documents that are 50 MB or larger should be transferred to a CD, DVD, or flash drive and mailed to the following address:

Central Valley Regional Water Quality Control Board
ECM Mailroom
11020 Sun Center Drive, Suite 200
Rancho Cordova, California 95670

To ensure that your submittal is routed to the appropriate staff person, the following information should be included in the body of the email or transmittal sheet:

Attention: Compliance/Enforcement Section
California Department of Transportation (Caltrans)
Westley Safety Roadside Rest Area WWTP
Stanislaus County
Place ID: 820261

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., effluent, solids, etc.), and reported analytical or visual inspection results are readily discernible. The data shall be summarized to clearly illustrate compliance with the General Order and NOA as applicable. The results of any monitoring done more frequently than required at the locations specified in the MRP shall be reported in the next regularly scheduled monitoring report and shall be included in calculations as appropriate.

Monitoring information shall include the method detection limit (MDL) and the Reporting limit (RL) or practical quantitation limit (PQL). If the regulatory limit for a given constituent is less than the RL (or PQL), then any analytical results for that constituent that are below the RL (or PQL) but

above the MDL shall be reported and flagged as estimated. For a Discharger conducting any of its own analyses, reports must be signed and certified by the chief of the laboratory.

A. Quarterly Monitoring Reports

Quarterly reports shall be submitted to the Regional Water Board on the **first day of the second month after the quarter ends** (e.g., the January-March Quarterly Report is due by May 1st). The reports shall bear the certification and signature of the Discharger's authorized representative. At a minimum, the quarterly reports shall include:

1. Results of all required quarterly monitoring. Data shall be organized by the associated monitoring sections (e.g., Flow Monitoring, Effluent Monitoring, etc.) and presented in tabular format.
2. A comparison of monitoring data to the discharge specifications, flow limit, and effluent limits.
3. A disclosure of any violations of the NOA and/or General Order requirements and an explanation of corrective actions.
4. If requested by staff, copies of laboratory analytical report(s) and chain of custody form(s).

B. Annual Report

Annual Reports shall be submitted to the Regional Water Board by **February 1st following the monitoring year**. The Annual Report shall include the following:

1. Tabular and graphical summaries of all monitoring data collected during the year.
2. An evaluation of the performance of the wastewater treatment system, including discussion of capacity issues, nuisance conditions, system problems, and a forecast of the flows anticipated in the next year. A flow rate evaluation, as described in the General Order (Provision E.2.c), shall also be submitted if required.
3. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the NOA and/or General Order.
4. A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.
5. Every five years after the issuance of this NOA, the report shall include an evaluation of the pond liner condition and test results that determine whether the pond liner is leak-free. The report shall include procedures for replacement or repair of the liner when a leak is detected.
6. The name and contact information for the wastewater operator responsible for operation, maintenance, and system monitoring.

A letter transmitting the self-monitoring reports shall accompany each report. The letter shall clearly indicate the submitting Discharger's name, facility or site name, county, monitoring period, and type of report (i.e., monthly, quarterly, or annual). The letter shall include a discussion of any requirement violations during the reporting period and actions taken or planned for correcting noted violations, such as operation or facility modifications. If the discharger has previously submitted a report describing corrective actions and/or a time schedule for implementing the corrective actions, reference to the previous correspondence will

be satisfactory. Pursuant to the Standard Provisions and Reporting Requirements, the transmittal letter shall contain a statement by the Discharger or its authorized agent, under penalty of perjury, that to the best of the signer's knowledge, the report is true, accurate, and complete.

The Discharger shall implement the above monitoring program as of the date of the Order.

I, PATRICK PULUPA, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of a Monitoring and Reporting Program issued by the California Regional Water Quality Control Board, Central Valley Region on 9 July 2019.

Ordered by:

for Patrick Pulupa

PATRICK PULUPA, Executive Officer

GLOSSARY

BOD ₅	Five-day biochemical oxygen demand
CaCO ₃	Calcium carbonate
DO	Dissolved oxygen
EC	Electrical conductivity at 25° C
FDS	Fixed dissolved solids
NTU	Nephelometric turbidity unit
TKN	Total Kjeldahl nitrogen
TDS	Total dissolved solids
TSS	Total suspended solids
Continuous	The specified parameter shall be measured by a meter continuously.
24-hr Composite	Samples shall be a flow-proportioned composite consisting of at least eight aliquots over a 24-hour period.
Daily	Every day except weekends or holidays.
Twice Weekly	Twice per week on non-consecutive days.
Weekly	Once per week.
Twice Monthly	Twice per month during non-consecutive weeks.
Monthly	Once per calendar month.
Bimonthly	Once every two calendar months (i.e., six times per year) during non-consecutive months.
Quarterly	Once per calendar quarter.
Semiannually	Once every six calendar months (i.e., two times per year) during non-consecutive quarters.
Annually	Once per year.
bgs	below ground surface
gpd	Gallons per day
MGD	Million gallons per day
mg/L	Milligrams per liter
mL/L	Milliliters [of solids] per liter
MPN/100 mL	Most probable number [of organisms] per 100 milliliters
MTF	Multiple tube fermentation
µg/L	Micrograms per liter
µmhos/cm	Micromhos per centimeter