
Central Coast Regional Water Quality Control Board

May 27, 2022

Tom Messier
Rancho Larios Homeowners Associations
19500 Monterey Road
Morgan Hill, CA, 95037
Email: tmessier1692@aol.com

Sent Via Electronic Mail

Steve Loupe
San Benito County Resource Management Agency
2301 Technology Parkway
Hollister, CA, 95023
Email: SLoupe@cosb.us

Sent Via Electronic Mail

Dear Tom Messier and Steve Loupe,

RANCHO LARIOS DOMESTIC WASTEWATER TREATMENT PLANT, ROCKS ROAD, SAN JUAN BAUTISTA, CA, 95045, SANTA BENITO COUNTY:

- **NOTICE OF APPLICABILITY FOR RANCHO LARIOS HOMEOWNERS ASSOCIATION'S ENROLLMENT IN ORDER WQ 2014-0153-DWQ, *GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0041**
- **TERMINATION OF WASTE DISCHARGE AND WATER RECYCLING REQUIREMENTS ORDER NO. R3-2004-0153 FOR THE COUNTY OF SAN BENITO, COUNTY SERVICE AREA 45 RANCHO LARIOS**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200 Report of Waste Discharge (received on February 28, 2022), and available documents submitted by Wallace Group on behalf of Rancho Larios Homeowners Associations (Rancho Larios HOA) for the domestic wastewater treatment system at Rancho Larios Domestic Wastewater Treatment Plant. The wastewater system is currently regulated pursuant to individual permit Order No. R3-2004-0153 with the County of San Benito County Service Area 45 as the responsible party for permit compliance.

On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water

Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. R3-2004-0153.

The County and Rancho Larios HOA want to transfer permitting responsibilities from the County of San Benito to the Rancho Larios HOA. This letter serves as a notice of applicability for Rancho Larios HOA enrollment in the General Permit for the discharge of wastewater, and production and use of recycled water from Rancho Larios Domestic Wastewater Treatment Plant. This letter terminates the County of San Benito Service Area 45's individual permit Order No. R3-2004-0153 for this facility.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Rancho Larios HOA must comply with the following:

1. **General Permit** – Rancho Larios HOA must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Rancho Larios HOA must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0041, enclosed with this letter (Attachment 3). Rancho Larios must start implementing the monitoring on **August 1, 2022**. Your first semiannual report is due on **February 1, 2023**.

Monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Rancho Larios HOA must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

Information (ESI) requirements under the wastewater system-specific global identification number WDR100035692 at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Rancho Larios HOA paid an annual fee on December 22, 2021 for coverage in the existing individual permit, Order No. R3-2004-0153. This payment covers permit fees for the 2021-2022 fiscal year.

Rancho Larios HOA must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$3,743. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 3B and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on August 25-26, 2022. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Rancho Larios HOA is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Rancho Larios HOA to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Rancho Larios HOA must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit.

Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.

8. **Certified Operator** – Rancho Larios HOA is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Class III certified operator onsite to maintain and operate the treatment system.
9. **Title 22 Engineering Report** – In May 2002, Fuog Water Resources Inc., on behalf of the County of San Benito, submitted Amendment of Waste Discharge Engineering Report (Engineering Report) in accordance with California Code of Regulation, title 22, Division 4 (title 22) engineering report. In an October 9, 2003 letter to the Central Coast Water Board, the California Department of Health Services conditionally approved the recycled water uses described in the Engineering Report to distribute recycled water for irrigation of soccer fields and green of areas surrounding the tennis and volleyball courts. In a September 17, 2003 letter, the Central Coast Water Board provided requirements for construction grading and soil compaction related to the title 22 engineering report. Rancho Larios HOA must comply with the provisions contained in the October 9, 2003 (Attachment 4) and the requirements contained in the September 17, 2003 letter (Attachment 5).
10. **Termination of Order No R3-2004-0153 for the County** - The County of San Benito's enrollment in Order No. R3-2004-0153 is terminated, except for enforcement purposes. County of San Benito is responsible for compliance with the Order No. R3-2004-0153 for the Rancho Larios Domestic Wastewater Treatment Plant prior to the date of this letter.

If you have any questions, please contact **Mark Lemus at (805) 549-3703 or by email at Mark.Lemus@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp
Digitally signed by Jennifer Epp
Date: 2022.05.27 08:52:54
-07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0041

Attachment 4: California Department of Public Health letter dated Oct 9, 2003

Attachment 5: Central Coast Water Board letter dated September 17, 2003

c:

Kari Wagner, Wallace Group, KARIW@wallacegroup.us

Miles Farmer, Cypress Water Services, Miles@cypresswaterservices.com

Reed Sanders, San Benito County RMA, <mailto:RSanders@cosb.us>

Todd Stanley, Central Coast Water Board Todd.Stanely@Waterboards.ca.gov

Jennifer Epp, Central Coast Water Board Jennifer.Epp@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-251675

GeoTracker No. = GT- WDR100035692

Rev 3/11/22

Subject Name = Rancho Larios HOA Wastewater Permit

R:\RB3\Shared\WDR\WDR Facilities\San Benito Co\Rancho Larios\2022\0153

NOA_Rancho Larios_Draft.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Rancho Larios HOA to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Rancho Larios Domestic Wastewater Treatment Plant
Facility Address	Rocks Road San Juan Bautista, CA, 95045
Parcel Numbers	012-140-026-000
Latitude/Longitude	36.843921, -121.575067
Owner of Facility	Rancho Larios Homeowners Associations
Legally Responsible Official	Tom Messier
Owner Mailing Address	19500 Monterey Road Morgan Hill, CA, 95037
Billing Address	19500 Monterey Road Morgan Hill, CA, 95037
Design Flow (gallons per day, gpd)	Maximum daily capacity (dry weather flow) 50,000
Baseline Flow (average annual flow) in gpd	37,000
Operators	Miles Farmer - Chief Plant Operator, Grade III, Cypress Water Services
Waste type and Service Area	Domestic wastewater from 140 homes within the Rancho Larios HOA
Threat to Water Quality	3
Complexity	B
Nearest Water Body	The San Benito River is the nearest surface water located approximately 3 miles northeast of the Rancho Larios HOA
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater

Regulatory measure Type	Enrollee - WDR
Reclamation Included	Yes, Producer and User

2. WASTEWATER SYSTEM OPERATION SUMMARY

A summary of the system is included in Table 2 below. A facility location n and site map are shown in Attachment 2.

Table 2. Permitted Treatment, Disposal, and Reclamation Technology and Capacity

Design Flows	Design Influent Maximum Daily Flow 50,000 gpd Design Influent Average Flow 37,000 gpd
Headworks/Preliminary Treatment	Static Parabolic Screen
Primary Treatment	Not Applicable
Secondary Treatment	Two Activated Sludge Sequencing Batch Reactors
Tertiary Treatment	Polymer-assisted Sand Filtration
Disinfection	Chlorination with 12% Sodium Hypochlorite, underground chlorine contact pipe.
Effluent Storage	15.8 acre-foot storage recycled water reservoir
Disposal	10 acre Land Application Area for off-specification reclaimed water.
Biosolids/Sludge Production and Handling	Aerobic Digester and Solids Dewatering & Bagging System
Non-Potable Recycled Water	Disinfected Tertiary 2.2 Recycled Water is used for irrigation of community soccer field, tennis courts green areas, and volleyball lawn areas as detailed in the Rancho Larios HOA Amendment to Waste Discharge Disinfected Secondary-23 Recycled Water may be used for onsite soil compaction and dust control as detailed in the Rancho Larios Amendment to Waste Discharge Any off-specification reclaimed water must be sent to the Land Application Area.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Rancho Larios HOA must operate the facility in accordance with the General Order⁴ and this notice of applicability.⁵

⁴ General Order sections B.2, B.3, and B.6 are not applicable for this facility.

⁵ General Order section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Order, effluent limits in the General Order, and compliance with site-specific limits set forth in this notice of applicability.

A. Effluent limits

Rancho Larios Domestic HOA must comply with the site-specific limits listed in Table 3.

Table 3. Effluent Limits

Constituent	Unit	Limit	Point of Compliance
Flow	gpd	50,000 (maximum daily flow) 100,000 (Instantaneous max)	Influent (IS-1) ^[1]
Total Suspended Solids (TSS)	mg/L ^[2]	30 (monthly average) 45 (7-day average)	Effluent (ES-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	30 (monthly average) 45 (7-day average)	Effluent (ES-1)
Total Nitrogen	mg/L	10 mg/L	Effluent (ES-1)
Disinfected Tertiary Recycled Water ^[3]			
Total Coliform	MPN/100 mL ^[3]	Must not exceed: a. Seven-day median concentration of 2.2 b. 23 in more than one sample taken over a 30 day range c. 240 at any time	Disinfection Process (ES-2)
Turbidity	NTU ^[5]	2 (24 hour mean) 5 (5-percent of 24 hour period) 10 (Instantaneous Max)	Tertiary Filtration Process (ES-2)
Filtration Rate ^[6]	gpm/sq-ft ^[7]	5	Tertiary Filtration Process (ES-2)
CT ^[8]	mg-min/L ^[9]	450 at all times with a minimum modal contact time of 90 minutes	Disinfection Process (ES-2)
Disinfected Secondary-23 Recycled Water ^[3]			
Total Coliform	MPN/100 mL	Must not exceed: a. 23 in more than one sample taken over a 30 day range b. 240 at any time	Disinfection Process (ES-1)

- [1] Refer to monitoring and reporting program for sampling locations
- [2] mg/L denotes milligrams per liter
- [3] Point of compliance for Recycled Water Limits must be immediately following appropriate treatment process which will collectively sampled at ES-2.
- [4] MPN / mL denotes most probable number per milliliter
- [5] NTU denotes nephelometric turbidity units.
- [6] Rate limits apply or mono, dual or mixed media filtration systems
- [7] gpm/sq-ft denotes gallons per minute per square foot
- [8] CT is the product of total chlorine residual and modal contact time measured at the same point
- [9] mg-min/L denote milligram minutes per liter

B. Groundwater Limits

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Rancho Larios HOA must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁶ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Because the receiving groundwater has a designated use of municipal and domestic supply, objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.

Based on the existing effluent water quality, the Central Coast Water Board does not require first-encountered groundwater monitoring wells. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require installation of groundwater monitoring wells in the future.

C. Recycled Water Use Area Requirements

As stated in Finding 7 and Section A, Prohibition 6, of the General Permit, use of recycled water is only allowed on land owned, operated, and controlled by Rancho Larios HOA. Onsite use of recycled water use must be as described, and in a manner, consistent with the title 22 regulations for recycled water, the General Permit, this Notice of Applicability, the title 22 engineering report, and the Division of Drinking Water (previously called the California Department of Health Services) and Central Coast

⁶ Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

Water Board conditions contained in the title 22 engineering report letters (Attachments 4 and 5).

ATTACHMENT 2
FIGURES



Figure 1. Site Location Map



ATTACHMENT 2: RANCHO LARIOS WWTP SITE MAP

Figure 2. Site Map

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2022-0041

for

**RANCHO LARIOS DOMESTIC WASTEWATER TREATMENT PLANT
SANTA BENITO COUNTY**

This monitoring and reporting program (MRP) describes requirements for monitoring a wastewater treatment system for Rancho Larios Homeowners Associations (Rancho Larios HOA) located at Rocks Road in San Juan Bautista, CA, 95045.

Rancho Larios HOA owns and operates the wastewater system that is subject to the notice of applicability (NOA) dated May 27, 2022, for coverage in Order WQ 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;

2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Rancho Larios HOA may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Rancho Larios HOA must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 2. Rancho Larios HOA must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually
Chloride	mg/L	Grab	Annually	Annually
Sodium	mg/L	Grab	Annually	Annually
Boron	mg/L	Grab	Annually	Annually
Sulfate	mg/L	Grab	Annually	Annually
Carbonate	mg/L	Grab	Annually	Annually
Bicarbonate	mg/L	Grab	Annually	Annually
Calcium	mg/L	Grab	Annually	Annually
Potassium	mg/L	Grab	Annually	Annually
Magnesium	mg/L	Grab	Annually	Annually

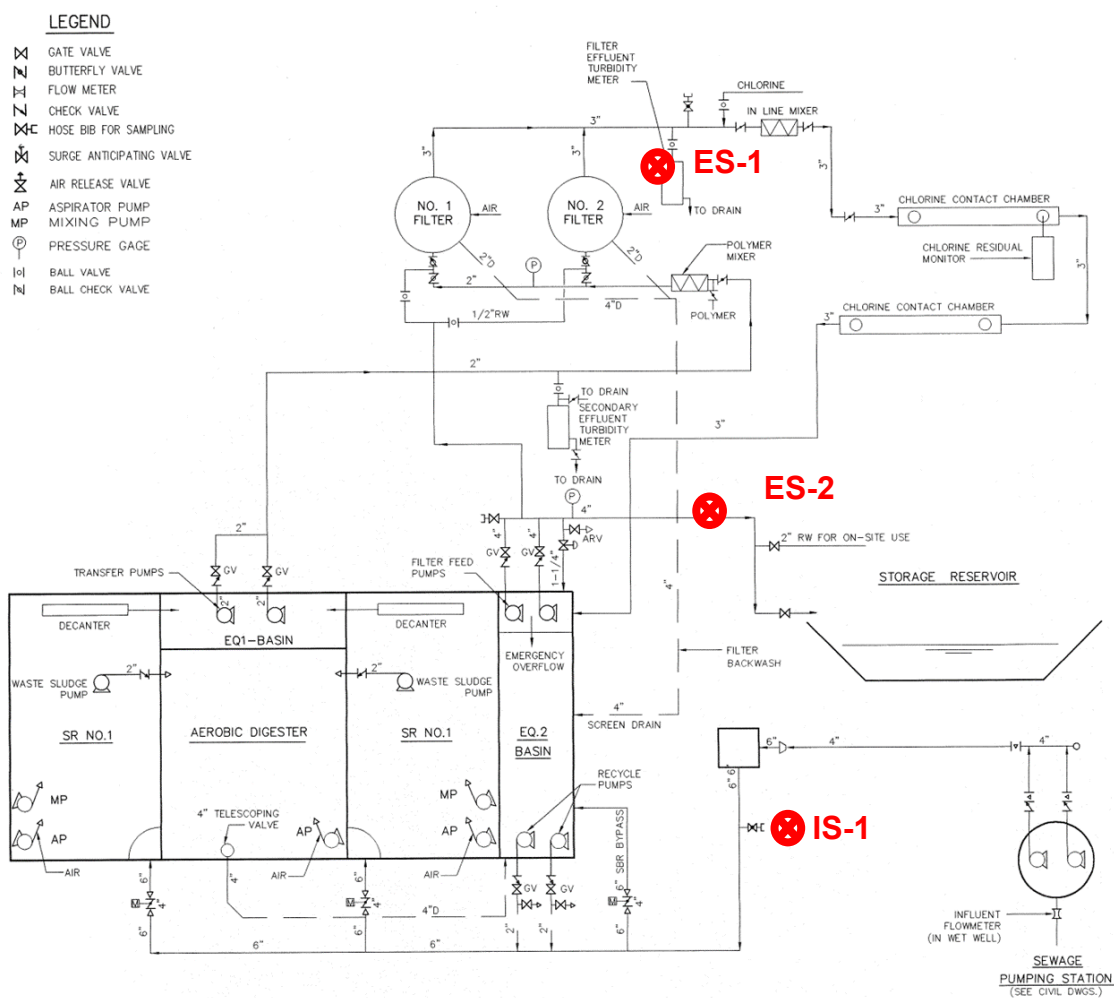
mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample after screening and before anoxic tank
Effluent Sample – 1	ES-1	Representative grab sample from MBR effluent pipeline before effluent storage tank
Recycled Water Sample -1	ES-2	Continuous monitoring of NTU, Chlorine residual, and grab samples for total coliform

**Figure 1. Process Flow Diagram with Sampling Locations****4. TREATMENT SYSTEM MONITORING****A. Flow Monitoring**

Rancho Larios HOA must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at sample location ES-1 after the Sequencing Batch Reactor, and influent flow is approximately equal to effluent flow.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Reporting Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

B. Influent and Effluent Constituent Monitoring

Representative samples of Rancho Larios Domestic Wastewater Treatment Plant's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. Unless otherwise noted all samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency	EFFLUENT (ES-2) Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Monthly	Monthly	Not Required
Total Suspended Solids	mg/L	Monthly	Monthly	Not Required
pH	pH units	Not Required	Monthly	Not Required
Total Nitrogen	mg/L	Quarterly	Quarterly	Not Required
Nitrate (as N) + Nitrite (as N) or separate species ^[1]	mg/L	Quarterly	Quarterly	Not Required
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly	Not Required
Total Dissolved Solids	mg/L	Semi-annually	Quarterly	Not Required
Chloride	mg/L	Semi-annually	Quarterly	Not Required
Sodium	mg/L	Semi-annually	Quarterly	Not Required
Sulfate	mg/L	Semi-annually	Quarterly	Not Required

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency	EFFLUENT (ES-2) Sampling Frequency
Bacteria (Total Coliform) ^[2]	MPN/ 100	Not Required	Not Required	Daily
Chlorine Residual ^[3]	mg/L	Not Required	Not Required	Continuously
CT ^[4]	mg-	Not Required	Not Required	Continuously
Turbidity ^[5]	NTU	Not Required	Not Required	Continuously
Priority Pollutants ^[6]	Varies	Not Required	Not Required	Every 5 Years

mg/L denotes milligram per liter

MPN/100 mL denotes most probable number per 100 mL sample

NTU denotes Nephelometric Turbidity unit

[1] Nitrate and nitrite sample may be combined

[2] Sampling for total coliform bacteria must be done at least once daily for every day that recycled water is produced. The samples must be taken from the disinfected effluent. Report maximum daily total coliform and rolling seven-day median values in a monthly tabular format. For rolling seven-day median determination, use days when recycled water is produced and sampled for total coliform bacteria.

[3] Must be compared to the chlorine residual required to achieve a minimum CT value of 450 milligrams-minutes per liter at all times with a modal contact time of at least 90 minutes, based on peak dry weather design flow in each contact basin. Report minimum daily CT values in a monthly tabular format.

[4] CT= the Product of total chlorine residual and modal contact time measured at the same point. Report minimum daily CT values in a monthly tabular format.

[5] At a minimum, daily average operating filtered effluent turbidity must be determined by averaging the levels of recorded turbidity taken at four-hour intervals over a 24-hour period per title 22 section 60321. Compliance with turbidity pursuant to the title 22 section 60301.320 (a)(2)(B) and (b)(1) must be determined using the levels of recorded turbidity taken at intervals of no more than 1.2 hours over a 24-hour period. Should the continuous turbidity meter and recorder fail, grab sampling at a minimum frequency of 1.-hours may be substituted for a period of up to 23-hours.

[6] As per finding 15 of the General Permit, irrigation of landscape with recycled water for flows less than one million gallons per day are required to sample for the Priority Pollutants listed in Appendix A of 40 CFR Part 423.

C. Recycled Water System

Rancho Larios HOA must monitor and report their dual plumbed recycled water systems as follows. If the water purveyor conducts the annual inspections/testing, Rancho Larios may elect to include those inspection/testing results with the following semi-annual report.

Table 6. Dual Plumbed Recycled Water System Monitoring

Requirement	Frequency	Reporting Frequency
Cross Connection Testing	Annually	Within 30 days/Annually ^[2]
Backflow Prevention Device Testing and Maintenance	Annually ^[1]	Annually
Backflow Incident	--	Within 24 hours of discovery
Cross Connection Device Use	--	Within 24 hours of use/Seven-days ^[3]

[1] Testing shall be performed by a qualified person as described in CCR, title 17, section 7605

[2] Testing results must be submitted within 30 days and included in the next semi-annual report.

[3] Use of cross connection device notification must be sent to the State Water Board Division of Drinking Water and the Regional Board within 24 hours of all switchovers. Notice must include:

- A. Timeframe estimate between switchovers
- B. Contact information for Water Purveyor Supervisor present during switchover
- C. Upstream Backflow Prevention tests results immediately prior to the use of cross connection device.

Within Seven days of each switchover, a written report must be submitted to the State Water Board Division of Drinking Water and the Regional Board describing compliance with regulations and usage amounts of potable and recycled water usage information.

D. Pond Monitoring

Recycled water storage ponds must be monitored consistent with Table 7. Rancho Larios HOA must inspect the ponds weekly and notations must be made in a bound logbook and include “observations” of the items in Table 7. Any problems must be promptly corrected and recorded. The bound logbook of these observations must be maintained onsite and made available to the Central Coast Water Board upon inspection. Only violations and mitigation measures must be included in the subsequent monitoring report.

Table 7. Pond Monitoring

Parameter	Units	Sample Type	Sample Frequency
Dissolved Oxygen	mg/L ¹	Grab ²	Weekly
pH	Std. units	Grab ²	Weekly
Evaporation	Inches	Weather station ³	Daily
Freeboard	0.1 feet	Measurement	Daily
Odors	--	Observation	Weekly
Berm Condition	--	Observation	Weekly
Plant Growth	--	Observation	Weekly
Vectors or Animals Burrowing	--	Observation	Weekly
Disposal Area Condition	--	Observation	Weekly

¹ mg/L denotes milligrams per liter

² Grab samples can be collected via handheld probe, see section 1 of this MRP

³ Weather station may be site-specific station, onsite evaporation pan, or nearby governmental weather reporting station

5. RECYCLED WATER IRRIGATION AND LAND APPLICATION AREA MONITORING

Rancho Larios HOA must monitor the recycled water irrigation use areas and the Land Application Areas when treated wastewater effluent is applied. If treated wastewater effluent is not applied during a reporting period, the monitoring report shall so state. Precipitation, windspeed and direction shall be recorded regardless if treated wastewater effluent is currently being applied. The recycled water irrigation use area and Land Application Areas monitoring shall include the following:

Table 8. Recycled Water Irrigation and Land Application Area Monitoring

Parameter	Units	Sample Type	Sample Frequency
Daily Effluent Flow	gpd ¹	Metered/Estimated ²	Monthly
Total Flow	gallons	Calculated	Monthly
Acreage Applied ³	Acres	Calculated	Monthly
Application Rate	gal/acres/mo	Calculated	Monthly
Local Rainfall	Inches	Weather Station ⁴	Each Precipitation Event
Wind Speed & Direction	mph ⁵	Weather Station	Daily
Irrigation Equipment	--	Observations ⁶	Weekly
Nuisance Odor Condition	--	Observations	Weekly
Saturated Soil/Ponding	--	Observations	Weekly
Plant Growth	--	Observations	Weekly
Vectors or Animals Burrowing	--	Observations	Weekly
Evidence of Soil Erosion	--	Observations	Weekly
Notification Signs ⁷	--	Observations	Quarterly

¹ gpd denotes gallons per day

² Effluent flow can be determined via meter reading, or estimated with pump time meter calculations.

³ Acreage applied denotes the acreage to which wastewater is applied.

⁴ Weather station may be site-specific station, onsite gauge, or nearby governmental weather reporting station.

⁵ mph denotes miles per hour

⁶ Observations must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded.

⁷ Notification signs shall be consistent with the requirements of California Code of Regulations, title 22, section 60310 (g).

6. SOLIDS DISPOSAL MONITORING

Rancho Larios HOA must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

7. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 9.

Table 9. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** -- Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Order requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen, Total Coliforms) over time, nuisance conditions, system problems, etc.
A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Disposal Area Inspection** -- Report the results of the disposal area inspections, as described in Section 6.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 7.
- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

8. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/docs/transmittal_sheet.pdf

Rancho Larios HOA must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number WDR100035692 over the internet at:

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml.

Table 10 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 10. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

9. TECHNICAL REPORTS

Rancho Larios HOA must submit to GeoTracker the three reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 11. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	90 days from date of General Permit enrollment ^[1]
Sampling and Analysis Plan	90 days from date of General Permit enrollment ^[1]
Sludge Management Plan	90 days from date of General Permit enrollment ^[1]

^[1] The date of General Permit enrollment is May 27, 2022

10. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Rancho Larios HOA submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Rancho Larios HOA to enforcement action pursuant to section [13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Rancho Larios HOA is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. Rancho Larios HOA

Rancho Larios HOA must implement the above monitoring program as of the date of this MRP. The Central Coast Water Board may rescind or modify the MRP at any time. Rancho Larios HOA must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Water Board.

Ordered by:

Jennifer Epp Digitally signed by Jennifer Epp
Date: 2022.05.27 08:53:39 -07'00'
Water Boards

for Matthew T. Keeling
Executive Officer

lett



State of California—Health and Human Services Agency
Department of Health Services



DIANA M. BONTÁ, R.N., Dr. P.H.
Director

GRAY DAVIS
Governor

October 9, 2003

Mr. Rene Fuog
Fuog Water Resources, Inc
1949 Cape Hilda Place
San Jose, CA 95133

Dear Mr. Fuog:

✓ SAN BENITO CO.

Rancho Larios Recycled Water Project, System No. 3590001
Final Comments on the Site Use Plans for the Recreational Facilities

The Monterey District office has reviewed the revised plans dated August 20, 2003 for the recycled water irrigation for the recreational facilities in Rancho Larios. The Department approves the plans for irrigation of the soccer fields with recycled water, and for the conversion of the irrigation facilities surrounding the tennis courts and volleyball court from potable water to recycled water, with the following provisions:

1. The text box on Sheet L1-1, titled "Conversion Description", has been superseded by the Conversion Description text box on Sheet L1-2. The text box on L1-1 should be deleted.
2. The Conversion Description text box on Sheet L1-2 should state that the sprinkler line between the tennis courts and the soccer field, which extends around to the west side of the courts, will be converted from potable water to recycled water as part of Phase 1.
3. On Sheet L1-2, under Recycled Water Notes, it is stated that clearance requirements for potable and non-potable lines shall be in accordance with the City of San Jose – Southbay Recycling drawings. These drawings are included in the project engineering report. However, they must also be included in the project construction plans.
4. It is recommended that pressure shutdown tests be conducted at the completion of Phase I and at the completion of Phase II to ensure that no cross connections with the potable water system have occurred. Aromas Water District staff should be present during these tests.
5. Construction plans for the swivel-ell connection as a supplemental irrigation water supply have not been provided for Department review and approval. Please contact our office to schedule a site inspection of the swivel-ell after construction of the connection has been completed and prior to initiating the use of recycled water for irrigation.

Items # 1 and 2 above were discussed in a phone call on October 1, 2003 between Don Kellogg and Jan Sweigert, an engineer in our office.

Please note that the Department had submitted comments by letter dated August 26, 2003 on the Rancho Larios Engineering Report Amendment. Additional action was required by Comments #1, 2, 3 and 4 in



Do your part to help California save energy. To learn more about saving energy, visit the following web site:
www.consumerenergycenter.org/flex/index.html

Northern California Drinking Water Field Operations Branch
1 Lower Ragsdale, Building 1, Suite 120, Monterey, CA 93940-5741
(831) 655-6939; Fax (831) 655-6944
Internet Address: <http://www.dhs.ca.gov/ps/ddwem/>

the letter. To date, we have not received the information requested in Comments #1, 2 and 3, and have not received the final signed agreement requested in Comment #4.

If you have any questions regarding, please call me or Jan Sweigert at (831) 655-6939.

Sincerely,



Betsy S. Lichti, P.E.

District Engineer, Monterey District

DRINKING WATER FIELD OPERATIONS BRANCH

cc: San Benito County Health Department
Mr. Matt Keeling, Regional Water Quality Control Board-Central Coast Region
Mr. Don Kellogg – Larwin Company, 801 San Ramon Road, Suite G, Danville CA 94526
Aromas Water District



California Regional Water Quality Control Board

Central Coast Region

Winston H. Hickox
Secretary for
Environmental
Protection

Internet Address: <http://www.swrcb.ca.gov/rwqcb3>
895 Aerovista Place, Suite 101, San Luis Obispo, California 93401
Phone (805) 549-3147 • FAX (805) 543-0397



Gray Davis
Governor

September 17, 2003

Don Kellogg
Larwin Company
50 Oak Court, Suite 202
Danville, CA 94526-4048

Dear Mr. Kellogg:

**RE: RANCHO LARIOS WASTEWATER TREATMENT FACILITY, SAN BENITO COUNTY
SERVICE AREA NO. 45, WDR ORDER NO. 98-75; UTILIZATION OF WASTEWATER FOR
CONSTRUCTION GRADING/SOIL COMPACTION**

We have reviewed your request to utilize reclaimed water from the Rancho Larios wastewater treatment facility storage pond for moisture conditioning of soil during grading operations (soil compaction). We understand that up to approximately 1.5 million gallons of tertiary treated wastewater will be used for soil compaction purposes during the last phase of the Rancho Larios development project and that the grading operation is scheduled to be complete October 15, 2003. We do not object to your proposal given use of the reclaimed wastewater is conducted in accordance with California Code of Regulations Title 22 requirements, which governs the use of recycled water, and the following requirements:

1. The Department of Health Services shall be in concurrence with the proposed recycled water usage.
2. No runoff shall be allowed to leave the project grading area.
3. No irrigation with, or impoundment of, recycled water shall take place within 100 feet of any domestic water supply well.
4. Spray, mist, or runoff shall not enter dwellings, designated outdoor eating areas, or food handling facilities.
5. No spray irrigation of recycled water shall take place within 100 feet of a residence or a place where public exposure could be similar to that of a park, playground, or schoolyard.
6. Readily visible 'non-potable' signage shall be posted on all trucks and equipment used to transport recycled water and in areas of spray irrigation.
7. All on-site staff and personnel shall be verbally notified of recycled water usage at the sight during a site safety meeting prior to implementation.

Be aware that the production and use of recycled water is subject to surveillance by this Regional Board, the California Department of Health Services, and the Monterey County Department of Environmental Health. The above requirements will be strictly enforced.

California Environmental Protection Agency



Recycled Paper

September 17, 2003

Questions regarding this matter may be directed to **Matthew Keeling** at (805) 549-3685 or **mkeeling@rb3.swrcb.ca.gov**, or Chris Adair at (805) 549-3761.

Sincerely,



for Roger W. Briggs
Executive Officer

Paper File: Discharger, San Benito County CSA 45, Rancho Larios

Electronic File: S:\WB\Northern Watershed\Matt\Facilities\WDRs\Rancho Larios\www grading req 090203.doc

Task Code: 126-01

cc: Lloyd Bracewell
Bracewell Engineering, Inc.
6239 College Avenue, Suite 202
Oakland, CA 94618

Doug Koenig
San Benito County Department of Public Works
3220 Southside Road
Hollister, CA 95023

Betsi Lichti
Department of Health Services
Northern California Drinking Water Field Operations Branch
1 Lower Regsdale, Building 1, Suite 120
Monterey, CA 93940-5741

Robert Shingai
San Benito County
Division of Environmental Health
1111 San Felipe Road, Suite 101
Hollister, CA 95023





August 28, 2003

VIA FAX

California Regional Water Quality Control Board
81 South Higuera Street, Suite 200
San Luis Obispo, CA 93401

Att: Matthew Keeling

Re: Rancho Larios - Utilization of Recycled Water for Grading

Dear Matt,

We would like to utilize reclaimed water from the Rancho Larios WWTP, which is currently stored in the storage pond at our project, for moisture conditioning of soil during our grading operation. The last phase of the project is now being graded (see attached site map). We are currently using potable water supplied by the Aromas Water District. However, the District is having difficulty supplying our needs. The reclaimed pond is currently approximately one-third full. Based on this, there may be 1.5 million gallons that we could utilize. Our mass grading operation is 230,000 CY in size and is scheduled to be complete October 15, 2003.

The reclaimed water would be pumped directly from the pond into water trucks. Everyone involved in the grading operation would be advised that it would be non-potable water. Signs would be posted at the pond where the water trucks would be filled and at the grading operation. Water from the trucks is sprayed on the soil after the scrapers dump their loads, and it is sprayed on the soil when the compactors run over it. The on-site soil engineer determines the optimum moisture content for compaction. Approximately 3% to 5% water is typically added to the soil (based on weight). Based on my personal observation, there is no runoff.

Please indicate if this utilization of reclaimed water is acceptable. Your prompt response would be appreciated. Contact me at (408) 839-3333 if you have any questions or comments.

Sincerely,

Don Kellogg
Vice President Operations

CENTRAL COAST REGIONAL
WATER QUALITY CONTROL BOARD
RECEIVED
2003 AUG 28 PM 4:05
81 HIGUERA, STE. 200
SAN LUIS OBISPO, CA 93401

