



Central Valley Regional Water Quality Control Board

18 June 2021

Jesse Hampton
Calaveras County Water District
P.O. Box 846
San Andreas, California 95249

CERTIFIED MAIL
7020-1810-0002-0569-0098

NOTICE OF APPLICABILITY

GENERAL WASTE DISCHARGE REQUIREMENTS FOR
SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS
ORDER WQ 2014-0153-DWQ
FOR
CALAVERAS COUNTY WATER DISTRICT
SOUTHWORTH RANCH ESTATES WASTEWATER TREATMENT FACILITY
CALAVERAS COUNTY

On 2 July 2020, the Calaveras County Water District (CCWD, hereafter Discharger) submitted a Report of Waste Discharge (RWD) for Southworth Ranch Estates Wastewater Treatment Facility (WWTF) requesting to obtain coverage under the State Water Resources Control Board's (State Water Board's) General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems, Order WQ 2014-0153-DWQ (General Order). This Notice of Applicability (NOA) provides notice that the General Order is applicable to the site as described below. You are hereby assigned Order WQ 2014-0153-DWQ-R5357 for the discharge. After Waste Discharge Requirements (WDRs) Order 90-258 has been rescinded, coverage under General Order 2014-0153-DWQ will become effective. A copy of the [General Order](#) is enclosed and also available at:

(http://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf)

You should familiarize yourself with the entire General Order and its attachments, which describe mandatory discharge and monitoring requirements. The General Order contains operational and reporting requirements by wastewater system type. Sampling, monitoring, and reporting requirements applicable to your treatment and disposal methods must be completed in accordance with the appropriate treatment system sections of the General Order and the attached Monitoring and Reporting Program (MRP) WQ 2014-0153-DWQ-R5357. The Discharger is responsible for all the applicable requirements that exist in the General Order

KARL E. LONGLEY SCD, P.E., CHAIR | PATRICK PULUPA, ESQ., EXECUTIVE OFFICER

11020 Sun Center Drive #200, Rancho Cordova, CA 95670 | www.waterboards.ca.gov/centralvalley

and this NOA.

EXISTING FACILITY AND DISCHARGE DESCRIPTION

The WWTF is located at 7466 Leslie Court, Valley Springs, in the community of Southworth Ranch Estates approximately three miles southwest of Burson and seven miles west of Valley Springs in Calaveras County, as shown on Attachment A, which is incorporated herein. The WWTF provides wastewater treatment and disposal service to Southworth Ranch Estates development, which is comprised of approximately sixty single family residential properties. The Discharger owns and is responsible for operation and maintenance of the sewer collection system, treatment system, effluent storage, and land application areas (LAAs).

Wastewater is collected, and initially treated via residential septic tanks. The decant wastewater from residential septic tanks is conveyed to the WWTF for further treatment and disposal. The WWTF consists of recirculation filters and tanks, a chlorine contact basin (disinfection will be eliminated, see attached Memorandum), an effluent storage pond, 6.7 acres of LAAs, and a tailwater control system. When constructed in 1990, the WWTF was designed for an average flow of 16,000 gallons per day (gpd). The site plan and process schematic are shown on Attachments B and C, respectively, which are incorporated herein.

SITE-SPECIFIC REQUIREMENTS

The Discharger shall comply with all applicable sections in the General Order, including:

1. Requirements A. Prohibitions
2. Requirements B.1.a.

The Discharger shall comply with the following flow limit: The effluent discharged to the storage pond shall not exceed 16,000 gpd as an annual average.

3. Requirements B.1.b. through B.1.I

For Section B.1.I, the Discharger shall comply with the following setback requirements listed in in Table 3 of the General Order:

Equipment or Activity	Domestic Well	Flowing Stream	Ephemeral Stream Drainage	Property Line	Lake or Reservoir
Septic Tank, Aerobic Treatment Unit, Treatment System, or Collection System	150 ft.	50 ft.	50 ft.	5 ft.	200 ft.
LAAs	150 ft.	100 ft.	100 ft.	100 ft.	200 ft.
Impoundment	150 ft.	150 ft.	150 ft.	50 ft.	200 ft.

4. Requirements B.2 Septic Systems

5. Requirements B.5 Pond Systems
6. Requirements B.7 Land Application Systems
7. Requirements B.8 Sludge/Solids/Biosolids Disposal
8. Requirements C. Groundwater and Surface Water Limitations
9. Requirements D. Effluent Limitations

D.1.a. Effluent discharged to the LAAs shall not exceed BOD₅ of 40 mg/L as a monthly average and 80 mg/L as a daily maximum.

10. Provision E.2 and E.3

MONITORING AND REPORTING PROGRAM

Upon activation of this NOA, the Discharger shall comply with MRP WQ 2014-0153-DWQ-R5357, which is incorporated herein.

ENFORCEMENT

Please review this NOA carefully to ensure that it completely and accurately reflects the discharge. Discharge of wastes other than those described in this NOA is prohibited. Prior to allowing changes to the wastewater strength, generation rate, or to the method of waste disposal, you must contact the Central Valley Regional Water Quality Control Board (Central Valley Water Board) to determine if submittal of a RWD is required.

The Discharger generates the waste subject to the terms and conditions of Water Quality Order WQ 2014-0153-DWQ-R5357 and maintains exclusive control over the discharge. As such, the Discharger is primarily responsible for compliance with this NOA, MRP, and General Order, with all attachments. Failure to comply with the requirements in the General Order or this NOA could result in an enforcement action as authorized by provisions of the California Water Code.

DOCUMENT SUBMITTAL

All monitoring reports and other correspondence should be converted to searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50 MB should be emailed to:

centralvalleysacramento@waterboards.ca.gov

To ensure that your submittal is routed to the appropriate staff person, the following information should be included in the body of the email or any documentation submitted to the mailing address for this office:

Facility Name: Southworth Ranch Estates Wastewater Treatment Facility
Program: Non-15 Compliance
Order: WQ 2014-0153-DWQ-R5357
CIWQS Place ID: CW- 258004

Documents that are 50 MB or larger should be transferred to a CD, DVD, or flash drive and mailed to:

Central Valley Regional Water Quality Control Board
ECM Mailroom
11020 Sun Center Drive, Suite 200
Rancho Cordova, CA 95670

Now that the NOA has been issued, the Central Valley Water Board's Compliance and Enforcement section will take over management of your case. Kenny Croyle is your new point of contact for any questions about the General Order. If you find it necessary to make a change to your permitted operations, Kenny will direct you to the appropriate Permitting section staff. You may contact Kenny at (916) 464-4676 or at kenny.croyle@waterboards.ca.gov.




Digitally signed
by John J. Baum
Date:
2021.06.18
15:35:21 -07'00'
Water Boards

for Patrick Pulupa
Executive Officer

Enclosures : Water Quality Order WQ 2014-0153-DWQ
Monitoring and Reporting Program WQ 2014-0153-DWQ-R5357
Attachment A, Site Location Map
Attachment B, Site Plan
Attachment C, Process Schematic
Memorandum

cc w/out enc: Brian Moss, Calaveras County Environmental Health Department
Debbie Webster, CVCWA (via email)
David Lancaster, State Water Resources Control Board, Sacramento (via email)
Laurel Warddrip, State Water Resources Control Board, Sacramento (via email)
Howard Hold, Central Valley Water Board, Rancho Cordova (via email)

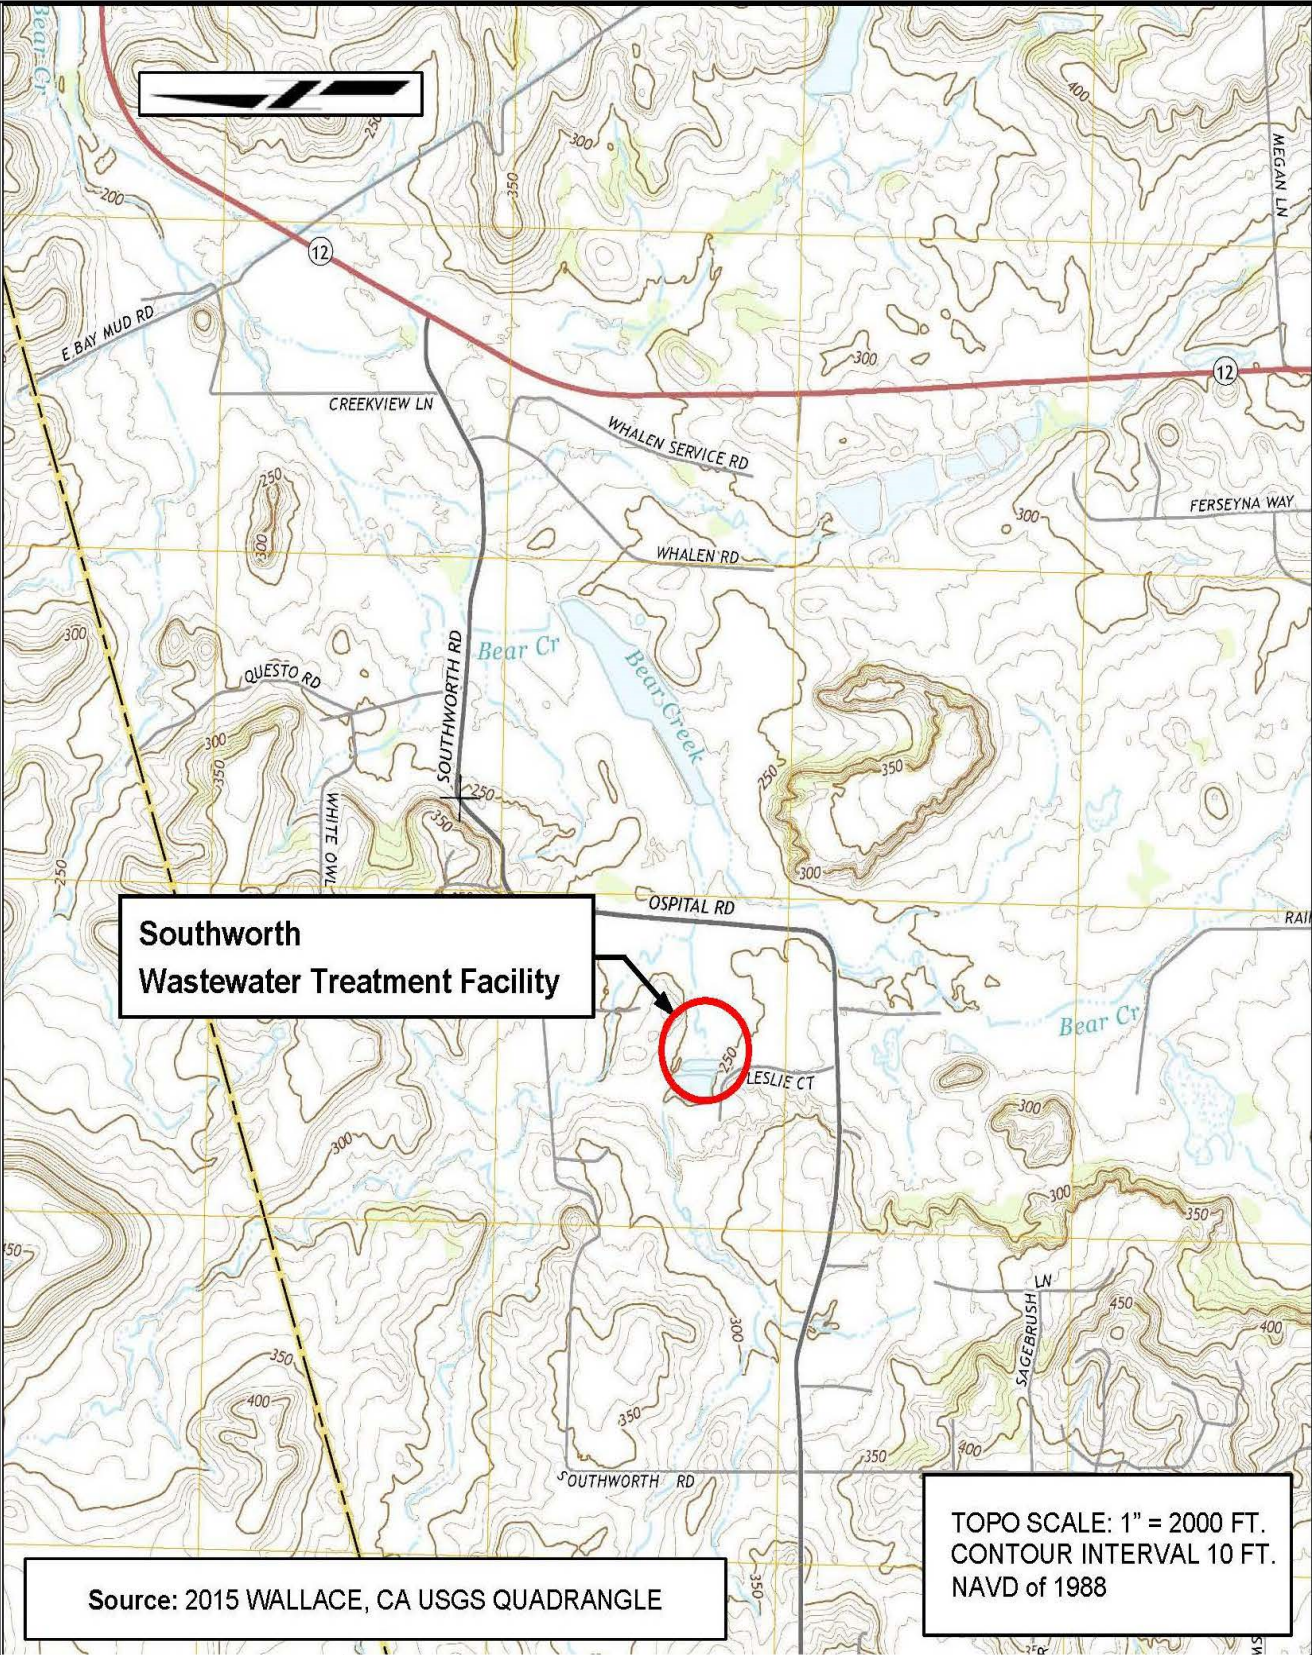

Drawing Reference:
CCWD RWD
20 July 2020


LOCATION MAP
CALAVERAS COUNTY WATER DISTRICT
SOUTHWORTH WASTEWATER TREATMENT FACILITY
CALAVERAS COUNTY



Drawing Reference:
CCWD RWD
20 July 2020

SITE PLAN

**CALAVERAS COUNTY WATER DISTRICT
SOUTHWORTH WASTEWATER TREATMENT FACILITY
CALAVERAS COUNTY**

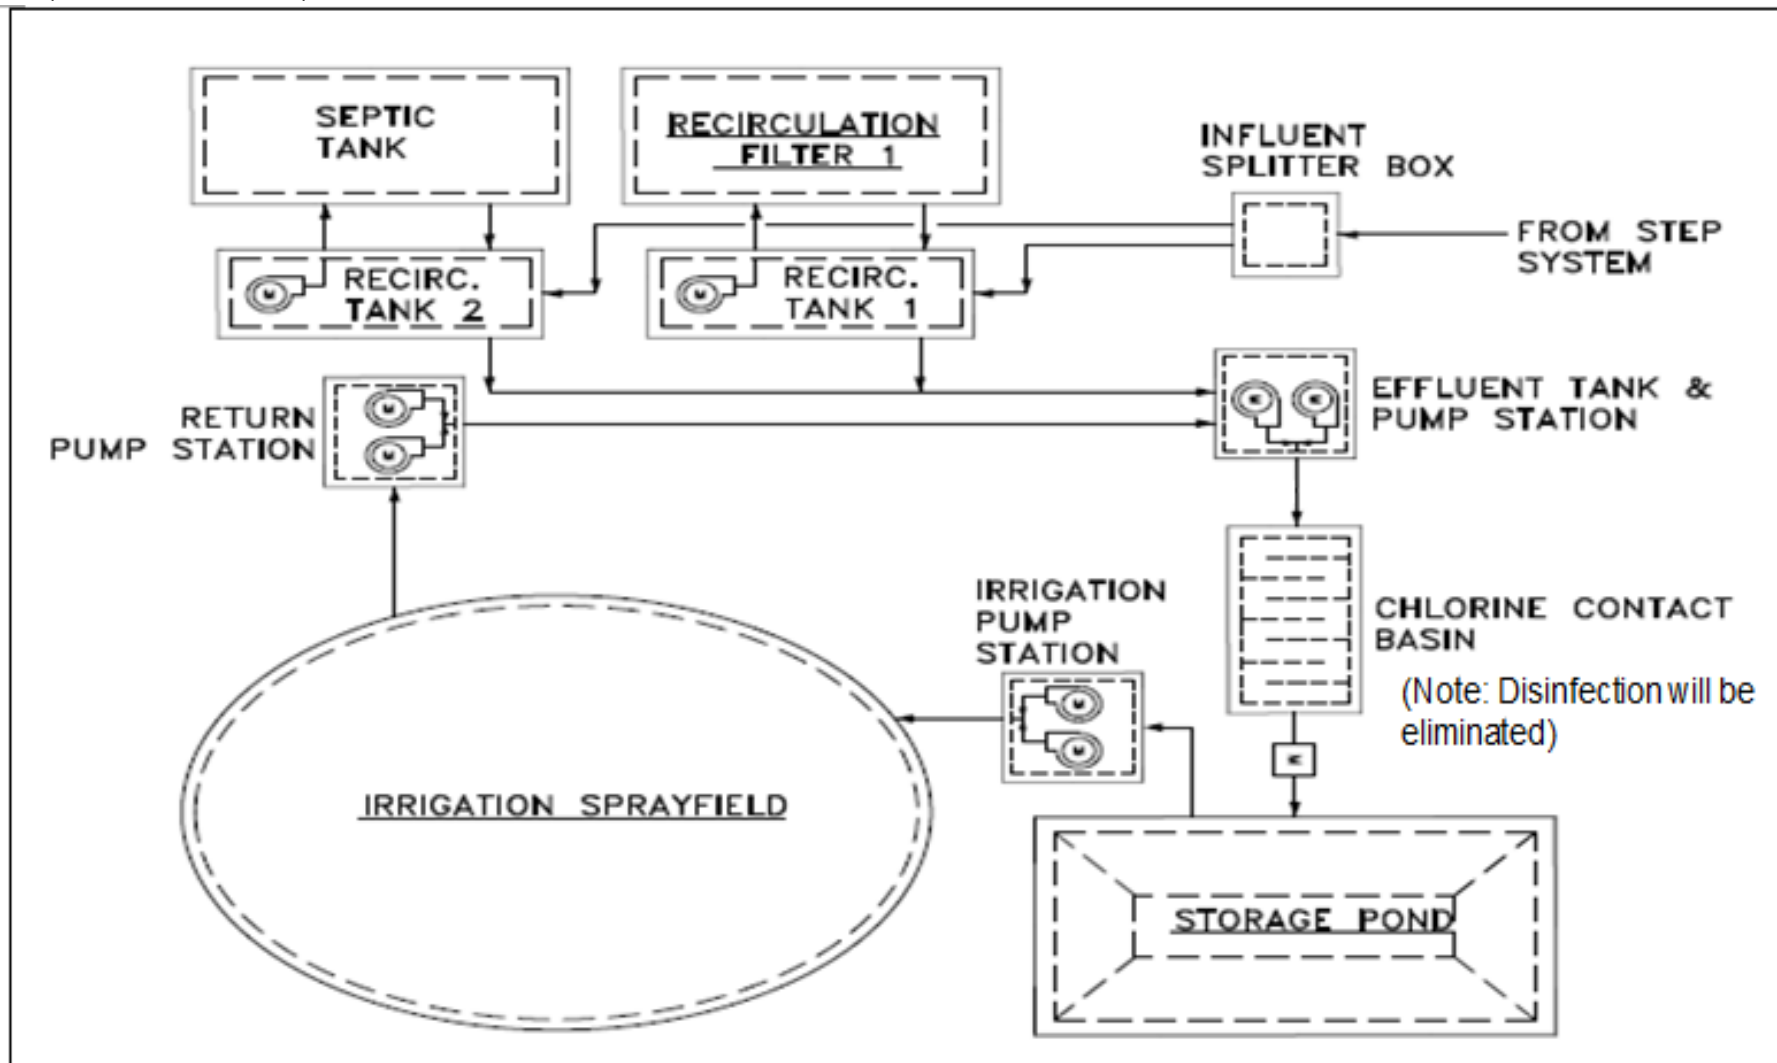

Drawing Reference:

CCWD RWD
20 July 2020**PROCESS SCHEMATIC****CALAVERAS COUNTY WATER DISTRICT
SOUTHWORTH WASTEWATER TREATMENT FACILITY
CALAVERAS COUNTY**

ATTACHMENT C

TO: Robert Busby
Supervising Engineering Geologist

FROM: Scott Armstrong
Senior Engineering Geologist

Lixin Fu
Water Resource Control Engineer

DATE: 10 June 2021

APPLICABILITY OF COVERAGE UNDER STATE WATER RESOURCES CONTROL BOARD ORDER WQ 2014-0153-DWQ; GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS; CALAVERAS COUNTY WATER DISTRICT SOUTHWORTH RANCH ESTATES WASTEWATER TREATMENT FACILITY; CALAVERAS COUNTY

On 2 July 2020, the Calaveras County Water District (CCWD, hereafter Discharger) submitted a Report of Waste Discharge (RWD) for Southworth Ranch Estates Wastewater Treatment Facility (WWTF) requesting to obtain coverage under the State Water Resources Control Board (State Water Board) General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems, Order WQ 2014-0153-DWQ (General Order). This memorandum provides a summary of the applicability of this discharge for coverage under the General Order.

REGULATORY BACKGROUND

WDRs 90-258, adopted by the Central Valley Regional Water Quality Control Board (Central Valley Water Board) on 28 September 1990, prescribes requirements for the Calaveras County Water District Southworth Ranch Estates WWTF, and allows a 30-day average dry weather discharge flow of 16,500 gallons per day (gpd). WDRs Order 90-258 will be rescinded at an upcoming Central Valley Water Board meeting. Effective upon rescission of Order 90-258, the discharge described in this NOA shall be regulated pursuant to the General Order.

EXISTING FACILITY AND DISCHARGE DESCRIPTION

The WWTF is located at 7466 Leslie Court, Valley Springs, in Calaveras County (Section T04N, R09E, Section 35, MDB&M). The Assessor's Parcel Numbers (APN) is 048-075-010 and 048-075-007.

The service area of the WWTF is approximately 410 acres. Each customer connection includes a 1,250-gallon, two-chamber septic tank and pump system. Customer septic systems are installed by the Discharger or by contractor per CCWD Standards and inspected by the CCWD prior to acceptance. As of late 2019, the WWTF provided treatment for 57 Equivalent Dwelling Units (EDU) comprised of residential services. Buildout for the community is estimated at 64 connections. Influent wastewater from the residential community is biologically stabilized by two recirculation packed bed filters (RPBF). These filters include recirculation tanks, pump station, and flow splitter structure. Minimum recirculation rate is five to one versus

influent rate. Treated wastewater from RPBF was disinfected using liquid sodium hypochlorite via a 2,000-gallon chlorine contact basin then stored at the effluent storage pond. Total effluent storage capacity is approximately 9.0 acre-feet, excluding two feet of freeboard and dead pool volume. Disposal of effluent is accomplished by a combination of pond evaporation and land irrigation with spray irrigation equipment. There are no groundwater monitoring wells at the WWTF.

The WWTF contains a tailwater control system, including a tailwater collection basin, a pump system, and a levee in the downgradient of LAAs as shown in Attachment B. The tailwater collection basin has a surface area of 144 square feet (12 feet by 12 feet). The tailwater in the basin could be returned to the effluent storage pond and replied to the LAAs.

Average flow measured from 2015 through 2019 ranged from 9,000 to 14,200 gallons per day (gpd) as an annual average flow. Based on the 2015 through 2019 monthly monitoring reports, the effluent had an average of BOD5 concentration of 2.0 mg/L. MRP 90-258 does not contain monitoring requirements for salinity, nitrate and total kjeldahl nitrogen concentrations. Therefore, there are no effluent data for these constituents. MRP WQ 2014-0153-DWQ-R5357 will include monitoring requirements for these constituents.

The existing WDRs contains requirements for disinfection and an effluent limit on total coliform. Because the effluent is discharged to the LAAs for disposal, this is not considered beneficial use. In addition, the entire WWTF is fenced from public access, therefore disinfection may not be necessary since chlorine disinfection could contribute to salinity and cause disinfection by-product pollution in groundwater. The Discharger prefers to discontinue of use of sodium hypochlorite for disinfection. Therefore, this NOA does not include effluent limit and monitoring requirements for total coliform.

Accumulated solids in residential septic tanks, along with tank and pump maintenance is responsibility of the Discharger. When required, typically every two to three years, solids from the customer septic tanks are removed and transported La Contenta WWTF, which is regulated under WDRs Order R5-2013-0133-01.

The WWTF is equipped with computer telemetry system and radio for calling out alarm conditions. The telemetry system is equipped with an uninterruptable power supply to permit the telemetry and radio's operation in the event of power failure.

Privately owned groundwater wells provide drinking water to the residential homes in the Southworth Ranch Estates community. The Discharger has no information concerning quality of the groundwater supply.

The Federal Emergency Management Agency (FEMA) has designated portions of the Facility property Zone A "Special Flood Hazard Area" and Zone X "Minimal Flood Hazard Area".

SALT AND NITRATE CONTROL PROGRAMS

The Central Valley Water Board adopted Basin Plan amendments incorporating new programs for addressing ongoing salt and nitrate accumulation in the Central Valley at its 31 May 2018 Board Meeting. The Basin Plan amendments were conditionally approved by the

State Water Board on 16 October 2019 (Resolution 2019-0057) and by the Office of Administrative Law on 15 January 2020 (OAL Matter No. 2019-1203-03).

For nitrate, dischargers that are unable to comply with stringent nitrate requirements will be required to take on alternate compliance approaches that involve providing replacement drinking water to persons whose drinking water is affected by nitrates. Dischargers may comply with the new nitrate program either individually or collectively with other dischargers. For the Nitrate Control Program, the facility falls within Non-Prioritized Groundwater Basins. Notices to Comply for Non-Prioritized Basins will be issued within two to four years after the effective date of the Nitrate Control Program.

For salinity, dischargers that are unable to comply with stringent salinity requirements will instead need to meet performance-based requirements and participate in a basin-wide effort to develop a long-term salinity strategy for the Central Valley. Dischargers received a Notice to Comply with instructions and obligations for the Salt Control Program within one year of 17 January 2020, the effective date of the amendments. Upon receipt of the Notice to Comply, the discharger had no more than six months to inform the Central Valley Water Board of their choice between Option 1 (Conservative Option for Salt Permitting) or Option 2 (Alternative Option for Salt Permitting).

As these strategies are implemented, the Central Valley Water Board may find it necessary to modify the requirements of this Order to ensure the goals of the Salt and Nitrate Control Programs are met. This order may be amended or modified to incorporate newly applicable requirements. More information regarding this regulatory planning process can be found on the [Central Valley Water Board CV-SALTS website](https://www.waterboards.ca.gov/centralvalley/water_issues/salinity) (https://www.waterboards.ca.gov/centralvalley/water_issues/salinity).

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION
MONITORING AND REPORTING PROGRAM WQ 2014-0153-DWQ-R5357
FOR
CALAVERAS COUNTY WATER DISTRICT
SOUTHWORTH RANCH ESTATES WASTEWATER TREATMENT FACILITY
CALAVERAS COUNTY

This Monitoring and Reporting Program (MRP) describes monitoring requirements for the Southworth Wastewater Treatment Facility. This MRP is issued pursuant to Water Code section 13267. The Discharger shall not implement any changes to this MRP unless and until a revised MRP is issued by the Regional Water Quality Control Board, Central Valley Region (Central Valley Water Board) or Executive Officer.

Water Code section 13267 states, in part:

“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports.”

Water Code section 13268 states, in part:

“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”

The Calaveras County Water District operates the wastewater system that is subject to the Notice of Applicability (NOA) of Water Quality Order 2014-0153-DWQ-R5357. The reports required in this MRP are necessary to ensure that the Discharger complies with the NOA and General Order.

Pursuant to Water Code section 13267, the Discharger shall implement this MRP and shall submit the monitoring reports described herein.

All samples shall be representative of the volume and nature of the discharge or matrix of material sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by Central Valley Water Board staff.

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board, Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency, and
4. Field calibration reports are maintained and available for at least three years.

Analytical procedures shall comply with the methods and holding times specified in the following: Methods for Organic Chemical Analysis of Municipal and Industrial Wastewater (EPA); Test Methods for Evaluating Solid Waste (EPA); Methods for Chemical Analysis of Water and Wastes (EPA); Methods for Determination of Inorganic Substances in Environmental Samples (EPA), and Standard Methods for the Examination of Water and Wastewater (APHA/AWWA/WEF). Approved editions shall be those that are approved for use by the United States Environmental Protection Agency or the California Department of Public Health's Environmental Laboratory Accreditation Program. The Discharger may propose alternative methods for approval by the Executive Officer. Where technically feasible, laboratory reporting limits shall be lower than the applicable water quality objectives for the constituents to be analyzed.

SEPTIC TANK MONITORING

Based on Requirements for Septic System B.2.d. of the General Order WQ 2014-0153-DWQ-R5357, residential septic tanks shall be pumped when any one of the following conditions exists:

1. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
2. The scum layer is within 3 inches of the outlet device.

3. The sludge layer is within 8 inches of the outlet device.

The discharger shall keep all inspection and pumping reports in the record. At a minimum, the record shall include the date, nature of service, service company name, and service company license number.

EFFLUENT MONITORING

Samples of effluent shall be collected downstream from the last connection (recirculation filters and tanks) through which wastes can be admitted into the effluent storage pond. At a minimum, effluent monitoring shall consist of the following:

Constituent	Units	Sample Type	Sampling Frequency	Reporting Frequency
Flow	gpd	Meter Observation	Daily	Monthly
Monthly Average Flow	gpd	Calculation	-	Monthly
pH	Standard Units	Grab	Monthly	Monthly
BOD ₅	mg/L	Grab	Weekly	Monthly
Electrical Conductivity	µmhos/cm	Grab	Semi-annually	Semi-annually
Nitrate as Nitrogen	mg/L	Grab	Semi-annually	Semi-annually
Total Kjeldahl Nitrogen	mg/L	Grab	Semi-annually	Semi-annually
Ammonia	mg/L	Grab	Semi-annually	Semi-annually
Standard Minerals	mg/L	Grab	Annually	Annually

Note: BOD₅ presents five-day biochemical oxygen demand.

Standard minerals shall include, at a minimum, the following elements and compounds: arsenic, boron, calcium, chloride, dissolved iron, magnesium, dissolved manganese, potassium, sodium, sulfate, TDS, total alkalinity (including alkalinity series), and hardness.

STORAGE POND MONITORING

Each storage pond shall be monitored as follows. If the pond is empty on the scheduled monitoring date, the Discharger shall report the freeboard monitoring result as "dry".

Constituent	Units	Sample Type	Sampling Frequency	Reporting Frequency
Dissolved Oxygen	mg/L	Grab	Weekly	Monthly
Freeboard	0.1 feet	Measurement	Weekly	Monthly
Odors	--	Observation	Weekly	Monthly
Levee condition	--	Observation	Weekly	Monthly

Samples shall be collected at a depth of one foot, opposite the inlet. Containment levees shall be observed for signs of seepage or surfacing water along the exterior toe of the levees.

LAND APPLICATION AREA MONITORING

The effluent should be applied to the LAAs evenly in order to prevent runoff from the LAAs and/or ponding condition at the LAAs. Monitoring of the LAAs shall be conducted when the disposal areas are used, and the results shall be included in the monthly monitoring report. Evidence of erosion, saturation, irrigation runoff, or the presence of nuisance conditions shall be noted in the report. Effluent monitoring results shall be used in calculations to ascertain loading rates at the spray disposal areas. Monitoring of the LAAs shall include the following:

Constituent	Units	Sample Type	Sampling Frequency	Reporting Frequency
Flow	gallons	Continuous	Daily	Monthly
Rainfall	inches	Observation	Daily	Monthly
Acreage Applied	acres	Calculated	Daily	Monthly
Water Application Rate	gal/acre/day	Calculated	Daily	Monthly
Any Runoff / Ponding	--	Observation	Daily	Monthly

At least once per week when the LAAs are being used, the entire LAAs shall be inspected to identify any equipment malfunction or other circumstances that might allow irrigation runoff to leave the irrigation area and/or create ponding conditions. A daily log of each inspection shall be kept at the facility and be submitted with the monthly monitoring reports. If the LAAs are not used, then the monthly monitoring reports shall state so.

SLUDGE AND SOLID WASTE MONITORING

Prior to the removal of sludge from the storage pond, a composite sample shall be collected in accordance with EPA's POTW Sludge Sampling and Analysis Guidance Document (August 1989) and tested for the following metals: Cadmium, Copper, Nickel, Chromium, Lead, and Zinc.

Sampling records shall be retained for a minimum of five years. A log shall be kept of solid waste (grits and screenings) and sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the water supply can be obtained. Water supply monitoring may be substituted with the annual report of the supplying agency. Water supply monitoring shall include at least the following:

Constituent	Units	Sample Type	Sampling and Reporting Frequency
Total Dissolved Solids	mg/L	Grab	Annually
Electrical Conductivity	µmhos/cm	Grab	Annually
Standard Minerals	mg/L	Grab	Annually

Standard Minerals shall include, at a minimum, the following elements and compounds: boron, calcium, iron, magnesium, manganese, sodium, potassium, chloride, sulfate, total alkalinity (including alkalinity series), and hardness.

REPORTING

All regulatory documents, submissions, materials, data, monitoring reports, and correspondence should be converted to a searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50MB should be emailed to: centralvalleysacramento@waterboards.ca.gov

Documents that are 50 MB or larger should be transferred to a CD, DVD, or flash drive and mailed to the following address:

Central Valley Regional Water Quality Control Board
ECM Mailroom
11020 Sun Center Drive, Suite 200
Rancho Cordova, California 95670

To ensure that your submittals are routed to the appropriate staff, the following information block should be included in any correspondence used to transmit documents to this office:

Facility Name: Southworth Ranch Estates Wastewater Treatment Facility
Program: Non-15 Compliance
Order: WQ 2014-0153-DWQ-R357
CIWQS Place ID: CW- 258004

In accordance with California Business and Professions Code sections 6735, 7835, and 7835.1, engineering and geologic evaluations and judgments shall be performed by or under the direction of registered professionals competent and proficient in the fields pertinent to the required activities. All technical reports specified herein that contain workplans for investigations and studies, that describe the conduct of investigations and studies, or that contain technical conclusions and recommendations concerning engineering and geology shall be prepared by or under the direction of appropriately qualified professional(s), even if not explicitly stated. Each technical report submitted by the Discharger shall bear the professional's signature and stamp.

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., effluent, pond, etc.), and reported analytical result for each

sample are readily discernible. The data shall be summarized in such a manner to clearly illustrate compliance with the NOA and General Order and spatial or temporal trends, as applicable. The results of any monitoring done more frequently than required at the locations specified in the MRP shall be reported in the next scheduled monitoring report.

In addition to the requirements of Standard Provision C.3, monitoring information shall include the method detection limit (MDL) and the Reporting limit (RL) or practical quantitation limit (PQL). If the regulatory limit for a given constituent is less than the RL (or PQL), then any analytical results for that constituent that are below the RL (or PQL) but above the MDL shall be reported and flagged as estimated.

A. Monthly Monitoring Reports

Monthly reports shall be submitted to the Regional Board by the **1st day of the second month** following the end of the reporting period (i.e. the January monthly report is due by 1 March). At a minimum, the reports shall include:

1. Results of the effluent, pond, land application area, and solid wastes and sludge monitoring, including semi-annual monitoring results for effluent in the sampling month. The Discharger shall establish a semi-annual sampling schedule for effluent monitoring such that samples are obtained approximately every six months.
2. Copies of inspection logs;
3. A comparison of the monitoring data to the discharge specifications and an explanation of any violation of those requirements;
4. If requested by staff, copies of laboratory analytical report(s), and
5. Date(s) on which the monitoring instruments were calibrated.

B. Annual Report

In addition to the monthly monitoring reports, an Annual shall be prepared. The Annual Report shall be submitted to the Central Valley Water Board by **1 February** each year. The Annual Report shall include the following:

1. The results from annual monitoring of the effluent and water supply;
2. Annual average effluent flow;
3. The results of monitoring any sludge from the effluent storage pond required by the disposal facility;
4. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into full compliance with the NOA

and General Order;

5. A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program;
6. Tabular and graphical summaries of all data collected during the year, and
7. A copy of the certification for each certified wastewater treatment plant operator working at the facility and a statement about whether the Discharger is in compliance with Title 23, CCR, Division 3, Chapter 26.

C. State Water Board Volumetric Annual Reporting

To establish a realistic estimate of statewide recycled water use and potential for increased recycled water use statewide, the Recycled Water Policy requires domestic wastewater dischargers to report the volume of treated wastewater and recycled water. The annual report will meet implementation needs of the Recycled Water Policy and fill data gaps for additional statewide water planning efforts. Based on current influent flows of less than 20,000 gallons per day, the Discharger is not required to submit volumetric annual reporting at this time.

A letter transmitting the self-monitoring reports shall accompany each report. Such a letter shall include a discussion of requirement violations found during the reporting period, and actions taken or planned for correcting noted violations, such as operation or facility modifications. If the Discharger has previously submitted a report describing corrective actions and/or a time schedule for implementing the corrective actions, reference to the previous correspondence will be satisfactory. The transmittal letter shall contain the penalty of perjury statement by the Discharger, or the Discharger's authorized agent, as described in the Standard Provisions General Reporting Requirements Section B.3.

The Discharger shall begin implementing the above monitoring program the first day of the month following rescission of WDRs Order 90-258.

This Order is issued under authority delegated to the Executive Officer by the Central Valley Water Board pursuant to Resolution R5-2009-0027 and is effective upon signature.

Ordered by:  **John J. Baum**
for PATRICK PULUPA, Executive Officer
6/18/2021

Digitally signed
by John J. Baum
Date: 2021.06.18
15:52:56 -07'00'
Water Boards

(Date)