

Central Coast Regional Water Quality Control Board

December 23, 2022

Sent Via Electronic Mail

Ed Schmidt
Tres Pinos County Water District
Tres Pinos County Water District Wastewater Treatment Plant
P.O. BOX #1001
Tres Pinos, CA, 95075
Email: edschmidt880@yahoo.com

Dear Ed Schmidt,

**TRES PINOS COUNTY WATER DISTRICT WASTEWATER TREATMENT PLANT,
BEHIND 8223 SOUTHSIDE ROAD, TRES PINOS, SAN BENITO COUNTY:**

- **NOTICE OF APPLICABILITY FOR TRES PINOS ENROLLMENT IN ORDER
WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR
SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-
2022-0078**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. R3-2012-0015**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200, July 2022 Report of Waste Discharge and available documents associated with the domestic wastewater treatment system at Tres Pinos County Water District Wastewater Treatment Plant owned by Tres Pinos County Water District. The wastewater system is currently regulated pursuant to Order No. R3-2012-0015. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. R3-2012-0015.

This letter serves as a notice of applicability for enrollment in the General Permit for the discharge of wastewater from Tres Pinos County Water District Wastewater Treatment Plant.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Tres Pinos County Water District must comply with the following:

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

1. **General Permit** – Tres Pinos County Water District must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Tres Pinos County Water District must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0078, enclosed with this letter (Attachment 3). Tres Pinos County Water District must start implementing the monitoring on **January 1, 2023**. Your first semiannual report is due on **August 1, 2023**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Tres Pinos County Water District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100036960 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Tres Pinos County Water District paid an annual fee on January 20, 2022 for coverage in the existing individual permit, Order No. R3-2012-0015. This payment covers permit fees for the 2021-2022 fiscal year. On December 7, 2022, the Central Coast Water Board sent Tres Pinos County Water District their 2022-2023 annual invoice.

Tres Pinos County Water District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

program and cover the state fiscal year of July 1 through June 30. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Next year, your annual fee will increase because the Central Coast Water Board has corrected your threat and complexity rating to 3B. You will continue to receive a 50% fee reduction for domestic discharges less than 50,000 gallons per day. The 2022-2023 fee for 3B rated facilities with a 50% discount is \$3,885.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on February 16-17, 2023 Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Tres Pinos County Water District is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Tres Pinos County Water District to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Tres Pinos County Water District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Certified Operator** – Tres Pinos County Water District is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Class I certified operator onsite to maintain and operate the treatment system.

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

- 9. Service Agreement** – Tres Pinos County Water District Wastewater Treatment Plant submitted an executed service agreement to the Central Coast Water Board with, a qualified service provider/vendor who will perform required maintenance, sampling, and reporting to the Central Coast Water Board. A service agreement with a qualified service provider must remain in place until the Central Coast Water Board agrees in writing that such an agreement is no longer necessary.
- 10. Termination of Permit** – The existing individual permit, Order No. R3-2012-0015 is terminated, except for enforcement purposes. Tres Pinos County Water District is responsible for compliance with Order No. 12-0015 prior to the date of this letter.

If you have any questions, please contact **Mark Lemus at (805) 549-3703 or by email at Mark.Lemus@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

 Digitally signed by Jennifer Epp
Date: 2022.12.23 10:19:33 -08'00'

Jennifer Epp

for Matthew T. Keeling
Executive Officer

Attachments:

- Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
- Attachment 2: Figures
- Attachment 3: Monitoring and Reporting Program No. R3-2022-0078

cc:

Maria Fehl, trespinoswaterdistrict@gmail.com
Robert Campos, robert@bracewellengineering.com
Mark Lemus, Mark.Lemus@Waterboards.ca.gov
Darryl Wong, dwong@cosb.us
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-266350

GeoTracker No. = GT- WDR100036960

Rev 10/7/22

Subject Name = Tres Pinos New Wastewater Permit

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Tres Pinos County Water District to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Tres Pinos County Water District Wastewater Treatment Plant
Facility Address	Behind 8223 Southside Road Tres Pinos, CA, 95075
Parcel Numbers	025-200-056
Latitude/Longitude	36.79193852/-121.3308707
Owner of Facility	Tres Pinos Water District
Legally Responsible Official of Owner	Ed Schmidt, Tres Pinos Water District Board President
Owner Mailing Address	P.O. BOX #1001 Tres Pinos, CA, 95075
Billing Address	P.O. BOX #1001 Tres Pinos CA 95075
Permitted Design Flow, Maximum Daily (gallons per day, gpd)	Maximum daily capacity (dry weather flow) 60,000
Baseline Flow (average annual flow) in gpd	19,000
Operators	Robert Campos – Chief Plant Operator, Bracewell Engineering, Grade III
Waste type and Service Area	Domestic wastewater collected from 116 service connections of the Tres Pinos Community population of 350 residents.
Threat to Water Quality	3
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility

Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

Tres Pinos Creek is the nearest surface water located approximately 600 feet south of the wastewater treatment plant. First-encountered groundwater is at approximately 20 feet below ground surface.

2. WASTEWATER SYSTEM OPERATION SUMMARY

The Facility is located adjacent and north of Tres Pinos Creek. The wastewater collection system flows by gravity to the west where the headworks before being pumped north to the pond system for treatment and disposal. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Treatment, Disposal Technologies, and Capacity

Permitted Design Flows	Design Influent Maximum Daily Flow 60000 gallons per day
Treatment	Partial-Mix Facultative Ponds
Disposal	Percolation & evaporation ponds
Biosolids/Sludge Production and Handling	Accumulated sludge depth is monitored, to date there has been no removal of the pond sludge.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Tres Pinos County Water District must operate the facility in accordance with the General Permit¹ and this notice of applicability.²

A. Effluent limits

Tres Pinos County Water District Wastewater Treatment Plant must comply with the site-specific limits listed in Table 3.

¹ General Permit sections B.2, B.3, B.4, B.6, and B.7 are not applicable for this facility.

² General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

Table 3. Wastewater Limits

Constituent	Unit	Limit	Point of Compliance¹
Flow	gpd	60,000 (maximum daily flow)	Influent (IS-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90 (monthly average)	Effluent (ES-1)
Total Nitrogen	mg/L	10	Effluent (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Tres Pinos County Water District must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).³ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
- 3) The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

³ Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

ATTACHMENT 2 FIGURES

Tres Pinos System Boundary



Figure 1. Site Location Map

Tres Pinos Wastewater Plant



Figure 2. Site Map

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2022-0078

for

**TRES PINOS COUNTY WATER DISTRICT WASTEWATER TREATMENT PLANT
SAN BENITO COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for Tres Pinos County Water District located Behind 8223 Southside Road in Tres Pinos, CA, 95075.

Tres Pinos County Water District owns and operates the wastewater system that is subject to the notice of applicability dated December 23, 2022, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;

2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Tres Pinos County Water District may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Tres Pinos County Water District must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Tres Pinos County Water District must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling and Reporting Frequency
TDS ¹	mg/L	Grab	Annually
Nitrate (as N)	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sulphate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Fluoride	mg/L	Grab	Annually

mg/L = milligrams per liter

[1] Measured not calculated.

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Representative grab sample at influent pump station.
Effluent Sample – 1	ES-1	Representative grab sample from Pond 2 effluent pipeline before effluent storage tank

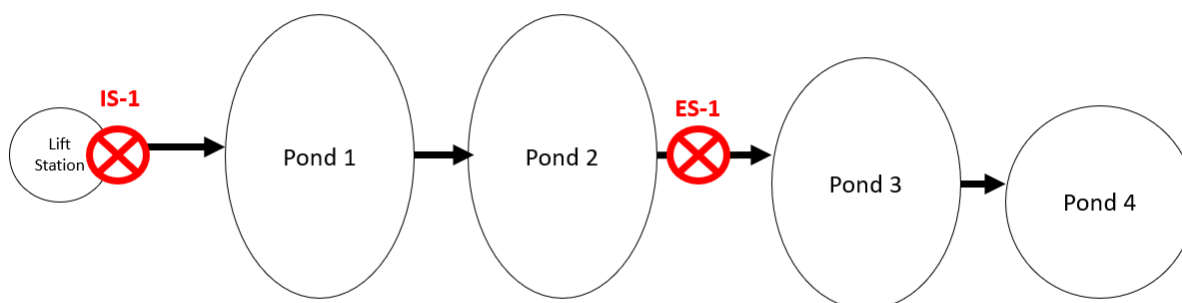


Figure 1. Process Flow Diagram with Sampling Locations

4. POND TREATMENT UNIT MONITORING

4.1 Flow Monitoring

Tres Pinos County Water District must monitor and report flow, as described in Table 4, with each monitoring report.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

4.2 Influent and Effluent Constituent Monitoring

Representative samples of Tres Pinos County Water District Wastewater Treatment Plant's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Quarterly	Monthly
Total Suspended Solids	mg/L	Quarterly	Monthly
pH	pH units	Quarterly	Monthly
Total Nitrogen	mg/L	Quarterly	Monthly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Quarterly	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Monthly
Total Dissolved Solids ²	mg/L	Quarterly	Monthly
Calcium	mg/L	Semiannually	Semiannually
Magnesium	mg/L	Semiannually	Semiannually
Sodium	mg/L	Semiannually	Semiannually
Potassium	mg/L	Semiannually	Semiannually
Chloride	mg/L	Semiannually	Semiannually
Sulphate	mg/L	Semiannually	Semiannually
Bicarbonate	mg/L	Semiannually	Semiannually
Carbonate	mg/L	Semiannually	Semiannually
Boron	mg/L	Semiannually	Semiannually
Fluoride	mg/L	Semiannually	Semiannually

mg/L = milligram per liter

[1] Nitrate and nitrite sample may be combined

[2] Measured not calculated

4.3 WASTEWATER POND MONITORING

All wastewater ponds and storage ponds must be monitored consistent with Table 6. Tres Pinos Water District must inspect the ponds weekly and notations must be made in a bound logbook and include "observations" of the items in Table 6. Any problems

must be promptly corrected and recorded. The bound logbook of these observations must be maintained onsite and made available to the Central Coast Water Board upon inspection. Only violations and mitigation measures must be included in the subsequent monitoring report.

Table 6. Wastewater Pond Monitoring

Parameter	Units	Sample Type	Sample Frequency
Dissolved Oxygen	mg/L	Grab ²	Weekly
pH	Std. units	Grab ²	Weekly
Evaporation	Inches	Weather station ³	Daily
Freeboard	0.1 feet	Measurement	Daily
Odors	--	Observation	Weekly
Berm Condition	--	Observation	Weekly
Plant Growth	--	Observation	Weekly
Vectors or Animals Burrowing	--	Observation	Weekly

mg/L = milligrams per liter

[2] Grab samples can be collected via handheld probe, see section 1 of this MRP

[3] Weather station may be site-specific station, onsite evaporation pan, or nearby governmental weather reporting station

5. SOLIDS DISPOSAL MONITORING

Tres Pinos County Water District must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

6. COLLECTION SYSTEM MAINTENANCE

Tres Pinos County Water District must submit records of any maintenance performed on the sewer collection system within the past year.

7. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 7.

Table 7. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** --
 - Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
 - An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen) over time, nuisance conditions, system problems, etc.
 - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Disposal Area Inspection** -- Report the results of the disposal area inspections, as described in Section 6.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 7.
- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

8. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permittting/docs/transmittal_sheet.pdf

Tres Pinos County Water District Wastewater Treatment Plant must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR100036960** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 8 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 8. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

9. TECHNICAL REPORTS

Tres Pinos County Water District must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 9. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this

requirement.

9.1 DISPOSAL POND MAINTENANCE PLAN

The wastewater treatment plant was not designed with the flexibility to alternate percolation pond usage. The decline in pond percolation performance has created some concerns with overall wastewater plant capacity in the past. The current practice is to scrape the bed of the pond with heavy equipment while the pond still has standing water, this restores some percolation to the pond however it does not allow for full recovery of the percolation rates. Tres Pinos County Water District must submit a Disposal Pond Maintenance Plan for Central Coast Water Board approval to include the following at a minimum:

1. Determination of the frequency of pond maintenance to occur via establishing a threshold for action based off incoming flow and percolation/evaporation rates. These numbers should be provided with the semiannual self monitoring reports.
2. Developing a short and long term solution to modify the current flow scheme to allow for full sequestration of a disposal pond for a completely dry pond maintenance.
3. An analysis of the pond bed soil column (sieve analysis, hydraulic conductivity, and other appropriate soil permeability tests) to determine if the pond should be ripped/disked or if a layer of the pond bedding should be removed and replaced with appropriate soil to restore adequate percolation rates.
4. A project timeline for work to be completed to restore pond percolation rates.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	March 23, 2023
Sampling and Analysis Plan	March 23, 2023
Sludge Management Plan	March 23, 2023
Disposal Pond Maintenance Plan	March 23, 2023

10. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Tres Pinos County Water District submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Tres Pinos

County Water District to enforcement action pursuant to [section 13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Tres Pinos County Water District is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Tres Pinos County Water District must implement the above monitoring program on January 1, 2023. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Tres Pinos County Water District must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

 Digitally signed by Jennifer Epp
Date: 2022.12.23 10:18:32
Water Boards

for Matthew T. Keeling
Executive Officer