

Central Coast Regional Water Quality Control Board

February 13, 2023

Sent Via Electronic Mail

Martin Wilder
Utilities Manager
Laguna County Sanitation District
620 West Foster Road
Santa Maria, CA 93455
e-mail: mwilder@countyofsb.org

Dear Martin Wilder:

LAGUNA COUNTY SANITATION DISTRICT WASTEWATER RECLAMATION PLANT, 3500 BLACK ROAD, SANTA MARIA, SANTA BARBARA COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2023-0019; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER NO. R3-2011-0217 FOR LAGUNA COUNTY SANITATION DISTRICT WASTEWATER RECLAMATION PLANT PRODUCER OF RECYCLED WATER, SANTA BARBARA COUNTY.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the June 14, 2019 notice of intent and available documents associated with Laguna County Sanitation District's domestic wastewater reclamation plant (Wastewater System) located at 3500 Black Road in Santa Maria, California. The Wastewater System, owned by Laguna County Sanitation District is currently regulated pursuant to *Waste Discharge Requirements and Master Recycling Permit Order No. R3-2011-0217 for Laguna County Sanitation District Wastewater Reclamation Plant Producer of Recycled Water, Santa Barbara County* (Order No. R3-2011-0217).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

limitations (Attachment 1); figures (Attachment 2); and Laguna County Sanitation District's monitoring and reporting program requirements (Attachment 3).

This letter also serves as a notice of termination of Laguna County Sanitation District's coverage in existing individual permit, Order No. R3-2011-0217.

Laguna County Sanitation District must comply with the following:

1. **General Permit** – Laguna County Sanitation District must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf
2. **Monitoring and Reporting Program** – Laguna County Sanitation District must comply with the requirements of the monitoring and reporting program enclosed with this letter (monitoring and reporting program no. R3-2023-0019, Attachment 3). Laguna County Sanitation District must start implementing the monitoring on **April 1, 2023**. The first quarterly monitoring report is due **August 1, 2023**, and the annual report for 2023 is due **March 1, 2024**. Laguna County Sanitation District is also required to comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board), due annually to the GeoTracker database on April 30th.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

Laguna County Sanitation District must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{2,3} database with applicable

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number WDR100030531 over the internet at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – Laguna County Sanitation District paid an annual fee of \$24,687 on January 24, 2023, for coverage in existing individual permit, Order No. R3-2011-0217. This payment covers Laguna County Sanitation District's enrollment in the General Permit for the 2022-2023 fiscal year.

Laguna County Sanitation District must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$24,687. Laguna County Sanitation District's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of Laguna County Sanitation District's enrollment at a regularly scheduled public meeting on April 20-21, 2023. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, Laguna County Sanitation District must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, Laguna County Sanitation District must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 3500 Black Road, Santa Maria, California 93455. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, Laguna County Sanitation District must notify the Central Coast Water Board if this

information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

- 6. Responsible Party** – Laguna County Sanitation District is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects Laguna County Sanitation District to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, Laguna County Sanitation District must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and Laguna County Sanitation District's enrollment in the General Permit can be terminated.
- 8. Certified Operator** – Laguna County Sanitation District is required to comply with the operator certification requirements⁴ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade IV Chief Plant Operator, Grade III Designated Operator-in-Charge and at least 50% of operator staff possessing operator or operator-in-training certificates at the Grade II level or higher onsite to operate and maintain the Wastewater System.
- 9. Termination of Permit** – The existing individual permit, Order No. R3-2011-0217 is terminated, except for enforcement purposes⁵. Laguna County Sanitation District is responsible for compliance with Order No. R3-2011-0217 prior to the date of this letter.

If you have any questions, please contact **Cecile Blancarte at (805) 542-4782 or by email at Cecile.Blancarte@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

Jennifer Epp
Digitally signed by Jennifer Epp
Date: 2023.02.13 09:39:30 -08'00'
Water Boards

for Matthew T. Keeling
Executive Officer

⁴ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

⁵ The General Permit states "... where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2023-0019

cc:

Scott McGolpin, Santa Barbara County Public Works Director,
mcgolpin@countyofsb.org

Jerry Nichols, Chief Plant Operator, jenichl@countyofsb.org

Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov

Jesse Woodward, Central Coast Water Board, Jesse.Woodard@Waterboards.ca.gov

[Cecile Blancarte](#), Central Coast Water Board, Cecile.Blancarte@Waterboards.ca.gov

WDR Program, *GeoTracker* RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-236124

GeoTracker No. = GT- WDR100030531

Rev 10/6/2022

ECM Subject Name = Laguna County Sanitation District NOA for R3-2020-0020

\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\santa barbara co\laguna county sanitation district
wwtp\2023 noa-wdr\final\3-2020-0020 noa lcsd-final.docx

ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by Laguna County Sanitation District to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Facility Name	Laguna County Sanitation District Wastewater Reclamation Plant
Facility Address	3500 Black Road Santa Maria, CA 93455
Parcel Number(s)	113-240-005, 113-240-013
Latitude	34.891667
Longitude	-120.503611
Facility Owner	Laguna County Sanitation District
Legally Responsible Official	Martin Wilder phone: (805) 803-8755 e-mail: mwilder@countyofsb.org
Owner Mailing Address	620 West Foster Road Santa Maria, CA 93455
Billing Address	Attn: Angela Arredondo 620 Foster Road Santa Maria, CA 93455 (805) 803-8757
Raw Wastewater Sources	Sewer Connections: 12,000 Population Served: 35,000 Domestic (%): 100% Industrial (%): 0%
Permitted Design Flow, (Maximum Daily) (gallons per day, gpd)	3,700,000 (3,200,000 low salt and 500,000 high salt)
Baseline Flow (average annual flow) in gpd	Recycled water flow is 1,600,000 Brine waste and sludge flows are 70,000
Operator	Jerry Nichols phone: (805) 934-6281 e-mail: jenichl@countyofsb.org
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Place Type	Wastewater Treatment Facility

Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Waste Discharge Requirements
Reclamation Included	Yes
EPA Approved Pretreatment Program	No

2. WASTEWATER SYSTEM OPERATION SUMMARY

Laguna County Sanitation District wastewater reclamation plant (Wastewater System) is a Class IV wastewater system. Laguna County Sanitation District must staff a Grade IV chief plant operator for proper operation of the Wastewater System. The current chief plant operator is Jerry Nichols, Grade IV.

The Wastewater System can treat a maximum of 3,700,000 gallons per day. Approximately, 3,200,000 gpd has a low salt concentration and is treated to disinfected tertiary⁶ treatment levels. Another 500,000 gpd has a high salt concentration and is treated through a reverse osmosis system. The reverse osmosis permeate is treated to disinfected tertiary treatment levels. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 2.

Table 2. Treatment Technology and Capacity

Headworks/Preliminary Treatment	The new headworks is located upstream of the former headworks and collects influent from the two existing trunk lines. Headworks consists of an influent flow meter, a submersible pump station (including backup), and two ¼" step screens, in a two-channel system to allow for redundancy. One screen is sized for 9 million gallons per day (mgd) peak wet weather flow (PWWF) and the second screen is sized for 12 mgd PWWF. Screened material is washed and pressed for disposal. After the screens, wastewater flows into a vortex aerated grit chamber with a bypass channel and primary clarifier splitter box. The grit removal structure is sized for 12 mgd and the four influent pumps are sized for 2,100 gallons per minute (gpm) each. Headworks capacity (gpd): 12 mgd
--	--

⁶ California Code of Regulations, Title 22 section 60301.230

[https://govt.westlaw.com/calregs/Document/IEA4FA520D4B911DE8879F88E8B0DAAAE?viewType=FullText&originContext=documenttoc&transitionType=CategoryPageItem&contextData=\(sc.Default\)](https://govt.westlaw.com/calregs/Document/IEA4FA520D4B911DE8879F88E8B0DAAAE?viewType=FullText&originContext=documenttoc&transitionType=CategoryPageItem&contextData=(sc.Default))

Influent Separation	Wastewater flows into the primary clarifier splitter box after degritting. The primary clarifier splitter box splits high salt flow and low salt flow. High salts flow goes to the high TDS pond, while low salts flow normally goes to the aeration basin/mixed liquor splitter box. Separation is controlled by monitoring electrical conductivity (EC). The high salts set point is approximately 2,600 microsiemens per centimeter ($\mu\text{S}/\text{cm}$). High salts flow is typically 0.35 million gallons per day (mgd) and as high as 0.5 mgd. This flow regularly occurs between 5:00 am and 10:00 am with the low salts flow occurring the remainder of the time. The low salts pond receives flow from the primary clarifier splitter box, tertiary filtration reject, sludge beds return flow and captured stormwater. Typical flows are 650 gpm during the high salts diversion five-hour period.
Low Salts Secondary Treatment	Secondary treatment systems for low salts wastewater consists of an aeration basin/mixed liquor splitter box, three aeration basins, two secondary clarifiers, a return activated sludge (RAS) and wasted activated sludge (WAS) pump station, and two equalization ponds. Undisinfected secondary recycled water may be diverted by overflow from these ponds to Lower Storage Ponds. Bypass of less than undisinfected secondary recycled water from these ponds is pumped to the Low TDS Pond where it is reintroduced to plant treatment at the aeration basin/mixed liquor splitter box. The aeration basin/mixed liquor splitter box equally distributes wastewater to the aeration basins. The aeration basins are sized for 3.2 mgd and a solids retention time (SRT) of 12 days. Each aeration basin has six zones and bypassing capabilities with various settings for anaerobic, anoxic, or oxic functions. Normal zone operation is anticipated to be anoxic (can be anaerobic), anoxic, oxic (can be anaerobic), anoxic (can be oxic), oxic and oxic. Various combinations of zone functions exist when planning maintenance, startup, and other operating conditions. Low Salts Secondary treatment capacity (mgd): 3.2

High Salts Biological and Filtered Treatment	Biological and filtered treatment for high salt concentration wastewater is performed by a membrane bioreactor (MBR). When high salt concentrations are detected by an electroconductivity meter in the primary clarifier splitter box, wastewater is redirected as high salt flow to 1 mm rotary drum screens with flows directed to a shotcrete-lined high TDS pond. This flow is pumped over the course of the next 24-hour period to a MBR for biological treatment and ultrafiltration (UF). The MBR is housed in two above ground steel process tanks. Each tank holds 4 cassettes with each cassette housing 16 membrane modules. Membrane pore sizes range from 0.001 microns to 0.05 microns with a nominal size of 0.035 microns and absolute pore size of less than 0.1 microns. Membrane useful life is approximately 5 years. High Salts biological and filtration treatment capacity (mgd): 0.5
Low Salts Filtration Treatment	Filtration of the low salt concentration wastewater stream is performed by the UF membrane facility. The UF membrane is used to separate or remove colloidal sized contaminants and suspended solids but does not remove dissolved solids such as salts. Membrane pore sizes range from 0.001 microns to 0.05 microns with a nominal size of 0.035 microns and absolute pore size of less than 0.1 microns. Filtration treatment capacity (mgd): 3.2
High Salts RO Filtration Treatment – Dissolved Salts Reduction	The high salts treatment train flows from the MBR to a reverse osmosis (RO) system for advanced treatment. The RO pore size is on the order of 0.0008 microns and employed to remove dissolved solids (salt) content from the MBR effluent. The RO facility consists of three RO military surplus refurbished mobile water treatment plants. Three units are used in 2+1 fashion with daily rotation to match the MBR effluent flow rates. Each of the three units houses a cartridge filter assembly and 40 spiral wound medium pressure membranes contained in 8 pressure vessels in a 4:2:1:1 four stage array. MBR effluent is dosed with ammonia to convert free chlorine to chloramines to prevent damage to the RO membranes. Sulfuric acid and antiscalant is also dosed to prevent calcium carbonate and sulfate formation on the RO membrane surface. RO permeate merges with the low salts UF membrane filtration permeate prior to disinfection. High Salts RO filtration treatment capacity, including up to 20% brine concentrate (mgd): 0.5

UV Disinfection	The UV disinfection system disinfects the comingled flows from the background UF permeate (low TDS treatment train) and the RO permeate (high TDS treatment train). Check valves upstream of the UV units and on both inflow lines prevent backflow in the system and the new upstream UV break tank provides steady state flow rates that improves UV system performance. The UV disinfection system in use is manufactured by Aquionics and consists of 4 inline Model 7500 medium pressure lamp chambers (a.k.a. banks). Each chamber houses 12 lamps. Standard operation is based on three in use with the one in standby. With all four units in operation at power level 3, the system can disinfect up to 4.7 mgd. Revalidation of UV lamps performed after startup of new treatment train may change these settings. Turbidity is monitored in the feed water, UV transmittance is monitored from the through-flow, and flow rate is monitored at the effluent. Disinfection Capacity (mgd): 4.7
RO Brine Disposal Method	RO Brine waste is disposed via an EPA Underground Injection Control class 1 non-hazardous well. Class I Non-Hazardous Permit No. R9UIC-CA1-FY20-3R Brine Disposal capacity (gpd): Injection rate is permitted to not exceed 6,480,000 gallons per month or 216,000 gpd.
Biosolids/Sludge Production and Handling	Solids from the two secondary clarifiers are sent to concrete lined beds for drying and hauled off annually to the Engel & Gray composting facility. The destination of biosolids produced is Engel & Gray located at 745 Betteravia Road, Santa Maria, California Annual production of biosolids: Approximately 306 dry tons of municipal class B biosolids
Non-Potable Recycled Water	<u>Non-potable Recycled Water Produced Onsite:</u> Disinfected tertiary recycled water and undisinfected secondary recycled water.

Non-Potable Recycled Water	<u>Recycled Water Use Areas:</u> Disinfected tertiary recycled water is held in short term storage (currently two one-million-gallon (mg) aboveground steel welded tanks) at the plant and distributed to offsite users. Recycled water not used on demand goes from the 1 mg holding tanks to the upper reservoir and irrigation of Laguna County Sanitation District pastureland. Current offsite reuse locations are: 1. Santa Maria Public Airport District – up to 200 million gallons per year on 510 acres of agriculture and landscaping. 2. Santa Maria Energy, LLC up to 163 million gallons per year for oil exploration and 285 acres of beef cattle pasture. 3. Northern Branch Jail up to 3.94 million gallons per year for landscape irrigation and laundry purposes. 4. Waller Park up to 101 million gallons per year for 65 acres of irrigated turf. 5. Laguna County Sanitation District pastureland. Up to 151 million gallons per year on 373 irrigable acres of pasture for beef cattle grazing. 6. Contractor historical use is up to 8 million gallons per year for dust control, grading operations, and soil compaction.
	<u>Undisinfected Secondary Recycled Water:</u> Per existing Division of Drinking Water requirements, if turbidity goes above 0.2 Nephelometric Turbidity Units (NTU), or if transmittance goes below 65%⁷, or if dose goes below 200 millijoules per square centimeter squared (mJ/cm²), then actuated valves located on the pipeline between the UV system and the recycled water holding tanks automatically divert highly treated but not fully disinfected effluent by gravity to lower storage ponds with a capacity of 80 million gallons. This effluent meets or exceeds the requirements for undisinfected secondary recycled water and is used for the irrigation of beef cattle pasture per CCR §60304(d)(4).

⁷ Transmittance and power dose parameters are based on State Water Resources Control Board Division of Drinking Water approved UV validation parameters per letter dated October 18, 2005. These parameters may change after the revalidation of the UV disinfection system.

Non-Potable Recycled Water	Enrolled in WQ 2016-0068-DDW:	Yes
	Disinfected Tertiary Recycled water capacity production volume (mgd):	3.6*

* The UV lamps validation was limited to 3.6 mgd at the time of test, however Laguna County Sanitation District may request that the Central Coast Water Board increase this to 3.7 mgd once the UV lamps are revalidated. Since other processes limit disinfected tertiary recycled water to 3.7 mgd, this will not be increased beyond 3.7 once the lamps are revalidated.

Chemical additives are used to maintain the functions of filters, to adjust pH, and to ensure clean tanks and piping. They are not a requirement of this permit for treatment or disinfection of wastewater. Laguna County Sanitation District reported the following chemical additives to the treatment system and the reason for their use.

- Sodium Hypochlorite 12.5% - 3,200 gallons per month. Required for UF and MBR membrane cleaning.
- Sodium Hypochlorite 12.5% – 930 gallons per month. Applied to keep recycled water piping and tanks clean.
- Citric Acid 50% - 1,000 gallons per month. Required for UF and MBR membrane cleaning.
- Sulfuric Acid 93% - 600 gallons per month. Required for pH control of RO feed water.
- Aqua Ammonia 29.4% - 150 gallons per month. Required to convert free chlorine to chloramines in RO feed water.
- Antiscalant – 300 gallons per month. Required to maintain RO elements.

A summary of historic and recent average effluent concentrations is included in Table 3, which were reported in Laguna County Sanitation District quarterly monitoring reports. The data includes modeled effluent quality as presented in *Design Memorandum No. 1* dated May 2016 by Carollo Engineers. The Central Coast Water Board used reported and modeled effluent water quality data to establish the effluent and groundwater limitations in section 3.

Table 3. Effluent Water Quality for Select Constituents

Constituents	Units [1]	Annual Average for 2018 [2]	Annual Average for 2021 [3][4]
Biochemical Oxygen Demand, 5-Day	mg/L	2.5	3.8 (1.0)
Total Suspended Solids	mg/L	1.4	0.0
Total Dissolved Solids	mg/L	760	716
Chloride	mg/L	161	136
Sodium	mg/L	155	142
Sulfate	mg/L	202	181
Boron	mg/L	0.4	0.3

Constituents	Units [1]	Annual Average for 2018 [2]	Annual Average for 2021 [3][4]
Total Nitrogen	mg/L	22.7	23.5 (4.6)
Nitrate as Nitrogen	mg/L	7.1	1.8

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by Laguna County Sanitation District in the 2018 annual monitoring report.

[3] Based on water quality data reported by Laguna County Sanitation District in the 2021 annual monitoring report.

[4] Values in parenthesis is data reported in the Design Memorandum No. 1 dated 2016 by Carollo Engineers.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

Laguna County Sanitation District must operate the Wastewater System in accordance with the General Permit and this notice of applicability. Laguna County Sanitation District must comply with the wastewater specific limitations specified in Table 4 through 8. Laguna County Sanitation District land applies treated wastewater and thus organic loading limitations specified in Table 9 apply.

Flow limitations are shown in Table 4. Effluent limitations for Disinfected Tertiary Recycled Water are shown in Table 8. **Interim effluent limitations presented in Tables 5a and 5b apply for up to 24 months from the date of this notice of applicability. Effluent limitations shown in Tables 6 and 7 apply immediately after the 24 month period.**

A. Flow Limitations:

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily Disinfected Tertiary Recycled Water Low TDS Train	Million Gallons per day	3.2	Effluent
Maximum Daily RO Permeate High TDS Train	Million Gallons per Day	0.5	Effluent
Total Combined Treatment Capacity	Million Gallons Per Day	3.7	Effluent

B. Effluent Limitations:

Based on reported water quality data, effluent water quality meets the General Permit effluent limits for an activated sludge, MBR, and non-potable recycled water producer.

The Laguna County Sanitation District's Wastewater System is undergoing construction upgrades at this time. Therefore, pursuant to the General Permit, Laguna County Sanitation District can comply with their individual permit No. R3-2011-0127 limits for two years as presented in Tables 5a and 5b.

Effluent discharged to the Laguna County Sanitation District's irrigated land disposal area shall not exceed the following:

Table 5a: Interim Land Disposal Effluent Limitations

Constituent	Units	Monthly Average	Daily Maximum
Settleable Solids	mL/L	0.1	0.4
BOD, 5-Day	mg/L	30	90
Suspended Solids	mg/L	30	90
Total Dissolved Solids ¹	mg/L	900	Not applicable
Sodium ¹	mg/L	180	Not applicable
Chloride ¹	mg/L	180	Not applicable
pH	within the range 6.5 to 8.4		
Dissolved Oxygen	at all times not less than 2.0 mg/L		

mL/L – milliliters per liter

mg/L – milligrams per liter

[1] Compliance based upon 12-month running mean.

Recycled water shall be adequately oxidized, coagulated, clarified, filtered, disinfected and not exceed the following limitations:

Table 5b: Interim Recycled Water Limitations

Constituent	Units	Monthly Average (30-day)	Daily Maximum
Settleable Solids	mL/L	Not applicable	0.1
Suspended Solids	mg/L	10	25
Sulfate	mg/L	300	Not applicable
Boron	mg/L	0.5	Not applicable

Table 6. Effluent Limitations at ES-2⁸

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day ^{[4][5]}	mg/L ^[1]	30	45	Not Applicable
Total Suspended Solids ^{[4][5]}	mg/L	30	45	Not Applicable

⁸ Points of compliance are defined in Proposed Process Flow Diagram found in Attachment 2 and in Attachment 3 - Monitoring and Reporting Program R3-2023-0019.

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Settleable Solids	mL/L ^[2]	0.1	0.3	0.5
pH	Not Applicable	Between 6.5 and 8.4 ^[3]	Not Applicable	Not Applicable

[1] mg/L denotes milligram per liter.

[2] mL/L denotes milliliters per liter.

[3] Basin Plan. For pH, the effluent limitation values shown are a range, not an average or maximum.

[4] USEPA Office of Wastewater Management, Water Permits Division, State and Regional Branch, EPA 833-K-10-001, September 2010.

[5] USEPA, Code of Federal Regulations, title 40, part 133.102, Secondary Treatment Standards, Technology-Based Effluent Limits

Table 7. Effluent Limitations at ES-2 Based on Current Non-Designated Groundwater Basin

Constituent	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L	900
Chloride	mg/L	180
Sodium	mg/L	180
Sulfate	mg/L	300
Boron	mg/L	0.5
Total Nitrogen	mg/L	10

Table 8. Effluent Limitations for Disinfected Tertiary Recycled Water at ES-1 and ES-2

Constituents	Units	Regulatory Limitations	Point of Compliance/ Sample Location
Transmittance	%T ^[1]	Minimum 65%	ES-1
Turbidity	NTU ^[2]	- Pre-UV must be ≤ 0.2 NTU 95% of the time within a 24-hour period. - Must not exceed 0.5 NTU at any time. ^[5]	ES-1

Constituents	Units	Regulatory Limitations	Point of Compliance/ Sample Location
Total Coliform	MPN/100 mL ^{[3],[4]}	Post UV Must Not Exceed: 2.2 MPN per 100 mL (median concentration), as determined from the bacteriological results of the last seven days for which analyses have been completed. 23 MPN per 100 mL in more than one sample in any 30-day period. 240 MPN per 100 mL in any single sample.	ES-2
Virus	% Inactivation	A disinfection process that, when combined with the filtration process, has been demonstrated to inactivate and/or remove 99.999 percent of the plaque forming units of F-specific bacteriophage MS2, or polio virus in the wastewater. A virus that is at least as resistant to disinfection as polio virus may be used for purposes of the demonstration.	ES-2

[1] %T denotes percent transmittance

[2] NTU denotes Nephelometric Turbidity Unit

[3] MPN denotes most probable number

[4] mL denotes milliliters

[5] Technology based effluent limit for MBR.

C. Organic Loading Limitations

Laguna County Sanitation District land applies treated wastewater and thus organic loading limitations specified in Table 9 apply.

Table 9. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

D. Ultraviolet Disinfection Unit Requirements:

The UV disinfection unit must be operated in accordance with the manufacturer's specifications, UV validation testing, title 22 Engineering report, and Division of Drinking Water title 22 Engineering report letter of approval. Table 10 below includes some, but

not all, of the required UV setpoints. UV lamps must operate at the specified parameters presented in Table 10 and be inspected monthly to determine if cleaning and/or maintenance are needed. Revalidation after startup of new treatment system may revise the set point values.

Table 10. Required UV Parameters ^[1]

UV Parameters	Unit	Value	Actions
No. of Medium Pressure UV Banks	UV Banks	3	Three UV banks must always be in operation. A fourth bank will be on standby and must be used if conditions warrant.
UV dose	mJ/cm ² ^[2]	200 minimum	Must divert all flows to effluent storage pond if below 200 mJ/cm ² with three banks. Must notify end users of reuse water supply quality problem. The power reading level must be increased as needed to ensure minimum required delivered dose is always achieved. The Aquionics equations used to control the dose setting must not be modified or altered in any manner without notifying and receiving written permission from the Central Coast Water Board and Division of Drinking Water.
Percent Transmittance	%T	65 minimum	Measured at ES-1. Must divert all flows to effluent storage ponds if the transmittance falls below 65%.
Maximum Flow Rate	gpm	2,500 maximum	Must limit UF flux rates to not exceed stated value (with three UV banks running).

[1] Revalidation after startup of new treatment system may revise the set point values.

[2] mJ/cm² denotes millijoules per square centimeter

**ATTACHMENT 2
FIGURES**

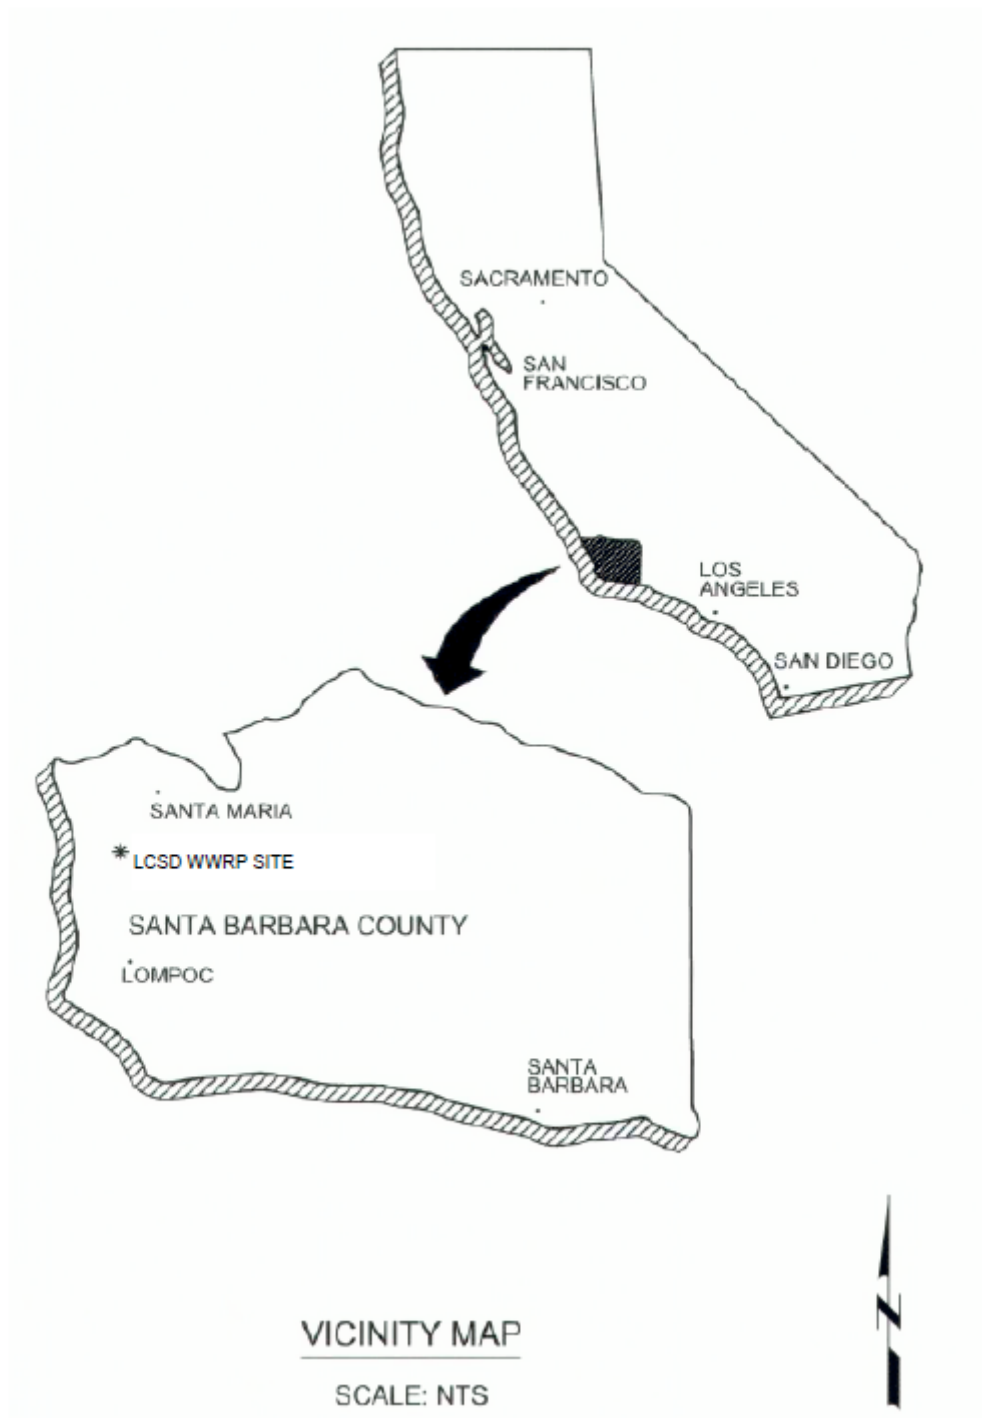


FIGURE 1. VICINITY MAP

FIGURE 2. PROCESS FLOW DIAGRAM



FIGURE 3. OVERALL SITE PLAN

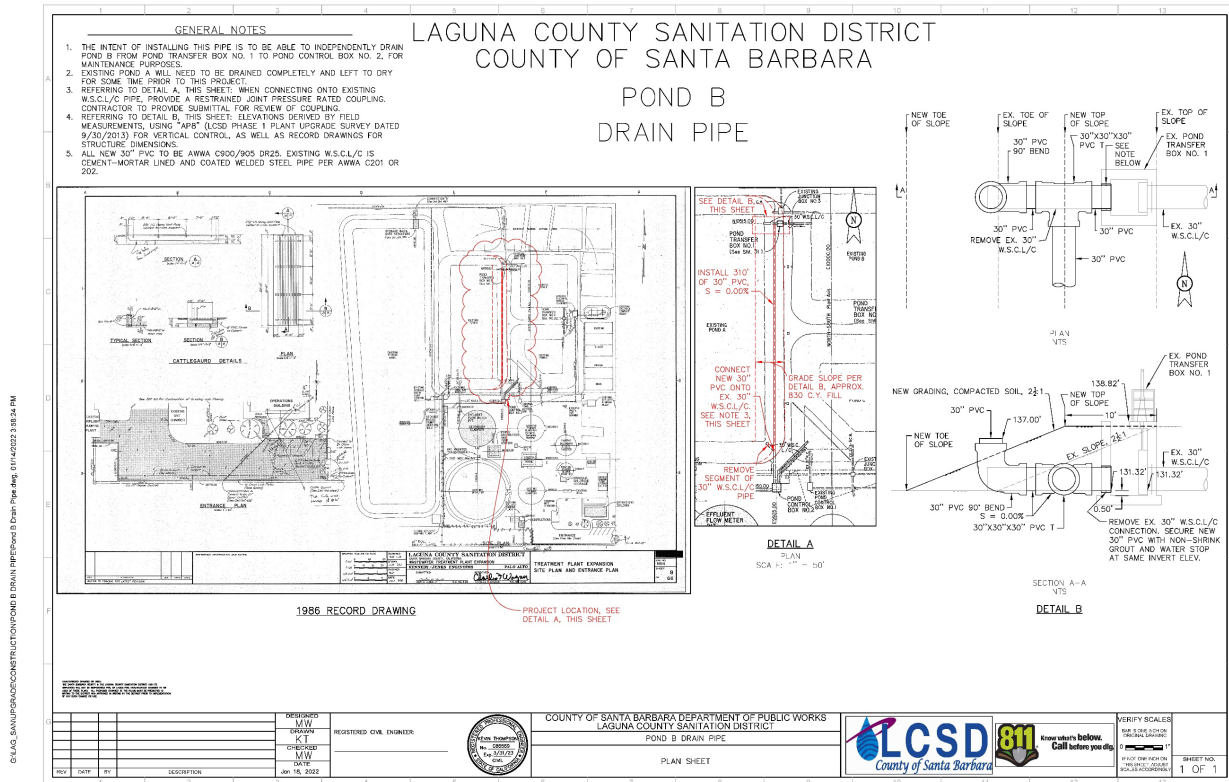


FIGURE 4. POND B DRAIN PIPE BYPASS



**FIGURE 5. IMAGE OF NEW AND EXISTING WASTEWATER SYSTEM
PHOTO DATE NOVEMBER 11, 2022**

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD
MONITORING AND REPORTING PROGRAM NO. R3-2023-0019
(FEBRUARY 13, 2023 MODIFICATION OF MONITORING AND REPORTING
PROGRAM NO. R3-2020-0020)
FOR
LAGUNA COUNTY SANITATION DISTRICT RECLAMATION SYSTEM
SANTA MARIA, SANTA BARBARA COUNTY

This Monitoring and Reporting Program applies to the monitoring and reporting requirements for Laguna County Sanitation District wastewater reclamation plant (Reclamation System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

Laguna County Sanitation District owns and operates the Reclamation System that is subject to the General Permit and notice of applicability. Laguna County Sanitation District must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs Laguna County Sanitation District to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section V.C).

I. SAMPLING AND ANALYSIS

Laguna County Sanitation District must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the

Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with **Table 1**.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW) and others presented in Table 2 must be collected at the locations described in Table 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **Laguna County Sanitation District must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 9).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Water Supply Well	WSW-1	Water purveyor data or consumer confidence reports of water supplied in the Laguna County Sanitation District's service area.

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks.
Effluent Sample	ES-1	Treated wastewater sample collected upstream of ultraviolet light (UV) disinfection banks
Effluent Sample	ES-2	Treated wastewater sample collected downstream of UV disinfection banks
Reservoir Sample	ES-3	Holding reservoir (primary storage facility) sample collected 8-inches below surface
Pond Sample	ES-4A through ES-4H	Holding ponds sample collected 8-inches below surface. Eight holding ponds labeled ES-2A through ES-2H.
Monitoring Well 1	MW-1	Existing groundwater monitoring well LCSD-1 ^[1]
Monitoring Well 6	MW-6	Existing groundwater monitoring well LCSD-6 ^[1]
Monitoring Well 7	MW-7	Existing groundwater monitoring well LCSD-7 ^[1]
Monitoring Well 8	MW-8	Existing groundwater monitoring well LCSD-8 ^[1]
Monitoring Well 12	MW-12	Existing groundwater monitoring well LCSD-12 ^[1]
Monitoring Well 13	MW-13	Existing groundwater monitoring well LCSD-13 ^[1]
Monitoring Well 14	MW-14	Existing groundwater monitoring well LCSD-14 ^[1]

[1] This monitoring and reporting program does not contain requirements to sample groundwater, however historical groundwater monitoring data exists at these locations.

II. WATER SUPPLY MONITORING

Representative raw water supply data (sampled before use or treatment) of water supplied in the Laguna County Sanitation District's service area that, at a minimum, include constituents specified in Table 3. Data must be submitted annually and may come from online water purveyor data or consumer confidence reports (annual water quality report or drinking water quality report) that includes water purveyor's water quality, as required by the State Water Board Division of Drinking Water and/or county.

Laguna County Sanitation District must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring at WSW-1

Constituent	Units^[1]
Nitrate (as N)	mg/L
Total Dissolved Solids	mg/L
Chloride	mg/L
Sodium	mg/L
Sulfate	mg/L
Boron	mg/L
Carbonate	mg/L
Bicarbonate	mg/L
Calcium	mg/L
Potassium	mg/L
Magnesium	mg/L

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – Laguna County Sanitation District must monitor and report flow in gallons per day, as described in Table 4 with each monitoring report. See monitoring and reporting program section V.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent (IS-1) and Effluent (ES-2) Flow Monitoring

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter ^[2]	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[1]	Metered	Daily	Metered	Daily
Maximum Daily Flow	Metered	Monthly	Metered	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter ^[2]	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Total Flow Volume Delivered to Each Recycled Water Use Area	Not Applicable	Not Applicable	Metered	Monthly

- [1] The General Permit notice of applicability specifies the Reclamation System's maximum permitted flow. In the monitoring reports, Laguna County Sanitation District must evaluate and provide a comparison of monitored flow to the permitted flow.
- [2] Report as million gallons per day, mgd.

B. Reclamation System Monitoring – Representative samples of Laguna County Sanitation District's influent (raw wastewater) into the Reclamation System and effluent (recycled water) distributed to holding ponds, holding tanks, or end users must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figure 1 for the location of samples and GeoTracker field points.

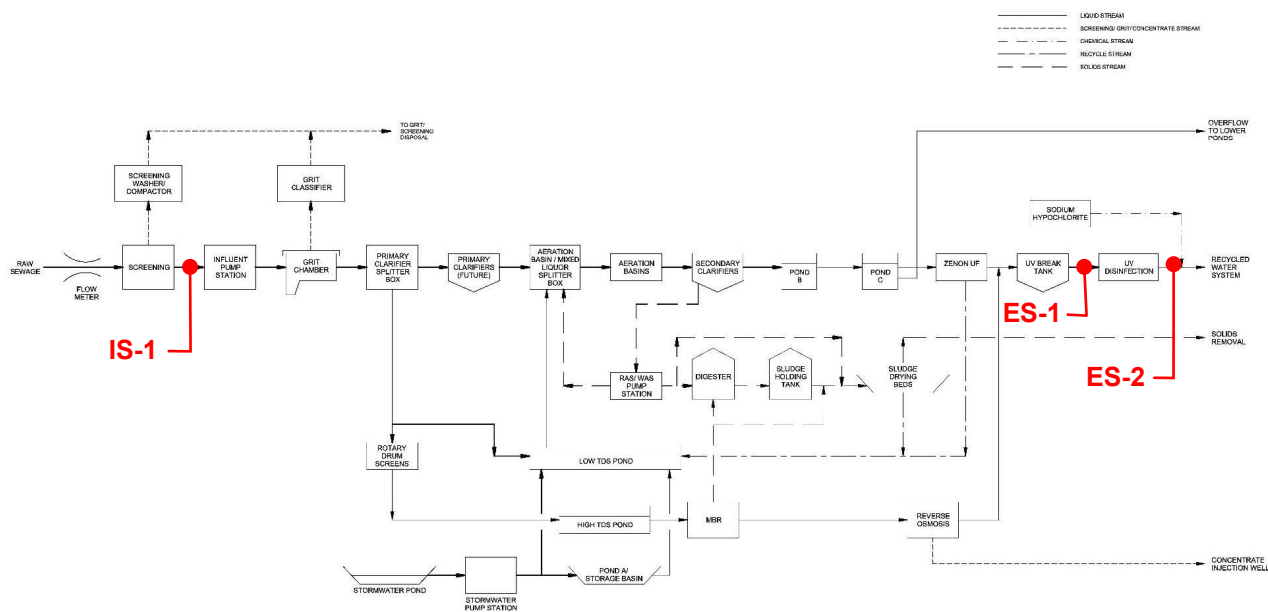


Figure 1. Process Flow Diagram and Sample Locations

1. Pond System Monitoring

- i. **Required Reservoir and Pond Monitoring** – All wastewater treatment and recycled water storage ponds (lined and unlined) must be monitored as specified in Table 5.

Table 5. Recycled Water Storage Reservoir and Pond Monitoring at ES-3 and ES-4A through ES-4H

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
Dissolved Oxygen	mg/L	Grab	Monthly
Odors	Not Applicable	Observation	Weekly
Berm condition	Not Applicable	Observation	Monthly

2. Activated Sludge, Membrane Biological Reactor, and Reverse Osmosis Treatment Systems

- i. **Influent and Effluent Monitoring** – At a minimum, influent and effluent constituent monitoring for the activated sludge, membrane biological reactor, reverse osmosis reclamation system must be consistent with Table 6.

Table 6. Influent and Effluent Monitoring at IS-1 and ES-2

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-2)	EFFLUENT (ES-2)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
pH	units	Grab	Weekly	Grab	Weekly
Biochemical Oxygen Demand, 5-Day	mg/L	24-hour composite	Monthly	Grab	Monthly
Total Suspended Solids	mg/L	24-hour composite	Monthly	Grab	Monthly
Total Nitrogen ^[1]	mg/L	Calculated	Quarterly	Calculated	Monthly
Nitrate (as N) + Nitrite (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly

		INFLUENT (IS-1)	INFLUENT (IS-1)	EFFLUENT (ES-2)	EFFLUENT (ES-2)
Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Total Kjeldahl Nitrogen (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly
Ammonia (as N)	mg/L	24-hour composite	Quarterly	Grab	Monthly
Settleable Solids	mg/L	Not Required	Not Required	Grab	Weekly
Total Dissolved Solids	mg/L	Not Required	Not Required	Grab	Monthly
Chloride	mg/L	Not Required	Not Required	Grab	Monthly
Sodium	mg/L	Not Required	Not Required	Grab	Monthly
Sulfate	mg/L	Not Required	Not Required	Grab	Monthly
Boron	mg/L	Not Required	Not Required	Grab	Monthly
Carbonate	mg/L	Not Required	Not Required	Grab	Semiannually
Bicarbonate	mg/L	Not Required	Not Required	Grab	Semiannually
Calcium	mg/L	Not Required	Not Required	Grab	Semiannually
Potassium	mg/L	Not Required	Not Required	Grab	Semiannually
Magnesium	mg/L	Not Required	Not Required	Grab	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

C. Effluent Monitoring for Non-Potable Recycled Water Producers – Wastewater effluent monitoring of non-potable recycled wastewater is required if a Reclamation System is recycling non-potable treated wastewater pursuant to a State Water Board Division of Drinking Water conditionally accepted title 22 Engineering Report.

A conditionally accepted title 22 Engineering Report will specify non-potable recycled water monitoring requirements (e.g., disinfection, priority pollutants). Laguna County Sanitation District is required to comply with the non-potable recycled water monitoring requirements specified in Table 7 and the title 22 Engineering Report. If there is an overlap in constituent-specific monitoring, the title 22 Engineering Report governs.

Table 7. Effluent Monitoring for Ultraviolet Treatment at ES-1 and ES-2

Constituent	Units	Sample Type	Sampling Frequency	Sampling Location
Turbidity ^[1]	NTU ^[3]	Continuous	Continuously	ES-1
Total Coliform ^[1]	MPN/100 mL ^[2]	Grab	Daily	ES-2
Virus ^[1]	%Inactivation	Demonstrate per Notice of Applicability Table 10: UV Required Parameters	Continuous	ES-2

[1] Report values as required by conditionally accepted title 22 Engineering Report and/or Division of Drinking Water conditional acceptance letter.

[2] MPN/100 mL denotes most probable number per 100 mL sample.

[3] NTU denotes Nephelometric Turbidity unit.

IV. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

Laguna County Sanitation District must report the handling and disposal of all sludge/biosolids generated at the Reclamation System. Records must include the date removed from the Reclamation System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Laguna County Sanitation District must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, Laguna County Sanitation District must explain the absence of this monitoring in the annual report.

V. REPORTING REQUIREMENTS

A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 8.

Table 8. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **Laguna County Sanitation District must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. If groundwater monitoring is required in the future by the Central Coast Water Board issuing a revised monitoring and reporting program, an updated hydrogeologic conceptual site model with the groundwater monitoring reporting requirements based on new information generated from the monitoring well boring logs, groundwater elevation data, and water quality data.
 - vi. If groundwater monitoring is required in the future by the Central Coast Water Board issuing a revised monitoring and reporting program, copies of groundwater monitoring well field sheets with purge methods and data.

2. **Annual Reporting** – Laguna County Sanitation District must submit annual reports in compliance with Standard Provisions 2013¹, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

3. **State Water Board Volumetric Annual Reporting** – Laguna County Sanitation District must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database².

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e., total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website³.

B. NON-COMPLIANCE REPORTING:

Laguna County Sanitation District must notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, the conditionally accepted title 22 Engineering Report requirements, delivery of off-specification recycle water, and wastewater containment failure, pursuant to General Permit section VI.C.2.

¹ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

² See: <https://geotracker.waterboards.ca.gov/>

³ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

C. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permiitting/docs/transmittal_sheet.pdf

Laguna County Sanitation District must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{4,5} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Reclamation System-specific global identification number **WDR100030531** at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:

Geotracker@waterboards.ca.gov.

Table 9 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 9. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Reclamation System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.

⁴ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁵ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Reclamation System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

- [1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. Laguna County Sanitation District must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.
- [2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

VI. TECHNICAL REPORTS

The technical reports are due as described in Table 10.

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date
Pretreatment Program Plan	Not Required at This Time
UV Validation Report	60-days after completion of UV validation test
Operations and Maintenance Manual	February 13, 2024
Climate Change Adaptation Plan	February 13, 2025
Capital Improvement Plan	February 13, 2026

1. **Pretreatment Program Plan** – A Pretreatment Program is not required at this time. If the Central Coast Water Board notifies Laguna County Sanitation District that development of a Pretreatment Program Plan is required, submit a plan that meets the requirements specified in General Permit section IV.F.2.i and General Permit section VI.A.1. The plan must contain an implementation schedule and identification of adequate funding to implement the plan.
2. **UV Validation Report** – Laguna County Sanitation District proposes to revalidate the UV system upon completion of the plant upgrade currently under construction. Provide updated UV Validation Report and Division of Drinking Water approval letter immediately upon receipt.
3. **Operations and Maintenance Manual** – In addition to the required components specified in Standard Provisions⁶ A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component

⁶ See Attachment E, Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

must contain an implementation schedule and identification of adequate funding to implement the component.

- i. **Sampling and Analysis Plan** – Laguna County Sanitation District's Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of Laguna County Sanitation District must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
 - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Reclamation System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds), buildings, (if Laguna County Sanitation District needs to update Figure 1 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).
 - b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report).
 - h. For groundwater monitoring, a description of the well purging and field methods.
- ii. **Sludge Management Plan** – Laguna County Sanitation District's Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
 - a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.

- c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
 - iii. **Spill Prevention and Emergency Response Plan** – Laguna County Sanitation District's Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Reclamation System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.
 - b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
 - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.
 - d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
 - e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.

- ⁷ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

- e. Increased power outages.
 - ii. Resiliency Actions – Identify actions to build Reclamation System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
 - iii. Adaptation Strategy – For Reclamation Systems with design flows over 1,000,000 gallons per day, develop and implement a strategy to complete resiliency actions, at a minimum encompassing the following:
 - a. Prioritization – Prioritized resiliency actions based on risks to water quality, but also accounting for costs and benefits.
 - b. Schedule and Milestones – Timeframes to complete prioritized resiliency actions and/or climate change hazard triggers to inform when Laguna County Sanitation District must implement actions. Milestones to complete critical steps for prioritized resiliency actions, designed to demonstrate measurable progress at a steady, or accelerated, completion pace over the established timeframes.
 - c. Financial Planning – Projected costs necessary to implement and sustain resiliency actions and strategy to procure funds.
5. **Capital Improvements Plan** – Laguna County Sanitation District must prepare and submit a Capital Improvement Plan (CIP). The CIP must contain all significant capital projects, equipment purchases, and major studies for operating the Laguna County Sanitation District's Wastewater Reclamation System. In general, the CIP will include the following elements:
- i. Estimated Overall Cost of Each Project
 - ii. Estimated Operational & Maintenance Cost for Each Project
 - iii. Estimated Project Timelines
 - iv. Funding Sources
 - v. Project Prioritization

VII. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that the Laguna County Sanitation District submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Laguna County Sanitation District to enforcement action pursuant to section 13268 of the California Water Code. Pursuant to [section 13268 of the Water Code](#), a violation of a request made pursuant to section 13267 may subject Laguna County Sanitation District to civil liability assessment of up to \$1,000 per day in which the violation occurs.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Laguna County Sanitation District is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Laguna County Sanitation District must implement the above monitoring program on April 1, 2023. The Central Coast Water Board may rescind or modify this monitoring and reporting program at any time.

Ordered By:

 Digitally signed by
Jennifer Epp
Date: 2023.02.13 09:37:30
-08'00'
Water Boards

for Matthew T. Keeling
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Santa Barbara Co\Laguna County Sanitation District WWTP\2023 NOA-WDR\final\LCSD R3-2023-0019 MRP-Final.docx