

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. R6V-2004-0018
WDID NO. 6B140109001

REVISED WASTE DISCHARGE REQUIREMENTS
FOR

HILTON CREEK COMMUNITY SERVICES DISTRICT, AND THE U.S. DEPARTMENT OF
THE INTERIOR, BUREAU OF LAND MANAGEMENT; HILTON CREEK
WASTEWATER TREATMENT PLANT

Mono County

The California Regional Water Quality Control Board, Lahontan Region (Regional Board) finds:

1. Discharger

The Hilton Creek Community Services District submitted information that constitutes a revised Report of Waste Discharge. For the purpose of this Regional Board Order (Order), Hilton Creek Community Services District is referred to as the "Discharger." The U.S. Department of the Interior, Bureau of Land Management is the "Landowner."

2. Facility

The Hilton Creek Wastewater Treatment Plant is the facility from which the discharge occurs. For the purpose of this Order, the Hilton Creek Wastewater Treatment Plant is referred to as the "Facility." The Facility discharges secondary treated domestic wastewater to four percolation ponds.

3. History of Previous Regulation by the Regional Board

The Regional Board previously established Waste Discharge Requirements (WDRs) for the Facility under Board Order No. 6-78-25, which was adopted on May 11, 1978 and updated by Board Order No. 6-84-12 on January 12, 1984 and Board Order No. 6-94-63 on May 19, 1994.

4. Reason for Action

The Regional Board is updating WDRs for the Facility as part of a statewide program to periodically review and update WDRs and to incorporate changes based on expansion of the Facility.

5. Facility Location

The Facility is located approximately 14 miles southwest of the Town of Mammoth Lakes, Mono County, within Section 27, T4S, R29E, MDB&M, as shown on Attachment "A," which is made part of this Order.

6. Description of Facility and Discharge

The Discharger collects, treats and disposes of domestic wastewater from the communities of Hilton Creek and Lake Crowley. Currently, the Facility is designed for daily flows of 0.176 million gallons per day (mgd) and peak instantaneous flow of 0.403 mgd. The Facility has measured daily flows of 0.045 mgd and peak flows of 0.175 mgd. Treatment is provided by a barminutor, extended aeration activated sludge tanks, a secondary clarifier and sludge drying beds. Treated wastewater is disposed in four percolation ponds connected in parallel.

7. Authorized Disposal Site

The percolation ponds are the only authorized disposal site for wastewater, as shown on attachment "B," which is made part of this Order. The designated disposal site is located on land owned by the U.S. Government and administered by the Department of the Interior, Bureau of Land Management. The disposal site is operated by the Discharger.

8. Sludge Treatment and Disposal

Sludge is periodically removed from the secondary clarifier to drying beds. Dried sludge is disposed at the Benton Crossing Class III solid waste disposal site or an alternate authorized disposal site. The Benton Crossing Class III solid waste disposal site is currently the authorized sludge disposal site.

9. Site Geology

The geology of the site is characterized by older alluvial (Pleistocene) stream deposits including late Pleistocene glacial outwash and related periglacial sediments.

10. Site Hydrology

Runoff from the plant flows to Lake Crowley located approximately one mile south of the Facility, and to Hilton Creek approximately 1½ miles southwest of the Facility.

11. Site Hydrogeology

Depth to ground water at the disposal site is expected to fluctuate with the seasons and the amount of precipitation received in the Sierra Nevada mountains. No ground water was found in a 35-foot test hole excavated at the disposal site on November 10, 1977. Depth to ground water in monitoring well No. 1, which is located down-gradient, 350 feet north of the disposal site, was 19 feet below ground surface (bgs) on September 28, 1983. Ground water in monitoring well No. 3 located 300 feet northeast of the site was found at a depth of two feet bgs on June 17, 1983. The quality of ground water beneath the site is excellent with measured total dissolved solids of less than 200 mg/L.

12. Receiving Waters

The receiving waters are the ground waters of the Long Hydrologic Area of the Owens Valley Hydrologic Unit (Department of Water Resources Hydrologic Unit No. 603.10 and DWR Ground Water Basin No. 6-11).

13. Lahontan Basin Plan

The Regional Board adopted a Water Quality Control Plan for the Lahontan Region (Basin Plan) on March 31, 1995. This Order implements the Basin Plan as amended.

14. Beneficial Uses

The beneficial uses of the ground waters of the Long Hydrologic Area of the Owens Valley Hydrologic Unit as set forth and defined in the Basin Plan are:

- a. municipal and domestic supply (MUN)
- b. agricultural supply (AGR)
- c. industrial service (IND)
- d. freshwater replenishment (FRSH)

15. California Environmental Quality Act Compliance

This project involves minor alteration of an existing facility and is therefore exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000, et seq.) in accordance with Title 14, California Code of Regulations, Chapter 3, Section 15301.

16. Notification of Interested Parties

The Regional Board has notified the Discharger and interested parties of its intent to revise waste discharge requirements for the discharge.

17. Consideration of Public Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent/Discharge Limitations

- 1. The total effluent flow of wastewater during a 24-hour period shall not exceed 0.176 million gallons.
- 2. The maximum (peak) instantaneous flowrate of wastewater shall not exceed 0.403 mgd.
- 3. All wastewater made available for percolation at the authorized disposal site shall not contain pollutant concentrations in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Maximum</u>
BOD	mg/L	30	45
MBAS ²	mg/L	1.0	2.0

4. All wastewater made available for percolation at the authorized disposal site shall not have a pH of less than 6 pH units or more than 9 units.
5. All wastewater made available for percolation at the authorized disposal site shall not have a dissolved oxygen concentration of less than 1.0 mg/L.

B. Receiving Water Limitations

The discharge of waste shall not cause the presence of the following substances or conditions in ground waters of the Long Hydrologic Area of the Owens Valley Hydrologic Unit:

1. Any perceptible color, odor, taste or foaming.
2. Coliform organisms attributable to human wastes.
3. Toxic substances in concentrations that individually, collectively, or cumulatively cause detrimental physiological responses in humans, plants, animals, or aquatic life.
4. Identifiable chlorinated hydrocarbons, organophosphate, carbamate, and other pesticide and herbicide groups, in summation in excess of the lowest detectable levels.
5. Concentrations of chemical constituents in excess of the maximum contaminant levels or secondary maximum contaminant levels based upon drinking water standards specified by the more restrictive of the California Code of Regulations (CCR), Title 22, Division 4; Title 23, Chapter 15; or U.S. Code of Federal Regulations (CFR) 40 CFR, Part 141.

C. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent at or from the authorized disposal site to adjacent land areas or surface waters is prohibited.
3. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than two (2) feet.

¹ The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days.
² Methylene Blue Active Substances

4. Neither the treatment nor the discharge shall cause a nuisance, pollution or threatened pollution as defined in Section 13050 of the California Water Code.
5. The discharge of wastewater except to the authorized disposal site is prohibited.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Board Order No. 6-94-63 is hereby rescinded.

B. Operator Certification

The Discharger's wastewater treatment plant shall be supervised by persons possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to Title 23, Division 4, Chapter 14, CCR.

C. Standard Provisions

The Discharger shall comply with the "Standard Provisions for Waste Discharge Requirements," dated September 1, 1994, in Attachment "C", which is made part of this Order.

D. Monitoring and Reporting

1. Pursuant to the California Water Code Section 13267(b), the Discharger shall comply with the Monitoring and Reporting Program No. R6V-2004-0018 as specified by the Executive Officer.
2. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of the Monitoring and Reporting Program.


I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on June 9, 2004.



HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: A. Location map
B. Location of Disposal Ponds
C. Standard Provisions

ATTACHMENT "A"

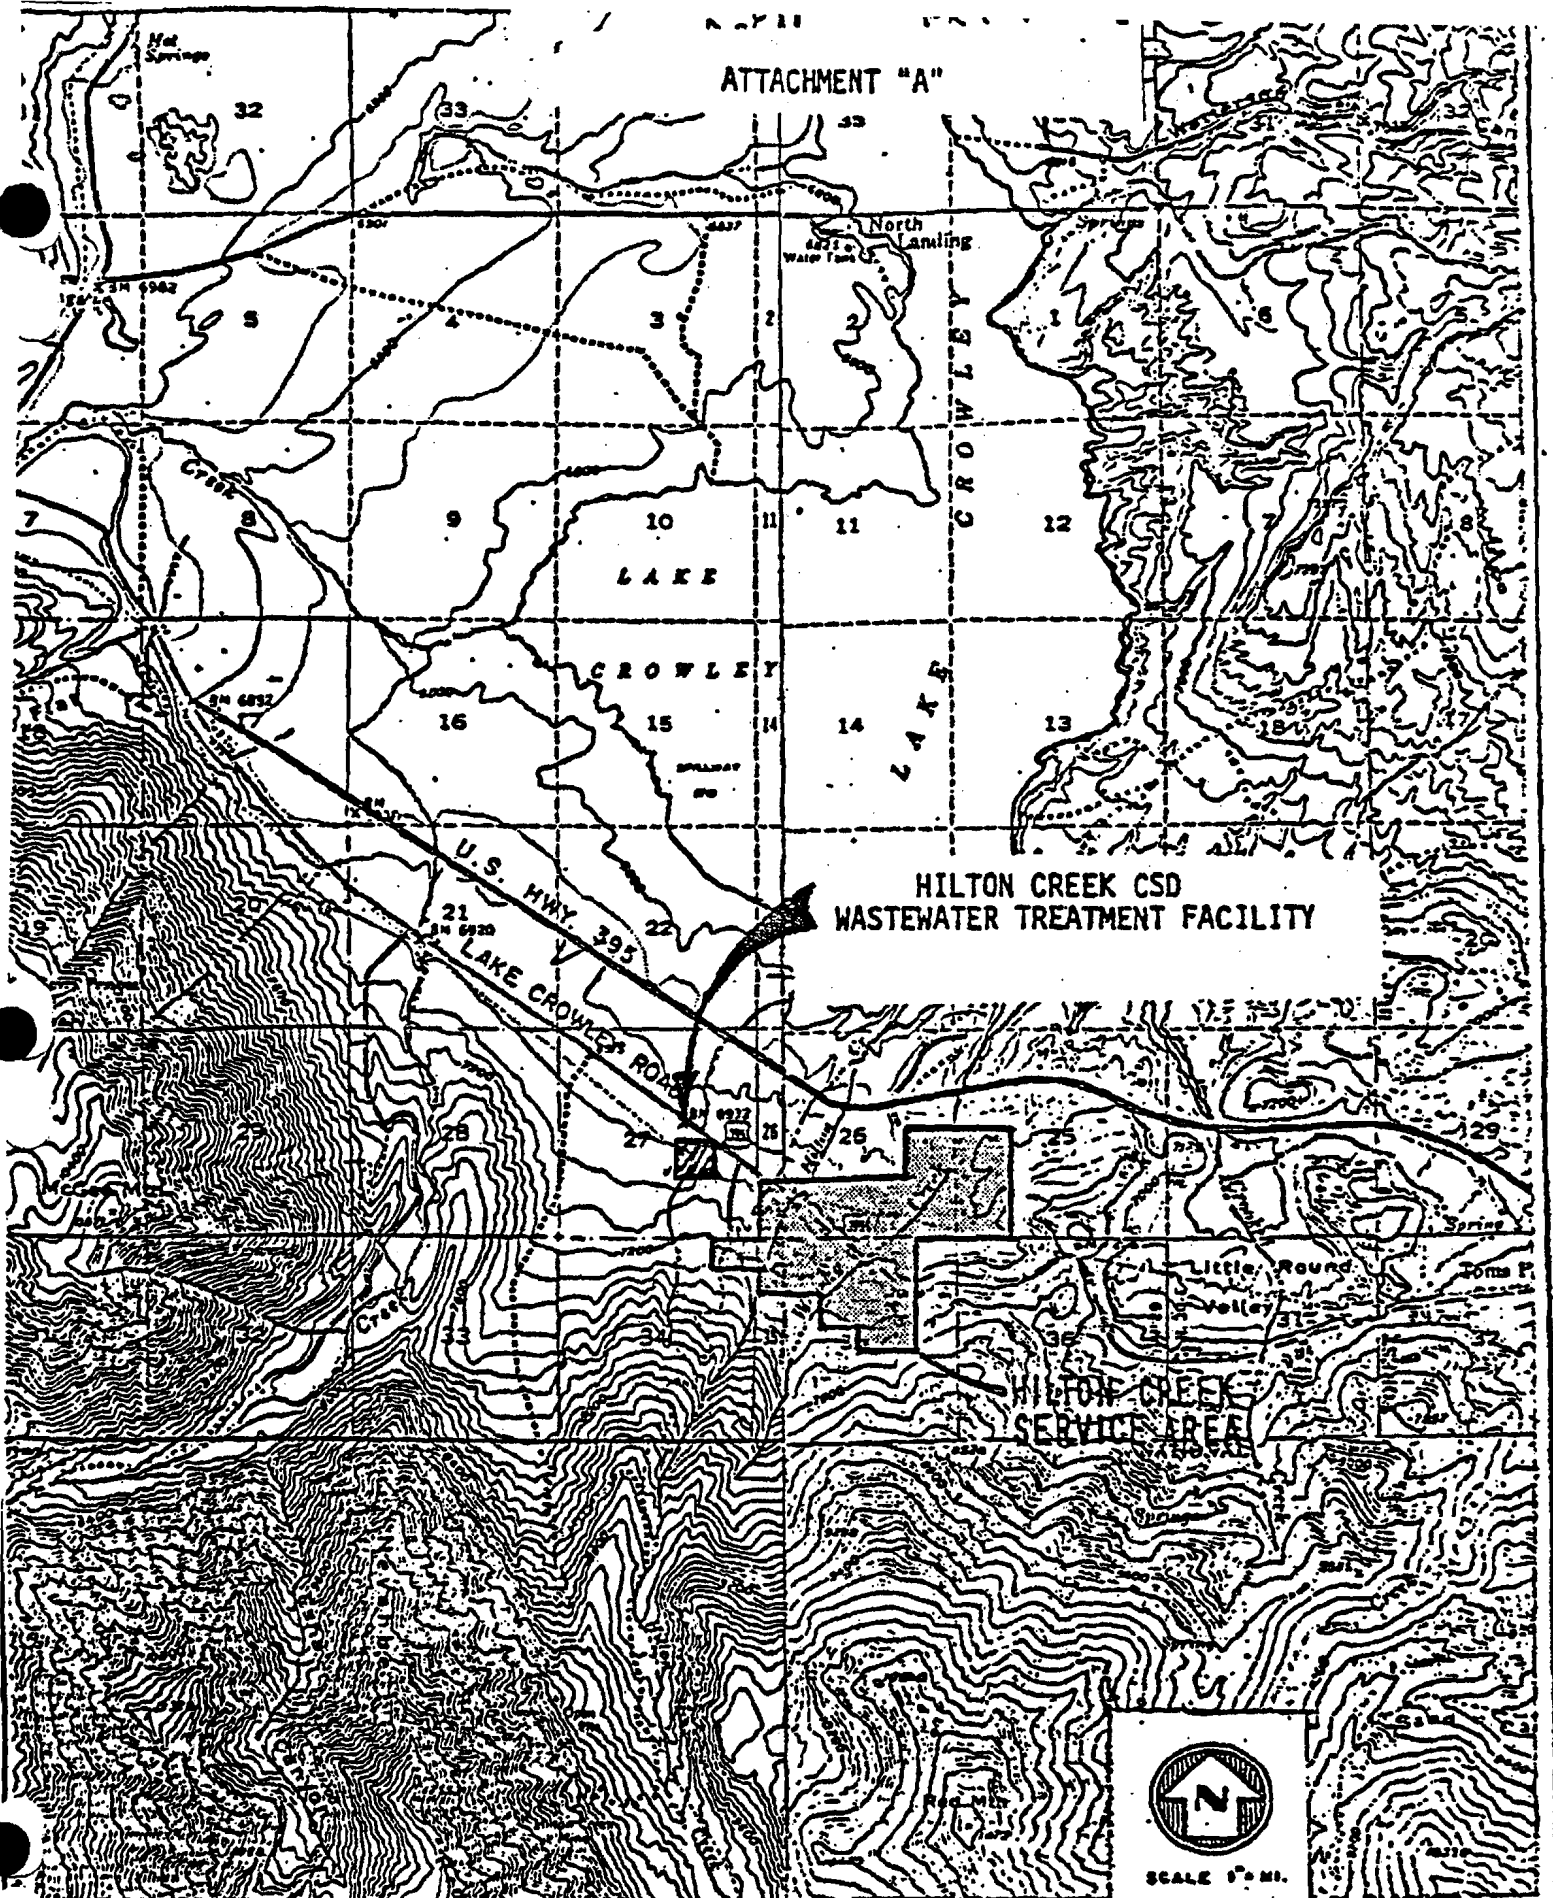

Case Diablo Quadrangle

Longitude 118° 45'

Latitude 37° 34'

HILTON CREEK COMMUNITY SERVICES DISTRICT.

VICINITY MAP.



SCALE 1" = 1 MI.

EXISTING FACILITIES


- ① AERATION TANK
- ② MECHANICAL BUILDING
- ③ SLUDGE BEDS
- ④ MAINTENANCE BUILDING
- ⑤ BARGE/BOAT STRUCTURE
- ⑥ BLM FIRESTATION

NEW FACILITIES

- ⑦ CLARIFIERS

SYMBOL KEY

- DISPOSAL AREA FOR EXCESS EXCAVATION MATERIAL, UNRESTRICTED. DO NOT DAMAGE OR PILE MTL. AGENTS FENCE.
- DISPOSAL AREA FOR EXCESS EXCAVATION MATERIAL, NO BOULDERS LARGER THAN 12" IN THIS AREA. GRADE THIS AREA TO ALLOW VEHICLE ACCESS UPON COMPLETION. MATCH (E. PERC. POND NO. 2) SLOPE.
- CONTRACTORS STAGING AREA.
- EXISTING PAVED AREAS.
- SOIL BORING.
- TEST PIT.

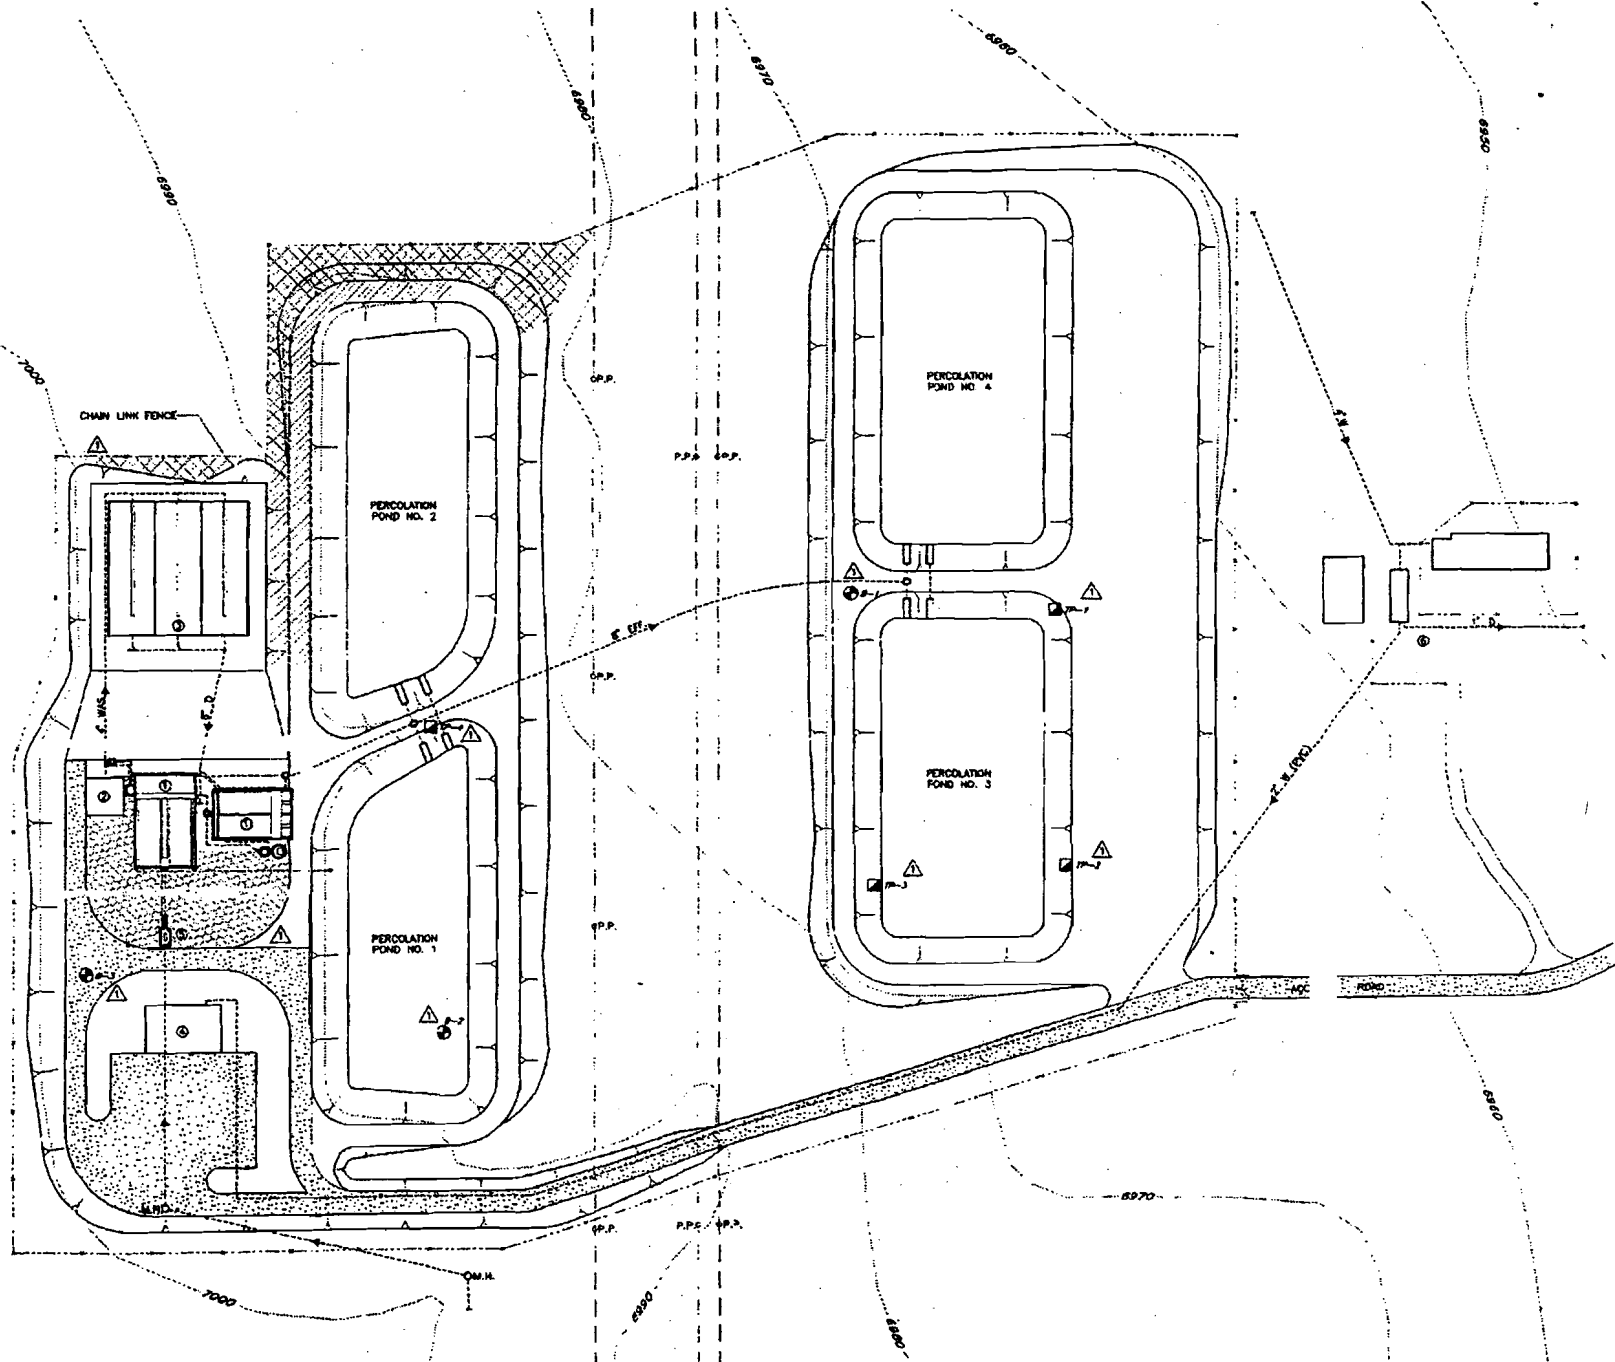

ATTACHMENT B

Base map prepared by
ENVIRONMENTAL SERVICES



**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION**

**MONITORING AND REPORTING PROGRAM NO. R6V-2004-0018
WDID NO. 6B140109001
FOR**

**HILTON CREEK COMMUNITY SERVICES DISTRICT, AND THE U.S. DEPARTMENT OF
THE INTERIOR, BUREAU OF LAND MANAGEMENT; HILTON CREEK
WASTEWATER TREATMENT PLANT**

Mono County

I. MONITORING

A. Flow Monitoring

1. The following shall be recorded for the flows of wastewater to the treatment facility:
 - a. Total volume in million gallons day (mgd),
 - b. Total volume in million gallons month, and
 - c. Average flowrate in mgd month.
 - d. Maximum instantaneous flow rate mgd of wastewater to the treatment facility for, each month.
2. The Discharger shall measure and record the freeboard (distance from the top of the lowest part of the berm to the wastewater surface in pond) in each Percolation Pond each month. If a Percolation Pond does not contain wastewater, indicate that it is empty.
3. The total volume, mgd, of wastewater flow to each disposal facility for each month.

B. Facility Effluent Monitoring

Grab samples of the effluent discharged to the percolation ponds shall be collected and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Biochemical Oxygen Demand (BOD)	mg/L	Monthly
Methylene Blue Active Substances	mg/L	Monthly
pH	pH units	Monthly
Carbonaceous BOD	mg/L	Monthly
Total Kjeldahl Nitrogen	mg/L as N	Quarterly
Total Filterable Residue	mg/L	Annually
Chloride	mg/L	Annually

C. Ground Water Monitoring

Grab samples from the uppermost ground water bearing zone shall be collected from the three monitoring wells at the facility and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Methylene Blue Active Substances	mg/L	Semi-annually
Total Settleable Solids	mg/L	Semi-annually
Chloride	mg/L	Semi-annually
Nitrate Nitrogen ¹	mg/L as N	Quarterly
Total Dissolved Solids	meq/L	Quarterly

- a. The elevation (mean sea level) of ground water in each well shall be measured and recorded each time a monitoring well is sampled (prior to purging, as specified below).
- b. Well Purging: ground water samples shall be collected only after at least three volumes of water in the well casing have been removed and measurements of temperature, pH and electrical conductivity of water in the well have stabilized.
- c. The velocity and direction of ground water flow beneath the facility site shall be determined and reported on a scaled map semi-annually.
- d. By **January 15, 2005**, the Discharger shall submit a Sampling and Analysis Plan describing sample collection for the ground water monitoring network to ensure ground water samples are representative of the aquifer beneath the site.

D. Sludge Monitoring

1. By **October 12, 2004**, the Discharger shall submit a Sludge Management Plan to the Regional Board office for review and consideration of approval. The Discharger shall submit subsequent annual reports summarizing disposal of sludge in accordance with the provisions in the Plan with the last quarterly report of the calendar year.
2. The Discharger shall report to the Regional Board quarterly and annually all information necessary to comply with the U.S. Environmental Protection Agency Sludge Management Regulations contained in Section 503 of the Federal Clean Water Act.
3. Annually, the Discharger must submit a tabular and descriptive report of all spills for the year along with any changes or improvements to the Spill Prevention and Response Plan.

1. Performed in accordance with EPA Test No. 352.2 or 353.3

II. REPORTING

A. General Provisions

The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program.

B. Submittal Periods

Beginning on the 15th day of the month following the adoption of this Order, a monitoring report including the preceding information shall be submitted to the Regional Board. Subsequent monitoring reports shall be submitted to the Regional Board by the 15th day of the month following each quarter.

Ordered by: _____



HAROLD J. SINGER
EXECUTIVE OFFICER

Dated: June 9, 2004

- Attachments: A. General Provisions for Monitoring and Reporting Program
B. See Attachment B of the WDRs for Monitoring Locations