

## Central Coast Regional Water Quality Control Board

September 28, 2023

**Sent Via Electronic Mail**

David Morisoli  
Little Bear Water Company, Inc.  
Little Bear Water Company Wastewater Treatment Plant  
51201 Pine Canyon Road  
King City, CA 93930  
Email: [dmorisoli@hotmail.com](mailto:dmorisoli@hotmail.com)

Dear David Morisoli,

**LITTLE BEAR WATER COMPANY, INC. WASTEWATER TREATMENT PLANT,  
ROYAL DRIVE, ROYAL ESTATES PARK, KING CITY, CA 93930, MONTEREY  
COUNTY:**

- **NOTICE OF APPLICABILITY FOR LITTLE BEAR WATER COMPANY, INC.'s  
ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE  
DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER  
TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-  
2023-0072**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. R3-86-26**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the electronic application (received on June 28, 2022, with revisions January 25, 2023), and available documents associated with the domestic wastewater treatment system at Little Bear Water Company Wastewater Treatment Plant (Little Bear WWTP) owned by Little Bear Water Company, Inc. (Little Bear). The wastewater system is currently regulated pursuant to Order No. R3-86-26. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. R3-86-06.

This letter serves as a notice of applicability for Little Bear's enrollment in the General Permit for the discharge of wastewater from Little Bear WWTP.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Little Bear must comply with the following:

1. **General Permit** – Little Bear must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

[https://www.waterboards.ca.gov/board\\_decisions/adopted\\_orders/water\\_quality/2014/wqo2014\\_0153\\_dwq.pdf](https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf)

2. **Monitoring and Reporting Program** – Little Bear must comply with the requirements of Monitoring and Reporting Program No. R3-2023-0072, enclosed with this letter (Attachment 3). Little Bear must start implementing the monitoring on **January 1, 2024**. Little Bear must comply with the previous monitoring and reporting program until January 1, 2024. Your first quarterly report is due on **May 1, 2024**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

[https://www.waterboards.ca.gov/centralcoast/water\\_issues/programs/wastewater\\_permitting/docs/transmittal\\_sheet.pdf](https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf)

Little Bear must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker<sup>1,2</sup> database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100030866 at:

[https://www.waterboards.ca.gov/ust/electronic\\_submittal/index.html](https://www.waterboards.ca.gov/ust/electronic_submittal/index.html)

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

---

<sup>1</sup> Information for first-time GeoTracker users is available at:

[https://www.waterboards.ca.gov/ust/electronic\\_submittal/docs/beginnerguide2.pdf](https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf)

<sup>2</sup> Additional information available at: <http://geotracker.waterboards.ca.gov/>

3. **Fees** – Little Bear paid an annual fee on January 3, 2023 for coverage in the existing individual permit, Order No. R3-86-026. This payment covers permit fees for the 2022-2023 fiscal year.

Little Bear must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$26,785. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B.

A copy of the current state fee schedule is available at the following link:

[https://www.waterboards.ca.gov/resources/fees/water\\_quality/#wdr](https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr)

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on December 14-15, 2023. Details about that meeting are available on our website at:

[http://www.waterboards.ca.gov/centralcoast/board\\_info/agendas/](http://www.waterboards.ca.gov/centralcoast/board_info/agendas/)

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Little Bear is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Little Bear to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Little Bear must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Certified Operator** – Little Bear is required to comply with the operator certification requirements<sup>3</sup> administered by the State Water Board's Office of

---

<sup>3</sup> Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

[https://www.waterboards.ca.gov/water\\_issues/programs/operator\\_certification/docs/ocr\\_clean.pdf](https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf)

Operator Certification, which currently requires a Class II certified operator onsite to maintain and operate the treatment system. Little Bear must:

- a. Keep a current Wastewater Treatment Plant Classification Form on file with the Office of Operator Certification and update the form when modifications to the Wastewater System treatment processes occur.
- b. Provide the Office of Operator Certification with a Chief Plant Operator Acknowledgement Form and update this information within 30 days of a change of Chief Plant Operator.
- c. If a contractor operator is used, the contract operator must register with the Office of Operator Certification and obtain a contract operator certificate for the Wastewater System.

Forms are available at the following link:

[https://www.waterboards.ca.gov/water\\_issues/programs/operator\\_certification/form.html](https://www.waterboards.ca.gov/water_issues/programs/operator_certification/form.html)

- 9. Termination of Permit** – The existing individual permit, Order No. R3-86-026 is terminated, except for enforcement purposes. Little Bear is responsible for compliance with Order No. R3-86-026 prior to the date of this letter.

If you have any questions, please contact **Kristina Olmos at (805) 549-3293 or by email at [kristina.olmos@Waterboards.ca.gov](mailto:kristina.olmos@Waterboards.ca.gov)**, or Jennifer Epp at [Jennifer.Epp@waterboards.ca.gov](mailto:Jennifer.Epp@waterboards.ca.gov).

Sincerely,

*for* Matthew T. Keeling  
Executive Officer

Attachments:

- Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations
- Attachment 2: Figures
- Attachment 3: Monitoring and Reporting Program No. R3-2023-0072

cc:

Miles Farmer, Cypress Water Services, [miles@cypresswaterservices.com](mailto:miles@cypresswaterservices.com)  
Nicole Fowler, Monterey County, [nfowler@co.monterey.ca.us](mailto:nfowler@co.monterey.ca.us)

Roger VanHorn, Monterey County, [vanhornrw@co.monterey.ca.us](mailto:vanhornrw@co.monterey.ca.us)  
Kristina Olmos, [Kristina.Olmos@Waterboards.ca.gov](mailto:Kristina.Olmos@Waterboards.ca.gov)  
Kathy Truong, [Kathy.Truong@Waterboards.ca.gov](mailto:Kathy.Truong@Waterboards.ca.gov)  
Jesse Woodard, [Jesse.Woodard@waterboards.ca.gov](mailto:Jesse.Woodard@waterboards.ca.gov)  
Jennifer Epp, [Jennifer.Epp@Waterboards.ca.gov](mailto:Jennifer.Epp@Waterboards.ca.gov)  
WDR Program, [RB3-WDR@Waterboards.ca.gov](mailto:RB3-WDR@Waterboards.ca.gov) GeoTracker

ECM/CIWQS = CW-237149

GeoTracker No. = GT- WDR100030866

Rev 10/7/22

Subject Name = Little Bear Wastewater Permit

\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\monterey co\little  
bear\1\_permit\noa\_mrp\_littlebear\_0153\_2023\_final.docx

# ATTACHMENT 1

## WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC REQUIREMENTS AND LIMITATIONS

### 1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Little Bear Water Company, Inc. (Little Bear) to the Central Coast Water Board is shown in Table 1.

**Table 1. Owner and Wastewater Facility Information**

|                                                                      |                                                                                      |
|----------------------------------------------------------------------|--------------------------------------------------------------------------------------|
| <b>Facility Name</b>                                                 | Little Bear Wastewater Treatment Plant (WWTP)                                        |
| <b>Facility Address</b>                                              | Royal Drive, Royal Estates Park<br>King City, CA 93930                               |
| <b>Parcel Numbers</b>                                                | 221-122-038-000, 221-122-025-000                                                     |
| <b>Latitude/Longitude</b>                                            | 36.185822/-121.143302                                                                |
| <b>Owner and Manager of Facility</b>                                 | Little Bear Water Company, Inc.                                                      |
| <b>Legally Responsible Official of Owner</b>                         | David Morisoli                                                                       |
| <b>Owner Mailing Address</b>                                         | 51201 Pine Canyon Road<br>King City, CA 93930                                        |
| <b>Billing Address</b>                                               | 51201 Pine Canyon Road<br>King City, CA 93930                                        |
| <b>Permitted Design Flow, Average Monthly (gallons per day, gpd)</b> | 90,000                                                                               |
| <b>Baseline Flow (average annual flow) gpd</b>                       | 78,000                                                                               |
| <b>Operators</b>                                                     | David Morisoli (chief plant operator) and Cypress Water Services (contract operator) |
| <b>Waste type and Service Area</b>                                   | Domestic wastewater from Pine Canyon community                                       |
| <b>Threat to Water Quality</b>                                       | 2                                                                                    |
| <b>Complexity</b>                                                    | B                                                                                    |
| <b>For Internal Use</b>                                              |                                                                                      |
| <b>Fee Code</b>                                                      | 58                                                                                   |
| <b>Primary Place Type</b>                                            | Wastewater Treatment Facility                                                        |
| <b>Facility Type</b>                                                 | Municipal/Domestic                                                                   |
| <b>Facility Waste Type</b>                                           | Domestic Wastewater                                                                  |
| <b>Regulatory measure Type</b>                                       | Enrollee - WDR                                                                       |
| <b>Reclamation Included</b>                                          | No                                                                                   |

|                                          |    |
|------------------------------------------|----|
| <b>EPA Approved Pretreatment Program</b> | No |
|------------------------------------------|----|

Pine Canyon Creek is the nearest surface water body approximately 30 feet from the Little Bear WWTP. The Salinas River is approximately one mile from the Little Bear WWTP.

## 2. WASTEWATER SYSTEM OPERATION SUMMARY

Little Bear WWTP is a Class II aerated pond system. The treatment and disposal system is composed of a primary treatment pond (Pond 1), secondary treatment pond (Pond 2), polishing pond (Pond 3), effluent pond (Sprayfield Pond) and spray fields. The wastewater gravity flows from the Pine Canyon community to the WWTP and through the pond system. After the polishing pond (Pond 3), wastewater is pumped five miles away to the effluent pond (Sprayfield Pond) where the effluent is then disposed of on an 11-acre spray field. The WWTP is adjacent to Pine Canyon Creek and multiple sewer pipelines and effluent pipelines run across the creek.

A summary of the system is included in Table 2 below. Capacity information was obtained from the treatment plant classification form, if there is more current information, Little Bear must submit the information to Central Coast Water Board. A facility site map and dispersal system layout are shown in Attachment 2.

**Table 2. Permitted Pond Treatment, Disposal Technologies, and Capacity**

|                                        |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |
|----------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Permitted Design Flows</b>          | Design Influent Maximum Daily Flow: 124,000 gpd<br>Influent Average Monthly Flow: 90,000 gpd                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| <b>Headworks/Preliminary Treatment</b> | Influent flows via gravity to Pond 1 where it is metered prior to entering the pond. There is no preliminary treatment (no screening).                                                                                                                                                                                                                                                                                                                                                                                                                                                              |
| <b>Primary and Secondary Treatment</b> | Primary treatment occurs in Pond 1, which is described in the treatment plant classification form as being 1,115,000 gallons, 12 feet deep, and is mixed and aerated. Effluent from Pond 1 flows via gravity to Pond 2. Secondary treatment occurs in Pond 2, which is described in the treatment plant classification form as being 1,440,000 gallons, 17 feet deep, and is mixed and aerated. Flow from Pond 2 passes to Pond 3 via gravity. Pond 3 provides some additional treatment in the form of polishing.<br><br>The ponds are not synthetically lined, and their permeability is unknown. |
| <b>Effluent Storage</b>                | Effluent from Pond 3 is pumped via force main to an effluent storage pond (Sprayfield Pond) with an estimated capacity of 1,300,000 gallons five miles from the treatment facility.                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>Disposal</b>                        | Effluent disposal consists of two spray fields areas with a combined surface area of 11 acres.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |

|                                                 |                                                                                                                                                                                                                                           |
|-------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Biosolids/Sludge Production and Handling</b> | <p>As stated in the General Permit application, solids are stored within the ponds until removed by special pumping events.</p> <p>As of the date of this notice of applicability, Little Bear has never reported any sludge removal.</p> |
|-------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

### 3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Little Bear must operate the facility in accordance with the General Permit<sup>4</sup> and this notice of applicability.<sup>5</sup> Little Bear must operate the WWTP to comply with the effluent limits below.

#### A. Effluent limits

Little Bear must comply with the site-specific limits listed in Table 3.

**Table 3. Wastewater Limits**

| Constituent                                            | Unit                       | Limit                                                            | Point of Compliance <sup>1</sup>                                            |
|--------------------------------------------------------|----------------------------|------------------------------------------------------------------|-----------------------------------------------------------------------------|
| Flow                                                   | gpd                        | 90,000 (monthly average) <sup>4</sup><br>124,000 (maximum daily) | Influent (IS-1)                                                             |
| Five-Day Biochemical Oxygen Demand (BOD <sub>5</sub> ) | mg/L                       | 90 (monthly average)                                             | Effluent Samples (ES-1, ES-2, ES-3, ES-4)                                   |
| Total Nitrogen (as N) <sup>2</sup>                     | % Influent versus Effluent | 50% Removal                                                      | Influent <sup>3</sup> compared to Effluent Samples (ES-1, ES-2, ES-3, ES-4) |

<sup>1</sup> Refer to monitoring and reporting program for sampling locations.

<sup>2</sup> The value represents the minimum percent reduction compared to the untreated wastewater value.

<sup>3</sup> Influent is currently sampled in Pond 1, where treatment begins. Little Bear may propose an alternative sampling location to demonstrate 50% nitrogen removal for Central Coast Water Board review and approval.

<sup>4</sup> Average flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month.

<sup>4</sup> General Permit sections B.2, B.3, B.4, and B.6 are not applicable for this facility.

<sup>5</sup> General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.



#### 4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Little Bear must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).<sup>6</sup> These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) Specific objectives for the groundwater basin where the discharge occurs. The treatment facility discharges into the Salinas Upper Valley Basin, and those Basin Plan's groundwater objectives are included in Table 4.

**Table 4. Basin Plan, Median Groundwater Objectives (mg/L)**

| Constituent                  | Median Groundwater Objective for Salinas Upper Valley Basin |
|------------------------------|-------------------------------------------------------------|
| Total Dissolved Solids (TDS) | 600                                                         |
| Chloride                     | 150                                                         |
| Sulfate                      | 150                                                         |
| Boron                        | 0.5                                                         |
| Sodium                       | 70                                                          |
| Nitrate                      | 5                                                           |

mg/L = milligrams per liter

The WWTP currently has five monitoring wells. While groundwater flow direction varies, MW-3 is generally upgradient from the disposal area; MW-1, MW-2, and MW-4 are within or downgradient from the disposal area; and MW-5 is downgradient from the unlined treatment ponds (Ponds 1, 2, and 3). The treatment plant overlies the Salinas Upper Valley Basin. The sprayfield is about one mile from the footprint of the Salinas Upper Valley Basin, and based on historical groundwater flow direction and the flow of the steam, shallow groundwater likely flows from the sprayfield into the Salinas Upper Valley Basin.

#### 5. SETBACK REQUIREMENTS

General Permit Section B.1.I Table 3 includes setback requirements. Little Bear's treatment ponds (Ponds 1, 2, and 3) are within the 150-foot setback requirement to an ephemeral stream drainage (Pine Canyon Creek). The General Permit states,

<sup>6</sup> Current edition, June 2019 is available at:  
[https://www.waterboards.ca.gov/centralcoast/publications\\_forms/publications/basin\\_plan/](https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/)

“Noncomplying facilities may be permitted, if nuisance conditions do not result from the noncompliance. Expansion of a noncomplying wastewater system shall trigger further evaluation of the setbacks.” Therefore, Little Bear must not expand (or add additional connections) without notifying the Central Coast Water Board and receiving Central Coast Water Board approval considering an evaluation of the setbacks.



## 6. POND LINER PERMEABILITY

In accordance with General Permit Section IV.B.1 all treatment, storage, and evaporation ponds must be lined<sup>7</sup> to protect groundwater and associated beneficial uses. All three treatment ponds (Pond 1, 2, and 3) are considered treatment **and disposal** ponds, and Little Bear must comply with effluent limits at the treatment and disposal ponds (ES-3 and ES-4 locations in Pond 2 and the Sprayfield Pond). To change the point of compliance, the ponds would need to be evaluated by a California licensed Professional Engineer or Professional Geologist for permeability and a report submitted to the Central Coast Water Board, for approval. Until such time, the Central Coast Water Board will assume the ponds may percolate wastewater to groundwater and effluent samples must be collected and evaluated at the treatment ponds. See the attached monitoring and reporting program for work plan and report requirements.

---


<sup>7</sup> Liner must have a permeability of less than  $1 \times 10^{-6}$  centimeters per second and may be constructed with synthetic materials, two feet of low permeable soils, or another engineered alternative. Discharger must provide documentation for Central Coast Water Board approval to confirm that a treatment, storage, or evaporation pond is sufficiently impermeable to prevent discharges of untreated or partially treated wastewater.

## ATTACHMENT 2 FIGURES

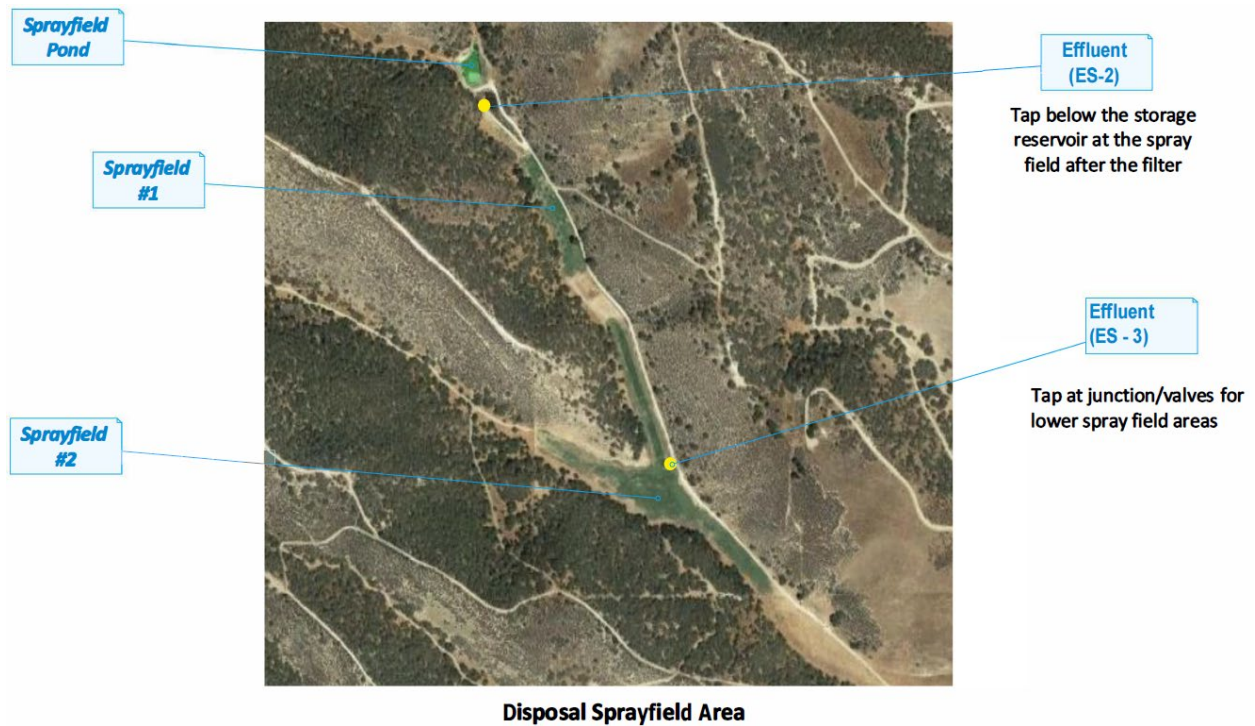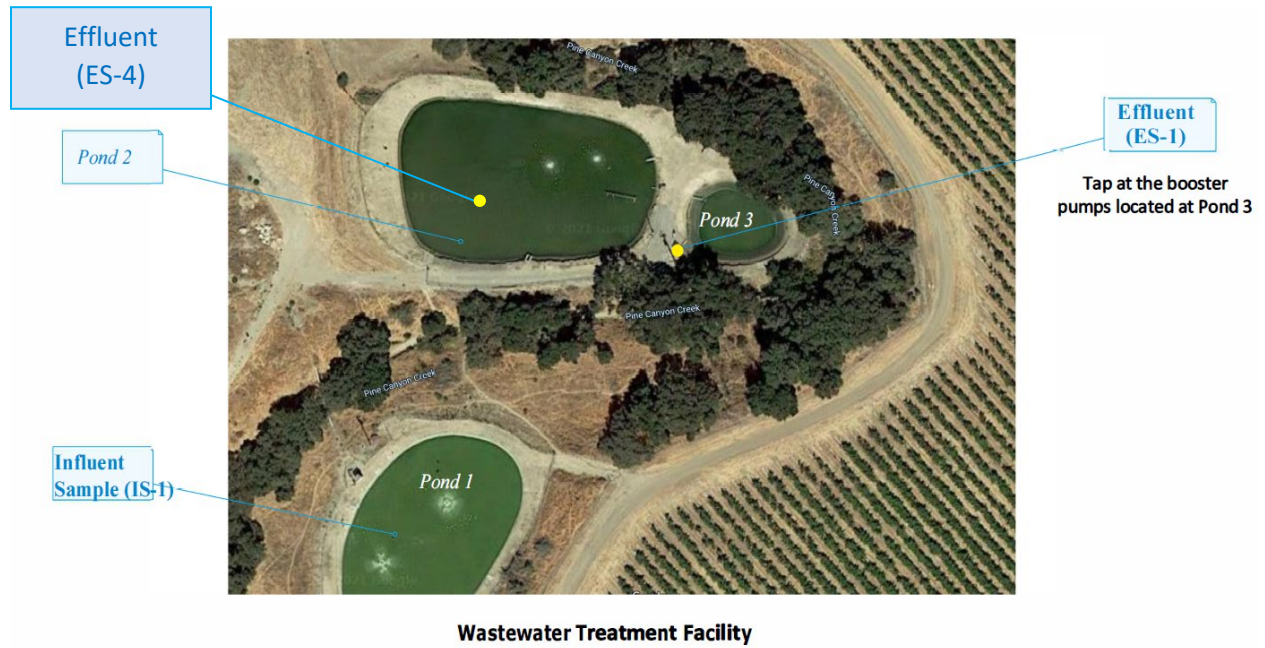


**Figure 1. Map of the Wastewater Treatment Facility and Disposal Sprayfield**



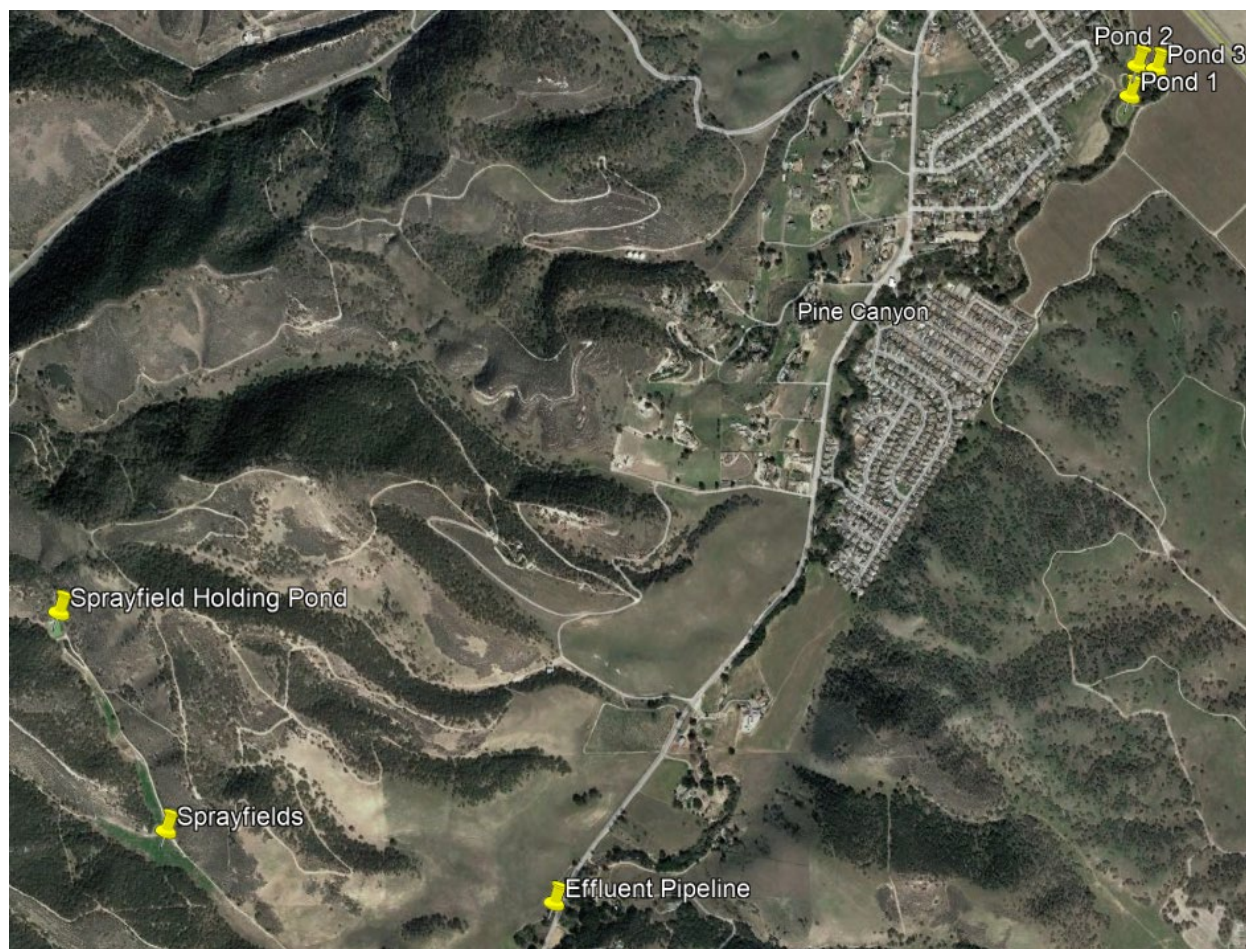


**Figure 2. Site Map**

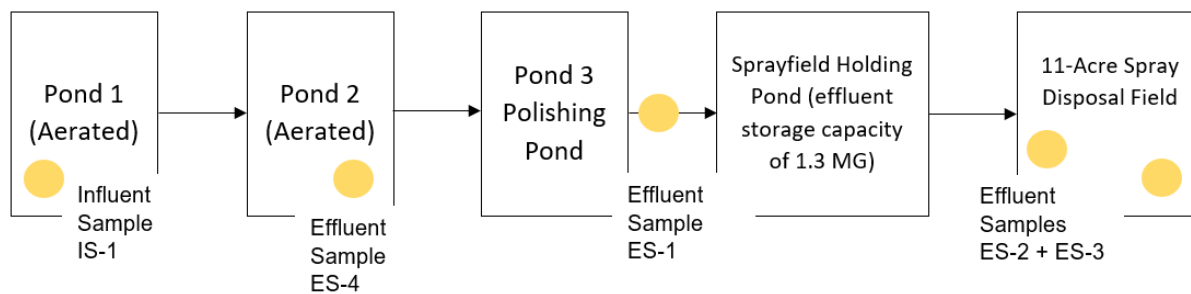

**Figure 3. Process Flow Diagram**



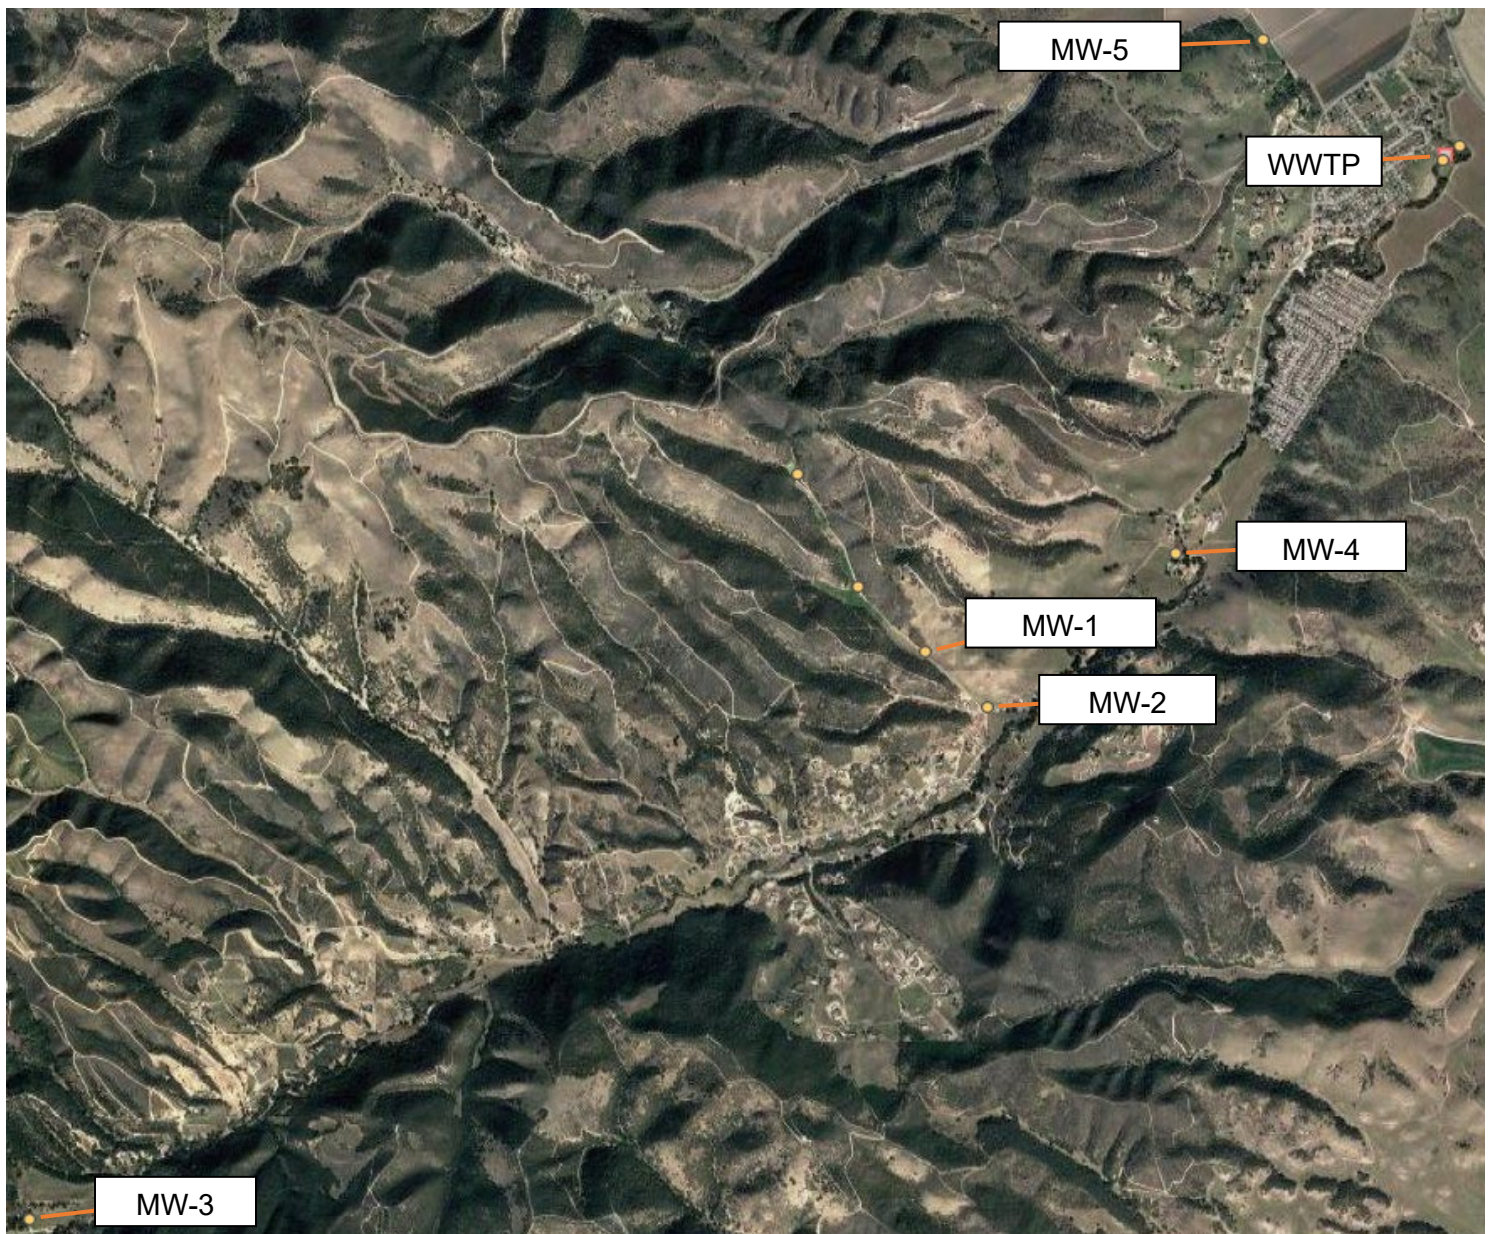

**Figure 4. Monitoring Well Locations**

**CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD**

**MONITORING AND REPORTING PROGRAM NO. R3-2023-0072**

**SEPTEMBER 28, 2023**

**FOR**

**LITTLE BEAR WATER COMPANY WASTEWATER TREATMENT PLANT  
MONTEREY COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for Little Bear Water Company, Inc.'s (Little Bear's) Wastewater Treatment Plant (WWTP) located at Royal Drive, in King City, California.

Little Bear owns and operates the wastewater system that is subject to the notice of applicability dated September 28, 2023 for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

**1. SAMPLING AND ANALYSIS**

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

**Table 1. Sampling and Monitoring Schedule**

| <b>Monitoring Period</b> | <b>Sample Collection Months</b>   |
|--------------------------|-----------------------------------|
| Annually                 | October                           |
| Semiannually             | April and October                 |
| Quarterly                | January, April, July, and October |
| Monthly                  | Each month of the year            |

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- A. The user is trained in proper use and maintenance of the instruments;

- B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- D. Field calibration reports are maintained and available for at least three years.

## 2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Little Bear may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Little Bear must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Little Bear must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

**Table 2. Water Supply Monitoring**

| Parameter              | Units | Type of Sample | Sampling Frequency |
|------------------------|-------|----------------|--------------------|
| Nitrate (as N)         | mg/L  | Grab           | Annually           |
| Total Dissolved Solids | mg/L  | Grab           | Annually           |
| Chloride               | mg/L  | Grab           | Annually           |
| Sodium                 | mg/L  | Grab           | Annually           |
| Sulfate                | mg/L  | Grab           | Annually           |
| Boron                  | mg/L  | Grab           | Annually           |
| Carbonate              | mg/L  | Grab           | Annually           |
| Bicarbonate            | mg/L  | Grab           | Annually           |
| Calcium                | mg/L  | Grab           | Annually           |
| Potassium              | mg/L  | Grab           | Annually           |
| Magnesium              | mg/L  | Grab           | Annually           |

mg/L denotes milligrams per liter


## 3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that must be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

**Table 3. Monitoring Locations**

| <b>Sample Title</b> | <b>GeoTracker Field Point Code</b> | <b>Sample Description</b>                                                                  |
|---------------------|------------------------------------|--------------------------------------------------------------------------------------------|
| Influent – 1        | IS-1                               | Grab sample from Pond 1 <sup>1</sup>                                                       |
| Effluent – 1        | ES-1                               | Tap at the booster pumps located at Pond 3 polishing pond                                  |
| Effluent – 2        | ES-2                               | Tap below Sprayfield Pond after the filter                                                 |
| Effluent – 3        | ES-3                               | Tap at junctions/valves for lower spray field areas                                        |
| Effluent – 4        | ES-4 <sup>2</sup>                  | Grab sample from Pond 2                                                                    |
| Monitoring Well - 1 | MW-1                               | Monitoring well at base of sprayfield parcel near entrance gate, formerly called Site A    |
| Monitoring Well - 2 | MW-2                               | Monitoring well between sprayfield parcel and Pine Canyon Creek Rd, formerly called Site B |
| Monitoring Well - 3 | MW-3                               | Residential well at 54120 Pine Canyon Road, formerly called Site C                         |
| Monitoring Well - 4 | MW-4                               | Residential well at 52045 Pine Canyon Road, formerly called Site D                         |
| Monitoring Well - 5 | MW-5                               | Monitoring well off Pettit Road, formerly called Site E                                    |


1. This existing influent sample may not be representative of influent because treatment begins to occur in Pond 1. To demonstrate the permit requirement of total nitrogen 50% reduction between influent and effluent, Little Bear may propose an alternative influent sampling point with Central Coast Water Board approval.
2. ES-4 added during the 2023 General Permit enrollment and monitoring and reporting program revisions.

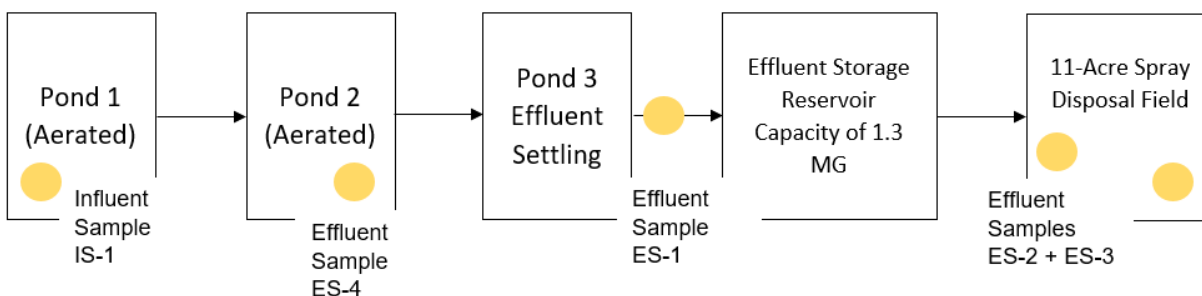





**Figure 1. Process Flow Diagram with Sampling Locations**

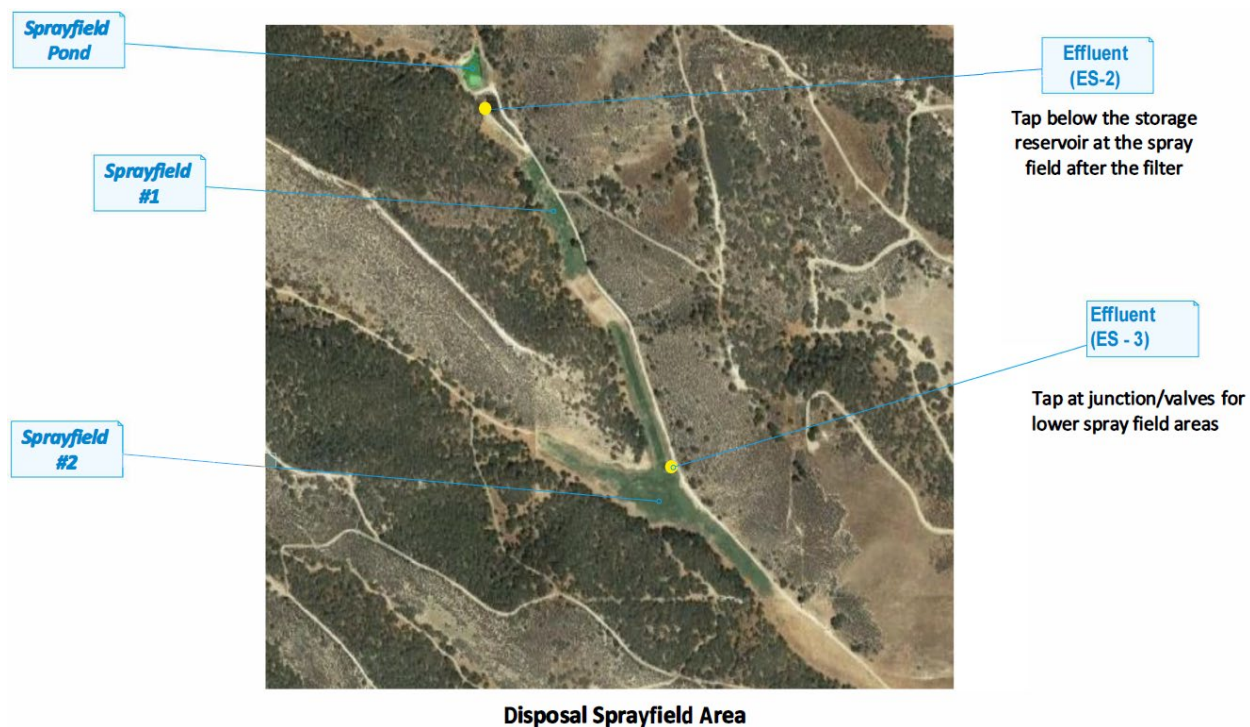

**Figure 2. Little Bear Facility Maps with Sampling Locations**

#### 4. INFLUENT AND EFFLUENT TREATMENT UNIT MONITORING

##### A. Flow Monitoring

Little Bear must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored in the influent line as wastewater enters Pond 1.

**Table 4. Flow Monitoring**

| Parameter          | Units           | Sample Type | Sampling Frequency |
|--------------------|-----------------|-------------|--------------------|
| Daily Flow         | Gallons per day | Metered     | Daily              |
| Maximum Daily Flow | Gallons per day | Metered     | Monthly            |
| Mean Daily Flow    | Gallons per day | Calculated  | Monthly            |

##### B. Influent and Effluent Constituent Monitoring

Representative samples of Little Bear WWTP's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

**Table 5. Influent and Effluent Constituent Monitoring**

| Parameter/<br>Constituent             | Units       | INFLUENT<br>(IS-1)<br>Pond 1 | EFFLUENT<br>(ES-1)<br>After Pond 3 | EFFLUENT<br>(ES-2 or ES-3) <sup>1</sup><br>Sprayfield Area | EFFLUENT<br>(ES-4)<br>Pond 2 |
|---------------------------------------|-------------|------------------------------|------------------------------------|------------------------------------------------------------|------------------------------|
|                                       |             | Sampling<br>Frequency        | Sampling<br>Frequency              | Sampling<br>Frequency                                      | Sampling<br>Frequency        |
| Settleable Solids                     | mL/L        | Weekly                       | Weekly                             | Not Required                                               | Not Required                 |
| pH                                    | pH<br>units | Quarterly                    | Quarterly                          | Quarterly                                                  | Quarterly                    |
| Biochemical<br>Oxygen Demand,         | mg/L        | Quarterly                    | Quarterly                          | Quarterly                                                  | Quarterly                    |
| Total Suspended<br>Solids (TSS)       | mg/L        | Quarterly                    | Quarterly                          | Not Required                                               | Not Required                 |
| Total Nitrogen (as<br>N) <sup>2</sup> | mg/L        | Quarterly                    | Quarterly                          | Quarterly                                                  | Quarterly                    |

| <b>Parameter/<br/>Constituent</b>        | <b>Units</b> | <b>INFLUENT<br/>(IS-1)<br/>Pond 1</b> | <b>EFFLUENT<br/>(ES-1)<br/>After Pond 3</b> | <b>EFFLUENT<br/>(ES-2 or ES-3)<sup>1</sup><br/>Sprayfield Area</b> | <b>EFFLUENT<br/>(ES-4)<br/>Pond 2</b> |
|------------------------------------------|--------------|---------------------------------------|---------------------------------------------|--------------------------------------------------------------------|---------------------------------------|
|                                          |              | <b>Sampling<br/>Frequency</b>         | <b>Sampling<br/>Frequency</b>               | <b>Sampling<br/>Frequency</b>                                      | <b>Sampling<br/>Frequency</b>         |
| Nitrate + Nitrite<br>(as N) <sup>3</sup> | mg/L         | Quarterly                             | Quarterly                                   | Quarterly                                                          | Quarterly                             |
| Total Kjeldahl<br>Nitrogen (as N)        | mg/L         | Quarterly                             | Quarterly                                   | Quarterly                                                          | Quarterly                             |
| Total Dissolved<br>Solids                | mg/L         | Not Required                          | Semiannually                                | Not Required                                                       | Not Required                          |
| Chloride                                 | mg/L         | Not Required                          | Semiannually                                | Not Required                                                       | Not Required                          |
| Sodium                                   | mg/L         | Not Required                          | Semiannually                                | Not Required                                                       | Not Required                          |
| Sulfate                                  | mg/L         | Not Required                          | Semiannually                                | Not Required                                                       | Not Required                          |
| Boron                                    | mg/L         | Not Required                          | Semiannually                                | Not Required                                                       | Not Required                          |
| Carbonate                                | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Bicarbonate                              | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Calcium                                  | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Magnesium                                | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Potassium                                | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Metals <sup>4</sup>                      | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |
| Chromium VI                              | mg/L         | Not Required                          | Annually                                    | Not Required                                                       | Not Required                          |

mg/l = milligram per liter

[1] Little Bear must sample one of the sprayfield locations where a majority of the flow is discharged to, per quarter. All reports must specify if the sample was taken at ES-2 or ES-3.

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

[3] Nitrate and nitrite sample may be combined.

[4] California Code of Regulations (CAM 17) Metals (dissolved) including: Antimony (Sb), Arsenic (As), Barium (Ba), Beryllium (Be), Cadmium (Cd), Chromium (Cr), Cobalt (Co), Copper (Cu), Lead (Pb), Mercury (Hg), Molybdenum (Mo), Nickel (Ni), Selenium (Se), Silver (Ag), Thallium (Tl), Vanadium (V) and Zinc (Zn).

## 5. POND SYSTEM MONITORING

All wastewater treatment and storage ponds (Pond 1, Pond 2, Pond 3, and the Sprayfield Pond)) must be monitored as specified in Table 6. Grab samples must be collected at 1 foot below surface water depth. If additional pond sampling is required by Monterey County Health Department, Little Bear must submit that data with their annual reports.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

**Table 6. Pond Monitoring**

| Parameter/<br>Constituent              | Units                  | Sample Type             | Sampling/Monitoring<br>Frequency           |
|----------------------------------------|------------------------|-------------------------|--------------------------------------------|
| Freeboard                              | 0.1 feet               | Measured                | Weekly                                     |
| pH                                     | pH Units               | Grab <sup>[3]</sup>     | Weekly                                     |
| Dissolved Oxygen                       | mg/L                   | Grab <sup>[3]</sup>     | Monthly                                    |
| Sludge Depth                           | 0.1 feet               | Measured                | Annually                                   |
| Odors                                  | Not<br>Applicable      | Observation             | Monthly                                    |
| Color                                  | Not<br>Applicable      | Observation             | Monthly                                    |
| Vegetation in and<br>surrounding ponds | Not<br>Applicable      | Observation             | Monthly                                    |
| Berm condition                         | Not<br>Applicable      | Observation             | Monthly                                    |
| Precipitation                          | inches/day<br>and date | Measured <sup>[1]</sup> | Each precipitation<br>event <sup>[2]</sup> |

[1] Little Bear may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

[2] A precipitation event is one producing precipitation of ½ inch or more.

[3] Grab samples must be collected at 1 foot below surface water depth.

## 6. DISPOSAL AREA INSPECTIONS

Little Bear must inspect all items in Table 7 at least weekly and after rain events. All pump controllers and automatic distribution valves must be inspected for proper operation as recommended by the manufacturer. Shallow-rooted plants are generally

desirable, deep-rooted plants such as trees must be removed as necessary. Evidence of animals burrowing must be immediately investigated, and burrowing animal populations controlled as necessary. Disposal areas must be inspected to ensure they are allowing wastewater to infiltrate as designed, there is no surfacing, and soils are not saturated.

**Table 7. Disposal Area Monitoring**

| <b>Parameter</b>                         | <b>Inspection Frequency</b> | <b>Reporting Frequency</b> |
|------------------------------------------|-----------------------------|----------------------------|
| Pump controllers, automatic valves, etc. | Weekly                      | Quarterly                  |
| Nuisance Odor Condition                  | Weekly                      | Quarterly                  |
| Saturated Soil Condition                 | Weekly                      | Quarterly                  |
| Plant Growth                             | Weekly                      | Quarterly                  |
| Vectors or Animals Burrowing             | Weekly                      | Quarterly                  |
| Sprayfield Condition                     | Weekly                      | Quarterly                  |

A log of these inspections must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded. Little Bear must submit a summary of violations found during the inspections with each subsequent monitoring report, or a note that there were no violations.

## **7. SOLIDS DISPOSAL MONITORING**

Little Bear must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

Sludge removal must be in accordance with an Operations and Maintenance Plan. If solids are not removed during the year, Little Bear must explain the absence of this monitoring in the annual report.

## **8. COLLECTION SYSTEM MAINTENANCE**

Little Bear must submit records of any maintenance performed on the sewer collection system within the past year.

## **9. REPORTING REQUIREMENTS**

The quarterly and annual monitoring reports are due as described in Table 8.



**Table 8. Quarterly and Annual Monitoring Reporting**

| <b>Report</b>                                 | <b>Monitoring Period</b> | <b>Report Due Date</b> |
|-----------------------------------------------|--------------------------|------------------------|
| First Quarter Monitoring Report               | January 1 to March 31    | May 1                  |
| Second Quarter Monitoring Report              | April 1 to June 30       | August 1               |
| Third Quarter Monitoring Report               | July 1 to September 30   | November 1             |
| Fourth Quarter Monitoring Report              | October 1 to December 31 | February 1             |
| Annual Report                                 | January 1 to December 31 | March 1                |
| State Water Board Volumetric Annual Reporting | January 1 to December 31 | April 30               |

**A. Quarterly Reporting** – At a minimum, the quarterly reports must include:

1. Results of all required monitoring in tabular format.
2. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
3. A comparison of monitoring data to the discharge specifications and applicable effluent limitations. Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.
4. Copies of laboratory analytical report(s) and chain of custody form(s).
5. Copies of groundwater monitoring well field sheets with purge methods and logs.

**B. Annual Reporting** – At a minimum, the annual reports must include:

1. **Facility Information and Description:** A description of Little Bear's facility, treatment process, and disposal process with reference to figures.

2. **Data Tables and Graphs:** Tabular and graphical summaries of all monitoring data (water supply, influent, effluent, etc.) collected during the reporting year. Compare influent and effluent concentrations over time for the main constituents, along with effluent limitations and/or design criteria, as appropriate.
3. **Flow Evaluation (wastewater treatment system capacity):** A summary, in tabular and graphical format, of the maximum (peak) and mean daily flows for each month and note the maximum permitted flow, in gallons per day.
4. **Pond Monitoring:** A summary of required pond monitoring data/information collected during the reporting year (dissolved oxygen and pH).
5. **Solids Disposal/Management:** A tabular summary of required solids disposal monitoring data/information collected during the reporting year.
6. **Compliance and Performance Discussion:**
  - a) A discussion of compliance and any corrective action(s) taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the General Permit.
  - b) An evaluation of the treatment plant performance, including percent removal of the main constituents (BOD, TSS, total nitrogen) over time, nuisance conditions, system problems, etc.
  - c) A summary of any changes or upgrades that were made over the past year (or need to be made) to the wastewater treatment system (including treatment and disposal) to improve performance.
7. **Operator Certification:**
  - a) The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.
  - b) A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.
  - c) A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.
  - d) If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.
8. **Operation and Maintenance Manual:** The date the Operation and Maintenance Manual was last revised, and whether the manual is complete for the current operations.
9. **Data Gaps:** A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.
10. **Figures:** A wastewater treatment system process flow diagram with a label for the monitoring locations and a scaled facility map with treatment components,

discharge locations, monitoring locations, groundwater wells, storage locations (e.g. chemical, sludge, emergency overflow ponds, etc.), buildings, etc.

## 10. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

[https://www.waterboards.ca.gov/centralcoast/water\\_issues/programs/wastewater\\_permitting/docs/transmittal\\_sheet.pdf](https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf)

Little Bear must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker<sup>1,2</sup> database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR1000030866** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: [Geotracker@waterboards.ca.gov](mailto:Geotracker@waterboards.ca.gov).

**Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements**

| Electronic Submittal  | Description of Action                                                                                                                                       | Action                                                                                                              | Frequency                                                                                                                          |
|-----------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|
| Reports and Documents | Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System. | Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents. | On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board. |

<sup>1</sup> Information for first-time GeoTracker users is available at:

[https://www.waterboards.ca.gov/ust/electronic\\_submittal/docs/beginnerguid2.pdf](https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf)

<sup>2</sup> Additional information available at:

<https://geotracker.waterboards.ca.gov/>

| <b>Electronic Submittal</b>           | <b>Description of Action</b>                                                                                                                                                                                                                      | <b>Action</b>                                                                                                  | <b>Frequency</b>                                                                                                                       |
|---------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------|
| Laboratory Data                       | All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water quality samples collected from the lab, field monitoring not required.                                                           | Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker. | On or before the due date of the required monitoring report                                                                            |
| Depth to Groundwater                  | Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.                                                                                                              | Upload depth-to-water information to the GeoTracker GEO_WELL file.                                             | On or before the due date of the required monitoring report                                                                            |
| Boring Logs and Well Screen Intervals | Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)                                                                                                             | Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.                  | Every time a new boring is drilled.                                                                                                    |
| Location data (Geo XY)                | Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data." | Upload the Geo_XY for surveyed monitoring wells, and input the non-surveyed sampling locations.                | These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established. |
| Elevation Data (Geo Z)                | Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.                                                                                    | Upload the survey data to the GeoTracker GEO_Z File.                                                           | One-time, for all groundwater monitoring wells.                                                                                        |

## 11. TECHNICAL REPORTS

### A. Technical Reports

Little Bear must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 10. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

## B. Pond Liner Evaluation

In accordance with General Permit Section IV.B.1 all treatment, storage, and evaporation ponds must be lined to protect groundwater and associated beneficial uses. At this time, all three treatment ponds (Ponds 1, 2, and 3) are considered treatment **and disposal** ponds, and Little Bear must comply with effluent limits at the treatment and disposal ponds (ES-3 and ES-4 locations at Pond 2 and the Sprayfield Pond). Little Bear may submit to GeoTracker a Pond Liner Permeability Work Plan, and following Central Coast Water Board staff approval and completion of work, a Pond Liner Permeability Report. The reports must be prepared by a California licensed Professional Engineer or Professional Geologist and propose a method to evaluate pond permeability, and/or assessment of underlying groundwater quality to confirm the ponds do not leak. These are optional, and due before the Central Coast Water Board can evaluate removal of the effluent compliance locations at the treatment ponds.

**Table 10. Technical Report Submittal Due Dates**

| Report                                                               | Report Due Date                                                                                                             |
|----------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|
| Spill Prevention & Emergency Response Plan                           | December 28, 2023                                                                                                           |
| Sampling and Analysis Plan                                           | December 28, 2023                                                                                                           |
| Sludge Management Plan                                               | December 28, 2023                                                                                                           |
| Pond Liner Permeability Work Plan and Pond Liner Permeability Report | Optional, and due before Central Coast Water Board can evaluate the removal of treatment pond effluent compliance location. |

## 12. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Little Bear submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Little Bear to enforcement action pursuant to [section 13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Little Bear is required to submit this information because it is subject to the General Permit and is responsible for the discharge.



The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Little Bear must implement the above monitoring program on January 1, 2024. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Little Bear must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

*for* Matthew T. Keeling  
Executive Officer