



EDMUND G. BROWN JR.,
GOVERNOR



MATTHEW RODRIGUEZ
SECRETARY FOR
ENVIRONMENTAL PROTECTION

Los Angeles Regional Water Quality Control Board

September 26, 2014

Mr. Marty Moreno
Assistant Division Engineer for Sewer
Maintenance Division
Los Angeles County Department of Public Works
900 South Fremont Avenue, 9th Floor
Alhambra, CA 91803

CERTIFIED MAIL
RETURN RECEIPT REQUIRED
CLAIM NO. 7012 3460 0000 2166 2969

WASTE DISCHARGE REQUIREMENTS (WDRs) AND REVISED MONITORING AND REPORTING PROGRAM FOR LOS ANGELES COUNTY, DEPARTMENT OF PUBLIC WORKS, TRANCAS WATER POLLUTION CONTROL PLANT – 6338 PASEO CANYON DR., MALIBU, CA (ORDER NO. 00-030, FILE NO. 61-061, CI NO. 3017, GLOBAL ID WDR100001760)

Dear Mr. Moreno:

Our letter of July 15, 2014, transmitted tentative Waste Discharge Requirements (WDRs), a tentative revised Monitoring and Reporting Program (MRP) and tentative Standard Provisions for the Los Angeles County, Department of Public Works – Trancas Water Pollution Control Plant (Trancas WPCP).

Pursuant to Division 7 of the California Water Code, this Regional Water Quality Control Board (Regional Board) at a public meeting held on September 11, 2014, reviewed the tentative WDRs, the tentative revised MRP, and the tentative Standard Provisions, considered all factors in the case, and adopted WDRs Order No. R4-2014-0188 and revised MRP CI No. 3017 (copies enclosed) relative to this discharge. Standard Provisions, which are a part of the WDRs, are also enclosed. The adopted WDRs will be posted on the Regional Board's website at:

http://www.waterboards.ca.gov/losangeles/board_decisions/adopted_orders/

You are required to implement the revised MRP CI No. 3017 on the effective date of Order No. R4-2014-0188. Your first monitoring report under these requirements is due to this Regional Board by February 15, 2015.

The Discharger (Los Angeles County, Department of Public Works) shall comply with the Electronic Submittal of Information (ESI) requirements by submitting all reports required under the MRP, including groundwater monitoring data, discharge location data, and pdf monitoring reports to the State Water Resources Control Board GeoTracker database under Global ID **WDR100001760**. ESI training video is available at:

<https://waterboards.webex.com/waterboards/ldr.php?AT=pb&SP=MC&rID=44145287&rKey=7dad4352c990334b>

Mr. Marty Moreno
Los Angeles County
Department of Public Works
Trancas WPCP

- 2 -

September 26, 2014

If you have any additional questions, please contact the Project Manager, Ms. Mercedes Merino at (213) 620-6156 or via email at Mercedes.Merino@waterboards.ca.gov, or me at (213) 576-6683 or via email at Eric.Wu@waterboards.ca.gov.

Sincerely,



Eric Wu, Ph.D., P.E.
Chief of Groundwater Permitting Unit

Enclosures: WDRs Order No. R4-2014-0188
Revised Monitoring and Reporting Program No. 3017
Standard Provisions Applicable to WDRs.

cc (via email): Mr. Craig George, Division Manager of Building and Safety, City of Malibu
Mr. Jeff Bouse, Sewer Maintenance Division, County of Los Angeles

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD

LOS ANGELES REGION

320 West 4th Street, Suite 200, Los Angeles, California 90013

(213) 576-6660 • Fax (213) 576-6640

<http://www.waterboards.ca.gov/losangeles/>

ORDER NO. R4-2014-0188

(FILE NO. 61-061)

CI NO. 3017

**WASTE DISCHARGE REQUIREMENTS
FOR**

**LOS ANGELES COUNTY, DEPARTMENT OF PUBLIC WORKS
TRANCAS WATER POLLUTION CONTROL PLANT**

The California Regional Water Quality Control Board, Los Angeles Region (Regional Board) finds:

BACKGROUND

1. The Los Angeles County, Department of Public Works (hereinafter Discharger or County) operates the Trancas Water Pollution Control Plant (Trancas WPCP), located at 6338 Paseo Canyon Drive, Malibu, California (Figure 1). The Trancas WPCP was originally constructed by a private developer in 1963, and treats domestic wastewater from an estimated population of 600 people residing in 273 single family homes and condominiums located in two communities as follows:

- The Malibu West Community, consisting of 237 single family homes and condominiums
- The Lechuza Community, consisting of 36 single family homes

The Trancas WPCP, including the sewer collection system and disposal system, is owned by the Los Angeles County.

2. On March 2, 2000, the Los Angeles Regional Water Quality Control Board (Regional Board) adopted Waste Discharge Requirements (WDR) Order No. 00-030, requiring upgrade of the Plant with the installation of disinfection equipment, and a Time Schedule Order (TSO) No. 00-031, providing the time in which to complete the Plant upgrade. The TSO directed the Discharger to complete construction by June 1, 2002, and achieve final compliance with all the requirements of WDR Order No. 00-030, including fecal coliform limitations, by July 30, 2002.
3. TSO Order No. 00-031, allowed the Regional Board's Executive Officer, at his discretion, to extend the time schedule in the event that the compliance with the California Environmental Quality Act (CEQA) or project funding needs delay construction start-up. Since 2001, the Executive Officer granted five TSO extensions for the various Plant upgrade milestones (completing Plant design, beginning construction, completing construction and achieving final compliance). The last TSO extension granted by the Executive Officer on October 19, 2005, extended the task completion deadlines to April 2008.
4. The County notified the Regional Board that Trancas WPCP construction was completed March 17, 2008, and the Discharger has been meeting the effluent limitations.

September 11, 2014

5. On August 29, 2008, the Regional Board reviewed the compliance with the requirements contained in TSO No. 00-031 and determined that the Trancas WPCP and the Discharger had completed the tasks specified in TSO No. 00-031 by completing construction of the advanced Trancas WPCP on March 17, 2008 and proving compliance with the discharge limits prescribed in WDR Order No. 00-030 on April 25, 2008. Consequently, the Regional Board adopted Order No. R4-2008-0086, which terminated TSO No. 00-031
6. The Discharger discharges on average 55,000 gallons per day (gpd) of secondary-treated domestic wastewater. The Trancas WPCP was designed for an average dry weather flow of 85,000 gpd and a peak flow of 220,000 gpd.
7. WDR Order No. 00-030 does not allow developments outside the defined boundary to be connected with Trancas WPCP. Any development in the adjacent parcels has to install its own individual wastewater treatment systems. In 2013, a property owner requested to connect to the Trancas WPCP. The property owner is planning to build a single-family residence. The property is located approximately 3,800 feet (5920 Paseo Canyon Drive, Parcel Number 4469-046-007) from the Trancas WPCP.
8. California Water Code section 13263(e) provides that all waste discharge requirements shall be reviewed periodically and, upon such review, may be revised by the Regional Board. Following a review of requirements in WDR Order No. 00-030, these requirements have been revised to include additional findings, effluent limitations, updated standard provisions, and revised monitoring and reporting program.

FACILITY AND TREATMENT PROCESS DESCRIPTION

9. The Trancas WPCP and the leachfield disposal systems are located in Section 2, T2S, R19W, San Bernardino Base & Meridian (See Figure 1. Facility Site Location and Figure 2. Monitoring wells and Leachfields Location Map). The approximate coordinates of the Trancas WPCP are latitude is 34° 02' 25" and longitude 118°50' 20". Some of the hydrologic features near the Plant include:
 - Trancas and Zuma Beaches are located 1,000 feet to the south of the Trancas WPCP.
 - Trancas Lagoon is located at the mouth of Trancas Canyon Creek. The leachfield disposal system is located within 300 feet of the creek.
10. The site is in an unsewered area of Los Angeles County. To date, no public sewers have been scheduled for construction in the vicinity of the project.
11. The Trancas WPCP was designed to produce secondary-treated wastewater for discharge to groundwater. It was designed to treat 85,000 gpd (average daily dry weather flow) of domestic wastewater and maximum daily wet weather flow of 220,000 gpd.
12. The existing headwork consists of a communitor, bypass channel with a manual bar screen, a metering flume, and a pump station. The wastewater enters the treatment plant through an 8-inch gravity line into the influent channel and flows to the communitor. A bypass channel with a manual bar rack is provided if the communitor needs to be

served.

13. Secondary treatment consists of a dual-train activated sludge package plant with integral secondary clarifiers and anoxic chambers. The wastewater is pumped from the influent pump station to the anoxic tanks, an oxygen deficient environment, where it undergoes denitrification. Flow continues to the aeration tanks where the wastewater is aerated by coarse bubble diffusion. The aeration tanks allow biological treatment of the wastewater to take place. After the aeration tanks, the flow enters the secondary clarifier basins where the solids are settled and pumped by airlift pumps to either the anoxic tank (return activated sludge) or to the aerobic sludge holding tank (waste activated sludge).
14. The secondary effluent flows into a single-media filter for the removal of suspended solids. The filter has three individual filtration cells containing single-media anthracite filters. The filters are designed to produce secondary effluent quality to enhance the percolation of the effluent into the leachfield disposal system.
15. The filtered effluent is pumped to the chlorine contact tank where a Sodium Hypochlorite (typically 12% NaOCl solution) is dispensed, killing the remaining microorganisms in the filtered effluent.
16. Following disinfection, the final effluent is discharged to a leachfield disposal system located south and southwest of the plant where it is allowed to percolate into the ground. The leachfield disposal system consists of three (3) leachfields: the primary leachfield, an alternate leachfield and the backup leachfield. Each leachfield disposal system consists of five (5) 75 feet long by 10 feet wide and 5 feet deep cells. The leachfield disposal system is approximately 330 feet away from Trancas Canyon Creek and approximately 1,315 feet from the Pacific Ocean.
17. Sludge generated from the plant goes into the sludge holding tank. The sludge is hauled in tanker trucks to the City of Los Angeles Tillman Water Reclamation Plant for treatment and disposal.
18. Self-monitoring data from March 2008 to December 2013 characterize the recent effluent water quality as follows:

Table 1. Effluent Water Quality

Constituents	Units ¹	Trancas WPCP Effluent ²	Effluent Limits ³
pH	mg/L	6.51 - 7.45	6.5 – 8.5
Total coliform	MPN/100 mL	<20 - 300	NA ⁴
Fecal coliform	MPN/100 mL	<20 -300	200
Turbidity	NTU	1.9 -12.1	10 – 15
BOD ₅ 20°C	mg/L	2.0 – 6.8	30 – 45
Total Suspended Solids	mg/L	1.00 - 2.55	30 – 45
Residual chlorine	mg/L	0.10 - 4.92	NA ⁴
Oil & grease	mg/L	<1 - <5	15

Table 1. Effluent Water Quality (continued)

Constituents	Units ¹	Trancas WPCP Effluent ²	Effluent Limits ³
Total Dissolved Solids	mg/L	392 - 774	1,000
Chloride	mg/L	91 - 171	250
Boron	mg/L	0.13 – 0.64	1.0
Sulfate	mg/L	18.2 – 199	250
Nitrate as N	mg/L	0.24 – 16.5	NA ⁴
Nitrite as N	mg/L	<0.03 – <0.3	NA ⁴
Ammonia as N	mg/L	0.1 – 1.02	NA ⁴
Organic-N	mg/L	0.07 – 6.6	NA ⁴
Total Nitrogen	mg/L	0.71 – 17.5	NA ⁴
Phosphate as P	mg/L	0.494 – 4.28	NA ⁴
MBAS	mg/L	0.01 – 0.816	NA ⁴

¹mg/L=milligrams per liter; MPN/100mL = most probable number (MPN) per 100 milliliters

²Based on analyses performed from March 25, 2008 to December 31, 2013.

³Effluent limits prescribed in Order No. 00-030

⁴NA= Not applicable

19. The Discharger installed four (4) monitoring wells in the vicinity of the Trancas WPCP in March 2002. The completed well depths vary between 20 feet and 24 feet below ground surface (bgs). Monitoring well MW-1 is an existing well, and no installation date, well depth and/or well screen information is available. Self-monitoring data from March 2008 to December 2013 characterize the recent groundwater quality as follows:

Table 2. Groundwater Quality

Constituents	Units ¹	MW-1 ²	MW-2 ²	MW-3 ²	MW-4 ²	MW-5 ²
pH	pH units	7.05	6.84	6.95	6.84	7.08
Total Coliform	MPN/100ml	606	281	141	15,757	1,899
Fecal Coliform	MPN/100ml	93	220	<20	2,267	33.3
BOD ₅ 20°C	mg/L	3	<2	2	3.30	2.06
Total dissolved solids	mg/L	827	1,173	679	1,272	653
Chloride	mg/L	198	178	129	226	140
Residual chlorine	mg/L	0.12	0.12	0.15	0.08	0.04
Boron	mg/L	0.41	0.37	0.40	0.34	0.41
Sulfate	mg/L	193	277	146	351	131
Nitrate as N	mg/L	4.56	0.69	1.99	1.46	5.65
Nitrite as N	mg/L	<0.3	<0.03	<0.03	<0.03	<0.03
Ammonia as N	mg/L	0.16	0.18	0.18	0.38	0.23
Organic-N	mg/L	0.33	0.37	0.42	0.50	0.38
Phosphorus	mg/L	1.26	<0.3	0.83	0.78	2.08
MBAS	mg/L	0.07	0.04	0.07	0.08	0.08

¹mg/L=milligrams per liter; MPN/100mL = most probable number (MPN) per 100 milliliters

²Based on analyses performed from February 26, 2008 to December 31, 2013

MW-1 and MW-2: Upgradient Well; MW-3, MW-4 and MW-5: Downgradient Well

20. The existing flow has never reached the capacity limit of the Trancas WPCP, and the Trancas WPCP has sufficient capacity for the connection of the current and future development projects. Therefore, there will be no change in the flow capacity limit of 220,000 gpd.
21. Currently, the Trancas WPCP is treating approximately 50,752 gpd of domestic wastewater from the Malibu West Community and the Lechuza Community residential units.

SITE-SPECIFIC CONDITIONS

22. The Trancas WPCP and its leachfields are located in the Point Dume Hydrologic Area - Trancas Canyon Hydraulic unit, and are approximately 1,000 feet east of the intersection of Trancas Canyon Drive and Pacific Coast Highway in the City of Malibu. The Trancas WPCP is located adjacent to the Trancas Canyon streambed, and overlies groundwater in a small alluvial basin of gravels and sands within Trancas Canyon.
23. Groundwater beneath the Trancas WPCP is contained in alluvial, beach and terrace deposits. Groundwater levels and flow directions beneath the site are determined by these deposits. In addition, groundwater may be present in some sandstone rock formations underlying recent deposits, especially in fracture systems within bedrock formations.
24. Depth to groundwater at the Trancas WPCP is approximately 14.5 feet below the ground surface (bgs). Groundwater flows in a southwesterly direction towards the Pacific Ocean.
25. The Point Dume quadrangle is covered by unconsolidated to moderately consolidated sedimentary deposits of Quaternary age deposits. Within approximately 2.5 miles of the tip of Point Dume and within about one-half mile of the coast away from the flanks of the point, upper Pleistocene marine and nonmarine coastal terrace deposits rest on three distinct erosional platforms cut into older bedrock.
26. The Late Pleistocene marine, coastal terrace deposits are especially prominent west of Point Dume, where younger, Holocene and upper Pleistocene, nonmarine coastal terrace deposits also occur. Holocene and upper Pleistocene stream terrace deposits are perched on the flanks of Trancas, Zuma, Ramirez, and Medea Creek canyons. Most of these terrace deposits consist of gravel, sand, and silt.
27. The remaining Quaternary deposits are relatively young and are considered to be of late Pleistocene to Holocene age, except for the artificial fill, which is strictly Holocene. The younger Quaternary deposits occur within or immediately adjacent to lowlying valley and canyon floors, or they form beach and associated dune deposits, both of which consist of unconsolidated, cohesionless, fine- to medium-grained sand.
28. Undifferentiated alluvium (stream-deposited, unconsolidated, generally cohesionless gravel, sand, and silt) fills the bottoms of all canyons. Colluvium deposits, in this area, are generally found resting on lower hillslopes and consist of silt, sand, and clay, typically with abundant angular rock fragments.

29. Bedrock within the Point Dume quadrangle can be classified into two distinct stratigraphic sequences, which are separated by the Malibu Coast Fault. Bedrock, south of the Malibu Coast Fault, consists of the middle and upper Miocene Monterey Shale, overlying the Trancas Formation (detrital sedimentary rocks), which overlies and intertongues with the lower and middle Miocene Zuma Volcanics.
30. Bedrock units exposed in this area are almost entirely of Tertiary age, with some Cretaceous rocks exposed on the southern flank of the Santa Monica Mountains. The youngest Tertiary rocks (upper Miocene) are unconformably overlain by upper Pleistocene marine terrace deposits. Strata of Pliocene and early Pleistocene age are not present within the quadrangle.
31. North of the Malibu Coast Fault, the marine clastic sedimentary rocks of the middle Miocene Upper Topanga Formation overlie the Conejo Volcanics, a thick sequence of submarine and subaerial extrusive and related intrusive rocks of middle Miocene age. The Conejo Volcanics overlie middle and lower Miocene marine clastic sedimentary rocks of the Lower Topanga Formation, which in turn rests on Oligocene nonmarine clastic sedimentary rocks of the Sespe Formation.
32. There are no public water wells downgradient of the Trancas WPCP and all residents and facilities, receive water from the Metropolitan Water District of Southern California through the West Basin Municipal Water District.

COMPLIANCE HISTORY

33. Monitoring reports submitted to the Regional Board from July 2007 through September 2013 show twenty-nine (29) effluent limit violations for total suspended solids, biochemical oxygen demand (BOD₅20°C), turbidity, and fecal coliform. Most violations occurred in 2007 for exceedances of turbidity, total suspended solids, biochemical oxygen demand, and fecal coliform. Trancas WPCP operation personnel attributed these exceedances to optimization of the system and sampling errors. The construction of Trancas WPCP was completed on March 17, 2008. The last effluent limit violations of fecal coliform occurred on July 7, 2010. The Discharger attributed the July 7, 2010 effluent limit exceedances to field contamination during the sampling procedure. The Discharger addressed these compliance issues and has increased the sampling frequency from monthly to weekly. The subsequent weekly sampling results showed that fecal coliform concentrations were within the effluent limits. The Trancas WPCP compliance record has improved significantly.

APPLICABLE PLANS, POLICIES AND REGULATIONS

34. ***Water Quality Control Plan for the Coastal Watersheds of Los Angeles and Ventura Counties (Basin Plan)*** – On June 13, 1994, the Regional Board adopted a revised Basin Plan. The Basin Plan (i) designates beneficial uses for surface and groundwater, (ii) establishes narrative and numeric water quality objectives that must be attained or maintained to protect the designated beneficial uses, and (iii) sets forth implementation programs to protect the beneficial uses of the waters of the state. The Basin Plan also incorporates State Water Resources Control Board (State Board) Resolution 68-16 (see finding No. 35 below for detail). In addition, the Basin Plan

incorporates by reference applicable State and Regional Board plans and policies and other pertinent water quality policies and regulations. The Regional Board prepared the 1994 update of the Basin Plan to be consistent with previously adopted State and Regional Board plans and policies. This Order implements the plans, policies and provisions of the Regional Board's Basin Plan. The Basin Plan has been amended occasionally since 1994.

35. The Trancas WPCP and its leachfields are located in the Point Dume Hydrologic area Santa Clara — Trancas Canyon Hydrologic Subarea and overlies the Point Dume Hydrologic Area. The Basin Plan has the following beneficial use designations:

Surface water (Trancas Canyon Creek – LA County Coastal Streams)

Potential: Municipal and domestic supply

Existing: Industrial process and service supply; agricultural supply; groundwater recharge; freshwater replenishment; water-contact recreation (REC-1); non-water contact recreation (REC-2); warm and cold freshwater habitat; spawning rare, threatened, or endangered species; wildlife habitat; migration of aquatic organisms; and spawning, reproduction, and/or early development of fish

Groundwater (Point Dume Hydrologic area – Trancas Canyon Hydrologic Subarea):

Potential: Industrial Service Supply

Existing: Municipal and Domestic Supply, and Agricultural Supply

36. To protect sources of drinking water the Basin Plan (Chapter 3) incorporate as water quality objectives primary and secondary maximum contaminants levels (MCLs) for inorganic, organic, and radioactive contaminants in drinking water that are codified in Title 22 California Code of Regulations, Division 1 (CCR title 22). This incorporation by reference is prospective, including future changes to the incorporated provisions as the changes take effect. The CCR title 22 primary MCLs are applicable water quality objectives for a receiving water to protect beneficial uses when that receiving water is designated as municipal and domestic supply. Also, the Basin Plan specifies that "Ground waters shall not contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses." Therefore the CCR title 22 secondary MCLs, which are limits based on aesthetic, organoleptic standards, are applicable water quality objectives for a receiving water to protect beneficial uses when that receiving water is designated as municipal and domestic supply. These water quality objectives are implemented in this Order to protect groundwater quality.

It is the policy of the State of California that every human being has the right to safe, clean, affordable, and accessible water adequate for human consumption, cooking, and sanitary purposes. This Order promotes that policy by requiring discharges to meet MCLs designed to protect human health and ensure that water is safe for domestic use.

37. **State Water Board Resolution No. 68-16** ("Statement of Policy with Respect to Maintaining High Quality Waters in California", also called the "Antidegradation Policy") requires the Regional Board, in regulating the discharge of waste, to maintain high quality waters of the state until it is demonstrated that any change in quality will be consistent with maximum benefit to the people of the State, will not unreasonably affect beneficial uses, and will not result in water quality less than that described in the State Water Board's policies (e.g., quality that exceeds water quality objectives). The Regional Board finds that the discharge, as allowed in these WDRs, is consistent with Resolution No. 68-16 since this Order (1) requires compliance with the requirements sets forth in this Order, including the use of best practicable treatment and control of the discharges, (2) requires implementation of Monitoring Reporting Program (MRP); and (3) requires discharges to be treated to comply with water quality objectives.
38. This Order establishes limitations that will not unreasonably threaten present and anticipated beneficial uses or result in receiving quality that exceeds water quality objectives set forth in the Basin Plan. This means that where the stringency of the limitations for the same waste constituent differs according to beneficial use, the most stringent applies as the governing limitation for that waste constituent. This Order contains tasks for assuring that best practicable treatment or control (BPTC) and the highest water quality consistent with the maximum benefit to the people of the State will be achieved. Accordingly, the discharge is consistent with the antidegradation provisions of Resolution 68-16. Based on the results of the scheduled tasks, the Regional Board may reopen this Order to reconsider groundwater limitations and other requirements to comply with Resolution 68-16.
39. Pursuant to California Water Code Section 13263(g), the discharge of waste is a privilege, not a right, and adoption of this Order does not create a vested right to continue the discharge.
40. The Regional Board will review this Order periodically and will revise requirements when necessary.
41. Section 13267(b) of the California Water Code states, in part, that "In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging or who proposes to discharge within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste outside of its region that could affect the quality of waters of the state within its region shall furnish under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs of these reports shall bear a reasonable relationship to the need for the reports and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports." The reports required by the MRP CI No. 3017 are necessary to assure compliance with these waste discharge requirements. The Discharger operates facilities that discharge wastes subject to this Order.

CALIFORNIA ENVIRONMENTAL QUALITY ACT AND NOTIFICATION

42. This project involves the issuance of WDRs for an existing facility; as such the action to adopt WDRs is exempt from the provisions of the California Environmental Quality Act (Public Resources Code section 21000 et seq.) in accordance with California Code of Regulations, title 14, section 15301.
43. On July 25, 2014, the Regional Board has notified the Discharger and interested agencies and persons of the intent to revise WDRs for this discharge, and has provided an opportunity to submit written comments by August 25, 2014.
44. The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge and to the tentative requirements.
45. Pursuant to California Water Code section 13320, any person affected by this action of the Regional Board may petition the State Water Board to review the action in accordance with section 13320 of the California Water Code and Title 23, California Code of Regulations, Section 2050. The State Water Board (P.O. Box 100, Sacramento, California, 95812) must receive the petition within 30 days of the date this Order is adopted. The regulations regarding petitions may be found at http://www.waterboards.ca.gov/public_notices/petitions/water_quality/index.shtml

IT IS HEREBY ORDERED that the Discharger, Los Angeles County Department of Public Works, shall be responsible for and shall comply with the following requirements in all operations and activities at the Trancas Water Pollution Control Plant:

A. INFLUENT LIMITATIONS

1. The source of wastewater is limited to the Malibu West Community, Lechuza Community, and neighboring properties shown in Figure 2. The Trancas WPCP may accept wastewater from future neighboring residential development projects provided that the Trancas WPCP has sufficient treatment capacity for additional connection. The Executive Officer of the Regional Board is delegated with the authority to approve the additional connection(s). The Discharger shall submit a workplan including the analysis of the capacity, for the Executive Officer's review and approval.
2. Waste discharged shall be limited to domestic wastewater only. No commercial or industrial wastewaters shall be discharged to the system.
3. The maximum daily flow of influent from the collection system to the wastewater treatment system shall not exceed the maximum design flow of 220,000 gpd.
4. No volatile organic compounds are to be discharged into the Trancas WPCP.

B. EFFLUENT LIMITATIONS

1. The discharge flow shall not exceed a maximum flow of 220,000 gpd.

2. The pH in the effluent shall at all times be from 6.5 to 8.5 pH units.
3. Effluent shall not contain constituents in excess of the following limits:

Table 3. Effluent Limitations

Constituent	Units ¹	Daily Maximum	30-day Average
BOD ₅ 20°C	mg/L	45	30
Total suspended solids	mg/L	45	30
Turbidity	NTU	15	10
Total nitrogen ²	mg/L	10	--
Nitrate as N	mg/L	10	--
Nitrite as N	mg/L	1	--
Oil and grease	mg/L	15	10
Total dissolved solids	mg/L	1,000	--
Sulfate	mg/L	250	--
Chloride	mg/L	250	--
Boron	mg/L	1.0	--
MBAS (Surfactants)	mg/L	1.0	--
Fecal coliform	MPN/100mL	200	--

¹mg/L=milligrams per liter; MPN/100mL = most probable number (MPN) per 100 milliliters

²Total nitrogen= nitrate-N + nitrite-N + ammonia-N + Organic Nitrogen

³MBAS=Methylene Blue Active Substances

4. Total coliform Limits: The total coliform (median number of coliform organisms in the effluent) shall not exceed 23 MPN per 100 ml, as determined from the bacteriological results of the last 7 days for which analyses have been completed, and the number of total coliform bacteria shall not exceed 240 MPN/100mL in more than one sample in any 30 days period.
5. Effluent from the Trancas WPCP shall not contain heavy metals, arsenic, or cyanide, or other pollutants designated Priority Pollutants (Appendix A to 40 CFR, Part 423--126 Priority Pollutants) by the U.S. Environmental Protection Agency in concentrations exceeding the limits contained in the California Drinking Water Standards, CCR title 22, section 64431 (Attachment A-1).
6. Radioactivity shall not exceed the limits specified in the CCR title 22, sections 64441 et seq., or subsequent revisions (Attachment A-2).
7. Effluent shall not contain organic chemicals in concentrations exceeding the limits contained in the current California Drinking Water Standards, CCR title 22, section 64444 or subsequent revisions (Attachment A-3).
8. Effluent shall not contain disinfectant byproducts in concentrations exceeding the limits contained in the current California Drinking Water Standards, CCR title 22, section 64533, or subsequent revisions (Attachment A-4).

C. GROUNDWATER LIMITATIONS

1. "Receiving water" is defined as groundwater underlying the wastewater treatment plant, and the discharge areas described in Finding 35.
2. The Discharger shall monitor the background of the receiving groundwater quality as it relates to its effluent discharges. Should the constituent concentrations in groundwater exceed the limits specified in Table 4; the Discharger shall demonstrate that the discharge from the Trancas Water Pollution Control Plant does not contribute to the degradation of groundwater quality.

Table 4. Groundwater Limitations

Constituent	Units ¹	Maximum Limitation ³
Total dissolved solids (TDS)	mg/L	1,000
Sulfate	mg/L	250
Chloride	mg/L	250
Boron	mg/L	1.0
Total Nitrogen ²	mg/L	10
Nitrate as N	mg/L	10
Nitrite as N	mg/L	1
Total coliform	MPN/100mL	1.1
Fecal coliform	MPN/100mL	1.1
Enterococcus	MPN/100mL	1.1

¹mg/= milligrams per liter; MPN/100mL= most probable number (MPN) per 100 milliliters

²Total nitrogen= nitrate-N + nitrite-N + ammonia-N + Organic Nitrogen

³The point of compliance with groundwater limitation is the downgradient monitoring wells.

D. GENERAL REQUIREMENTS

1. Standby or emergency power facilities and/or sufficient capacity shall be provided for treated wastewater storage during rainfall or in the event of plant upsets or outages.
2. Adequate facilities shall be provided to protect the Trancas WPCP wastewater treatment, treatment system devices, and wastewater collection system from damage by storm flows and runoff or runoff generated by a 100-year storm.
3. The Discharger shall operate all systems and equipment to maximize treatment of wastewater and optimize the quality of the discharge.
4. The treatment system, including the collection system that is a part of the treatment system and the disposal system, shall be maintained in such a manner that prevents wastewater from surfacing or overflowing at any location.

5. Sludge and other solids removed from wastewater shall be disposed of in a manner that is consistent with Title 27, Division 2, Subdivision 1 of the CCR and approved by the Executive Officer.
6. Sludge and other solids shall be removed from wastewater treatment equipment, sumps, ponds, etc. as needed to ensure optimal plant operation and adequate hydraulic capacity. Drying operations shall take place such that leachate does not impact the quality of groundwater or surface water.
7. Storage and disposal of domestic wastewater shall comply with existing Federal, State, and local laws and regulations, including permitting requirements and technical standards.
8. Any proposed change in solids use or disposal practice from a previously approved practice shall be reported to the Executive Officer at least 60 days in advance of the change.
9. Dischargers are directed to submit all reports required by the WDRs, including groundwater monitoring analytical data and discharge location data, to the State Water Resources Control Board GeoTracker database under Global ID WDR100001760. The GeoTracker training video is available at:

<https://waterboards.webex.com/waterboards/ldr.php?AT=pb&SP=MC&rID=44145287&rKey=7dad4352c990334b>

E. PROHIBITIONS

1. The direct or indirect discharge of any waste and/or wastewater to surface waters or surface water drainage courses is prohibited.
2. Bypass, discharger or overflow of untreated wastes, except as allowed by Section E. 13 of this Order, is prohibited.
3. Discharge of waste classified as 'hazardous', as defined in Section 2521(a) of Title 23, CCR, Section 2510 et seq., is prohibited. Discharge of waste classified as 'designated,' as defined in California Water Code Section 13173, in a manner that causes violation of groundwater limitations, is prohibited.
4. Wastes shall not be disposed of in geologically unstable areas or so as to cause earth movement.
5. Wastes discharged shall not impart tastes, odors, color, foaming or other objectionable characteristics to the receiving water.
6. There shall be no onsite permanent disposal of sludge. Sludge-drying activities are allowed, but only as an intermediate treatment prior to off-site disposal. Any offsite disposal of wastewater or sludge shall be made only to a legal point of disposal. For purposes of this Order, a legal disposal site is one for which requirements have been established by a California Regional Water Quality

Control Board or comparable regulatory entity, and which is in full compliance therewith. Any wastewater or sludge handling shall be in such a manner as to prevent its reaching surface waters or watercourses.

7. Odors originating at this facility shall not be perceivable beyond the limits of the property owned by the Discharger.
8. Wastes discharged from the wastewater treatment plant shall at no time contain any substances in concentrations toxic to human, animal, plant, or aquatic life.
9. The discharge of waste shall not create a condition of pollution, contamination, or nuisance. No new connections may be made without notification to the Regional Board.
10. The discharge of any wastewater to surface waters or surface water drainage courses is prohibited without a NPDES permit.
11. The holding tanks shall not contain floating materials, including solids, foams or scum in concentrations that cause nuisance, adversely affect beneficial uses, or serve as a substrate for undesirable bacterial or algae growth or insect vectors.
12. Bypass (the intentional diversion of waste stream from any portion of a treatment facility) is prohibited. The Regional Board may take enforcement action against the Discharger for bypass unless:
 - a) Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage. (Severe property damage means substantial physical damage to property, damage to the treatment facilities that cause them to become inoperable, or substantial and permanent loss in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production);
 - b) There were no feasible alternatives to bypass, such as the use of auxiliary treatment facilities, retention of untreated waste, or maintenance during normal periods of equipment down time. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that could occur during normal periods of equipment downtime or preventive maintenance; and
 - c) The Discharger submitted a notice at least 48 hours in advance of the need for a bypass to the Regional Board.
13. Any discharge of wastewater from the treatment system (including the wastewater collection system) at any point other than specifically described in this Order is prohibited and constitutes a violation of this Order.

F. PROVISIONS

1. A copy of this Order shall be maintained at the wastewater treatment plant so as to be available at all times to operating personnel.
2. The Discharger shall file with the Regional Board technical reports on self-monitoring work performed according to the detailed specifications contained in Monitoring and Reporting Program CI No. 3017 attached hereto and incorporated herein by reference, as directed by the Executive Officer. The results of any monitoring done more frequently than required at the location and/or times specified in the Monitoring and Reporting Program shall be reported to the Regional Board. The Discharger shall comply with all of the provisions and requirements of the Monitoring and Reporting Program.
3. The Discharger shall comply with all applicable requirements of chapter 4.5 (commencing with section 13290) of division 7 of the California Water Code.
4. The Discharger shall achieve compliance with all the effluent limitations requirements listed in this Order.
5. Monitoring and Reporting Program CI No. 3017 contains requirements, among others, a groundwater monitoring program for the Trancas Water Pollution Control Plant so that the groundwater downgradient and upgradient from the discharge/disposal area can be measured, sampled, and analyzed to determine if discharges from the disposal system are impacting water quality.
6. The Discharger shall monitor the background of the receiving groundwater quality as it relates to its effluent discharges. Should the constituent concentrations in any downgradient monitoring well exceed the receiving water quality objectives in the Basin Plan and the increase in constituents is attributable to the Discharger's effluent disposal practices, the Discharger must develop a source control plan including a detailed source identification and pollution minimization plan, together with the time schedule of implementation, and must be submitted within 90 days of recording the exceedance.
7. Should effluent monitoring data indicate possible degradation of groundwater attributable to Discharger's effluent, the Discharger shall submit, within 90 days after discovery of the problem, plans for measures that will be taken, or have been taken, to prevent degradation that may result from the discharge(s).
8. Should the nitrate-nitrogen plus nitrite-nitrogen concentration in effluent of Trancas WPCP wastewater exceed 15 mg/L in three (monthly sampling plus two additional sampling events for result verification) consecutive samples taken within one month, the Discharger must submit an investigation plan (Plan) to the Executive Officer for approval within 90 days from the occurrence. The Plan must contain a detailed description of pollutant minimization strategies and prevention measures proposed, together with the time schedule of implementation.

9. Wastewater treatment and discharge at the discharge/disposal area shall not cause pollution or nuisance as defined in California Water Code section 13050.
10. In accordance with California Water Code section 13260(c), the Discharger shall file a report of any material change or proposed change in the character, location, or volume of the discharge.
11. The Discharger shall operate and maintain its wastewater collection, treatment and disposal facilities in a manner to ensure that all facilities are adequately staffed, supervised, financed, operated, maintained, repaired, and upgraded as necessary, to provide adequate and reliable transport, treatment, and disposal of all wastewater from both existing and planned future wastewater sources under the Discharger's responsibilities. Anyone employed in the operation of the wastewater treatment plant must be certified pursuant to California Water Code sections 13625-13633.
12. The Discharger shall submit to the Regional Board an Operations and Maintenance Manual (O & M Manual) for the entire updated Trancas WPCP and disposal facilities for the Trancas WPCP facility by **February 15, 2015**. The Discharger shall maintain the O & M Manual in useable condition, and available for reference and use by all applicable personnel. The Discharger shall regularly review, and revise or update as necessary, the O & M Manual(s) in order for the document(s) to remain useful and relevant to current equipment and operation practices. Reviews shall be conducted annually, and revisions or updates shall be completed as necessary and submitted to the Regional Board.
13. Supervisors and operators of municipal wastewater treatment plants and privately owned facilities used in the treatment or reclamation of sewage and industrial waste shall possess a wastewater treatment plant operator certificate in accordance with Title 23, California Code of Regulations section 3680.
14. The Discharger shall take all reasonable steps to minimize or prevent any discharge that has a reasonable likelihood of adversely affecting human health or the environment.
15. For any violation of requirements in this Order, the Discharger shall notify the Regional Board within 24 hours of knowledge of the violation either by telephone or electronic mail. The notification shall be followed by a written report within one week. The Discharger in the next monitoring report shall also confirm this information. In addition, the report shall include the reasons for the violations or adverse conditions, the steps being taken to correct the problem (including dates thereof), and the steps being taken to prevent a recurrence.
16. This Order does not relieve the Discharger from the responsibility to obtain other necessary local, state, and federal permits to construct facilities necessary for compliance with this Order; nor does this Order prevent imposition of additional standards, requirements, or conditions by any other regulatory agency.

17. After notice and opportunity for a hearing, this Order may be terminated or modified for causes including, but not limited, to:
 - a) Violation of any term or condition contained in this Order;
 - b) Obtaining this Order by misrepresentation, or failure to disclose all relevant facts; or
 - c) A change in any condition, or the discovery of any information, that requires either a temporary or permanent reduction or elimination of the authorized discharge.
18. The Discharger shall furnish, within a reasonable time, any information the Regional Board may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order. The Discharger shall also furnish to the Regional Board, upon request, copies of records required to be kept by this Order.
19. This Order includes the attached *Standard Provisions Applicable to Waste Discharge Requirements* which are incorporated herein by reference. If there is any conflict between provisions stated herein and the *Standard Provisions Applicable to Waste Discharge Requirements*, the provisions stated herein will prevail.
20. The Discharger shall allow the Regional Board, or an authorized representative upon the presentation of credentials and other documents as may be required by law, to:
 - a) Enter upon the Discharger premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this Order;
 - b) Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order;
 - c) Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
 - d) Sample or monitor at reasonable times, for the purposes of assuring compliance with this Order, or as otherwise authorized by the CWC, any substances or parameters at any locations.
21. The WDRs contained in this Order will remain in effect and will be reviewed after five (5) years. Should the Discharger wish to continue discharging to groundwater for a period of time in excess of 5 years, the Discharger must file an updated Report of Waste Discharge with the Regional Board no later than 120 days in advance of the fifth-year anniversary date of the Order for consideration of issuance of new or revised waste discharge requirements. Any discharge of

waste ten years after the date of adoption of this Order, without filing an updated Report of Waste Discharge with the Regional Board, is a violation of California Water Code section 13264. The Regional Board is authorized to take appropriate enforcement action for any noncompliance with this provision including assessment of penalties.

22. All discharges of waste into the waters of the State are privileges, not rights. In accordance with California Water Code section 13263(g), these requirements shall not create a vested right to continue to discharge and are subject to rescission or modification.
23. Failure to comply with this Order and MRP No. 3017, could subject the Discharger to monetary civil liability pursuant to the California Water Code, including sections 13268 and 13350. Person's failing to furnish monitoring reports or falsifying any information provided therein is guilty of a misdemeanor.


G. TERMINATION

Regional Board Order No. 00-030, adopted by the Regional Board on March 2, 2000, is hereby terminated, except for enforcement purposes.

H. REOPENER

1. The Regional Board may modify, or revoke and reissue this Order at any time, and may if present or future investigations demonstrate that the discharge(s) governed by this Order will cause, have the potential to cause, or will contribute to adverse impacts on water quality and/or beneficial uses of the receiving waters or to address Discharger's expansion or mitigation plans, TMDL or Basin Plan provisions, or compliance with Resolution 68-16.

I, Samuel Unger, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Los Angeles Region, on September 11, 2014.



Samuel Unger, P. E.
Executive Officer

Attachment A-1

Table 64431-A: Inorganic Chemicals ¹	
Constituent	Maximum Contamination Levels (mg/L)
Aluminum	1
Antimony	0.006
Arsenic	0.05
Asbestos	7 MFL ²
Barium	1
Beryllium	0.004
Cadmium	0.005
Chromium	0.05
Cyanide	0.2
Fluoride	2
Mercury	0.002
Nickel	0.1
Selenium	0.05
Thallium	0.002

1. California Code of Regulation (CCR) Title 22, Section 64431

2. MFL= million fibers per liter; MCL for fibers exceeding 10µm in length

Attachment A-2

Table 4 – Radioactivity ³	
Constituent	Maximum Contamination Levels (pCi/L)
Combined Radium-226 and Radium-228	5
Gross Alpha Particle Activity (Including Radium-226 but Excluding Radon and Uranium)	15
Tritium	20,000
Strontium-90	8
Gross Beta Particle Activity	50
Uranium	20

3. CCR Title 22, Section 64443

Attachment A-3

Table 64444-A – Organic/Regulated Chemicals ⁴	
Constituent	Maximum Contamination Levels (mg/L)
Volatile Organic Chemicals	
Benzene	0.001
Carbon Tetrachloride (CTC)	0.0005
1,2-Dichlorobenzene	0.6
1,4-Dichlorobenzene	0.005
1,1-Dichloroethane	0.005
1,2-Dichloroethane (1,2-DCA)	0.0005
1,1-Dichloroethene (1,1-DCE)	0.006
Cis-1,2-Dichloroethylene	0.006
Trans-1,2-Dichloroethylene	0.01
Dichloromethane	0.005
1,2-Dichloropropane	0.005
1,3-Dichloropropene	0.0005
Ethylbenzene	0.7
Methyl-tert-butyl-ether	0.013
Monochlorobenzene	0.07
Styrene	0.1
1,1,2,2-Tetrachloroethane	0.001
Tetrachloroethylene (PCE)	0.005
Toluene	0.15
1,2,4-Trichlorobenzene	0.07
1,1,1-Trichloroethane	0.2
1,1,2-Trichloroethane	0.005
Trichloroethylene (TCE)	0.005
Trichlorofluoromethane	0.15
1,1,2-Trichloro-1,2,2-Trifluoroethane	1.2
Vinyl Chloride	0.0005
Xylenes (m,p)	1.75
Non-Volatile synthetic Organic Chemicals	
Alachlor	0.002
Atrazine	0.003
Bentazon	0.018
Benzo(a)pyrene	0.0002
Carbofuran	0.018
Chloradane	0.0001
2,4-D	0.07
Dalapon	0.2
1,2-Dibromo-3-chloropropane	0.0002

(Continues to the Next Page)

(Continued from the Previous Page)

Table 64444-A – Organic/Regulated Chemicals⁴

Constituent	Maximum Contamination Levels (mg/L)
Non-Volatile synthetic Organic Chemicals	
Di(2-ethylhexyl)adipate	0.4
Di(2-ethylhexyl)phthalate	0.004
Dinoseb	0.007
Diquat	0.02
Endothall	0.1
Endrin	0.002
Ethylene Dibromide (EDB)	0.00005
Glyphosate	0.7
Heptachlor	0.00001
Heptachlor Epoxie	0.00001
Hexachlorobenzene	0.001
Hexachlorocyclopentadiene	0.05
Lindane	0.0002
Methoxychlor	0.04
Molinate	0.02
Oxamyl	0.2
Pentachlorophenol	0.001
Picloram	0.5
Polychlorinated Biphenyls	0.0005
Simazine	0.004
Thiobencarb	0.07
Toxaphene	0.003
2,3,7,8-TCDD (Dioxin)	3×10^{-8}
2,4,5-TP (Silvex)	0.05

4. CCR Title 22, Section 64444

Attachment A-4

Table 64533-A – Primary MCLs for Disinfection Byproducts⁵	
Constituent	Maximum Contamination Levels (mg/L)
Total Trihalomethanes (TTHM)	0.08
Bromodichloromethane	
Bromoform	
Chloroform	
Dibromochloromethane	
Haloacetic acid (five) (HAA5)	0.06
Monochloroacetic acid	
Dichloroacetic acid	
Trichloroacetic acid	
Monobromoacetic acid	
Dibromoacetic acid	
Bromate	0.01
Chlorite	1.0

5. CCR Title 22, Section 64533, Chapter 15.5


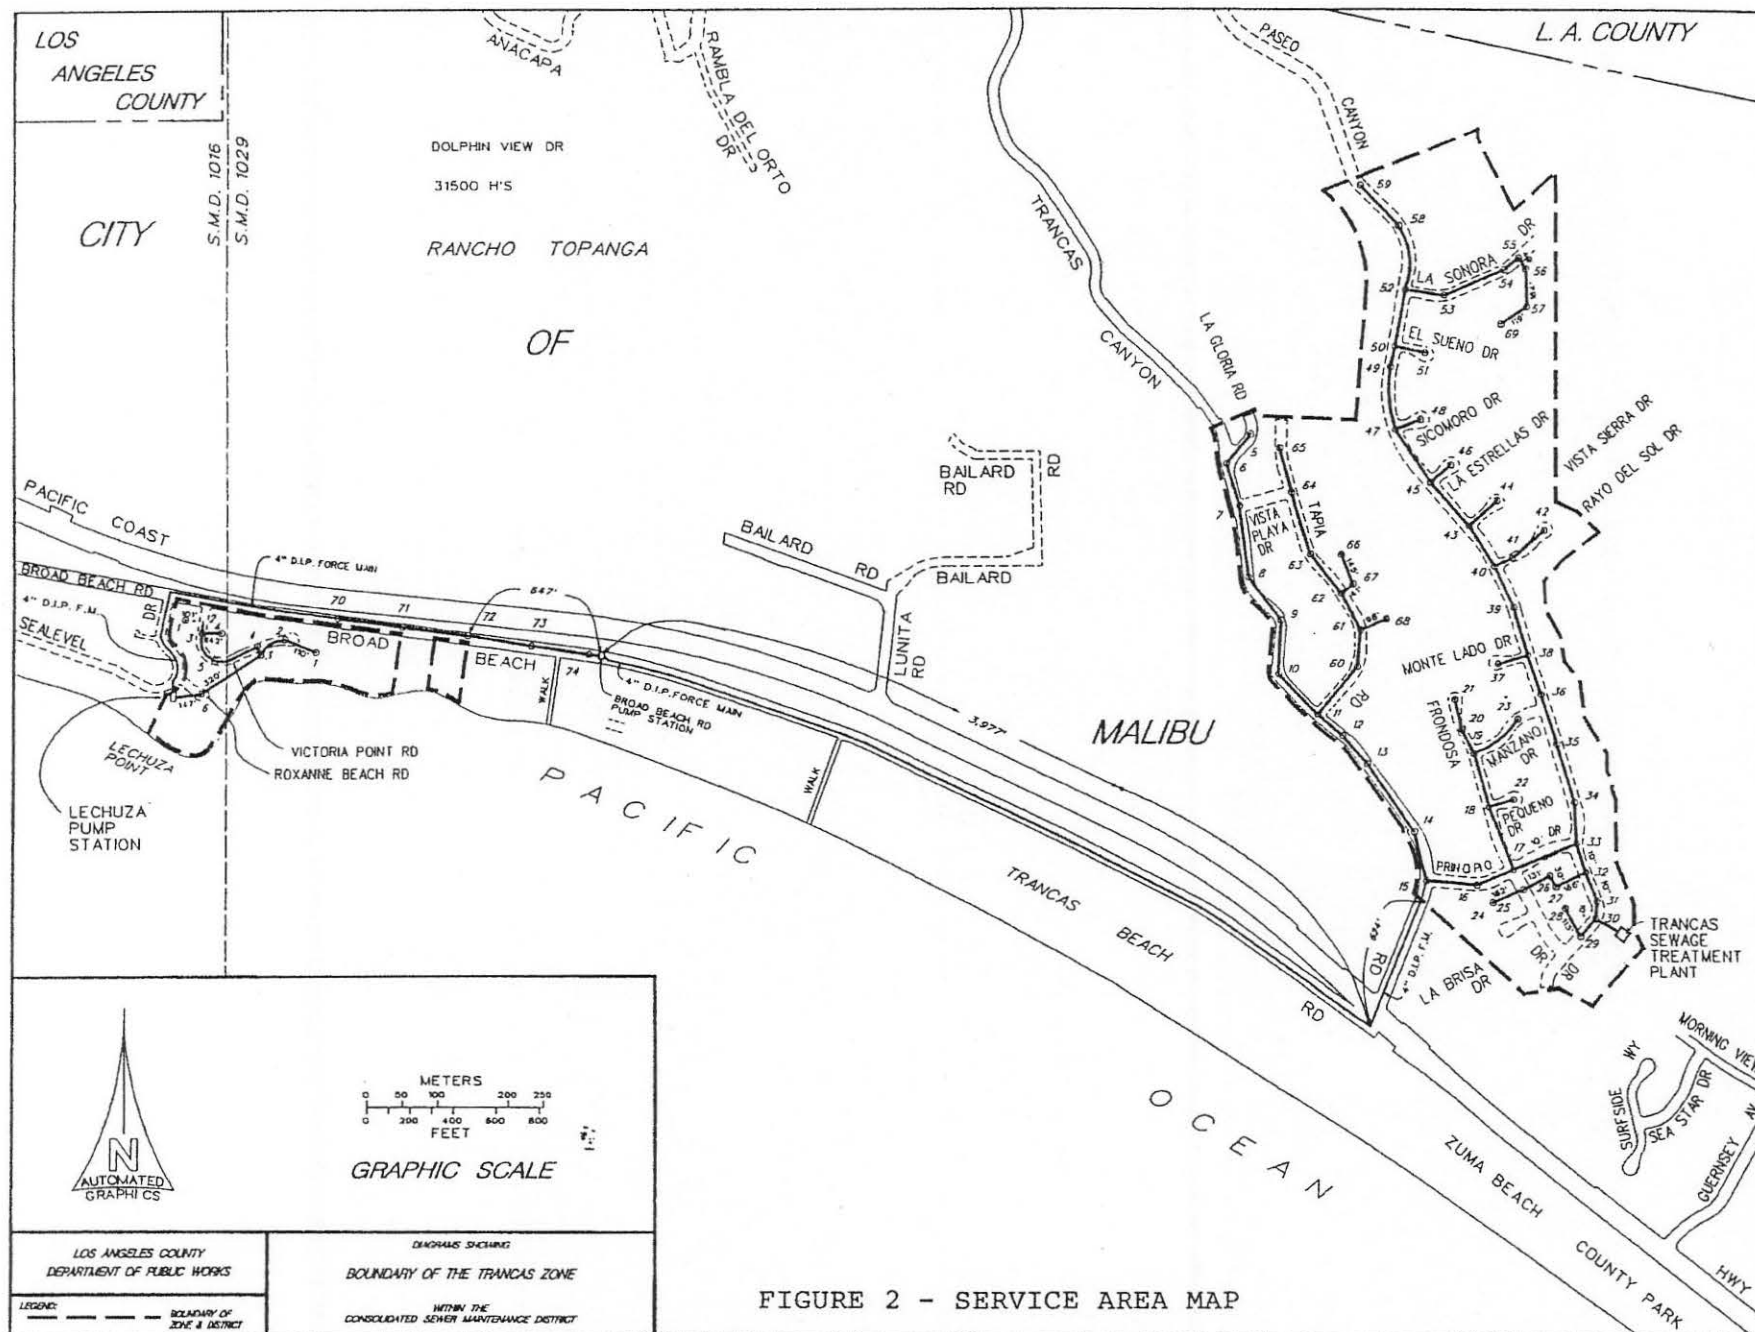


FIGURE 3. TRANCAS WPCP FLOW CHART

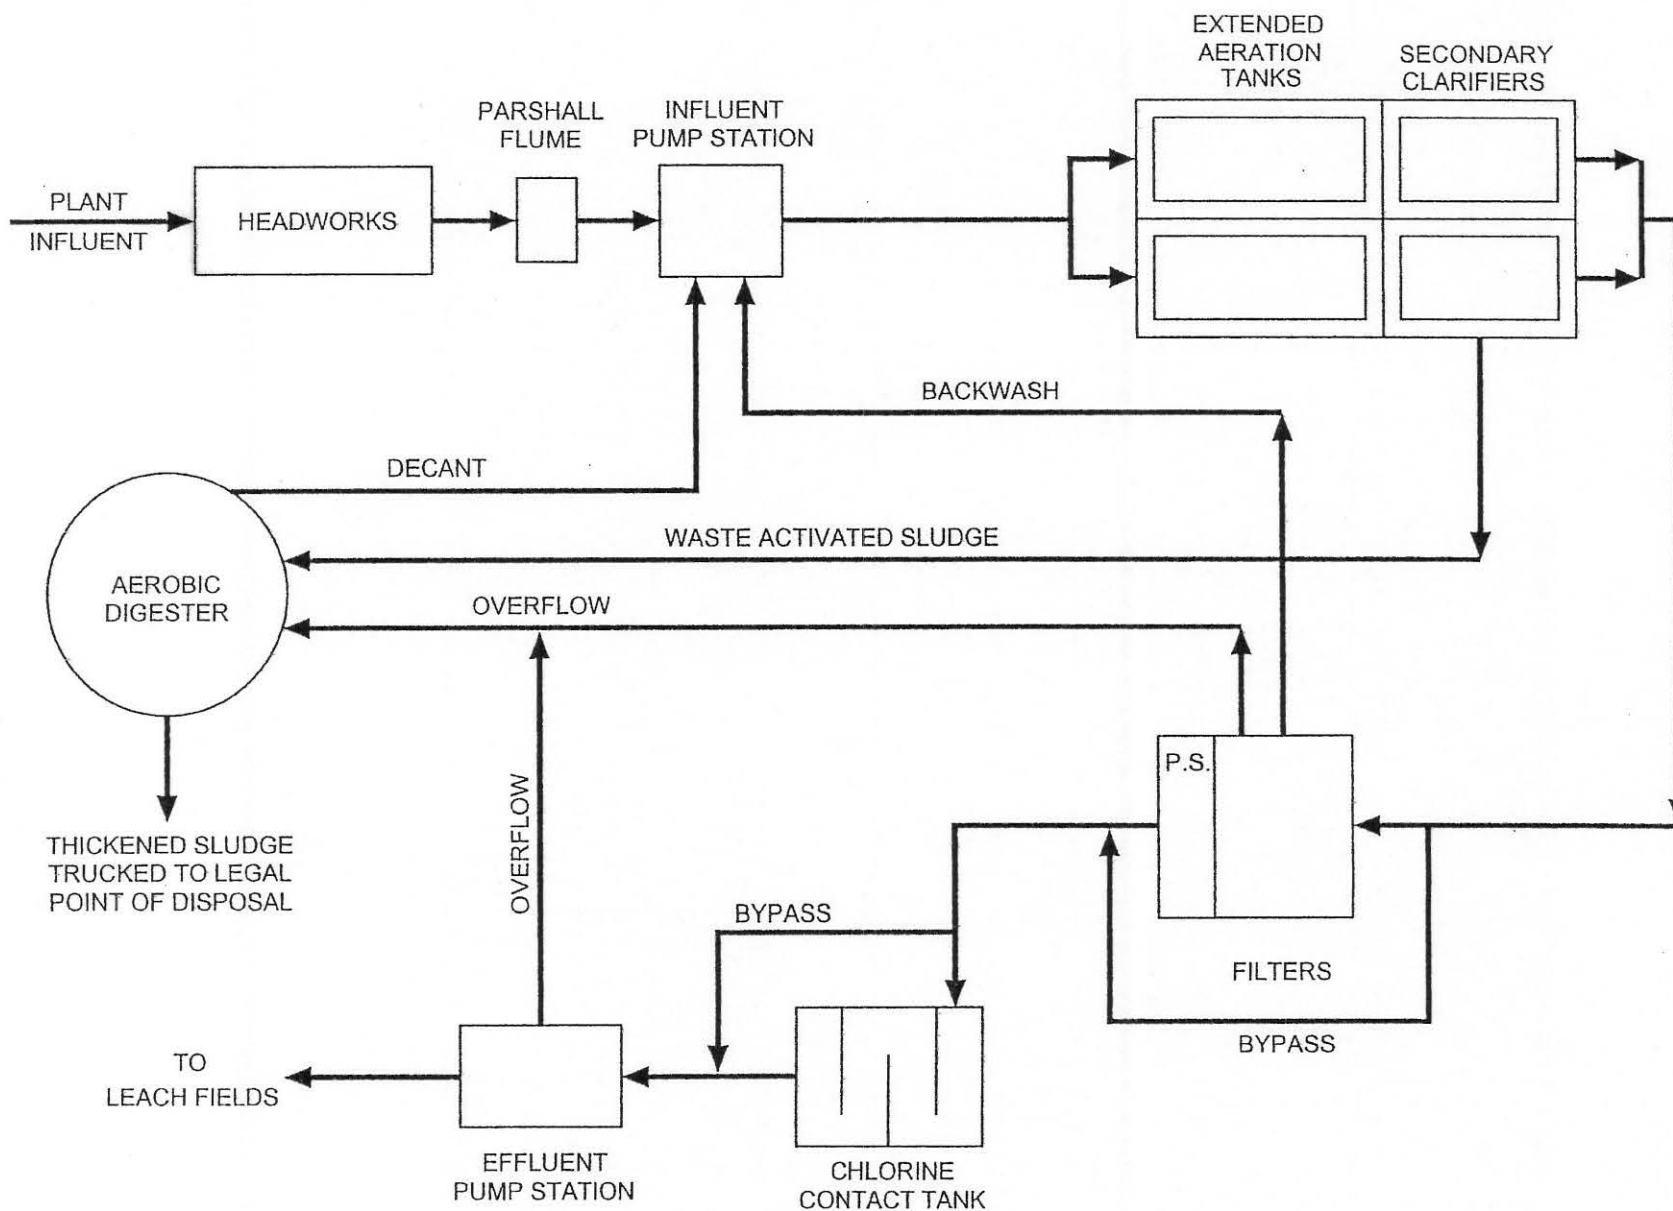

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION**

320 West 4th Street, Suite 200, Los Angeles, California 90013
(213) 576-6660 • Fax (213) 576-6640
<http://www.waterboards.ca.gov/losangeles/>

**MONITORING AND REPORTING PROGRAM CI NO. 3017
FOR
LOS ANGELES COUNTY, DEPARTMENT OF PUBLIC WORKS
TRANCAS WATER POLLUTION CONTROL PLANT
(FILE NO. 61-061)**

This Monitoring and Reporting Program (MRP) CI No. 3017 is issued pursuant to California Water Code section 13267, which authorizes the Regional Water Quality Control Board, Los Angeles Region (Regional Board) to require Los Angeles County, Department of Public Works (hereinafter, Discharger) to submit technical and monitoring reports. The reports required herein are necessary to assure compliance with Waste Discharge Requirements (WDRs) Order No. R4-2014-0188 and to protect the waters of the state and their beneficial uses. The evidence that supports the need for the reports is set forth in the WDRs and the Regional Board Record.

I. SUBMITTAL OF REPORTS

1. The Dischargers shall submit the required reports, set forth in the following paragraphs to the Regional Board. The reports shall be submitted to the Regional Board via GeoTracker database under Global ID WDR100001760 on the dates indicated as follows:
 - A. **Quarterly Monitoring Reports** shall be received at the Regional Board by the 15th day of the second month following the end of each quarterly monitoring period according to Table 1. The first monitoring report under this program shall be received at the Regional Board by February 15, 2015.

Table 1. Reporting Period and Due Dates

Reporting Period	Report Due
January - March	May 15
April - June	August 15
July - September	November 15
October – December	February 15

- B. **Annual Summary Report** shall be received at the Regional Board February 15 of each year. The first Annual Summary Report under this program shall be received at the Regional Board on February 15, 2015.

If there is no discharge during any reporting period, the report shall so state.

2. The Dischargers shall comply with the Electronic Submittal of Information (ESI) requirements by submitting all reports required under the MRP, including electronic data format (EDF) groundwater monitoring data, discharge location data, and pdf monitoring to the State Water Resources Control Board (State Board) GeoTracker database under Global ID WDR100001760.

II. MONITORING REQUIREMENTS

1. Monitoring shall be used to determine compliance with the requirements of this Order and shall include, but not limited to, the following:
 - A. Locations of each groundwater monitoring station where representative samples can be obtained and the rationale for the selection. The Discharger must include a map, at a scale of 1 inch equals 1,200 feet or less, that clearly identifies the locations of all monitoring wells, and production wells.
 - B. Sampling protocols (specified in 40 Code of Federal Regulations (CFR) Part 136 or American Water Works Association (AWWA) standards where appropriate) and chain of custody procedures.
 - C. For groundwater monitoring, outline the methods and procedures to be used for measuring water levels; purging wells; collecting samples; decontaminating equipment; containing, preserving, and shipping samples, and maintaining appropriate documentation. Also include the procedures for handling, storing, testing, and disposing of purge and decontamination waters generated from the sampling events.
 - D. Laboratory or laboratories, which conducted the analyses. Include copy or copies of laboratory certifications by the State Board Environmental Laboratory Accreditation Program (ELAP) every year or when the Discharger changes their contract laboratory.
 - E. Analytical test methods used and the corresponding detection limits for purposes of reporting (DLRs) for unregulated and regulated chemicals. For regulated chemicals, please see the State Board website at:
http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Chemicalcontaminants.shtml
 - F. Quality assurance and control measures.
2. The samples shall be analyzed using analytical methods described in 40 CFR Part 136; or where no methods are specified for a given pollutant, by commercially available methods approved by the Regional Board and/or State Board. The Discharger shall select the analytical methods that provide DLRs lower than the limits prescribed in this Order.
3. The Discharger shall instruct its laboratories to establish calibration standards so that the DLRs (or its equivalent if there is a different treatment of samples relative to calibration standards) are the lowest calibration standard. At no time shall the Discharger use analytical data derived from extrapolation beyond the lowest point of the calibration curve.

4. Upon request by the Discharger, the Regional Board, in consultation with the State Board Quality Assurance Program, may establish DLRs, in any of the following situations:
 - A. When the pollutant has no established method under 40 CFR 136 (revised May 14, 1999, or subsequent revision);
 - B. When the method under 40 CFR 136 for the pollutant has a DLR higher than the limit specified in this Order; or,
 - C. When the Discharger agrees to use a test method that is more sensitive than those specified in 40 CFR Part 136 and is commercially available.
5. Samples of disinfected effluent must be analyzed within allowable holding time limits as specified in 40 CFR Part 136.3. All quality assurance and quality control (QA/QC) analyses must be run on the same dates when samples were actually analyzed. The Discharger shall make available for inspection and/or submit the QA/QC documentation upon request by Regional Board staff. Proper chain of custody procedures must be followed and a copy of that documentation shall be submitted with the quarterly report.
6. For unregulated chemical analyses, the Discharger shall select methods according to the following approach:
 - A. Use drinking water methods, if available;
 - B. Use State Board-recommended methods for unregulated chemicals, if available;
 - C. If there is no State Board-recommended drinking water method for a chemical, and more than a single Environmental Protection Agency (EPA)-approved method is available, use the most sensitive of the EPA-approved methods;
 - D. If there is no EPA-approved method for a chemical, and more than one method is available from the scientific literature and commercial laboratory, after consultation with State Board, use the most sensitive method;
 - E. If no approved method is available for a specific chemical, the Discharger's laboratory may develop or use its own methods and should provide the analytical methods to State Board for review. Those methods may be used until State Board recommended or EPA-approved methods are available.
 - F. If the only method available for a chemical is for wastewater analysis (e.g., a chemical listed as a priority pollutant only), sample and analyze for that chemical in the treated and disinfected effluent immediately increase the likelihood of detection. Use this approach until the Discharger's laboratory develops a method for the chemical in drinking water, or until a State Board-recommended or EPA-approved drinking water method is available.

- G. The Discharger is required to inform the Regional Board, in event that D, E, F is occurring.

III. REPORTING REQUIREMENTS

The Discharger shall submit all reports, shown on Section I SUBMITTAL OF REPORTS to the Regional Board by the dates indicated. All quarterly, and annual monitoring reports shall contain a separate section titled "Summary of Non-Compliance", which discusses the compliance records and corrective actions taken or planned that may be needed to bring the effluent into full compliance with water discharge requirements. This section shall clearly list all non-compliance with WDRs, as well as all excursions of effluent limitations.

1. Quarterly reports

- A. These reports shall include, at a minimum, the following information:
- a. The volume of the final effluent.
 - b. The date and time of sampling and analyses.
 - c. All analytical results of samples collected during the monitoring period of the final effluent and groundwater.
 - d. Records of any operational problems, plant upset and equipment breakdowns or malfunctions, and any discharge(s) of the final effluent.
 - e. Discussion of compliance, noncompliance, or violation of requirements.
 - f. All corrective or preventive action(s) taken or planned with schedule of implementation, if any.
- B. For the purpose of reporting compliance with numerical limitations, analytical data shall be reported using the following reporting protocols:
- a. Sample results greater than or equal to the DLRs must be reported "as measured" by the laboratory (i.e., the measured chemical concentration in the sample); or
 - b. Sample results less than the DLRs, but greater than or equal to the laboratory's method detection limit (MDL), must be reported as "Detected, but Not Quantified", or DNQ. The laboratory must write the estimated chemical concentration of the sample next to DNQ as well as the words "Estimated Concentration" (may be shortened to Est. Conc.); or
 - c. Sample results less than the laboratory's MDL must be reported as "Not-Detected", or ND.

- C. If the Discharger samples and performs analyses (other than for process/operational control, startup, research, or equipment testing) on any sample more frequently than required in this MRP using approved analytical methods, the results of those analyses shall be included in the report. These results shall be reflected in the calculation of the average used in demonstrating compliance with average effluent, receiving groundwater water, etc., limitations.
- D. The Regional Board may request supporting documentation, such as daily logs of operations.

2. Annual Reports

- A. Tabular and graphical summaries of the monitoring data obtained during the previous calendar year.
- B. Discussion of the compliance record and corrective or preventive action(s) taken or planned that may be needed to bring the treated effluent into full compliance with the requirements in this Order.
- C. An in-depth discussion of the results of the groundwater monitoring and final effluent monitoring programs conducted during the previous year.
- D. The description of any changes and anticipated changes including any impacts in operation of any unit processes or facilities shall be provided.
- E. A list of the analytical methods employed for each test and associated laboratory quality assurance/quality control procedures shall be included. The report shall restate, for the record, the laboratories used by the Discharger to monitor compliance with this Order, their status of certification, and provide a summary of performance.
- F. The report shall confirm operator certification and provide a list of current operating personnel, their responsibilities, and their corresponding grade of certification.
- H. The report shall also include the date of the Trancas Water Pollution Control Plant Operation and Maintenance Management Plan, the date the plan was last reviewed, and whether the plan is complete and valid.
- I. The groundwater monitoring portion of the annual report shall be prepared under the direction of an engineer registered in the State of California, or a professional geologist in California. All groundwater monitoring reports must include, at minimum, the following:
 - a. Well identification, date and time of sampling;
 - b. Sampler identification, and laboratory identification; and,

- c. Quarterly observation of groundwater levels, recorded to .01 feet mean sea level, flow direction.

If there is no discharge during any reporting period, the report shall so state.

IV. WATER QUALITY MONITORING REQUIREMENTS

A. INFLUENT MONITORING

1. The Discharger shall measure the monthly average and maximum daily waste flow to the facility.
2. The Discharger shall update the population estimate in the single family homes and condominiums served by the Trancas Water Pollution Control Plant in each annual summary report.

B. WASTEWATER TREATMENT SYSTEM EFFLUENT MONITORING

1. The following shall constitute the effluent monitoring program, specified in Table 2:

Table 2. Effluent Monitoring Program

Constituent	Units ³	Type of Sample	Minimum Frequency ⁴ of Analysis
Total flow ¹	gal/day	recorder	continuous
Turbidity	NTU	recorder	continuous
pH	pH Units	grab	weekly
Temperature	mg/L	grab	weekly
BOD ₅ 20°C ²	mg/L	grab	weekly
Total coliform	MPN/100mL	grab	weekly
Fecal coliform	MPN/100mL	grab	weekly
Enterococcus	MPN/100mL	grab	weekly
Total suspended solids	mg/L	grab	weekly
Residual chlorine	mg/L	grab	weekly
Oil and grease	mg/L	grab	monthly
Ammonia-N	mg/L	grab	monthly
Nitrite-N	mg/L	grab	monthly
Nitrate-N	mg/L	grab	monthly
Organic nitrogen	mg/L	grab	monthly
Total nitrogen ⁵	mg/L	grab	monthly
Total dissolved solids	mg/L	grab	monthly
Sulfate	mg/L	grab	monthly
Chloride	mg/L	grab	monthly
Boron	mg/L	grab	monthly
MBAS ⁶	mg/L	grab	monthly
Phosphorous	mg/L	grab	monthly

Constituent	Units ³	Type of Sample	Minimum Frequency ⁴ of Analysis
Radioactivity ⁷	pCi/L	grab	annually
Priority Pollutants ⁸	µg/L	grab	annually
CECs ⁹	µg/L	grab	annually ¹⁰

¹For those constituents that are continuously monitored the Discharger shall report the minimum, maximum, and daily average values.

²BOD₅20°C=Biochemical oxygen demand

³mg/L=milligrams per liter; µg/L: microgram per liter; °F: degree Fahrenheit; MPN/100mL=most probable number per 100 milliliters; NTU= Nephelometric turbidity units; pCi/L=picocuries per liter.

⁴If any constituent exceeds the limitations contained in Order No. R4-2014-0188, then the frequency of analysis shall increase to monthly for quarterly sampling or weekly for monthly within one week of knowledge of the test results until at least three consecutive test results have been obtained. After which if no constituents exceed the prescribed limits, the frequency of analysis shall revert back to the minimum analysis frequency prescribed.

⁵Total nitrogen= nitrate-N + nitrite-N + ammonia-N + Organic Nitrogen

⁶MBAS=Methylene Blue Active Substances

⁷See Attachment A-2 for list of radionuclides

⁸See Appendix A to 40 CFR, Part 423 for list of priority pollutants

⁹See Attachment B for the list of California Constituents of Emerging Concern (CECs)

¹⁰Effluent monitoring for CECs shall be performed during annually for the first five year of the WDRs adoption, and once every five (5) years thereof.

2. The quarterly reports shall contain the following information:

- Average and maximum daily waste flow (effluent from wastewater treatment system) for each month of the quarter in gallons per day.
- Estimated population served during each month of the reporting period.
- Results of at least monthly observations in the disposal area for any over flow or surfacing of wastes.

3. In addition, the Discharger shall annually inspect the wastewater treatment system, including the disposal area, and submit an operation and maintenance report on the system (See section VI, page T-10).

C. GROUNDWATER MONITORING PROGRAM

The groundwater monitoring program for the Los Angeles County, Department of Public Works disposal system consists of a network of four monitoring wells (MW-2, MW-3, MW-4, and MW-5) installed around the Trancas Water Pollution Control Plant and leachfields.

The following shall constitute the groundwater monitoring program, specified in Table 3:

Table 3. Groundwater Monitoring Program

Constituent	Units ¹	Type of Sample	Minimum Frequency of Analysis
pH	pH Units	grab	Quarterly
Total coliform	MPN/100mL	grab	Quarterly
Fecal coliform	MPN/100mL	grab	Quarterly
Enterococcus	MPN/100mL	grab	Quarterly
BOD ₅ 20°C ²	mg/L	grab	Quarterly
Ammonia-N	mg/L	grab	Quarterly
Nitrate-N	mg/L	grab	Quarterly
Nitrite-N	mg/L	grab	Quarterly
Organic nitrogen	mg/L	grab	Quarterly
Total nitrogen ³	mg/L	grab	Quarterly
Total dissolved solids	mg/L	grab	Quarterly
Sulfate	mg/L	grab	Quarterly
Chloride	mg/L	grab	Quarterly
Boron	mg/L	grab	Quarterly
Residual chlorine	mg/L	grab	Quarterly
Phosphorus	mg/L	grab	Quarterly
MBAS ⁴	mg/L	grab	Quarterly
Priority pollutants ⁵	µg/L	grab	Annually ⁶

¹mg/L=milligrams per liter; MPN/100mL=most probable number per 100 milliliters

²BOD₅ 20°C=Biochemical oxygen demand

³Total nitrogen = nitrate-N + nitrite-N + ammonia-N + Organic Nitrogen

⁴MBAS=Methylene Blue Active Substances

⁵See Appendix A to 40 CFR, Part 423 for list of priority pollutants

⁶Groundwater monitoring for priority pollutants shall be performed annually during the first five years of the WDRs adoption, and once every five (5) years thereafter

All groundwater monitoring reports must include, at minimum, the following:

- Well identification, date and time of sampling;
- Sampler identification, and laboratory identification;
- Quarterly measurement of groundwater levels, recorded to 0.01 feet mean sea level;
- Water temperature;
- An assessment of the hydraulic connection, if any, between the disposal areas, groundwater and surface water; and
- Groundwater contour map depicting the direction of groundwater flow across the subject facility.

D. SURFACE WATER MONITORING

The surface water monitoring program for the Los Angeles County, Department of Public Works consists of four monitoring stations (SW-1A or SW-1B, SW-2, and SW-3).

The following shall constitute the surface water monitoring program, specified in Table 4:

Table 4. Surface Water Monitoring Program

Constituent	Units ¹	Type of Sample	Minimum Frequency of Analysis
pH	pH units	grab	Quarterly
Total coliform	MPN/100mL	grab	Quarterly
Fecal coliform	MPN/100mL	grab	Quarterly
Enterococcus	MPN/100mL	grab	Quarterly
BOD ₅ 20°C ²	mg/L	grab	Quarterly
Ammonia-N	mg/L	grab	Quarterly
Nitrate-N	mg/L	grab	Quarterly
Nitrite-N	mg/L	grab	Quarterly
Organic nitrogen	mg/L	grab	Quarterly
Total nitrogen ³	mg/L	grab	Quarterly
Residual chlorine	mg/L	grab	Quarterly
Phosphorus	mg/L	grab	Quarterly
Surfactants	mg/L	grab	Quarterly
Total dissolved solids	mg/L	grab	Quarterly
Sulfate	mg/L	grab	Quarterly
Chloride	mg/L	grab	Quarterly
Boron	mg/L	grab	Quarterly

¹mg/L=milligrams per liter; MPN/100mL=most probable number per 100 milliliters

²BOD₅ 20°C=Biochemical oxygen demand

³Total nitrogen= nitrate-N + nitrite-N + ammonia-N + Organic Nitrogen

The surface water monitoring and reporting must include the following information:

- Sample Location, including date and time sampled;
- Sampler identification and laboratory used;
- Water temperature;
- Water elevation with respect to mean sea level; and
- An assessment of the hydraulic connection, if any, between the disposal areas and surface water.

V. WASTE HAULING REPORTING

In the event that waste sludge, septage, or other wastes are hauled offsite, the name and address of the hauler shall be reported, along with types and quantities hauled during the reporting period and the location of final point of disposal. In the event that no wastes are hauled during the reporting period, a statement to that effect shall be submitted.

VI. OPERATION AND MAINTENANCE REPORT

The Discharger shall annually submit a technical report to the Executive Officer relative to the operation and maintenance program for the wastewater treatment system and disposal site at the Los Angeles County, Department of Public Works – Trancas Water Pollution Control Plant. The information to be contained in the report shall include the following:

- a. Results of annual inspection;
- b. The name of the person responsible for the operation and maintenance of the facility;
- c. The maintenance records for the wastewater treatment system;
- b. Type of maintenance (preventive or corrective action performed);
- c. Frequency of maintenance, if preventive;
- e. Maintenance record of leachfields disposal system; and
- f. Results of at least monthly observations in the disposal area for any overflow or surfacing of waste.

This operations and maintenance record shall be kept current and filed with the annual report due by February 15.

VII. MONITORING FREQUENCIES

Specifications in this monitoring program are subject to periodic revisions. Monitoring requirements may be modified or revised by the Executive Officer based on review of monitoring data submitted pursuant to this Order. Monitoring frequencies may be adjusted to a less frequent basis or parameters and locations dropped by the Executive Officer if the Discharger makes a request and the request is backed by statistical trends of monitoring data submitted.

VIII. ELECTRONIC SUBMITTAL OF INFORMATION

The Discharger shall comply with the Electronic Submittal of Information (ESI) requirements by submitting all reports required under the MRP, including discharge location data, and pdf monitoring reports to the State Water Resources Control Board GeoTracker database under Global ID WDR100001760.

IX. CERTIFICATION STATEMENT

Each report shall contain the following completed declaration:

"I certify under penalty of law that this document, including all attachments and supplemental information, was prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including

the possibility of a fine and imprisonment.

Executed on the ____ day of _____ at _____.

(Signature)

(Title)"

These records and reports are public documents and shall be made available for inspection during normal business hours at the office of the California Regional Water Quality Control Board, Los Angeles Region.

Ordered by: Samuel Unger
Samuel Unger, PE
Executive Officer

Date: September 11, 2014

Appendix A to 40 CFR, Part 423--126 Priority Pollutants

001 Acenaphthene	047 Bromoform (tribromomethane)	090 Dieldrin
002 Acrolein	048 Dichlorobromomethane	091 Chlordane (technical mixture and metabolites)
003 Acrylonitrile	051 Chlorodibromomethane	092 4,4-DDT
004 Benzene	052 Hexachlorobutadiene	093 4,4-DDE (p,p-DDX)
005 Benzidine	053 Hexachloromyclopentadiene	094 4,4-DDD (p,p-TDE)
006 Carbon tetrachloride (tetrachloromethane)	054 Isophorone	095 Alpha-endosulfan
007 Chlorobenzene	055 Naphthalene	096 Beta-endosulfan
008 1,2,4-trichlorobenzene	056 Nitrobenzene	097 Endosulfan sulfate
009 Hexachlorobenzene	057 2-nitrophenol	098 Endrin
010 1,2-dichloroethane	058 4-nitrophenol	099 Endrin aldehyde
011 1,1,1-trichloroethane	059 2,4-dinitrophenol	100 Heptachlor
012 Hexachloroethane	060 4,6-dinitro-o-cresol	101 Heptachlor epoxide (BHC-hexachlorocyclohexane)
013 1,1-dichloroethane	061 N-nitrosodimethylamine	102 Alpha-BHC
014 1,1,2-trichloroethane	062 N-nitrosodiphenylamine	103 Beta-BHC
015 1,1,2,2-tetrachloroethane	063 N-nitrosodi-n-propylamin	104 Gamma-BHC (lindane)
016 Chloroethane	064 Pentachlorophenol	105 Delta-BHC (PCB-polychlorinated biphenyls)
018 Bis(2-chloroethyl) ether	065 Phenol	106 PCB-1242 (Arochlor 1242)
019 2-chloroethyl vinyl ether (mixed)	066 Bis(2-ethylhexyl) phthalate	107 PCB-1254 (Arochlor 1254)
020 2-chloronaphthalene	067 Butyl benzyl phthalate	108 PCB-1221 (Arochlor 1221)
021 2,4, 6-trichlorophenol	068 Di-N-Butyl Phthalate	109 PCB-1232 (Arochlor 1232)
022 Parachlorometa cresol	069 Di-n-octyl phthalate	110 PCB-1248 (Arochlor 1248)
023 Chloroform (trichloromethane)	070 Diethyl Phthalate	111 PCB-1260 (Arochlor 1260)
024 2-chlorophenol	071 Dimethyl phthalate	112 PCB-1016 (Arochlor 1016)
025 1,2-dichlorobenzene	072 1,2-benzanthracene (benzo(a) anthracene)	113 Toxaphene
026 1,3-dichlorobenzene	073 Benzo(a)pyrene (3,4-benzo-pyrene)	114 Antimony
027 1,4-dichlorobenzene	074 3,4-Benzofluoranthene (benzo(b) fluoranthene)	115 Arsenic
028 3,3-dichlorobenzidine	075 11,12-benzofluoranthene (benzo(b) fluoranthene)	116 Asbestos
029 1,1-dichloroethylene	076 Chrysene	117 Beryllium
030 1,2-trans-dichloroethylene	077 Acenaphthylene	118 Cadmium
031 2,4-dichlorophenol	078 Anthracene	119 Chromium
032 1,2-dichloropropane	079 1,12-benzoperylene (benzo(ghi) perylene)	120 Copper
033 1,2-dichloropropylene (1,3-dichloropropene)	080 Fluorene	121 Cyanide, Total
034 2,4-dimethylphenol	081 Phenanthrene	122 Lead
035 2,4-dinitrotoluene	082 1,2,5,6-dibenzanthracene (dibenzo(h) anthracene)	123 Mercury
036 2,6-dinitrotoluene	083 Indeno (1,2,3-cd) pyrene (2,3-o-pheynylene pyrene)	124 Nickel
037 1,2-diphenylhydrazine	084 Pyrene	125 Selenium
038 Ethylbenzene	085 Tetrachloroethylene	126 Silver
039 Fluoranthene	086 Toluene	127 Thallium
040 4-chlorophenyl phenyl ether	087 Trichloroethylene	126 Silver
041 4-bromophenyl phenyl ether	088 Vinyl chloride (chloroethylene)	128 Zinc
042 Bis(2-chloroisopropyl) ether	089 Aldrin	129 2,3,7,8-tetrachloro-dibenzo-p-dioxin (TCDD)
043 Bis(2-chloroethoxy) methane		
044 Methylene chloride (dichloromethane)		
045 Methyl chloride (dichloromethane)		
046 Methyl bromide (bromomethane)		

ATTACHMENT B

Parameter	Units
17 α -Ethinyl Estradiol	ng/L
17 β -Estradiol	ng/L
Estrone	ng/L
Bisphenol A	ng/L
Nonylphenol and nonylphenol polyethoxylates	ng/L
Octylphenol and octylphenol polyethoxylates	ng/L
Polybrominated diphenyl ethers	ng/L
Acetaminophen	ng/L
Amoxicillin	ng/L
Azithromycin	ng/L
Carbamazepine	ng/L
Caffeine	ng/L
Ciprofloxacin	ng/L
DEET	ng/L
Dilantin	ng/L
Gemfibrozil	ng/L
Ibuprofen	ng/L
Lipitor	ng/L
Primidone	ng/L
Sulfamethoxazole	ng/L
Trimethoprim	ng/L
Salicylic acid	ng/L
TCEP	ng/L
Triclosan	ng/L

STANDARD PROVISIONS
APPLICABLE TO WASTE DISCHARGE REQUIREMENTS

1. DUTY TO COMPLY

The discharger must comply with all conditions of these waste discharge requirements. A responsible party has been designated in the Order for this project, and is legally bound to maintain the monitoring program and permit. Violations may result in enforcement actions, including Regional Board orders or court orders requiring corrective action or imposing civil monetary liability, or in modification or revocation of these waste discharge requirements by the Regional Board. [CWC Section 13261, 13263, 13265, 13268, 13300, 13301, 13304, 13340, 13350]

2. GENERAL PROHIBITION

Neither the treatment nor the discharge of waste shall create a pollution, contamination or nuisance, as defined by Section 13050 of the California Water Code (CWC). [H&SC Section 5411, CWC Section 13263]

3. AVAILABILITY

A copy of these waste discharge requirements shall be maintained at the discharge facility and be available at all times to operating personnel. [CWC Section 13263]

4. CHANGE IN OWNERSHIP

The discharger must notify the Executive Officer, in writing at least 30 days in advance of any proposed transfer of this Order's responsibility and coverage to a new discharger containing a specific date for the transfer of this Order's responsibility and coverage between the current discharger and the new discharger. This agreement shall include an acknowledgement that the existing discharger is liable for violations up to the transfer date and that the new discharger is liable from the transfer date on. [CWC Sections 13267 and 13263]

5. CHANGE IN DISCHARGE

In the event of a material change in the character, location, or volume of a discharge, the discharger shall file with this Regional Board a new Report of Waste Discharge. [CWC Section 13260(c)]. A material change includes, but is not limited to, the following:

- (a) Addition of a major industrial waste discharge to a discharge of essentially domestic sewage, or the addition of a new process or product by an industrial facility resulting in a change in the character of the Waste.
- (b) Significant change in disposal method, e.g., change from a land disposal to a direct discharge to water, or change in the method of treatment which would significantly alter the characteristics of the waste.

Standard Provisions Applicable to
Waste Discharge Requirements

- (c) Significant change in the disposal area, e.g., moving the discharge to another drainage area, to a different water body, or to a disposal area significantly removed from the original area potentially causing different water quality or nuisance problems.
- (d) Increase in flow beyond that specified in the waste discharge requirements.
- (e) Increase in the area or depth to be used for solid waste disposal beyond that specified in the waste discharge requirements. [CCR Title 23 Section 2210]

6. REVISION

These waste discharge requirements are subject to review and revision by the Regional Board. [CCR Section 13263]

7. TERMINATION

Where the discharger becomes aware that it failed to submit any relevant facts in a Report of Waste Discharge or submitted incorrect information in a Report of Waste Discharge or in any report to the Regional Board, it shall promptly submit such facts or information. [CWC Sections 13260 and 13267]

8. VESTED RIGHTS

This Order does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to persons or property, do not protect the discharger from his liability under Federal, State or local laws, nor do they create a vested right for the discharger to continue the waste discharge. [CWC Section 13263(g)]

9. SEVERABILITY

Provisions of these waste discharge requirements are severable. If any provisions of these requirements are found invalid, the remainder of the requirements shall not be affected. [CWC Section 921]

10. OPERATION AND MAINTENANCE

The discharger shall, at all times, properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the discharger to achieve compliance with conditions of this Order. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training, and adequate laboratory and process controls including appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of this Order. [CWC Section 13263(f)]

Standard Provisions Applicable to
Waste Discharge Requirements

11. HAZARDOUS RELEASES

Except for a discharge which is in compliance with these waste discharge requirements, any person who, without regard to intent or negligence, causes or permits any hazardous substance or sewage to be discharged in or on any waters of the State, or discharged or deposited where it is, or probably will be, discharged in or on any waters of the State, shall, as soon as (a) that person has knowledge of the discharge, (b) notification is possible, and (c) notification can be provided without substantially impeding cleanup or other emergency measures, immediately notify the Office of Emergency Services of the discharge in accordance with the spill reporting provision of the State toxic disaster contingency plan adopted pursuant to Article 3.7 (commencing with Section 8574.7) of Chapter 7 of Division 1 of Title 2 of the Government Code, and immediately notify the State Board or the appropriate Regional Board of the discharge. This provision does not require reporting of any discharge of less than a reportable quantity as provided for under subdivisions (f) and (g) of Section 13271 of the Water Code unless the discharger is in violation of a prohibition in the applicable Water Quality Control plan. [CWC Section 1327(a)]

12. PETROLEUM RELEASES

Except for a discharge which is in compliance with these waste discharge requirements, any person who without regard to intent or negligence, causes or permits any oil or petroleum product to be discharged in or on any waters of the State, or discharged or deposited where it is, or probably will be, discharged in or on any waters of the State, shall, as soon as (a) such person has knowledge of the discharge, (b) notification is possible, and (c) notification can be provided without substantially impeding cleanup or other emergency measures, immediately notify the Office of Emergency Services of the discharge in accordance with the spill reporting provision of the State oil spill contingency plan adopted pursuant to Article 3.5 (commencing with Section 8574.1) of Chapter 7 of Division 1 of Title 2 of the Government Code. This provision does not require reporting of any discharge of less than 42 gallons unless the discharge is also required to be reported pursuant to Section 311 of the Clean Water Act or the discharge is in violation of a prohibition in the applicable Water Quality Control Plan. [CWC Section 13272]

13. ENTRY AND INSPECTION

The discharger shall allow the Regional Board, or an authorized representative upon the presentation of credentials and other documents as may be required by law, to:

- (a) Enter upon the discharger's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this Order;
- (b) Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order;

Standard Provisions Applicable to
Waste Discharge Requirements

- (c) Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
- (d) Sample or monitor at reasonable times, for the purposes of assuring compliance with this Order, or as otherwise authorized by the California Water Code, any substances or parameters at any location. [CWC Section 13267]

14. MONITORING PROGRAM AND DEVICES

The discharger shall furnish, under penalty of perjury, technical monitoring program reports; such reports shall be submitted in accordance with specifications prepared by the Executive Officer, which specifications are subject to periodic revisions as may be warranted. [CWC Section 13267]

All monitoring instruments and devices used by the discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year, or more frequently, to ensure continued accuracy of the devices. Annually, the discharger shall submit to the Executive Office a written statement, signed by a registered professional engineer, certifying that all flow measurement devices have been calibrated and will reliably achieve the accuracy required.

Unless otherwise permitted by the Regional Board Executive officer, all analyses shall be conducted at a laboratory certified for such analyses by the State Department of Health Services. The Regional Board Executive Officer may allow use of an uncertified laboratory under exceptional circumstances, such as when the closest laboratory to the monitoring location is outside the State boundaries and therefore not subject to certification. All analyses shall be required to be conducted in accordance with the latest edition of "Guidelines Establishing Test Procedures for Analysis of Pollutants" [40CFR Part 136] promulgated by the U.S. Environmental Protection Agency. [CCR Title 23, Section 2230]

TREATMENT FAILURE

In an enforcement action, it shall not be a defense for the discharger that it would have been necessary to halt or to reduce the permitted activity in order to maintain compliance with this Order. Upon reduction, loss, or failure of the treatment facility, the discharger shall, to the extent necessary to maintain compliance with this Order, control production or all discharges, or both, until the facility is restored or an alternative method of treatment is provided. This provision applies, for example, when the primary source of power of the treatment facility fails, is reduced, or is lost. [CWC Section 13263(f)]

15. DISCHARGE TO NAVIGABLE WATERS

Any person discharging or proposing to discharge to navigable waters from a point source (except for discharge of dredged or fill material subject to Section 404 of the

Standard Provisions Applicable to Waste Discharge Requirements

Clean Water Act and discharge subject to a general NPDES permit) must file an NPDES permit application with the Regional Board. [CCR Title 2 Section 22357]

16. ENDANGERMENT TO HEALTH AND ENVIRONMENT

The discharger shall report any noncompliance which may endanger health or the environment. Any such information shall be provided verbally to the Executive Officer within 24 hours from the time the discharger becomes aware of the circumstances. A written submission shall also be provided within five days of the time the discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance. The Executive officer, or an authorized representative, may waive the written report on a case-by-case basis if the oral report has been received within 24 hours. The following occurrence(s) must be reported to the Executive Office within 24 hours:

- (a) Any bypass from any portion of the treatment facility.
- (b) Any discharge of treated or untreated wastewater resulting from sewer line breaks, obstruction, surcharge or any other circumstances.
- (c) Any treatment plan upset which causes the effluent limitation of this Order to be exceeded. [CWC Sections 13263 and 13267]

17. MAINTENANCE OF RECORDS

The discharger shall retain records of all monitoring information including all calibration and maintenance records, all original strip chart recordings for continuous monitoring instrumentation, copies off all reports required by this Order, and record of all data used to complete the application for this Order. Records shall be maintained for a minimum of three years from the date of the sample, measurement, report, or application. This period may be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Board Executive Officer.

Records of monitoring information shall include:

- (a) The date, exact place, and time of sampling or measurement;
- (b) The individual(s) who performed the sampling or measurement;
- (c) The date(s) analyses were performed;
- (d) The individual(s) who performed the analyses;
- (e) The analytical techniques or method used; and

Standard Provisions Applicable to
Waste Discharge Requirements

- (f) The results of such analyses.
18. (a) All application reports or information to be submitted to the Executive Office shall be signed and certified as follows:
- (1) For a corporation – by a principal executive officer or at least the level of vice president.
 - (2) For a partnership or sole proprietorship – by a general partner or the proprietor, respectively.
 - (3) For a municipality, state, federal, or other public agency – by either a principal executive officer or ranking elected official.
- (b) A duly authorized representative of a person designated in paragraph (a) of this provision may sign documents if:
- (1) The authorization is made in writing by a person described in paragraph (a) of this provision.
 - (2) The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
 - (3) The written authorization is submitted to the Executive Officer.

Any person signing a document under this Section shall make the following certification:

“I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment. [CWC Sections 13263, 13267, and 13268]”

19. OPERATOR CERTIFICATION

Supervisors and operators of municipal wastewater treatment plants and privately owned facilities regulated by the PUC, used in the treatment or reclamation of sewage and industrial waste shall possess a certificate of appropriate grade in accordance with Title 23, California Code of Regulations Section 3680. State Boards may accept experience in lieu of qualification training. In lieu of a properly certified wastewater treatment plant operator, the State Board may approve use of a water treatment plant operator of appropriate grade certified by the State Department of Health Services where reclamation is involved.

Standard Provisions Applicable to
Waste Discharge Requirements

Each plant shall be operated and maintained in accordance with the operation and maintenance manual prepared by the municipality through the Clean Water Grant Program [CWC Title 23, Section 2233(d)]

ADDITIONAL PROVISIONS APPLICABLE TO
PUBLICLY OWNED TREATMENT WORKS' ADEQUATE CAPACITY

20. Whenever a publicly owned wastewater treatment plant will reach capacity within four years the discharger shall notify the Regional Board. A copy of such notification shall be sent to appropriate local elected officials, local permitting agencies and the press. The discharger must demonstrate that adequate steps are being taken to address the capacity problem. The discharger shall submit a technical report to the Regional Board showing flow volumes will be prevented from exceeding capacity, or how capacity will be increased, within 120 days after providing notification to the Regional Board, or within 120 days after receipt of notification from the Regional Board, of a finding that the treatment plant will reach capacity within four years. The time for filing the required technical report may be extended by the Regional Board. An extension of 30 days may be granted by the Executive Officer, and longer extensions may be granted by the Regional Board itself. [CCR Title 23, Section 2232]