

Central Coast Regional Water Quality Control Board

May 31, 2023

Sent Via Electronic Mail

Peter Sevcik
Nipomo Community Services District
Blacklake Water Reclamation Facility
PO Box 326
Nipomo, CA 93444
Email: psevcik@ncsd.ca.gov

Dear Peter Sevcik,

BLACKLAKE WATER RECLAMATION FACILITY, 1400 WILLOW ROAD, NIPOMO, CA 93444, SAN LUIS OBISPO COUNTY:

- **NOTICE OF APPLICABILITY FOR NIPOMO COMMUNITY SERVICES DISTRICT'S ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2023-0022**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. 94-14**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200, May 2022 Report of Waste Discharge (received on May 27, 2022), and available documents associated with the domestic wastewater treatment system at Blacklake Water Reclamation Facility (Blacklake WRF) owned by Nipomo Community Services District (Nipomo CSD). The wastewater system is currently regulated pursuant to *Order No. 94-14, Water Reclamation Requirements for Nipomo Community Services District, Black Lake Reclamation Facility* (Order No. 94-14). On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 94-14.

This letter serves as a notice of applicability for Nipomo CSD's enrollment in the General Permit for the discharge of wastewater from the Blacklake WRF.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Nipomo CSD must comply with the following:

1. **General Permit** –Nipomo CSD must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Nipomo CSD must comply with the requirements of Monitoring and Reporting Program No. R3-2023-0022, enclosed with this letter (Attachment 3). Nipomo CSD must start implementing the monitoring on June 1 2023. Your first semiannual report is due on **August 1, 2023**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Nipomo CSD must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100033575 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

3. **Fees** – Nipomo CSD paid an annual fee on December 21, 2022, for coverage in the existing individual permit, Order No. 94-14. This payment covers permit fees for the 2022-2023 fiscal year.

Nipomo CSD must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$7,770. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 3B.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on August 24-25, 2023. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Nipomo CSD is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Nipomo CSD to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Nipomo CSD must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Certified Operator** – Nipomo CSD is required to comply with the operator certification requirements³ administered by the State Water Board's Office of

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Operator Certification, which currently requires a Class I certified operator onsite to maintain and operate the treatment system.

- 9. Termination of Permit** – The existing individual permit, Order No. 94-14, is terminated, except for enforcement purposes. Nipomo CSD is responsible for compliance with Order No. 94-14 prior to the date of this letter.

If you have any questions, please contact **Rachel Hohn at (805) 542-4789 or by email at Rachel.Hohn@waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program No. R3-2023-0022

cc:

Francisco Maldonado, Nipomo Community Services District, fmaldonado@ncsd.ca.gov
Cheryl Journey, SLO County, cjourney@co.slo.ca.us
Jesse Woodard, Jesse.Woodard@waterboards.ca.gov
Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov
Rachel Hohn, Rachel.Hohn@Waterboards.ca.gov
James Bishop, James.Bishop@Waterboards.ca.gov
WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-244360

GeoTracker No. = GT- WDR100033575

Rev 6/16/22

Subject Name = Nipomo CSD Blacklake Wastewater Permit

R:\RB3\Shared\WDR\WDR Facilities\San Luis Obispo Co\Nipomo\Nipomo Black Lake WRF\enrollment in 2014-0153\0153 enrollment

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Nipomo CSD to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Blacklake Water Reclamation Facility
Facility Address	1400 Willow Road Nipomo, CA 93444
Parcel Numbers	091-411-026
Latitude/Longitude	35.047806/-120.544625
Onsite Manager	Francisco Maldonado
Owner of Facility	Nipomo Community Services District
Legally Responsible Official or Owner	Peter Savcik
Owner Mailing Address	PO Box 326 Nipomo, CA 93444
Billing Address	PO Box 326 Nipomo, CA 93444
Design/Permitted Flow (max average monthly, gpd)	100,000
Baseline Flow (average annual flow) in gpd	46,000
Operators	Francisco Maldonado, 41275, Grade III
Waste type and Service Area	Domestic wastewater from 555 residential and 4 commercial connections.
Threat to Water Quality	3
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater

Regulatory measure Type	Enrollee - WDR
Reclamation Included	Yes
EPA Approved Pretreatment Program	No

An unnamed intermittent stream is the nearest surface waterbody and is located approximately half a mile from the Blacklake WRF. This stream meets Black Lake approximately 3 miles west of the Blacklake WRF.

First-encountered groundwater is approximately 200 feet below ground surface.

2. WASTEWATER SYSTEM OPERATION SUMMARY

The Blacklake WRF is a Class I Aerated Pond System. The treatment system is composed of conveyance piping, lift stations, solids screening, aerated ponds, chlorine contact chambers, and an effluent storage pond. The system is described in detail below and a summary is included in Table 2. A facility site map and dispersal system layout are shown in Attachment 2.

A 12-inch influent PVC gravity sewer line delivers sewage to the plant. Flow is divided over two parallel comminutors. The comminutors are designed to grind large solids that pass through a bar screen and are operated continuously. If one or both comminutors becomes clogged or is out of services, water level will rise in the influent channel and flow over a slide gate into a bypass channel containing a manual bar screen.

Wastewater flows by gravity through an 8-inch pipe from the headworks to the aerated ponds. Aerated ponds provide both primary and secondary treatment. The three HDPE-lined partially-mixed aerated ponds are operated in series. The ponds contain splash-type aerators. Water levels are controlled at a depth of 9.5 feet utilizing an effluent weir in the third pond.

An 8-inch SDR-35 PVC pipeline carries flow from the Pond 3 effluent weir box to the chlorine contact basin for disinfection. Treated wastewater is reused for irrigation at the adjacent golf course. A chlorine solution is injected into the mixing chamber and mixed with an air sparger. Flow can then be split into two chlorine contact basins. Each contact chamber is baffled and designed for a minimum of 20 minutes contact time at 200,000 gpd, to provide redundancy during peak flows. The effluent flow rate is measured at the end of each contact basin with a v-notch flume flow meter. Each contact chamber has a dedicated flow meter. Grab samples are collected and analyzed to measure chlorine levels.

Although Nipomo Blacklake CSD was not required to monitor influent flows per Order No. 94-14, the General Permit requires influent flow monitoring. Flow rate of wastewater discharged to the headworks must not exceed 100,000 gpd as a monthly average. The

Central Coast Water Board understand that the district will need to install influent flow meters or demonstrate how influent flow does not exceed a monthly average of 100,000 gpd.

Sludge is dewatered onsite with a portable centrifuge and the biosolids are hauled offsite to Liberty Composting, Inc., in Lost Hills, CA. The facility has not dewatered and removed biosolids since 2019 when 338 tons of sludge were removed from Aerated Pond #2 and 93 tons of sludge were removed from Aerated Pond #3.

Table 2. Permitted Pond Treatment & Disposal Technologies and Capacity

Permitted Design Flows	Influent Monthly Average Flow - 100,000 gallons per day Influent Maximum Daily Flow - 200,000 gallons per day
Headworks/Preliminary Treatment	Two parallel comminutors grind large solids. If one or both comminutors becomes clogged or is out of services, wastewater flows over a slide gate into a bypass channel containing a manual bar screen.
Treatment	Aerated ponds provide both primary and secondary treatment. Treatment consists of three partially-mixed aeration ponds with splashers- type aerators.
Disinfection	Two chlorine contact basins designed for a minimum of 20 minutes contact time at 200,000 gpd, to provide redundancy during peak flows
Effluent Storage	Effluent is pumped to a lined effluent storage pond and used as irrigation for a golf course. Off spec water is recirculated back into the treatment ponds.
Disposal	Effluent is used to irrigate approximately 45 acres of Blacklake Golf Resort.
Biosolids/Sludge Production and Handling	Sludge is dewatered onsite with a portable centrifuge and the biosolids are hauled offsite to Liberty Composting, Inc., in Lost Hills, CA.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Nipomo CSD must operate the facility in accordance with the General Permit⁴ and this notice of applicability.⁵ Nipomo CSD must comply with the site-specific limits listed in Table 3.

⁴ General Permit sections B.2, B.4, and B.6 are not applicable for this facility.

⁵ General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

Table 3. Wastewater Limits for Blacklake WRF

Constituent	Unit	Limit	Point of Compliance ¹
Flow	gpd	100,000 (average daily flow) ¹	Influent (IS-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90 (monthly average)	Effluent manhole (ES-1)
Total N	% Influent versus Effluent	50% Removal ²	Effluent manhole (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

² The value represents the minimum percent reduction compared to the untreated wastewater value. Reduction must be calculated each time total nitrogen is sampled.

4. GROUNDWATER LIMITS

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Nipomo CSD must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁶ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) Specific objectives for the groundwater basin where the discharge occurs. This facility discharges into the Santa Maria River Valley—Lower Nipomo Mesa, and those Basin Plan's groundwater objectives are included in Table 4.

⁶ Current edition, June 2019 is available at:

https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

Table 4. Basin Plan, Median Groundwater Objectives (mg/L)

Constituent	Median Groundwater Objectives for Lower Nipomo Mesa
Total Dissolved Solids (TDS)	710
Chloride	95
Sulfate	250
Boron	0.15
Sodium	90
Total Nitrogen as N	5.7 ¹

mg/L = milligrams per liter

The Central Coast Water Board does not require first-encountered groundwater monitoring at this time. If effluent water quality indicates exceedances of the Basin Plan groundwater objectives, the Central Coast Water Board may require groundwater monitoring in the future.

ATTACHMENT 2
FIGURES



Nipomo Community
Services District

Blacklake WRF
Report of Waste
Discharge

Figure 2-5:
Effluent Storage
Pond and
Irrigation Area


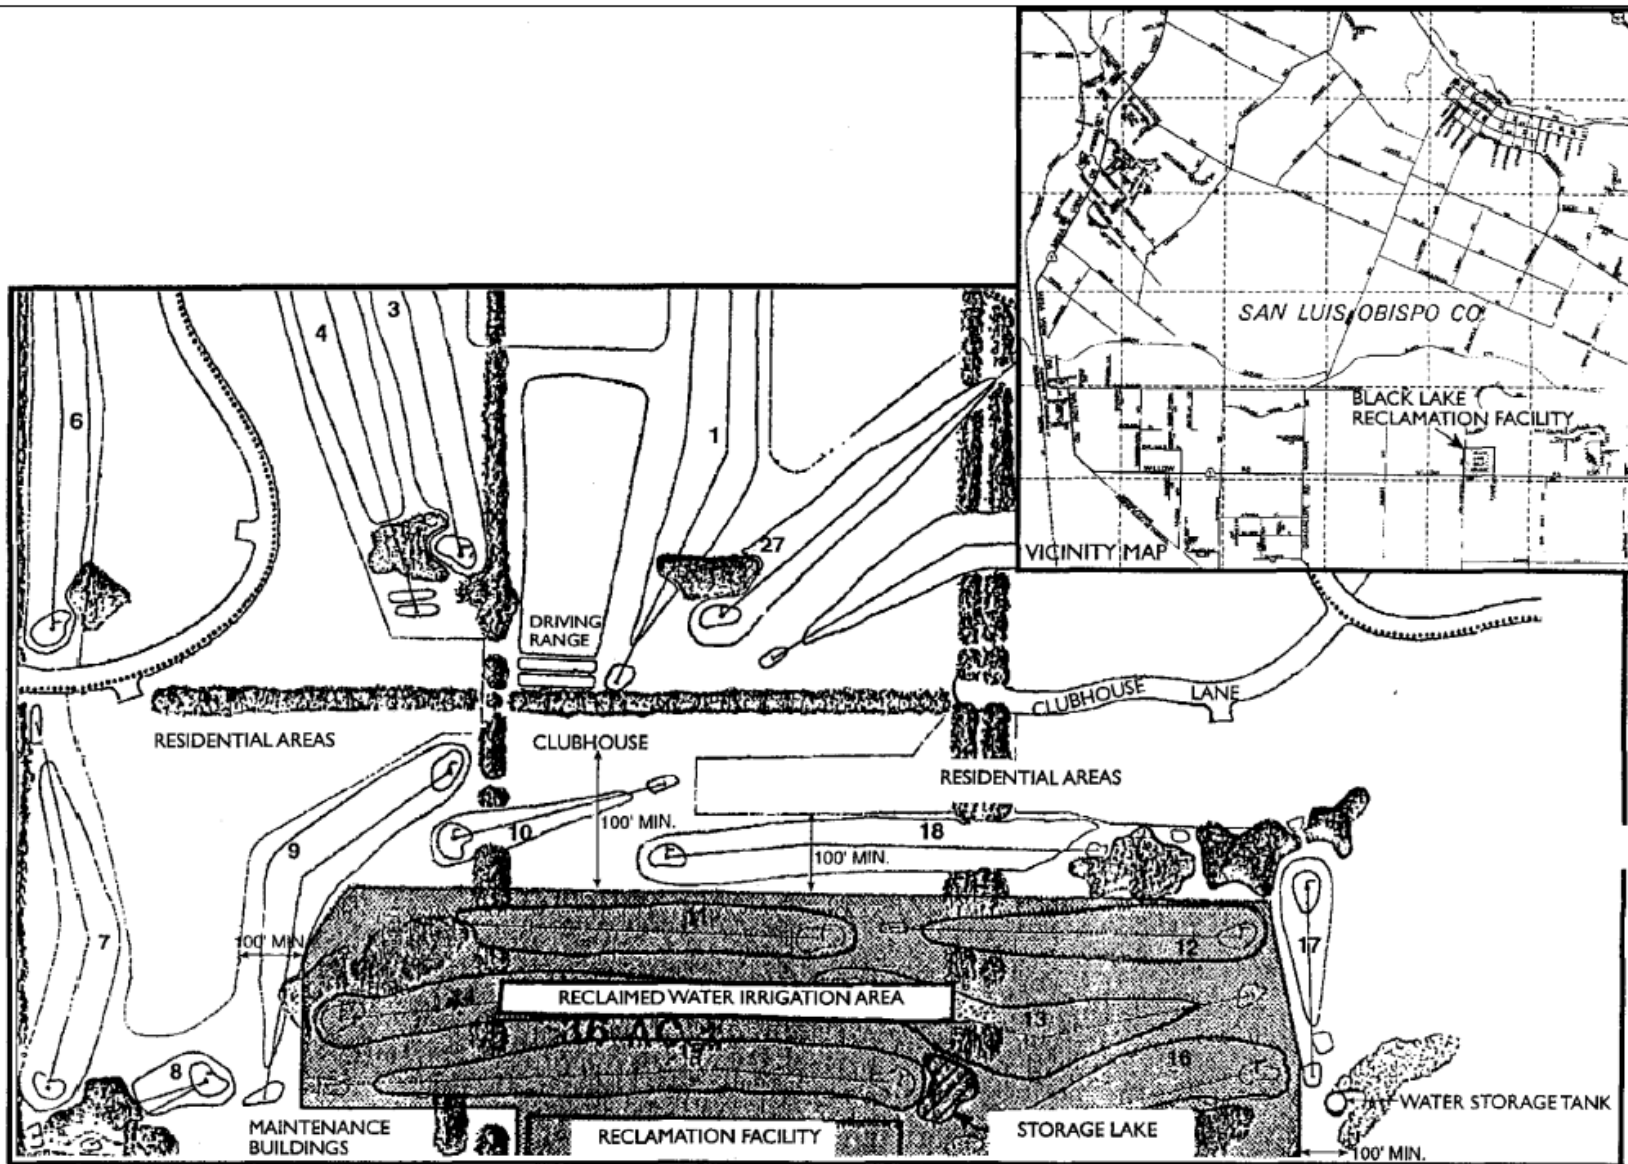


Figure 1. Site Vicinity Map and Disposal Area Location (from Blacklake WRF Report of Waste Discharge).




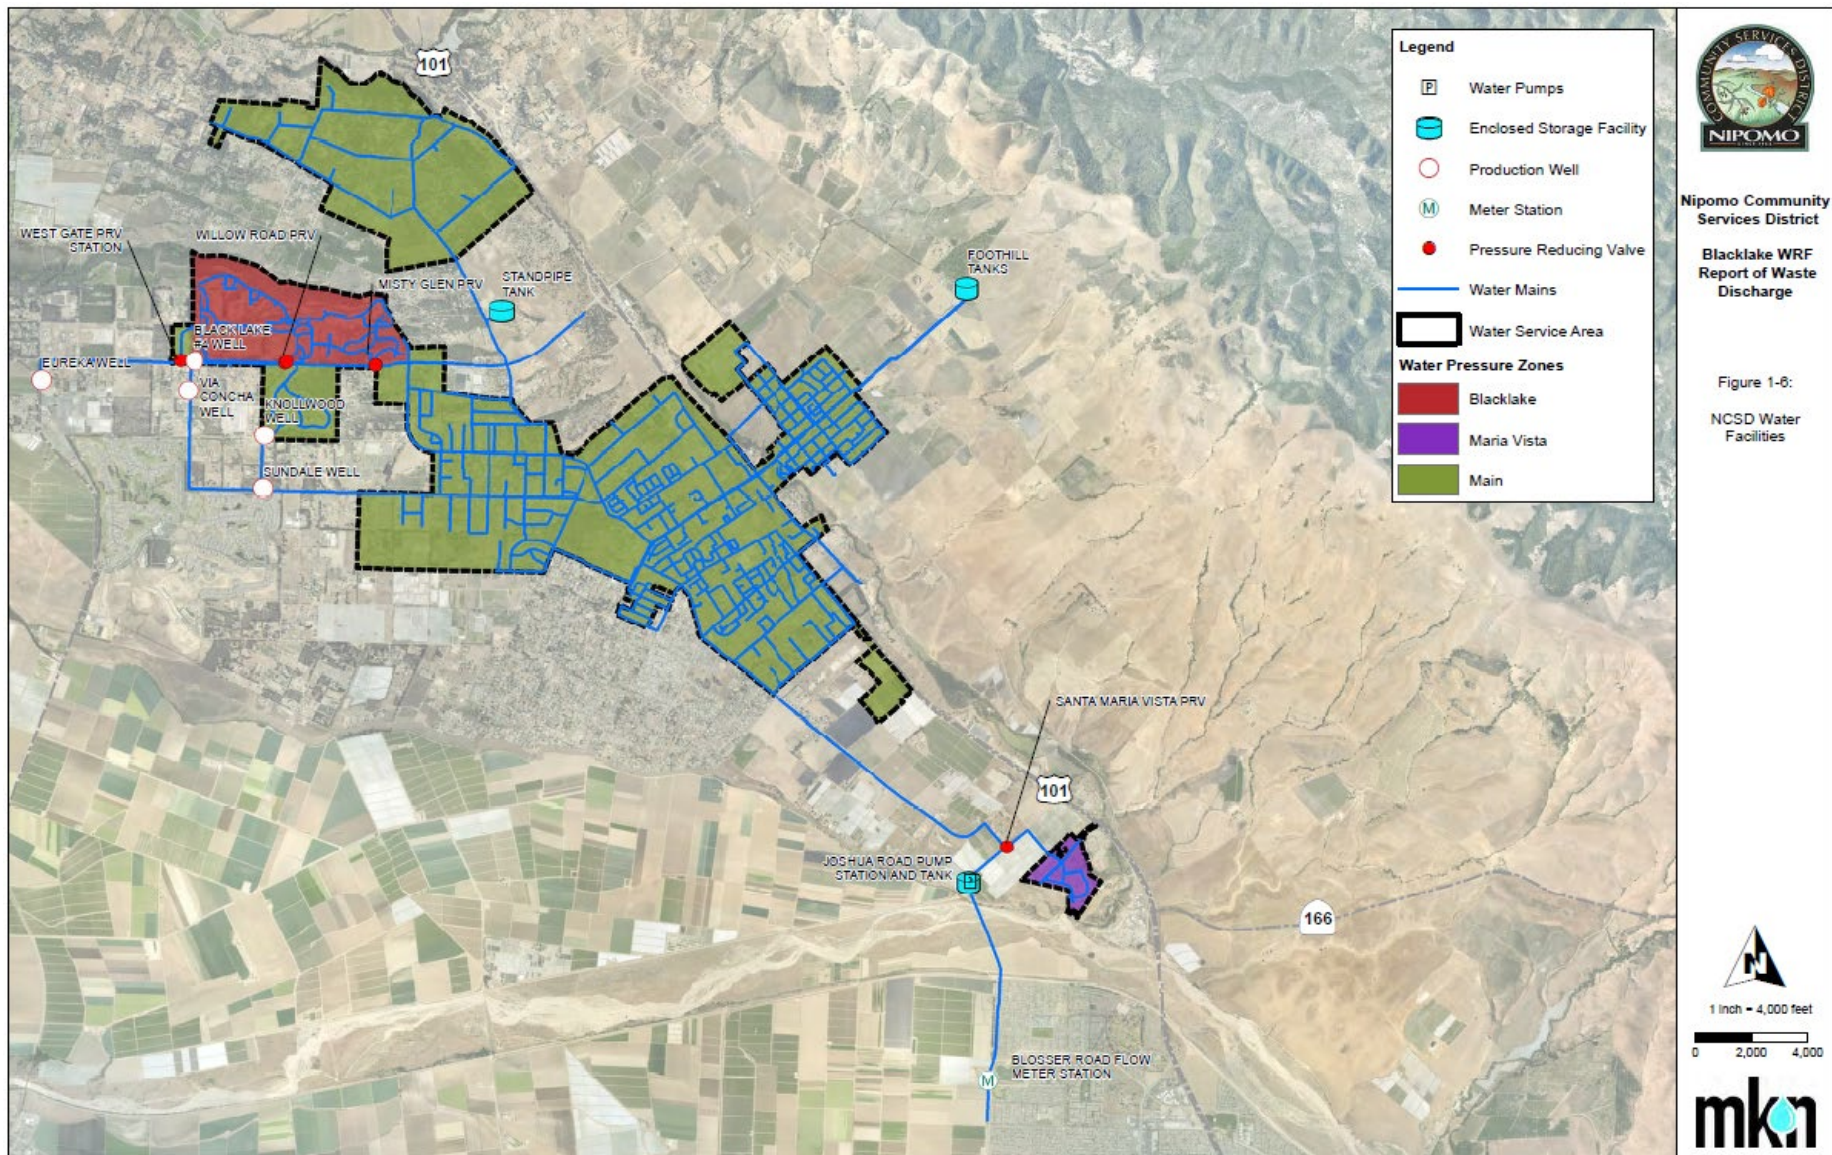

Nipomo Community Services District
Blacklake WRF
Report of Waste Discharge

Figure 1-8:
 NCSD Water Facilities

Figure 2. Blacklake WRF collection system services areas (from Blacklake WRF Report of Waste Discharge – Figure 2-5).

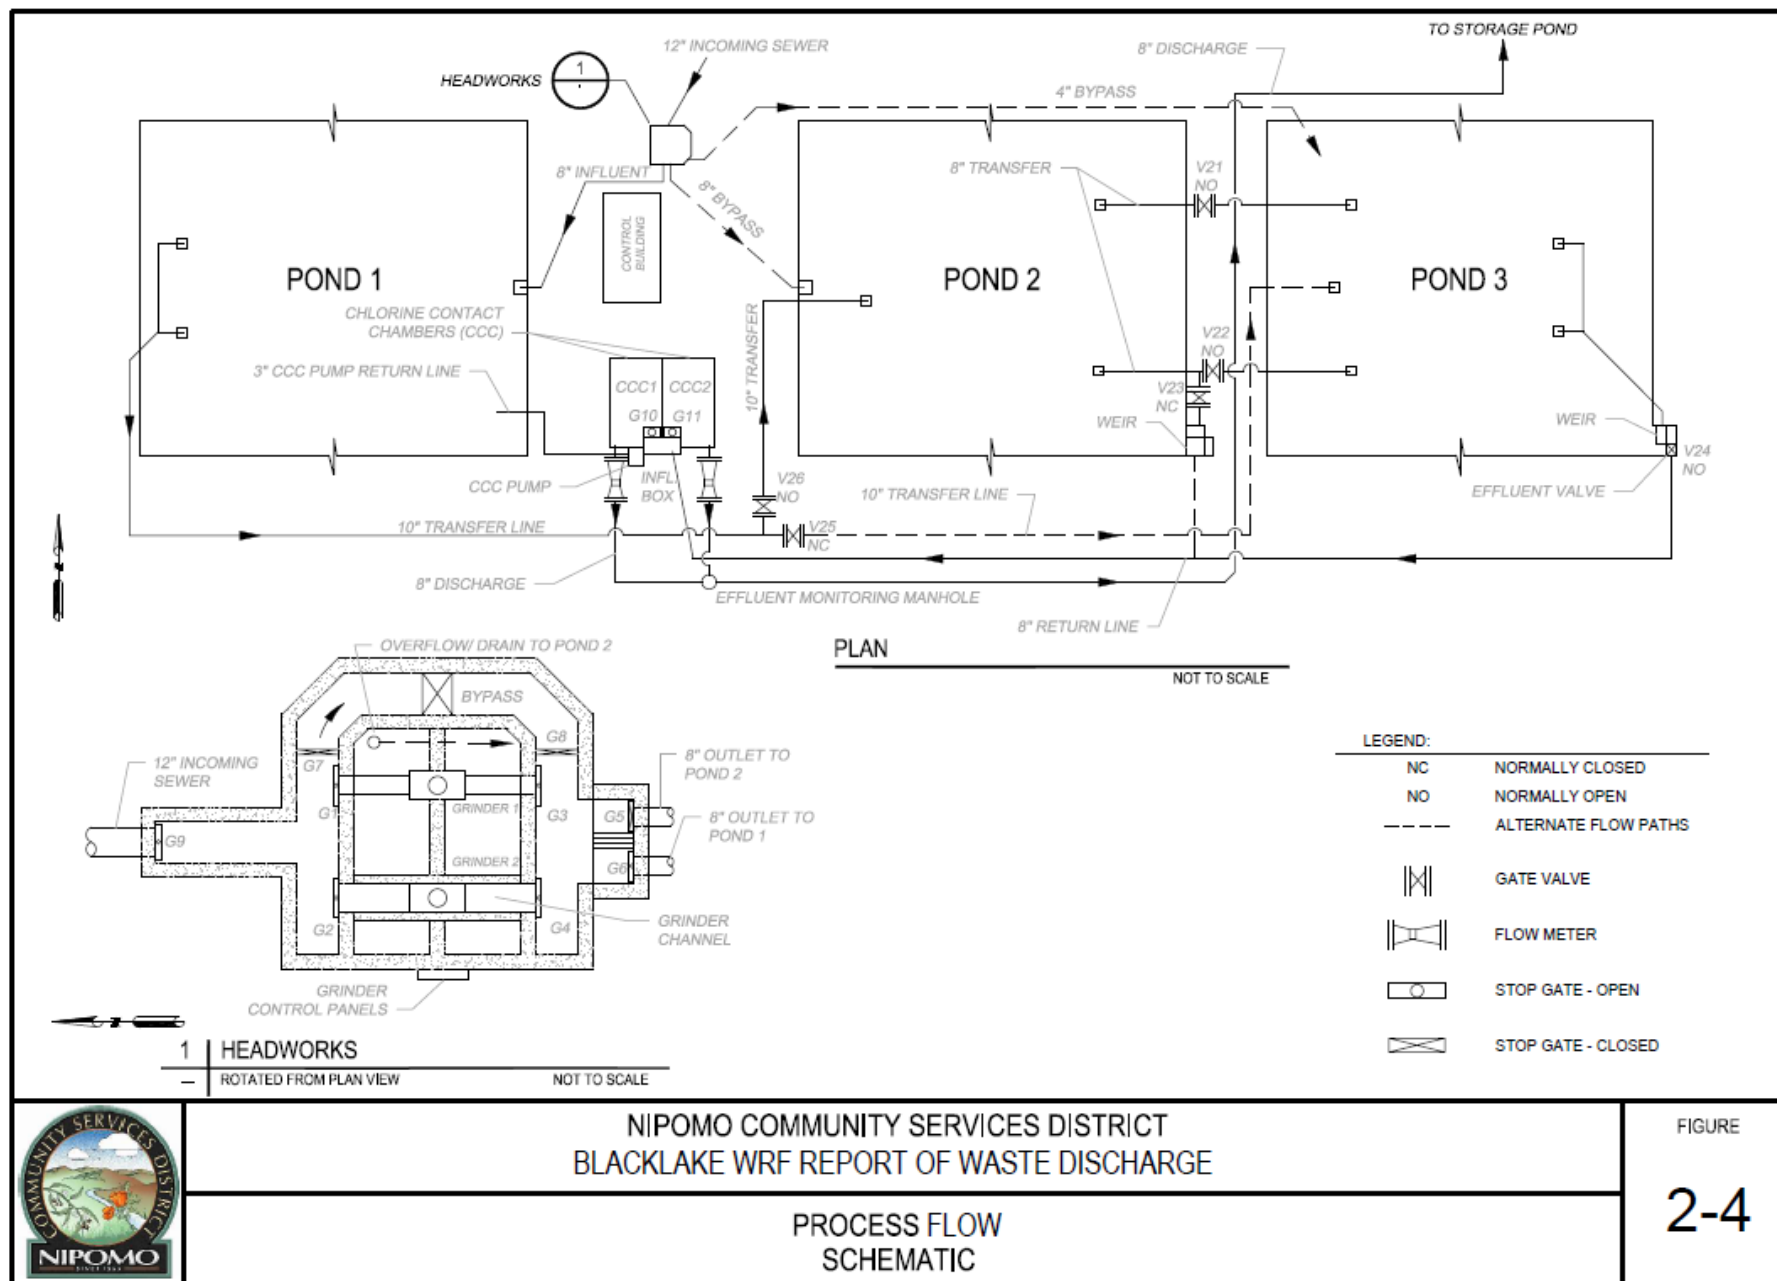

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2023-0022

for

**BLACKLAKE WATER RECLAMATION FACILITY
SAN LUIS OBISPO COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system for Nipomo Community Services District's (Nipomo CSD) Blacklake Water Reclamation Facility (Blacklake WRF) located at 1400 Willow Road in Nipomo, California.

Nipomo CSD owns and operates the wastewater system that is subject to the notice of applicability dated May 31, 2023, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;

2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data in the semiannual report and/or to the GeoTracker database (described below), is shown in Table 2.

Table 2. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Influent Sample – 1	IS-1	Before the headworks
Effluent Sample – 1	ES-1	Effluent manhole
Water Supply Well Sample	NA ¹	Representative sample from a groundwater supply well

¹ Water supply sample data should be included in the semiannual reports but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves the submittal of a Well Identification Number pursuant to the Water Supply Monitoring section below.

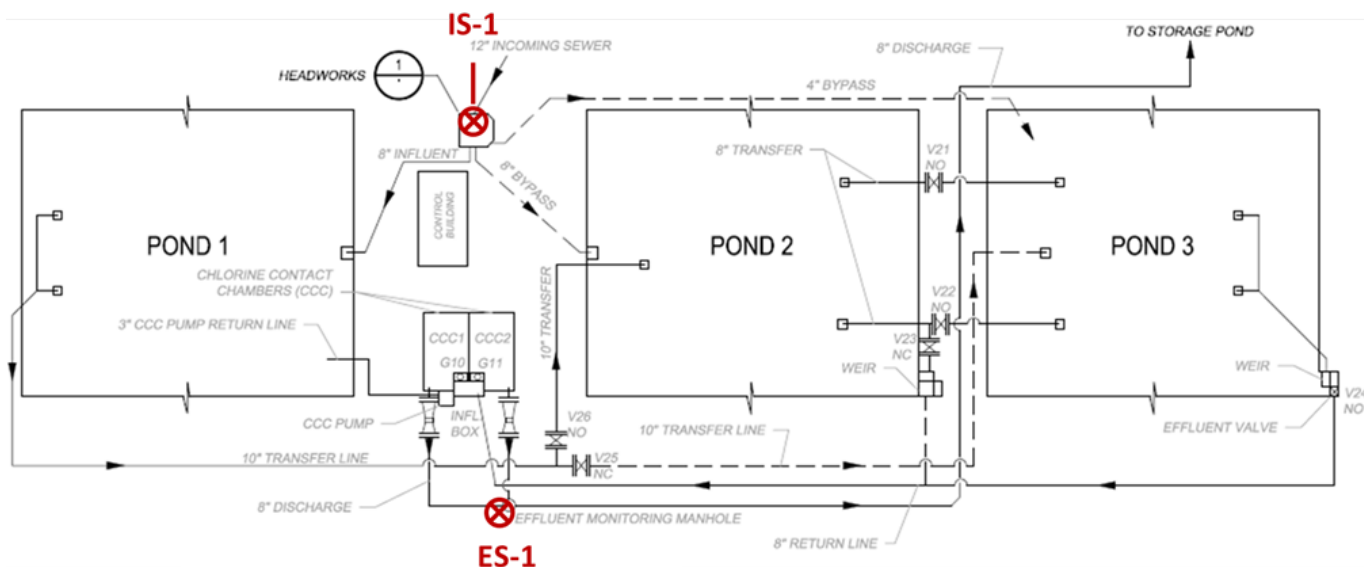


Figure 1. Process Flow Diagram with Sampling Locations

3. WATER SUPPLY MONITORING

Blacklake utilizes potable water from groundwater and imported water from the City of Santa Maria. Representative samples of the water supply must be collected and analyzed as shown in Table 3 from the production wells prior to any disinfection. In lieu of the required water supply sampling, Nipomo CSD may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Nipomo CSD must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Nipomo CSD must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 3. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency
TDS	mg/L	Grab	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually

mg/L denotes milligrams per liter

4. RECYCLED WATER MONITORING

Because recycled water is used for irrigation of landscape areas, priority pollutant monitoring is required at the production facility. Priority pollutants are listed in Appendix A of 40 Code of Federal Regulations (CFR) Part 423. Sampling and reporting frequency are shown in Table 4.

Table 4. Priority Pollutant Sampling and Reporting Frequency

Constituent	Sample frequency	Reporting Frequency
Priority Pollutants	5 years	Semiannually

5. DISINFECTION SYSTEM MONITORING

Samples must be collected from downstream of the disinfection system and analyzed by an approved laboratory per title 22, section 60321(a). Disinfection monitoring requirements are described in Table 5.

Table 5. Disinfection System Monitoring Requirements

Constituent/ Parameter	Units	Sample Type	Sample Frequency (ES-1)
---------------------------	-------	----------------	----------------------------

Total Coliform Bacteria ¹	MPN/100 mL	Grab	Daily
Turbidity	NTU	Meter	Continuous

MPN = most probable number

NTU = nephelometric turbidity units

¹ Using a minimum of 15 tubes or three dilutions

6. FLOW MONITORING

Nipomo CSD must monitor and report flow, as described in Table 6, with each monitoring report. Flow must be monitored using a flow meter at sample location IS-1. Nipomo CSD may propose, for Central Coast Water Board approval, an alternate flow meter location that is representative of system flows. Reports containing flow measurements must specify where the flow is taken from.

Table 6. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Daily Flow	Gallons per day	Metered	Daily
Maximum Daily Flow	Gallons per day	Metered	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly

7. INFLUENT AND EFFLUENT CONSTITUENT MONITORING

Representative samples of Blacklake WRF's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 7. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Monthly	Monthly
pH	pH units	Not Required	Monthly
Total Nitrogen	mg/L	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Semiannually

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency
Chloride	mg/L	Not Required	Semiannually
Sodium	mg/L	Not Required	Semiannually
Sulfate	mg/L	Not Required	Semiannually

mg/L = milligram per liter

MPN = most probably number

¹ Nitrate and nitrite sample may be combined

8. POND SYSTEM MONITORING

Treated wastewater is stored in a lined storage pond before Blacklake Golf Resort reuses it for golf course irrigation system. These monitoring requirements apply only to ponds permitted through the General Permit. Pond(s) containing recycled water must be monitored for the following:

Table 8. Wastewater Treatment/Storage/Disposal Pond Monitoring

Parameter	Units	Sample Type	Sample Frequency ²
Freeboard	Feet ¹	Measurement	Quarterly
Measurement	Quarterly	Annually	Quarterly
Odors	--	Observation	Quarterly

¹ Units must be in feet rounded to the nearest tenth of a foot (i.e., 2.4 feet)

² Or less frequently if approved by the Central Coast Water Board

9. USE AREA MONITORING

Nipomo CSD must monitor use areas at a frequency appropriate to determine compliance with the General Permit. The following must be recorded for each user with additional reporting for use areas as appropriate. The frequency of use area inspections must be based on the complexity and risk of each use area. Use areas may be aggregated to combine acreage for calculation or observation purposes. Use area monitoring requirements are shown in Table 9.

Table 9. Use Area Monitoring Requirements

Parameter	Units	Monitoring Type	Sample Frequency
Recycled Water User	NA	NA	NA
Recycled Water Flow	gpd	Meter ^(a)	Monthly

Recycled Water Volume	acre-feet	Meter ^(a)	Monthly
Acreage Applied ^(b)	Acres	Calculated	NA
Application Rate	inches/acre/year	Calculated	NA
Soil Saturation/Ponding	NA	Observation	Quarterly
Nuisance Odors/Vectors	NA	Observation	Quarterly
Discharge Off-Site	NA	Observation	Quarterly
Notification Signs ^(c)	NA	Observation	Quarterly

gpd = gallons per day

NA = not applicable

^(a) Meter requires meter reading, a pump run time meter, or other approved method.

^(b) Acreage applied denotes the acreage to which recycled water is applied.

^(c) Notification signs must be consistent with the requirements of California Code of Regulations, title 22, section 60310 (g).

10. SOLIDS DISPOSAL MONITORING

Nipomo CSD must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

11. SYSTEM UPGRADES

System upgrades may be necessary for influent flow monitoring. Nipomo CSD must report on any changes made to the existing wastewater treatment system, including installation of influent flow meters, in semiannual reports. Nipomo CSD must contact the Central Coast Water Board to request alternative methods for monitoring influent flow.

12. WASTEWATER CONSOLIDATION PROGRESS REPORTING

Each semiannual monitoring report must provide a status update with respect to the ongoing efforts to consolidate the Blacklake WRF with the Southland Wastewater Treatment Facility. The monitoring report must include a description of activities that occurred in the previous six months related to this consolidation and must include a timeline for completion of future activities that will lead to consolidation. If it is determined that consolidation with the Southland Wastewater Treatment Facility is not feasible in the near future, Nipomo CSD must complete a new Title 22 report for Blacklake WRF and submit plans detailing the facility's needed wastewater treatment upgrades and timeline for implementation.

13. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 10.

Table 10. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Consolidation Progress** per the Wastewater Consolidation Progress Reporting Section
- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** –
 - Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
 - An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, Total Nitrogen, Total Coliforms) over time, nuisance conditions, system problems, etc.
 - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Septic Tank Pumping** -- Annually, in the March 1 report, note if the septic tank was pumped or inspected and provide the results as described in Section 5.
- **Disposal Area Inspection** -- Report the results of the disposal area inspections, as described in Section 6.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 7.
- **Operator Information** – A discussion of operator certification and a list of current operating personnel, their grades of certification, and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.

- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

14. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permittting/docs/transmittal_sheet.pdf

Nipomo CSD must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number WDR100033575 at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 11 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 11. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water and soil samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.

Electronic Submittal	Description of Action	Action	Frequency
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

15. TECHNICAL REPORTS

Nipomo CSD must submit to GeoTracker the three reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 12. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 12. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	September 1, 2023
Sampling and Analysis Plan	September 1, 2023
Sludge Management Plan	September 1, 2023

16. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Nipomo CSD submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Nipomo CSD to enforcement action pursuant to [section 13268 of the Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Nipomo CSD is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

Nipomo CSD must implement the above monitoring program as of the date of this monitoring and reporting program. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Nipomo CSD must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Blacklake Water Reclamation Facility
Monitoring and Reporting Program

May 31, 2023

Ordered by:

for Matthew T. Keeling
Executive Officer