



Central Coast Regional Water Quality Control Board

January 13, 2022

Sent Via Electronic Mail

Thomas R. Adcock
President, California Utilities Service, Inc
249 Williams Road
Salinas, CA 93905
E-mail: tom@calutilities.com

Dear Thomas R. Adcock:

CALIFORNIA UTILITIES SERVICE, INC, 16625 RESERVATION ROAD, SALINAS, CA 93908, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0019; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER NO. R3-2007-0008 FOR CALIFORNIA UTILITIES SERVICE, INC.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the September 14, 2021 notice of intent and available documents associated with California Utilities Services, Inc.'s domestic wastewater treatment facility (Wastewater System) located at 16625 Reservation Road in Salinas, California. The Wastewater System, owned by California Utilities Service, Inc. is currently regulated pursuant to *Waste Discharge Requirements Order No. R3-2007-0008 for California Utilities Service* (Order No. R3-2007-0008).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

DR. JEAN-PIERRE WOLFF, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

895 Aerovista Place, Suite 101, San Luis Obispo, CA 93401 | www.waterboards.ca.gov/centralcoast

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and limitations (Attachment 1); figures (Attachment 2); and California Utilities Service, Inc.'s monitoring and reporting program requirements (Attachment 3).

This letter also serves as a notice of termination of California Utilities Service, Inc.'s coverage in existing individual permit, Order No. R3-2007-0008.

California Utilities Service, Inc. must comply with the following:

1. **General Permit** – California Utilities Service, Inc. must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – California Utilities Service, Inc. must comply with the requirements of the monitoring and reporting program enclosed with this letter (monitoring and reporting program no. R3-2022-0019, Attachment 3). California Utilities Service, Inc. is required to submit quarterly monitoring reports and annual reports to the Central Coast Water Board and comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board). The first quarterly monitoring report is due **May 1, 2022**, the first annual report is due **March 1, 2022**, and the annual volumetric data submission must be uploaded to the State Water Board GeoTracker database by **April 30, 2022**.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

California Utilities Service, Inc. must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number over the internet at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. Central Coast Water Board staff may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – California Utilities Service, Inc. was billed \$23,783 on December 8, 2021 for coverage in their existing individual permit, Order No. R3-2007-0008. This payment covers California Utilities Service, Inc.'s enrollment in the General Permit for the 2021-2022 fiscal year.

California Utilities Service, Inc. must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$23,783. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

California Utilities Service, Inc.'s Wastewater System is currently assigned a threat and complexity rating of 2B.

4. **Notification** – The Central Coast Water Board will be notified of California Utilities Service, Inc.'s enrollment at a regularly scheduled public meeting on April 21-22, 2022. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, California Utilities Service, Inc. must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, California Utilities Service, Inc. must notify the Central Coast Water Board immediately of such changes.

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

Attachment 1 contains Central Coast Water Board staff's understanding of the Wastewater System located at 16625 Reservation Road in Salinas, California. Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, California Utilities Service, Inc. must notify Central Coast Water Board staff if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

- 6. Responsible Party** – California Utilities Service, Inc. is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects California Utilities Service, Inc. to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, California Utilities Service, Inc. must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board's Executive Officer so that the new owner or operator can be enrolled in the General Permit and California Utilities Service, Inc.'s enrollment in the General Permit can be terminated.
- 8. Termination of Permit** - The existing individual permit, Order No. R3-2007-0008 is terminated, except for enforcement purposes⁴. California Utilities Service, Inc. is responsible for compliance with Order No. R3-2007-0008 prior to the date of this letter.

If you have any questions, please contact **Kathy Truong at (805) 549-3293 or by email at Kathy.Truong@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

⁴ The General Permit states "...where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0019

cc:

Lotfi Boukraa, California Utilities Service, Lotfi@calutilities.com

Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov

Kristina Olmos, Central Coast Water Board, Kristina.Olmos@Waterboards.ca.gov

Sharon Denker, Central Coast Water Board, Sharon.Denker@Waterboards.ca.gov

Kathy Truong, Central Coast Water Board, Kathy.Truong@Waterboards.ca.gov

WDR Program, GeoTracker RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-212424

GeoTracker No. = GT- WDR100029948

Rev 9/24/2021

ECM Subject Name = California Utilities Service, Inc NOA for R3-2020-2020

R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\California Utilities Service
212424\Big Order Enrollment

**ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by California Utilities Service, Inc. to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	California Utilities Service, Inc.
Physical Address	16625 Reservation Road Salinas, CA 93908
Latitude	N36° 27.966'
Longitude	W121° 41.504'
Mailing Address	249 Williams Road Salinas, CA 93905
Owner	California Utilities Service, Inc.
Operator	California Utilities Service, Inc. phone: 831-424-0441 E-mail: tom@calutilities.com
Legally Responsible Official	Thomas R. Adcock phone: 831-424-0441 E-mail: tom@calutilities.com
Raw Wastewater Characteristics	Sewer Connections: 1115 Population Served: 3679 Domestic (%): 100%
Average Monthly Design Flow (gallons per day, gpd)	300,000
Baseline Flow (average annual flow) in gpd	151,000
Threat to Water Quality	2
Complexity	B

2. WASTEWATER SYSTEM OPERATION SUMMARY

California Utilities Service, Inc.'s wastewater treatment facility (Wastewater System) is a Class III wastewater system. California Utilities Service, Inc. must staff a Class III chief plant operator for proper operation of the Wastewater System. Operator names, grades, and license numbers are shown in Table 2.

Table 2. Wastewater System Operators

Operator Name	Grade	License Number
Thomas R. Adcock	V	36882
Lotfi Boukraa	V	29080
Adnen Chaabane	V	40761
Andy Clarke	IV	40960
Mohsen BenKahia	III	43374
Ryan Monighetti	III	29060
Edward Alexandre	IV	1103

The Wastewater System is capable of treating a daily peak flow of 450,000 gallons per day to a secondary treatment level. The Wastewater System consists of the treatment technologies and treatment capabilities shown in Table 3.

Table 3. Treatment Technology and Capacity

Headworks/Preliminary Treatment	Wedge wire static screen that removes solids from the influent to the aerobic digester before they reach the Sequencing Batch Reactors (SBR) tanks.
	Headworks capacity (gpd): 450,000 peak daily flow
Emergency Storage	Emergency storage pond has storage capacity of approximately 3.23 MG (approximately ten-day storage capacity)
Secondary Treatment	Two SBR tanks in parallel, one is filled while the other performs its various treatment process steps. Dimensions: 62x21x17 feet 4 cycles/day Volume: 168,000 gallons
	Secondary treatment capacity (gpd): 450,000 peak daily flow
Effluent storage	Storage pond; storage capacity is approximately 7.8 million gallons (MG); managed as a treated effluent disposal/storage pond, as the pond is not lined.

Wastewater Disposal Method	The treated effluent is pumped in an 8" C900 PVC pipe that is 20' below the Salinas River bottom. There is also a backup 4" pipe hanging above the river. The effluent pump has the ability to pump through either of these 2 pipes, depending upon valving. The effluent pump is located at the plant. Wastewater is then land applied via an overhead irrigation system. Public access is prohibited, and area is bermed.
	Area: 74 acres of usable land (38 acres are used for spray irrigation and remaining 36 acres are for future expansion) Soils: Sandy clay Perched groundwater zones beneath disposal area
	Disposal capacity (gpd): 750,000 based on pump sizing and 24 hrs/ day disposal
Biosolids/Sludge Production and Handling	Settled (waste) activated sludge is wasted to an aerobic digester where it further degrades aerobically to a solids concentration of 1.5-3.5%. Subsequently, the waste activated sludge is pumped, with the addition of polymer, into a wedge wire type sludge drying bed for further dewatering to an approximate solids concentration of 10% – 30%.
	Annual production of biosolids: 450 tons
	The ultimate destination of biosolids produced is Monterey Regional Waste Management District landfill located at 14201 Del Monte Blvd in Marina.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

California Utilities Service, Inc., must operate the Wastewater System in accordance with the General Permit and this notice of applicability. California Utilities Service, Inc. must comply with the wastewater specific limitations specified in Table 4 through Table 8.

A. Flow Limitations:

Table 4. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily Flow	Gallons per day	450,000	Influent
Mean Monthly Flow	Gallons per day	300,000	Influent
Maximum Effluent Flow (to disposal area)	Gallons per day	750,000	Effluent

Mean Monthly Flow	Gallons per day	750,000	Effluent
-------------------	-----------------	---------	----------

B. Effluent Limitations

Table 5. Effluent Limitations: Sequencing Batch Reactor

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L ^[1]	30	45	Not Applicable
Total Suspended Solids	mg/L	30	45	Not Applicable
Settleable Solids	mL/L ^[2]	0.1	0.3	0.5
pH	Not Applicable	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mg/L denotes milligrams per liter

[2] mL/L denotes milliliter per liter

Table 6. Effluent limitations based on the Designated Groundwater Basin - *Salinas Valley 180 foot Aquifer*

Constituents	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L ^[1]	1,500
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	10

[1] mg/L denotes milligrams per liter

C. Groundwater Limitations:

Based on review of historical data, California Utilities Service, Inc. is unable to comply with the General Permit effluent limitations for constituents specified in Table 7, and thus the point of compliance for these constituents will be underlying groundwater. Through groundwater monitoring, California Utilities Service, Inc. must demonstrate that the discharge does not cause underlying groundwater to exceed the water quality objectives set forth in the Basin Plan including the limitations listed in Table 7.

Table 7. Groundwater Limitations for Designated Groundwater Basin - *Salinas Valley 180 foot Aquifer*

Constituents	Units	25-Month Rolling Median ^[2]
Chloride	mg/L ^[1]	250
Sodium	mg/L	250

[1] mg/L denotes milligrams per liter

[2] Rolling Median is the median from all data collected over the most recent 25 months

D. Organic Loading Limitations:

California Utilities Service, Inc. land applies treated wastewater and thus organic loading limitations specified in Table 8 apply.

Table 8. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5- Day	Pounds/acre/day	100	300

ATTACHMENT 2 FIGURES



Figure 1. Site Map

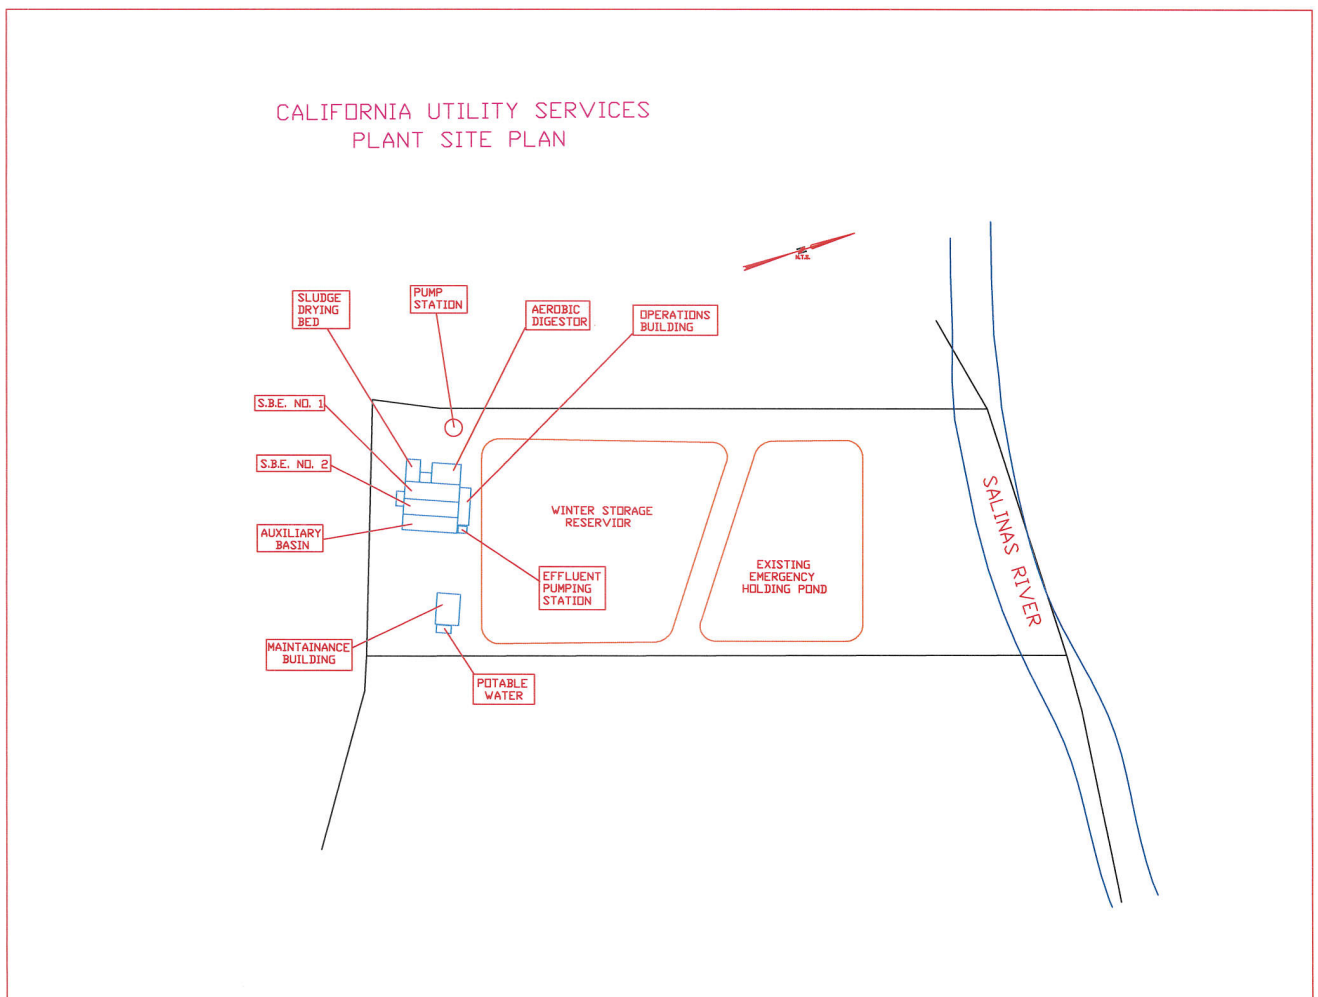


Figure 2. Wastewater System Layout

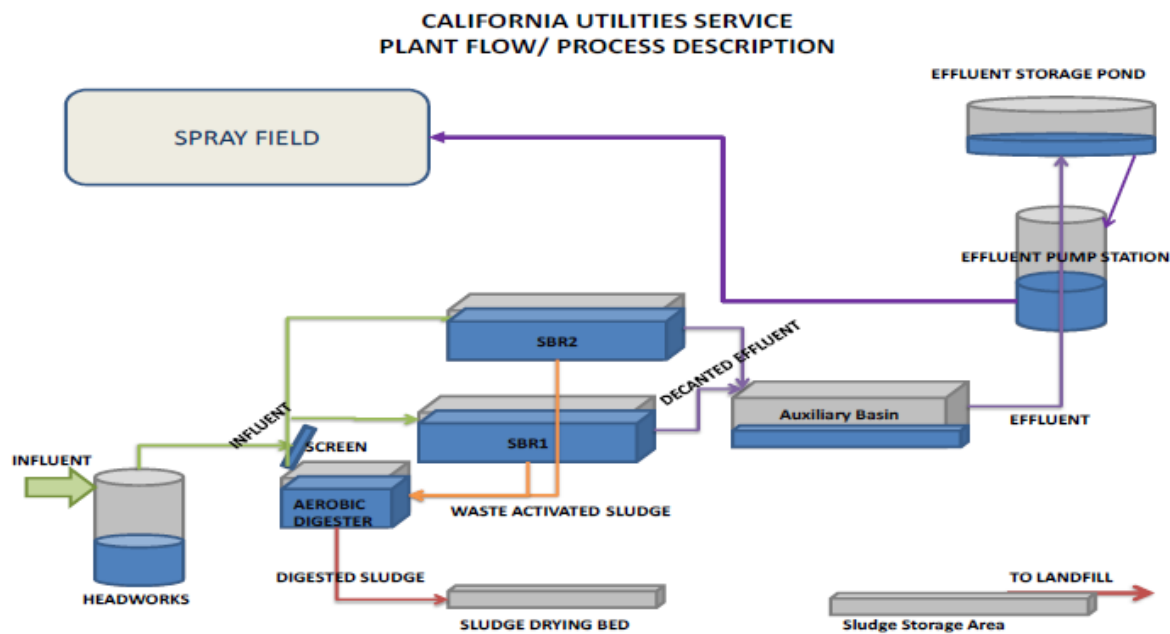


Figure 3. Process Flow Diagram



Figure 4. Total Disposal Areas Outlined in Yellow



Figure 5. Disposal Areas Under Spray Irrigation (Area Currently Being Used to Spray Treated Effluent) Outlined in Yellow

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

**MONITORING AND REPORTING PROGRAM ORDER NO. R3-2022-0019
(MODIFICATION OF MRP ORDER NO. R3-2020-0020)**

FOR

**CALIFORNIA UTILITIES SERVICE, INC.'S WASTEWATER SYSTEM
SALINAS, MONTEREY COUNTY**

This Monitoring and Reporting Program (MRP) applies to the monitoring and reporting requirements for California Utilities Service, Inc.'s wastewater treatment facility (Wastewater System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

California Utilities Service, Inc. (Discharger) owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. The Discharger must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board) Executive Officer.

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The MRP directs the Discharger to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see MRP section VII.D).

I. SAMPLING AND ANALYSIS

The Discharger must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge, etc.) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the Operations and Maintenance Manual for Central Coast Water Board Executive Officer review and approval.

A. Sampling Schedule – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity, etc.) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

B. Monitoring Location Descriptions – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring wells (MW), etc. must be collected at the locations described in Table 2. These locations must be consistent with the Central Coast Water Board Executive Officer approved sampling and analysis plan. The Discharger must upload the GeoTracker field point information for each sampling location in the GeoTracker database (see Table 11).

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Location Description
Influent Sample	IS-1	Raw wastewater sample collected at the headworks
Effluent Sample	ES-1	Treated wastewater sample collected downstream of the two SBR tanks and auxiliary basin
Effluent Sample	ES-2	Treated wastewater sample collected from the final effluent storage pond
Monitoring Well	MW-1	South of the land disposal area (Sprayfield, Upstream)

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	Field Point Location Description
Monitoring Well	MW-2	Within the land disposal area (Sprayfield)
Monitoring Well	MW-3	Within the land disposal area (Sprayfield)
Monitoring Well	MW-4	North of the land disposal area (Sprayfield, Downstream)

II. WATER SUPPLY MONITORING

Representative samples of the Discharger's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3.

In lieu of the required water supply sampling, the Discharger may request Central Coast Water Board Executive Officer approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. The Discharger must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. The Discharger must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

The Discharger must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – The Discharger must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See MRP section VII.B.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 2. Influent and Effluent Flow Monitoring

		INFLUENT	INFLUENT	EFFLUENT ^[1]	EFFLUENT
Parameter	Units	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[2]	Gallons per day	Metered	Daily	Metered/Estimated ^[3]	Daily
Maximum (Peak) Daily Flow	Gallons per day	Metered	Monthly	Metered/Estimated ^[3]	Monthly
Mean Daily Flow	Gallons per day	Calculated	Monthly	Calculated	Monthly

[1] Flow as measured leaving the effluent storage pond(s).

[2] The General Permit notice of applicability specifies the Wastewater System's permitted flow. In the monitoring reports, the Discharger must evaluate and provide a comparison of monitored flow to the permitted flow.

[3] If the flow is estimated, the Discharger is required to provide an explanation (e.g., no meter-estimated using pump operations including rate and time, etc.) with each monitoring report.

B. Wastewater System Monitoring – Representative samples of the storage/disposal pond and wastewater system must be collected and analyzed in accordance with the tables below. The Discharger must report monitoring data, as described in Tables 5 and 6, with each monitoring report.

1. Pond System – The wastewater storage/disposal pond must be monitored as specified in Table 5.

Table 3. Wastewater Storage/Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
Odors	Not Applicable	Observation	Weekly

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Berm condition	Not Applicable	Observation	Monthly
Sludge Depth	0.1 feet	Measured	Annually

- 2. Sequencing Batch Reactor** – The influent (IS) and effluent (ES) samples must be collected at the locations described in Table 2 and Figure 1. Influent must be collected as a 24-hour composite sample (except for pH, which is grab) and effluent must be collected as a grab sample.

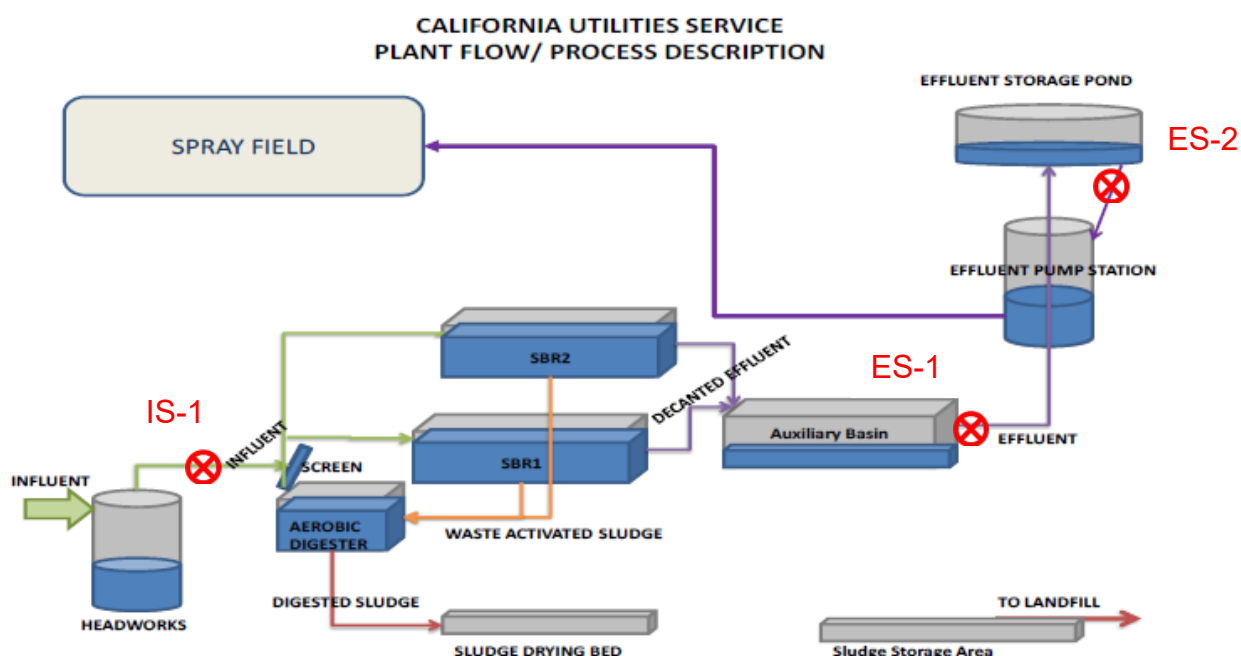


Figure 1. Process Flow Diagram and Sample Locations (Referenced in Table 2)

Table 6. Influent and Effluent Monitoring

		INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-2)
Constituent	Units ^[1]	Sampling Frequency	Sampling Frequency	Sampling Frequency
pH	units	Weekly	Weekly	Not Applicable
Biochemical Oxygen Demand, 5-Day	mg/L	Quarterly	Monthly	Not Applicable

		INFLUENT (IS-1)	EFFLUENT (ES-1)	EFFLUENT (ES-2)
Constituent	Units ^[1]	Sampling Frequency	Sampling Frequency	Sampling Frequency
Total Suspended Solids	mg/L	Quarterly	Monthly	Not Applicable
Settleable Solids	mg/L	Not Applicable	Weekly	Not Applicable
Total Nitrogen ^[2]	mg/L	Quarterly	Monthly	Not Applicable
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	Quarterly	Monthly	Not Applicable
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Monthly	Not Applicable
Ammonia (as N)	mg/L	Quarterly	Monthly	Not Applicable
Total Dissolved Solids	mg/L	Quarterly	Not Applicable	Monthly
Chloride	mg/L	Quarterly	Not Applicable	Monthly
Sodium	mg/L	Quarterly	Not Applicable	Monthly
Sulfate	mg/L	Quarterly	Not Applicable	Monthly
Boron	mg/L	Not Applicable	Not Applicable	Monthly
Carbonate	mg/L	Not Applicable	Not Applicable	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	Semiannually
Potassium	mg/L	Not Applicable	Not Applicable	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	Semiannually

[1] mg/L denotes milligrams per liter

[2] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

IV. WASTEWATER DISPOSAL MONITORING

The Discharger must monitor the sprayfields when wastewater is applied. Inspections must be conducted and documented at least weekly during operation and during and after rain events. Notations must be made in a bound logbook and include observations of bank or soil erosion, excessive odors, insects, or other potential nuisance conditions that may be present. Any problems must be promptly corrected and recorded. A log of

these inspections must be maintained onsite and made available to Central Coast Water Board staff upon inspection.

The Discharger must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, etc. with each monitoring report.

If wastewater is not discharged to land during a reporting period, the monitoring report must still be submitted and indicate that there was no discharge during the reporting period.

Wastewater disposal monitoring must be consistent with Table 7.

Table 7. Wastewater Disposal Monitoring

Constituent	Units	Sample Type	Monitoring Frequency
Local Precipitation	Inches/day	Weather Station ^[1]	Each precipitation event
Acreage Applied ^[2]	Acres	Measured	Daily
Application Rate	Gallons per day	Metered/Estimated ^[3]	Daily
Salts Applied ^[4] ^[5] (sodium, chloride)	lbs/acre/day	Calculated	Monthly
Soil Erosion Evidence	Not Applicable	Observation	Monthly
Containment Berm Conditions	Not Applicable	Observation	Monthly
Soil Saturation/Ponding	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

[1] The Discharger must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.

[2] Acreage applied denotes the acreage to which treated wastewater is applied.

[3] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, the Discharger is required to provide an explanation (e.g., no meter- estimated using pump operations including rate and time) with each monitoring report.

[4] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

- [5] Frequencies of analytical testing are defined in the influent and effluent monitoring table (Table 6).

V. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

The Discharger must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the property, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report. If sludge/biosolids are not removed during the year, the Discharger must explain the absence of this monitoring in the annual report.

The Discharger must also monitor sludge/biosolids consistent with a Central Coast Water Board Executive Officer approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

VI. GROUNDWATER MONITORING

Groundwater Monitoring Program – The Discharger has chosen General Permit Option 2 for groundwater monitoring. The discharge exceeds effluent limitations specified in Table 6 of the General Permit for chloride and sodium and is required to implement a groundwater monitoring program to demonstrate compliance with the water quality objectives specified in the Basin Plan. The Discharger must, at a minimum, sample and analyze MW-1, MW-2, MW-3, and MW-4 as specified in Table 8 and in accordance with the Executive Officer approved sampling and analysis plan (see section VI.A.2.i of the General Permit).

Prior to sampling, depth to groundwater must be measured and groundwater elevations¹ must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable if they are described in the Central Coast Water Board Executive Officer approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician, etc.) trained in using proper sampling methods must recover samples using approved USEPA methods.

¹ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports. All data must be recorded in monitoring well field sheets.

The Discharger must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation	0.01 feet	Calculated	Quarterly
Depth to Groundwater	0.01 feet	Measurement	Quarterly
Chloride	mg/L ^[1]	Grab	Quarterly
Sodium	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually

[1] mg/L denotes milligrams per liter

VII. REPORTING REQUIREMENTS

A. TECHNICAL REPORTS

The technical reports are due as described in Table 9.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date ^[1]
Operations and Maintenance Manual	12 months
Climate Change Adaptation Plan	24 months

[1] Reports are due within the time specified after issuance of notice of applicability to the Discharger.

1. **Operations and Maintenance Manual** – In addition to the required components specified in Standard Provisions² A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.
 - i. **Sampling and Analysis Plan** – The Discharger’s Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of the Discharger must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
 - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds, etc.), buildings, etc.
 - b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies (see Table 11 for an example of sample identification details).
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report, etc.).
 - h. For groundwater monitoring, a description of the well purging and field methods and an example monitoring well field sheet.
 - i. For groundwater monitoring, the well screen intervals and depth of wells.

² See Attachment E, Standard Provisions, 2013:
https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

- ii. **Sludge Management Plan** – The Discharger’s Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
 - a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
- iii. **Wastewater Disposal Management Plan** – The Discharger’s Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:
 - a. A description of the wastewater disposal area and a map denoting acreage.
 - b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.
 - c. A description of wastewater disposal and water quality protection practices.
- iv. **Spill Prevention and Emergency Response Plan** – The Discharger’s Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

- b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
 - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.
 - d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
 - e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
 - f. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
 - v. **Training Records Log** – The Discharger's Operation and Maintenance Manual must contain updated training records logs that demonstrates the Discharger is complying with General Permit section VI.B.3.
2. **Climate Change Adaptation** – The Climate Change Adaptation Plan must, at a minimum, include the following components:
- i. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt³, Sea-Level Rise Guidance from

³ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses

Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.

- a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
- b. Precipitation Pattern Changes.
 - I. Drought – Decreased influent quantity and quality.
 - II. Peak Events – Flooding and increased influent quantity.
- c. Temperature fluctuations and extremes.
- d. Increased wildfires.
- e. Increased power outages.
- ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.

B. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 10.

Table 10. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1

considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

Report	Monitoring Period	Report Due Date
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. **The Discharger must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. Copies of groundwater monitoring well field sheets with purge methods and logs
2. **Annual Reporting** – The Discharger must submit annual reports in compliance with Standard Provisions 2013⁴, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board staff.

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf
3. **State Water Board Volumetric Annual Reporting** – The Discharger must electronically certify and submit a summary of the monthly influent and effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database⁵.

⁴ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

⁵ See: <https://geotracker.waterboards.ca.gov/>

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website⁶.

C. VERBAL NON-COMPLIANCE REPORTING:

The Discharger must verbally notify and report to Central Coast Water Board staff noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

D. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

GeoTracker – The Discharger must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{7,8} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a Wastewater System-specific global identification number over the internet at:

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml.

⁶ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

⁷ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

⁸ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

For general questions, please contact the GeoTracker Help Desk at:
Geotracker@waterboards.ca.gov.

Table 11 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board staff may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 11. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Direct your California ELAP-accredited laboratory staff to upload all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.
Volume of Wastewater and Recycled Water	Monthly volume of wastewater influent, wastewater produced (treated), and effluent (discharged by the wastewater system). Level of treatment and discharge type. Monthly volume of recycled water distributed, annual volume of treated wastewater distributed for beneficial use, and category of reuse.	Submit relevant volumetric and treatment data electronically.	On or before the due date of the required annual monitoring report (see State Water Board Volumetric Annual Reporting).

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. The Discharger must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

VIII. LEGAL REQUIREMENTS

All technical and monitoring reports submitted pursuant to this MRP are required pursuant to section 13267 of the California Water Code. Failure to submit reports in accordance with schedules established by this General Permit or attachments to this General Permit, or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board Executive Officer, may subject the Discharger to enforcement action pursuant to section 13268 of the California Water Code.

California Water Code section 13267 states, in part:

“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports and shall identify the evidence that supports requiring that person to provide the reports.”

California Water Code section 13268 states, in part:

“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”

The technical and monitoring reports required by this General Permit, the notice of applicability, and this MRP are necessary to ensure compliance with this General Permit. The evidence supporting the need for the reports are contained in the information provided by the dischargers subject to this General Permit and in the files of the Central Coast Water Board. The burden and cost of preparing the monitoring and technical reports is reasonable and consistent with the interest of the state in maintaining water quality. The reports are necessary to ensure that the Discharger complies with the notice of applicability and General Permit. Pursuant to California Water Code section 13267, the Discharger must implement this MRP and must submit the monitoring and technical reports described herein.

The Discharger must implement the above monitoring program as of the date of this MRP. The Central Coast Water Board Executive Officer may rescind or modify this MRP at any time.

Ordered by:

for Matthew T. Keeling
Executive Officer

R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\California Utilities Service
212424\Big Order Enrollment\MRP CAL UTILITIES.docx