
San Francisco Bay Regional Water Quality Control Board

July 20, 2020
CIWQS Place ID 860254
DDW System No. 4390012

Microsoft Corporation
Attn: Darren Lombardi
1065 La Avenida
Mountain View, CA 94043
Sent electronically to Darren.Lombardi@microsoft.com

Natural Systems Utilities
Attn: Julian Kayne
477 Devlin Road, Suite 107
Napa, CA 94558
Sent electronically to jkayne@nsuwater.com

**Subject: Notice of Applicability, Water Quality Order WQ 2014-0153-DWQ
Microsoft Corporation, Microsoft Silicon Valley Wastewater and Rainwater
Treatment System, Mountain View, Santa Clara County**

Dear Messrs. Lombardi and Kayne:

Natural Systems Utilities submitted a Report of Waste Discharge and a Title 22 Engineering Report¹ dated April 6, 2018 (Reports), on behalf of Microsoft Corporation (Discharger) for the Microsoft Silicon Valley Wastewater and Rainwater Treatment System (Facility) at 1065 La Avenida in the City of Mountain View in Santa Clara County. Supplemental information and subsequent revised versions of the Reports were submitted to the San Francisco Bay Regional Water Quality Control Board (Regional Water Board), with the most recent submittal dated May 10, 2019. Additionally, a letter dated March 3, 2020, was submitted requesting alternative ultraviolet disinfection system operating conditions, which are addressed in section C.9. of this Notice of Applicability (Notice). Based on the information presented in the Reports, the wastewater treatment system and proposed discharges are consistent with the requirements of the State Water Resources Control Board's (State Water Board's) *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems*, Order WQ 2014-0153-DWQ (General Order).

This letter serves as Notice from the Regional Water Board that the General Order is applicable to the subject wastewater and rainwater treatment system and the system is

¹ A Title 22 Engineering Report is documentation that addresses the production, transmission, and reuse of recycled water and compliance with the requirements of the California Code of Regulations Title 22 (22 CCR or Title 22) division 4, chapter 3 Water Recycling Criteria.

henceforth regulated under the General Order as described below. A Monitoring and Reporting Program (Monitoring Program) for the Facility is included as Attachment B of this Notice.

The General Order contains requirements that apply to all wastewater treatment systems and requirements that apply only to specific types of treatment and/or disposal systems. Applicable requirements and effluent limits are discussed in section C and summarized in Table 1 of this Notice. The General Order contains additional requirements that are not summarized in Table 1. The Discharger is responsible for all applicable requirements in the General Order, this Notice, and the Title 22 Engineering Report, as described in further detail below.

A copy of the General Order is enclosed as Attachment C and is made part of this Notice by reference. The General Order is also accessible online at

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf.

A. Facility and Discharge Description

The Microsoft Silicon Valley Campus is located on approximately 32.8 acres and consists of existing and new structures. The structures include office workspace, hardware and software labs, and amenities consisting of a conference center, retail store, fitness center, and cafes. The site location is shown in Attachment A, which is attached and made part of this Notice by reference.

Domestic wastewater from toilet flushing, sinks, showers, and the food preparation areas will be collected and treated onsite to disinfected tertiary recycled water standards in accordance with 22 CCR sections 60301.230 and 60301.320. The disinfected tertiary treatment requirements are also referenced in section C.3 of this Notice. The tertiary treated recycled water will be blended with collected and treated rainwater and used for flushed fixtures (toilets and urinals) and irrigation. The estimated annual average domestic wastewater flow, excluding rainwater, is 18,000 gallons per day (gpd), and the maximum wastewater treatment system design capacity is approximately 25,000 gpd.

The wastewater will flow via a gravity collection system to the influent pump station. The wastewater treatment system consists of the following components: two 10,000-gallon primary treatment / septic tanks; a 20,000-gallon anoxic / equalization tank; a 10,000-gallon aeration tank; Orenco's AdvanTex AX-Max recirculating textile packed bed filters; 1,800 square feet of polishing vertical flow wetland (also indicated as vegetated recirculating gravel filter system) with a recirculation tank; ultrafiltration membrane system consisting of one skid with two Pentair X-Flow Aquaflex 55 hollow fiber membrane modules (pore size 0.03 microns); Aquionics In-line 400+ ultraviolet (UV) disinfection system; and ozone disinfection primarily for color and odor removal. The AdvanTex system consists of four Ax-Max 100 – 14 recirculation modules and four Ax-Max 100 - 14 filtrate modules. Effluent from the packed bed filter system will be pumped to the 3,000-gallon recirculating tank containing the duplex pumps that will dose the vegetated recirculating gravel filter system. The Aquionics In-line 400+ UV disinfection system was conditionally accepted by the Division of Drinking Water on October 15, 2008, with revisions to the acceptance conditions noted in a letter dated February 19, 2015.

Rainwater will be collected from approximately 130,000 square feet of selected rooftop and photovoltaic panels and will flow through basket strainers into two 60,000-gallon

underground tanks. The maximum threshold for the rainwater harvesting system is a 2-year, 24-hour storm duration, which will supply the two underground tanks. Excess rain will bypass the force main transmission system by overflowing the rainwater lift station into the storm drain. The stored rainwater will be pumped to a sand and gravel packed media filtration system and a separate UV disinfection system.

The blended recycled water and rainwater will be stored in four 75,000-gallon fiberglass storage tanks. Three vertical multistage centrifugal pumps will be used to distribute the blended water through separate pipelines to the toilets, urinals, and landscape irrigation system. The building will be dual plumbed to allow for the use of potable and non-potable water sources. The State Water Board's Division of Drinking Water provided two acceptance letters for the dual plumbed report and plumbing design plans and specifications dated December 3, 2018, and May 9, 2019, and a Title 22 Engineering Report comments and recommendations letter dated August 14, 2019 (Attachment E). Schematics of the wastewater and rainwater treatment systems are presented in Attachment A, which is made part of this Notice by reference.

Disinfected tertiary recycled water treated at the Palo Alto Regional Water Quality Control Plant and distributed through the City of Mountain View (City) or municipal potable water from the City are also available as backup water supplies for flushed fixtures and landscape irrigation if needed. The backup water supplies may be added into the first blended storage tank via an air gap. In the event of a prolonged recycled water treatment failure at Microsoft or the influent flow exceeds the treatment capacity, wastewater from the Facility will be directed to the City's sewer system.

B. California Environmental Quality Act

A 2017 Initial Study determined that the proposed project would result in either no impact or a less than significant impact as addressed in the North Bayshore Precise Plan Environmental Impact Report (2014) and the Mountain View 2030 General Plan and Greenhouse Gas Reduction Program Environmental Impact Report (2012). The project complies with CEQA (California Environmental Quality Act), since office uses at the proposed intensity on the site were analyzed in the North Bayshore Precise Plan Environmental Impact Report. No water quality mitigation measures were included in the Initial Study as conditions of project approval.

C. Site-Specific Requirements and Effluent Limitations

Table 1 of this Notice provides a summary of applicable General Order discharge requirements for the subject system, both general and specific, and associated effluent limits.

In order to maintain coverage under the General Order, the Discharger is required to operate consistently with: (A) its approved Title 22 Engineering Report, (B) conditions of the Division of Drinking Water's approval letters (Notice Attachment E); (C) the 22 CCR Uniform Statewide Recycling Criteria; (D) the applicable Recycled Water Quality Requirements set forth below; and (E) the Monitoring and Reporting Program in Notice Attachment B.

Treatment system managers and operators must be familiar with the applicable requirements contained in the General Order, this Notice, and the Facility's Title 22 Engineering Report. General Order Provision E.2.k states that wastewater facilities shall be supervised and operated by persons possessing a wastewater treatment operator certificate

of the appropriate grade. 23 CCR sections 3680.1, *Grade Levels of Operators at Privately Owned Wastewater Treatment Plants*, and 3680, *Grade Levels of Operator Certification*, state the operator grade level requirements according to the wastewater treatment plant classification. Wastewater treatment plant classification criteria are defined in 23 CCR section 3675. The Facility aligns with a Class III wastewater treatment plant classification since it will provide tertiary treatment for a design flow of less than 1.0 million gallons day. For a Class III wastewater treatment plant, the Chief Plant Operator's minimum certification level is III and the Designated Operator-in-Charge must meet a minimum grade level of II. The State Water Board will review the wastewater plant classification form, make the final determination, and send a letter indicating the classification and appropriate operator grades. Contact the State Water Board Plant Classifications Analyst via email at wwopcrtprogram@waterboards.ca.gov. Additional information on the wastewater treatment plant classification process is accessible online at https://www.waterboards.ca.gov/water_issues/programs/operator_certification/wwtp.html.

1. Effluent Limitations

The wastewater treatment system is required to be operated and maintained to achieve the design objectives included in the Reports and to demonstrate compliance with technology-based performance effluent limits of a monthly average of 30 mg/L for both biochemical oxygen demand and total suspended solids. The numeric limits for these design objectives and effluent limits are presented in Notice Table 1.

Staff evaluated the need for a nitrogen effluent limit using the method contained in Attachment 1 of the General Order and determined a nitrogen effluent limit is not necessary at this time based on the depth to groundwater and the estimated annual average daily discharge to land flow rate. If the average discharge to land flow rate exceeds 20,000 gpd, staff will reevaluate the nitrogen effluent limit per Attachment 1 of the General Order. Due to the Facility's proximity to San Francisco Bay and a regional effort to monitor and assess nutrient loadings to the Bay, influent and effluent monitoring for total nitrogen is included in the attached Monitoring Program. The Monitoring Program also includes flow rate monitoring and requires the calculation of the wastewater treatment system's total nitrogen percent reduction.

2. Bypass

- a. There shall be no bypassing of untreated or partially treated wastewater from the recycled water treatment system or any intermediate unit process to the point of use.
- b. All unit processes must be well maintained and in operation at all times consistent with the original design and operational intent.

3. Recycled Water Filter Effluent Water Quality Standards

The Discharger shall ensure that the recycled water meets the following disinfected tertiary recycled water quality standards for unrestricted use established in 22 CCR sections 60301.230 and 60301.320, Water Recycling Criteria.

- a. Filtered oxidized wastewater that has passed through membrane filtration so that the turbidity does not exceed the following:

- i. 0.2 NTU² more than 5 percent of the time within a 24-hour period; and
 - ii. 0.5 NTU at any time.
- b. Total coliform measured in the disinfected effluent does not exceed the following:
 - i. 2.2 MPN / 100 mL² (7-day median);
 - ii. 23 MPN / 100 mL (not more than one sample in 30 days); and
 - iii. 240 MPN / 100 mL (maximum any sample).

4. Sampling and Analysis

- a. Disinfected tertiary recycled water shall be sampled at least once daily during the weekdays for total coliform bacteria. The samples shall be taken from the disinfected effluent and shall be analyzed by an approved laboratory as defined by 22 CCR section 60301.100.
- b. The Discharger shall ensure that disinfected tertiary recycled water is continuously sampled for turbidity using a continuous turbidity meter and recorded following filtration. Compliance with the daily average operating filter effluent turbidity shall be determined by averaging the levels of recorded turbidity taken at four-hour intervals over a 24-hour period. The daily average operating membrane filter effluent turbidity limits is 0.2 NTU more than 5 percent of the time within a 24-hour period.

Pursuant to 22 CCR section 60321(b), should the continuous turbidity meter and recorder fail and the recycled water is stored for distribution or distributed, grab sampling at a minimum frequency of 1.2-hours may be substituted for a period of up to 24 hours, to determine compliance with the disinfected tertiary daily average turbidity limits.

5. Operating Records and Reports

- a. Operating records shall be maintained at the Facility or a central depository within the operating agency, and available upon request. These shall include: all analyses specified in the recycled water criteria; records of operational problems, plant and equipment breakdowns, and diversions to emergency storage or disposal; all corrective or preventive action taken.
- b. Process or equipment failures triggering an alarm shall be recorded and maintained as a separate record file. The recorded information shall include the time and cause of failure and corrective action taken.

6. Notification

The Discharger shall notify the Regional Water Board, Division of Drinking Water, and local health agency of the following:

- a. Any incidence of backflow from the dual plumbed recycled water system into the potable water system within 24 hours of the discovery of the incident.
- b. Any discharge of untreated or partially treated wastewater to the use area, and the cessation of same.

² Units of measurement: NTU denotes Nephelometric Turbidity Unit; MPN / 100 mL denotes most probable number of coliform bacteria per 100 milliliters.

7. Cross-Connection Control

- a. Prior to the initial operation of the recycled water system and annually thereafter, the Discharger shall ensure that the Facility is inspected for possible cross connections with the potable water system. The recycled water system shall also be tested for possible cross connections at least once every four years. The testing shall be conducted in accordance with the method described in the report submitted pursuant to 22 CCR section 60314. The inspections and the testing shall be performed by a cross-connection control specialist certified by the California-Nevada section of the American Water Works Association or an organization with equivalent certification requirements.
- b. A written report documenting the result of the cross-connection inspection or testing for the prior year shall be submitted to the Regional Water Board and Division of Drinking Water within **30 days** following completion of the inspection or testing.
- c. Any backflow prevention device installed to protect the public water system serving the dual plumbed recycled water system must be inspected and maintained in accordance with 17 CCR section 7605.

8. Operations, Maintenance and Monitoring Plan

An Operations, Maintenance, and Monitoring Plan (Operations and Maintenance Plan) shall be developed and submitted to the Regional Water Board and the Division of Drinking Water for review and approval, in writing, prior to distribution and use of recycled water. The Operations and Maintenance Plan shall, at a minimum, discuss and include the following elements:

- a. Identify and describe the operations, maintenance, analytical methods, monitoring, and inspection necessary for each unit process.
- b. Standard Operating Procedures for membrane cleaning, equipment calibration, compliance monitoring, alarm testing, etc.
- c. A Preventative Maintenance and Capital Improvement Program to ensure that all equipment is kept in a reliable operating condition and replaced before they fail.
- d. Operating personnel, including the numbers of staff, certification levels and responsibilities to achieve the required level of treatment at all times.
- e. Operating records that include all analyses specified in the recycled water criteria; records of operational problems, plant and equipment breakdowns, and diversions to emergency storage or disposal; all corrective or preventive action taken. Process or equipment failures triggering an alarm must be recorded and maintained as a separate record file. The recorded information must include the time and cause of failure and corrective action taken.
- f. Monitoring and alarm systems for each unit process, including specific alarm set points.
- g. Monitoring and alarm systems to verify and ensure that excess ozone is destructed and not released into atmosphere.

9. Ultraviolet Disinfection

- a. The UV disinfection system must be operated in accordance with the Operations and Maintenance Plan that assures adequate disinfection, and shall meet the minimum specifications to provide virus inactivation equivalent to 22 CCR section 60301.230

disinfected tertiary recycled water requirement of a disinfection process that, when combined with the filtration process, has been demonstrated to inactivate and/or remove 99.999 percent of the plaque forming units of F-specific bacteriophage MS2, or polio virus in the wastewater.

- b. The UV disinfection system shall be operated at a minimum of 160 millijoules per square centimeter (mJ/cm^2), which is double the design UV dose of $80 \text{ mJ}/\text{cm}^2$, until a spot-check bioassay is conducted to establish the site-specific UV operating conditions.
- c. The spot-check bioassay test procedures or protocols shall be submitted to the Division of Drinking Water for review and approval prior to initiating the test.
- d. The spot-check bioassay test shall be conducted in accordance with the National Water Research Institute UV Disinfection Guidelines for Drinking Water and Water Reuse.
- e. Operating conditions for the UV disinfection system based on the spot-check bioassay test results will be provided by the Division of Drinking Water after the test has been completed and the test report submitted for review.
- f. The Contingency Plan included in the Title 22 Engineering Report section 2.9 shall delineate the actions to be taken in the event of a UV lamp breakage resulting in a mercury release.

10. New Uses Engineering Report

- a. Disinfected tertiary recycled water will be used onsite to serve flushed fixtures and landscape irrigation. Should Microsoft consider other uses of recycled water, such as use within HVAC cooling systems, or expansion of recycled water to additional facilities, an updated Title 22 Engineering Report shall be submitted to the Regional Water Board and the Division of Drinking Water for review and approval.
- b. The Discharger is responsible for assuring the Title 22 Engineering Report on file with the Regional Water Board and Division of Drinking Water remains current and accurate and addresses comments provided by both agencies during the permitting process.

11. City of Mountain View Conditions

The Facility is located within the City of Mountain View. To comply with the City's Customer Guidelines for Recycled Water Use and per the Title 22 Engineering Report section 4.6 *Employee Training*, submit the following to the City:

- a. Site supervisor annual self-inspection report, and
- b. Site supervisor training workshop certification of completion within 90 days of establishing a recycled water connection.

12. Blended Water Storage Conditions

The following conditions are applicable to the final four blending tanks to ensure safe storage of the blended recycled water for later use:

- a. The storage container must be located at least 50 feet from a drinking water source and 25 feet from a flowing surface water body.

- b. Although the tank lids are lockable, ensure there is proper screening and sealing of the tank to prevent the entry or egress of insects and mosquitos. The Environmental Protection Agency recommends a minimum of #24 mesh for vent screens.
- c. Reduce the potential for microbial growth in the recycled water distribution system and storage tanks by avoiding stagnation resulting from dead zones or prolonged periods of zero-flow or low flow that create long residence times.
- d. Any storage tank containing recycled water for reuse applications shall be managed in a manner to control odor or nuisance conditions.

13. Treatment System Conditions

- a. Oxidation reduction potential (ORP) electrodes used to monitor the ozone system performance are prone to fouling. The Discharger shall address cleaning the ORP sensor and maintaining its surface smooth in the Operations and Maintenance Plan.
- b. The AdvanTex Treatment System shall not be organically loaded more than:
 - i. 0.04 pounds BOD₅ per square foot per day (lbs BOD₅ / ft²-day) at design average flow; or
 - ii. 0.08 lbs BOD₅ / ft² at design maximum day flow.
- c. The AdvanTex Treatment System shall not be hydraulically loaded more than:
 - i. 25 gallons per day per square foot (gpd / ft²) at design average flow; or
 - ii. 50 gpd / ft² at design maximum day flow.
- d. The Pentair X-Flow Aquaflex 55 hollow fiber membrane modules shall not produce more than 20,000 gallons per day of permeate.

14. General Conditions

- a. The Discharger shall submit a notification report to the Regional Water Board following commencement of the operation of the treatment system resulting in recycled water uses. This report shall be submitted no later than **15 calendar days** after the treatment system is operational.
- b. The Discharger shall submit a report to the Regional Water Board providing complete plan-view design drawings of the completed wastewater system and all of its components. This report shall be submitted no later than **30 calendar days** after finalization of the as-built plans.
- c. The Discharger shall discontinue the distribution of recycled water to the indoor uses during any period in which it has a reason to believe that the quality of the recycled water is not meeting the Title 22 Uniform Statewide Recycling Criteria specifications.

D. Reports to be Submitted to the Regional Water Board

In accordance with General Order Provisions E.1.a, b, and c, the following technical reports, shall be submitted as described below and in the referenced Order Provisions and shall be acceptable to the Regional Water Board's Executive Officer.

The objective of these reports is to provide appropriate and current information about how to operate and maintain the treatment systems in order to assure adequate and reliable wastewater management for the life of the Facility, and ongoing compliance with waste discharge requirements.

Future Report Updates

The requirements herein address initial report submittals. As time proceeds, and the wastewater treatment system matures, it is anticipated that repairs, replacements, improvements or operational changes will occur, and these will need to be incorporated into the operating reports accordingly. Whenever any of these reports are updated, the Discharger shall submit the updated sections or revised report to the Regional Water Board.

1. **By not later than Monday, October 19, 2020**, the Discharger shall submit a **Spill Prevention and Emergency Response Plan** (Response Plan) consistent with the requirements of General Order Provision E.1.a. The Response Plan shall, at a minimum, address the following:
 - a. Operation and control of wastewater treatment
 - b. Solids handling
 - c. Collection and distribution system maintenance
 - d. Emergency response
 - e. Notification procedures, including the following:
 - i. Recycled water spills greater than 50,000 gallons or for spills that reach a surface water body in accordance with the recycled water spill notification protocol in Attachment D of this Notice.
 - ii. In the event of a wastewater collection system overflow.
 - iii. City of Mountain View staff contacts including the Fire Department Water Environment Specialist

The Response Plan can be combined with the Operations and Maintenance Plan outlined in Notice section C.8.

2. **By not later than Monday, October 19, 2020**, the Discharger shall submit a **Sampling and Analysis Plan** consistent with the requirements of General Order Provision E.1.b.
3. **By not later than Monday, October 19, 2020**, the Discharger shall submit a **Sludge Management Plan** consistent with the requirements of General Order Provision E.1.c.

E. Monitoring and Reporting Program

The Discharger shall comply with the Monitoring and Reporting Program in Attachment B, which is attached hereto and made part of this Notice by reference.

F. Enforcement

Please review this Notice carefully to ensure that it completely and accurately reflects the wastewater treatment system and discharge. If the Discharger violates the terms or conditions listed, the Regional Water Board may take enforcement action, including assessment of administrative civil liability, as authorized by provisions of the California Water Code (Water Code). Prior to allowing changes to the wastewater strength or generation rate, or if the method of waste discharge changes from that described in the Reports, you shall contact the Regional Water Board to determine if submittal of an updated Report of Waste Discharge or Title 22 Engineering Report is required.

The Discharger shall manage and discharge the waste subject to the terms and conditions of the General Order, this Notice, and the Title 22 Engineering Report and will maintain exclusive control over the discharges. As such, the Discharger is responsible for compliance with the General Order and this Notice.

G. Annual Fees

The Discharger is responsible for payment of an annual fee, pursuant to Water Code section 13260 and the Annual Fee Schedule as stated in 23 CCR section 2200. The fee amount is determined by the type of order and the Threat to Water Quality and Complexity rating. An application fee of \$5,145, which will also be the annual fee, was submitted to the Regional Water Board on November 6, 2019. This represents the fee for a discharge with a threat and complexity rating of 3-B. The Water Quality Fee Schedule is subject to change annually and is accessible online at http://www.waterboards.ca.gov/resources/fees/water_quality/#wdr.

The fee is due and payable on an annual basis once the recycled water uses commence until coverage under the General Order is formally rescinded. To rescind coverage, you must provide written notice if the wastewater discharge ceases so that we may terminate coverage. To terminate coverage voluntarily, the Discharger must submit in writing a Notice of Termination that includes, at a minimum, the Discharger's name and contact information, Facility name and address, and reason for requesting termination of coverage. However, termination shall not be considered effective until the Regional Water Board provides written approval of the Notice of Termination.

Authorization for Coverage under Order WQ 2014-0153-DWQ

I hereby approve the Microsoft Silicon Valley Wastewater and Rainwater Treatment System as described in the Report of Waste Discharge and Title 22 Engineering Report, and as approved by the Division of Drinking Water's letters, and the Regional Water Board herein, to henceforth be regulated under the General Order. Failure to abide by the conditions of the General Order, this Notice, the Monitoring and Reporting Program, and the Title 22 Engineering Report, could result in enforcement actions, as authorized by provisions of the California Water Code.

If you have any questions or comments, please contact Melissa Gunter of my staff at (510) 622-2390 or Melissa.Gunter@waterboards.ca.gov.

Sincerely,

for Michael Montgomery
Executive Officer

Tables: Table 1: Summary of Applicable General Order Requirements
Attachments: A. Figures: Site Location & Site Plan
Water Management Schematic
Process Flow Diagrams

- B. Monitoring and Reporting Program
- C. Water Quality Order WQ 2014-0153-DWQ
- D. Recycled Water Spill Notification Protocol
- E. Division of Drinking Water's dual plumbing and engineering report letters

Copy to (via email): City of Mountain View

Gregg Hosfeldt, Gregg.Hosfeldt@mountainview.gov
Elizabeth Flegel, Elizabeth.Flegel@mountainview.gov
Ankit Turner, Ankit.Sharma@mountainview.gov
Carrie Sandahl, Carrie.Sandahl@mountainview.gov

City of Palo Alto

Karin North, Karin.North@cityofpaloalto.org

Natural Systems Utilities

Cara Lucas, clucas@NSUWater.com

Sherwood Design Engineers

Amelia Luna, aluna@rewsprojects.com

Water Board

Eric Lacy, DDW, Eric.Lacy@waterboards.ca.gov
Van Tsang, DDW, Van.Tsang@waterboards.ca.gov
Margaret Monahan, Margaret.Monahan@waterboards.ca.gov

TABLE 1: SUMMARY OF APPLICABLE GENERAL ORDER REQUIREMENTS

General Order Section	Page	Numeric Limit	Requirement (refer to General Order and Notice for details)
A. PROHIBITIONS			
A.1-A.11	15	--	Prohibitions
B. REQUIREMENTS BY WASTEWATER SYSTEM TYPE			
B.1.a - B.1.l	16	• 25-foot setback from land application areas and flowing stream. • 50-foot setback from treatment system and flowing stream.	All Wastewater Systems, which includes the setback distances for Land Application Area (disinfected tertiary recycled water) in General Order Table 3.
B.1.a	16	Discharger shall not accept wastewater in excess of the wastewater treatment system's design capacity.	25,000 gallons per day
B.2.d & B.2.e	20	• Combined thickness of sludge & scum exceeds 1/3 of the tank depth of the first compartment. • Scum layer is within 3 inches of the outlet device. • Sludge layer is within 8 inches of the outlet device.	Conditions when septic tanks shall be pumped.
B.3.a - B.3.g	21	--	Aerobic Treatment Units - Refer to General Order sections
B.7.a - B.7.h	26	--	Land Application and/or Recycled Water Systems – Refer to General Order sections
B.8.a - B.8.f	26	--	Sludge/Solids/Biosolids Disposal - Refer to General Order sections
C. GROUNDWATER AND SURFACE WATER LIMITATIONS			
C.1	27	--	Refer to General Order section

D. EFFLUENT LIMITATIONS			
Activated Sludge, Membrane Bioreactor (MBR), or similar			
D.1.a	27	30 mg/L (monthly avg)	Five-day Biochemical Oxygen Demand (BOD ₅) (refer to General Order Table 4 for averaging allowances)
D.1.a	27	30 mg/L (monthly avg)	Total Suspended Solids (TSS) (refer to General Order Table 4 for averaging allowances)
California Code of Regulations Title 22 Water Recycling Criteria Requirements			
B.7.f	26	a. 2.2 MPN / 100 mL (7-day median); b. 23 MPN / 100 mL (not more than one sample in 30 days); & c. 240 MPN / 100 mL (maximum any sample)	If recycled water is applied to land or flushing fixtures, it shall comply with the Title 22 water recycling criteria. Total coliform organisms California Code of Regulations (CCR) Title 22 section 60301.230 requirements.
B.7.f	26	a. 0.2 NTU more than 5% of the time within a 24-hour period; & b. 0.5 NTU any time	Disinfected tertiary recycled water turbidity requirements following membrane filtration applicable to the domestic wastewater treatment system per CCR Title 22 section 60301.320.
E. PROVISIONS			
Technical Report Preparation Requirements			
E.1.a	28	Submit 90 days after Notice, DATE , to Regional Water Board for review & approval	Spill Prevention and Emergency Response Plan; Can be combined with the Operations and Maintenance Plan outlined in this Notice section C.8 . Also refer to Notice section D.1 for additional report requirements.
E.1.b	29	Submit 90 days after Notice, DATE , to Regional Water Board	Sampling and Analysis Plan
E.1.c	30	Submit 90 days after Notice, DATE , to Regional Water Board	Sludge Management Plan
E.2. all sections	30	--	Entire section provisions applicable to all wastewater treatment systems
E.2.h	32	Have onsite	A copy of the General Order, Notice, and Title 22 Engineering Report
E.2.k	32	Supervision	Certified wastewater treatment operator. Refer to Notice section C . Contact the State Water Board Plant Classifications Analyst at wwopcertprogram@waterboards.ca.gov
E.3.	34	--	General Reporting Requirements provisions applicable to all wastewater treatment systems
E.4.	35	--	Monitoring Requirements provisions applicable to all wastewater treatment systems

Attachment A

Figures


Microsoft Silicon Valley Campus Site Location Map

Water Management Schematic


Recycled Water System Site Plan

Recycled Water System Process Flow Diagram

LOCATION MAP

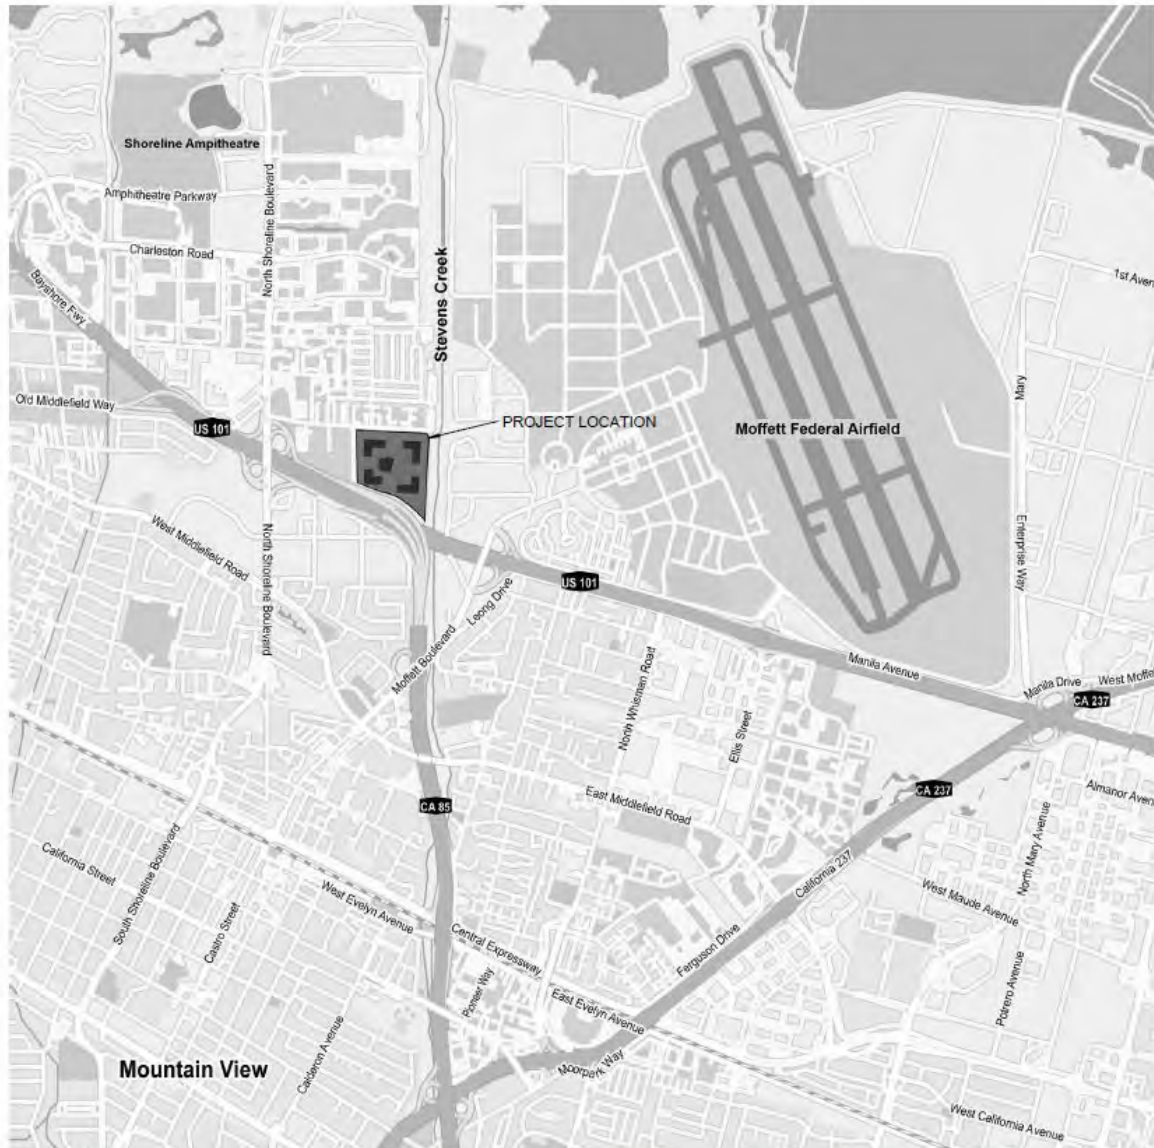

If this drawing is not 30"x48", then the drawing has been revised from its original size. Noted scales must be adjusted. This line should be equal to one inch.

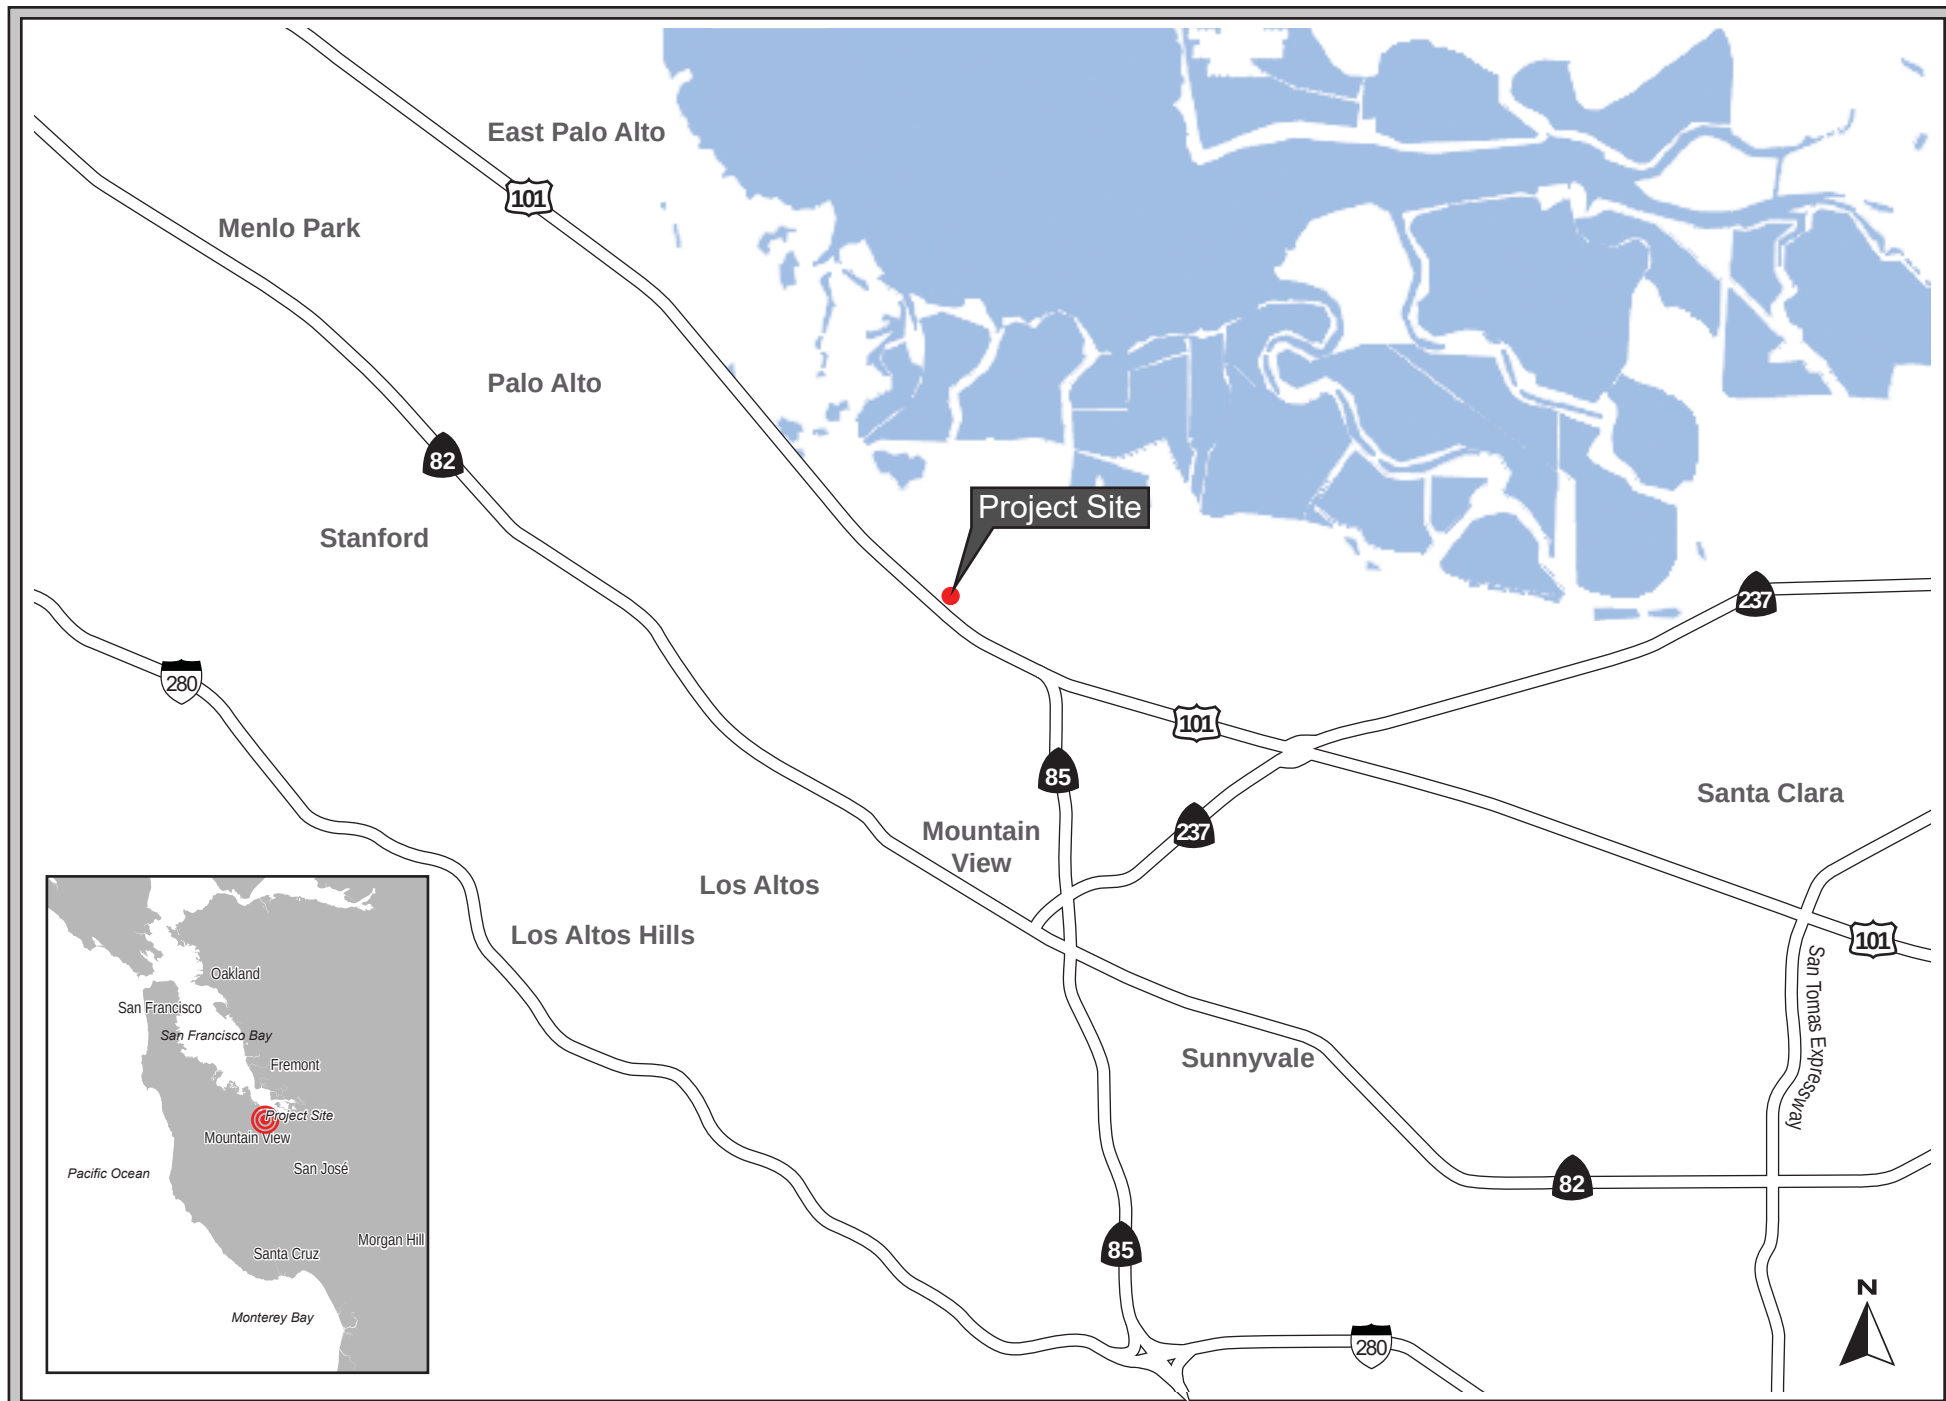

REGIONAL MAP


FIGURE 1



AERIAL PHOTOGRAPH AND SURROUNDING LAND USES

FIGURE 3

Figure 2: Microsoft Silicon Valley Campus Water Management Schematic

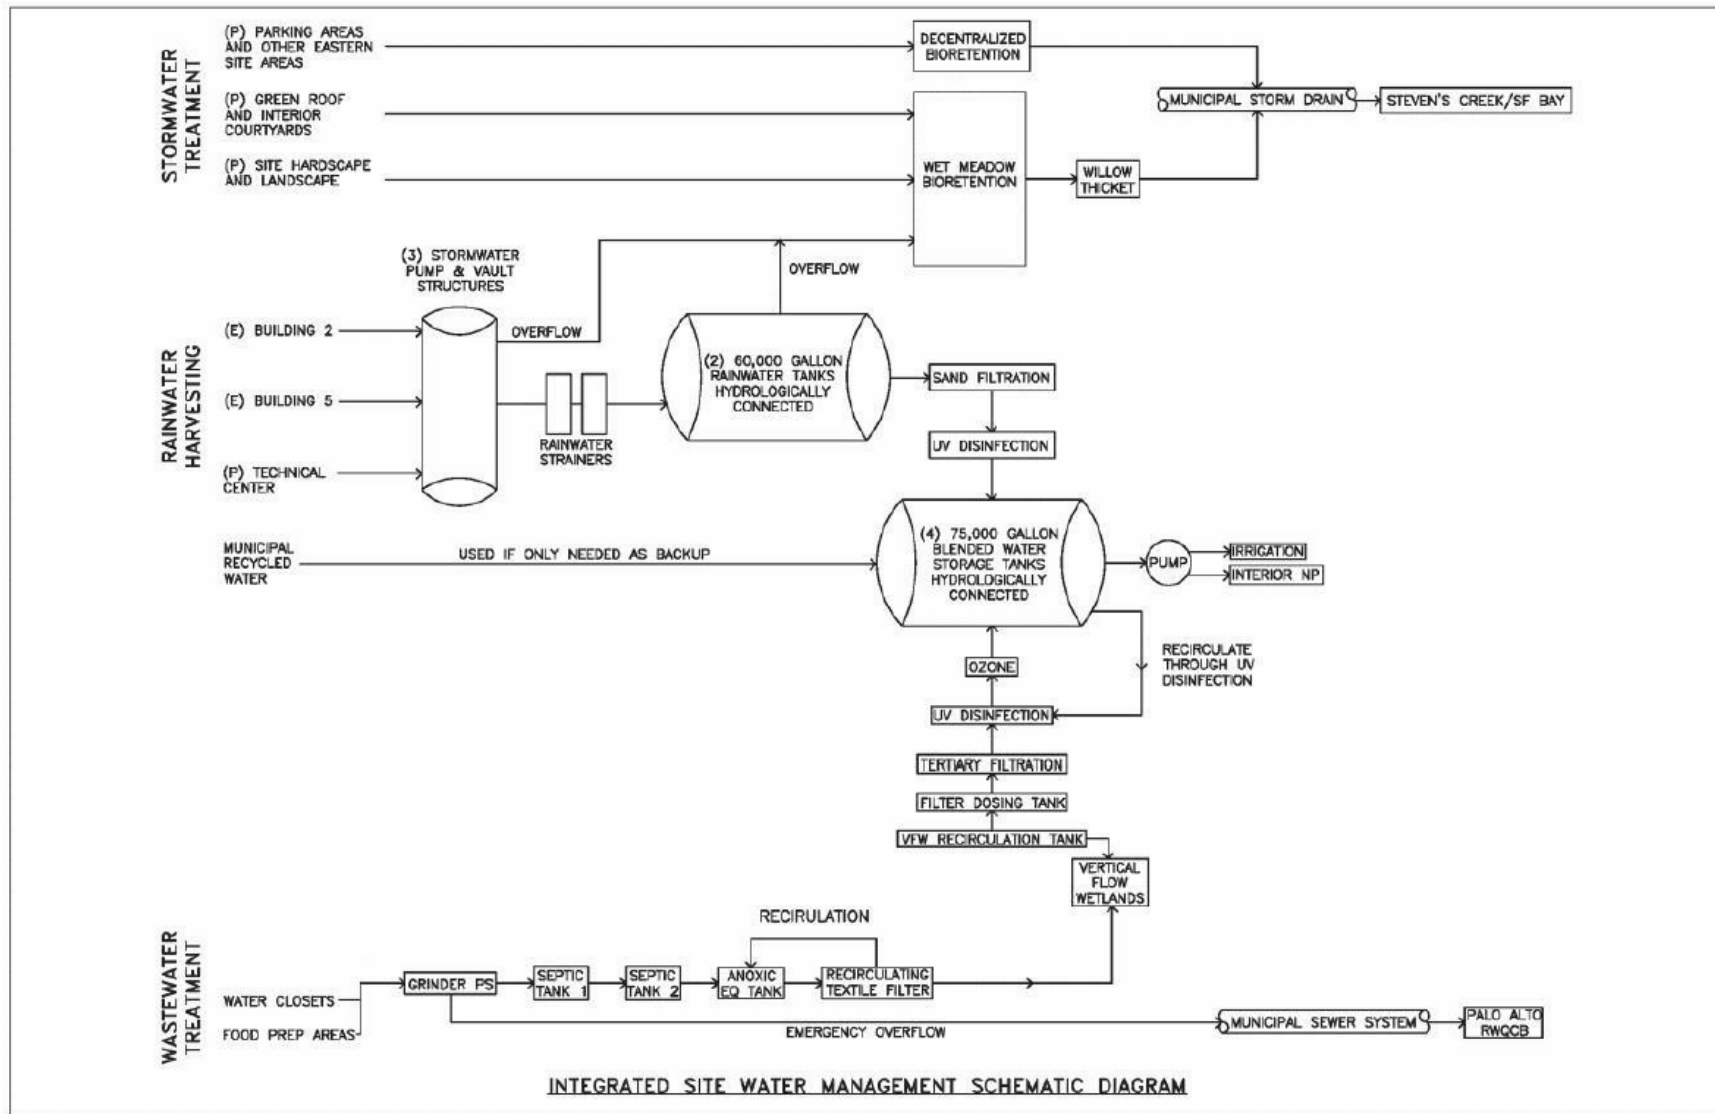

WRNSSTUDIO

501 SECOND STREET
4TH FLOOR, STE. 402
SAN FRANCISCO
CALIFORNIA 94107
415.489.2224 TEL
415.358.9100 FAX
WWW.WRNSSTUDIO.COM



477 DEVILN RD., SUITE 107
NAPA, CA 94558



MICROSOFT
SILICON VALLEY
CAMPUS

1065 La Avenida St
Mountain View, CA 94043

Design Team

MZAYODA
MCALLENTE
KSAIKKONEN
3/5/18
B01619
1001 Project No.
P 13823
M.S. Project No.

Approvals

CUSTOMER OPERATIONS
Microsoft Mechanical Engineer
Microsoft Cable Engineer
Microsoft Electrical Engineer
Engineering Manager
Security Manager
PROJECT MANAGEMENT
Project Planner
Senior Project Manager
Development Manager
Project Manager
Quality Control Reviewer
Quality Control FR&E


Revisions

No. Date Description
08/04/2017 PERMIT SET
12/07/2017 PERMIT PLAN CHECK 1
03/22/2018 PERMIT PLAN CHECK 2
A 12/07/2017 COMMENT RESPONSE
B 12/07/2017 GENERAL COORDINATION
D 03/22/2018 PPC2 COMMENT RESPONSE
E 03/22/2018 GENERAL COORDINATION

Registration



Key Plan

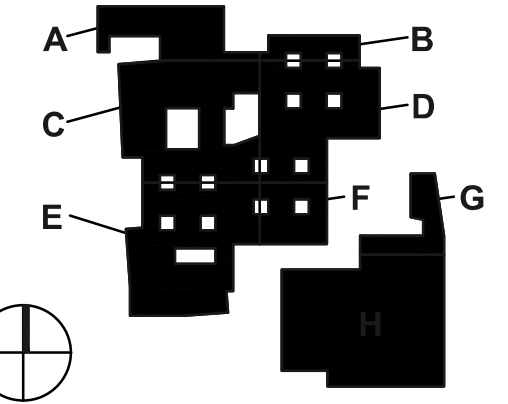

Bar Code

Sheet Title / Number

MICROSOFT SILICON VALLEY
CIVIL
ONSITE RECYCLED WATER SYSTEM
SITE PLAN

W - C - 01


PERMIT SCALE: 1"= 60' _XREF

NOTES:

1. ANY INSTALLATION FOR RECYCLED WATER IS REQUIRED TO HAVE A SPECIAL INSPECTION BY A CERTIFIED AWWA CROSS-CONNECTION SPECIALIST TO ENSURE THAT THE ON-SITE RECYCLED WATER SYSTEM WAS CONSTRUCTED PER THE APPROVED PLANS AND SPECIFICATIONS. A CERTIFIED AWWA CROSS-CONNECTION SPECIALIST SHALL SUBMIT A LETTER TO THE CITY OF MOUNTAINVIEW, PUBLIC SERVICES DIVISION AND BUILDING INSPECTION DIVISION, VERIFYING THAT THE ON-SITE RECYCLED WATER SYSTEM WAS CONSTRUCTED PER THE APPROVED PLANS AND SPECIFICATIONS.
2. A CROSS-CONNECTION TEST IS REQUIRED PRIOR TO RECEIVING RECYCLED WATER.
3. SEE CIVIL DRAWINGS C-G-01 TO C-G-05 FOR MUNICIPAL AND ONSITE RECYCLED WATER PIPING.

SHEET LIST	
SHEET NUMBER	SHEET TITLE
W-C-01	SITE PLAN
W-C-02	HYDRAULIC PROFILE
W-C-03	EQUIP. ROOM & STORAGE TANK PLAN
W-C-04	CIVIL DETAILS
W-P-01	PROCESS FLOW DIAGRAM
W-M-01	INFLUENT PUMP STATION
W-M-02	SEPTIC TANKS
W-M-03	ANOXIC TANK
W-M-04	ORENCO ADVANTEX SYSTEM
W-M-04A	ORENCO SECTIONS
W-M-04B	ORENCO SECTIONS 2
W-M-05	VFW DOSING & RECIRC TANK
W-M-06	VFW PLAN
W-M-07	VFW SECTIONS
W-M-08	EQUIPMENT ROOM PLAN
W-M-09	EQUIPMENT ROOM SECTION VIEWS
W-M-10	DISINFECTION SYSTEM
W-M-11	RAW RAINWATER LIFT STATIONS
W-M-12	RAINWATER STRAINER, FILTERS & PUMPS
W-M-13	RAINWATER STORAGE TANKS
W-M-14	BLEND STORAGE TANKS
W-M-15	MEMBRANE FILTER
W-M-16	RAINWATER & BLENDED STORAGE TANK SECTIONS & DETAILS
W-M-17	ORENCO UNIT
W-M-17A	ORENCO UNIT PLAN & DETAILS
W-E-01	ONE LINE DIAGRAM
W-E-02	CONTROL PANEL ONE LINE
W-E-03	SCHEDULES & JB DETAILS
W-E-04	ELECTRICAL SCHEDULES
W-E-05	ELECTRICAL SITE PLAN
W-D-01	SYMBOLS AND ABBREVIATIONS
W-D-02	INFLUENT PUMP STATION SEPTIC AND ANOXIC TANKS
W-D-03	AERATION TANKS
W-D-04	ADVANTEX UNITS
W-D-05	WETLANDS & MEMBRANE
W-D-06	OZONE & UV SYSTEMS
W-D-07	RAIN WATER SYSTEM 1
W-D-08	RAIN WATER SYSTEM 2

LEGEND

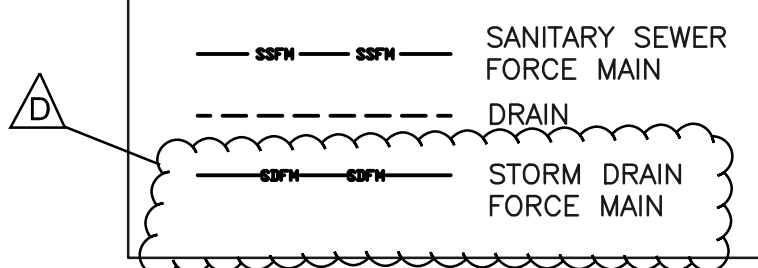

NOTE: FORCE MAINS TO AND FROM WETLAND MAY BE LOCATED IN SAME TRENCH AS NEEDED, SHOWN SEPARATELY FOR CLARITY.

Attachment B

Monitoring and Reporting Program for Order No. WQ 2014-0153-DWQ



**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION**

MONITORING AND REPORTING PROGRAM

for

**Microsoft Corporation's
Silicon Valley Wastewater and Rainwater Treatment Systems
CIWQS Place No. 860254**

**State Water Resources Control Board's
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS
ORDER WQ 2014-0153-DWQ**

Effective Date: July 20, 2020

TABLE OF CONTENTS

I.	GENERAL	3
A.	MONITORING AND REPORTING PROGRAM PURPOSE	3
B.	MONITORING AND REPORTING PROGRAM BASIS	3
II.	SAMPLING AND ANALYTICAL METHODS.....	4
III.	DEFINITION OF TERMS	5
IV.	MONITORING REQUIREMENTS	6
A.	SYSTEM OPERATION PROCESS CONTROL MONITORING	6
B.	DOMESTIC WASTEWATER AND FINAL BLENDED RECYCLED WATER MONITORING.....	7
C.	VOLUMETRIC REPORTING	9
D.	PATHOGEN REMOVAL / INACTIVATION INDICATORS & MONITORING	10
E.	ADVANTECH TREATMENT SYSTEM MONITORING	13
F.	VERTICAL FLOW TREATMENT WETLAND CELL MONITORING	14
G.	FINAL BLEND AND RAINWATER TANKS AND TREATMENT MONITORING	14
H.	LAND APPLICATION AREA MONITORING	14
I.	SOLIDS MONITORING	15
J.	DUAL PLUMBED RECYCLED WATER SYSTEMS	16
V.	REPORTING REQUIREMENTS	16
A.	MODIFICATION OF MONITORING PRACTICES	16
B.	INCREASED MONITORING FREQUENCY	17
C.	REPORTS OF VIOLATIONS	17
D.	MONITORING REPORTS	17
VI.	MONITORING PROGRAM CERTIFICATION	20

LIST OF TABLES

Table 1: Influent Monitoring Requirements.....	7
Table 2: Wastewater Treatment System Effluent Prior to the Blend Tank Monitoring Requirements	8
Table 3: Final Blended Recycled Water Monitoring Requirements	9
Table 4: Log ₁₀ Reduction Credits and Targets.....	12
Table 5: Pathogen Removal / Inactivation Monitoring Requirements.....	13
Table 6: Reporting Requirements for Disinfection System Exceedances	13
Table 7: Land Application Area Monitoring Requirements.....	14
Table 8: Primary Tank / Septic Tank Monitoring.....	16
Table 9: Dual Plumbed Recycled Water System Testing and Reporting Requirements	16
Table 10: Monitoring Data Reporting Schedule	18

I. GENERAL

A. MONITORING AND REPORTING PROGRAM PURPOSE

This Monitoring and Reporting Program (Monitoring Program) describes requirements for monitoring the Microsoft Silicon Valley Wastewater and Rainwater Treatment System located at 1065 La Avenida in Mountain View (Facility). The Facility is owned and operated by Microsoft Corporation (Discharger). The Discharger is responsible for compliance with the monitoring and reporting requirements specified in this Monitoring Program. The Facility is subject to the Notice of Applicability (Notice) of *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* Order WQ 2014-0153-DWQ (General Order). This Monitoring Program applies to the wastewater and rainwater treatment systems and associated discharges to land and recycled water uses described in the Report of Waste Discharge and the Title 22 Engineering Report submitted for the Discharger's coverage under the General Order and authorized in the Notice. This Facility-specific Monitoring Program replaces the model Monitoring and Reporting Program contained within the General Order Attachment C Information Sheet. Priority pollutant monitoring is not included in this Monitoring Program. The State Water Resources Control Board (State Water Board) removed priority pollutant monitoring requirements from the monitoring and reporting programs for dischargers that produce and use recycled water for landscape irrigation per Order No. WQ 2019-0036-EXEC.

Domestic wastewater will be collected and treated onsite to disinfected tertiary recycled water standards. The tertiary treated recycled water will be blended with treated rainwater for flushed fixtures and irrigation uses. The building will be dual plumbed to allow for the use of potable and non-potable water sources. The Facility consists of primary treatment, an anoxic / equalization tank, aeration tank, recirculating textile packed bed filters, polishing vertical flow wetlands with a recirculation tank, hollow fiber membrane ultrafiltration system, ultraviolet (UV) disinfection, and ozone disinfection. Collected rainwater will flow through basket strainers into two underground tanks. The stored rainwater will be pumped to a sand and gravel packed media filtration and a separate UV disinfection system. The blended recycled water and rainwater will be stored in four 75,000-gallon fiberglass storage tanks.

The principle purposes of a Monitoring Program by the Discharger are:

1. To document compliance with the General Order, Notice, Report of Waste Discharge, and Title 22 Engineering Report; and
2. To facilitate accountability and self-monitoring by the Discharger in the prevention and abatement of pollution or potential threats to water quality arising from waste discharges or recycled water use.

B. MONITORING AND REPORTING PROGRAM BASIS

Monitoring and reporting responsibilities of waste dischargers are specified in California Water Code (Water Code) sections 13267(b), 13268, and 13383. This Monitoring Program is issued pursuant to Water Code section 13267.

Water Code section 13267 states, in part:

“... the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state

who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports and shall identify the evidence that supports requiring that person to provide the reports.”

Water Code section 13268 states, in part:

“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of section 13399.2, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).

(b)(1) Civil liability may be administratively imposed by a regional board in accordance with article 2.5 (commencing with section 13323) of chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”

The monitoring reports are necessary to document the Discharger’s compliance with the Notice, General Order, and the California Code of Regulations Title 22 (22 CCR) Water Recycling Criteria, and the burden imposed in their preparation bears a reasonable relationship to the need for the reports and the benefits to be obtained from them. More specifically, the monitoring data are needed to evaluate the performance of recycled water production, distribution, and use and to assure protection of public health and the environment. Inconsistently treated or misused recycled water could expose people to pathogens or other harmful constituents and could adversely affect beneficial uses. Pursuant to Water Code section 13267, the Discharger shall implement this Monitoring Program and submit the monitoring reports described herein.

The monitoring requirements and practices described in the Monitoring Program are, generally, *minimum* levels of monitoring. Additional monitoring, other than as specified here, may be necessary to assure proper performance of the recycled water treatment systems, such as in response to treatment changes or investigations of uncertainties. If the Discharger monitors any pollutant at the locations designated herein more frequently than required by this Monitoring Program, using test procedures approved by the Code of Federal Regulations Title 40 (40 CFR), part 136, or as specified in this Monitoring Program, the results of such monitoring shall be included in the calculation and reporting of the data submitted in monitoring reports.

II. SAMPLING AND ANALYTICAL METHODS

1. All discharges to land and recycled water uses must be monitored by observations and measurements sufficient to adequately characterize the location, quantity, and quality of the discharges. Wastewater sources and treatment systems also must be monitored in order to verify that adequate and reliable treatment and management of the wastewater is being provided.

2. The Discharger shall maintain a sample chain of custody form that records the name of the sampler, sample type (grab or composite), time, date, location, and any preservative used for each sample, available to the Regional Water Board upon request. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished.
3. Field test instruments may be used if they are used by a State Water Board California Environmental Laboratory Accreditation Program certified laboratory, or:
 - a. The user is trained in proper use and maintenance of the instruments;
 - b. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
 - c. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
 - d. Field calibration reports are maintained and available for at least three years.
4. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
5. Collecting composite samples is acceptable in most cases. However, due to short sample holding times, bacteriological samples collected to verify disinfection effectiveness must be grab samples.
6. Flow measurement is the accurate measurement of the flow volume over a given period of time using a properly calibrated and maintained flow measuring device. Flow determination from a properly calibrated and maintained automated pump-use recording device, such as a pump dose event counter, for a calibrated and documented pump, is acceptable.

III. DEFINITION OF TERMS

The following definitions and descriptions of terms apply to the requirements of this Monitoring Program.

1. Sampling Frequency

Continuous	=	Continuous monitoring, for the full duration of the monitored event.
Daily	=	One time each calendar day.
Weekly	=	One time per calendar week, at intervals of about seven days.
Monthly	=	One time per calendar month, at intervals of about four weeks.
Quarterly	=	One time per calendar quarter, at intervals of about three months.
Annually	=	One time per calendar year.

Continuous Verification Monitoring = Ongoing confirmation of system performance using sensors for continuous observation of selected parameters, including surrogate parameters that are correlated with pathogen log₁₀ reduction target requirements.

2. Abbreviations

Monitoring Parameters

BOD ₅	=	Biochemical Oxygen Demand, 5-day, at 20° Celsius
TSS	=	Total Suspended Solids

TDS = Total Dissolved Solids
N = Nitrogen

Units

gpd = gallons per day
mg/L = milligrams per liter
NTU = Nephelometric Turbidity Unit
mJ/cm² = millijoule per square centimeter
s.u. = pH standard units

3. Description of Monitoring Stations

- a. **Monitoring Station Definitions.** Stations to be used for sampling and observations in accordance with this Monitoring Program shall be described in each monitoring report submitted in response to this Monitoring Program. The station description shall include a description of the water, wastewater, point of the wastewater system, or land area where specified monitoring is to be conducted.
- b. **Monitoring Station Changes.** Changes to the monitoring stations defined in this Monitoring Program may be authorized by the Executive Officer in order to accommodate changes in the wastewater or rainwater treatment systems or system operations or to provide improved monitoring. Requests for changes to the monitoring stations must be submitted to the Regional Water Board in writing, with a detailed explanation of the purpose of the proposed station changes. Proposed changes to monitoring stations must be approved in writing from the Executive Officer prior to implementation.
- c. **Site Plan Showing All Monitoring Stations.** The Discharger shall develop a legible plan view drawing that clearly depicts the locations of all major components of the wastewater and rainwater systems, all monitoring stations identified in this Monitoring Program, and relevant land use features such as buildings, access roads, property boundaries, and surface water drainage systems. A copy of this drawing shall be included with all reports submitted in response to this Monitoring Program.

IV. MONITORING REQUIREMENTS

A. SYSTEM OPERATION PROCESS CONTROL MONITORING

Title 22 Engineering Report section 2.8 Table 5 includes the parameters that the Discharger will monitor for wastewater and rainwater treatment systems process control and operational effectiveness. The Facility's process flow diagram W-P-01, included in Notice Attachment A, depicts sampling locations throughout the treatment systems. Continuous monitoring is recommended to demonstrate compliance with effluent water quality limitations, dose requirements, and other aspects of a treatment process related to treatment performance. The data collected can be assessed to determine whether the log₁₀ reduction targets in Table 4 are being met.

B. DOMESTIC WASTEWATER AND FINAL BLENDED RECYCLED WATER MONITORING

Domestic Wastewater Influent Monitoring

1. Influent samples shall be collected from a location that provides representative samples of the domestic wastewater quality entering the first primary treatment tank. Samples shall be collected at approximately the same time as effluent samples. The influent total nitrogen measurement will be compared to the effluent concentration to determine total nitrogen percent reduction. The total nitrogen reduction is not an effluent limitation.
2. The influent and effluent total coliform results will be compared to assess the effectiveness of the UV disinfection system in support of the log₁₀ reduction framework approach outlined in section IV.D of this Monitoring Program.
3. Two influent sampling events shall be conducted per year, one representative of wet season and one representative of dry season conditions. During each of the two sampling events, three influent samples shall be collected concurrently and analyzed for total nitrogen and total coliform. The influent sample collection dates shall align with the collection of the effluent samples that are also analyzed for total nitrogen and total coliform per Table 1.
4. At a minimum, influent monitoring shall consist of the following:

Table 1: Influent Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Flow, wastewater influent to treatment system	gpd	Meter	Continuous	Annually ¹
Total Nitrogen	mg/L	Grab	2 x / year Wet & Dry Season ² 3 samples collected per sampling event	Include in Quarterly report following sampling event
Total Coliform	MPN / 100 mL	Grab	2 x / year Wet & Dry Season ² 3 samples collected per sampling event	Include in Quarterly report following sampling event

1. The monthly influent wastewater flow values are reported annually via the State Water Board's GeoTracker Electronic Submittal of Information (ESI) system per section IV.C *Volumetric Reporting* of this Monitoring Program.
2. Collect and analyze three influent water samples during the wet season (generally from October to April) sampling event and three during the dry season (generally from May through September) sampling event. Collecting multiple samples during the sampling event will identify and quantify variability in the sampling and analytical results.

Effluent Monitoring

1. Effluent samples representative of the recycled water following the wastewater treatment system but prior to the final blended recycled water shall be collected from a location prior to the final blend tanks.
2. Monitoring of the disinfected tertiary treated effluent following treatment but prior to the final blended recycled water shall consist of the requirements listed in Table 2.
3. If treated domestic wastewater is discharged to the land surface for irrigation or used for flushing fixtures (toilets and urinals), then the final effluent shall be sampled daily when a discharge occurs during weekdays and analyzed for total coliform. This requirement does not apply to subsurface discharges of recycled water.
4. Effluent samples representative of the final blended recycled water shall be collected from a location following the final blend tanks, such as the reuse supply booster pumps.
5. Monitoring of the final blended recycled water shall consist of the requirements listed in Table 3.

Table 2: Wastewater Treatment System Effluent Prior to the Blend Tank Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Biochemical Oxygen Demand ₅ , monthly average	mg/L	Grab	Monthly	Quarterly
Total Suspended Solids, monthly average	mg/L	Grab	Monthly	Quarterly
Total Coliform ²	MPN/100 mL	Grab	Daily weekdays	Quarterly

1. The total nitrogen percent reduction values shall be calculated two times per year. The total nitrogen percent reduction shall be determined based on the three influent total nitrogen samples collected during the wet season (generally from October to April) and the three influent samples collected during the dry season (generally from May through September). The influent samples shall be collected concurrently with the effluent samples.
2. Changes to the total coliform sample collection frequency are dependent upon demonstration of treatment system performance and disinfection effectiveness per Monitoring Program sections IV.B and D, and Regional Water Board Executive Officer approval.

Table 3: Final Blended Recycled Water Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Flow, average daily discharged to land	gpd	Meter	Continuous	Quarterly
Flow, maximum daily discharged to land	gpd	Meter	Continuous	Quarterly
Flow, volume for indoor uses	gallons	Meter	Continuous	Quarterly: report monthly volume
Total Nitrogen	mg/L	Grab	Monthly	Quarterly
Total Nitrogen % Reduction	%	Calculate	2 x / year Wet & Dry Season ¹ 3 samples collected per sampling event. Collect influent & effluent total nitrogen samples concurrently.	Quarterly: when influent total nitrogen is measured
Total Dissolved Solids	mg/L	Grab	Monthly	Quarterly
Temperature, final blend tank	°F	Grab/sensor	Monthly for the 1 st year	Annually

C. VOLUMETRIC REPORTING

1. In order to establish an estimate of statewide recycled water use and potential for increased recycled water use statewide, the Water Quality Control Policy for Recycled Water (Recycled Water Policy) requires Dischargers to report the volume of treated recycled water.¹ Annual reporting is necessary to evaluate progress towards the recycled water goals in the Recycled Water Policy and evaluate the need to update the recycled water goals in the future based on consistent statewide data. Additional information on the recycled water volumetric reporting is accessible online at:
https://www.waterboards.ca.gov/water_issues/programs/water_recycling_policy/volumetric_annual_reporting.html.
2. The Discharger shall monitor recycled water volumes and **report annually** to the State Water Board's online **GeoTracker database by April 30** of each calendar year. The data shall be submitted to the GeoTracker database under a site-specific global identification number assigned by the State Water Board.

The GeoTracker Electronic Submittal of Information (ESI) system is accessible online at: <https://geotracker.waterboards.ca.gov/esi/login.asp>
3. The Discharger shall report annually in accordance with each of the applicable items in section 3 of the Recycled Water Policy as described below:

¹ The Water Quality Control Policy for Recycled Water was amended on December 11, 2018, and is accessible online at https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf.

- a. Influent.
Monthly volume of wastewater collected and treated by the wastewater treatment plant.
- b. Production.
Monthly volume of wastewater treated, specifying level of treatment.
- c. Discharge.
Monthly volume of treated wastewater discharged to land, where beneficial use is **not** taking place, specifying level of treatment.
- d. Reuse.
Monthly volume of recycled water distributed.
- e. Reuse Categories.
Annual volume of treated wastewater distributed for beneficial use in compliance with 22 CCR in each of the applicable use categories listed below:
 - 1) Landscape irrigation
 - 2) Commercial application: commercial facilities, business use (such as laundries and office buildings), car washes, retail nurseries, and appurtenant landscaping that is not separately metered.
 - 3) Industrial application: manufacturing facilities, cooling towers, process water, and appurtenant landscaping that is not separately metered.
 - 4) Other non-potable uses: including but not limited to dual plumbed flushing fixtures, dust control, flushing sewers, fire protection, fill stations, snow making, and recreational impoundments.

Note that the Recycled Water Policy includes other reuse categories that are not applicable to the Facility and are not stated herein.

4. GeoTracker guidance documents are also accessible online at:
 - a. Help Guide for Volumetric Annual Report in GeoTracker:
https://www.waterboards.ca.gov/ust/electronic_submittal/docs/var_helpguide.pdf
 - b. Electronic Submittal of Information Beginner's Guide for Responsible Parties:
https://www.waterboards.ca.gov/ust/electronic_submittal/docs/geotracker_esi_rp_beginners_guide_revisedoct2019.pdf
 - c. Frequently Asked Questions: Volumetric Annual Reporting of Wastewater and Recycled Water:
https://www.waterboards.ca.gov/water_issues/programs/water_recycling_policy/docs/2020/faq_volumetric_annual_reporting.pdf

D. PATHOGEN REMOVAL / INACTIVATION INDICATORS & MONITORING

1. The Water Environment & Reuse Foundation (WE&RF) publication entitled *Risk-based Framework for the Development of Public Health Guidance for Decentralized Non-potable Water Systems* provides wastewater treatment system risk-based fecal pathogen log₁₀ reduction targets for non-potable uses of onsite waters. The use of risk-based pathogen reduction credits is an attempt to achieve a

specific level of human health protection, typically expressed as a tolerable burden of disease.²

Log₁₀ reduction is defined by the National Blue Ribbon Commission (NBRC)³ as the removal of a pathogen or surrogate in a unit process expressed in log₁₀ units. A 1-log reduction equates to 90% removal, 2-log reduction to 99% removal, 3-log reduction to 99.9% removal, etc. Log₁₀ reduction targets were established for specified pathogen groups (e.g., viruses, bacteria, or protozoa) to achieve an agreed level of risk to individuals of an annual “tolerable” infection risk of 10⁻⁴ infection per year.² Meeting these log₁₀ reduction targets is dependent upon proper wastewater treatment system design, construction, operation, and maintenance. Pathogenic microorganism control is achieved by meeting log₁₀ reduction targets, which are verified through measurements of influent and effluent quality. In addition, the Facility includes continuous monitoring systems for detecting a surrogate parameter that correlates directly with log₁₀ reduction values for one or more of the reference pathogen groups.

Pathogen crediting frameworks generally consist of requirements for validation, field verification, and ongoing monitoring of treatment performance. For continuous log₁₀ reduction value verification of process performance, WE&RF stated that it is common to use non-biological surrogates monitored with instrumentation. The NBRC-published *A Guidebook for Developing and Implementing Regulations for Onsite Non-potable Water Systems* states that the recommended standard for pathogen removal and/or inactivation is to continuously monitor using microbial, chemical, or physical indicator(s) or surrogate parameter(s) that verify the performance of each treatment process’s ability to achieve its credited pathogen removal and/or inactivation.

Senate Bill No. 966, approved on September 28, 2018, requires the State Water Board to adopt regulations for risk-based water quality standards for the onsite treatment and reuse of non-potable water. The Facility will conduct additional continuous surrogate monitoring in preparation for the risk-based water quality standards and as a demonstration of the applicability of surrogate monitoring to support the risk-based framework approach.

The Facility’s wastewater treatment system includes ultrafiltration, UV disinfection, and ozone, each with varying pathogen reduction credits depending on the target pathogen and treatment component. The effectiveness of the Facility’s ultrafiltration treatment process will be demonstrated by the membrane filter permeation rate and turbidity. Continuous monitoring of the UV disinfection system’s influent UV transmittance, influent turbidity, UV dose, and flowrate will be conducted to verify that the pathogen log₁₀ reduction target is met. The continuously monitored parameters to

² Source: Water Environment & Reuse Foundation. 2017. Risk-Based Framework for the Development of Public Health Guidance for Decentralized Non-Potable Water Systems. Chapter 3. Risk-Based Pathogen Reduction Targets.

³ The National Blue Ribbon Commission for Onsite Non-potable Water Systems is comprised of 30 representatives from municipalities, public health agencies including the State Water Resources Control Board, water utilities, and national organizations. It is convened by the US Water Alliance, the Water Environment & Reuse Foundation, and the Water Research Foundation.

demonstrate the ozone unit performance are oxidation-reduction potential and turbidity.

The Facility's pathogen credits based on this framework are greater than the recommended values as indicated in Table 4, thus providing additional assurance of the capability to achieve pathogen removal and/or inactivation.

Table 4: Log₁₀ Reduction Credits and Targets

Pathogen Credits per Treatment Train Component to Meet 10 ⁻⁴ per Person per Year Infection Benchmark				Log ₁₀ Reduction Targets	
Pathogen Group	Ultrafiltration	UV Disinfection	Ozone	Total Provided by Microsoft Blackwater System	Recommended for indoor use ⁴
Virus	0	6	4	10	8.5
Giardia	4	6	3	13	7.0
Cryptosporidium	4	6	3	13	7.0
Bacteria	0	6	0	6	6.0

2. To demonstrate the effectiveness of the domestic wastewater treatment system components using the pathogen log₁₀ reduction framework approach, the Discharger shall continuously monitor the parameters in Table 5 at the applicable wastewater treatment system component monitoring locations. Following a minimum of six months of log₁₀ reduction potential verification through the continuously monitored parameters in conjunction with influent and effluent total coliform sampling results, the data will be reviewed by the Regional Water Board upon the request of the Discharger to assess the effectiveness of the surrogate water quality monitoring to demonstrate the treatment system pathogen reduction effectiveness. Based upon the results of the data assessment, experience gained in operating the Facility, and advances in risk-based methodologies, modifications to the monitoring program can be made in accordance with section V.A of this Monitoring Program.
3. Continuous monitoring of the disinfected tertiary recycled water UV transmittance and dose shall be conducted to ensure compliance with the facility-specific operating conditions and 22 CCR requirements. The daily minimum UV transmittance and the daily minimum hourly average UV dose shall be monitored. The data shall be maintained on file and available to the Regional Water Board upon request. If the UV dose falls below the minimum operating conditions and the recycled water is distributed for use or to a use area, the event shall be reported to the Regional Water Board in accordance with section V.C of this Monitoring Program.

⁴ Source: Water Environment & Reuse Foundation. 2017. Risk-Based Framework for the Development of Public Health Guidance for Decentralized Non-Potable Water Systems. Table 3-3.

Table 5: Pathogen Removal / Inactivation Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Membrane filter permeation rate	psi	Continuous	Continuous	Quarterly ¹
Turbidity, influent to UV ²	NTU	Meter	Continuous	Quarterly • Report Daily Average, 95th Percentile & Maximum • Report Exceedances of Title 22 Turbidity Limits in Table 6
Ultraviolet (UV) Transmittance, influent	%	Meter	Continuous ³	Quarterly
UV Dose	mJ/cm ²	Meter / Calculated	Continuous	Quarterly • Report Exceedances of UV dose Limit in Table 6
Oxidation Reduction Potential (ORP); Ozone system	Millivolts	Grab / Meter	Continuous	Quarterly ⁴
Temperature at time of ORP sample collection	°C or °F	Grab / Meter	Weekly	Quarterly

1. Data must be collected to understand typical variability in the membrane filter permeation rate for the ultrafiltration unit process. The membrane filter permeation rate is monitored continuously. The reported values that reflect change in pressure indicative of treatment effectiveness will be determined based upon data collection and review.
2. Turbidity requirements are per 22 CCR section 60301.320(b).
3. Although the parameters are monitored continuously, report the daily minimum UV transmittance and minimum hourly average UV dose values.
4. Data must be collected to understand typical variability in the oxidation reduction potential for the ozone system process. The oxidation reduction potential is monitored continuously. The reported value that reflects change in the oxidation reduction potential indicative of treatment effectiveness will be determined based upon data collection and review.

Table 6: Reporting Requirements for Disinfection System Exceedances

Parameter	Report Exceedance Value
UV Dose	< 160 mJ/cm ²
Total Coliform Bacteria	> 2.2 MPN / 100 mL rolling 7-day median > 23 MPN / 100 mL 30-day maximum if more than 1 exceedance occurs during 30-day period. Can exceed maximum limit once. > 240 MPN / 100 mL any time
Turbidity	> 0.2 NTU more than 5% in 24 hours > 0.5 NTU any time maximum

E. ADVANTEX TREATMENT SYSTEM MONITORING

1. All components of the AdvanTex Treatment System shall be inspected for

proper operation by a qualified service provider/vendor, as recommended by the manufacturer and specified in the Operation and Maintenance Manual.

2. A **summary of the inspections** shall be submitted with the next regularly scheduled monitoring report.

F. VERTICAL FLOW TREATMENT WETLAND MONITORING

1. The vertical flow wetland or vegetated recirculating gravel filter shall be visually inspected **weekly**, at a minimum, for proper operation including the following:⁵
 - a. Maintenance of flow uniformity (inlet and outlet structures), which include indicators that the flow is backing up, ponding, or causing flow cavities.
 - b. Pumps and flow controls. All pump controls and flow distribution devices and controls shall be inspected for proper operation as recommended by the manufacturer.
 - c. Vegetation health.
 - d. Odor control.
2. A **summary of inspections** that resulted in corrective actions shall be submitted with the next regularly scheduled monitoring report.

G. FINAL BLEND AND RAINWATER TANKS AND TREATMENT MONITORING

1. All components and appurtenances of the final blend tanks and the rainwater storage tanks, including but not limited to, risers, valves, and air gaps, shall be inspected **weekly**, at a minimum, for proper operation by a qualified service provider, vendor, or Facility operator.
2. A **summary of inspections** that resulted in corrective actions shall be submitted with the next regularly scheduled monitoring report.

H. LAND APPLICATION AREA MONITORING

1. The Discharger shall monitor land application areas **monthly, at a minimum**, when recycled water is applied. If recycled water is not applied during a reporting period, then state so in the monitoring report. Land application area monitoring shall include the requirements listed in Table 7.

Table 7: Land Application Area Monitoring Requirements

Parameter	Sample Type	Monitoring Frequency	Reporting Frequency
Observation of land application areas Refer to Monitoring Program section IV.H.2	Observation	Monthly, minimum	Quarterly

⁵ Source: Environmental Protection Agency. September 2000. Constructed Wetlands Treatment of Municipal Wastewaters, Chapter 6. EPA/625/R-99/010.

2. Land Application Area Observations

The following observations shall be conducted **monthly, at a minimum**, when recycled water is being discharged to land. Refer to the Standard Observations template at the end of this Monitoring Program.

- a. Check discharge system control equipment (e.g., valves, pumps, meters, etc.) for proper functioning. Note operational status during observations (e.g., on/off; in use/not in use).
- b. Check all irrigation emitters for proper operational status (e.g., proper height, direction, and trajectory).
- c. Check for evidence of recycled water escaping the discharge areas and offsite through uncontrolled surface runoff or through airborne spray. If recycled water escape is observed, show the source and affected area on a site plan drawing.
- d. Check perimeter drainage ways and other runoff control systems for proper condition.
- e. Check for odor from discharge areas. If nuisance odors are observed, describe the odor, indicate apparent source or cause, direction of travel, and any public use area or offsite area affected by the odors.
- f. Check for evidence of recycled water breaching land surface or ponding, and/or evidence of mosquitoes breeding within the discharge area due to ponded water. Note the course of action taken in response to recycled water breaching land surface or ponding.
- g. Check the soil for impacts related to the accumulation of salts, which can be indicated by the following symptoms: White crust on soil surface, water-stressed plants, leaf tip burn, poor drainage, black powdery residue on soil surface, and grey-colored soil.
- h. Check that warning signs are properly posted to inform public that irrigation water is recycled water that is not safe for drinking.

I. SOLIDS MONITORING

1. The Discharger shall report **annually** the handling and disposal of all solids (e.g., screenings, sludge, biosolids, etc.) generated at the wastewater and rainwater treatment systems.
2. All septic tanks and grease interceptors shall be inspected, and serviced if needed, as frequently as necessary to assure continued proper operation.
3. Primary treatment tanks / septic tanks shall be inspected and pumped when any one of the following conditions exists:
 - a. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
 - b. The scum layer is within 3 inches of the outlet device.
 - c. The sludge layer is within 8 inches of the outlet device.
 - d. It is determined to be necessary based on the Operations and Maintenance Plan.

4. The monitoring in Table 8 shall be implemented for each primary treatment tank / septic tank inspection, unless other equivalent facility-specific monitoring is specified in the Operations and Maintenance Plan.

Table 8: Primary Tank / Septic Tank Monitoring

Parameter	Units	Reporting Frequency
Sludge depth and scum thickness in each compartment of each septic tank	feet	Annually
Distance between bottom of scum layer and bottom of outlet device	inches	Annually
Distance between top of sludge layer and bottom of outlet device	inches	Annually

J. DUAL PLUMBED RECYCLED WATER SYSTEMS

The frequency of testing for cross-connection and backflow prevention devices shall be as listed in Table 9 or more frequently if specified by the State Water Board's Division of Drinking Water.

Table 9: Dual Plumbed Recycled Water System Testing and Reporting Requirements

Requirement	Frequency	Reporting Frequency
Cross-Connection Testing	Four Years ^(a)	30 days/Annually ^(b)
Backflow Incident	--	24 hours from discovery
Backflow Prevention Device Testing and Maintenance	Annually ^(c)	Annually

^(a) Testing shall be performed at least every four years, or more frequently at the discretion of the State Water Board's Division of Drinking Water.

^(b) Cross-connection testing shall be reported pursuant to 22 CCR section 60314. The report shall be submitted to Division of Drinking Water within 30 days and included in the annual report to the Regional Water Board.

^(c) Backflow prevention device maintenance shall be tested by a qualified person as described in 17 CCR section 7605.

V. REPORTING REQUIREMENTS

A. MODIFICATION OF MONITORING PRACTICES

1. Modifications of the monitoring and reporting practices specified in this Monitoring Program may be authorized by the Executive Officer, in consideration of acceptable accumulated data and acceptable alternate means of monitoring. Factors to be considered include the following: data quality, adequate characterization of the identified water or wastewater system process, consistency of system performance, compliance with waste discharge requirements for a minimum of six months, and acceptable means for providing equivalent and adequate monitoring of the identified water or wastewater system process.

2. Requests for modification of monitoring frequencies must be submitted to the Regional Water Board in writing, with a technical report that includes an evaluation of accumulated data, and a complete description of proposed alternate means of monitoring.
3. Proposed modifications of monitoring practices must be approved in writing from the Executive Officer prior to implementation.

B. INCREASED MONITORING FREQUENCY

1. If any monitoring indicates a violation of waste discharge requirements or unstable wastewater system operation or performance, or if any specified samplings or analyses are not completed as required, then the monitoring for the parameter(s) and monitoring station(s) in concern shall immediately and henceforth be conducted at twice the frequency identified in Table 2 of this Monitoring Program. This increased monitoring frequency shall be maintained for at least two sampling events and until such time as the results of monitoring indicate violations are no longer occurring or the problem has been corrected and the wastewater system has returned to stable operation and performance.
2. The Discharger shall discontinue the distribution of recycled water to the indoor uses during any period in which it has a reason to believe that the quality of the recycled water is not meeting the Title 22 Uniform Statewide Recycling Criteria specifications.

C. REPORTS OF VIOLATIONS

In the event the Discharger violates or threatens to violate the conditions of the waste discharge requirements, the Discharger or Discharger's agent(s) **shall notify the Regional Water Board office by email and telephone** as soon as the Discharger or Discharger's agent has knowledge of the incident. Written notification shall be submitted **within 10 business days** of the date of the incident, unless directed otherwise by Water Board staff.

The written notification shall include pertinent information explaining reasons for the non-compliance and shall indicate what steps were taken to correct the problem and the dates thereof, and what steps are being taken to prevent the problem from recurring.

Contact Information

San Francisco Bay Regional Water Quality Control Board
Contact: Melissa Gunter
Email: Melissa.Gunter@waterboards.ca.gov
Phone: (510) 622-2390
Mail: 1515 Clay Street, Suite 1400
Oakland, CA 94612

D. MONITORING REPORTS

The Discharger shall submit to the Regional Water Board monitoring reports documenting the wastewater and rainwater treatment systems operation and performance, and

compliance with the General Order, Notice, and Title 22 Engineering Report in accordance with the following:

1. Reporting Frequency and Schedule

Monitoring reports shall be submitted quarterly for each calendar quarter to the Regional Water Board by the first day of the second month following the three-month monitoring period, as stated in Table 10.

Table 10: Monitoring Data Reporting Schedule

Due Date	Report	Reporting Period
May 1	1 st Quarter	January 1 through March 31
August 1	2 nd Quarter	April 1 through June 30
November 1	3 rd Quarter	July 1 through September 30
February 1	4 th Quarter	October 1 through December 31

2. “As-Built” Plans of Completed Wastewater System

The Discharger shall submit a report to the Regional Water Board providing complete plan-view design drawings of the completed wastewater system and all of its components. This report shall be submitted no later than **30 calendar days** after finalization of the as-built plans.

3. Treatment System Commencement Progress Report

The Discharger shall submit a notification report to the Regional Water Board following commencement of the operation of the treatment system resulting in recycled water uses. This report shall be submitted no later than **15 calendar days** after the treatment system is operational.

4. Electronic Reporting Format

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., influent, effluent, etc.), and reported analytical results for each sample are readily discernible. The data shall be summarized in such a manner to clearly illustrate compliance with the General Order and indicate temporal trends, as applicable.

The monitoring reports shall be submitted to the Regional Water Board as electronic files and the data in spreadsheet format. All electronic files shall be submitted via the Regional Water Board’s centralized email address:

WDR.monitoring@waterboards.ca.gov.

When an additional electronic reporting method becomes available, such as the Water Boards’ electronic database GeoTracker⁶, the Discharger will be required to submit technical and monitoring reports via that method. At that time, analytical data shall be uploaded to the GeoTracker database under a site-specific global identification number.

⁶ The Regional Water Board will be transitioning to the use of the GeoTracker electronic database at a future date. At which time, the Discharger will be notified. An Electronic Submittal of Information *Beginner’s Guide* and *ESI Guide for Responsible Parties* are available online in the “Getting Started” section at http://www.swrcb.ca.gov/water_issues/programs/ust/electronic_submittal/.

5. **Monitoring Report Content.** Each monitoring report shall include, at a minimum, the following components:
 - a. Transmittal letter.
 - b. Summary table of the results of the influent, effluent, solid waste and sludge monitoring, and observations, such as, but not limited to, the following:
 - 1) Date of sampling or observation,
 - 2) Location of sampling or observation (sample station),
 - 3) Parameter of analysis,
 - 4) Result of the analysis, measurement, or observation **from the current reporting period and previous reporting periods** for the influent and effluent monitoring, and
 - 5) Laboratory reports indicating the recycled water quality analytical results.
 - c. A comparison of monitoring data to the discharge specifications and applicable effluent limits.
 - d. Facility site plan diagram that depicts the Facility, locations of all key wastewater and rainwater system components (e.g., septic tanks, treatment units), and stations where sampling or observations occur.
 - e. Discussion of any violations of the General Order, Notice, or Title 22 Engineering Report, that addresses the following:
 - 1) Date and time of occurrence;
 - 2) Location of occurrence indicated on a plan drawing of the Facility and/or site and, if applicable, affected land areas;
 - 3) Description of the violation; and
 - 4) Corrective actions taken or planned to correct the problem, including but not limited to, increased monitoring, treatment system equipment or operation modifications. If a report describing corrective actions and/or a time schedule for implementation of actions was previously submitted, reference to the report is satisfactory.
6. **Transmittal Letter.** A transmittal letter shall accompany each monitoring report submitted. The letter shall include the following:
 - a. Identification of:
 - 1) Facility name and address;
 - 2) Monitoring period being reported;
 - 3) Violations of the General Order, Notice, or Title 22 Engineering Report requirements, and
 - 4) Name and telephone number of a person familiar with the report and treatment systems, for follow-up discussions.
 - b. The transmittal letter shall contain the following certification statement and shall be signed by the Discharger or the Discharger's authorized agent:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of the those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

VI. MONITORING PROGRAM CERTIFICATION

The Discharger shall implement this Monitoring and Reporting Program as of the effective date given below.

I, Michael Montgomery, Executive Officer, hereby certify that this Monitoring and Reporting Program:

1. Has been developed in accordance with the procedure set forth in the Board's Resolution No. 73-16 in order to obtain data and document compliance with waste discharge requirements for the subject wastewater systems.
2. May be reviewed at any time subsequent to the effective date upon written notice from the Executive Officer or request from the Discharger, and revisions will be ordered by the Executive Officer.
3. Is effective on July 20, 2020.



for MICHAEL MONTGOMERY
Executive Officer

LAND APPLICATION AREA STANDARD OBSERVATIONS TEMPLATE

General Waste Discharge Requirements for
Small Domestic Wastewater Treatment Systems
Order WQ R2-2014-0153-DWQ Monitoring and Reporting Program

The use of this template is optional but is intended to aid the Discharger in reporting the standard land application area observations required in **Section IV.H** of the Monitoring Program. The tables may be reconstructed, and figures and additional information may be added.

The following observations shall be conducted **monthly**, at a minimum, when recycled water is discharged to land. Indicate if the answers are not applicable by entering 'N/A'.

Land Application Area Observations	
1. Check discharge system control equipment (e.g., valves, pumps, meters, etc.) for proper functioning. Note operational status during observations (e.g., on/off; in use/not in use).	☐ Inspection Date _____ ☐ Inspection Date _____
2. Check all irrigation emitters for proper operational status (e.g., proper height, direction, and trajectory).	☐ Inspection Date _____ ☐ Inspection Date _____
3. Check for evidence of recycled water escaping the discharge area and offsite through uncontrolled surface runoff or through airborne spray. If recycled water escape is observed, show the source and affected area on a site plan drawing.	☐ Inspection Date _____ ☐ Inspection Date _____
4. Check perimeter drainage ways or other runoff control systems for proper condition.	☐ Inspection Date _____ ☐ Inspection Date _____
5. Check for odor from discharge areas. If nuisance odors are observed, describe the odor, indicate apparent source or cause, direction of travel, and any public use area or offsite area affected by the odors.	☐ Inspection Date _____ ☐ Inspection Date _____
6. Check for evidence of recycled water breaching the land surface or ponding, and/or evidence of mosquitoes breeding within the discharge areas due to ponded water. Note the course of action taken in response to recycled water breaching land surface or ponding.	☐ Inspection Date _____ ☐ Inspection Date _____

Land Application Area Observations

7. Check the soil for impacts related to the accumulation of salts. Circle the symptoms that apply.

a. White crust on soil surface. Water-stressed plants. Leaf tip burn.

b. Poor drainage. Black powdery residue on soil surface.

c. Grey-colored soil.

☐ Inspection Date _____

☐ Inspection Date _____

☐ Inspection Date _____

☐ Inspection Date _____

8. Check that warning signs are properly posted to inform public that irrigation water is recycled water which is not safe for drinking.

☐ Inspection Date _____

☐ Inspection Date _____

☐ Inspection Date _____

☐ Inspection Date _____

Attachment C

General Waste Discharge Requirements for Small Domestic Wastewater
Treatment Systems Order No. WQ 2014-0153-DWQ



**STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 2014-0153-DWQ**

**GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS**

September 23, 2014



September 23, 2014

THIS PAGE INTENTIONALLY LEFT BLANK

STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 20140-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS

Contents

ACRONYMS AND ABBREVIATIONS	i
BACKGROUND INFORMATION.....	1
WASTEWATER DISPERSAL.....	5
APPLICATION PROCESS	8
ANTIDegradation ANALYSIS.....	8
TITLE 27 EXEMPTION.....	11
CALIFORNIA ENVIRONMENTAL QUALITY ACT.....	12
OTHER REGULATORY ISSUES	13
IT IS HEREBY ORDERED	15
A. Prohibitions.....	15
B. Requirements by Wastewater System Type.....	16
1. All Wastewater Systems.....	16
2. Septic Systems	20
3. Aerobic Treatment Units.....	21
4. Activated Sludge Systems	23
5. Pond Systems.....	23
6. Subsurface Disposal Systems.....	24
7. Land Application and/or Recycled Water Systems	26
8. Sludge/Solids/Biosolids Disposal.....	26
C. Groundwater and Surface Water Limitations:.....	27
D. Effluent Limitations:.....	27
E. Provisions	28
1. Technical Report Preparation Requirements.....	28
2. For All Wastewater Systems:.....	30
3. General Reporting Requirements:	34
4. Monitoring Requirements	35
5. Definitions.....	37
CERTIFICATION	38

List of Tables

Table 1: Summary of Domestic Wastewater Characteristics	2
Table 2: Summary of Wastewater System and California Code of Regulations, Title 27 Exemptions	12
Table 3: Summary of Wastewater System Setbacks	19
Table 4: Effluent Limitations for Wastewater Treatment Systems	28
Table 5: Minimum Depth to Groundwater and Minimum Soil Depth from the Bottom of Dispersal System.....	1-3

General Order Attachment

<u>Document</u>	<u>Number</u>	<u>Attachment Title</u>	
Attachment	1	Nitrogen Effluent Limit Evaluation	 1-1

Information Sheet Attachments

<u>Document</u>	<u>Number</u>	<u>Attachment Title</u>	
Information Sheet		Information Sheet Summary	.. INFO-1
Information Sheet	A	Generalized Permit Application Process Summary	 A-1
Information Sheet	B1	Recommended Report of Waste Discharge Format	 B1-1
Information Sheet	B2	Safe Wastewater Disposal for Recreational Vehicles	 B2-1
Information Sheet	C	Model Monitoring and Reporting Program	 C-1

STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 20140-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS

ACRONYMS AND ABBREVIATIONS	
afy	acre feet per year
AGR	Agricultural Supply
Antidegradation Policy	State Water Board Resolution 68-16
APMP	Advanced Protection Management Program
AQUA	Aquaculture
Basin Plan	Water Quality Control Plan
BOD	Biochemical Oxygen Demand
BPTC	Best Practicable Treatment or Control
CalOES	California Office of Emergency Services
CDPH	California Department of Public Health
CEC	Constituents of Emerging Concern
CEQA	California Environmental Quality Act
C.F.R.	Code of Federal Regulations
DDW	State Water Board, Division of Drinking Water
E. coli	Escherichia coli
e.g.	Latin <i>exempli gratia</i> (for example)
FDS	Fixed Dissolved Solids
FEMA	Federal Emergency Management Agency
FRESH	Fresh Water Replenishment
General Order	General Waste Discharge Requirements Order
gpd	gallons per day
GWR	Groundwater Recharge
I/I	Inflow and Infiltration
IND	Industrial Service Supply
LAA	Land Application Area
MBR	Membrane Biological Reactor
MCL	Maximum Contaminant Level
mg/L	Milligrams per liter
MPI	Minutes Per Inch
MPN	Most Probable Number
MRP	Monitoring and Reporting Program
MUN	Municipal Supply
N	Nitrogen
NOA	Notice of Applicability
NPDES	National Pollutant Discharge Elimination System
NTU	Nephelometric Turbidity Unit
OWTS Policy	Onsite Wastewater Treatment System Policy
P	Phosphorus
pdf	Portable Document Format
Perc Rate	Percolation Rate
PROC	Industrial Process Supply
REC-1	Water Contact Recreation
Regional Water Board	Regional Water Quality Control Board

ACRONYMS AND ABBREVIATIONS	
RV	Recreational Vehicle
ROWD	Report of Waste Discharge
SAP	Sampling and Analysis Plan
SNMP	Salt and Nutrient Management Plan
State Water Board	State Water Resources Control Board
TBD	To Be Determined
TDS	Total Dissolved Solids
TKN	Total Kjeldahl Nitrogen
TMDL	Total Maximum Daily Load
TSS	Total Suspended Solids
USEPA	United States Environmental Protection Agency
Wat. Code	Water Code
WILD	Wildlife Habitat
WDRs	Waste Discharge Requirements
WQO 97-10-DWQ	Water Quality Order 97-10 Division of Water Quality
§ or §§	Section or Sections

STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 2014-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS

BACKGROUND INFORMATION

Findings:

The State Water Resources Control Board (State Water Board) finds that:

1. Water Code section 13260(a) requires that any person discharging waste or proposing to discharge waste within any region, other than to a community sewer system, that could affect the quality of the waters of the state, file a Report of Waste Discharge (ROWD) to obtain coverage under Waste Discharge Requirements (WDRs) or a waiver of WDRs. "Waste" is defined in Water Code section 13050(d).
2. Discharges to land from Small Domestic Wastewater Treatment Systems (hereafter Small Domestic Systems) have certain common characteristics, such as similar constituents, concentrations of constituents, disposal techniques, flow ranges, and they require the same or similar treatment standards. These types of discharges are appropriately regulated under a General Waste Discharge Requirements Order (General Order). State Water Board Water Quality Order 97-10-DWQ (WQO 97-10-DWQ) is a 1997 General Order addressing Small Domestic Systems. Once effective, this General Order will supersede WQO 97-10-DWQ which will no longer be available for additional enrollees.
3. For the purposes of this General Order, the term "wastewater system" shall mean the collection system, treatment equipment, pumping stations, treatment ponds, clarifiers, sand/media filters, disinfection systems, recycled water systems (including distribution systems), storage ponds, land application areas, and other systems associated with the collection, treatment, storage, and disposal of wastewater.
4. Only Small Domestic Systems, with a monthly average flow rate of 100,000 gallons per day (gpd) or less, that discharge to land are eligible for coverage under this General Order. Small Domestic Systems are typically located at individual residences, rural parks, schools, campgrounds, mobile home parks, roadside rest stops, small commercial or residential subdivisions, restaurants, resort hotels/lodges, small correctional facilities, temporary fire-fighting camps, and recreational vehicle (RV) dump locations, including RV parks. An owner and/or operator of such a wastewater system is hereafter referred to as Discharger in this General Order. A Small Domestic System that uses subsurface disposal may be regulated by a local agency rather than a Regional Water Board, consistent with the Water Quality Control Policy for Siting, Design, Operation, and Maintenance of Onsite Wastewater Treatment Systems Policy (OWTS Policy). Wastewater systems regulated by local agencies may continue that coverage unless directed by the local agency or the Regional Water Board Executive Officer to seek WDRs from the Regional Water Board.
5. Wastewater treatment technologies evolve over time. Septic tanks and gravity fed leach fields provide the lowest level of acceptable treatment. Other treatment may include aerobic treatment systems, sand/media filters, package treatment plants, constructed wetlands, activated sludge, membrane biological reactors, and disinfection systems. Similarly, other dispersal options for the treated effluent may include pressure dosing, drip irrigation, land application, mound/at grade systems, or

evapotranspiration systems. The level of treatment shall be based upon the wastewater quality and the receiving water quality at the wastewater disposal location. For flow rates that exceed 20,000 gallons per day (gpd), Attachment 1, *Nitrogen Effluent Limit Evaluation*, provides direction in evaluating a discharge and determining when nitrogen control is required. Seepage pits may be considered part of the disposal system if inadequate land exists for a leach field dispersal system, other site conditions require the use of seepage pits, and site conditions are favorable for the use of seepage pits (groundwater quality shall be maintained consistent with this General Order). The discussion of treatment and disposal alternatives is not intended to limit the selection of alternatives available to the wastewater system designer.

6. All WDRs must implement the applicable Regional Water Quality Control Board's (Regional Water Board's) Water Quality Control Plan (Basin Plan) for the region in which the discharge occurs; therefore this General Order requires Dischargers to comply with all applicable Basin Plan requirements, including any prohibitions and/or water quality objectives, governing the discharge. The Discharger must comply with any more stringent standards in the applicable Basin Plan. In the event of a conflict between the requirements of this General Order and the Basin Plan, the more stringent requirement prevails.
7. This General Order allows the production and use of recycled water (as defined in Water Code section 13050(n)) and requires all recycled water use to comply with the applicable requirements described in California Code of Regulations, title 22, division 4, chapter 3, (hereafter title 22). Compliance with title 22 water recycling criteria and title 17 sanitation requirements shall be determined by the State Water Board Division of Drinking Water (DDW) (formerly California Department of Public Health), which reviews title 22 Engineering Reports. This General Order also allows for the application of treated wastewater to land that does not meet the definition of beneficial use, and is therefore not subject to the title 22 requirements.
8. Wastewater and treated wastewater quality vary depending upon source water quality, the activities generating the wastewater, water conservation efforts, inflow and infiltration (I/I), and treatment technology. Typical domestic wastewater and treated wastewater characteristics are presented in Table 1. Published wastewater textbooks and/or United States Environmental Protection Agency (USEPA) wastewater publications may also be used to characterize wastewater characteristics.

Table 1: Summary of Domestic Wastewater Characteristics

<u>Constituent</u>	<u>Units^a</u>	Typical Domestic Wastewater	Septic Tank Influent	Septic Tank Effluent	Secondary Treatment Effluent	Equivalent to Secondary Treatment Effluent
Biochemical Oxygen Demand	mg/L	200-290 ^b	155-286 ^c	140-200 ^d	30-45 ^e	65 percent reduction ^f
Total Suspended Solids	mg/L	200-290 ^b	155-330 ^c	50-100 ^d	30-45 ^e	^p
Ammonia (as N)	mg/L	6-18 ^b	4-13 ^c	-- ^{g,o}	-- ^{g,h}	-- ^{g,h,i}
Total Nitrogen	mg/L	35-100 ^b	26-75 ^c	40-100 ^d	50% ^m	43-80% ^{k,h,i}

STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 2014-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS

- 3 -

<u>Constituent</u>	<u>Units^a</u>	Typical Domestic Wastewater	Septic Tank Influent	Septic Tank Effluent	Secondary Treatment Effluent	Equivalent to Secondary Treatment Effluent
Nitrite and Nitrate (as N)	mg/L	<1 ^b	<1 ^c	-- ^{g,o}	-- ^{g,h}	-- ^{g,h,i}
Total Phosphorus (as P)	mg/L	6-12 ^b	6-12 ^c	5-15 ^d	51% ^m	50% ^{k,h,i}

^a. mg/L denotes milligrams per liter.

^b. Data from Table 4-3, USEPA Wastewater Treatment/Disposal for Small Communities, Manual, September 1992, EPA/625/R-92/005.

^c. Data from Table 3-7, USEPA Onsite Wastewater Treatment System Manual, June 2005, EPA/625/R-00/008.

^d. Data from Table 3-19, USEPA Onsite Wastewater Treatment Systems Manual, June 2005, EPA/625/R-00/008.

^e. Data from Exhibit 5-6, USEPA NPDES Permit Writers' Manual, December 1996, EPA-833-B-96-003.

^f. Data from Section 5.2.2, USEPA NPDES Permit Writers' Manual, December 1996, EPA-833-B-96-003.

^g. "--" denotes data not available.

^h. Value highly variable depending upon treatment technology.

ⁱ. No technology based limit established by USEPA.

^k. Percent reduction from influent, wastewater pond treatment. USEPA webpage <http://www.epa.gov/caddis/ssr_urb_ww1.html>, accessed August 29, 2014.

^m. Percent reduction from influent wastewater, activated sludge treatment. USEPA webpage <http://www.epa.gov/caddis/ssr_urb_ww1.html>, accessed August 29, 2014.

^o. Insignificant change expected in treatment.

^p. TSS limit not appropriate for land discharge.

9. Discharges from RV holding tanks or portable toilets may contain chemicals that can pollute groundwater quality. Some commercially available products used to control holding tank/portable toilet odors may contain harmful chemicals such as formaldehyde, zinc, or phenol. The harmful chemicals can kill the bacteria in the wastewater treatment system and cause wastewater to be inadequately treated. Inadequately treated wastewater may cause additional problems such as leachfield/seepage pit failure, surfacing wastewater, and potential exposure and health risks. Discharge of the harmful chemicals to groundwater that creates pollution may result in enforcement activities requiring groundwater remediation. The best and least expensive method to prevent groundwater pollution is to not use harmful chemicals by educating RV owners about the pollution hazard.
10. Total dissolved solids (TDS) consists of both volatile (organic) and fixed (inorganic) fractions. A varying concentration of volatile dissolved solids will exist in wastewater effluent depending upon the wastewater source and treatment technology. In a properly operated land application system, volatile dissolved solids in percolate are generally reduced to negligible concentrations (less than 2 mg/L) by filtration and biological degradation following percolation through five feet of soil.¹ However, fixed

¹ USEPA, Process Design Manual, Land Treatment of Municipal Wastewater, Section 4.2.1, 1981.

dissolved solids (FDS) do not degrade biologically. Elevated concentrations of FDS in land applied effluent can change soil chemistry and degrade groundwater quality.

11. Wastewater discharged to land in close proximity to a surface water body may impact surface water quality. Additional monitoring may be required by a Regional Water Board's Executive Officer to determine if the discharge has degraded surface water quality. The USEPA recommends *Escherichia coli* (E. coli) and enterococci bacteria, which exist in fecal material from humans and other warm-blooded animals, as the best indicators of health risk from water contact.² Because both bacteria are present in domestic wastewater, there is no need to monitor separately for them in wastewater effluent. The effectiveness of disinfection procedures are similar for bacteria, therefore total coliform organisms, which is a less expensive analysis, is appropriate to determine if wastewater effluent is effectively disinfected. Total coliform monitoring is required for recycled water use consistent with title 22.
12. Use of recycled water in lieu of potable water is encouraged by the State Water Board as described below:
 - a. The State Water Board's Strategic Plan Update 2008-2012 includes a priority to increase sustainable local water supplies available for meeting existing and future beneficial uses by 1,725,000 acre-feet per year (afy) in excess of 2002 levels by 2015.
 - b. The State Water Board's Policy for Water Quality Control for Recycled Water states the following goals (in part): 1) Increase the use of recycled water over the 2002 level by at least 1 million afy by 2020 and by at least 2 million afy by 2030. 2) Increase the amount of water conserved in urban and industrial uses by 20 percent compared to 2007. 3) Substitute as much recycled water for potable water as possible by 2030.
13. The Recycled Water Policy calls on local water and wastewater entities together with other stakeholders who contribute salt and nutrients to a groundwater basin or sub-basin, to fund and develop Salt and Nutrient Management Plans (SNMPs) to comprehensively address all sources of salts and nutrients. The State Water Board herein reasserts the need for comprehensive salt and nutrient management planning and directs that salinity and nutrient increases should be managed in a manner consistent with the Recycled Water Policy. It is the intent of the Recycled Water Policy that every groundwater basin/sub-basin in California ultimately has a consistent Salt and Nutrient Management Plan. The appropriate way to address salt and nutrient issues is through the development of regional or subregional SNMPs. Dischargers may be directed to perform or participate in SNMP planning activities as described in the Provisions of this General Order.

² USEPA Internet page accessed June 10, 2014 <<http://water.epa.gov/type/rsl/monitoring/vms511.cfm>>.

14. The Recycled Water Policy includes monitoring requirements for Constituents of Emerging Concern³ for the use of recycled water for groundwater recharge by surface and subsurface application methods. The monitoring requirements and criteria for evaluating monitoring results in the Recycled Water Policy are based on recommendations from a Science Advisory Panel.⁴ Because this General Order is limited to non-potable uses and does not authorize groundwater replenishment activities, monitoring for Constituents of Emerging Concern is not required.
15. The Recycled Water Policy requires permits for landscape irrigation with recycled water to include priority pollutant monitoring at the recycled water production facility. Annual monitoring is required for design production flows greater than one million gallons per day; a five year monitoring frequency is required for flows less than one million gallons per day. Priority pollutants are listed in Appendix A of 40 Code of Federal Regulations (C.F.R.) Part 423.
16. Beneficial uses for groundwater are determined by each Regional Water Board and are listed in their respective Basin Plans. Beneficial uses for groundwater are: municipal supply (MUN), industrial service supply (IND), industrial process supply (PROC), fresh water replenishment (FRESH), aquaculture (AQUA), wildlife habitat (WILD), water contact recreation (REC-1), agricultural supply (AGR), and groundwater recharge (GWR). Some beneficial uses only apply to certain geographic areas within regions.
17. Basin Plans establish groundwater quality objectives to protect beneficial uses. The objectives may be narrative, numerical, or both. This General Order requires the Discharger to comply with those objectives in receiving groundwater.

WASTEWATER DISPERSAL

18. Wastewater dispersal will occur by different methods. It may be percolated from ponds; applied to the surface by spray, flood, or drip methods; or discharged to a subsurface dispersal area such as a leachfield or seepage pit. The choice of disposal method will depend upon the amount of wastewater generated, the value of the wastewater for irrigation, and the receiving environment.
 - a. Wastewater discharged to a pond for treatment and/or storage can result in groundwater degradation or nuisance odors. Ponds can also be vulnerable to damage caused by burrowing animals.

³ For this order, Constituents of Emerging Concern are defined to be chemicals in personal care products, pharmaceuticals including antibiotics, antimicrobials; industrial, agricultural, and household chemicals; hormones; food additives; transformation products, inorganic constituents; and nanomaterials.

⁴ The Science Advisory Panel was convened in accordance with provision 10.b of the Recycled Water Policy. The panel's recommendations were presented in the report; *Monitoring Strategies for Chemicals of Emerging Concern in Recycled Water - Recommendations of a Science Advisory Panel*, dated June 25, 2010.

Wastewater percolated from a pond to the subsurface has the potential to degrade groundwater quality to an unacceptable extent. Reducing the amount of wastewater percolated by lining a pond with a synthetic or low permeability liner can control the percolation rate, but an alternative method of wastewater disposal may be required. Land application (discussed below) is often selected as the method to dispose of the wastewater from lined ponds.

Overloading a wastewater pond with Biochemical Oxygen Demand (BOD) constituents can result in nuisance odor generation. Source control of BOD constituents, additional pretreatment prior to discharge to the pond, or mechanical aeration of wastewater in the pond are typically used to prevent a pond from generating nuisance odors.

Burrowing animals can result in rapid failure of a containment berm. The population of such animals should be promptly controlled and repairs to the containment completed as soon as possible.

- b. When land application of wastewater is selected as a disposal method, adequate acreage must be available to allow application rates that will not create nuisance conditions (e.g. vectors, nuisance odors, off-site discharge) or degrade groundwater quality to an unacceptable extent.

Crops are often grown and harvested from a land application area (LAA) to take up wastewater constituents such as nitrogen and dissolved solids, as well as maintain roots which promote wastewater infiltration rates. When climatic conditions are favorable, double cropping an LAA can increase the uptake of wastewater constituents.

Hydraulic loading of an LAA must be controlled to prevent off-site wastewater discharge; if wastewater is not disinfected prior to land application, storm water that falls on the LAA must be contained to prevent the potential migration off-site of pathogenic organisms. LAAs are sometimes equipped with a tailwater control system that allows for reapplication of wastewater to the LAA or returning tailwater to a wastewater pond.

- c. Subsurface disposal areas may be constructed as leachfields or when conditions allow, seepage pits. If seepage pits are employed, they are often located at the end of a leachfield distribution pipe to maximize shallow distribution of wastewater.

If conditions are not favorable for traditional leachfield construction, an at-grade, or an above grade (mound) system may be used. Typically, at-grade and above grade systems are dosed using a dosing pump and pump controller. Dosed systems use relatively small diameter pipe to distribute the wastewater to zones within the dispersal area. Even in well operated systems, some suspended solids will be pumped into the distribution piping. Cleanouts or a flushing system on the distribution piping are required to remove the solids that will accumulate if the emitters are small enough diameter to prevent suspended solids from passing through the distribution equipment. Gravelless trench systems which do not use gravel, typically use distribution piping and a dosing

system, and should be constructed with cleanouts or a flushing system similar to at-grade and/or above grade systems when needed.

Subsurface disposal areas should be planted with shallow rooted plants to prevent erosion and provide for uptake of wastewater nutrients; trees and shrubs should be removed to prevent roots from damaging the leachfield. Similarly, burrowing animals can damage an at-grade or above grade (mound) disposal system and result in leakage. Burrowing animals should be promptly controlled and repairs to the disposal system completed as soon as possible.

19. Setbacks from wastewater treatment areas, dispersal areas, and/or LAAs from domestic wells, flowing and/or ephemeral streams, lakes/reservoirs, and property lines are provided in this General Order. Setbacks are included as a means of reducing pathogenic risks by coupling pathogen inactivation rates with groundwater travel time to a well or other potential exposure route (e.g. water contact activities). In general, a substantial unsaturated zone reduces pathogen survival compared to saturated soil conditions. Fine grained (silt or clay) soil particles reduce the rate of groundwater transport and therefore are generally less likely to transport pathogens; coarse grained soil particles or fracture flow groundwater conditions may be more likely to transport pathogens. Setbacks also provide attenuation of other wastewater constituents through physical, chemical, and biological processes. The setbacks provided in this General Order are based on the title 22 water recycling criteria, the California Well Standards, the OWTS Policy, the California Plumbing Code, and commonly imposed setbacks by regulatory agencies.
20. The OWTS Policy identified wastewater disposal as a potential contributing source of pathogens or nitrogen to an impaired surface water body.⁵ OWTS Policy Tier 3 addresses impaired surface water bodies and describes an Advanced Protection Management Program (APMP) as the minimum management program for wastewater systems subject to the OWTS Policy. In general, wastewater systems located within the geographic area⁶ of an APMP are not eligible for coverage under this General Order unless the Regional Water Board's Executive Officer determines the discharge is acceptable based on site-specific conditions, the level of wastewater treatment, and/or total maximum daily load (TMDL) implementation plan requirements.

⁵ Impaired surface water bodies are those identified on a list approved first by the State Water Board and then approved by USEPA pursuant to Section 303(d) of the Federal Clean Water Act.

⁶ The geographic area of an APMP is established (in order of hierarchy) by an approved TMDL, an approved local agency defined APMP, or 600 feet from the water body.

APPLICATION PROCESS

21. Dischargers seeking coverage under this General Order shall file an ROWD with the appropriate Regional Water Board. The application process is summarized in Attachment A. Some Regional Water Boards may provide procedures for electronic submittal of application documents. An ROWD consists of:
 - a. A completed Form 200, which is available at:
http://www.waterboards.ca.gov/publications_forms/forms/docs/form200.pdf .
 - b. An application fee that serves as the first annual fee. Fees are based on threat and complexity ratings, and the treatment technology employed. Threat and complexity ratings are defined in the fee schedule listed in California Code of Regulations, title 23, section 2200 and also available at:
<http://www.waterboards.ca.gov/resources/fees/docs/fy1112fee_schdl_wdr.pdf>.
 - c. A technical report that describes the wastewater generation, treatment, storage, and disposal. Submittal of the report in the recommended format provided in Attachment B1 will allow for an expedited review by Regional Water Board staff. (Some Regional Water Boards' staff may have different or additional technical report requirements in addition to Attachment B1. An applicant is advised to inquire with the Regional Water Board staff before performing investigations and/or preparing the technical report.)

Upon review of the ROWD, Regional Water Board staff will determine if coverage under this General Order is appropriate. The Regional Water Board's Executive Officer will issue a Notice of Applicability (NOA) when coverage under this General Order has been authorized. The NOA will contain the necessary site-specific monitoring and reporting requirements.

22. Dischargers covered by WQO 97-10-DWQ or another administrative mechanism may continue discharging under that authority until notified of the need to update their coverage by the State Water Board or Regional Water Board.
23. Although a Discharger may be eligible for coverage under this General Order, the appropriate Regional Water Board Executive Officer may determine that the discharge would be better regulated by a waiver of WDRs, individual WDRs, a different general order, an enforcement order, or a National Pollutant Discharge Elimination System (NPDES) Permit.

ANTIDEGRADATION ANALYSIS

24. State Water Board Resolution 68-16, the *Statement of Policy with Respect to Maintaining High Quality of Waters in California* (hereafter the Antidegradation Policy) requires that disposal of waste into the waters of the state be regulated to achieve the highest water quality consistent with the maximum benefit to the people of the state. The quality of some waters is higher than established by adopted policies and that higher quality water shall be maintained to the maximum extent possible consistent with the Antidegradation Policy. The Antidegradation Policy requires the following:

- a. Higher quality water will be maintained until it has been demonstrated to the state that any change will be consistent with the maximum benefit to the people of the state, will not unreasonably affect present and anticipated beneficial use of the water, and will not result in water quality less than that prescribed in the policies.
 - b. Any activity that produces a waste and discharges to existing high quality waters will be required to meet WDRs that will result in the Best Practicable Treatment or Control (BPTC) of the discharge necessary to assure pollution or nuisance will not occur, and the highest water quality consistent with the maximum benefit to the people of the state will be maintained.
25. The Antidegradation Policy requires maintenance of high quality of waters of the state unless limited degradation is consistent with the maximum benefit to the people of the state. When issuing NOAs under this General Order, Executive Officers must assure that Dischargers implement BPTC as necessary to maintain the highest water quality consistent with the maximum benefit to the people of the state.
26. This General Order allows discharges to numerous groundwater bodies, each with its own chemical characteristics. There are not sufficient data to determine which receiving waters are high quality waters. To the extent a discharge covered under this General Order may be to high quality waters, this General Order authorizes limited degradation consistent with the Antidegradation Policy as described in the findings below.
27. This General Order limits a discharge flow rate to 100,000 gpd; therefore, only small Dischargers will be eligible for coverage. Wastewater systems with a flow rate greater than 20,000 gpd must evaluate the discharge with the method presented in Attachment 1 to determine if nitrogen effluent limits are appropriate. Discharge of domestic wastewater at lower flow rates inherently has less potential to significantly degrade water quality.
28. Limited degradation of groundwater by some waste constituents associated with domestic wastewater effluent, after effective source control, treatment, and control measures are implemented, is consistent with the maximum benefit to the people of the state. The technology, energy, water recycling, and waste management advantages of centralized wastewater treatment systems far exceed any benefits derived from reliance on numerous, concentrated individual wastewater systems, and the cumulative impact on water quality will be substantially less. The economic prosperity of communities and associated industry is of maximum benefit to the people of the state and provides sufficient justification for allowing the limited groundwater degradation that may occur pursuant to this General Order provided the terms of the applicable Basin Plan, and other applicable State Water Board and Regional Water Board policies are consistently met. The State Water Board recognizes variability in a small community's ability to construct wastewater treatment systems based on financial resources.
29. Constituents of concern that have the potential to degrade groundwater include salinity, nutrients, and pathogens (represented by coliform bacteria). In addition, excessive BOD loading of ponds or LAAs may result in nuisance odors or anaerobic

conditions, which are not favorable biological treatment conditions. This General Order includes effluent limits for nitrogen and BOD, and a process to determine how to apply the limits. Implementation of the process to determine the effluent limit that applies will result in the BPTC for the wastewater constituents. In addition, this General Order provides guidance on preparing a monitoring program that ensures the treatment is effective. Each of the wastewater constituents of concern are discussed below:

- a. Salinity is a measure of dissolved solids in water. Excessive salinity can reduce the beneficial uses of water. Salinity can be affected by the discharge of wastewater with elevated concentrations of TDS. TDS consists of both volatile (organic) and fixed (inorganic) fractions. In a well-operated land application system, volatile dissolved solids in percolate will be reduced to negligible concentrations. The best approach for addressing salinity is through source control activities. This General Order allows an Executive Officer to require participation in salt and nutrient management planning processes.
- b. Nitrogen is a nutrient normally present in domestic wastewater at a concentration that can degrade groundwater quality. The potential for degradation depends upon the wastewater treatment method and the environment into which the wastewater effluent is discharged. Nitrogen concentration reduction is not required in every situation, such as when wastewater treatment and application is performed in a way that is protective of the beneficial uses of water.

When needed, nitrogen concentrations can be reduced in a number of ways, such as nitrification, denitrification, and/or crop uptake and removal. However, the General Order requires that the effluent limit for nitrogen be determined based on procedures in Attachment 1, which provides additional criteria to determine when and how much nitrogen control is required. Effluent limits are determined based on the threat to groundwater quality. If nitrogen control is needed, a minimum of 50-percent reduction is required. In cases where a higher threat to groundwater exists, a total nitrogen concentration limit of 10 mg/L is required. By imposing the total nitrogen limit of 10 mg/L, the wastewater derived nitrogen cannot exceed the maximum contaminant level (MCL) for groundwater. Because natural systems are rarely 100-percent efficient, the nitrogen concentration limit will be protective of the existing and/or potential beneficial use of groundwater. Effluent limitations for nitrogen are contained in this General Order. To ensure the nitrogen control is effective, the model Monitoring and Reporting Program (MRP) provided as Information Sheet Attachment C includes monitoring that can be implemented to verify compliance with effluent limits.

- c. Pathogens and other microorganisms are present in domestic wastewater. Wastewater treatment processes will reduce the concentration of pathogens but disinfection is required to significantly reduce their presence. Coliform bacteria are used as a surrogate (indicator) because they are excreted by warm-blooded animals, are present in high numbers, survive in the environment similar to

pathogenic bacteria, and are easy to detect and quantify. Disinfection of wastewater is not required in every situation, such as when the wastewater application is performed in such a way that public contact is minimized through physical controls and/or notification.

When needed, disinfection can be performed in a number of ways. The title 22 water recycling criteria lists disinfection requirements for specific activities. To ensure the disinfection is effective, the model MRP provided as Information Sheet Attachment C includes monitoring that can be implemented to verify compliance with effluent limits.

30. Compliance with the General Order, the NOA, DDW requirements, and any mitigation measures will ensure compliance with the applicable Basin Plan.

TITLE 27 EXEMPTION

31. The wastewater treatment, storage, and disposal activities described in this General Order are exempt from the requirements of *Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste* in California Code of Regulations, title 27, division 2, Subdivision 1, section 20005, et seq. The activities are exempt from the requirements of title 27 so long as the activity meets, and continues to meet, all preconditions listed below. (Cal. Code Regs., tit. 27, § 20090.)
 - a. Sewage—Discharges of domestic sewage or treated effluent which are regulated by WDRs issued pursuant to California Code of Regulations, title 23, division 3, chapter 9, or for which WDRs have been waived, and which are consistent with applicable water quality objectives, and treatment or storage facilities associated with municipal wastewater treatment plants, provided that residual sludge or solid waste from wastewater treatment facilities shall be discharged only in accordance with the applicable State Water Board promulgated provisions of this division. (Cal. Code Regs., tit. 27, § 20090(a).)
 - b. Wastewater—Discharges of wastewater to land, including but not limited to evaporation ponds, percolation ponds, or subsurface leach fields if the following conditions are met:
 - (1) the applicable Regional Water Board has issued WDRs, reclamation requirements, or waived such issuance;
 - (2) the discharge is in compliance with the applicable water quality control plan; and
 - (3) the wastewater does not need to be managed according to, California Code of Regulations, title 22, division 4.5, chapter 11, as a hazardous waste. (Cal. Code Regs., tit. 27, § 20090(b).)
 - c. Underground Injection—Discharges of waste to wells by injection pursuant to the Underground Injection Control Program established by the USEPA under the Safe Drinking Water Act, 42 US Code section 300(h), see Code of Federal Regulations title 40, Parts 144 to 146. (Cal. Code Regs., tit. 27, § 20090(c).)

- d. Soil Amendments—Use of nonhazardous decomposable waste as a soil amendment pursuant to applicable best management practices, provided that Regional Water Boards may issue waste discharge or reclamation requirements for such use. (Cal. Code Regs., tit. 27, § 20090(f).)
- e. Fully Enclosed Units—Waste treatment in fully enclosed facilities, such as tanks, or in concrete lined facilities of limited areal extent, such as oil water separators designed, constructed, and operated according to American Petroleum Institute specifications. (Cal. Code Regs., tit. 27, § 20090(i).)

Table 2: Summary of Wastewater System and California Code of Regulations, Title 27 Exemptions

Example of Wastewater System <u>Element/ Activity</u>	Potentially Applicable <u>Exemption(s)</u>
Wastewater collection, treatment, storage, and disposal systems.	Section 20090 (a) Sewage, domestic wastewater, and treated effluent
Applying wastewater to evaporation ponds, storage ponds, percolation ponds, rapid infiltration basins, leach fields, seepage pits, land application areas, spray fields, etc.	Section 20090 (b) Wastewater discharges to land
Disposal of wastewater in injection wells or seepage pits.	Section 20090 (c) Underground injection
Application of treated wastewater containing suspended solids to a land application area.	Section 20090 (f) Soil amendments, nonhazardous decomposable waste
Wastewater collection, flow equalization, and treatment in a septic tank, Imhoff tank, sand/media filter, package treatment tank, aeration basin, clarifier, sludge holding/thickening tank, pumping sumps, lined sludge drying beds, etc.	Section 20090 (i) Waste treatment in fully enclosed facilities.

CALIFORNIA ENVIRONMENTAL QUALITY ACT

- 32. This General Order is intended to cover both new and existing Small Domestic Systems.
 - a. The adoption of this General Order for existing Small Domestic Systems is categorically exempt from the California Environmental Quality Act (CEQA) pursuant to California Code of Regulations, title 14, section 15301 (ongoing or existing projects), section 15302 (replacement or reconstruction of existing utility systems), and section 15303 (new construction or conversion of small structures).

- b. For new or expanding Small Domestic Systems, the State Water Board considered the environmental impacts associated with the adoption of this General Order and prepared an Initial Study in accordance with California Code of Regulations, title 14 section 15063. Analysis in the Initial Study and early consultation with responsible and trustee agencies did not identify any significant impacts on the environment. Therefore, a Negative Declaration was prepared. The State Water Board adopted the Negative Declaration ([Resolution 2014-0054](#)) on September 23, 2014.
- c. New or expanding systems are subject to further CEQA evaluation on a site-specific basis by local agencies performing CEQA evaluations of proposed projects. The potential significant environmental impacts from discharges of domestic wastewater can be mitigated to less than significant impacts by compliance with this General Order, the NOA, and any mitigation measures adopted by local agencies.

OTHER REGULATORY ISSUES

- 33. Dischargers that meet the criteria for coverage under State Water Board Order No. 2006-0003-DWQ, *Statewide General Waste Discharge Requirements for Sanitary Sewer Systems*, or updated order, are required to obtain coverage.
- 34. Consistent with Water Code section 13241, the State Water Board, in establishing the requirements contained herein, considered factors including, but not limited to, the following:
 - a. Past, present, and probable future beneficial uses of water.
 - b. Environmental characteristics of the hydrographic unit under consideration, including the quality of water available thereto.
 - c. Water quality conditions that could reasonably be achieved through the coordinated control of all factors which affect water quality in the area.
 - d. Economic considerations.
 - e. The need for developing housing within the region(s).
 - f. The need to develop and use recycled water.
- 35. Water Code section 13263(i) states, The State Water Board or a Regional Water Board may prescribe general WDRs for a category of discharges if the State Water Board or that Regional Water Board finds or determines that all of the following criteria apply to the discharges in that category:
 - 1) The discharges are produced by the same or similar operations.
 - 2) The discharges involve the same or similar types of waste.
 - 3) The discharges require the same or similar treatment standards.
 - 4) The discharges are more appropriately regulated under general WDRs than individual WDRs.

Small Domestic Systems that will be regulated under this General Order are consistent with the criteria listed above and therefore a general order is appropriate. All discharges regulated under this order will be from similar operations and will be consistent with the description of domestic wastewater as defined in Finding 8. The discharges will use similar treatment methods (e.g. screening, settling, biological treatment, clarification, and application to land). Individual WDRs are not necessary because the discharges are similar and discharge requirements would be similar if individual WDRs were issued.

36. Technical and monitoring reports specified in this General Order are required. (Wat. Code, § 13267.) Failing to furnish the reports by the due date or falsifying information in the reports, are misdemeanors that may result in assessment of civil liabilities against the Discharger. Water Code section 13267 states, in part:

“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports.”

The technical reports required by this General Order, the NOA, and the MRP are necessary to assure compliance with this General Order. The burden and cost of preparing the reports is reasonable and consistent with the interest of the state in maintaining water quality.

37. The BOD and Total Suspended Solids (TSS) effluent limitations contained in this General Order are technology based. USEPA has developed technology based effluent limits for secondary treatment for use in NPDES permits. However, pond treatment systems often cannot comply with the limits that apply to activated sludge treatment systems due to algae growth in the pond. In response, USEPA developed an equivalent to secondary treatment definition for alternative biological treatment technologies such as a trickling filter or waste stabilization pond. (40 C.F.R. §133.05). Although this General Order only authorizes discharges to land, some of the secondary treatment standards are appropriate to demonstrate that wastewater is adequately treated. For pond and/or trickling filter wastewater systems, the total suspended solids limit is not appropriate because application of algal solids to land is not a concern.

38. This General Order does not preempt or supersede the authority of municipalities, flood control agencies, or other local agencies to prohibit, restrict, or control discharges of waste subject to their jurisdiction.
39. The State Water Board has notified potential Dischargers and all other known interested parties of the intent to prescribe WDRs as described in this General Order.
40. The State Water Board, in a public meeting, has heard and considered all comments pertaining to the proposed discharge.

IT IS HEREBY ORDERED

IT IS HEREBY ORDERED that upon adoption of this General Order, WQO 97-10-DWQ is classified as in effect, but inactive for future Discharger enrollment.

Pursuant to Water Code section 13263 and 13267, the Discharger, its agents, successors, and assigns, in order to meet the provisions contained in division 7 of the Water Code and regulations adopted hereunder, shall comply with the following:

A. Prohibitions

1. The direct or indirect discharge of any wastewater to surface waters or surface water drainage courses is prohibited.
2. The use of cesspools, an excavation or device that allows wastewater infiltration into the soil without treatment, is prohibited.
3. The treatment, storage, and/or disposal of waste in or at the wastewater system shall not cause or contribute to a condition of pollution, contamination, or nuisance as defined in Water Code section 13050.
4. The discharge of wastewater other than domestic wastewater is prohibited.
5. Bypass or overflow of treated or untreated waste is prohibited.
6. The discharge of waste to land not owned, operated, or controlled by the Discharger is prohibited. An exception to this prohibition is when recycled water is used as described in a title 22 Engineering Report approved by DDW.
7. The discharge of waste classified as hazardous (Cal. Code Regs., tit. 23, § 2521(a)), or designated (Wat. Code, § 13173) is prohibited.
8. The discharge of waste in violation of, or not consistent with, the applicable Regional Water Board's Basin Plan is prohibited.
9. A physical connection between a recycled water system and a potable water system is prohibited.
10. The use of recycled water in a manner different than described in the DDW approved title 22 engineering report is prohibited.
11. Use of equipment used to convey recycled water (e.g. tanks, piping, valves,) also used for potable water supply, is prohibited.

B. Requirements by Wastewater System Type

1. All Wastewater Systems

- a. The Discharger shall not discharge wastewater in excess of the flow limit(s) specified in the NOA. In no case shall the flow rate of wastewater discharged to the headworks exceed 100,000 gpd as a monthly average. Headworks are defined as the facilities where wastewater enters a wastewater treatment plant. Headworks may include bar screens, comminutors, a wet well, and pumps. Dischargers that store wastewater and apply it to an LAA during irrigation season may land apply more than 100,000 gallons per day of treated wastewater to an LAA during the irrigation season as allowed by the NOA.
- b. Treatment and disposal of wastewater must demonstrate BPTC for domestic wastewater. BPTC shall be demonstrated by compliance with all of the following:
 - i. Compliance with this General Order.
 - ii. Compliance with effluent limitations included in this General Order.
 - iii. Compliance with the NOA, which will specify the following (at a minimum):
 1. Site-specific flow limit(s).
 2. Site-specific wastewater system treatment and disposal methods provided in Section B.2 through B.8 of this General Order.
 3. Applicable Basin Plan groundwater and/or surface water limitations in addition to those provided in Section C of this General Order.
 4. Applicable effluent limitations from Section D of this General Order. For flow rates greater than 20,000 gpd, the discharge must be evaluated as described in Attachment 1 to determine if nitrogen effluent limits are required.
 5. Requirements for operation of the wastewater treatment system and disinfection requirements provided by the DDW approved title 22 Engineering Report.
 6. Water quality related mitigation measures from an approved site-specific CEQA document (if one is prepared).
- c. Wastewater systems located within the geographic area⁷ of an APMP are not eligible for coverage under this General Order unless the Regional Water Board's Executive Officer determines the discharge is acceptable based on site-specific conditions, the level of wastewater treatment, and/or TMDL implementation plan requirements.

⁷ The geographic area of an APMP is established (in order of hierarchy) by an approved TMDL, an approved local agency defined APMP, or 600 feet from the water bodies listed on Table 5 or Table 6 of OWTS Policy Attachment 2.

- d. The siting, design, construction, operation, maintenance, and monitoring of the wastewater system shall comply with the requirements of the applicable Regional Water Board's Basin Plan.
- e. Nuisance odors shall not be perceivable beyond the property line of the wastewater treatment facility.
- f. Public contact with wastewater shall be deterred through such means as fences, signs, and other acceptable alternatives.
- g. For systems with a design flow rate greater than 3,500 gpd, the technical report required as part of the ROWD shall be prepared by a California licensed professional civil engineer. For systems with a design flow rate less than 3,500 gpd, the technical report shall be prepared by a California licensed professional engineer or other appropriately licensed professional (e.g., a California licensed professional geologist or California registered environmental health specialist).
- h. For new or expanding Small Domestic Systems within or nearby the boundaries of a centralized wastewater district or regional service area, the Discharger must demonstrate a good faith effort to connect to the centralized system when feasible and practicable, and provide evidence that connection to the system was not approved.
- i. A Regional Water Board Executive Officer may require additional investigations or monitoring to demonstrate beneficial uses of water are protected and antidegradation requirements are satisfied. Acceptable methods may include, but not be limited to, evaluation of the wastewater system's treatment performance, groundwater monitoring, or additional sampling to characterize the wastewater discharge.
- j. The Discharger shall comply with any water quality related mitigation measures adopted in a CEQA document addressing the facility.
- k. When producing or using recycled water, the Discharger shall comply with the provisions of the DDW approved title 22 Engineering Report.
- l. The Discharger shall comply with the setbacks described in Table 3. However, some existing sites may not comply with the setbacks provided herein. Such noncomplying sites may be permitted under this General Order if nuisance conditions do not result from the noncompliance. Expansion of a noncomplying wastewater system shall trigger further evaluation of the setbacks. In some cases, more than one setback standard exists. The following procedure shall be implemented when determining the appropriate setback:
 - i. When the setback requirement comes from title 22, approval of a variance must be obtained from DDW.

- ii. When the setback comes from the California Well Standards, a reduced setback may be allowed based on site-specific conditions; review the California Well Standards for clarification.
- iii. When the setback comes from the OWTS Policy, the Regional Water Board Executive Officer may allow a reduced setback based upon site-specific conditions (e.g. annular seal in a well, groundwater flow direction near water bodies, treatment/disinfection level of wastewater, etc.).
- iv. When the setback comes from the California Plumbing Code, the Regional Water Board Executive Officer may not reduce the setback.
- v. Setbacks that are not referenced to a requirement listed above are based on professional judgment and may be revised by the Regional Water Board Executive Officer based on site-specific conditions.

Table 3: Summary of Wastewater System Setbacks

Equipment or Activity	Domestic Well	Flowing Stream ^a	Ephemeral Stream Drainage ^b	Property Line	Lake or Reservoir ^d
Septic Tank, Aerobic Treatment Unit, Treatment System, or Collection System ^e	150 ft. ^y 100 ft. ^o 50 ft. ^c	50 ft. ^c	50 ft.	5 ft. ^c	200 ft. ^w 50 ft. ^c
Leach Field ^f	100 ft. ^{o,c}	100 ft. ^c	50 ft.	5 ft. ^c	200 ft. ^w 100 ft. ^c
Seepage Pit	150 ft. ^{o,c}	150 ft. ^c	50 ft.	8 ft. ^c	200 ft. ^w 150 ft. ^c
LAND APPLICATION AREA REQUIREMENTS					
LAA (disinfected tertiary recycled water) ^g	50 ft. ^m	25 ft.	50 ft.	25 ft.	200 ft.
LAA (disinfected sec-2.2 or sec-23 recycled water) ^h	100 ft. ^r	50 ft.	50 ft.	100 ft. ^x 50 ft. ^p	200 ft.
LAA (undisinfected secondary recycled water) ⁱ	150 ft. ^s	100 ft.	100 ft.	100 ft. ^x 50 ft. ^p	200 ft.
Spray Irrigation (disinfected tertiary recycled water) ^k	No spray irrigation of any recycled water, other than disinfected tertiary recycled water, shall take place within 100 feet of a residence or a place where public exposure could be similar to that of a park, playground, or school yard.				
WASTEWATER STORAGE AND/OR TREATMENT PONDS					
Impoundment (disinfected tertiary recycled water) ^g	100 ft. ^t	100 ft.	100 ft.	50 ft.	200 ft.
Impoundment (disinfected sec-2.2 or sec-23 recycled water) ^h	100 ft. ^r	100 ft.	100 ft.	50 ft.	200 ft.
Impoundment (undisinfected secondary recycled water) ⁱ	150 ft. ^s	150 ft.	150 ft.	50 ft.	200 ft.

LAA denotes Land Application Area. Sec denotes secondary.

^a A flowing stream shall be measured from the ordinary high water mark established by fluctuations of water elevation and indicated by characteristics such as shelving, changes in soil character, vegetation type, presence of litter or debris, or other appropriate means.

^b Ephemeral Stream Drainage denotes a surface water drainage feature that flows only after rain or snow-melt and does not have sufficient groundwater seepage (baseflow) to maintain a condition of flowing surface water. The drainage shall be measured from a line that defines the limit of the ordinary high water mark (described in "a" above). Irrigation canals are not considered ephemeral streams drainage

features. The ephemeral stream shall be a "losing stream" (discharging surface water to groundwater) at the proposed wastewater system site.

^c Setback established by California Plumbing Code, Table K-1.

^d Lake or reservoir boundary measured from the high water line.

^e Septic Tank, Aerobic Treatment Unit, Treatment System, or Collection System addresses equipment located below ground or that impedes leak detection by routine visual inspection.

^f Leach Field includes all subsurface dispersal systems, including mound systems except seepage pits.

^g Disinfected tertiary recycled water is defined in California Code of Regulations, title 22, section 60301.230.

^h Disinfected secondary-2.2 recycled water is defined in California Code of Regulations, title 22, section 60301.220. Disinfected secondary-23 recycled water is defined in California Code of Regulations, title 22, section 60301.225.

ⁱ Undisinfected secondary recycled water is defined in California Code of Regulations, title 22, section 60301.900.

^k Additional restrictions for spray irrigation of recycled water are contained in California Code of Regulations, title 22, section 60310(f)

^m Setback established by California Code of Regulations, title 22, section 60310(a). A reduced setback is allowed as described in California Code of Regulations, title 22, section 60310(a) if all the conditions in the section are met and compliance is documented in the ROWD and NOA.

^o California Well Standards, part II, section 8. Site-specific conditions may allow reduced setback or require an increased setback. See discussion in Well Standards.

^p Setback for drip or flood application methods. Spray irrigation is subject to additional setbacks and restrictions. (See footnote k.)

^r Setback established by California Code of Regulations, title 22, section 60310(c).

^s Setback established by California Code of Regulations, title 22, section 60310(d).

^t Setback established by California Code of Regulations, title 22, section 60310(b).

^w Setback established by the Onsite Wastewater Treatment System Policy, section 7.5.5.

^x Setback established by California Code of Regulations, title 22, section 60310(f).

^y Setback established by Onsite Wastewater Treatment System Policy, section 7.5.6.

2. Septic Systems

- a. Gauging and limited repairs may be performed by homeowners or contractors as allowed by the Business and Professions Code (Bus. & Prof. Code, section 7044 and/or section 7048). With certain exceptions, anyone performing construction work in California must be licensed by the California Contractors' State License Board. Septic tank and/or leach field service (repairs, pumping, etc.) shall be performed only by a California licensed General Engineering (A), Plumbing (C-36), or Sanitation System (C-42) contractor. The Discharger shall maintain a record of all septic service activities for a minimum of five years. At a minimum, the record shall include the date, nature of service, service company name, and service company state contractor license number.

Health and Safety Code sections 117400 - 117450 require septic tank pumping to be registered by the jurisdiction where work is performed. Such service providers may be exempt from the state contractor's licensing requirements if meeting the exceptions described in the Business & Professions Code section 7044 and/or 7048.

- b. Owners and/or operators of wastewater systems that accept wastes from RVs or other mobile waste systems must ensure that such wastes do not deleteriously affect the wastewater system or adversely affect beneficial uses of groundwater

with holding tank additives that may contain, among other chemicals, formaldehyde, zinc, and/or phenol.

Use of holding tank chemicals shall be discouraged by the wastewater system owner/operator. Education of visitors can be accomplished by providing an information sheet upon check-in. Information on holding tank chemicals is provided in Attachment B2. The sale or provision of such additives by the Discharger to operators of RVs served by the Discharger's wastewater facility may be determined to be evidence of noncompliance with this section.

- c. To the maximum extent possible, RV, portable toilet, or similar wastes shall not be discharged to a septic tank or functionally equivalent system (e.g. Imhoff tank) without subsequent additional treatment (e.g., aerated pond, recirculating sand filter, etc.) prior to disposal.
- d. Septic tanks shall be pumped when any one of the following conditions exists:
 - i. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
 - ii. The scum layer is within 3 inches of the outlet device.
 - iii. The sludge layer is within 8 inches of the outlet device.
- e. Septage is the liquid, solid, and semisolid material that results from wastewater treatment in a septic tank, which must be pumped, hauled, treated, and disposed of properly. (40 C.F.R. § 503.) Septage disposal shall only be to a legal disposal site that has been issued WDRs by a Regional Water Board allowing septage disposal. Septage shall be handled in such a manner as to prevent its reaching surface waters or watercourses.

3. Aerobic Treatment Units

- a. Within **90 days** of the issuance of an NOA, the Discharger shall submit a Sludge Management Plan consistent with the requirements of Provision E.1.c of this General Order. The Discharger must obtain written approval from the Regional Water Board's Executive Officer prior to any disposal of sludge. The Executive Officer shall be notified of any changes in an approved Sludge Management Plan at least **90 days** in advance of the proposed change.
- b. Modifications to a Sludge Management Plan deemed part of an emergency action shall be noticed to the Regional Water Board Executive Officer within **five days** of disposal with a rationale for the emergency modification.
- c. Gauging and limited repairs may be performed by homeowners or contractors as allowed by the Business and Professions Code (Bus. & Prof. Code, §§ 7044, 7048). With certain exceptions, anyone performing construction work in California must be licensed by the California Contractors' State License Board. Septic tank, aerobic treatment unit, and/or leach field service (repairs, pumping, etc.) shall be performed only by a California licensed General Engineering (A), Plumbing (C-36), or Sanitation System (C-42) contractor. The Discharger shall maintain a record of all service activities for a minimum of five years. At a minimum, the record shall

include the date, nature of service, service company name, and service company state contractor license number.

Health and Safety Code sections 117400 - 117450 require septic tank pumping to be registered by the jurisdiction where work is performed. Such service providers may be exempt from the state contractor's licensing requirements if meeting the exceptions described in the Business & Professions Code section 7044 and/or 7048.

- d. Owners and/or operators of wastewater systems that accept wastes from RVs or other mobile waste systems must ensure that such wastes do not deleteriously affect the wastewater system or adversely affect beneficial uses of groundwater with holding tank additives that may contain, among other chemicals, formaldehyde, zinc, and/or phenol.

Use of holding tank chemicals shall be discouraged by the wastewater system owner/operator. Education of visitors can be accomplished by providing an information sheet upon check-in. Information on holding tank chemicals is provided in Attachment B2. The sale or provision of such additives by the Discharger to operators of RVs served by the Discharger's wastewater facility may be determined to be evidence of noncompliance with this section.

- e. Aerobic treatment units shall be pumped when any one of the following conditions exists :
 - i. The combined thickness of sludge and scum exceeds one-third of the tank depth of the final settling tank or interferes with the operation of the system (mixed liquor⁸ aerator solids shall not exceed the manufacturer's recommendation).
 - ii. The scum layer is within 3 inches of the outlet device.
 - iii. The sludge layer is within 8 inches of the outlet device.
- f. Septic tanks (a septic tank may be used as a pretreatment step to minimize the amount of solids discharged to an aerobic treatment unit) shall be pumped when any one of the following conditions exists:
 - i. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
 - ii. The scum layer is within 3 inches of the outlet device.
 - iii. The sludge layer is within 8 inches of the outlet device.
- g. Septage is the liquid, solid, and semisolid material that results from wastewater treatment in a septic tank, which must be pumped, hauled, treated, and disposed

⁸ When the activated sludge in an aeration tank is mixed with primary effluent or raw wastewater and return sludge, this mixture is referred to as mixed liquor when it is in the aeration tank.

of properly. (40 C.F.R. § 503.) Septage disposal shall only be to a legal disposal site that has been issued WDRs by a Regional Water Board allowing septage disposal. Septage shall be handled in such a manner as to prevent its reaching surface waters or watercourses.

4. Activated Sludge Systems

- a. Within **90 days** of the issuance of an NOA, the Discharger shall submit a Sludge Management Plan consistent with the requirements of Provision E.1.c of this General Order. The Discharger must obtain written approval from the Regional Water Board's Executive Officer prior to any disposal of sludge. The Executive Officer shall be notified of any changes in an approved Sludge Management Plan at least **90 days** in advance of the proposed change.
- b. Modifications to a Sludge Management Plan deemed part of an emergency action shall be noticed to the Regional Water Board's Executive Officer within **five days** of disposal with a rationale for the emergency modification.

5. Pond Systems

- a. Sufficient freeboard shall be maintained at all times in ponds to provide adequate storage capacity and prevent wastewater spills. Freeboard shall be measured vertically from the lowest elevation of the pond berm to the pond water surface. If freeboard is less than one foot, the discharger shall immediately implement the contingency plan contained in the *Spill Prevention and Emergency Response Plan* (Provision E.1.a).
- b. Pond systems shall have sufficient capacity to accommodate wastewater, design seasonal precipitation, ancillary I/I, and wind driven waves. Design seasonal precipitation shall be based on the following precipitation criteria:
 - i. If wastewater spills do not occur, existing pond systems may continue to operate at their present size if they are covered under individual WDRs, a general order issued by a Regional Water Board, or by WQO 97-10-DWQ. If wastewater spills do occur, the Executive Officer may require the pond size requirement to be consistent with the specification defined in Pond Systems 5.b.ii (below).
 - ii. For new or expanding pond systems covered under this General Order, seasonal precipitation used in the pond sizing water balance calculations shall be based on the following:
 - a. The 100-year return annual total precipitation value distributed monthly in accordance with average (mean) precipitation values. The calculations shall demonstrate adequate capacity to maintain two feet of freeboard in the pond(s).
 - b. The Executive Officer may allow a lower standard for the return annual total precipitation value, with approval of a technical report describing how operation of the wastewater system will not result in wastewater spills. In no case shall the Executive Officer allow less than a 50-year

return annual total precipitation value. If the Discharger seeks relief from the 100-year return annual total precipitation value, the Discharger shall certify that the *Spill Prevention and Emergency Response Plan* (Provision E.1.a) has been prepared, and is adequate to respond to forecast conditions using the 100-year return annual total precipitation value distributed monthly in accordance with average (mean) precipitation values. The calculations shall demonstrate adequate capacity to maintain two feet of freeboard in the pond(s).

- c. All ponds shall be managed to mitigate breeding of mosquitoes including, but not limited to the following:
 - i. An erosion control program shall be implemented to ensure that small coves and irregularities are not created around the perimeter of the water surface.
 - ii. Weeds shall be minimized through control of water depth, a shoreline synthetic liner, harvesting, or herbicides.
 - iii. Dead algae, vegetation, and debris shall be removed from the water surface.
 - iv. Coordination with the local mosquito abatement or vector control district to supplement the measures described above in cases where other methods are infeasible.
- d. Objectionable odors shall not create nuisance conditions beyond the limits of the wastewater treatment facility. A dissolved oxygen concentration less than 1.0 mg/L in the upper one foot of any wastewater pond shall be evidence of the potential to generate objectionable odors.
- e. Burrowing animals active in areas that may compromise the integrity of a pond containment shall be promptly controlled and repairs to the containment completed as soon as possible.
- f. Prior to any removal, drying, treatment, or disposal of sludge for pond maintenance, the Discharger shall submit a Sludge Management Plan consistent with the requirements of Provision E.1.c and obtain written approval from the Regional Water Board's Executive Officer. The Executive Officer shall be notified of any changes in an approved Sludge Management Plan at least **90 days** in advance of the proposed change.

6. Subsurface Disposal Systems

- a. Wastewater shall not surface in any location of the disposal area.
- b. Subsurface disposal systems shall hold in reserve sufficient land area for possible future 100-percent replacement of the subsurface disposal system, or establish an equivalent contingency that is approved by the Regional Water Board's Executive Officer and described in the NOA. If less than 100-percent replacement area was previously permitted under existing individual WDRs, WQO 97-10-DWQ, or a local agency permit, the minimum reserve area previously permitted shall be maintained.

- c. No part of the disposal system(s) shall extend to a depth where waste may pollute groundwater.
- d. All new or rehabilitated disposal areas associated with effluent pressure distribution systems (pressure-dosed systems) shall be equipped with cleanouts or a flushing system to allow solids to be removed from distribution pipes and orifices when needed.
- e. Deep rooted plants such as trees or shrubs shall be removed as needed from a subsurface disposal system area to prevent damage to the dispersal system by roots.
- f. Burrowing animals active in areas that may result in wastewater leakage from an at-grade or above grade (mound) disposal system shall be promptly controlled and repairs to the disposal system completed as soon as possible.
- g. Subsurface disposal systems including leach fields and seepage pits, must comply with USEPA Underground Injection Control requirements when classified as a Class V well. Subsurface disposal systems with at least one of the following characteristics are classified as Class V wells:
 - i. The system has the capacity to serve 20 or more persons per day.
 - ii. The system receives wastewater other than domestic wastewater such as that generated by manufacturing, chemical processing, industrial fluid disposal, automotive repair, or recycling.
 - iii. The system receives sewage containing biological agents (such as wastewater from recreational vehicles or portable toilets).

Disposal systems that are classified as Class V wells must be registered with USEPA either by completing the online form at: <http://www.epa.gov/region09/water/groundwater/injection-wells-register.html> , or by completing and submitting Form 7520-16: Inventory of Injection Wells. Form 7520-16 is available at: <http://epa.gov/region09/water/groundwater/uic-pdfs/7520-16.pdf> .

- h. Limited repairs may be performed by homeowners or contractors as allowed by the Business and Professions Code (Bus. & Prof. Code, §§ 7044, 7048). With certain exceptions, anyone performing construction work in California must be licensed by the California Contractors' State License Board. Leach field repairs shall be performed only by a California licensed General Engineering (A), Plumbing (C-36), or Sanitation System (C-42) contractor. The Discharger shall maintain a record of all repair activities for a minimum of five years. At a minimum, the record shall include the date, nature of repair, service company name, and service company state contractor license number.

7. Land Application and/or Recycled Water Systems

- a. Wastewater shall not be applied to an LAA within 24 hours of forecasted precipitation with a greater than 50-percent probability of occurring, during precipitation events, or when the LAA surface soil is saturated.
- b. Spray irrigation with treated wastewater is prohibited when wind speed (including gusts) exceeds 30 miles per hour. Wind speed may be measured onsite or at a nearby weather station operated by a governmental organization.
- c. Discharge of wastewater from an LAA is prohibited.
- d. If undisinfected wastewater is applied to an LAA, storm water runoff from the LAA is prohibited.
- e. If storm water is allowed to runoff from an LAA (during the time of year wastewater is not applied), all applied wastewater shall meet disinfection requirements at a level equivalent to disinfected secondary-23 recycled water. (Cal. Code Regs., title 22, § 60301.225.) Land application of more highly treated water is acceptable. Alternatively, a Discharger may submit a technical report, for Executive Officer approval, describing how the LAA will be operated to prevent pathogens from migrating off the LAA with stormwater.
- f. If recycled water is applied, it shall comply with the title 22 water recycling criteria, this General Order, the NOA, a title 22 Engineering Report, and any DDW approval conditions.
- g. Public contact with wastewater/recycled water shall be precluded through use of fences, signs, and/or other appropriate means. All public use areas where recycled water is used shall be posted with signs that are visible, in a size no less than 4 inches by 8 inches and include the following wording, "Recycled Water – Do Not Drink." (Cal. Code Regs., tit. 22, § 60310(g).)
- h. Land application areas shall be managed to mitigate breeding of mosquitoes including, but not limited to the following:
 - i. There shall be no standing water 48 hours after application of wastewater.
 - ii. Tailwater ditches must be maintained essentially free of emergent, marginal, or floating vegetation.
 - iii. Low-pressure and unpressurized pipelines and ditches accessible to mosquitoes shall not be used to store wastewater or recycled water.
 - iv. Coordination with the local mosquito abatement or vector control district to supplement the measures described above in cases where other methods are infeasible.

8. Sludge/Solids/Biosolids Disposal

- a. Sludge means the solid, semisolid, and liquid residues removed during primary, secondary, or other wastewater treatment processes. Solid waste refers to grit and screenings generated during preliminary treatment. Residual sludge means

sludge that will not be subject to further treatment at the wastewater system. Biosolids refers to sludge that has undergone sufficient treatment and testing to qualify for reuse pursuant to the USEPA Part 503 Biosolids Rule. (40 C.F.R. § 503.)

- b. Sludge and solid waste shall be removed from screens, sumps, tanks, and ponds as needed to ensure optimal plant operation.
- c. Treatment and storage of sludge shall be confined to the wastewater system property, and shall be conducted in a manner that precludes infiltration of waste constituents into soil in a mass or at concentrations that will violate the groundwater limitations of this General Order.
- d. Any storage of residual sludge, solid waste, or biosolids at the wastewater system shall be temporary, and the waste shall be controlled and contained in a manner that minimizes leachate formation and precludes infiltration of waste constituents into soils in a mass or at concentrations that will violate the groundwater limitations of this General Order.
- e. Residual sludge, and solid waste shall be disposed of in a manner approved by the appropriate Regional Water Board's Executive Officer and consistent with the Consolidated Requirements for Treatment, Storage, Processing, or Disposal of Solid Waste. (Cal. Code Regs., tit. 27 div. 2.) Removal for further treatment, disposal, or reuse at disposal sites operated in accordance with valid WDRs issued by the State Water Board or Regional Water Board will satisfy this specification.
- f. Use and disposal of biosolids shall comply with the USEPA Part 503 Biosolids Rule. (40 C.F.R. § 503.)

C. Groundwater and Surface Water Limitations

1. The discharge shall not

- a. Pollute groundwater or surface waters.
- b. Adversely affect beneficial uses of groundwater or cause an exceedance of any applicable Basin Plan water quality objectives for groundwater or surface water.

D. Effluent Limitations

1. The discharge shall not:

- a. Exceed any of the applicable effluent limitations presented in Table 4. Effluent limitation selection is a two-step process. Step one is based upon the treatment technology employed; step two applies only to systems with a flow rate greater than 20,000 gpd and is based upon an evaluation of the need for a nitrogen effluent limit (as described in Attachment 1). Low and high threat are defined in Attachment 1. The limits presented below are average monthly limits unless otherwise specified.

Table 4: Effluent Limitations for Wastewater Treatment Systems

Step 1 - Effluent Limitations Based on Technology Performance		
Activated Sludge, MBR, or similar (not including residential aerobic treatment units)		
Constituent	Units	Limit
BOD	mg/L	30 (monthly average), 45 (7-day average)
TSS	mg/L	30 (monthly average), 45 (7-day average)
Wastewater Pond or Trickling Filter ¹ (not including residential recirculating sand filters)		
Constituent	Units	Limit
BOD	mg/L	90 ²
TSS	--	Not Applicable

Step 2 - Effluent Limits Based on Low/High Threat Situation (flow rate >20,000 gpd)		
Constituent	Units	Limit
Total N	mg/L	--
Low Threat	mg/L	50 % ³
High Threat	mg/L	10

BOD denotes biochemical oxygen demand; TSS denotes total suspended solids; MBR denotes membrane biological reactor. Residential denotes a single family home, property caretaker's home, a home with an associated residence (e.g. mother in law unit), or similar, with a flow rate less than 400 gpd. "--" denotes not applicable.

1. Limit applies when treated wastewater is applied to an LAA or to a subsurface disposal system.
2. The limit is based on a 65-percent reduction of incoming BOD. An incoming BOD of 250 mg/L was used to calculate the value.
3. The value represents the minimum percent reduction compared to the untreated wastewater value. Reduction shall be calculated on an annual basis. In no case shall the reduction result in an effluent limit lower than 10 mg/L total nitrogen.

E. Provisions

1. Technical Report Preparation Requirements

- a. **Within 90 days** of the issuance of an NOA, aside from residential septic tanks serving four or fewer residences, the Discharger shall prepare and implement a *Spill Prevention and Emergency Response Plan* (Response Plan) that describes operation and maintenance activities to prevent accidental releases of wastewater, and to effectively respond to such releases, minimizing the environmental impact. At a minimum, the Response Plan shall address the following:
 - i. **Operation and Control of Wastewater Treatment** - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.

- ii. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
- iii. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, reports prepared to comply with the State Water Board Order No. 2006-0003-DWQ satisfy this requirement.
- iv. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater or recycled water ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
- v. Notification Procedures - Coordination procedures with fire, police, Governor's Office of Emergency Services (CalOES), Regional Water Board, and local county health department personnel.

The Response Plan shall be maintained at the treatment facility and shall be presented to the Regional Water Board staff upon request.

- b. **Within 90 days** of the issuance of an NOA containing an MRP, the Discharger shall prepare and implement a written sampling and analysis plan (SAP) sufficient to assure compliance with the terms of this General Order and the NOA. Anyone performing sampling on behalf of the Discharger shall be familiar with the SAP. SAPs shall address the need for sample filtration and how filtration will be accomplished. When sampling groundwater or liquid waste, the chemical constituents available to migrate shall be considered. In general, dissolved waste constituents can migrate through soil to groundwater or surface water. In cases where the waste only threatens groundwater, samples shall be filtered prior to chemical preservation, digestion, or analysis for some analytes. If overland flow of liquid waste to surface water is possible, the total constituent concentrations may be available for movement and analyses shall be conducted on unfiltered samples.

At a minimum, the SAP shall describe the following:

- i. Sample chain-of-custody procedures and documentation.
- ii. Sampling locations.
- iii. Sampling frequencies.
- iv. Sample handling/preservation procedures.
- v. Analytical methods.
- vi. Sample containers, preservatives, and holding times.
- vii. For groundwater monitoring, well purging and field methods.

The SAP shall be maintained at the treatment facility and shall be presented to the Regional Water Board staff upon request or as required by the NOA.

- c. **Within 90 days** of the issuance of an NOA directing preparation, the Discharger shall submit and implement a Sludge Management Plan. At a minimum, the plan shall describe the following:
- i. Estimate the amount of sludge and scum that will be generated.
 - ii. Describe how sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - iii. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - iv. Describe cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.

The Sludge Management Plan shall be maintained at the treatment facility and shall be presented to the Regional Water Board staff upon request or as required by the NOA.

- d. If directed by the Regional Water Board Executive Officer pursuant to Water Code section 13267, a discharger shall prepare and submit a Salt and Nutrient Management Plan, to ensure that the overall impact of treated wastewater and/or water recycling projects does not degrade groundwater resources. Unless otherwise directed by the Regional Water Board Executive Officer, in lieu of developing an individual Salt and Nutrient Management Plan the discharger shall participate in a Regional Water Board's existing salt and nutrient management planning effort to meet the requirements of this provision.

2. For All Wastewater Systems:

- a. Bypass (the intentional diversion of waste streams from any portion of a treatment facility) is prohibited. The Regional Water Board and/or the Executive Officer may take enforcement action against the Discharger for bypass unless:
- i. Unavoidable and/or Unscheduled Bypass
 1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage. (Severe property damage means substantial physical damage to property, damage to the treatment facilities that causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production), and

2. There were no feasible alternatives to bypass, such as the use of auxiliary treatment facilities or retention of untreated waste. This condition is not satisfied if adequate backup equipment or wastewater storage facilities should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that would otherwise occur during normal periods of equipment downtime or preventive maintenance; or
- ii. Scheduled Bypass
 1. Bypass is required for essential maintenance to assure efficient operation,
 2. Neither effluent nor groundwater limitations are exceeded,
 3. The Discharger notifies the Regional Water Board's Executive Officer **10 days** in advance, and
 4. The prohibition against discharge to surface water is not violated.
- b. A Discharger that wishes to establish the affirmative defense of an upset (see definition in Provision E.5.a) in an action brought for noncompliance shall demonstrate, through properly signed, contemporaneous operating logs, or other evidence, that all of the following is true:
 - i. An upset occurred and the cause(s) can be identified.
 - ii. The permitted facility was being properly operated at the time of the upset.
 - iii. The Discharger submitted notice of the upset as required in Provision E.3.a.
 - iv. The Discharger complied with any remedial measures required by this General Order, the NOA, or direction from the Regional Water Board's Executive Officer. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof.
- c. A Discharger whose wastewater flow rate has been increasing, or is projected to increase, shall estimate when the flow rate will reach hydraulic and treatment capacities of its treatment, collection, and disposal facilities. The projections shall be made in January, based on the last 3 years average dry weather flow rates, peak wet weather flow rates, and total annual flow rates, as appropriate. When any projection shows that capacity of any part of the facilities may be exceeded in 4 years, the Discharger shall notify the Regional Water Board's Executive Officer by March 1st. Providing the notification in an annual report is acceptable.
- d. The requirements prescribed herein do not authorize the commission of any act causing damage to the property of another, or protect the Discharger from liabilities under federal, state, or local laws. This General Order does not convey any property rights or exclusive privileges and does not create a vested right to continue to discharge wastewater.

- e. This General Order does not relieve the Discharger from responsibility to obtain other necessary local, state, or federal permits to construct facilities necessary for compliance with this General Order, nor does this General Order prevent imposition of additional standards, requirements, or conditions by any other agency.
- f. The prohibitions, requirements, limitations, and provisions of this General Order are severable. If any provision of this General Order is held invalid, the remainder of this General Order shall not be affected.
- g. To the maximum extent possible, the wastewater system shall be sited and/or designed to prevent flood or surface water from inundating wastewater ponds or otherwise render the wastewater system inoperable. For design purposes, the most recent Federal Emergency Management Agency (FEMA) approved 100-year base flood elevations shall be used.
- h. The Discharger shall ensure that all site operating personnel are familiar with the contents of the wastewater system NOA, this General Order, and the title 22 Engineering Report (for recycled water uses when applicable). A copy of this General Order, the NOA, and technical reports required by this General Order (not including previously submitted monitoring reports) shall be kept at the wastewater treatment facility for reference by operating personnel.
- i. Access to the wastewater system shall be limited to authorized persons.
- j. The Discharger shall comply with all of the conditions of this General Order. Any noncompliance with this General Order constitutes a violation of the Porter-Cologne Water Quality Control Act and/or appropriate Regional Water Board's Basin Plan and may be grounds for an enforcement action.
- k. Wastewater facilities shall be supervised and operated by persons possessing a wastewater treatment operator certificate of the appropriate grade. (Cal. Code Regs., tit. 23, div. 3, ch. 26.) The definition of wastewater treatment plant in the wastewater treatment plant classification, operator certification, and contract operator registration regulations excludes treatment systems that use subsurface disposal.
- l. The State Water Board will review this General Order periodically and will revise requirements when necessary.
- m. After notice and opportunity for a hearing, coverage of this General Order may be terminated or modified for cause including, but not limited to, any of the following:
 - i. Violation of any of the terms or conditions contained in this General Order.
 - ii. Obtaining this General Order by misrepresentation, or failure to disclose fully all relevant facts.
 - iii. A change in any condition that results in either a temporary or permanent need to reduce or eliminate the authorized discharge.

- iv. A material change in the character, location, or volume of discharge.
- n. Before making a material change in the character, location, or volume of discharge, the Discharger shall notify the Regional Water Board Executive Officer. A material change includes, but is not limited to, any of the following:
 - i. An increase in area or depth used for waste disposal beyond that specified in the NOA.
 - ii. A significant change in disposal method, location, or volume (e.g., change from land application to percolation pond).

The Regional Water Board's Executive Officer may require that an ROWD be submitted.

- o. At least **90 days** prior to termination or expiration of any lease, contract, or agreement involving disposal or recycling areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this General Order, the Discharger shall notify the Regional Water Board's Executive Officer in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this General Order and the NOA.
- p. Except for material determined to be confidential in accordance with California law, all reports prepared in accordance with terms of this General Order shall be available for public inspection at the offices of the Regional Water Board. Data on waste discharges, water quality, geology, and hydrogeology are not confidential.
- q. The Discharger shall take all reasonable steps to minimize any adverse impact to waters of the state resulting from noncompliance with this General Order. Such steps shall include accelerated or additional monitoring as necessary to determine the nature and impact of the noncompliance.
- r. The Discharger shall maintain in good working order, and operate as efficiently as possible any facility, control system, or monitoring device installed to achieve compliance with this General Order and the NOA.
- s. The Discharger shall permit representatives of the Regional Water Board and/or the State Water Board, upon presentation of credentials, to:
 - i. Enter premises where wastes are treated, stored, or disposed of, and facilities in which any records are kept.
 - ii. Copy any records required under terms and conditions of this General Order.
 - iii. Inspect at reasonable hours, monitoring equipment required by this General Order.
 - iv. Sample, photograph, and/or video record any discharge, waste material, waste treatment system, or monitoring device.

- t. For any electrically operated equipment at the site, the failure of which would cause loss of control or containment of waste materials, or violation of this General Order, the Discharger shall employ safeguards to prevent loss of control over wastes. Such safeguards may include alternate power sources, standby generators, retention capacity, operating procedures, or other means.
- u. The fact that it would have been necessary to halt or reduce the permitted activity to maintain compliance with this General Order shall not be a defense for the Discharger's violations of the General Order.
- v. The discharge shall remain within the disposal area designated in the NOA at all times. (With the exception of activities allowed in an approved title 22 Engineering Report.)
- w. In the event of any change in control or ownership of the facility or wastewater disposal areas, the Discharger must notify the succeeding owner or operator of the existence of this General Order by letter, a copy of which shall be immediately forwarded to the Regional Water Board's Executive Officer.
- x. The Discharger shall pay an annual fee to the State Water Board in accordance with the fee schedule for each fiscal year. (Cal. Code Regs., tit. 23, § 2200.) Fees are based on threat to water quality and complexity ratings, will be determined based on information in the ROWD, and are subject to revision by the State Water Board. Annual invoices are issued by the State Water Board for the state fiscal year (July 1 to June 30).

3. General Reporting Requirements:

- a. If the Discharger does not comply, or will be unable to comply, with a limit related to effluent quality, pond freeboard, flow rate, the title 22 engineering report requirements, or bypass or overflow issues, the Discharger shall notify the Regional Water Board staff by telephone. Current phone numbers for Regional Water Board offices may be found on the NOA or on the Internet at:

http://www.waterboards.ca.gov/about_us/contact_us/docs/rwqcbcs_directory.pdf

Notification shall occur as soon as the Discharger or its agents have knowledge of such noncompliance or potential for noncompliance, and the Discharger shall confirm this notification in writing within **10 days**. The written notification shall state the date, time, nature, cause of noncompliance, immediate response action, and a schedule for corrective actions.

- b. In the event of a wastewater containment failure, the Discharger shall immediately notify CalOES. Notification shall be provided as soon as possible and when the notice can be provided without substantially impeding cleanup or other emergency measures. (Wat. Code, § 13271.) A written report to the Regional Water Board's Executive Officer shall be submitted within **10 days** of the failure describing the cause of the failure and how a recurrence will be prevented. Such a failure shall be promptly corrected in accordance with the requirements of this General Order.

- c. All reports submitted in response to this General Order, including monitoring reports, shall be signed by a person identified below:
- i. For a private residence: by the property owner of the residence.
 - ii. For a corporation: by a principal executive officer of at least the level of senior vice-president.
 - iii. For a partnership or sole proprietorship: by a general partner or the proprietor.
 - iv. For a municipality, state, federal, or other public agency: by either a principal executive officer or ranking elected or appointed official.
 - v. A duly authorized representative of a person described above if all of the following are completed:
 - 1) The authorization is made in writing by a person described above.
 - 2) The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity, such as the position of plant manager, operator of a waste management unit, superintendent, or position of equivalent responsibility. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.)
 - 3) The written authorization is submitted to the Regional Water Board.

Any person signing a document under this section shall make the following certification:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

- d. The Discharger shall mail a copy of each monitoring report and any other reports required by this General Order to the appropriate Regional Water Board or provide electronic submittals of reports or data as specified by the Regional Water Board. Contact and mail address information is available on the NOA or at:

http://www.waterboards.ca.gov/about_us/contact_us/docs/rwqcbcs_directory.pdf

4. Monitoring Requirements

- a. The Discharger shall comply with the MRP issued with the NOA, and any future revisions, as specified by the appropriate Regional Water Board's Executive Officer. A model MRP is provided as Attachment C. However, the Executive Officer may modify or replace the MRP for site-specific treatment and disposal conditions when issuing the NOA, or revise the MRP when deemed necessary.

- b. Unless otherwise approved by the Regional Water Board's Executive Officer, all analyses shall be conducted at a laboratory certified for the analyses by the DDW Environmental Laboratory Accreditation Program. If a certified laboratory is not available to the Discharger, analyses performed by a noncertified laboratory will be accepted provided an acceptable Quality Assurance/Quality Control Program is instituted by the laboratory. A manual containing the steps followed in this program must be kept in the laboratory and shall be available for inspection by Regional Water Board staff. The Quality Assurance/Quality Control Program must conform to USEPA guidelines or to procedures approved by the Regional Water Board.
- c. The results of any monitoring done more frequently than required by an MRP shall be reported in the next regularly scheduled monitoring report. Values obtained through additional monitoring shall be used in calculations as appropriate.
- d. Treated wastewater samples shall be collected downstream of all treatment works where a sample representative of the discharge can be obtained prior to disposal. In some cases, it may be necessary to collect samples for different analyses from different sampling locations (e.g. immediately downstream of a disinfection system for pathogens).
- e. The Discharger shall furnish, within a reasonable time, any information the Regional Water Board's staff may request to determine whether cause exists for modifying, revoking, reissuing, or terminating the Discharger's coverage under this General Order. The Discharger shall also furnish to the Regional Water Board's staff upon request, copies of records required to be kept by this General Order.
- f. All noncompliance issues shall be reported with the next regularly scheduled monitoring report in addition to any other reporting requirements.
- g. The Discharger shall retain records of all monitoring information, including all calibration and maintenance records, all original strip chart recordings of continuous monitoring instrumentation, copies of all reports required by this General Order, and records of all data used to complete the application for this General Order. Records shall be maintained for a minimum of **3 years** from the date of the sample, measurement, report, or application. This period may be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Water Board's Executive Officer.
- h. All monitoring and analysis instruments and devices used by the Discharger to fulfill the prescribed MRP shall be properly maintained and calibrated as recommended by the manufacturer to ensure their continued accuracy.
- i. The Discharger shall construct all groundwater monitoring wells to meet or exceed the standards stated in Department of Water Resources' Bulletins 74-81, 74-90, and subsequent revisions unless deviation is approved by the Regional Water Board's staff or local well construction enforcing agency, and shall comply with the reporting provisions for wells. (Wat. Code, § 13751.)

5. Definitions

- a. Upset means an exceptional incident in which there is unintentional and temporary noncompliance with effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper action.
- b. The monthly average flow rate is the total discharge by volume during a calendar month divided by the number of days in the month that the facility was discharging. This number shall be reported in gpd or million gallons per day.
- c. The monthly average concentration is the arithmetic mean of measurements recorded during a calendar month. If only one sample is collected in a calendar month, then that sample measurement is the monthly average concentration.
- d. The daily maximum concentration is the highest measurement recorded for any grab or composite sample collected during a day in a calendar month.
- e. The 7-day median total coliform organism value shall be calculated as the median concentration of the results for the last 7 calendar days. If only one sample is collected within a 7-day period, then that one sample becomes the 7-day median value.
- f. A grab sample is an individual sample collected in less than 15 minutes.
- g. Unless otherwise specified, a composite sample is a combination of individual samples collected over the specified sampling period. The method of compositing shall be reported with the results.
- h. A time-weighted sample is collected at equal time intervals, with a maximum interval of one hour.
- i. A flow-weighted sample is collected at varying time intervals (average interval one hour or less) so that each sample represents an equal portion of the cumulative flow. The duration of the sampling period shall be specified in the MRP.
- j. A day is the mean solar day of 24 hours beginning at mean midnight. All references to day in this General Order are calendar days.

CERTIFICATION


I, Jeanine Townsend, Clerk to the Board, do hereby certify that this General Order with all attachments is a full, true, and correct copy of a General Order adopted by the State Water Board, on September 23, 2014.

AYE: Chair Felicia Marcus
Vice Chair Frances Spivy-Weber
Board Member Tam M. Doduc
Board Member Steven Moore
Board Member Dorene D'Adamo

NAY: None

ABSENT: None

ABSTAIN: None



Jeanine Townsend
Clerk to the Board

ATTACHMENT 1
NITROGEN EFFLUENT LIMIT EVALUATION
ORDER WQ 2014-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS


Introduction

The nitrogen effluent limit will only be imposed where required to protect beneficial uses of groundwater and surface water and shall not be selected as a default to add water quality protection where the added expense of nitrogen control is not required. It is the discharger's responsibility to provide adequate information to allow the evaluation of the need for additional treatment.

Each of the five site-specific considerations listed below shall be considered when evaluating a discharge and the need for nitrogen control. The site-specific conditions are further discussed on the explanation sheets. If each of the site-specific considerations is favorable (as discussed individually below), the facility is not required to meet an effluent limit for nitrogen.

The attached flow charts provide a method to evaluate the discharge and the receiving environment to determine the applicability of a nitrogen effluent limit. Evaluation of the need for a nitrogen effluent limit is a two-step process. In the first step, applicability of a nitrogen effluent limit is determined based on the flow rate and site-specific characteristics of the receiving environment; in the second step effluent limits are selected based on further evaluation of level of threat related to the site-specific characteristics of the discharge and the receiving environment.

To begin the evaluation start at "Step A: Flow and Site-Specific Considerations," on the following page.

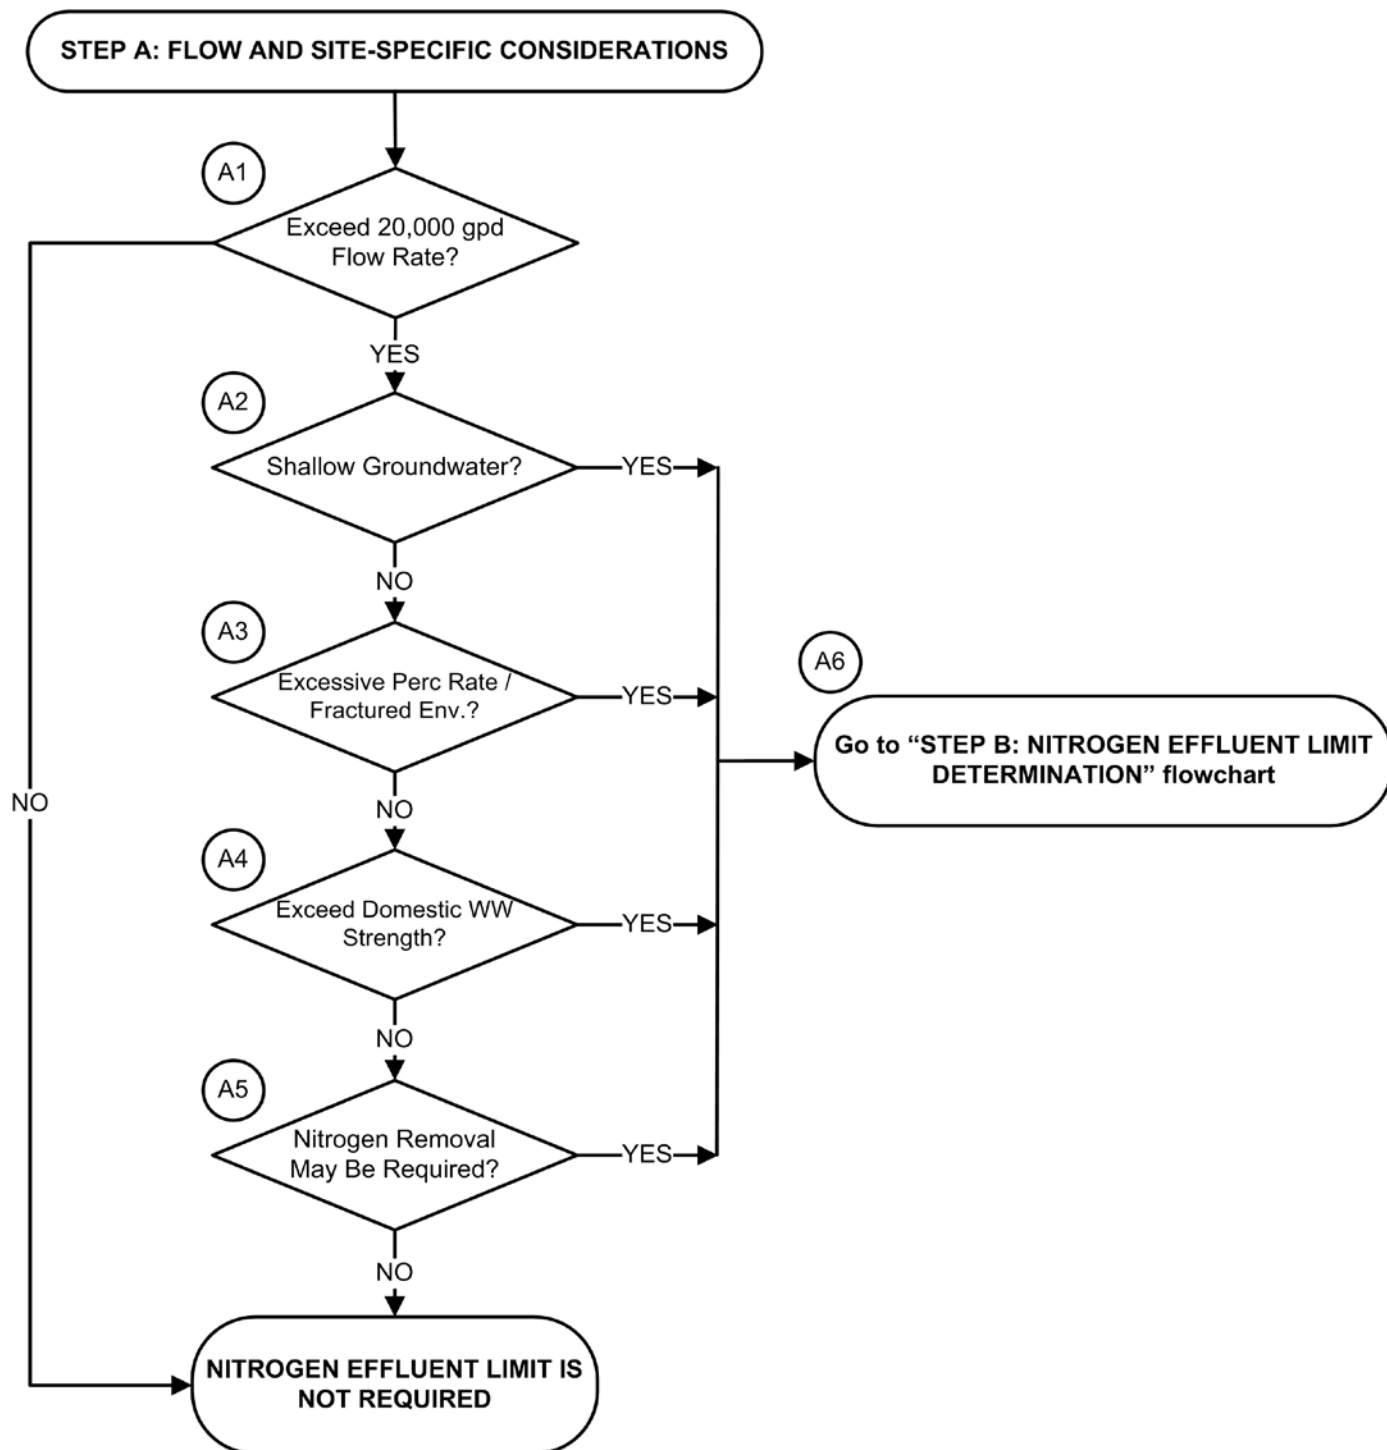

Step A – Flow and Site-Specific Considerations

The following considerations shall be evaluated to determine if a nitrogen effluent limit is appropriate.

- A1 *Exceed 20,000 gpd Flow Rate?* The General Order allows a flow rate up to 100,000 gpd. However, discharges with flow rates less than 20,000 gpd are not required to meet a nitrogen effluent limit.
- A2 *Shallow Groundwater?* Shallow groundwater conditions are defined by the OWTS Policy Table 2, *Minimum Depth to Groundwater and Minimum Soil Depth from the Bottom of the Dispersal System* (reproduced as Table 5 below).

Table 5: Minimum Depth to Groundwater and Minimum Soil Depth from the Bottom of Dispersal System

<u>Percolation Rate</u> ^a	<u>Depth to Groundwater</u> ^b
Perc Rate ≤ 1 MPI	Additional Treatment Required
1 MPI ≤ Perc Rate ≤ 5 MPI	20 Feet
5 MPI ≤ Perc Rate ≤ 30 MPI	8 Feet
30 MPI ≤ Perc Rate ≤ 120 MPI	5 Feet
Perc Rate ≥ 120 MPI	Engineered Disposal Required

^a Perc Rate denotes percolation rate. MPI denotes minutes per inch.

^b The minimum depth to groundwater is measured from the base of the infiltration surface to the seasonally high groundwater table or first saturated interval.


- A3 *Excessive Percolation Rate / Fractured Environment?* An excessive percolation rate is defined as a combination of percolation rate and depth to groundwater that does not comply with the conditions presented in Table 5.

A fractured environment is defined as less permeable rock with porosity resulting from fractures that allows groundwater to flow through the fractures and has either of the following: a) No unconsolidated soil cover, or b) Unconsolidated soil cover that possesses an excessive percolation rate (that does not comply with the conditions defined in Table 5).

- A4 *Exceed Domestic Wastewater Strength?* Typical domestic wastewater strength is presented in Finding 8 of the General Order. Alternative domestic wastewater strengths may be based upon other per capita flow rate assumptions. The data presented in the General Order may be used; alternative characterizations from textbook and/or governmental organizations (e.g. U.S. Environmental Protection Agency) may be acceptable at the discretion of Regional Water Quality Control Board (Regional Water Board) staff.

Some domestic wastewater streams (domestic wastewater originating in factory or warehouse situations) may exceed the typical municipal wastewater strengths due to a lack of diluting flows from showers, dishwashers, etc. Such flows are not excluded from coverage by the General Order; however, the discharge shall be evaluated to determine if nitrogen effluent limits are appropriate.

- A5 *Nitrogen Removal May Be Required?* If the Regional Water Board Basin Plan or groundwater studies indicate that nitrogen is a constituent of concern, then nitrogen reduction may be required. The appropriate limit shall be based on site conditions as evaluated in Step B.
- A6 *Go to “NITROGEN EFFLUENT LIMIT DETERMINATION” flowchart:* If the preliminary evaluation (Step A) indicates a nitrogen effluent limit may be required, proceed to the Nitrogen Effluent Limit Determination flowchart to determine if an effluent limit for nitrogen is required.

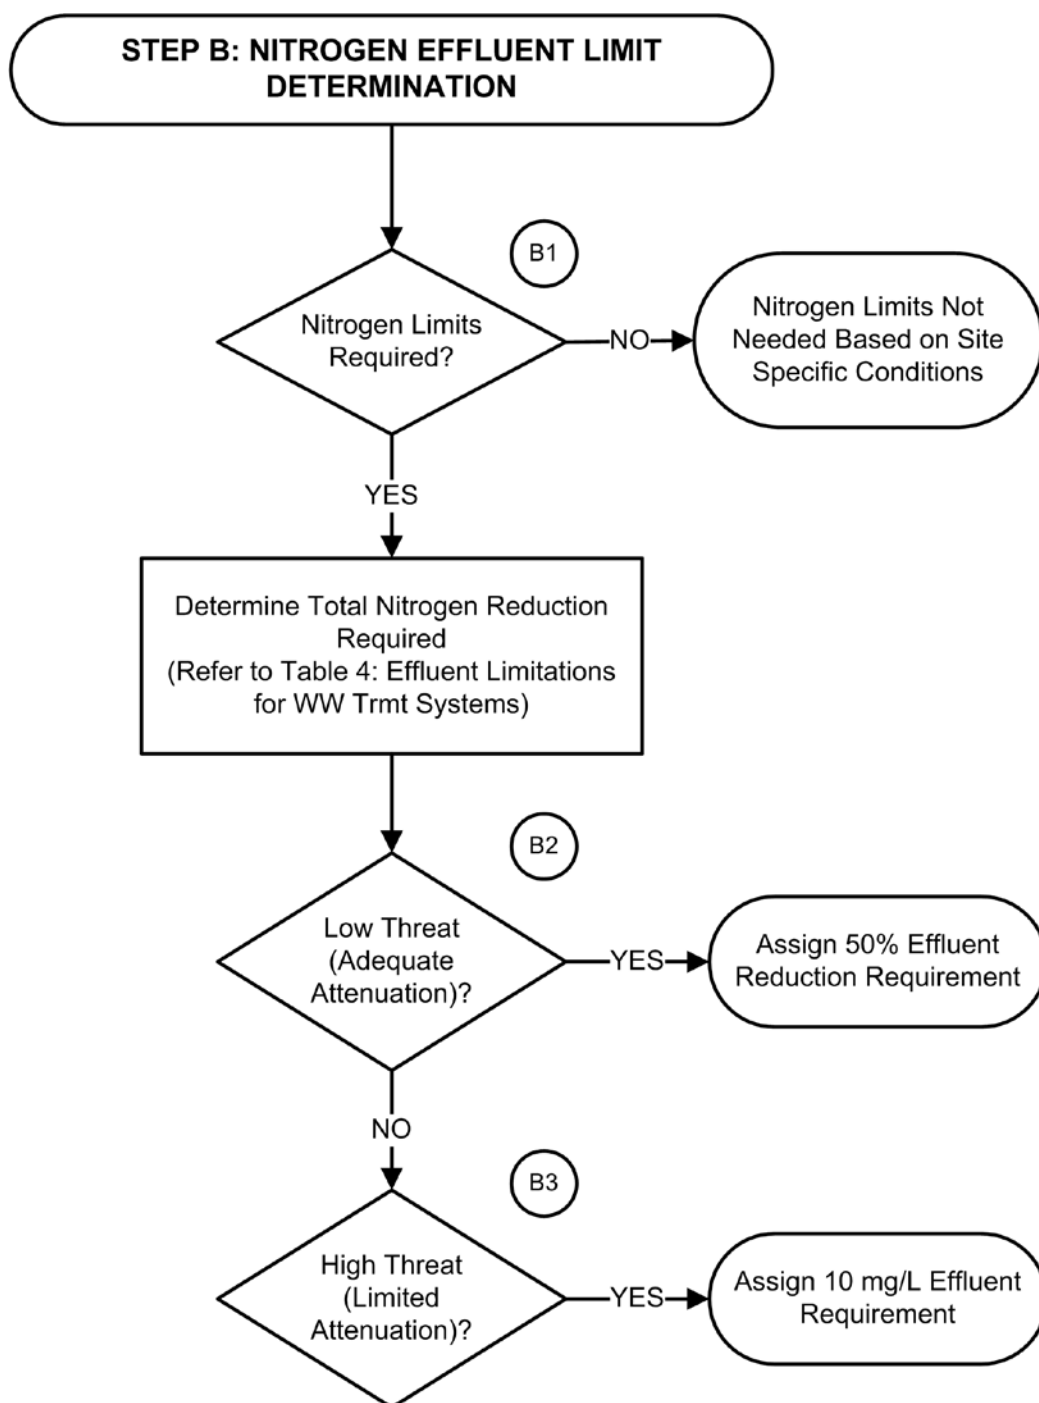

Step B – Nitrogen Effluent Limit Evaluation

If a Regional Water Board's Basin Plan addresses the area where the site is located, the nitrogen control measures shall be consistent with the Basin Plan.

If the Step A evaluation indicated additional treatment for nitrogen control may be necessary, continue the evaluation at "Step B, Nitrogen Effluent Limit Determination."

- B1 *Nitrogen Limits Required?* The initial evaluation of the need for nitrogen control (discussed in Item A5) shall include comparison of the wastewater effluent quality to groundwater quality and the potential for the wastewater discharge to cause or contribute to a condition of pollution or nuisance. The benefits of nitrogen control should be balanced with the cost of implementing nitrogen control.

Measures implemented to protect groundwater quality (e.g. equipping a pond with a synthetic or low permeability liner to reduce infiltration, using supplemental water to reduce LAA loading rates, or agronomic application of nitrogen) should be considered when determining the need for nitrogen effluent limits.

- B2 *Low-Threat (Adequate Attenuation)?* In low-threat situations, the 50 percent nitrogen removal (in effluent prior to discharge) is appropriate. Low-threat situations are those where additional nitrogen removal will occur in the dispersal area (e.g. land application crop uptake, denitrification, shallow dispersal area, etc.) or where adequate attenuation exists based on other conditions such as depth to groundwater.

- B3 *High-Threat (Limited Attenuation)?* In high-threat situations, the 10 milligrams per liter (mg/L) effluent limit is appropriate. High-threat situations are those where limited nitrogen removal will occur in the dispersal area or in limited attenuation situations (e.g. shallow depth to groundwater, fractured aquifer, potential for groundwater to migrate to surface water bodies with limited attenuation, etc.).

INFORMATION SHEET SUMMARY
 STATE WATER RESOURCES CONTROL BOARD
 ORDER WQ 2014-0153-DWQ
 GENERAL WASTE DISCHARGE REQUIREMENTS
 FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS

The attachments to this Information Sheet will help Dischargers understand the process of obtaining coverage under these *General Waste Discharge Requirements for Discharges to Land by Small Domestic Systems* (General Order). The attachments describe the permitting process and the information needed by Regional Water Quality Control Board (Regional Water Board) staff to prepare a Notice of Applicability (NOA), which provides the Discharger coverage under the General Order. Although not required, organization of the technical report described in Attachment B1 in the format presented in the attachment will allow streamlined review of the facility information and may reduce the time required to prepare an NOA. Some Regional Water Boards have implemented procedures for electronic submittal of technical reports and monitoring data. The Dischargers shall comply with those submittal requirements when applicable.

The Discharger is encouraged to contact the Regional Water Board staff early in the process to discuss their conceptual wastewater plan. Attachment A shows the generalized permitting process; it is recommended each of the items in the box labeled "Contact Regional Water Board to Discuss" be listed on a meeting agenda so that they are adequately discussed.

The *Conceptual Wastewater Plan* listed on Attachment A shall be complete enough for a meaningful discussion with the Regional Water Board staff so that any significant issues can be identified early in the process. However, the details of the *Conceptual Wastewater Plan* are unlikely to be finalized at this stage of the process. Determinations regarding the *Conceptual Wastewater Plan* may require additional investigation by the Discharger before the Regional Water Board staff can provide definitive answers to questions about the *Conceptual Wastewater Plan*.

Questions the Discharger may have regarding any of the attachments (such as the report requirements described in Attachment B1) should also be discussed at the meeting. At the conclusion of the meeting, the Discharger should understand how their system will be evaluated using the General Order Attachment 1, *Nitrogen Effluent Limit Evaluation*, and if any additional investigations are required to provide a complete Report of Waste Discharge.


The attachments included in this Information Sheet consist of the following:

<u>Name</u>	<u>Title</u>
Attachment A	Generalized Permit Application Process Summary
Attachment B1	Recommended Report of Waste Discharge Format
Attachment B2	Safe Wastewater Disposal for Recreational Vehicles
Attachment C	Model Monitoring and Reporting Program

ATTACHMENT A - INFORMATION SHEET
 GENERALIZED PERMIT APPLICATION PROCESS SUMMARY
 STATE WATER RESOURCES CONTROL BOARD
 ORDER WQ 2014-0153-DWQ
 GENERAL WASTE DISCHARGE REQUIREMENTS
 FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS


The Discharger shall perform the following:

- Determine availability of regional collection system
- Determine need to submit a Report of Waste Discharge (ROWD)
- Review Nitrogen Effluent Limit Evaluation (Attachment 1)
- Develop a Conceptual Wastewater Plan




Contact Regional Water Board to discuss:

- Wastewater characterization/treatment/disposal plan
- Water balance precipitation value
- Threat and Complexity/Application Fee
- Storm water runoff/wastewater disinfection needed?
- Review Nitrogen Effluent Limit Evaluation (Attachment 1)
- Title 22 Engineering Report needed?
- Groundwater monitoring needed?
- Sanitary Sewer Overflow General Order Applicability
- Operator Certification Required?
- California Environmental Quality Act status
- Electronic ROWD application/monitoring report procedures




Submit Report of Waste Discharge
 (electronic submittal if requested by Regional Water Board)

- Completed Form 200
- Application fee payment
- Technical Report (prepared consistent with the guidance in Attachment B1, or as directed by Regional Water Board staff).



Regional Water Board ROWD Review

- If the ROWD is complete, a notice of applicability (NOA) will be prepared.
- If incomplete, a Notice of Incomplete ROWD will be transmitted to the Discharger.



NOA Issued

- The NOA authorizes the wastewater discharge consistent with the ROWD, NOA, General Order, and title 22 Engineering Report (if applicable).
- The NOA will specify compliance criteria, monitoring requirements, and reporting requirements. In some cases, electronic reporting may be required.

ATTACHMENT B1 – INFORMATION SHEET
 RECOMMENDED REPORT OF WASTE DISCHARGE FORMAT
 STATE WATER RESOURCES CONTROL BOARD
 ORDER WQ 2014-0153-DWQ
 GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC
 WASTEWATER TREATMENT SYSTEMS
 GENERAL INFORMATION FOR DISCHARGER

The information presented in the Report of Waste Discharge (ROWD) is relied upon by staff to prepare the Notice of Applicability (NOA) for coverage by this General Waste Discharge Requirements for Order (General Order). The Discharger shall ensure that the information presented in the ROWD is accurate. Misstatements, errors, or omissions that exist in the ROWD may be included in the NOA and become enforceable.

Waste Discharge Requirements (WDRs) are generally updated at 10 or 15 year intervals depending on the waste's potential to impact water quality. The ROWD shall state realistic growth projections. Underestimating growth may result in additional or more frequent permitting requirements. Overestimating growth will result in the need for the Discharger to prepare more treatment, storage, and disposal capacity than might otherwise be immediately required.

The ROWD outline presented below is intended to provide general guidance for Dischargers and consultants. Submitting an ROWD consistent with the format will help the Discharger include all of the information that Regional Water Quality Control Board (Regional Water Board) staff need and will expedite review of the document and speed the permitting process. Contacting your Regional Water Board representative to discuss the project before preparing the ROWD is recommended.

1. BACKGROUND

1.1. Wastewater system description

- 1.1.1. Briefly, describe what the wastewater system is and how wastewater is generated.
- 1.1.2. Provide a site location map and a site plan.
- 1.1.3. Provide information on the location of wastewater system buildings, wastewater treatment system components, groundwater wells, and surface water bodies.
- 1.1.4. Provide the Assessor's Parcel Number(s), section number(s), and Township and Range.
- 1.1.5. Describe the water supply to the residence(s), business(es), and/or other facilities being served by the wastewater system.

1.2. Service area description

- 1.2.1. Describe the proximity of the wastewater system to an existing regional collection system; if nearby, discuss why connection to the regional system cannot be accomplished. If located within a regional system service area, or in close proximity to a collection system, provide written documentation that a good faith effort to connect to the regional system was made and that the request was not approved.

1.2.2. Wastewater collection system (describe the following). For collection systems subject to State Water Board Order No. 2006-0003-DWQ, reports prepared to comply with the State Water Board Order No. 2006-0003-DWQ satisfies this requirement and may be submitted as part of the ROWD technical report.

1.2.2.1. Age and condition of collection system.

1.2.2.2. Piping construction and layout (show on map).

1.2.2.3. Lift stations and backup pumping systems.

1.2.2.4. Failure warning system.

1.2.2.5. Inflow and infiltration (I/I) estimates (and any control that is necessary).

1.2.2.6. Maintenance of collection system and spill response.

1.2.3. Storm water collection system

1.2.3.1. Storm water collection area (show on map).

1.2.3.2. Storm water disposal area in relation to wastewater disposal area.

1.2.3.3. Storm water disposal permit (if needed).

2. WASTEWATER CHARACTERIZATION AND TREATMENT

2.1. Domestic wastewater characterization (untreated wastewater).

2.1.1. Describe the generation of wastewater (retirees, families, recreational vehicle [RV], institution, etc.).⁹ If RV waste is allowed, describe educational and institutional controls in place to minimize the potential for deleterious RV waste constituents to be discharged to the wastewater system.

2.1.2. Domestic wastewater flow rate (describe how determined). Describe any special events or seasonal variations that cause high wastewater flow rates or other sources of wastewater (e.g. swimming pool filter, potable water treatment backwash water, well attended festivals, etc.).

2.1.3. Characterize domestic wastewater for Biochemical Oxygen Demand (BOD), Total Suspended Solids (TSS), electrical conductivity, nitrogen, sodium, chloride, and specific constituents of concern as needed based on site activities. Characterize wastewater for holding tank chemicals identified in the General Order (and others as appropriate) if RV waste is discharged to the system.

2.2. Wastewater treatment system

2.2.1. Provide a wastewater treatment schematic.

⁹ Recreational vehicle (RV) holding tank connections, RV waste dump stations, etc. create special conditions for treatment and monitoring. Please refer to the General Order for more information.

- 2.2.2. Describe wastewater pretreatment components.
 - 2.2.2.1. Domestic wastewater pretreatment systems (e.g. septic tank effluent pump system, grease traps, etc.).
 - 2.2.2.2. Describe storage, treatment, and disposal of pretreatment residuals.
- 2.2.3. Describe preliminary treatment activities (e.g., screening, comminution, grit removal).
 - 2.2.3.1. Describe storage, treatment, and disposal of preliminary treatment residuals.
- 2.2.4. Describe primary treatment activities (remove settleable/flotable matter)
 - 2.2.4.1. Describe storage, treatment, and disposal of primary treatment residuals.
- 2.2.5. Describe treatment technology (e.g., activated sludge, membrane biological reactor, aerated lagoon, oxidation ditch, Imhoff tank, septic tank, etc.) include engineered design capacity in description.
 - 2.2.5.1. Describe storage, treatment, and disposal of treatment residuals (e.g. sludge, septage, etc.).
- 2.2.6. Size and location of treatment equipment (e.g. septic tank volume, package treatment plant, membrane biological reactor, pond size include acreage and storage capacity, pond liners, and number and horsepower of aerators, etc.).
- 2.2.7. Disinfection system equipment
- 2.2.8. Storage facilities
 - 2.2.8.1. If wastewater will be stored prior to disposal, describe the size and location of wastewater storage ponds, include a map showing all the ponds and describe them as lined or not. Describe the materials, age, and condition of any liners.
- 2.2.9. Predicted wastewater effluent quality
 - 2.2.9.1. Characterize the wastewater for TSS, BOD, total coliform organisms (if needed), and specific constituents of concern as needed. If RV waste is discharged to the system, characterize for holding tank chemicals identified in the General Order (and others as appropriate).
- 2.2.10. Treated effluent disposal method
 - 2.2.10.1. Describe how treated wastewater will be dispersed (land application area, leach field, percolation pond).
 - 2.2.10.2. Describe the proposed disposal area (and the 100-percent replacement area when needed, such as for a leach field disposal system) include acreage, surrounding land use, depth to groundwater, and the proximity of drainage ways, surface waters, and municipal, industrial, or agricultural wells.

- 2.2.10.2.1. If land application is proposed, describe how storm water that falls on the land application area (LAA) is handled. If storm water is allowed to run off the LAA, contact your Regional Water Board representative to discuss wastewater disinfection requirements.
- 2.2.10.2.2. Provide a water balance that demonstrates adequate storage/disposal capacity. Identify the safety factors used in the calculations. Please contact your Regional Water Board representative to determine the precipitation values to be included in the water balance. Typically, the 100-year return annual total precipitation value, distributed monthly in accordance with average (mean) precipitation values monthly is required. Some exemptions for existing ponds or sites that develop an acceptable *Spill Prevention and Emergency Response Plan* may apply. Rainfall depth duration frequency data is available on the Department of Water Resources Internet web page at:
<<http://www.water.ca.gov/floodmgmt/hafoo/hb/csm/engineering/>>
- 2.2.10.2.3. Support the assumptions and calculations in the water balance with adequate information. Information may include published infiltration values, site-specific percolation tests, application rates, or other sources. Cite the information source used; if a site-specific investigation, provide a copy of the report.
- 2.2.10.2.4. The use of subsurface disposal including leach fields and/or seepage pits serving more than 20 people, or systems that accept non-sanitary waste (generated by manufacturing, contains biocidal agents such as RV or portable toilets, etc.) must comply with the United States Environmental Protection Agency Underground Injection Control requirements. Please refer to General Order Requirement B.6.g and <http://www.epa.gov/region9/water/groundwater/uic.html> to determine if federal requirements apply to the proposed project. If registration is required, documentation of registration shall be provided in the ROWD.

2.3. Recycled Water Projects

- 2.3.1. If treated wastewater will be applied for beneficial uses (such as those described in title 22 water recycling criteria), provide a title 22 Engineering Report and the State Water Board Division of Drinking Water (DDW) (formerly the California Department of Public Health (CDPH) review/approval letter. Guidance for preparation of a title 22 Engineering Report is available on the Internet at:
<http://www.cdph.ca.gov/certlic/drinkingwater/Documents/Recharge/ERGUIDE2001.PDF>

2.3.1.1. Describe how any DDW requirements will be implemented in the project.

2.3.1.2. If needed, describe the disinfection requirements for the planned reuse.

2.4. Operation and Maintenance

2.4.1. Describe routine operation and maintenance procedures

2.4.2. Treatment operator training and qualifications requirements

2.4.3. Contingency plans for repairs/spills/treatment issues

3. GROUNDWATER QUALITY

3.1. Depending upon the threat to groundwater quality, groundwater monitoring may be required. Please contact your Regional Water Board representative to determine if groundwater monitoring is required.

4. CALIFORNIA ENVIRONMENTAL QUALITY ACT (CEQA)

4.1. Some existing Small Domestic Systems will be determined to be categorically exempt from the California Environmental Quality Act (CEQA) under Title 14, section 15301 (ongoing or existing projects), section 15302 (replacement or reconstruction of existing utility systems), and section 15303 (new construction or conversion of small structures). The potential for categorical exemptions shall be examined and discussed with the Regional Water Board representative prior to submitting an ROWD.

4.2. New or expanding Small Domestic Systems will likely require CEQA evaluation that should be performed by local agencies. The CEQA evaluation shall be submitted with the ROWD. At a minimum, the evaluation shall include the Initial Study, a list of any adopted mitigation measures related to water quality, and the Notice of Determination.

4.2.1. The ROWD must include a description of how any water quality related mitigation measures will be implemented.

5. ADDITIONAL TECHNICAL REPORTS

5.1. If required by the General Order, a *Sludge Management Plan* shall be submitted with the ROWD.

5.1.1. Estimate the amount of sludge and scum that will be generated.

5.1.1.1. Describe how sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.

5.1.1.2. If sludge will be subject to further treatment, describe the treatment and storage requirements.

5.1.1.3. Describe cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.

ATTACHMENT B2 – INFORMATION SHEET
SAFE WASTEWATER DISPOSAL FOR RECREATIONAL VEHICLES
STATE WATER RESOURCES CONTROL BOARD
ORDER WQ 2014-0153-DWQ
GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS



United States
Environmental
Protection Agency

Region 9 Ground Water
Office (WTR-9)

EPA 909-F-99-002
JULY 1999

ALERT FOR RV, BOAT AND MOBILE HOME OWNERS AND PARK OPERATORS ABOUT SAFE WASTEWATER DISPOSAL

DO NOT USE CHEMICALS WHICH HARM SEPTIC SYSTEMS

Formaldehyde: active ingredient in some deodorizers, also called Formalin. Formaldehyde is an EPA-recognized probable carcinogen (i.e., causes cancer).

Para-dichlorobenzene: Known carcinogen and drinking water contaminant. Common ingredient in mothballs, urinal cakes and bowl fresheners.

OTHER CHEMICALS TO BEWARE OF INCLUDE heavy metals (such as Zinc), benzene, toluene, xylene, ethylene glycol (anti-freeze), methylene chloride, 1,1,1-trichloroethane (TCA), trichloroethylene (TCE) and perchloroethylene (PCE). Strong acids and bases, such as sulfuric acid or caustic soda, can destroy biological activity and damage tanks and pipes.

\$ A healthy, well-maintained and appropriately sized septic tank will generally require less pumping over its service life, saving time and money.

If you spend any time in a recreational vehicle (RV) or boat, you probably know of the problem of odors from sewage holding tanks. There are a number of commercial products available to control those odors. Some of those products contain chemicals which may pollute water resources. If you use those chemicals and then empty your holding tank into a septic system (or other onsite wastewater treatment system) or dispose of holding tank waste illegally, you may be creating health and environmental hazards. These chemicals and their by-products may pass through onsite wastewater treatment systems, flowing to soil, ground water, and possibly nearby surface waters. They may also corrode treatment system parts, creating a safety hazard.

How septic systems work. A typical septic system contains two major components: a septic tank and an absorption field, also known as a drainfield or leachfield. These systems use natural processes to treat wastewater onsite, as opposed to offsite at a municipal wastewater treatment plant. The purpose of the septic tank is to separate solids from the liquid waste, and to promote partial breakdown of contaminants by microorganisms (bacteria) naturally present in wastewater. The leachfield also treats the wastewater through physical, biological and chemical processes in the soil.

Mixing chemicals with waste in sewage holding tanks or septic systems may produce toxic fumes, corrode pipelines and tanks, and pollute soil and ground water when discharged.

When chemicals, such as formaldehyde, are added to septic systems, they can cause bacteria in the system to die. When this happens, the septic system cannot treat waste adequately. Solids that are allowed to pass from the septic tank, due to inadequate or incomplete treatment, may clog the leachfield. Furthermore, clogged systems may send inadequately or incompletely treated sewage to the surface, threatening the health of people or pets who come into contact with it. Or it may percolate to ground water, where the chemicals and untreated wastewater could contaminate nearby drinking water wells, rivers and streams. Please **read labels carefully** to identify any hazardous ingredients.



* NATIONAL SMALL FLOWS CLEARINGHOUSE

The restoration of contaminated ground water is extremely costly and can take years. To prevent problems, RV and mobile home parks, as well as dump station operators, may take measures to control hazardous chemical disposal into their waste treatment systems. If they do not, and their system causes contamination, they may be forced to **close the dump station or the park** until the problem can be corrected.

**REPORT SEWAGE SPILLS
and other health hazards to the local
health department.
Keep People and Pets Away!**

PARK OPERATORS:

The United States Department of Health, Education and Welfare said in 1957 that "... there are no known chemicals, yeasts, bacteria, enzymes or other substances capable of



eliminating or reducing the solids and scum in a septic tank" and according to EPA, this is still true. No products have been verified by EPA to eliminate the need for routine maintenance, and some may actually accelerate system failure by allowing solids to clog the dispersal system; while the products may claim to "remove" sludge, they may just "move" sludge. Tanks should be checked routinely (see photo) for solids and scum buildup.

Sludge Removal (pumpouts) may be needed more often for RV, Mobile Home and Boat waste systems than for single-family septic systems, especially if your tanks are undersized and/or your residents are conservative with water. Oversizing your tanks, or adding additional tanks, may allow greater waste stabilization. Consult a wastewater professional.



**RVers CAN HELP...
Here's How:**

- Minimize your need of holding tank deodorizers by using rest stop facilities when you can.

- If you must use a holding tank deodorizer, read the label carefully. **Biodegradable** (enzyme and citrus-based) products are available. Whichever product you

choose, **follow label directions** and add no more than recommended amounts.

- Some products that claim to be flushable, such as some types of cat litter, may clog hoses and septic tanks; use toilets for waste and toilet paper only.

- Ask questions of your park manager about drinking water and wastewater management. Sanitation costs can be minimal, but not free.

- Educate other RVers. Don't be shy about health.

FREE HOTLINES!

Septic System Care: The National Small Flows Clearinghouse, (800) 624-8301, EST, or www.nslc.wvu.edu
The Safe Drinking Water Act Hotline, US EPA: (800) 426-4791, EST, or www.epa.gov/ogwdw

U.S. EPA, Region 9, WTR-9
Ground Water Office
75 Hawthorne Street
San Francisco, CA 94105-3109
OFFICIAL BUSINESS - PENALTY FOR PRIVATE USE \$300

Attachment D

San Francisco Bay Regional Water Quality Control Board's Recycled Water Spill Reporting Protocol

San Francisco Bay Regional Water Quality Control Board Recycled Water Spill Notification Protocol

A. For any spill or unauthorized release of more than 50,000 gallons of recycled water that discharges to land and overflows outside of the use area, the Site Supervisor or designated agency contact identified in the Recycled Water Program must take the following steps:

1. As soon as emergency response measures are completed, but no later than **24 hours** after the discharge, notify the San Francisco Bay Regional Water Quality Control Board and the Division of Drinking Water via the email addresses listed below.
2. Notify the Regional Water Board Spill Line via telephone or email.
3. Provide written confirmation via email to the Regional Water Board and the Division of Drinking Water within **15 calendar days** from the date of notification that includes the information listed below.

B. For any spills or other releases greater than 1,000 gallons of recycled water that discharges to surface water or may reach surface water (e.g., drainage ditch, storm drain), the Site Supervisor or designated agency contact identified in the Recycled Water Program must take the following steps:

1. As soon as emergency response measures are completed, but no later than **24 hours** after the discharge, notify the Regional Water Board via email and telephone.
2. Notify the Regional Water Board Spill Line via telephone or email. Staff may advise to contact the California Office of Emergency Services.
3. Provide written confirmation via email to the Regional Water Board within **15 calendar days** from the date of notification that includes the information listed below.
4. For spills or other unauthorized releases of chlorine disinfected recycled water greater than **50,000 gallons** that have **not been dechlorinated** and discharge to **surface water**, collect, at a minimum, a water quality sample of the recycled water and analyze for residual chlorine. If accessible and feasible, provide a sampling result taken at the point of discharge to the surface water.

Provide the following information when you notify the agencies:

- a. Date and time the spill began and ended
- b. Location of the spill
- c. If the spill entered a storm drain or surface water. Name of surface water if known
- d. Estimated volume of the spill or flow if the spill is ongoing
- e. Estimated time of repair
- f. Cause of the spill
- g. Agencies involved with the response actions
- h. Corrective actions taken or plans for corrective action
- i. Whether adverse impacts related to the spill were observed such as excessive sedimentation or a fish kill
- j. Photograph(s), coordinates, or a map of the spill location.¹
- k. Recycled water chlorine residual value (if the spill volume is greater than 50,000 gallons to surface water. Refer to section B.4 above for applicable conditions).

A spill reporting form is attached that can be used as a template but is not required. Attach any other relevant information that is not addressed in the form.

Spill Contact Information

San Francisco Bay Regional Water Quality Control Board

Phone: (510) 622-2390

Contact: Melissa Gunter

Email: Melissa.Gunter@waterboards.ca.gov
WDR.monitoring@waterboards.ca.gov

San Francisco Bay Regional Water Quality Control Board Spill Line

Phone: (510) 622-2369

Email: RB2spillreports@waterboards.ca.gov

State Water Resources Control Board Division of Drinking Water

The Division of Drinking Water contact is based on the county in which the spill occurred. Refer to the attached Division of Drinking Water district offices map for contact information. A current version is accessible online at https://www.waterboards.ca.gov/drinking_water/programs/districts/.

California Office of Emergency Services

Phone: (916) 845-8911

¹ If a map is prepared, the spill location can be hand drawn on the map.

San Francisco Bay Regional Water Quality Control Board
Recycled Water Spill Reporting Form

Name:

Phone:

Agency:

Site Name:

Location:

Date:

Contact for Follow-up (Name/Phone):

INFORMATION ON SPILL OR UNAUTHORIZED DISCHARGE

Date/time spill or discharge began:

Date/time spill or discharge ended:

Location of spill or discharge:

Did the recycled water enter or will it enter storm drains or receiving waters (e.g., rivers, creeks, lakes, or ocean); if so identify.

Estimated volume of spill or discharge (gallons):

Estimated time of repair:

If still ongoing, estimate flow rate (gallons/minute):

Agencies/entities involved with repair and/or clean-up:

Cause of the spill or discharge:

Corrective actions taken and when, or plan to correct spill/discharge:

Attachment E

Division of Drinking Water Letters

1. Dual Plumbing Report and Plumbing Design Plans and Specifications Acceptance Letter
2. Dual Plumbing Report and Design Addendum 1 Acceptance Letter
3. Title 22 Engineering Report Comment Letter

State Water Resources Control Board

Division of Drinking Water

December 3, 2018

Mr. Bruce Wolfe
Executive Officer
CRWQCB – San Francisco Region
1515 Clay Street, Suite 1400
Oakland, CA 94612

Dear Mr. Wolfe:

MICROSOFT SILICON VALLEY RECYCLED WATER PROJECT **Microsoft Silicon Valley Recycled Water, System No. 4390012**

This letter is in regards to the Microsoft Silicon Valley (Microsoft) recycled water project (Project). The Project is part of the Microsoft redevelopment of the existing corporate campus at 1065 La Avineda Street in the City of Mountain View. Three of the five existing buildings will be demolished and replaced with five new buildings and a parking structure. The two remaining buildings will be renovated to become a cohesive part of the new buildings. To achieve a net zero water consumption goal, Microsoft proposed to collect onsite wastewater from restroom and food facilities and treat to disinfected tertiary recycled water standards. The recycled water will also blend with rainwater captured from the campus roofs during the wet season. The blended recycled water and rain water will be used onsite to serve flushed fixtures and landscape irrigation. Separate piping systems will be utilized for recycled water and potable water within the Microsoft campus. As such, the Microsoft facility is considered a dual plumbed recycled water facility.

Pursuant to Sections 60314 and 60323, Chapter 3, Title 22 of the California Code of Regulations (CCR), Microsoft submitted the *Microsoft Silicon Valley On-Site Wastewater Treatment System Engineer's Report* and *Dual Plumbing Report (Reports)*, which included plumbing design plans and specifications, to the State Water Resources Control Board – Division of Drinking Water (Division) for review. The Reports were dated July 2017 and subsequently revised, with the latest revision on November 28, 2018. The *Dual Plumbing Report* included a detailed description of the intended use area and the methods to be used by Microsoft to assure that the installation and operation of the dual plumbed system will not result in cross connections between the recycled water piping system and the potable water piping system. The plumbing design plans and specifications included the proposed piping to be used, pipe locations of both recycled water and potable water systems, the type and locations of the outlets and plumbing fixtures at the facility, and the methods and devices to be used to prevent backflow of recycled water into the public water system.

The Division, through a Memorandum of Agreement with the California Regional Water Quality Control Board (CRWQCB), has reviewed the *Dual Plumbing Report* and plumbing design plans

FELICIA MARCUS, CHAIR | EILEEN SOBECK, EXECUTIVE DIRECTOR

and specifications and offer the following comments and recommendations to the CRWQCB regarding the Project. The review and recommendations for the *Engineer's Report*, as pertained to the design, operation, maintenance and management of the recycled water treatment system, will be provided at a later date.

The Division finds the *Dual Plumbing Report* and plumbing design plans and specifications acceptable based on the recycled water regulations set forth in Titles 17 and 22 of the (CCR). We recommend approval of the Dual Plumbing Report and plumbing design plans and specifications based on the following:

- The Project will utilize disinfected tertiary recycled water blended with onsite collected rainwater to supply all flushed fixtures within five office buildings and irrigation systems.
- The primary purpose of the buildings is office use. There will be multiple full kitchens incorporated into the building layout to serve staff and visitors. Title 22, Article 5, Dual Plumbed Recycled Water Systems, Section 60313(c) states:

No recycled water agency shall deliver recycled water for internal use except for fire suppression systems, to any facility that produces or processes food products or beverages. For purposes of this Subsection, cafeterias or snack bars in a facility whose primary function does not involve the production or processing of foods or beverages are not considered facilities that produce or process foods or beverages.


To minimize the potential risk of cross connections between the recycled water pipelines and potable water supply serving the kitchens and to address the prohibition stated in Section 60313(c), all kitchen areas will be solely and independently served by a dedicated cold water service lateral from the City of Mountain View's (City) water main. Therefore, the recycled water use area will exclude the kitchen facilities.

- Any areas where recycled water lines run parallel to the kitchen domestic water supply lines, both pipelines are located on the ceiling and are exposed and visible. The recycled water piping and kitchen domestic water pipelines do not share a common wet wall.
- Adequate signage regarding recycled water will be provided at the entrances to the buildings, within restroom facilities and throughout landscape areas.
- All irrigation will be applied subsurface to prevent any spray, mist or runoff of recycled water.
- The City will require inspection of the recycled water piping system for proper labeling and separation and require a three-part shutdown test at start-up of the recycled water system and every four years thereafter. The building's plumbing system will also be visually inspected by a cross connection control specialist on an annual basis.

A detailed cross connection shutdown test procedure will be submitted to the Division and City for review and approval prior to the test. A written report documenting the results of the inspection and/or testing for the prior year must be submitted to the Division within 30 days following completion of the inspection or testing.

If you have any questions regarding this letter, please contact Ms. Van Tsang at (510) 620-3602.

Sincerely,

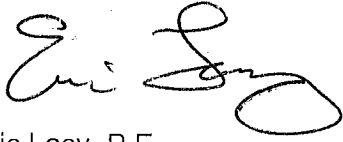A handwritten signature in black ink, appearing to read "Eric Lacy". The signature is fluid and cursive, with the first name "Eric" and last name "Lacy" clearly distinguishable.

Eric Lacy, P.E.

District Engineer
Santa Clara District
Division of Drinking Water
State Water Resources Control Board

cc: Santa Clara County Environmental Health

State Water Resources Control Board
Division of Drinking Water

May 8, 2019

Ms. Margaret Monahan
Senior Water Resources Control Engineer
CRWQCB – San Francisco Region
1515 Clay Street, Suite 1400
Oakland, CA 94612

Dear Ms. Monahan:

MICROSOFT SILICON VALLEY RECYCLED WATER PROJECT
Microsoft Silicon Valley Recycled Water, System No. 4390012

This letter is in regards to the Microsoft Silicon Valley (Microsoft) recycled water project (Project). The Project is part of the Microsoft redevelopment of the existing corporate campus at 1065 La Avineda Street in the City of Mountain View. Three of the five existing buildings will be demolished and replaced with five new buildings and a parking structure. The two remaining buildings will be renovated to become a cohesive part of the new buildings. To achieve a net zero water consumption goal, Microsoft proposed to collect onsite wastewater from restroom and food facilities and treat to disinfected tertiary recycled water standards. The recycled water will also blend with rainwater captured from the campus roofs during the wet season. The blended recycled water and rain water will be used onsite to serve flushed fixtures and landscape irrigation. The State Water Resources Control Board – Division of Drinking Water (Division) reviewed the *Microsoft Silicon Valley On-Site Wastewater Treatment System Engineer's Report and Dual Plumbing Report (Reports)*, which included plumbing design plans and specifications, and issued a recommendation letter to the California Regional Water Quality Control Board (CRWQCB) on December 3, 2018. Microsoft submitted revised plumbing design plans and specifications (Permit Addendum 1) on April 30, 2019 to include approximately 123,000 square feet of new tenant improvement design in Buildings SVC2 and SVC5. The tenant improvements, as it relate to water usage, include three new kitchenettes, one full-service kitchen, one remodeled coffee area and a pair of unisex restrooms.

The Division, through a Memorandum of Agreement with the CRWQCB, has reviewed Permit Addendum 1 and finds the revised plumbing design plans and specifications acceptable based on the recycled water regulations set forth in Titles 17 and 22 of the California Code of Regulations. We recommend approval of Permit Addendum 1 based on the following:

E. JOAQUIN ESQUIVEL, CHAIR | EILEEN SOBECK, EXECUTIVE DIRECTOR

850 Marina Bay Parkway, Bldg. P, 2nd Floor, Richmond, CA 94804-6403 | www.waterboards.ca.gov

- The Project will utilize disinfected tertiary recycled water blended with onsite collected rainwater to supply all flushed fixtures within five office buildings and irrigation systems.
- The primary purpose of the buildings is office use. There will be multiple full service kitchens incorporated into the building layout to serve staff and visitors. Title 22, Article 5, Dual Plumbed Recycled Water Systems, Section 60313(c) states:

No recycled water agency shall deliver recycled water for internal use except for fire suppression systems, to any facility that produces or processes food products or beverages. For purposes of this Subsection, cafeterias or snack bars in a facility whose primary function does not involve the production or processing of foods or beverages are not considered facilities that produce or process foods or beverages.

To minimize the potential risk of cross connections between the recycled water pipelines and potable water supply serving the kitchens and to address the prohibition stated in Section 60313(c), all kitchen areas will be solely and independently served by a dedicated cold water service lateral from the City of Mountain View's (City) water main. Therefore, the recycled water use area will exclude the kitchen facilities.

- Any areas where recycled water lines run parallel to the kitchen domestic water supply lines, both pipelines are located on the ceiling and are exposed and visible. The recycled water piping and kitchen domestic water pipelines do not share a common wet wall.
- Adequate signage regarding recycled water will be provided on piping and appurtenances, and at the entrances to the buildings, within restroom facilities and throughout landscape areas.
- All irrigation will be applied subsurface to prevent any spray, mist or runoff of recycled water.
- The City will inspect the installation of the recycled water piping system for proper labeling and separation and conduct a three-part shutdown test at start-up of the recycled water system and every four years thereafter. The building's plumbing system will also be visually inspected by a cross connection control specialist on an annual basis.

A detailed cross connection shutdown test procedure will be submitted to the Division and City for review and approval prior to the test. A written report documenting the results of the inspection and/or testing for the prior year must be submitted to the Division within 30 days following completion of the inspection or testing.

If you have any questions regarding this letter, please contact Ms. Van Tsang at (510) 620-3602.

Sincerely,

A handwritten signature in black ink, appearing to read "Eric Lacy", with a stylized, flowing script.

Eric Lacy, P.E.
District Engineer
Santa Clara District
Division of Drinking Water
State Water Resources Control Board

Cc: San Clara County Environmental Health Department
City of Mountain View (via email)

State Water Resources Control Board

Division of Drinking Water

August 14, 2019

Ms. Margaret Monahan
Senior Water Resources Control Engineer
CRWQCB – San Francisco Region
1515 Clay Street, Suite 1400
Oakland, CA 94612

Dear Ms. Monahan:

MICROSOFT SILICON VALLEY RECYCLED WATER PROJECT **Microsoft Silicon Valley Recycled Water, System No. 43900012**

This letter is in regards to the Microsoft Silicon Valley (Microsoft) recycled water project (Project). The Project is part of the Microsoft redevelopment of the existing corporate campus at 1065 La Avineda Street in the City of Mountain View. Three of the five existing buildings were demolished and replaced with five new buildings and a parking structure. The two remaining buildings were renovated and became a cohesive part of the new buildings. To achieve a net zero water consumption goal, Microsoft proposed to collect onsite wastewater from restroom and food facilities and treat to disinfected tertiary recycled water (recycled water) standards. The recycled water will also blend with rainwater captured from the campus roofs during the wet season. The blended recycled water and rain water will be used onsite to serve flushed fixtures and for landscape irrigation. The State Water Resources Control Board – Division of Drinking Water (Division), through a Memorandum of Agreement with the California Regional Water Quality Control Board (CRWQCB), reviewed the *Microsoft Silicon Valley On-Site Wastewater Treatment System Engineer's Report*, dated March 2018, and *Dual Plumbing Report (Reports)*, which included plumbing design plans and specifications, and issued recommendation letters to the CRWQCB on December 3, 2018 and May 8, 2019 regarding the plumbing design plans and specifications. This letter provides comments regarding the Reports and the proposed design and treatment of the recycled water system.

Proposed Disinfected Tertiary Recycled Water Treatment System

To treat the wastewater generated from toilet flushing, sinks, showers and food preparation areas on the Microsoft campus to disinfected tertiary recycled water standards, Microsoft proposed to design, construct and operate an onsite treatment system that consists of the following main treatment components:

E. JOAQUIN ESQUIVEL, CHAIR | EILEEN SOBECK, EXECUTIVE DIRECTOR

850 Marina Bay Parkway, Bldg. P, 2nd Floor, Richmond, CA 94804-6403 | www.waterboards.ca.gov

Primary Treatment System – tanks plumbed in series by the order listed below

- Two 10,000 gallon primary treatment tanks
- One 20,000 gallon anoxic/equalization tank
- One 10,000 gallon aeration tank
- One 10,000 gallon clarification tank

Secondary Treatment System

- Recirculating textile packed bed filters (AdvenTex Ax-Max by Orenco Systems Inc.)
- 1,800 square feet of polishing vertical flow wetlands with recirculating tank

Tertiary Treatment System

- Tertiary membrane filtration system - Pentair X-Flow Aquaflex 55 hollow fiber membrane modules

Disinfection

- UV disinfection

The anticipated average annual and maximum day wastewater flows for the Microsoft campus is 18,000 gallons per day (gpd) and 25,000 gpd, respectively. The treatment system was designed to treat an annual average flow of 18,000 gpd and a peak daily flow of 20,000 gpd. Raw wastewater from the Microsoft campus will flow by gravity through an 8-inch pipe into the below grade, precast wet well with duplex submersible pumps (influent pumps) installed within. The wet well measures 6 feet in diameter (internal) by 14 feet deep. The influent pumps will operate in a lead-lag configuration and are installed at the bottom of the wet well. If the treatment system fails or is offline, the pumps fail or are turned off by a signal from the main control panel, and/or the influent flow exceeds the treatment capacity, the wastewater will overflow to the municipal sewer by gravity. The 8-inch overflow pipe is located five feet from the bottom of the wet well.

Equalization for the incoming wastewater and primary solids removal through baffles and settling are provided by the tanks listed above. From the wet well, wastewater is pumped through the two primary tanks plumbed in series. Effluent from the second primary tank flows by gravity into the anoxic/equalization tank. A fraction of the nitrified secondary effluent from the recirculating textile packed bed filters are recirculated back into the anoxic/equalization tank to aid in the denitrification process. Effluent from the anoxic/equalization tank is pumped into a 10,000 gallon aeration tank, followed by the 10,000 clarification/settling tank to reduce total suspended solids (TSS) and biochemical oxygen demand (BOD). If the level within the tanks rise above an operator specified high value, an alarm will be triggered and a signal will be sent to the main control panel to disable the influent pumps. The tanks do not have the capability to discharge directly to sewer. Accumulated solids at the bottom of the tanks are pumped out by a licensed hauler and transported offsite for disposal.

Secondary treatment to remove BOD, TSS and total nitrogen is achieved through an AdvenTex Ax-Max by Orenco Systems Inc. The AdvenTex system consists of four Ax-Max 100 – 14 recirculation modules and four Ax-Max 100 – 14 filtrate modules. Effluent from the packed bed filter system will be pumped to the 3,000 gallon recirculating tank containing the duplex pumps that will dose the 1,800 square foot vegetated recirculating gravel filter (VRGF) system to provide polishing treatment. The recirculating tank will also contain a simplex denitrification recycled pump, which will send fully nitrified effluent from the VRGF back to the anoxic tank for denitrification.

To meet the tertiary filtration requirement, effluent from the VRGF system will be filtered through an ultrafiltration (UF) membrane system that consist of one membrane skid with two Pentair X-Flow Aquaflex 55 hollow fiber membrane modules operated in parallel. The membranes have a pore size of 0.03 microns and can produce up to 20,000 gpd total of permeate. Permeate from the UF system is discharged into the permeate/backwash tank. The membranes are backwashed every 30 minutes for 60 seconds. Spent backwash water is returned to the primary treatment tank. The membranes will also be chemically cleaned every 12 to 24 hours for a duration of 30 minutes. The membrane skid will include pressure transmitters to monitor the transmembrane pressure and also designed to allow the operator to perform a membrane integrity test. Filtered turbidity will be continuously analyzed downstream of the membrane system.

To meet the disinfection requirement, effluent from the filtration system will be pumped through the in-line UV system – Aquionics In-line 400+. The Aquionics In-line 400+ UV disinfection system was conditionally accepted by the Division on October 15, 2008 with revisions to the acceptance conditions noted in a letter dated February 19, 2015. The UV system was designed to treat up to 40 gpm (57,600 gpd). Daily coliform samples will be collected downstream of the UV system to verify compliance with the Title 22 disinfection requirement. Ozone disinfection will also be provided after the UV system. However, disinfection credit or operating conditions will not be established for the ozone system.

Division's Comments and Recommendations

The Pentair X-Flow Aquaflex 55 ultrafiltration membrane system and Aquionics In-line 400+ UV system are technologies that are conditionally approved by the Division for disinfected tertiary recycled water use. However, the Reports, plans and specifications submitted for the Project do not provide sufficient information for the Division to adequately evaluate the operation, monitoring, maintenance and performance of the proposed treatment system for compliance with filtration and disinfection requirements specified in Title 22. An Operations, Maintenance and Monitoring Plan (Plan) should be developed and submitted to the CRWQCB and the Division for review and approval, in writing, prior to distribution and use of recycled water. The Plan should discuss and include the following elements, at a minimum:

1. Identify and describe the operations, maintenance, analytical methods, monitoring and inspection necessary for each unit process.
2. Standard Operating Procedures for membrane cleaning, equipment calibration, compliance monitoring, alarm testing, etc.
3. A Preventative Maintenance and Capital Improvement Program to ensure that all equipment are kept in a reliable operating condition and replaced before they fail.
4. Operating personnel, including the numbers of staff, certification levels and responsibilities to achieve the required level of treatment at all times.
5. Operating records that include all analyses specified in the recycled water criteria; records of operational problems, plant and equipment breakdowns, and diversions to emergency storage or disposal; all corrective or preventive action taken.

Process or equipment failures triggering an alarm must be recorded and maintained as a separate record file. The recorded information must include the time and cause of failure and corrective action taken.

6. Monitoring and alarm systems for each unit process, including specific alarm set points.
7. Monitoring and alarm systems to verify and ensure that excess ozone is destructed and not released into atmosphere.

Secondly, it is recommended that an onsite spot check bioassay be conducted in accordance with the National Water Research Institute (NWRI) guidelines before UV disinfected water can be produced and distributed for recycled water use. The UV spot check bioassay is necessary to verify that the design and construction of the UV system and the dose equation established within the conditional acceptance letters are appropriate to comply with the coliform and virus disinfection criteria found in Title 22 for recycled water. The bioassay test protocol is currently under review by the Division. Operating conditions for the UV disinfection system will be provided after the onsite spot check bioassay has been completed and commissioning test report submitted to the Division for review.

Also, the Contingency Plan included in the Engineering Report should delineate the actions to be taken in the event of a UV lamp breakage (mercury release).

Finally, disinfected tertiary recycled water will be used onsite to serve flushed fixtures and landscape irrigation. Should Microsoft consider other uses of recycled water, such as use within HVAC cooling systems, or expansion of recycled water to additional facilities, an Engineering Report should be submitted to the CRWQCB and Division for review and approval.

If you have any questions regarding this letter, please contact Ms. Van Tsang at (510) 620-3602.

Sincerely,



Eric Lacy, P.E.
District Engineer
Santa Clara District
Division of Drinking Water
State Water Resources Control Board

Cc: Santa Clara County Environmental Health
City of Mountain View (via email)