

Central Coast Regional Water Quality Control Board

March 20, 2024

Sent Via Electronic Mail

Daniel Serns, Chief Executive Officer
Central California Conference of Seventh-day Adventists
Monterey Bay Academy
P.O. Box 770
Clovis, CA 93613
Email: president@cccsda.org

Dear Daniel Serns,

**CENTRAL CALIFORNIA CONFERENCE OF SEVENTH-DAY ADVENTISTS,
MONTEREY BAY ACADEMY, 783 SAN ANDREAS RD., LA SELVA BEACH, CA
95076, SANTA CRUZ COUNTY:**

- **NOTICE OF APPLICABILITY FOR CENTRAL CALIFORNIA CONFERENCE OF SEVENTH-DAY ADVENTISTS MONTEREY BAY ACADEMY'S ENROLLMENT IN *ORDER WQ 2014-0153-DWQ, GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM R3-2024-0013**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER 84-08**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the revised Form 200, Report of Waste Discharge (received on January 12, 2024), and available documents associated with the domestic wastewater treatment system at the Monterey Bay Academy owned by the Central California Conference of Seventh-day Adventists. The wastewater system is currently regulated pursuant to *Order 84-08, Waste Discharge and Water Reclamation Requirements for Central California Conference for Seventh Day Adventists Monterey Bay Academy Domestic Wastewater Facility* (Order 84-08).

On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order 84-08.

This letter serves as a notice of applicability for Central California Conference of Seventh-day Adventists enrollment in the General Permit for the discharge of wastewater from the Monterey Bay Academy.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

Central California Conference of Seventh-day Adventists must comply with the following:

1. **General Permit** – Central California Conference of Seventh-day Adventists must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Central California Conference of Seventh-day Adventists must comply with the requirements of Monitoring and Reporting Program R3-2024-0013, enclosed with this letter (Attachment 3). Central California Conference of Seventh-day Adventists must start implementing the monitoring on **April 1, 2024**. Your first quarterly report is due on **August 1, 2024**.

Monitoring reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Central California Conference of Seventh-day Adventists must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100033543 at:

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Central California Conference of Seventh-day Adventists paid an annual fee on January 8, 2024, for coverage in the existing individual permit, Order 84-08. This payment covers permit fees for the 2023-2024 fiscal year.

Central California Conference of Seventh-day Adventists must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30. Your annual fee is currently \$13,393. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 2B and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on April 18-19, 2024. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Central California Conference of Seventh-day Adventists is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Central California Conference of Seventh-day Adventists to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Central California Conference of Seventh-day Adventists must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the

new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated.

8. Certified Operator – Central California Conference of Seventh-day Adventists is required to comply with the operator certification requirements³ administered by the State Water Board's Office of Operator Certification, which currently requires a Class I operator. Central California Conference of Seventh-day Adventists has hired Central Coast Water Operations, LLC to maintain and operate the treatment system. Central California Conference of Seventh-day Adventists must:

- a. Keep a current Wastewater Treatment Plant Classification Form on file with the Office of Operator Certification and update the form when modifications to the Wastewater System treatment processes occur.
- b. Provide the Office of Operator Certification with a Chief Plant Operator Acknowledgement Form and update this information within 30 days of a change of Chief Plant Operator.
- c. If a contractor operator is used, the contract operator must register with the Office of Operator Certification and obtain a contract operator certificate for the Wastewater System.

Forms are available at the following link:

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/form.html

9. Termination of Permit – The existing individual permit, Order 84-08 is terminated, except for enforcement purposes. Central California Conference of Seventh-day Adventists is responsible for compliance with Order 84-08 prior to the date of this letter.

If you have any questions, please contact **Danial Woldearegay at (805) 549-3892 or by email at [Danial.Woldearegay @Waterboards.ca.gov](mailto:Danial.Woldearegay@Waterboards.ca.gov)**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Ryan E. Lodge
Executive Officer

³ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.
https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific
Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program R3-2024-0013

cc:

Jay Ketelsen, Monterey Bay Academy, jay@montereybayacademy.org

Mason Weidner, centralcoastwateroperations@gmail.com

Dave Nazari, Operator in Training, dnazari@montereybayacademy.org

Heather Reynolds, Heather.Reynolds@santacruzcounty.us

Danial Woldearegay, Danial.Woldearegay@waterboards.ca.gov

Corinne Watson, Corinne.Watson@waterboards.ca.gov

Jesse Woodard, Jesse.Woodard@waterboards.ca.gov

Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-241299

GeoTracker = GT- WDR100033543

Rev 04/13/2023

Subject Name = Monterey Bay Academy WWTP Wastewater Permit

\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\santa cruz co\monterey bay academy\1-
permit\order no. 2014-0153\for review\monterey bay academy noa mrp_jepp.docx

ATTACHMENT 1

**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
REQUIREMENTS AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Central California Conference of Seventh-day Adventists to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Monterey Bay Academy
Facility Address	783 San Andreas Rd. La Selva Beach, CA 95076
Parcel Numbers	046-371-01
Latitude/Longitude	36. 54' 18.99" N/121. 50' 20.96" W
Owner of Facility	Central California Conference of Seventh-day Adventists
Legally Responsible Official of Owner	Daniel R Serns Chief Executive Officer
Owner Mailing Address	P.O. Box 770 Clovis, CA 93613
Facility Billing Address	783 San Andreas Rd. La Selva Beach, CA 95076
Permitted Design Flow, Max Average Monthly (gallons per day, gpd)	Maximum average monthly 49,900
Baseline Flow (average annual flow) in gpd	35,000
Operators	Mason Weidner, Grade II
Waste type and Service Area	Domestic wastewater from standard connections from faculty housing and school campus buildings.
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater

Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

Per the Report of Waste Discharge (filed on July 5, 1983), the oxidation/percolation ponds are located on slightly sloping (5-12 percent) topography consisting of sandy soils to a depth of 55 feet. Depth to groundwater during the dry season is approximately 52 feet, as measured from onsite borings. Groundwater generally flows in a south-west direction.

2. WASTEWATER SYSTEM OPERATION SUMMARY

The treatment system consists of a series of eight unlined oxidation/percolation ponds covering approximately 2.5 acres throughout the Monterey Bay Academy facility. The oxidation/percolation ponds are located on slightly sloped topography consisting of sandy soils. Two primary wastewater transport lines, each serving a separate sector of the campus, convey wastewater to the lift station prior to entering pond #1. Ponds are designed to be self-leveling and the flow from pond #1 to pond #8 occurs in sequential order. In recent years, only pond #1 and pond #2 have actively been utilized, while pond #3 – pond #8 are used to temporarily store effluent when conducting maintenance on pond #1 and pond #2. Daily average flow into the ponds is between 35,000 and 40,000 gallons per day and the system has the capacity to hold 9.5 million gallons of wastewater. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Pond Treatment, Disposal Technologies, and Capacity

Permitted Design Flows	Influent Maximum Daily Flow 70,000 gallons per day Maximum average monthly flow 49,900 gallons per day
Grease Trap	A grease trap is located in the school kitchen and is maintained by staff monthly.
Headworks/Preliminary Treatment	Grinder pumps are used in lift stations to grind wastewater prior to Pond 1.
Treatment/Disposal	Treatment consists of eight, unlined oxidation/percolation ponds in series. The total volume of the eight ponds is approximately 9.5 million gallons. The ponds also percolate wastewater and are the only permitted disposal location.
Biosolids/Sludge Production and Handling	The ponds are periodically drained and cleaned to remove settled solids.

3. WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Central California Conference of Seventh-day Adventists must operate the facility in accordance with the General Permit¹ and this notice of applicability.² Historically, wastewater from the treatment and disposal ponds had been occasionally reclaimed on approximately 35 acres of nearby fodder crops, but is no longer being land applied. Wastewater disposal outside of the ponds shown in Figure 3 is no longer permitted. Central California Conference of Seventh-day Adventists must request approval from the Central Coast Water Board prior to discharging to areas other than the specified series of oxidation/percolation ponds. If the Central California Conference of Seventh-day Adventists wishes to pursue applying recycled water in the future, they must submit a title 22 engineering report to the State Water Resources Control Board's Division of Drinking Water and the Central Coast Water Board for review and approval. Central California Conference of Seventh-day Adventists must operate the pond system to comply with the effluent limits below.

A. Effluent limits

Central California Conference of Seventh-day Adventists must comply with the site-specific limits listed in Table 3.

Table 3. Wastewater Limits for Pond System

Constituent	Unit	Limit	Point of Compliance ¹
Flow	gpd	49,900 (monthly average ²) 70,000 (maximum daily)	Influent (IS-1)
Five-Day Biochemical Oxygen Demand (BOD ₅)	mg/L	90 (daily maximum)	Effluent (ES-1)
Total N	% Influent versus Effluent	50% Removal	Effluent (ES-1)

¹ Refer to monitoring and reporting program for sampling locations

² Average flow is the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month

4. GROUNDWATER LIMITS

¹ General Permit sections B.2, B.3, B.4, B.6, and B.7 are not applicable for this facility.

² General Permit section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Permit, effluent limits in the General Permit, and compliance with site-specific limits set forth in this notice of applicability.

As stated in the General Permit, Section C, the discharge must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Central California Conference of Seventh-day Adventists must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).³ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15.
- 3) The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

The Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time but may require installation of groundwater monitoring wells in the future.

³ Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

ATTACHMENT 2
FIGURES

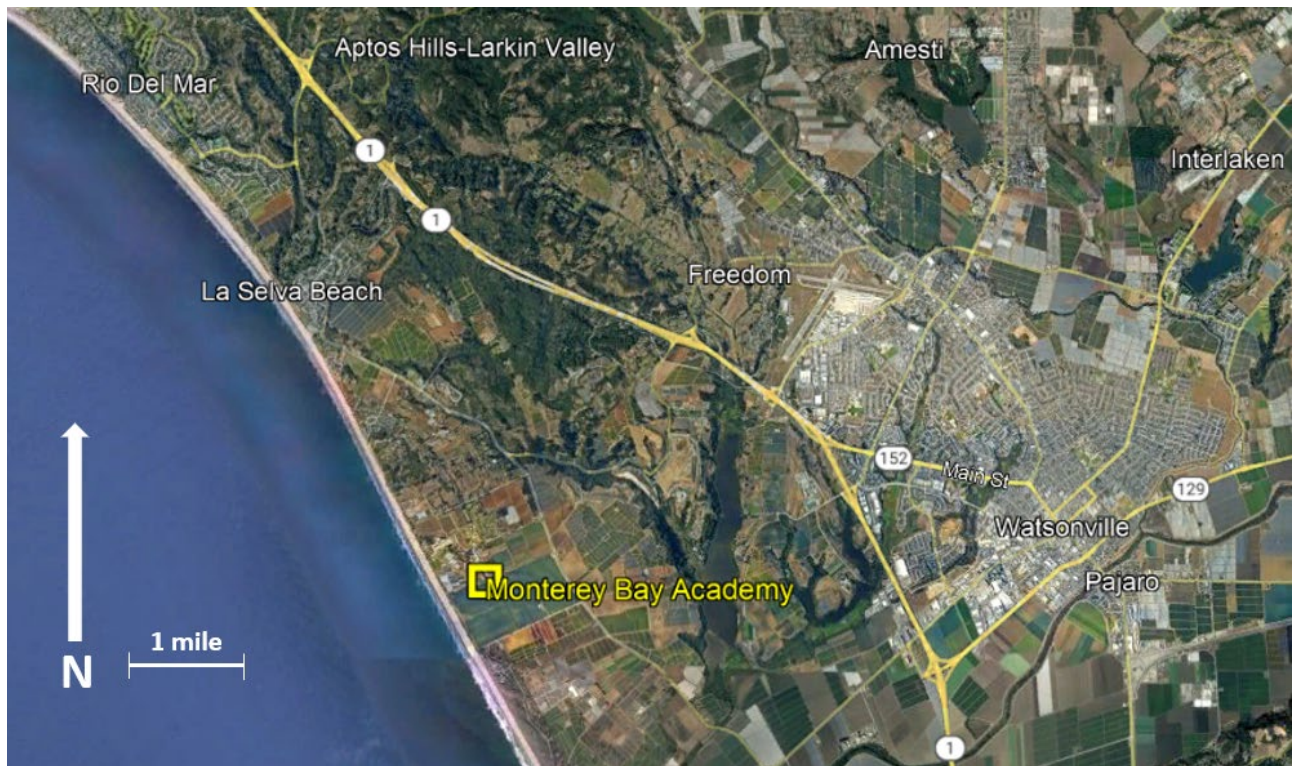


Figure 1. Site Location Map

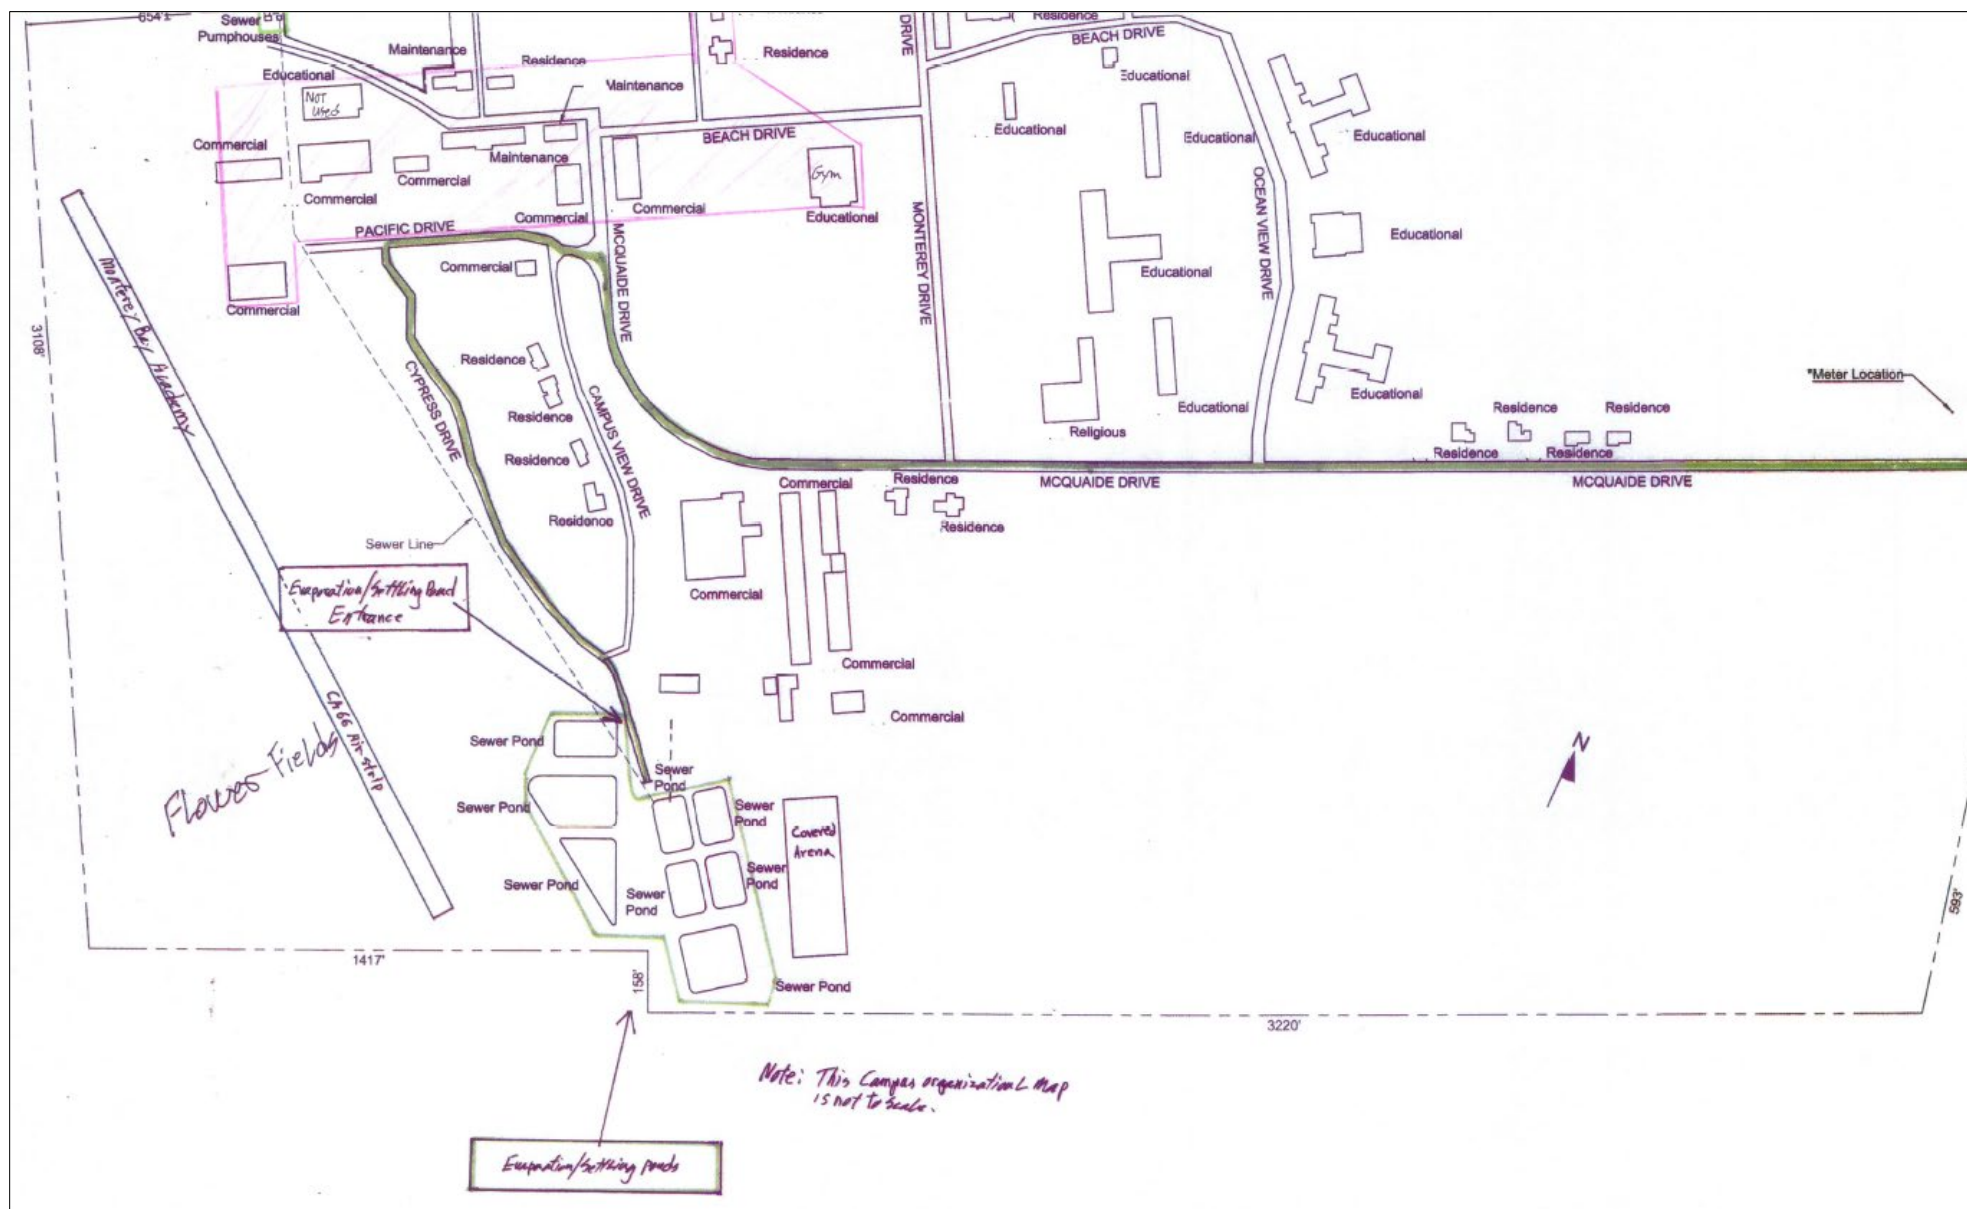


Figure 2. Site Map

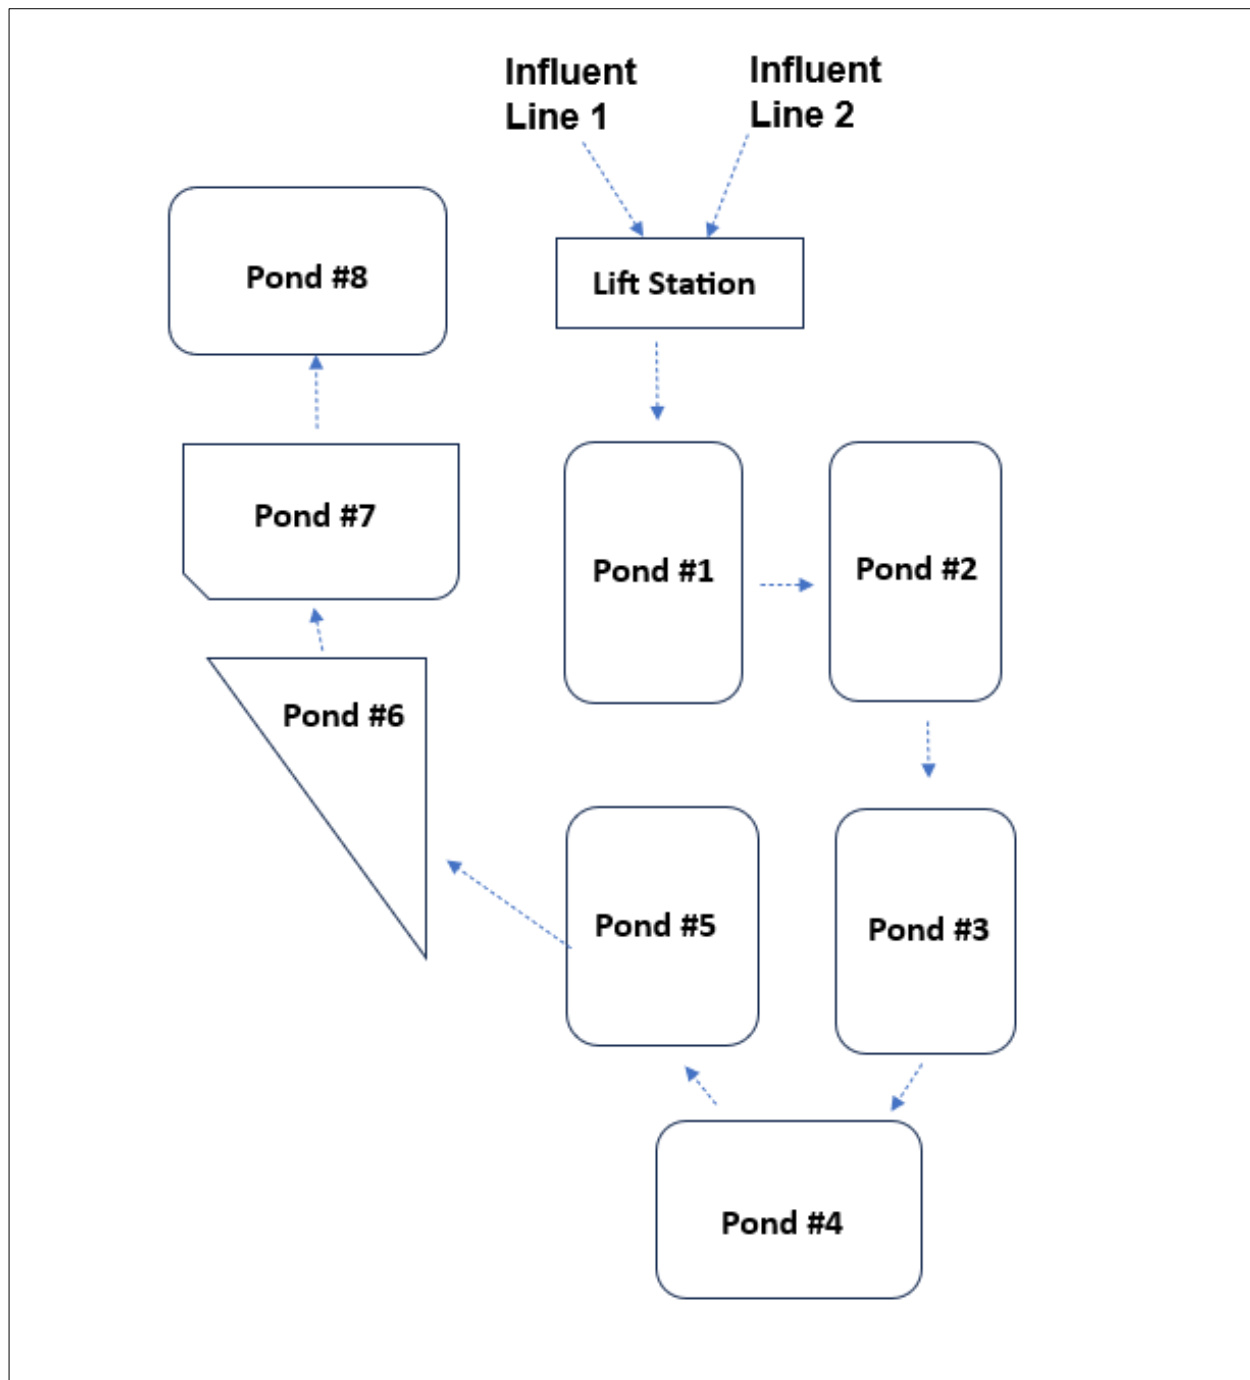


Figure 3. Treatment and Disposal System Process Flow (unlined ponds)

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

MONITORING AND REPORTING PROGRAM R3-2024-0013

MARCH 20, 2024

FOR

**CENTRAL CALIFORNIA CONFERENCE OF SEVENTH-DAY ADVENTISTS
MONTEREY BAY ACADEMY
LA SELVA BEACH, SANTA CRUZ COUNTY**

This monitoring and reporting program describes requirements for monitoring a wastewater treatment system at Monterey Bay Academy owned by Central California Conference of Seventh-day Adventists located at 783 San Andreas Road in La Selva Beach, California.

Central California Conference of Seventh-day Adventists owns and operates the wastewater system that is subject to the notice of applicability dated March 20, 2024, for coverage in *Order WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources

Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

- A. The user is trained in proper use and maintenance of the instruments;
- B. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
- C. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
- D. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Central California Conference of Seventh-day Adventists may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Central California Conference of Seventh-day Adventists must report the results of any constituent monitored more frequently than is required by this monitoring and reporting program. Central California Conference of Seventh-day Adventists must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually
Chloride	mg/L	Grab	Annually	Annually
Sodium	mg/L	Grab	Annually	Annually
Sulfate	mg/L	Grab	Annually	Annually
Boron	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code (Sample ID)	Sample Description
Influent Sample – 1	IS-1	Representative grab sample from inlet prior to Pond 1
Effluent Sample – 1	ES-1	Representative grab sample from Pond 1 at outlet to Pond 2
Water Supply Well Sample	WSW-1 ²	Representative sample from potable well serving Monterey Bay Academy.

²Water supply sample data should be included in the monitoring report but does not need to be uploaded to GeoTracker if the Central Coast Water Board approves submittal of a Well Identification Number pursuant to the Water Supply Monitoring section above.

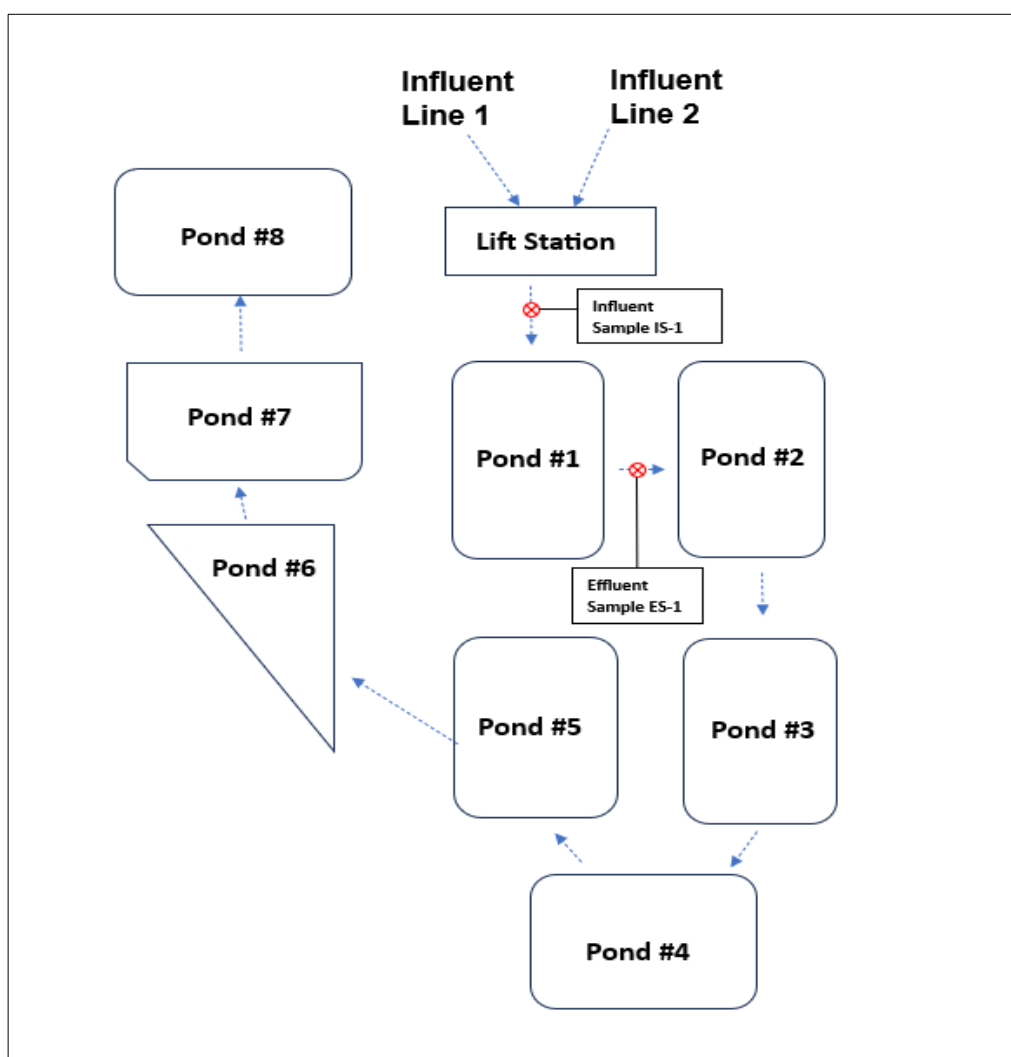


Figure 1. Process Flow Diagram with Sampling Locations

4. POND SYSTEM TREATMENT UNIT MONITORING

A. Flow Monitoring

Central California Conference of Seventh-day Adventists must monitor and report flow, as described in Table 4, with each monitoring report. Flow is monitored at sample location IS-1 prior to Pond 1.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Daily Flow	Gallons per day	Metered	Daily	Quarterly
Maximum Daily Flow	Gallons per day	Metered	Monthly	Quarterly
Mean Daily Flow	Gallons per day	Calculated ^[1]	Monthly	Quarterly

[1] Mean flow is based on the sum of the daily flow that occurs each day in a calendar month, divided by the number of days in the month

B. Influent and Effluent Constituent Monitoring

Representative samples of Monterey Bay Academy's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 5. Influent and Effluent Monitoring

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency	Reporting Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Quarterly	Quarterly	Quarterly
Total Suspended Solids	mg/L	Quarterly	Quarterly	Quarterly
pH	pH units	Not Required	Quarterly	Quarterly
Total Nitrogen	mg/L	Quarterly	Quarterly	Quarterly
Nitrate (as N) + Nitrite (as N) or separate species ¹	mg/L	Quarterly	Quarterly	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Quarterly	Quarterly	Quarterly
Ammonia (as N)	mg/L	Quarterly	Quarterly	Quarterly
Total Dissolved Solids	mg/L	Not Required	Quarterly	Quarterly
Chloride	mg/L	Not Required	Quarterly	Quarterly

Parameter/ Constituent	Units	INFLUENT (IS-1) Sampling Frequency	EFFLUENT (ES-1) Sampling Frequency	Reporting Frequency
Sodium	mg/L	Not Required	Quarterly	Quarterly
Sulfate	mg/L	Not Required	Quarterly	Quarterly
Boron	mg/L	Not Required	Quarterly	Quarterly

mg/L = milligram per liter

[1] Nitrate and nitrite sample may be combined

5. POND MONITORING

All wastewater treatment/ disposal ponds must be monitored as specified in Table 6. Sampling for pH and dissolved oxygen must be a grab sample taken from 1 foot below pond surface.

Observations do not need to be reported in the monitoring reports unless a violation, significant change, or treatment issue is observed. Photos of the pond(s) verifying the observations must be collected annually and included in the annual report, with the date and location of the photo clearly marked. Observations must be noted in a logbook or database and made available to the Central Coast Water Board upon request. Any problems must be promptly corrected and recorded.

Table 6. Wastewater Treatment/Storage/Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency	Reporting Frequency
Freeboard	0.1 feet	Measured	Monthly	Quarterly
pH	pH Units	Grab	Monthly	Quarterly
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly	Quarterly
Sludge Depth	0.1 feet	Measured	Semiannually	Annually
Color	Not applicable	Observation	Monthly	Quarterly
Vegetation in and surrounding ponds	Not Applicable	Observation	Monthly	Quarterly
Berm condition	Not Applicable	Observation	Monthly	Quarterly
Precipitation	inches/day and date	Measured ¹	Each precipitation event ²	Quarterly

¹Central California Conference of Seventh-day Adventists Monterey Bay Academy may use a rain gauge or use a National Oceanic and Atmospheric Administration, United States Geological Survey, or California Irrigation Management Information System weather station, such as <http://scacis.rcc-acis.org/>.

²A precipitation event is one producing precipitation of ½ inch or more.

6. SOLIDS DISPOSAL MONITORING

Central California Conference of Seventh-day Adventists must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

If solids are not removed during the year, Central California Conference of Seventh-day Adventists must explain the absence of this monitoring in the annual monitoring report.

7. COLLECTION SYSTEM MAINTENANCE

Central California Conference of Seventh-day Adventists must submit records of any maintenance performed on the sewer collection system within the past year.

8. REPORTING

The monitoring reports must be submitted in accordance with Table 7.

Table 7. Quarterly Monitoring Reports

Report	Monitoring Period	Report Due Date
First Quarterly Report	January to March	May 1
Second Quarterly Report	April to June	August 1
Third Quarterly Report	July to September	November 1
Fourth Quarterly Report	October to December	February 1
Annual Report	January to December	March 1

A. Quarterly Reports

At a minimum, the quarterly reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.
- **Compliance and Performance Discussion** –
 - Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Permit requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.

- An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen) over time, nuisance conditions, system problems, etc.
 - A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 6.
- **Operator Information** --
 - The name, grade, and license number for the wastewater operator responsible for operation, maintenance, and system monitoring, and all operator personnel.
 - A copy of the current Office of Operator Certification Wastewater Treatment Plant Classification Form.
 - A copy of the current Office of Operator Certification Chief Plant Operator Acknowledgement Form.
 - If a contract operator is used, a copy of the contract operator certificate from the Office of Operator Certification.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

B. Annual Reports

At minimum, the Annual reports must include:

- Tabular and graphical summaries of all monitoring data collected during the year.
- An evaluation of the performance of the wastewater treatment facility, including discussion of capacity issues, nuisance conditions, system problems, and a forecast of the flows anticipated in the next year. A flow rate evaluation as described in the General Permit (Provision E.2.c) shall also be submitted.
- A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into compliance with the notice of applicability and/or General Permit.

9. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permi tting/docs/transmittal_sheet.pdf

Central California Conference of Seventh-day Adventists must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{1,2} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number **WDR100033543** at:

<https://geotracker.waterboards.ca.gov/esi/login>

Table 8 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk: Geotracker@waterboards.ca.gov.

Table 8. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguide2.pdf

² Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Electronic Submittal	Description of Action	Action	Frequency
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports)	Upload boring logs (in searchable PDF format) to GeoTracker whenever a new boring is drilled.	Every time a new boring is drilled.
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Elevation Data (Geo Z)	Mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z File.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

10. TECHNICAL REPORTS

Central California Conference of Seventh-day Adventists must submit to GeoTracker the reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 9. If this information is already contained in an operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 9. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention and Emergency Response Plan	June 20, 2024

Report	Report Due Date
Sampling and Analysis Plan	June 20, 2024
Sludge Management Plan	June 20, 2024
Time Schedule Compliance Plan	March 20, 2025

A. Time Schedule Compliance Plan

The Central California Conference of Seventh-day Adventists must provide a report that evaluates the data collected in the quarterly sampling events in April, July, and October of 2024 and compare it with the effluent limits described in the notice of applicability Table 3 Wastewater Limits for Pond Systems. If effluent is not meeting the effluent limitations, the Central California Conference of Seventh-day Adventists must prepare and submit for Central Coast Water Board review and approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:

- i. Comparison of the current effluent quality to the effluent limits shown in notice of applicability Table 3 Wastewater Limits for Pond Systems.
- ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.
- iii. Justification of the need for additional time to achieve the effluent limitations in notice of applicability Table 3 Wastewater Limits for Pond Systems.
- iv. A detailed time schedule of specific actions Central California Conference of Seventh-day Adventists will take to achieve the effluent limitations.
- v. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).
- vi. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:
 - a. Effluent limitation(s) for the pollutant(s) of concern.
 - b. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).

11. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Central California Conference of Seventh-day Adventists submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Central California Conference of Seventh-day Adventists to enforcement action pursuant to [section 13268 of the California Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Central California Conference of Seventh-day Adventists is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

Central California Conference of Seventh-day Adventists must implement the above monitoring program on **April 1, 2024**. The Central Coast Water Board may rescind or modify the monitoring and reporting program at any time. Central California Conference of Seventh-day Adventists must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Water Board.

Ordered by:

for Ryan E. Lodge
Executive Officer