
Central Coast Regional Water Quality Control Board

May 5, 2022

Sent Via Electronic Mail

Charles Flint
Monterey Dunes Colony Association
Monterey Dunes Colony Mutual Water Association
195 Monterey Dunes Way
Moss Landing, CA 95039
Email: manager.mdca@gmail.com

Dear Charles Flint,

MONTEREY DUNES COLONY MUTUAL WATER ASSOCIATION, 195 MONTEREY DUNES WAY, MOSS LANDING, CA 95039, MONTEREY COUNTY:

- **NOTICE OF APPLICABILITY FOR MONTEREY DUNES COLONY ASSOCIATION'S ENROLLMENT IN ORDER WQ 2014-0153-DWQ, *GENERAL WASTE DISCHARGE REQUIREMENTS FOR SMALL DOMESTIC WASTEWATER TREATMENT SYSTEMS***
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2022-0038**
- **TERMINATION OF INDIVIDUAL PERMIT ORDER NO. 87-175**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the Form 200, Report of Waste Discharge (received on February 25, 2022), and available documents associated with the domestic wastewater treatment system at Monterey Dunes Colony Mutual Water Association owned by the Monterey Dunes Colony Association. The wastewater system is currently regulated pursuant to Order No. 87-0175. On September 23, 2014, the State Water Resources Control Board (State Water Board) adopted *WQ 2014-0153-DWQ, General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit). The Central Coast Water Board reviewed your facility information and determined the updated permit requirements and monitoring and reporting program contained in the General Permit are more appropriate for your facility than Order No. 87-175.

This letter serves as a notice of applicability for Monterey Dunes Colony Association's enrollment in the General Permit for the discharge of wastewater from Monterey Dunes Colony Mutual Water Association.

This letter also includes a wastewater facility operation summary and site-specific requirements and limitations (Attachment 1), figures (Attachment 2), and a monitoring and reporting program (Attachment 3).

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

Monterey Dunes Colony Association must comply with the following:

1. **General Permit** – Monterey Dunes Colony Association must comply with all conditions and requirements of the General Permit and this notice of applicability, including attachments. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2014/wqo2014_0153_dwq.pdf

2. **Monitoring and Reporting Program** – Monterey Dunes Colony Association must comply with the requirements of Monitoring and Reporting Program No. R3-2022-0038, enclosed with this letter (Attachment 3). Your first annual report is due on **August 22, 2022**.

Monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Monterey Dunes Colony Association must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible State Water Board's GeoTracker^{1,2} database with applicable Electronic Submittal of Information (ESI) requirements under the wastewater system-specific global identification number WDR100033656 at:

https://www.waterboards.ca.gov/ust/electronic_submittal/index.html

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements.

3. **Fees** – Monterey Dunes Colony Association paid an annual fee on January 4, 2022 for coverage in the existing individual permit, Order No. 87-175. This payment covers permit fees for the 2021-2022 fiscal year.

Monterey Dunes Colony Association must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board fee program and cover the state fiscal year of July 1 through June 30.

¹ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

² Additional information available at: <http://geotracker.waterboards.ca.gov/>

Your annual fee is currently \$1,663. Fees are charged (and updated) annually and are based on the facility's threat and complexity ratings. Your facility is currently rated with a threat and complexity of 3C and is receiving a 50% fee reduction for domestic discharges less than 50,000 gallons per day.

A copy of the current state fee schedule is available at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of your enrollment at a regularly scheduled public meeting on August 25-26, 2022. Details about that meeting are available on our website at:

http://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to Water Code section 13260, you must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, you must notify the Central Coast Water Board immediately of such changes.
6. **Responsible Party** – Monterey Dunes Colony Association is responsible for the management and disposal of the wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code and subjects Monterey Dunes Colony Association to enforcement action and termination of enrollment under this General Permit.
7. **Change in Ownership** – In the event of any change in control or ownership of the property, Monterey Dunes Colony Association must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board. In addition, the succeeding owner must submit a Form 200 for enrollment in the General Permit. Once both of these things have occurred, the new owner or operator can be enrolled in the General Permit and your enrollment in the General Permit can be terminated. Contact the Central Coast Water Board for a change of ownership form.
8. **Service Agreement** – Monterey Dunes Colony Association submitted an executed service agreement to the Central Coast Water Board with Tom's Septic Construction, a qualified service provider/vendor who will perform required maintenance, sampling, and reporting to the Central Coast Water Board. A service agreement with a qualified service provider must remain in place until the Central Coast Water Board agrees in writing that such an agreement is no longer necessary.

If you have any questions, please contact **Danial Woldearegay at (805) 549-3892 or by email at danial.woldearegay@Waterboards.ca.gov**, or Jennifer Epp at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary and Site-Specific
Requirements and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2022-0038

cc:

Sergio Ochoa, Carmel Lahaina Utility Service, carmellahaina@aol.com

Roger VanHorn, Monterey County, vanhornrw@co.monterey.ca.us

Danial Woldearegay, Danial.Woldearegay@waterboards.ca.gov

Todd Stanley, todd.stanley@waterboards.ca.gov

Jennifer Epp, Jennifer.Epp@Waterboards.ca.gov

WDR Program, RB3-WDR@Waterboards.ca.gov GeoTracker

ECM/CIWQS = CW-241306

GeoTracker No. = GT- WDR100033656

Rev 3/11/22

Subject Name = Monterey Dunes Mutual Water Association Wastewater Permit

R:\RB3\Shared\WDR\WDR Facilities\Monterey Co\Monterey Dunes Colony WWTP,
Castroville\2022\ROWD\For review

ATTACHMENT 1
**WASTEWATER SYSTEM OPERATION SUMMARY AND SITE-SPECIFIC
 REQUIREMENTS AND LIMITATIONS**

OWNERSHIP AND WASTEWATER SYSTEM DESCRIPTION

Ownership and facility information submitted by Monterey Dunes Colony Association to the Central Coast Water Board is shown in Table 1.

Table 1. Owner and Wastewater Facility Information

Facility Name	Monterey Dunes Colony Mutual Water Association
Facility Address	195 Monterey Dunes Way Moss Landing, CA 95039
Parcel Numbers	229-041-001-004
Latitude/Longitude	36.45.58/121.47.54
Onsite Manager	Charles Flint
Owner of Facility	Monterey Dunes Colony Association
Legally Responsible Official	Monterey Dunes Colony Association, Susan Kay Heavin
Owner Mailing Address	195 Monterey Dunes Way Moss Landing, CA 95039
Billing Address	195 Monterey Dunes Way Moss Landing, CA 95039
Permitted Design Flow, Average Monthly (gallons per day, gpd)	17,000
Baseline Flow (average annual flow) in gpd	12,000
Operators	Sergio Ochoa, Plant Operator, Grade 2
Waste type and Service Area	Domestic wastewater from approximately 120 residential units located on the property
Threat to Water Quality	3
Complexity	C
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater

Regulatory measure Type	Enrollee - WDR
Reclamation Included	No

Monterey Dunes Colony Association's wastewater system is located between 0.6 and 1.2 miles north of the mouth of the Salinas River. Depth between leachfields and first-encountered groundwater is approximately ten feet. The discharge area is located on rolling sand dunes consisting of sandy soils to a depth of 14 feet.

WASTEWATER SYSTEM OPERATION SUMMARY

The treatment system consists of nine septic tank-dual leachfields systems located throughout Monterey Dunes Colony. A summary of the system is included in Table 2 below. A facility site map and dispersal system layout are shown in Attachment 2.

Table 2. Permitted Septic Tanks & Disposal Methods

Design Flows	Design Influent Maximum Daily Flow 36,000 gallons per day Design Influent Monthly Average Flow 10,000 gallons per day
Treatment	Solid removal from the septic tank
Disposal	Septic to dual leach field system
Biosolids/Sludge Production and Handling	Sludge is pumped from the concrete septic tanks and hauled off to a biosolids composting facility on a semiannual basis.

WASTEWATER SYSTEM-SPECIFIC REQUIREMENTS AND LIMITATIONS

Monterey Dunes Colony Association must operate the facility in accordance with the General Order and this notice of applicability.³ Monterey Dunes Colony Mutual Water Association must operate the Septic system to comply with the effluent limits below.

A. Effluent limits

Monterey Dunes Colony Association must comply with the site-specific limits listed in Table 3.

³ General Order section B.1.b. states that treatment and disposal of wastewater must demonstrate best practicable treatment or control for wastewater, which shall be demonstrated by compliance with the General Order, effluent limits in the General Order, and compliance with site-specific limits set forth in this notice of applicability.

Table 3. Wastewater Limits Septic system

Constituent	Unit	Limit	Point of Compliance	Sample Location ¹
Maximum Flow	gpd	17,000 (monthly mean) 36,000 (daily flow)	Effluent	ES-1

B. Groundwater Limits

As stated in the General Permit, Section C, the discharge (septic system) must not pollute groundwater or surface waters, adversely affect beneficial uses of groundwater, or cause an exceedance of Basin Plan water quality objectives. Specifically, Monterey Dunes Colony Association must manage the facility to comply with water quality objectives for groundwater found in Section 3.3.4 of the *Water Quality Control Plan for the Central Coastal Basin* (Basin Plan).⁴ These objectives include:

- 1) General objectives for taste and odors and radioactivity for all groundwaters.
- 2) Because the receiving groundwater has a designated use of municipal and domestic supply, objectives for bacteria and organic chemicals, inorganic chemicals, and radionuclides, which are established at the drinking water maximum contaminant levels (MCLs) as defined in California Code of Regulations, title 22, division 4, chapter 15 2.
- 3) The facility does not discharge into a designated groundwater basin, so there are no groundwater basin-specific objectives.

The Central Coast Water Board does not require first-encountered groundwater monitoring wells at this time but may require installation of groundwater monitoring wells in the future.

⁴ Current edition, June 2019 is available at:
https://www.waterboards.ca.gov/centralcoast/publications_forms/publications/basin_plan/docs/2019_basin_plan_r3_complete.pdf

ATTACHMENT 2 **FIGURES**

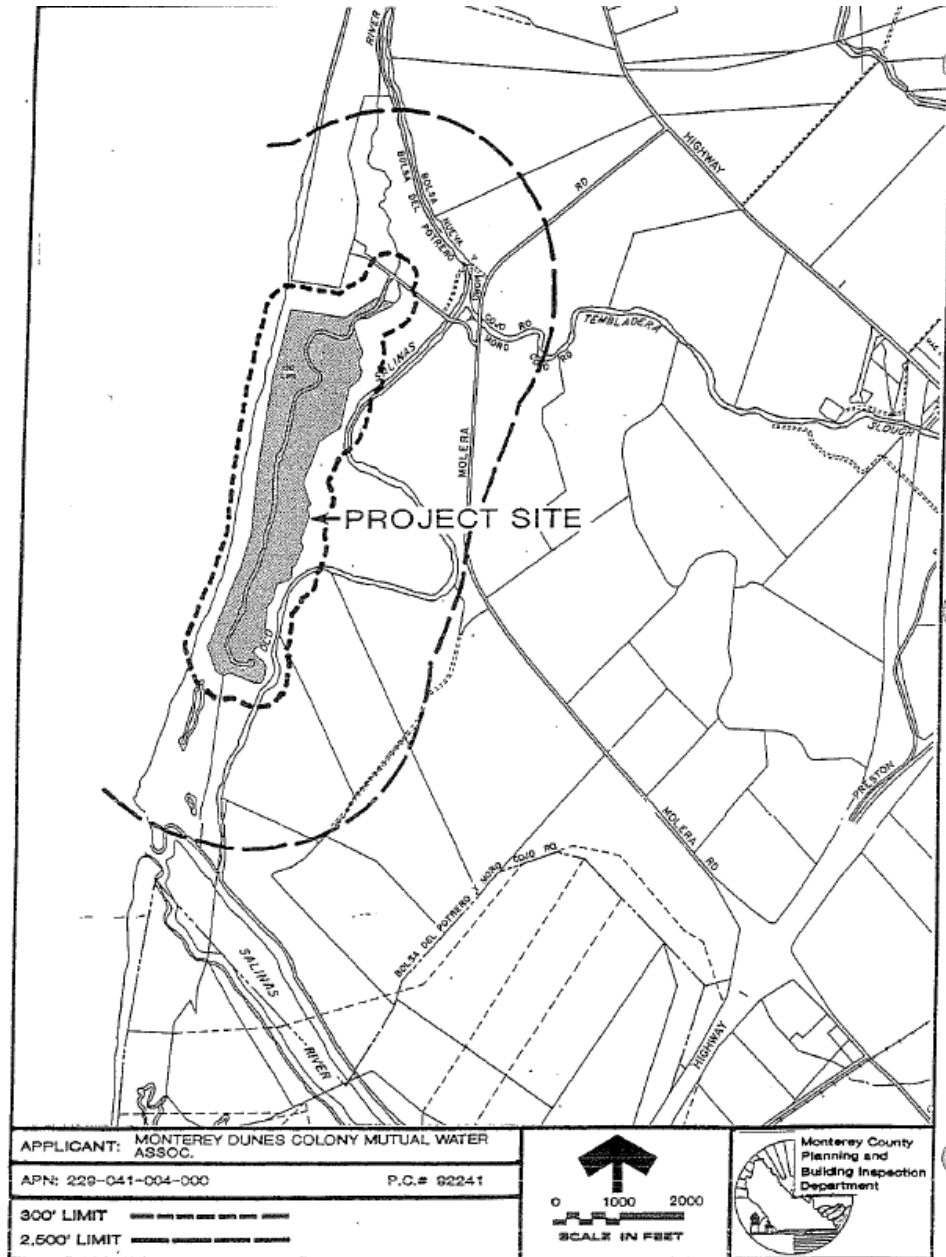


Figure 1. Site Location Map

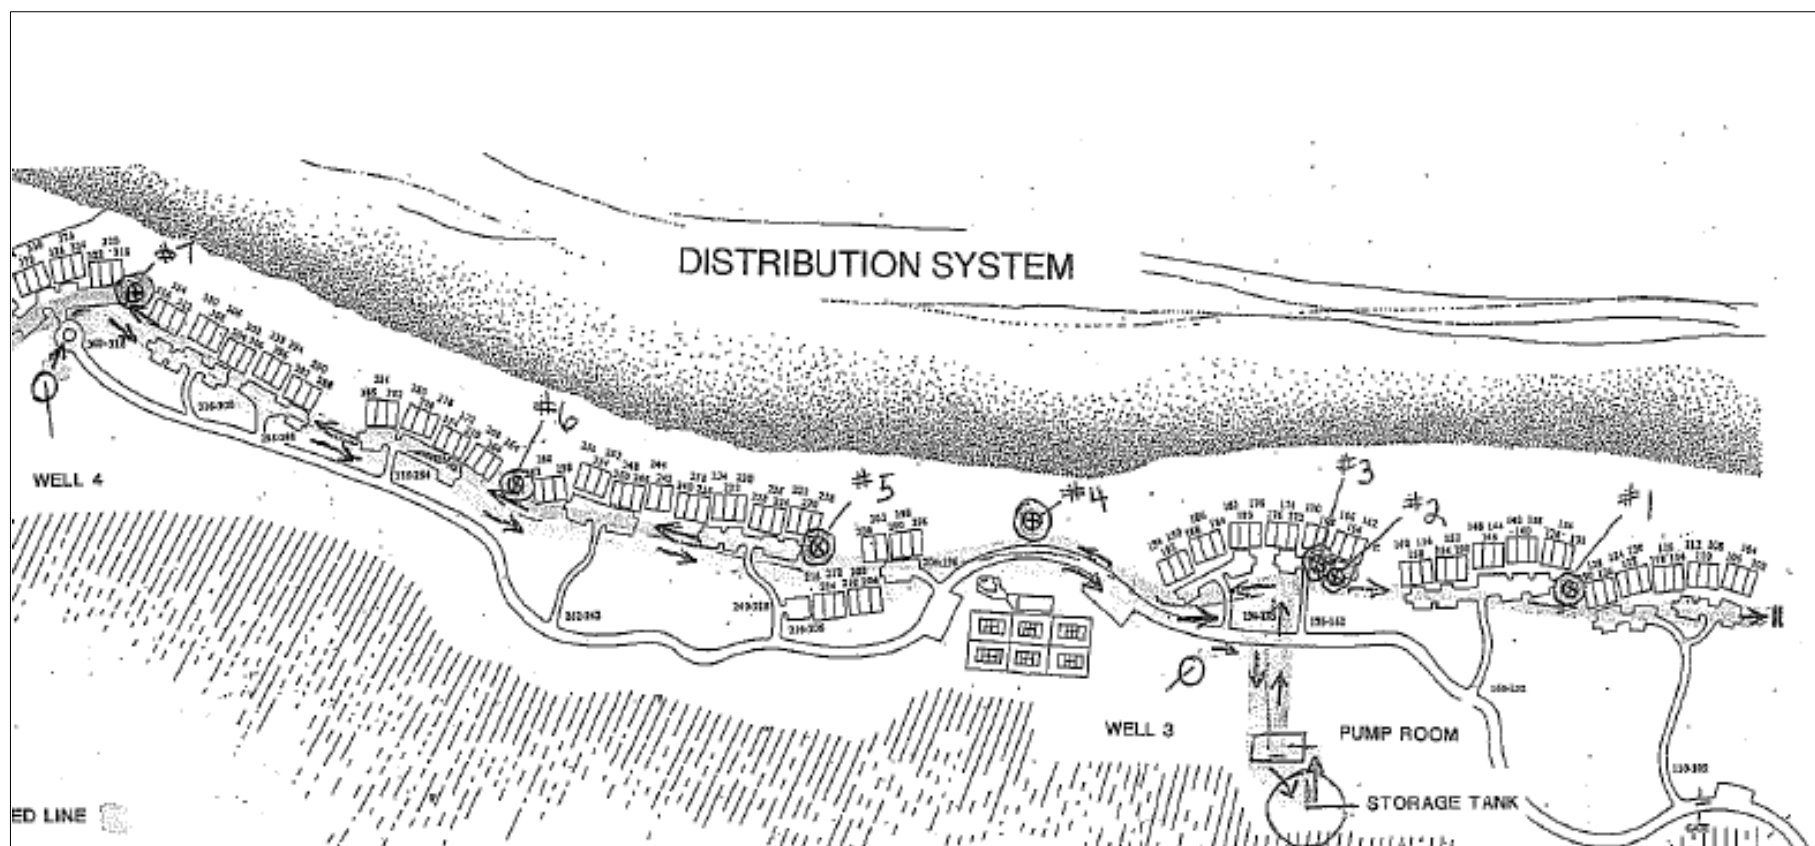


Figure 2. Site Map

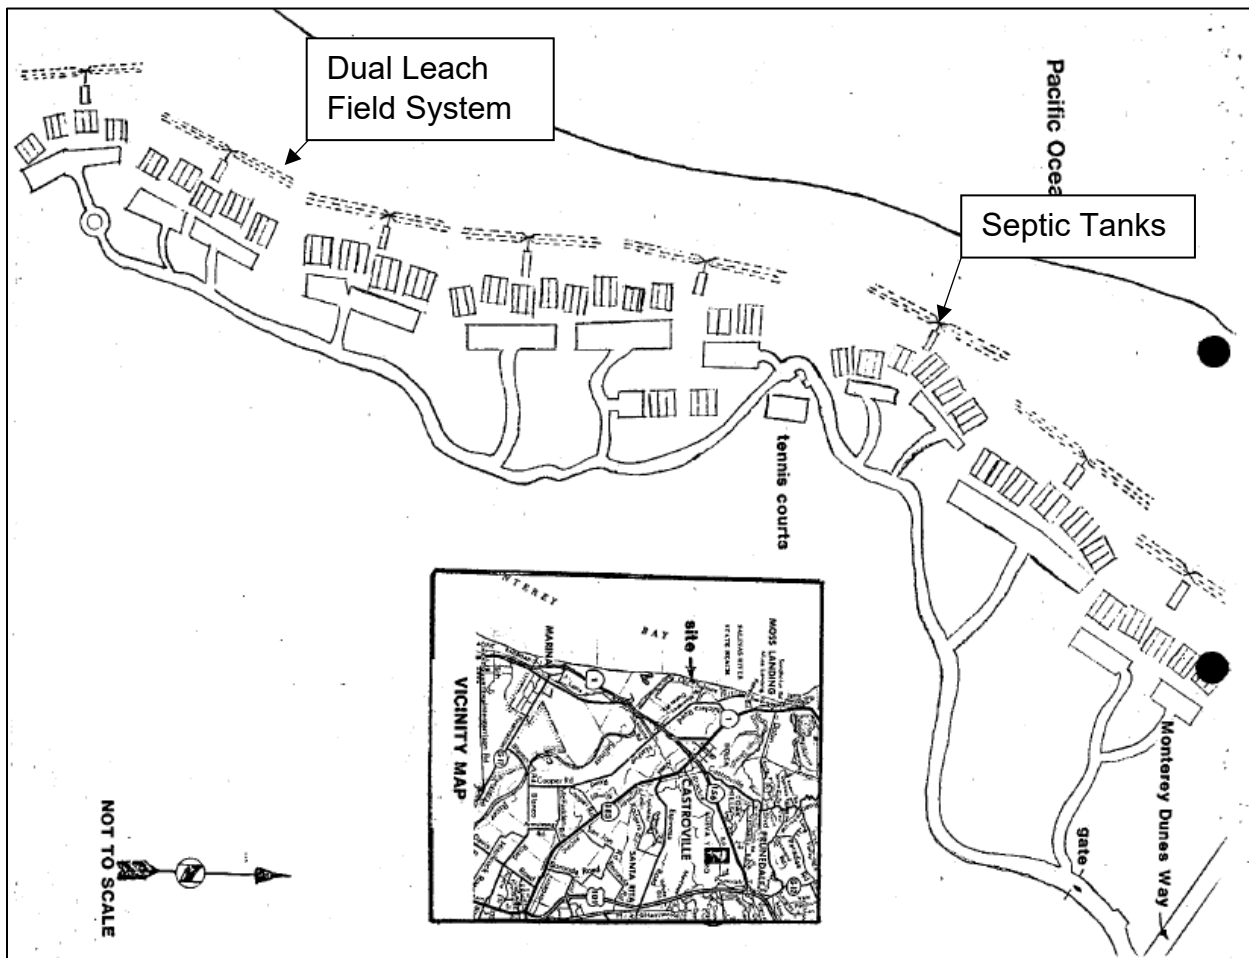


Figure 3. Dispersal System Layout

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL COAST REGION**

MONITORING AND REPORTING PROGRAM NO. R3-2022-0038

for

**MONTEREY DUNES COLONY MUTUAL WATER ASSOCIATION
MONTEREY COUNTY**

This monitoring and reporting program (MRP) describes requirements for monitoring a wastewater treatment system for Monterey Dunes Colony Mutual Water Association doing business as Monterey Dunes Colony Association located at 195 Monterey Dunes Way in Moss Landing, CA 95039.

Monterey Dunes Colony Association owns and operates the wastewater system that is subject to the notice of applicability (NOA) dated May 5, 2022 for coverage in Order WQ 2014-0153-DWQ, *General Waste Discharge Requirements for Small Domestic Wastewater Treatment Systems* (General Permit).

1. SAMPLING AND ANALYSIS

All samples must be representative of the volume and nature of the discharge or matrix of materials sampled. The name of the sampler, sample type (grab or composite), time, date, location, bottle type, and any preservative used for each sample shall be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom the samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) shall be approved by the Central Coast Regional Water Quality Control Board (Central Coast Water Board). Unless otherwise specified below, sampling shall be performed as shown in Table 1.

Table 1. Sampling and Monitoring Schedule

Monitoring Period	Sample Collection Months
Annually	October
Semiannually	April and October
Quarterly	January, April, July, and October
Monthly	Each month of the year

Field test instruments (such as those to test pH, dissolved oxygen, and electrical conductivity) may be used provided that they are used by a State Water Resources Control Board (State Water Board) California Environmental Laboratory Accreditation Program certified laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;

2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

2. WATER SUPPLY MONITORING

Representative samples of the water supply must be collected and analyzed as shown in Table 2 from the production wells prior to any disinfection.

In lieu of the required water supply sampling, Monterey Dunes Colony Association may request approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county. Monterey Dunes Colony Association must report the results of any constituent monitored more frequently than is required by the monitoring program. Monterey Dunes Colony Association must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

Table 2. Water Supply Monitoring

Parameter	Units	Type of Sample	Sampling Frequency	Reporting Frequency
TDS	mg/L	Grab	Annually	Annually
Nitrate and Nitrite (as N)	mg/L	Grab	Annually	Annually

mg/L denotes milligrams per liter

3. MONITORING LOCATIONS

Monitoring location information, including nomenclature that shall be used when reporting data to the GeoTracker database (described below), is shown in Table 3.

Table 3. Monitoring Locations

Sample Title	GeoTracker Field Point Code	Sample Description
Effluent Sample – 1	ES-1	Representative grab sample from after the septic tank's final baffle

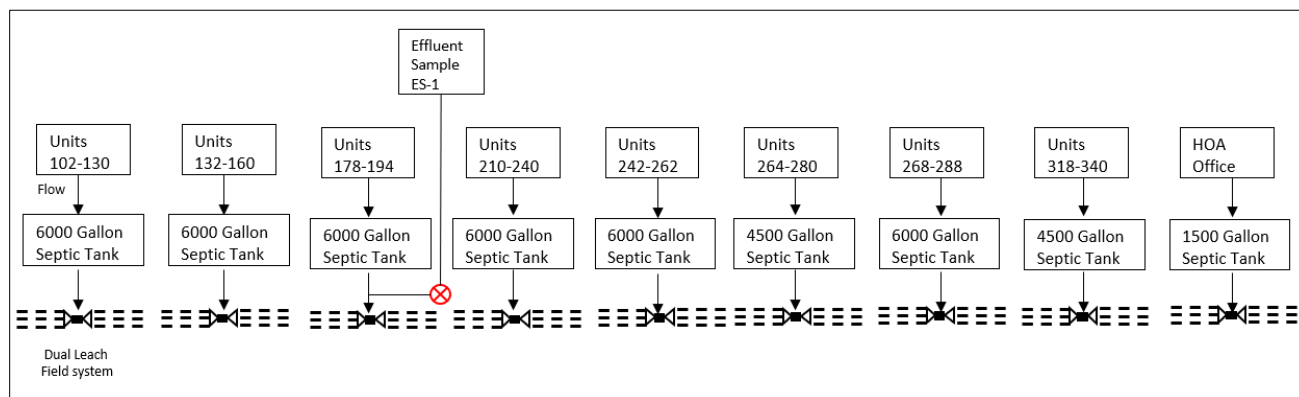


Figure 1. Process Flow Diagram with Sampling Locations

4. SEPTIC SYSTEM TREATMENT UNIT MONITORING

A. Flow Monitoring

Monterey Dunes Colony Association must monitor and report flow, as described in Table 4, with each monitoring report. Flow will continue to be estimated based on potable water supply meter readings.

Table 4. Flow Monitoring

Parameter	Units	Sample Type	Sampling Frequency	Reporting Frequency
Daily Flow	Gallons per day	Calculated	Monthly	Annually

B. Influent and Effluent Constituent Monitoring

Representative samples of Monterey Dunes Colony Mutual Water Association's influent (raw wastewater) into the wastewater system and effluent (treated wastewater) discharged to land must be collected and analyzed as follows. All samples must be grab.

Table 5. Effluent Monitoring

Parameter/ Constituent	Units	EFFLUENT (ES-1) Sampling Frequency	Reporting Frequency
Total Settleable Solids	mg/L	Annually	Annually

mg/L = milligram per liter

C. SEPTIC TANK SLUDGE MONITORING

Septic tanks must be inspected at least as frequently as described in Table 6. Inspections of sludge and scum depth are not required if the tanks are pumped at least annually.

Table 6. Septic Sludge Measurements¹

Parameter	Units	Measurement Type	Inspection/Reporting Frequency
Sludge depth and scum thickness in each compartment of the tank	Feet	Gauge	Annual
Distance between bottom of scum layer and bottom of outlet device	Inches	Gauge	Annual
Distance between top of sludge layer and bottom of outlet device	Inches	Gauge	Annual
Effluent filter condition (if equipped, clean as needed)	NA	NA	Annual

Septic tanks must be pumped when any one of the following conditions exists:

1. The combined thickness of sludge and scum exceeds one-third of the tank depth of the first compartment.
2. The scum layer is within 3 inches of the outlet device.
3. The sludge layer is within 8 inches of the outlet device.

If a septic tank is pumped during the year, the pumping report must be submitted with the February semiannual report. Monterey Dunes Colony Association must maintain a record of all septic tank service activities for a minimum of five years. At a minimum, the record must include the date, nature of service, service company name and license number.

D. SUBSURFACE DISPOSAL AREA INSPECTIONS

Monterey Dunes Colony Association must walk the disposal areas to inspect all items in Table 7 at least weekly and after rain events. All pump controllers and automatic distribution valves must be inspected for proper operation as recommended by the manufacturer. Shallow-rooted plants are generally desirable, deep-rooted plants such as trees must be removed as necessary. Evidence of animals burrowing must be immediately investigated, and burrowing animal populations controlled as necessary. Disposal areas must be inspected to ensure they are allowing wastewater to infiltrate as designed, there is no surfacing, and soils are not saturated.

Table 7. Subsurface Disposal Area Monitoring

Parameter	Inspection Frequency	Reporting Frequency
Pump controllers, automatic valves, etc.	Weekly	Annually
Nuisance Odor Condition	Weekly	Annually
Saturated Soil Condition	Weekly	Annually
Plant Growth	Weekly	Annually
Vectors or Animals Burrowing	Weekly	Annually
Disposal Area Condition	Weekly	Semiannually

A log of these inspections must be maintained onsite in a bound logbook and made available to the Central Coast Water Board upon inspection. Any problems must be promptly corrected and recorded. Monterey Dunes Colony Association must submit a summary of violations found during the inspections with each subsequent monitoring report, or a note that there were no violations.

E. SOLIDS DISPOSAL MONITORING

Monterey Dunes Colony Association must report the handling and disposal of all solids (e.g., screenings, grit, sludge, biosolids, grease, etc.) generated at the wastewater treatment system. Records must include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the wastewater system, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the subsequent monitoring report.

5. REPORTING

The semiannual monitoring reports must be submitted in accordance with Table 8.

Table 8. Semiannual Monitoring Reports

Report	Monitoring Period	Report Due Date
First Semiannual Report	January 1 to June 30	August 1
Second Semiannual Report	July 1 to December 31	February 1

At a minimum, the semiannual reports must include:

- **Facility Information and Description** -- Briefly describe your facility, treatment process, and disposal process with references to figures.
- **Data Tables** -- Tabular summaries of all monitoring data (water supply, influent, effluent, and groundwater) compared to effluent limits, as appropriate. Submit the results of any pollutant or parameter monitored more frequently than is required by this monitoring program.

- **Compliance and Performance Discussion** -- Disclosure of any noncompliance (violations) with of the notice of applicability and/or General Order requirements, including a description, it's cause, the exact date(s) and time(s), and the steps taken or planned to reduce, eliminate and prevent recurrence of the noncompliance.
An evaluation (graphs recommended) of the treatment facilities' performance, including percent removal of the main pollutants (BOD₅, TSS, Total Nitrogen, Total Coliforms) over time, nuisance conditions, system problems, etc.
A discussion of any data gaps and potential deficiencies in the monitoring system or reporting program.
- **Septic Tank Pumping** -- Annually, in the February report, note if the septic tank was pumped or inspected and provide the results as described in Section 5.
- **Disposal Area Inspection** -- Report the results of the disposal area inspections, as described in Section 6.
- **Solids Disposal** -- If solids are disposed of offsite, comply with the reporting in Section 7.
- **Operator Information** -- List the name and contact information for the wastewater operators responsible for operation, maintenance, and/or system monitoring.
- **Flow Evaluation** -- A summary in tabular format of the maximum and average flows for each month and comparison to permitted flows.
- **Figures** -- A wastewater treatment process flow diagram with a label for the monitoring locations and a scaled facility map showing the treatment system, discharge points, and wells (supply and groundwater, if present).
- **Laboratory Sheets** -- Copies of laboratory analytical report(s) and chain of custody form(s).

A. ELECTRONIC SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

Monterey Dunes Colony Mutual Water Association must submit all reports/documents and laboratory analytical data (influent, effluent, groundwater data) to the State Water Board's GeoTracker^{5,6} database consistent with applicable Electronic Submittal of Information (ESI) requirements under a wastewater system-specific global identification number WDR100033656 at:

⁵ Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

⁶ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

http://www.waterboards.ca.gov/ust/electronic_submittal/index.shtml.

Table 9 summarizes the GeoTracker electronic reporting requirements. For general questions, please contact the GeoTracker Help Desk:

Geotracker@waterboards.ca.gov.

Table 9. GeoTracker Electronic Submittal Information (ESI) Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all samples collected when monitoring a discharge.	Upload, or direct your State Certified Laboratory staff to upload, all laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report
Location data (Geo XY)	Name, classify, and identify the location (latitude and longitude) of all sampling points. Influent and effluent sample locations must be identified on the GeoTracker mapping tool under "non-surveyed data."	Upload the location data to the GeoTracker Geo_XY file.	These data points are required prior to laboratory data uploads. Must be added every time a permanent monitoring point is established.
Geo Map	Site layout, map of facilities, wastewater treatment system, and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	One time, or when the facility is modified.

B. TECHNICAL REPORTS

Monterey Dunes Colony Association must submit to GeoTracker the three reports described in General Permit *Section E. 1. Technical Report Preparation Requirements* by the dates included in Table 10. If this information is already contained in an

operation and maintenance manual or similar document, that may be submitted in compliance with this requirement.

Table 10. Technical Report Submittal Due Dates

Report	Report Due Date
Spill Prevention & Emergency Response Plan	90 days from date of General Permit enrollment ¹
Sampling and Analysis Plan	90 days from date of General Permit enrollment ¹
Sludge Management Plan	90 days from date of General Permit enrollment ¹

1. The date of General Permit enrollment is May 5, 2022

6. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that Monterey Dunes Colony submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject Monterey Dunes Colony Association to enforcement action pursuant to [section 13268 of the Water Code](#).

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. Monterey Dunes Colony Association is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained.

Monterey Dunes Colony Association must implement the above monitoring program as of the date of this MRP. The Central Coast Water Board may rescind or modify the MRP at any time. Monterey Dunes Colony Association must not implement any changes to this MRP unless and until a revised MRP is issued by the Central Coast Water Board.

Ordered by:

for Matthew T. Keeling
Executive Office