

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION**

**BOARD ORDER NO. 6-01-36
WDID NO. 6B150111001**

REVISED WASTE DISCHARGE REQUIREMENTS

FOR

**MOJAVE PUBLIC UTILITY DISTRICT
MOJAVE DOMESTIC WASTEWATER TREATMENT PLANT**

Kern County

The California Regional Water Quality Control Board, Lahontan Region, (Regional Board) finds:

1. Discharger

Mr. Bruce Gaines submitted a complete revised Report of Waste Discharge for the Mojave Public Utility District (MPUD), on January 30, 2001, and a submittal evaluation report from Boyle Engineering on February 16, 2001. For the purposes of this Regional Board Order (Order), the MPUD is referred to as the "Discharger."

2. Facility

The Discharger collects, treats, and disposes of approximately 0.36 million gallons per day (mgd) of domestic wastewater from the Community of Mojave. This Facility consists of six oxidation ponds (P1-P6) and one percolation pond (D1). The Facility receives only domestic sewage; no industrial waste is received or handled at this location.

3. Permit History

The Regional Board previously established Waste Discharge Requirements (WDRs) for the Facility under Board Order No. 6-89-79, which was adopted on April 13, 1989.

4. Reason for Action

The Regional Board is revising these WDRs as part of a statewide program to update backlogged WDRs and incorporate changes in the Monitoring and Reporting Program.

5. Facility Location

The treatment and disposal facilities are located in the SW/4, Section 22, T11N, R12W, SBB&M as shown on Attachments "A," "B," and "C," which are made a part of this Order. The Discharger's sewage treatment ponds (MPUD-STP), which are located approximately one mile southeast of Mojave, Assessor's Parcel No. 428-020-05.

6. Description of Facility and Discharge

The Community of Mojave receives effluent from a population of about 4,000 people. Domestic wastewater enters the treatment plant via a flow splitting device and then into one of two parallel oxidation pond systems. The MPUD-STP has six oxidation ponds (P1-P6), one percolation pond (D1) and one emergency percolation storage pond (D2), five to seven acres each in size with two-foot-thick clay liners. The pond sidewalls are concrete lined for bank stabilization. Percolation pond "D2," shown on Attachment "C," is an abandoned borrow pit which was used for obtaining fill material for a road construction project. The depth of the pit may be as much as 30 feet and has been used as an emergency percolation storage during seasons of low evaporation. During the winter season, with low daily evaporation rates, overflow from the oxidation ponds goes to percolation pond, "D1," shown on Attachment "C." There is no summer discharge to "D1."

7. Authorized Disposal Sites

The oxidation and percolation ponds are the only authorized disposal sites. The authorized disposal sites are located on land owned by the Discharger. The land at the Facility is the only authorized disposal site for sludge unless sludge is transported to an authorized off-site location.

8. Site Geology

The disposal site is underlain by silty sand, gravel, and boulders, with clay streaks intermingled. Silty sand is predominant to a depth of 50 feet. The Facility is located approximately 6-miles south of the Garlock Fault (Western Segment) Zone and approximately 30-miles northeast of the San Andreas Fault Zone. No fault movement has been documented in the area during the last 200 years.

9. Site Hydrology

The MPUD-STP is located at the northeastern boundary of the Chafee Sub-Basin of the Antelope Valley Ground Water Basin. Ground water flow is from west to east. The topography slopes in an easterly direction ending in the dry lakebeds of Rosamond and Rogers Lakes. Water levels measured in wells located in the vicinity of the treatment facility indicate that depth to ground water is in excess of 250 feet. Pilot well borings completed in 1989, showed bedrock at 400 feet below ground surface (bgs) and the water table below this depth. Ground water in the vicinity of the disposal site is of excellent quality for most beneficial uses.

The MPUD-STP is located in a semi-arid region area; which receives an average of 5.5 inches of rainfall annually and has a typical evaporation loss of 80 inches per year. A 25-year, 24-hour storm event generates an estimated 3 inches and a 100-year, 24-hour storm generates an estimated 3.6 inches of rain.

10. Receiving Water

Cache Creek, a ephemeral tributary to the Amargosa River, is the receiving water.

11. Compliance History

The Discharger has had twelve minor violations over a 15 year period. All violations have been for late report submittals ranging from 2 to 28 days. One report, 1996, was 28 days late; all other violations are for reports less than 7 days late.

12. Lahontan Basin Plan

The Regional Board adopted the Water Quality Control Plan for the Lahontan Region (Basin Plan) which became effective on March 31, 1995. This Order implements the Basin Plan, as amended.

13. Ground Water Beneficial Uses

The beneficial uses of the ground waters of the Chaffee Hydrologic Area of the Antelope Hydrologic Unit as set forth and defined in the Water Quality Control Plan for the South Lahontan Basin are:

- a. Municipal and Domestic Supply (MUN);
- b. Agricultural Supply (AGR);
- c. Industrial Service Supply (IND); and
- d. Freshwater Replenishment (FRSH).

14. California Environmental Quality Act (CEQA) Compliance

These revised WDRs apply to an existing discharge from an existing Facility and are therefore exempt from the provisions of the CEQA (Public Resources Code Section 21000 et seq.) in accordance with Section 15301 of the CEQA Guidelines.

15. Notification of Interested Parties

The Regional Board has notified the Discharger and interested parties of its intent to revise WDRs.

16. Consideration of Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent/Discharge Limitations

1. The total effluent flow of wastewater to the oxidation ponds during any 30-day period shall not exceed 0.6 million gallons per day.
2. The discharge of wastewater except to the authorized disposal sites is prohibited.
3. The discharge to waters of the State shall not contain substances in concentrations that are toxic to, or produce detrimental physiological responses in humans, plants, animals, or aquatic life.
4. All wastewater made available for percolation shall not contain concentrations in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Maximum</u>
BOD ²	mg/L	45	60
MBAS ³	mg/L	1.0	2.0

5. All wastewater made available to the authorized disposal/recycling sites shall have a pH of not less than 6.0 nor more than 9.0.
6. All wastewater discharged to the authorized disposal/recycling sites shall have a dissolved oxygen concentration not less than 1.0 mg/L.

B. Receiving Water Limitations

This discharge shall not cause a violation of any applicable water quality standard for receiving water adopted by the Regional Board or the State Water Resources Control Board (SWRCB). Discharges from the Facility shall not cause the presence of the following substances or conditions in ground waters of the Chaffee Hydrologic Area of the Antelope Hydrologic Unit.

-
1. The arithmetic mean of lab results of three consecutive effluent samples.
 2. Biochemical Oxygen Demand (5day, 20 °C) of an unfiltered sample
 3. Methylene Blue Active Substances

1. Bacteria, Coliform – In ground water, the median concentration of coliform organisms over any seven-day period shall be less than 1.1/100 milliliters.
2. Chemical Constituents - Ground waters shall not contain concentrations of chemical constituents in excess of the maximum contaminant level (MCL) or secondary maximum contaminant level (SMCL) based on drinking water standards specified in Title 22, California Code of Regulations.

Waters designated as Agricultural Supply shall not contain concentrations of chemical constituents in amounts that adversely affect the water for beneficial uses (i.e., agricultural purposes).

Ground waters shall not contain concentrations of chemical constituents that adversely affect the water for beneficial uses.

3. Radioactivity - Waters shall not contain concentrations of radionuclides in excess of limits specified in Title 22, California Code of Regulations, Chapter 15, Article 5, Section 64443.
4. Taste and Odors - Ground waters shall not contain taste or odor-producing substances in concentrations that cause nuisance or that adversely affect beneficial uses. Ground waters shall not exceed the adopted SMCL specified in Title 22, California Code of Regulations.

C. General Requirements and Prohibitions

1. The discharge of waste in violation of any narrative Water Quality Objectives (WQO) contained in the Basin Plan, including the Nondegradation Objective, is prohibited.
2. The discharge of waste that causes a violation of any numeric WQO contained in the Basin Plan is prohibited.
3. Where any numeric or narrative WQO contained in the Basin Plan is already being violated, the discharge of waste that causes further degradation or pollution, is prohibited.
4. Surface flow or visible discharge of wastewater from the disposal sites to adjacent land areas or surface waters is prohibited.
5. The discharge shall not cause pollution as defined by Section 13050(l) of the California Water Code or a threatened pollution.
6. The discharge shall not cause a nuisance as defined in Section 13050(m) of the California Water Code.

7. Any discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection or oxidation/percolation ponds to adjacent land areas or surface waters is prohibited.
8. Any discharge outside the permitted oxidation/percolation ponds due to overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from storm or flood having a recurrence interval of once in 100 years is prohibited.
9. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than 2.0 feet.

II. PROVISIONS

A. Rescission of WDRs

Board Order No. 6-89-79 is hereby rescinded.

B. Monitoring and Reporting

The Discharger shall comply with Monitoring and Reporting Program No. 01-36 and the General Provisions for Monitoring and Reporting dated September 1, 1994 as specified by the Executive Officer, which is made part of this Order.

C. Standard Provisions

The Discharger shall comply with the "Standard Provisions for WDRs," dated September 1, 1994, in Attachment "D," which is made a part of this Order.

D. Other Provisions


1. Prior to September 1, 2002, the Discharger shall submit to the Regional Board a revised Sampling and Monitoring Plan for including four hexavalent and total chromium sampling events (two at the end of separate dry seasons and two at the end of separate wet seasons) and report the results in the January 2003 and 2004 Annual Report.
2. Prior to September 1, 2002, the Discharger shall submit to the Regional Board a Sludge Assessment Report for Ponds P1-P6 and D1.
3. The Discharger's wastewater treatment plant shall be supervised by persons possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to Section 2465, Title 23, California Code of Regulations.

4. This Order may be reconsidered at any time by the Regional Board to incorporate effluent limitation for nitrogen if a Total Maximum Daily Load (TMDL) is established for a constituent. Additional wastewater treatment and/or disposal processes may be necessary in order to meet a TMDL prescribed effluent limitations for nitrogen.

I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on June 13, 2001.


HAROLD J. SINGER
EXECUTIVE OFFICER


Attachments: A. Site Location Map
B. Service Area Boundary
C. Pond Layout
D. Standard Provisions for WDRs

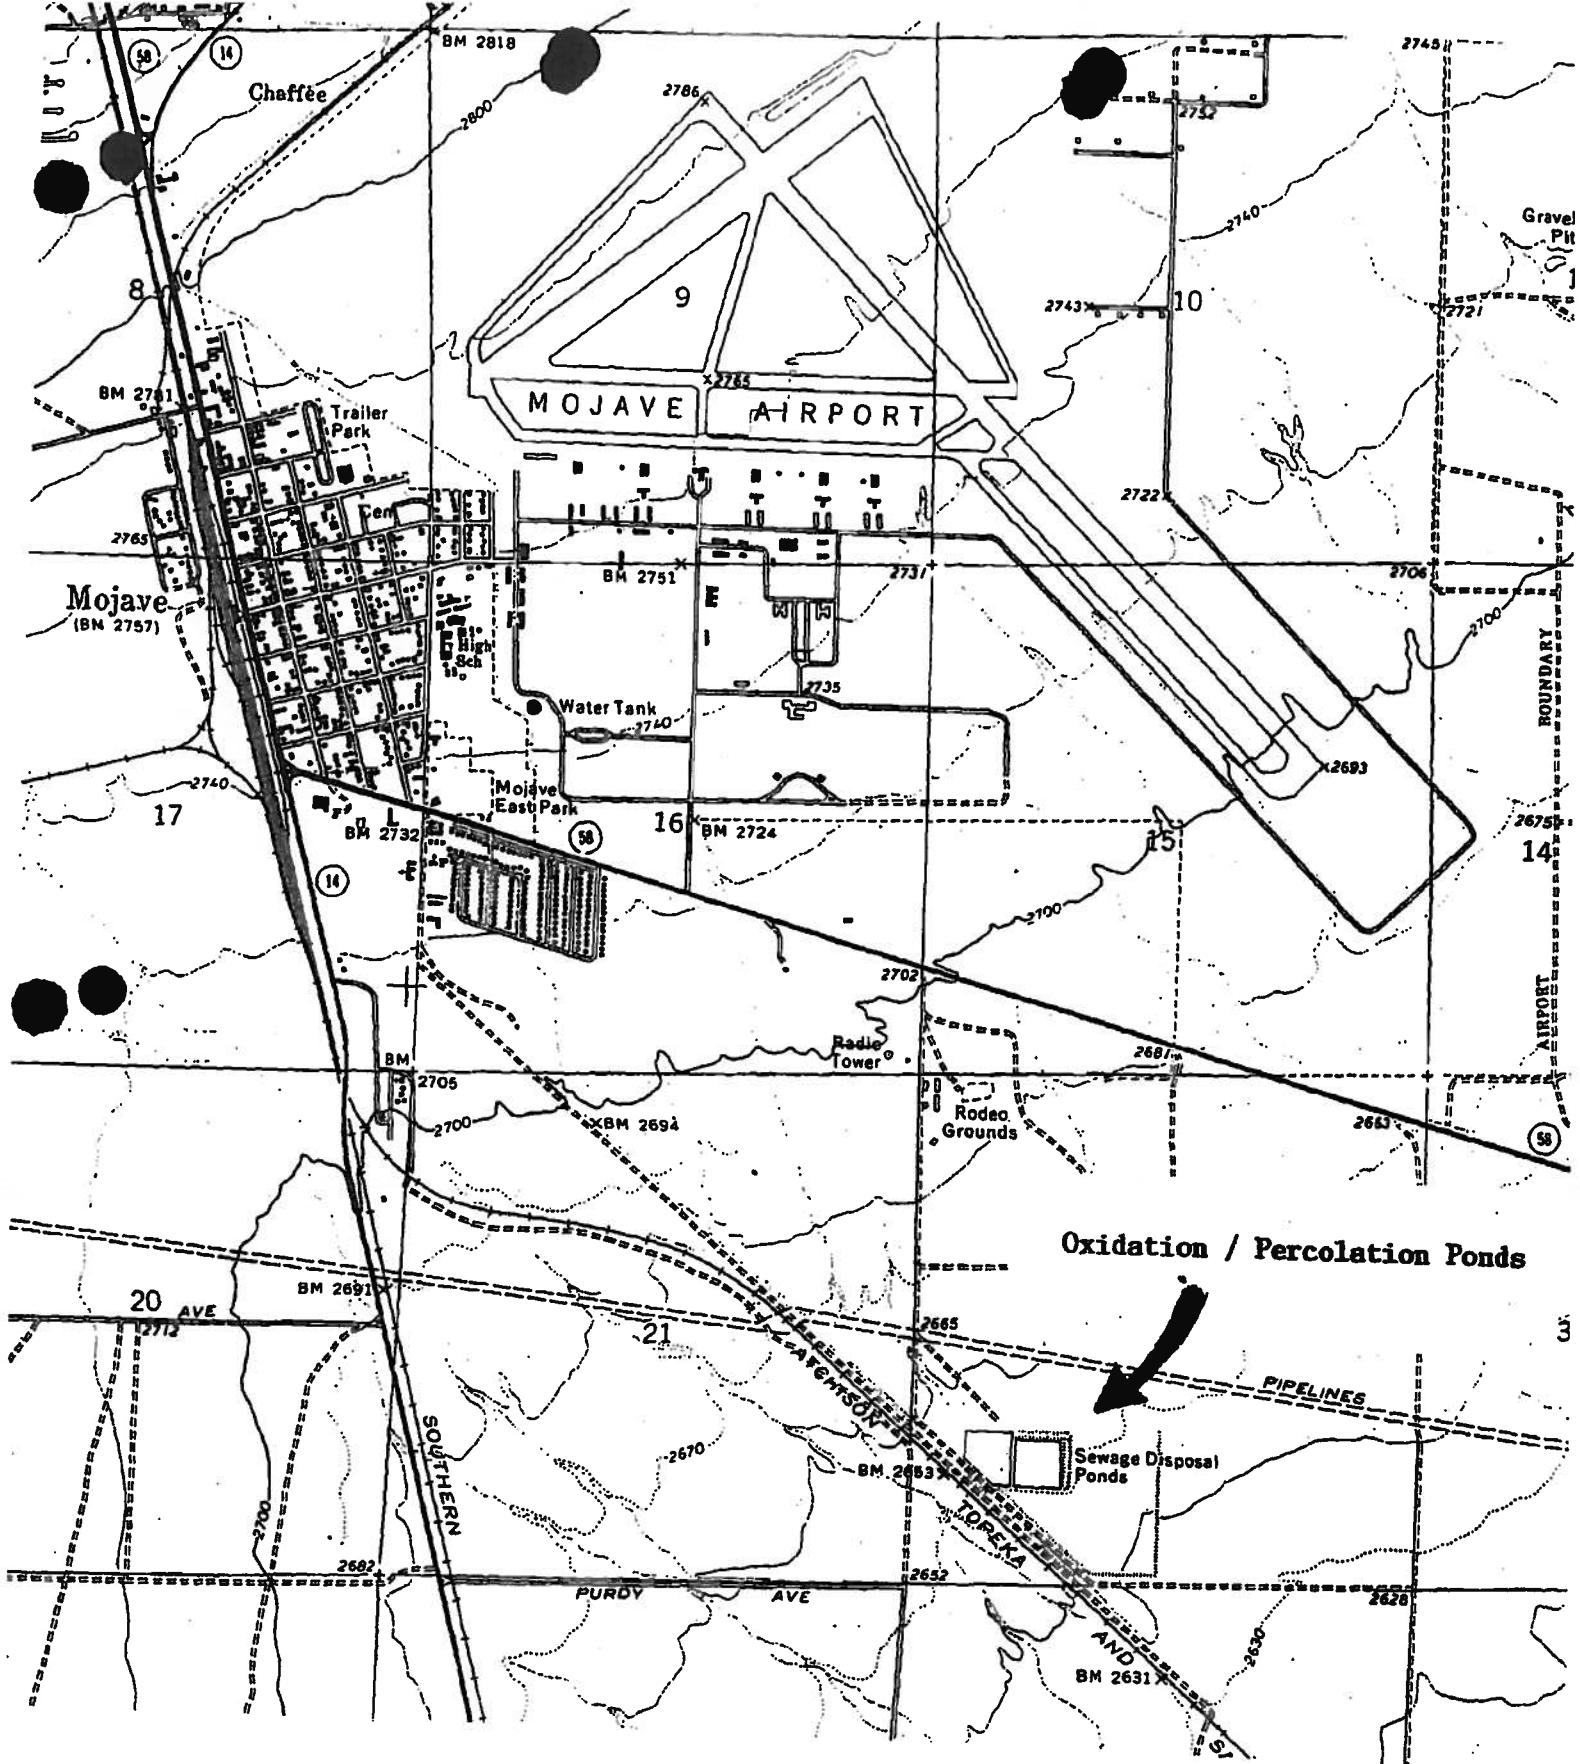

ATTACHMENT "A"


Mojave Public Utilities District
 Wastewater Treatment Facilities
 southeast of Mojave, Kern County

SW 1/4, S22, T11N, R12W, 50B&M
 US GS Mojave 7 5

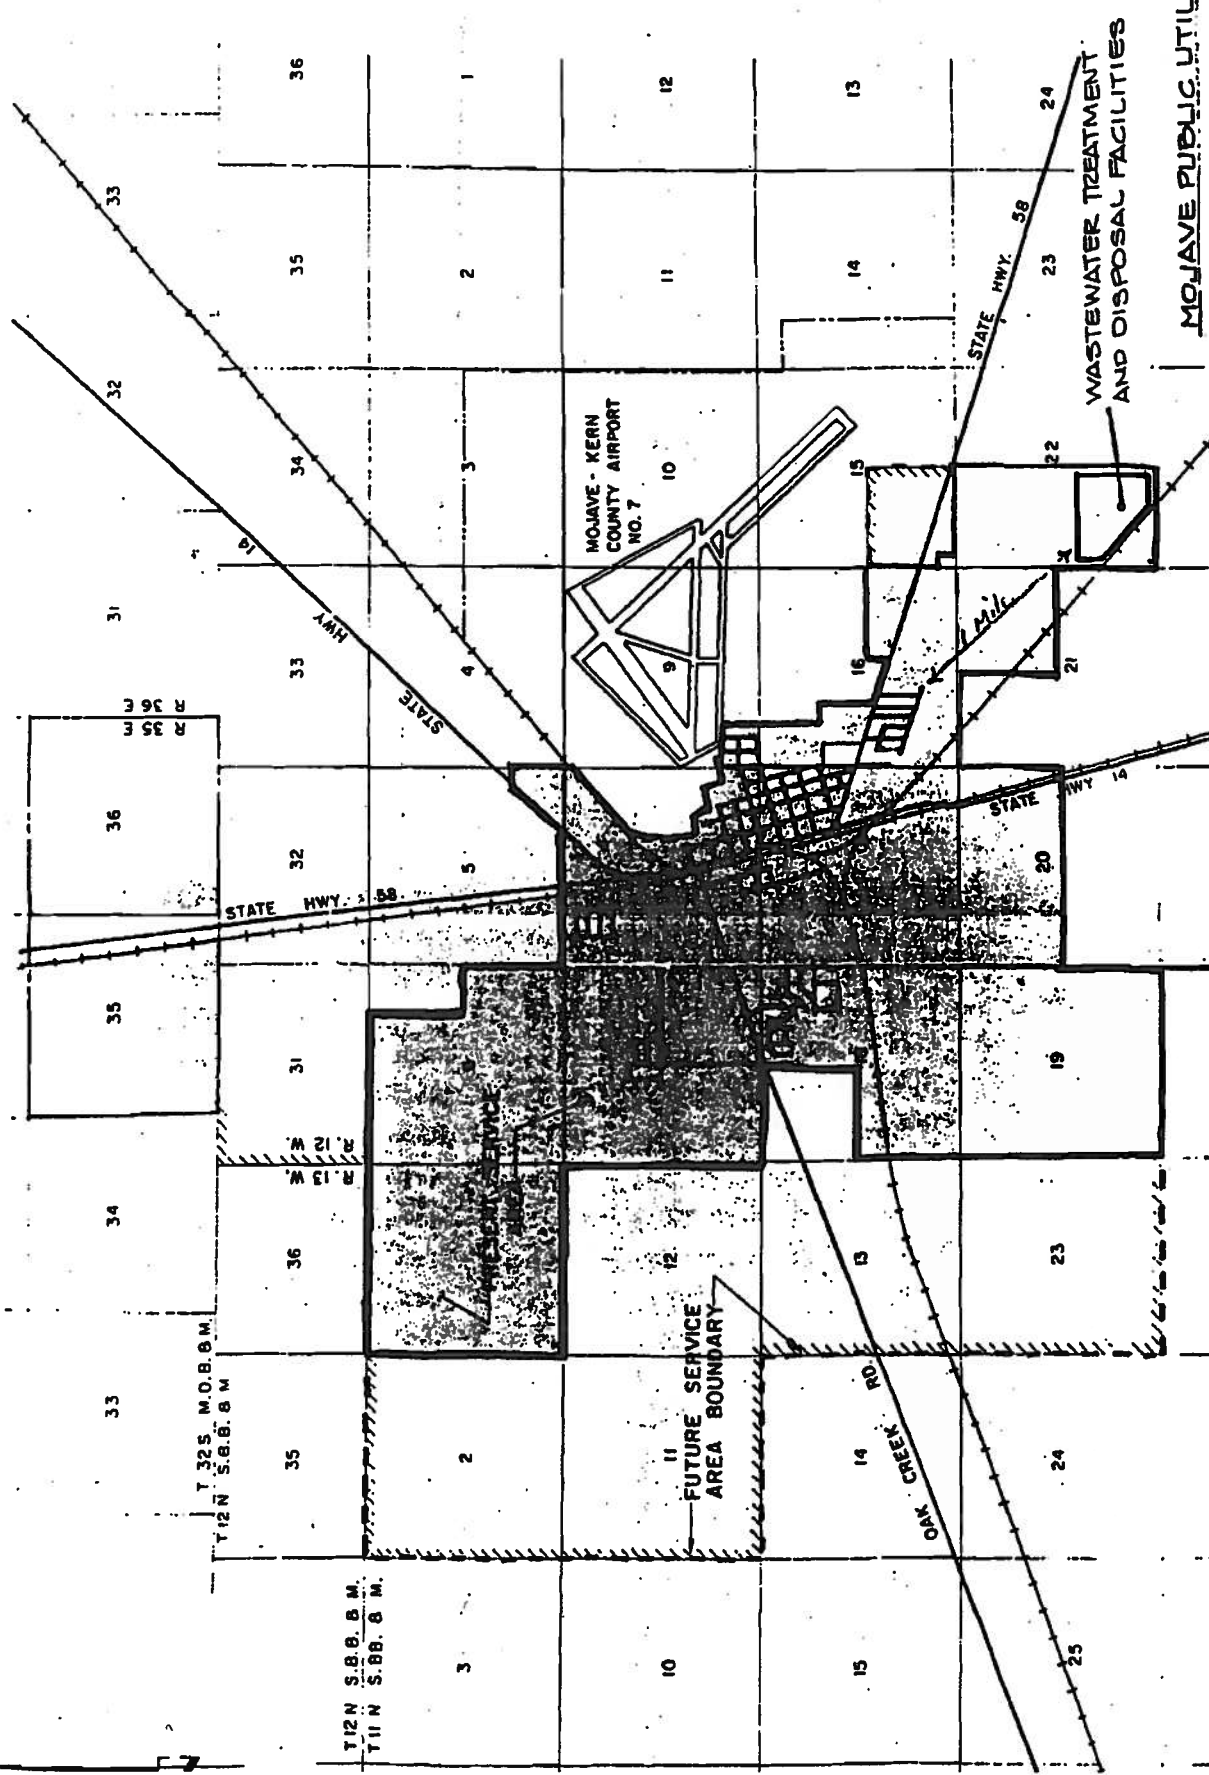

MOJAVE PUBLIC UTILITY DISTRICT
SERVICE AREA BOUNDARY

"ATTACHMENT C"

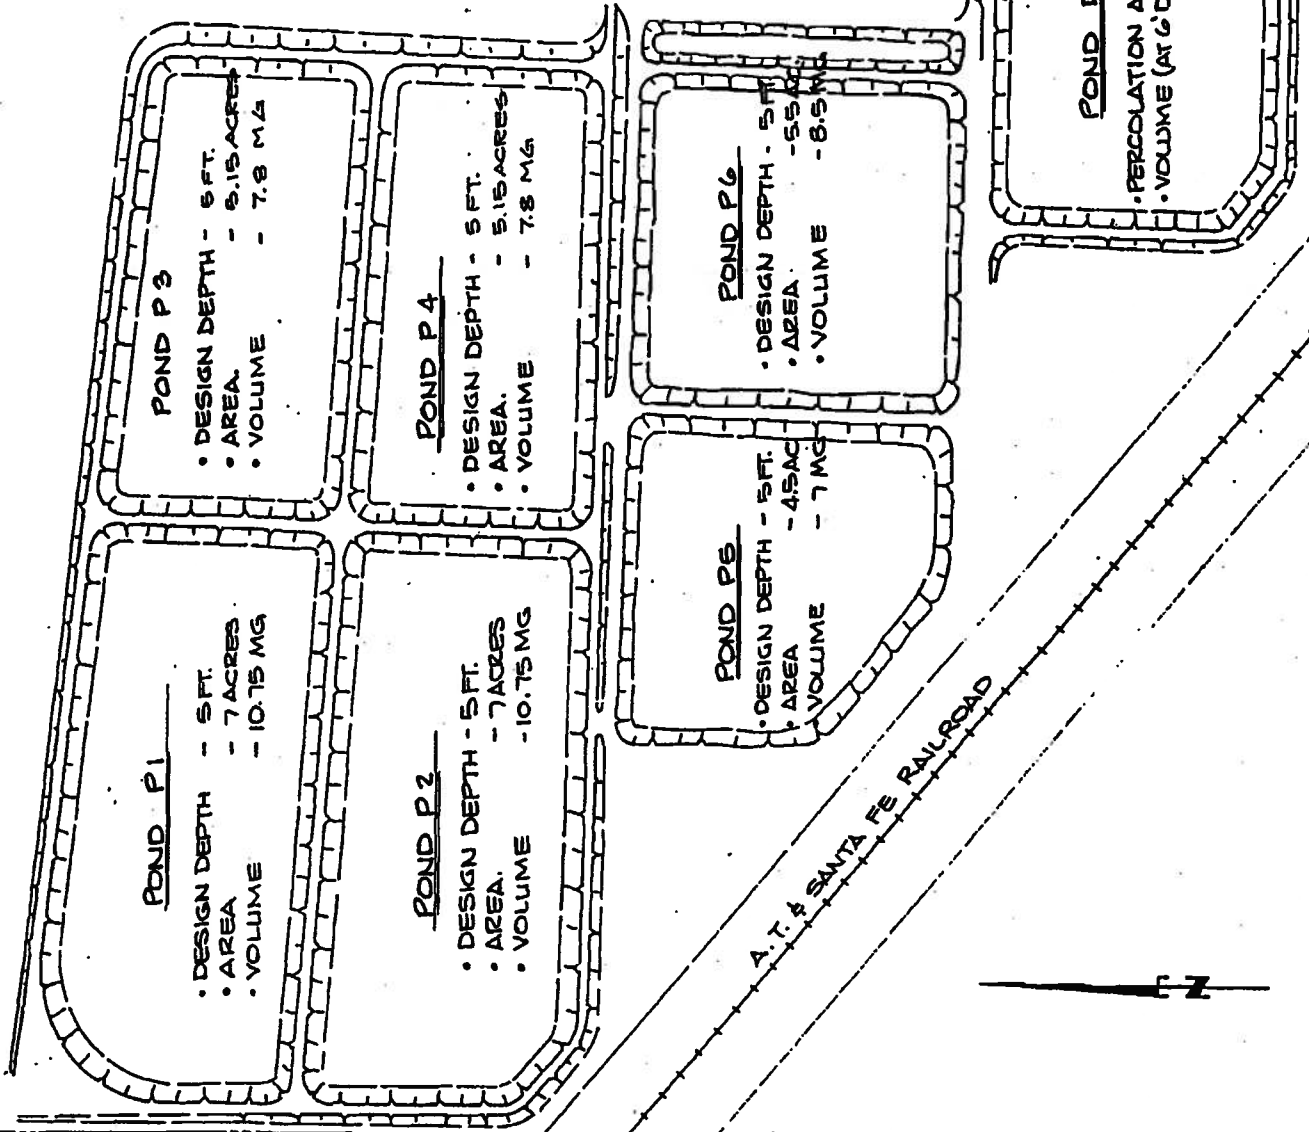

MOJAVE PUBLIC UTILITY DISTRICT

POND LAYOUT

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION**

**REVISED MONITORING AND REPORTING
PROGRAM NO. 01-36
WDID NO. 6B150111001**

FOR

**MOJAVE PUBLIC UTILITY DISTRICT
MOJAVE DOMESTIC WASTEWATER TREATMENT PLANT**

Kern County

I. MONITORING

A. Flow Monitoring

The Discharger shall monitor and report monthly the following:

1. The total volume, in million gallons, of wastewater flow to the oxidation ponds for each day.
2. The total volume in million gallons, of wastewater flow to the oxidation ponds for each month.
3. The average flow rate, in million gallons per day (mgd), of wastewater to the oxidation ponds each month (calculated).
4. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in a pond) measured each month in each pond. If the pond does not contain wastewater, indicate that it is empty.

B. Facility Influent Monitoring

Beginning on or before **June 30, 2001**, influent samples shall be taken and analyzed to determine the magnitude of the following:

<u>Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Frequency</u>
BOD ¹	mg/L	grab	monthly
TKN ²	mg/L as N	grab	monthly
Nitrate Nitrogen	mg/L as N	grab	monthly
Ammonia Nitrogen	mg/L as N	grab	monthly

1 Biochemical Oxygen Demand (5 day, 20° C) of a unfiltered sample.
2 Total Kjeldahl Nitrogen

C. Percolation Pond Monitoring

Beginning on or before June 30, 2001, effluent discharges, when greater than 3" of fluid depth or 400,000 gallons accumulated, to Ponds "D1" or "D2" shall be sampled analyzed to determine the magnitude of the following:

<u>Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Frequency</u>
Dissolved Oxygen	mg/L	grab	monthly
pH	0-14	grab	monthly
BOD ¹	mg/L	grab	monthly
TKN ²	mg/L as N	grab	monthly
Nitrate Nitrogen	mg/L as N	grab	monthly
Ammonia Nitrogen	mg/L as N	grab	monthly
MBAS ³	mg/L	grab	monthly
TDS ⁴	mg/L	grab	monthly
Chloride	mg/L	grab	monthly
Sodium	mg/L	grab	monthly
Sulfate	mg/L	grab	monthly
Total Hardness	mg/L as CaCO ₃	grab	monthly

If there is no discharge to Ponds "D1" or "D2" during the month, enter "no discharge" on the appropriate reports. Sampling is not required when depth of fluid in Ponds D1 and D2, at the center, is less than 3" or less than total accumulated volume of 400,000 gallons in each pond. Enter "below sampling criteria" on the appropriate reports when this conditions occurs for each Pond D1 or D2.

D. Oxidation Pond Monitoring

Beginning April 30, 2002, effluent discharges to oxidation ponds shall be sampled analyzed to determine the magnitude of the following:

<u>Parameter</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Frequency</u>
Hexavalent Chromium	µg/L	grab	annually for 2 wet seasons
Total Chromium	µg/L	grab	annually for 2 wet seasons
Hexavalent Chromium	µg/L	grab	annually for 2 dry seasons
Total Chromium	µg/L	grab	annually for 2 dry seasons

If the first wet and dry season analyses indicates concentrations for hexavalent and total chromium less than 5 µg/L, the second set of sampling will not be required.

3 Methylene Blue Active Substances
4 Total Dissolved Solids

E. Sludge Monitoring

The Discharger shall submit a Sludge Assessment Report on or before **June 1, 2002**. The report shall characterize the amount of sludge in each pond, levels of inorganic anions and drinking water metals contained in the lowest layer, and a forecast of removal actions. The plan should also assess the location and cumulative total quantity of sludge stockpiled on site.

F. Operation and Maintenance

A brief summary of any operational problems and maintenance activities shall be submitted to the Regional Board with each monitoring report.

This summary shall discuss:

1. Any modifications or additions to the wastewater conveyance system, treatment facilities, or disposal facilities.
2. Any major maintenance conducted on the wastewater conveyance system, treatment facilities, or disposal facilities.
3. Any major problems occurring in wastewater conveyance system, treatment facilities, or disposal facilities.
4. The calibration of any wastewater flow measuring devices and an estimate of routine/preventative maintenance that is anticipated.

II. REPORTING

A. General Provisions

1. The Discharger shall comply with Attachment "A" the "General Provisions for Monitoring and Reporting," (GPMR) dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program.
2. Pursuant to General Provisions 1.d of the GPMR, the Discharger shall submit by **September 1, 2001**, a revised Sampling and Analysis Plan (SAP) to the Regional Board for approval. The revised SAP shall define methods for sample collection, monitoring well purging, preservation and analysis shipment protocol, field procedures, laboratory Quality Assurance and Quality Control and data quality for all constituents listed in this Order. Priority pollutants (Attachment B) identified in the SAP should be sampled in accordance with the General Provisions for Monitoring and Reporting Section 1, Sampling and Analysis.

B. Submittal Periods

1. Beginning on July 15, 2001, monthly monitoring reports including the preceding information shall be submitted to the Regional Board by the first day of the second month following each monthly monitoring period.
2. Beginning on January 1, 2002, annual monitoring reports shall be submitted on the first day of the second month after the 12-month period. The annual report shall contain tabular and graphical summaries of all the above information, summary of violations, the compliance status indicating corrective actions taken for each violation, and the names and grades of all the certified operators.
3. Beginning on June 1, 2003, and annually thereafter, the Pond Sludge Assessment Report will be updated with the sludge depth of each pond, inorganic anions and drinking water metal concentrations in the lowest sludge layer, and a forecast for recommended sludge removal over the next 12-month period.

Ordered by:


HAROLD J. SINGER
EXECUTIVE OFFICER

Dated: June 13, 2001

Attachments: A. General Provisions for Monitoring and Reporting
B. Priority Pollutant List

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD

STANDARD PROVISIONS **FOR WASTE DISCHARGE REQUIREMENTS**

Attachment D

1. Inspection and Entry

The Discharger shall permit Regional Board staff:

- a. to enter upon premises in which an effluent source is located or in which any required records are kept;
- b. to copy any records relating to the discharge or relating to compliance with the Waste Discharge Requirements;
- c. to inspect monitoring equipment or records; and
- d. to sample any discharge.

2. Reporting Requirements

- a. Pursuant to California Water Code 13267(b), the Discharger shall immediately notify the Regional Board by telephone whenever an adverse condition occurred as a result of this discharge; written confirmation shall follow within two weeks. An adverse condition includes, but is not limited to, spills of petroleum products or toxic chemicals, or damage to control facilities that could affect compliance.
- b. Pursuant to California Water Code Section 13260(c), any proposed material change in the character of the waste, manner or method of treatment or disposal, increase of discharge, or location of discharge, shall be reported to the Regional Board at least 120 days in advance of implementation of any such proposal. This shall include, but not limited to, all significant soil disturbances.
- c. The Owners/Discharger of property subject to Waste Discharge Requirements shall be considered to have a continuing responsibility for ensuring compliance with applicable Waste Discharge Requirements in the operations or use of the owned property. Pursuant to California Water Code Section 13260(c), any change in the ownership and/or operation of property subject to the Waste Discharge Requirements shall be reported to the Regional Board. Notification of applicable Waste Discharge Requirements shall be furnished in writing to the new owners and/or operators and a copy of such notification shall be sent to the Regional Board.
- d. If a Discharger becomes aware that any information submitted to the Regional Board is incorrect, the Discharger shall immediately notify the Regional Board, in writing and correct that information.
- e. Reports required by the Waste Discharge Requirements, and other information requested by the Regional Board, must be signed by a duly authorized representative of the Discharger. Under Section 13268 of the California Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation.

- f. If the Discharger becomes aware that their Waste Discharge Requirements (or permit) is no longer needed (because the project will not be built or the discharge will cease) the Discharger shall notify the Regional Board in writing and request that their Waste Discharge Requirements (or permit) be rescinded.

3. Right to Revise Waste Discharge Requirements

The Regional Board reserves the privilege of changing all or any portion of the Waste Discharge Requirements upon legal notice to and after opportunity to be heard is given to all concerned parties.

4. Duty to Comply

Failure to comply with the Waste Discharge Requirements may constitute a violation of the California Water Code and is grounds for enforcement action or for permit termination, revocation and reissuance, or modification.

5. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge in violation of the Waste Discharge Requirements which has a reasonable likelihood of adversely affecting human health or the environment.

6. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the Discharger to achieve compliance with the Waste Discharge Requirements. Proper operation and maintenance includes adequate laboratory control, where appropriate, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by the Discharger, when necessary to achieve compliance with the conditions of the Waste Discharge Requirements.

7. Waste Discharge Requirement Actions

The Waste Discharge Requirements may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for waste discharge requirement modification, revocation and reissuance, termination, or a notification of planned changes or anticipated noncompliance, does not stay any of the Waste Discharge Requirements conditions.

8. Property Rights

The Waste Discharge Requirements do not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

9. Enforcement

The California Water Code provides for civil liability and criminal penalties for violations or threatened violations of the Waste Discharge Requirements including imposition of civil liability or referral to the Attorney General.

10. Availability

A copy of the Waste Discharge Requirements shall be kept and maintained by the Discharger and be available at all times to operating personnel.

11. Severability

Provisions of the Waste Discharge Requirements are severable. If any provision of the requirements is found invalid, the remainder of the requirements shall not be affected.

12. Public Access

General public access shall be effectively excluded from disposal/treatment facilities.

13. Transfers

Providing there is no material change in the operation of the facility, this Order may be transferred to a new owner or operator. The owner/operator must request the transfer in writing and receive written approval from the Regional Board's Executive Officer.

14. Definitions

- a. "Surface waters" as used in this Order, include, but are not limited to, live streams, either perennial or ephemeral, which flow in natural or artificial water courses and natural lakes and artificial impoundments of waters. "Surface waters" does not include artificial water courses or impoundments used exclusively for wastewater disposal.
- b. "Ground waters" as used in this Order, include, but are not limited to, all subsurface waters being above atmospheric pressure and the capillary fringe of these waters.

15. Storm Protection

- a. All facilities used for collection, transport, treatment, storage, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

Attachment A

GENERAL PROVISIONS
FOR MONITORING AND REPORTING

1. SAMPLING AND ANALYSIS

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes. EPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Regional Board. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The method used shall also be reported. If methods other than USEPA approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Regional Board prior to use.
- d. The Discharger shall establish chain-of-custody procedures to ensure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall ensure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book described in 2.b, below.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

2. OPERATIONAL REQUIREMENTS

a. Sample Results

Pursuant to California Water Code Section 13267(b), the Discharger shall maintain all sampling and analytical results including: strip charts; date, exact place, and time of sampling; date analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be obtained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.

b. Operational Log

Pursuant to California Water Code Section 13267(b), an operation and maintenance log shall be maintained at the facility. All monitoring and reporting data shall be recorded in a permanent log book.

3. REPORTING

- a. For every item where the requirements are not met, the Discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.
- b. Pursuant to California Water Code Section 13267(b), all sampling shall be made available to the Regional Board upon request. Results shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.
- c. The Discharger shall provide a brief summary of any operational problems and maintenance activities to the Regional Board with each monitoring report. Any modifications or additions to, or any major maintenance conducted on, or any major problems occurring to the wastewater conveyance system; treatment facilities, or disposal facilities shall be included in this summary.
- d. Monitoring reports shall be signed by:
 - i. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
 - ii. In the case of a partnership, by a general partner;

- iii. In the case of a sole proprietorship, by the proprietor;
 - iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
- i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number.
- f. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Under Section 13268 of the Water Code, any person failing or refusing to furnish technical or monitoring reports or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation under Section 13268 of the Water Code.

126 Priority Pollutants

ATTACHMENT B

A. Chlorinated Benzenes

Chlorobenzene
1,2-dichlorobenzene
1,3-dichlorobenzene
1,4-dichlorobenzene
1,2,4-trichlorobenzene
Hexachlorobenzene

B. Chlorinated Ethanes

Chloroethane
1,1-dichloroethane
1,2-dichloroethane
1,1,1-trichloroethane
1,1,2-trichloroethane
1,1,2,2-tetrachloroethane
Hexachloroethane

C. Chlorinated Phenols

2-chlorophenol
2,4-dichlorophenol
2,4,6-trichlorophenol
Parametachlorocresol (4-chloro-3-methyl phenol)

D. Other Chlorinated Organics

Chloroform (trichloromethane)
Carbon tetrachloride (tetrachloromethane)
Bis(2-chloroethoxy)methane
Bis(2-chloroethyl)ether
2-chloroethyl vinyl ether (mixed)
2-chloronaphthalene
3,3-dichlorobenzidine
1,1-dichloroethylene
1,2-trans-dichloroethylene
1,2-dichloropropane
1,2-dichloropropylene (1,3-dichloropropene)
Tetrachloroethylene
Trichloroethylene
Vinyl chloride (chloroethylene)
Hexachlorobutadiene
Hexachlorocyclopentadiene
2,3,7,8-tetrachloro-dibenzo-p-dioxin (TCDD)

E. Haloethers

4-chlorophenyl phenyl ether
2-bromophenyl phenyl ether
Bis(2-chloroisopropyl) ether

F. Halomethanes

Methylene chloride (dichloromethane)
Methyl chloride (chloromethane)

Methyl Bromide (bromomethane)
Bromoform (tribromomethane)
Dichlorobromomethane
Chlorodibromomethane

G. Nitrosamines

N-nitrosodimethylamine
N-nitrosodiphenylamine
N-nitrosodi-n-propylamine

H. Phenols (other than chlorinated)

2-nitrophenol
4-nitrophenol
2,4-dinitrophenol
4,6-dinitro-o-cresol (4,6-dinitro-2-methylphenol)
Pentachlorophenol
Phenol
2,4-dimethylphenol

I. Phthalate Esters

Bis(2-ethylhexyl)phthalate
Butyl benzyl phthalate
Di-N-butyl phthalate
Di-n-octyl phthalate
Diethyl phthalate
Dimethyl phthalate

J. Polynuclear Aromatic Hydrocarbons (PAHs)

Acenaphthene
1,2-benzanthracene (benzo(a) anthracene)
Benzo(a)pyrene (3,4-benzo-pyrene)
3,4-benzofluoranthene (benzo(b) fluoranthene)
11,12-benzofluoranthene (benzo(k) fluoranthene)
Chrysene
Acenaphthalene
Anthracene
1,12-benzoperylene (benzo(ghi) perylene)
Fluorene
Fluoranthene
Phenanthrene
1,2,5,6-bibenzanthracene (dibenzo(ah) anthracene)
Indeno (1,2,3-cd) pyrene (2,3-o-phenylene pyrene)
Pyrene

K. Pesticides and Metabolites

Aldrin
Dieldrin
Chlordane (technical mixture and metabolites)
Alpha-endosulfan
Beta-endosulfan
Endosulfan sulfate
Endrin
Endrin aldehyde
Heptachlor
Heptachlor epoxide (BHC-hexachlorocyclohexane)

Alpha-BHC
Beta-BHC
Gamma-BHC (Lindane)
Delta-BHC
Toxaphene

L. DDT and Metabolites

4,4-DDT
4,4-DDE (p,p-DDX)
4,4-DDD (p,p-TDE)

M. Polychlorinated Biphenyls (PCBs)

PCB-1242 (Arochlor 1242)
PCB-1254 (Arochlor 1254)
PCB-1221 (Arochlor 1221)
PCB-1232 (Arochlor 1232)
PCB-1248 (Arochlor 1248)
PCB-1260 (Arochlor 1260)
PCB-1016 (Arochlor 1016)

N. Other Organics

Acrolein
Acrylonitrile
Benzene
Benzidine
2,4-dinitrotoluene
2,6-dinitrotoluene
1,2-diphenylhydrazine
Ethylbenzene
Isophorone
Naphthalene
Nitrobenzene
Toluene

O. Inorganics

Antimony
Arsenic
Asbestos
Beryllium
Cadmium
Chromium
Copper
Cyanide, total
Lead
Mercury
Nickel
Selenium
Silver
Thallium
Zinc