

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. R6V-2002-0039
WDID NO. 6B149107005

REVISED WASTE DISCHARGE REQUIREMENTS
FOR

BIG PINE TRIBAL UTILITY DISTRICT, BIG PINE INDIAN RESERVATION
WASTEWATER TREATMENT FACILITY

Inyo County

The California Regional Water Quality Control Board, Lahontan Region, finds:

1. Discharger

For the purposes of this Order, the Big Pine Tribal Utility District (BPTUD) and the Big Pine Indian Tribal Council are collectively referred to as the "Discharger."

2. Facility

The BPTUD operates a sewage collection, treatment, and disposal system that discharges treated domestic sewage. For the purposes of this Order, the Big Pine Indian Reservation Wastewater Treatment Facility is referred to as the "Facility."

3. Permit History

New Waste Discharge Requirements (WDRs) were adopted under Board Order 6-91-934 on November 14, 1991, naming the Los Angeles Department of Water and Power (LADWP) as a co-discharger with the Big Pine Tribal Utility District and the Big Pine Indian Tribal Council. The Big Pine Indian Tribal Council purchased the land on which the Facility is located from the LADWP on March 1, 1993. Therefore, the LADWP will no longer be considered a Discharger for this Facility.

4. Reason for Action

The Regional Board is updating waste discharge requirements as part of an ongoing program to periodically review and revise requirements to reflect current regulations and policies. The purpose of this Order is to update the WDRs for the Facility and to change the Discharger designation to reflect the change of ownership of the Facility property.

5. Facility Location

The Facility is located approximately 1/8 of a mile northeast of the Big Pine Indian Reservation in Inyo County in Bishop. The Facility is located within the Big Pine Creek watershed of the Upper Owens Hydrologic Subunit of the Owens Hydrologic Unit, (HU No. 603.00) within a portion of the south half of the NE quarter and a portion of the north half of the SE quarter of Section 17, T9S, R34E, MDB&M, as shown on Attachment "A" which is made a part of this Order.

6. Description of Facility and Discharge

The Facility consists of a domestic sewage collection, treatment, and disposal system serving homes and an industrial park within the Big Pine Indian Reservation. Wastewater is collected and conveyed to the project by a gravity collection and interceptor system. The waste stream consists of domestic wastewater that is generated by residents and by an industrial park on the Reservation. Waste flows from the industrial park are limited to domestic waste only. Any other types of waste flows from the industrial park are prohibited.

The treatment facility consists of two lined, facultative treatment ponds, approximately 2.75 acres in size and 6 feet deep, with 6-inch bentonite liners, operated in series. Treated effluent from the facultative ponds is disposed of in two evaporation/percolation ponds, approximately 0.77 acres in size and 9 feet deep, where the wastewater either evaporates or percolates into the soil beneath the ponds. Ground water monitoring is conducted at three existing monitoring wells adjacent to the ponds.

7. Disposal Area

Effluent from the ponds is disposed of in the two unlined, evaporation/percolation ponds.

8. Sludge Treatment and Disposal

Sludge disposal, when it occurs, shall be to an authorized landfill.

9. Authorized Disposal Site

The evaporation/percolation ponds are the only authorized disposal sites for the effluent from the facultative lagoons.

10. Site Hydrogeology

A soils investigation for the Facility, conducted on June 25, 1991 by the U.S. Department of Health and Human Services, Indian Health Services, found the soil to range from fine to coarse sandy material with some gravel and cobbles at the lower depths of the test holes. Test hole depths ranged from 7 to 10 feet. No ground water was encountered and all the soil samples were very dry with little or no moisture. The soil is highly permeable.

The depth to groundwater in the three Facility monitoring wells tends to range from 15 to 20 feet below the ground surface.

11. Receiving Waters

The receiving waters for the Facility are the ground waters of the Owens Valley Basin (Dept. of Water Resources Basin No. 6-12).

12. Lahontan Basin Plan

The Regional Board adopted a *Water Quality Control Plan For The Lahontan Region* (Basin Plan), which became effective on March 31, 1995. This Order implements the Basin Plan.

13. Beneficial Uses of Ground Water

The beneficial uses of the ground waters of the Owens Valley Basin, as set forth and defined in the Basin Plan are:

- a. municipal and domestic supply;
- b. agricultural supply;
- c. industrial service supply;
- d. freshwater replenishment;
- e. wildlife habitat.

14. California Environmental Quality Act Compliance

These waste discharge requirements regulate waste discharges from an existing facility. The Facility is thus exempt from the provisions of the California Environmental Quality Act (CEQA, Public Resources Code 21000, et seq.) in accordance with Section 15301 of the CEQA Guidelines.

15. Notification of Interested Parties

The Board has notified the Discharger and interested parties of its intent to prescribe revised waste discharge requirements for the discharge.

16. Consideration of Public Comments

The Board in a public meeting heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent Limitations

1. The total flow of wastewater to the treatment and disposal facilities during a 24-hour period shall not exceed 0.061 million gallons.
2. All wastewater discharged to the evaporation/percolation ponds shall not contain concentrations of parameters in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ^{1/}	<u>Maximum</u>
BOD ^{2/}	mg/l	30	45
MBAS ^{3/}	mg/l	1.0	2.0

3. All wastewater discharged to the evaporation/percolation ponds shall have a pH of not less than 6.0 pH units nor more than 9.0 pH units.
4. All wastewater discharged to the evaporation/percolation ponds shall have a dissolved oxygen concentration not less than 1.0 mg/l.

B. Receiving Water Limitations

1. The discharge of waste shall not cause the presence of the following substances or conditions in ground waters of the Owens Hydrologic Unit:
 - a. any perceptible color, odor, taste or foaming;
 - b. coliform organisms attributable to human or animal wastes;
 - c. toxic substances in concentrations that individually, collectively, or cumulatively cause detrimental physiological responses in humans, plants, animals, or aquatic life.

^{1/} The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days.

^{2/} Biochemical Oxygen Demand (5 day, 20°C) of a filtered sample. The sample is to be filtered through a No. 1 Whitman filter or equivalent.

^{3/} Methylene Blue Active Substances.

- d. identifiable chlorinated hydrocarbons, organophosphates, carbamates, and other pesticides and herbicide groups, in summations, in excess of the lowest detectable levels;
- e. concentrations of chemical constituents in excess of the maximum contaminant levels or secondary maximum contaminant levels based upon drinking water standards specified by the more restrictive of the California Code of Regulations, Title 22, Division 4, Chapter 15, or 40 CFR, Part 141; and
- f. nitrate concentration below the disposal site shall not exceed the U.S. Environmental Protection Agency or State Department of Health Services drinking water maximum contaminant level of 10.0 mg/l as nitrogen.

C. General Requirements and Prohibitions

- 1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
- 2. Surface flow or visible discharge of sewage or sewage effluent at/or from the authorized disposal sites to adjacent land areas or surface waters is prohibited.
- 3. All facilities used for collection, transport, treatment, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.
- 4. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than 2.0 feet.
- 5. The discharge shall not cause a pollution as defined in Section 13050 of the California Water Code, or a threatened pollution.
- 6. Neither the treatment nor the discharge shall cause a nuisance as defined in Section 13050 of the California Water Code.
- 7. The discharge of wastewater except to the authorized disposal sites is prohibited.

8. This Order regulates the treatment and disposal of domestic wastewater. The Discharger shall submit a complete report of waste discharge to the Regional Board for the treatment and disposal of any other waste or wastewater other than domestic wastewater.
9. The discharge of industrial or hazardous waste to any pond, or generation of hazardous waste due to evaporation, is prohibited.
10. The treatment facilities and disposal sites shall be well maintained and kept in a proper state of operation.
11. The facultative ponds and evaporation/percolation ponds shall be fenced to effectively exclude the public. Signs shall be posted which warn the public of the presence of wastewater.
12. The integrity of the facultative pond liners shall be maintained throughout the life of the ponds and shall not be diminished as the result of any maintenance or cleaning operation.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Board Order No. 6-91-934 is hereby rescinded.

B. Standard Provisions

The Discharger shall comply with the "Standard Provisions for Waste Discharge Requirements," dated September 1, 1994, which is attached to and made part of this Order.

C. Monitoring and Reporting Requirements

1. Pursuant to California Water Code Section 13267(b), the Discharger shall comply with Monitoring and Reporting Program No. R6V-2002-(PROPOSED) as specified by the Executive Officer.
2. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of the Monitoring and Reporting Program.

BIG PINE TRIBAL UTILITY DIST.
BIG PINE INDIAN RESERVATION WTF
Inyo County

-7-

BOARD ORDER NO. R6V-2002-0039
WDID NO. 6B149107005


I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on June 12, 2002.



HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: A – Location Map
B – Facility Map
C - “Standard Provisions for Waste Discharge Requirements”
D – “General Provisions for Monitoring and Reporting Programs”

JSS/cgT: June02BigPine.WDR2.doc
[6B149107005]

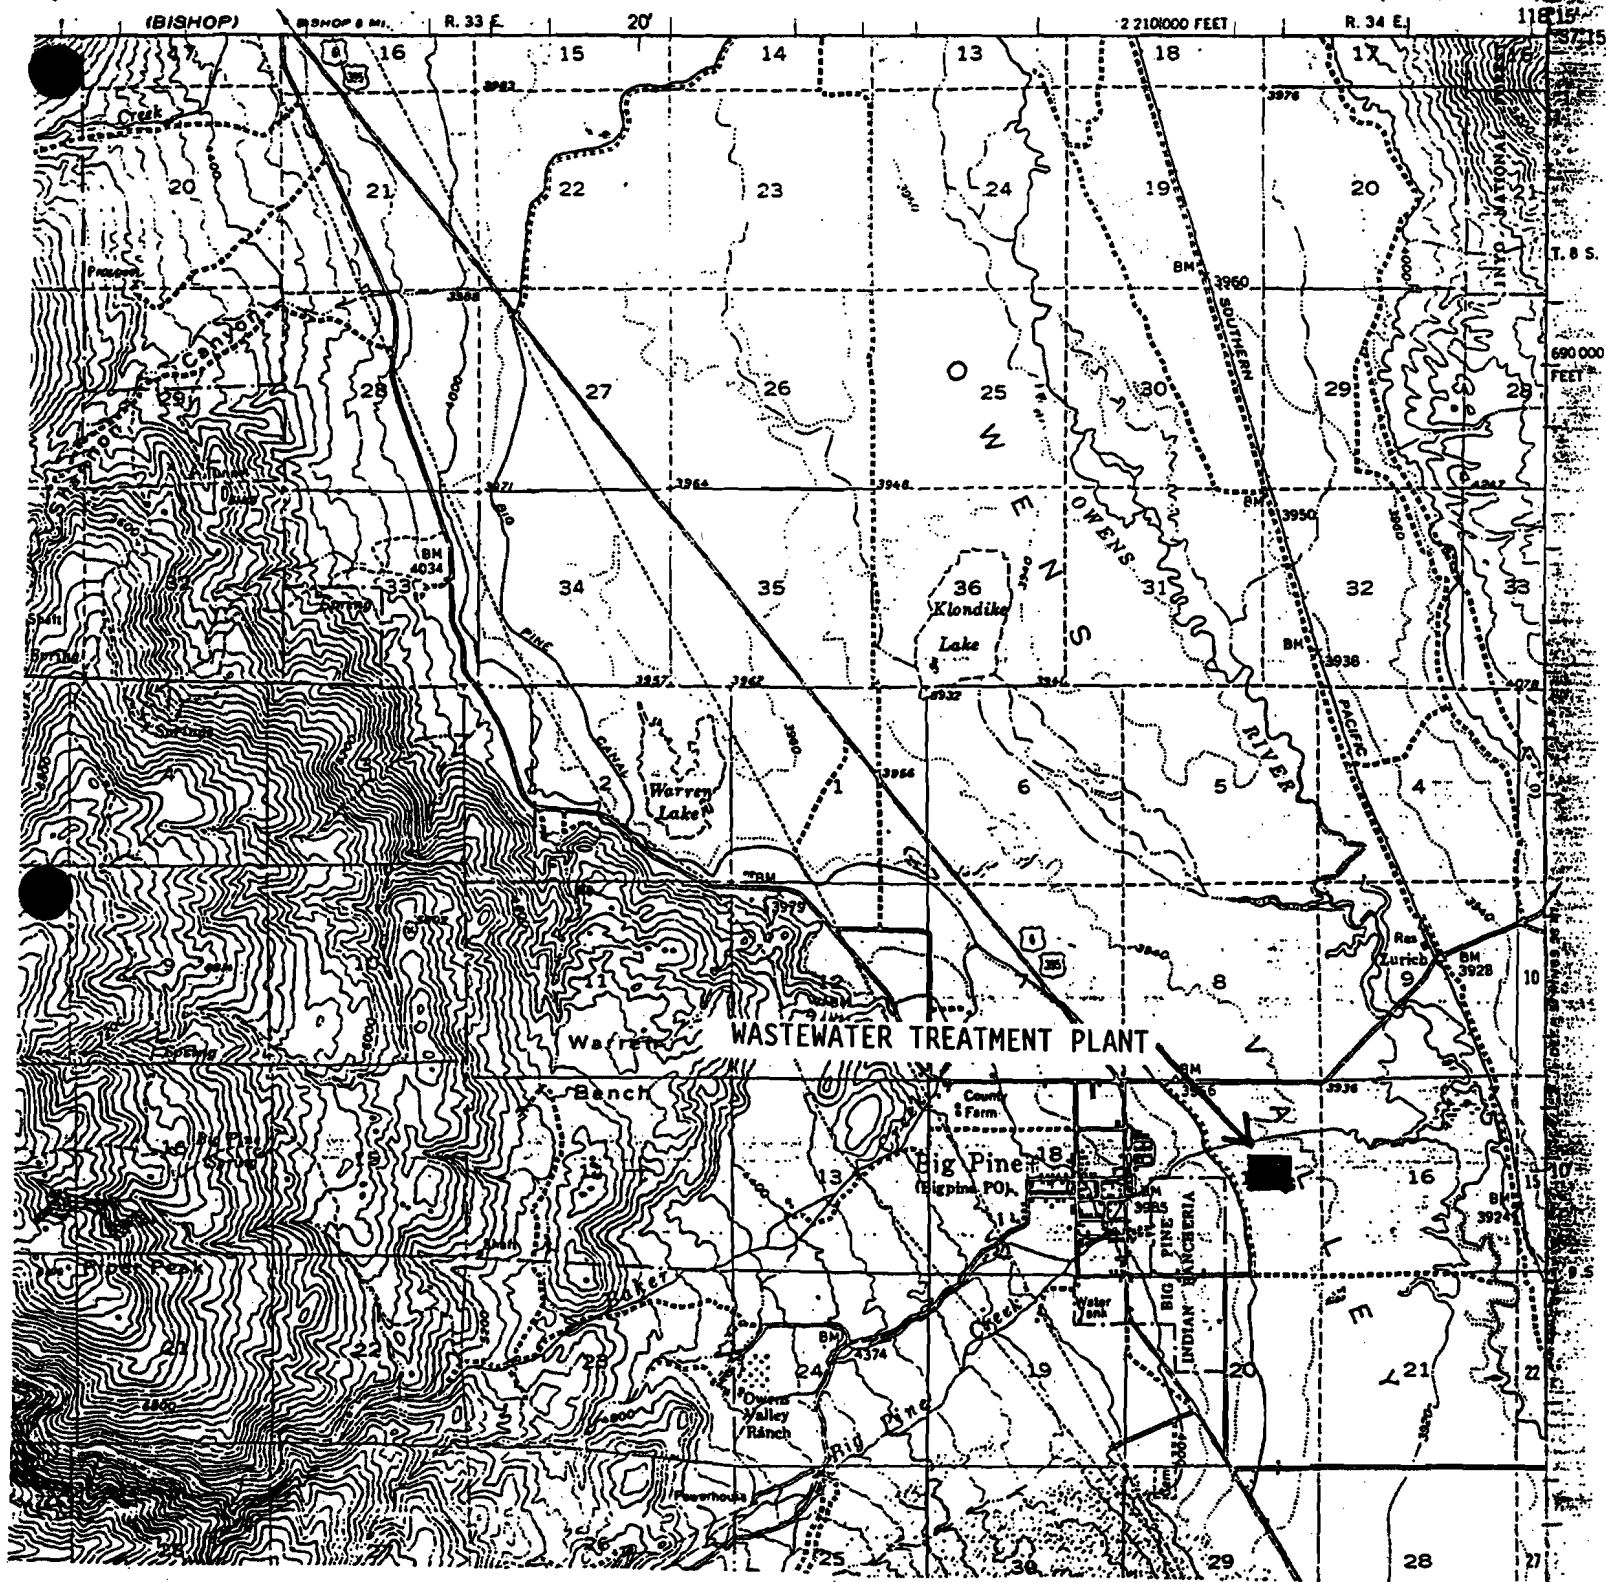


ATTACHMENT "A"

BIG PINE TRIBAL UTILITY DISTRICT
 BIG PINE INDIAN RESERVATION WTF

Northeast of the Big Pine Indian Reservation - Inyo County

Portion of the south half of the NE quarter and a
 portion of the north half of the SE quarter of
 Section 17, T9S, R34E, MDB&M

Attachment "B"

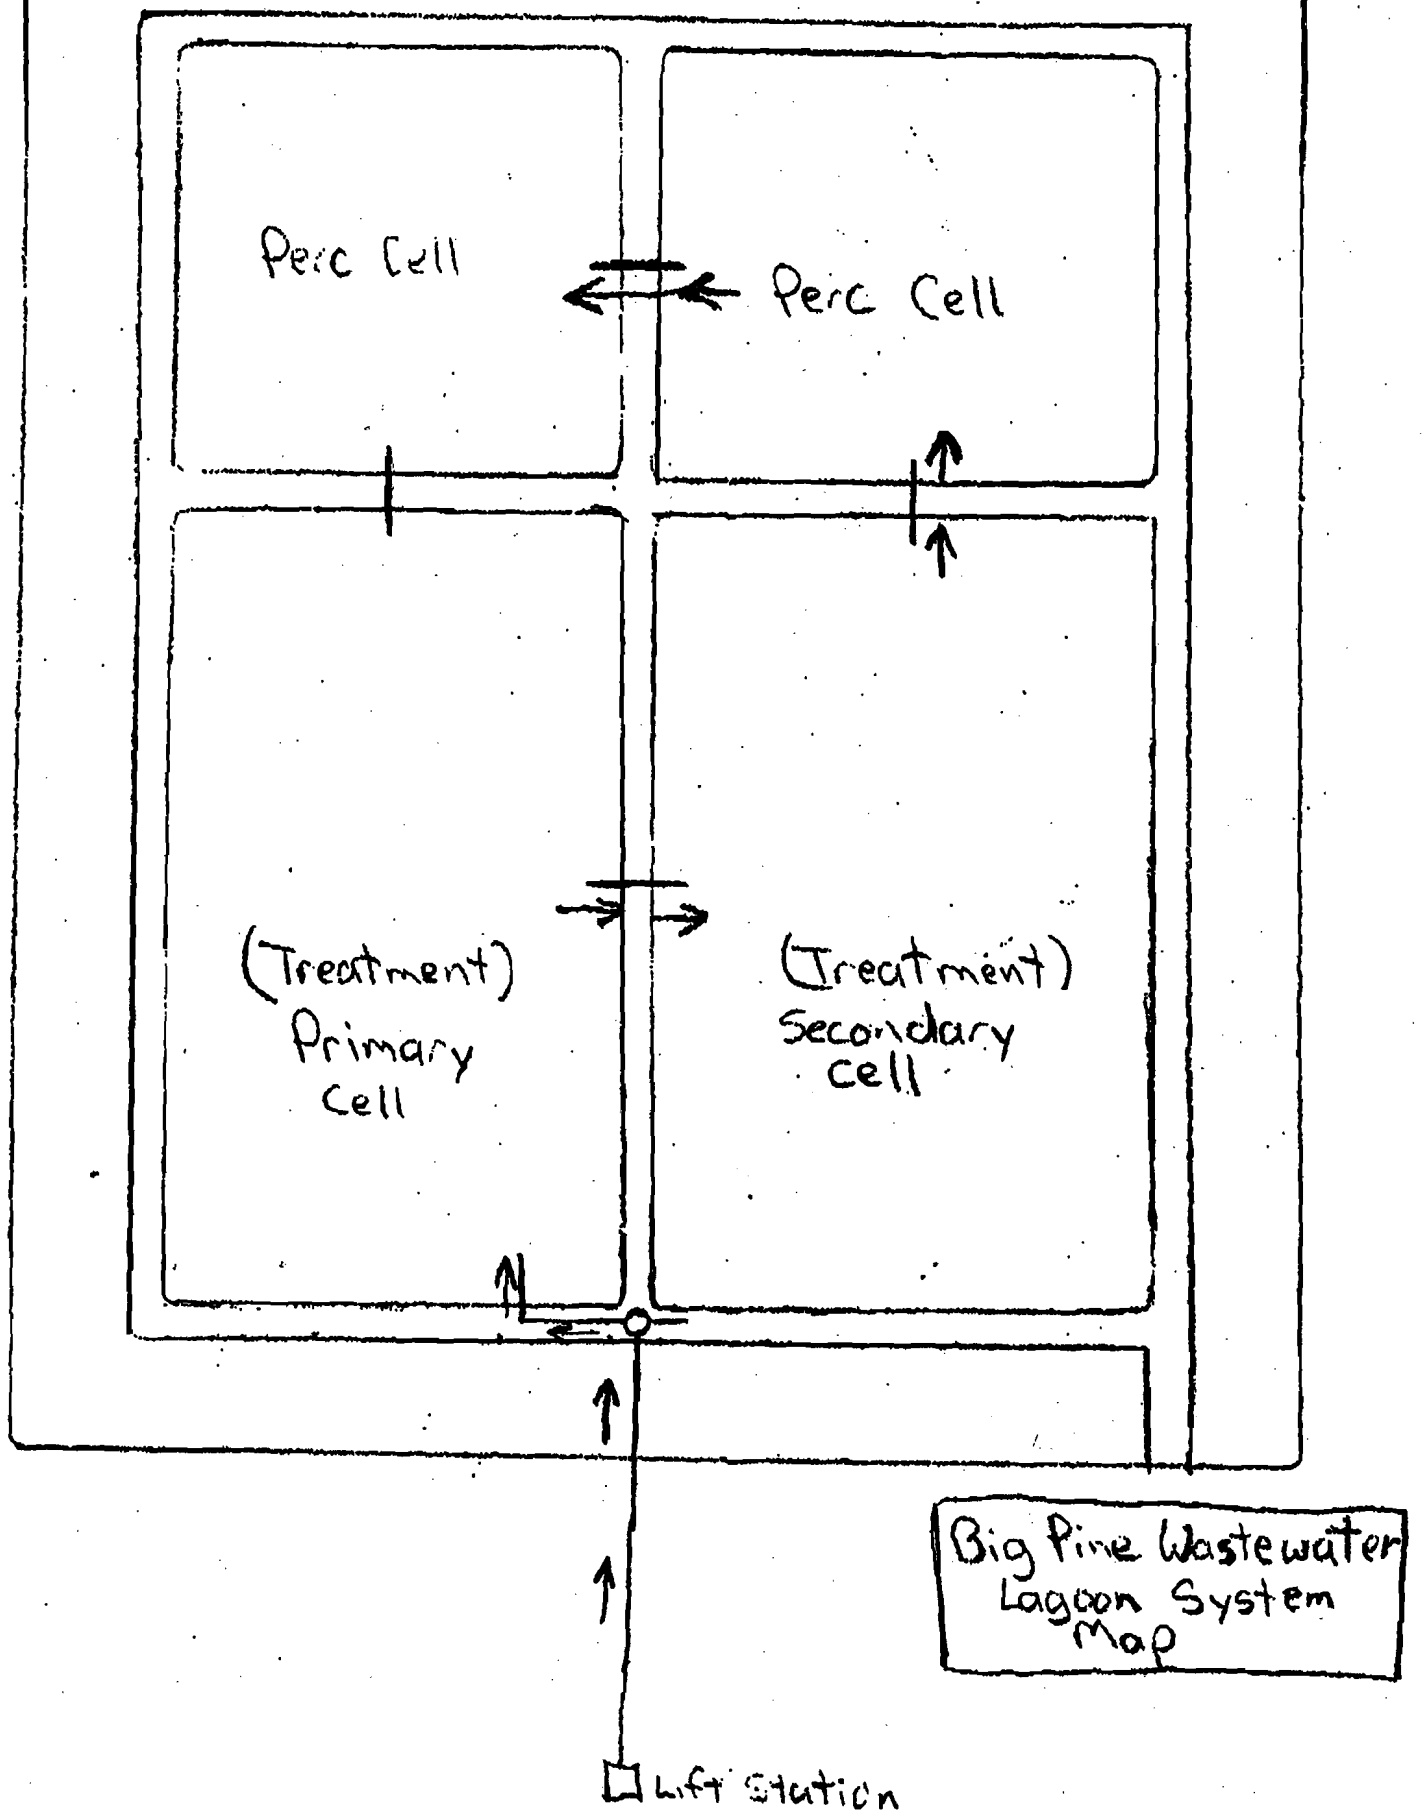

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

REVISED MONITORING AND REPORTING PROGRAM

NO. R6V-2002-0039

WDID NO. 6B149107005

FOR

**BIG PINE TRIBAL UTILITY DISTRICT, BIG PINE INDIAN RESERVATION
WASTEWATER TREATMENT FACILITY**

Inyo County

The Discharger shall comply with the following:

I. MONITORING

A. Flow Monitoring

The following shall be recorded in a permanent log book:

1. The total volume, in million gallons, of wastewater flow into the treatment facility for each day.
2. The total volume, in million gallons, of wastewater flow into the treatment facility for each month.
3. The average flow rate, in million gallons per day (mgd), of wastewater into the treatment facility calculated for each month.
4. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in the pond) measured each month in each pond. If a pond does not contain wastewater, indicate that it is empty.

B. Facility Influent Monitoring

Influent to the treatment plant shall be collected at a turbulent well-mixed location and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Type of Units</u>	<u>Sample</u>	<u>Frequency</u>
Oil & Grease	mg/l	grab	quarterly
BOD ₅ ^{1/}	mg/l	8-hr composite	monthly
MBAS ^{2/}	mg/l	grab	quarterly
Suspended Solids	mg/l	8-hr composite	quarterly
Temperature	°C or °F	grab	quarterly
pH	pH units	grab	quarterly

Samples shall be collected at a turbulent, well-mixed point.

C. Facility Effluent Monitoring

Effluent discharged to the evaporation/percolation ponds, when it occurs, shall be collected at a turbulent, well-mixed location and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Type of Units</u>	<u>Sample</u>	<u>Frequency</u>
Oil & Grease	mg/l	grab	quarterly*
BOD ₅	mg/l	8-hr composite	quarterly*
MBAS	mg/l	grab	quarterly*
Total Dissolved Solids (TDS)	mg/l	grab	quarterly*
Dissolved Oxygen	mg/l	grab	quarterly*
Temperature	°C or °F	grab	quarterly*
pH	pH units	grab	quarterly*
Nitrate Nitrogen	mg/l as N	grab	quarterly*
TKN ^{3/}	mg/l as N	grab	quarterly*
Ammonia Nitrate	mg/l as N	grab	quarterly*
Chloride	mg/l	grab	quarterly*

* If any effluent discharge occurs during a quarter, a minimum of one sample of the effluent is required. If no effluent discharge has occurred during a quarter, the monitoring report shall reflect "no discharge."

D. Ground Water Monitoring

1. Grab samples from the entire thickness or the upper 10 feet, whichever is less, of the uppermost ground water bearing zone shall be collected from the three monitoring wells and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
BOD ₅	mg/l	annually
MBAS	mg/l	annually
TKN	mg/l as N	annually
Total Dissolved Solids	mg/l	annually
pH	pH units	annually
Temperature	°C or °F	annually
Chloride	mg/l	annually
Oil & Grease	mg/l	annually
Total Coliform	mpn/100ml	annually
Ammonia Nitrogen	mg/l as N	annually
Nitrate Nitrogen	mg/l as N	annually
Purgeable Halocarbons ^{4/5/}	mg/l	bi-annually
Base/Neutral/Acid Extractable Organics ^{4/6/}	mg/l	bi-annually
Purgeable Aromatics ^{4/7/}	mg/l	bi-annually

4. The elevation of ground water (mean sea level) in each well shall be measured and recorded each time a monitoring well is sampled.
5. The velocity and direction of ground water flow under the facility site shall be determined at least annually unless it can be shown that no changes have occurred.

E. Offsite Disposal

The Discharger shall include in each monitoring report the volume and type of all waste hauled off site for disposal. The person or company doing the hauling and the legal point of disposal shall also be recorded.

II. REPORTING

A. General Provisions

1. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program R6V-2002-(PROPOSED).
2. Any violations of waste discharge requirements shall be clearly identified in all monitoring reports provided to the Regional Board, together with a schedule for any necessary or planned corrective actions. If there are no violations, a statement certifying compliance shall be provided.

B. Submittal Periods

Beginning on **October 15, 2002**, quarterly monitoring reports shall be submitted to the Board by the **15th day of the month following each quarter** (April 15, July 15, October 15, and January 15).

C. Annual Report

By January 15 of each year, the Discharger shall submit an annual report to the Regional Board with the following information:

1. The compliance record, and corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.
2. Graphical and tabular presentation of the monitoring data obtained for the previous year.

D. Provisions

This Monitoring and Reporting Program may be modified by the Regional Board Executive Officer.

Ordered By:


HAROLD J. SINGER
EXECUTIVE OFFICER

Dated:

June 12, 2002

-
- ^{1/} Biochemical Oxygen Demand (5 day, 20°C) of a filtered sample. The sample is to be filtered through a No. 1 Whatman filter or equivalent.
- ^{2/} Methylene Blue Active Substances
- ^{3/} Total Kjeldahl Nitrogen
- ^{4/} Analysis shall be conducted for those substances included on the EPA list of priority pollutants and all other substances known to be discharged to the Big Pine Indian Reservation sewer system.
- ^{5/} Purgeable organics analysis shall be conducted in accordance with EPA method 601, 40 CFR part 136, Appendix A.
- ^{6/} Base/neutral/acid extractable organics analysis shall be conducted in accordance with EPA method 625, 40 CFR, part 136, Appendix A.
- ^{7/} Purgeable Aromatics analysis shall be conducted in accordance with EPA method 602, 40 CFR part 136, Appendix A.