

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. 6-94-025
WDID NO. 6B140101001

UPDATED WASTE DISCHARGE REQUIREMENTS

FOR

CITY OF BISHOP
SEWAGE TREATMENT FACILITY

Inyo County

The California Regional Water Quality Control Board, Lahontan Region (Regional Board) finds:

1. Discharger

For the purposes of this Order, the City of Bishop is referred to as the "Discharger," and the City of Bishop's waste treatment and disposal facility is referred to as the "Facility."

2. Permit History

The Regional Board previously established waste discharge requirements for the Facility under Board Order No. 6-80-55, which was adopted on August 14, 1980, and revised by Board Order No. 6-85-122 on October 10, 1985.

3. Reason for Action

The Regional Board is updating waste discharge requirements for the Facility as part of a statewide program to periodically review and update waste discharge requirements. The purpose of this Order is to incorporate changes in regulations and regulatory policies (since the adoption of Board Order No. 6-85-122) which apply to operation of the Facility.

4. Facility Location

The Facility is located approximately 1.0 mile (1.6 km) east of the City of Bishop on East Line Street, within Section 8, T7S, R33E, MDB&M as shown on Attachment "A" which is made part of this Order.

5. Discharge Description

The Facility serves the City of Bishop which has a population of approximately 4,000. Wastewater treatment is provided by a primary clarifier, a clay-lined, aerated lagoon and two clay-lined oxidation ponds. The Facility collects, treats, and disposes of an average of 0.82 mgd of domestic wastewater. The Facility has a design capacity of 1.6 mgd.

6. Authorized Disposal Sites

Treated effluent is discharged to oxidation ponds or to pasture land. Mr. Donald Tatum currently uses treated effluent from the Facility to flood irrigate a 125-acre pasture site for non-milking animals located south of the oxidation ponds. The oxidation ponds and the pasture irrigation land are the only authorized disposal sites. Milking animals will be precluded from using the irrigation site.

7. Sludge Treatment and Disposal

Sludge from the primary clarifier is treated by two anaerobic digesters and is discharged to drying beds. Sludge from the drying beds is used on the irrigation site as a fertilizer and soil conditioner.

8. Site Hydrology

Depth to groundwater in the vicinity of the Facility is less than 10 feet (3.1 meters). The quality of the groundwater is excellent for most beneficial uses with total filterable residue concentrations in the range of 150 to 400 mg/l.

9. Receiving Waters

The receiving waters are the groundwaters of the Upper Owens Subunit of the Owens Hydrologic Unit.

10. South Lahontan Basin Plan

The Regional Board adopted a Water Quality Control Plan for the South Lahontan Basin on May 8, 1975 and this Order implements the Plan as amended.

11. Beneficial Uses

The beneficial uses of the groundwaters of the Upper Owens Subunit of the Owens Hydrologic Unit as set forth and defined in the Water Quality Control Plan for the South Lahontan Basin are:

- a. Municipal and domestic supply
- b. Agricultural supply
- c. Freshwater replenishment

12. Reclamation Regulations

The California Department of Health Services (DHS) has established state-wide regulations for the use of reclaimed domestic wastewater. In accordance with Section 13523 of the California Water Code, the Board consulted with and received the recommendations of the State DHS which are incorporated within this Order.

13. California Environmental Quality Act Compliance

This project involves the continued operation and maintenance of an existing Facility and, as such, is exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000, et seq.) in accordance with Title 14, California Code of Regulations, Chapter 3, Section 15301.

14. Notification of Interested Parties

The Regional Board has notified the Discharger and interested parties of its intent to update waste discharge requirements for the discharge.

15. Consideration of Public Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent/Discharge Limitations

1. The average flow of wastewater to the treatment and disposal facilities shall not exceed 1.6 million gallons per day (mgd).
2. The maximum instantaneous flowrate of wastewater to the treatment and disposal facilities shall not exceed 4.8 mgd.
3. All wastewater made available to the authorized disposal/reclamation sites shall not contain concentrations of parameters in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Maximum</u>
BOD ²	mg/l	50.0	----
MBAS ³	mg/l	1.0	2.0

4. All wastewater made available to the authorized disposal/reclamation sites shall have a pH of not less than 6 pH units nor more than 9 units.

¹ The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days

² Biochemical Oxygen Demand (5 day, 20° C) for an unfiltered sample

³ Methylene Blue Active Substances

5. All wastewater made available to the authorized disposal/reclamation sites shall have a dissolved oxygen concentration not less than 1.0 mg/l.

B. Receiving Water Limitations

The discharge of waste shall not cause the presence of the following substances or conditions in ground waters of the Upper Owens Subunit of the Owens Hydrologic Unit:

1. Any perceptible color, odor, taste or foaming.
2. Coliform organisms attributable to human wastes.
3. Toxic substances in concentrations that individually, collectively, or cumulatively cause detrimental physiological responses in human, plants, animals, or aquatic life.
4. Identifiable chlorinated hydrocarbons, organophosphates, carbamates, and other pesticide and herbicide groups, in summations, in excess of the lowest detectable levels.
5. Concentrations of chemical constituents in excess of the maximum contaminant levels or secondary maximum contaminant levels based upon drinking water standards specified by the more restrictive of the California Code of Regulations, Title 22, Division 4, Chapter 15, or 40 CFR, Part 141.

C. Reclamation Requirements

1. All effluent made available for reclamation shall comply with standard Department of Health Services regulations as specified in Chapter 3, Division 4, Title 22 of the California Code of Regulations.
2. Reclaimed water used for spray irrigation of fodder, fiber and seed crops shall contain not more than 0.5 ml/l/hour of settleable solids.
3. The irrigation sites shall be graded to prevent persistent ponding of wastewater which is capable of promoting the breeding of mosquitoes.
4. The irrigation site shall be properly fenced and posted to restrict public access and warn of the presence of sewage.
5. Wastewater to be utilized for the irrigation of pasture to which milking cows or goats have access the wastewater shall at all times be adequately disinfected and oxidized. The wastewater shall be considered adequately disinfected if, at some location in the treatment

process, the median number of coliform organisms does not exceed 23/100 ml, as determined from the bacteriological results of the last weekly period for which analyses have been completed.

D. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent at/or from the authorized disposal/reclamation sites to adjacent land areas or surface waters is prohibited.
3. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than 1.5 feet.
4. The discharge shall not cause a pollution as defined in Section 13050 of the California Water Code, or a threatened pollution.
5. Neither the treatment nor the discharge shall cause a nuisance as defined in Section 13050 of the California Water Code.
6. The discharge of wastewater except to the authorized disposal/reclamation sites is prohibited.
7. The integrity of the facultative pond liners and dikes shall be maintained throughout the life of the ponds and shall not be diminished as the result of any maintenance or cleaning operation.
8. The Discharger shall comply with all existing Federal and State laws and regulations that apply to sewage sludge use and disposal practices.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Regional Board Order No. 6-85-122 is hereby rescinded.

B. Operator Certificates

The Discharger's wastewater treatment plant shall be supervised by persons possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to Chapter 3, Subchapter 4, Title 23, California Code of Regulations.


C. Standard Provisions

The Discharger shall comply with the Standard Provisions for Waste Discharge Requirements, dated July 1, 1993, in Attachment "B" which is made part of this Order.

D. Monitoring and Reporting


Pursuant to the California Water Code § 13267(b), the Discharger shall comply with Monitoring and Reporting Program No. 94-025 as specified by the Regional Board Executive Officer.

I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on February 10, 1994.



HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: A. Location Map
B. Standard Provisions for Waste Discharge Requirements

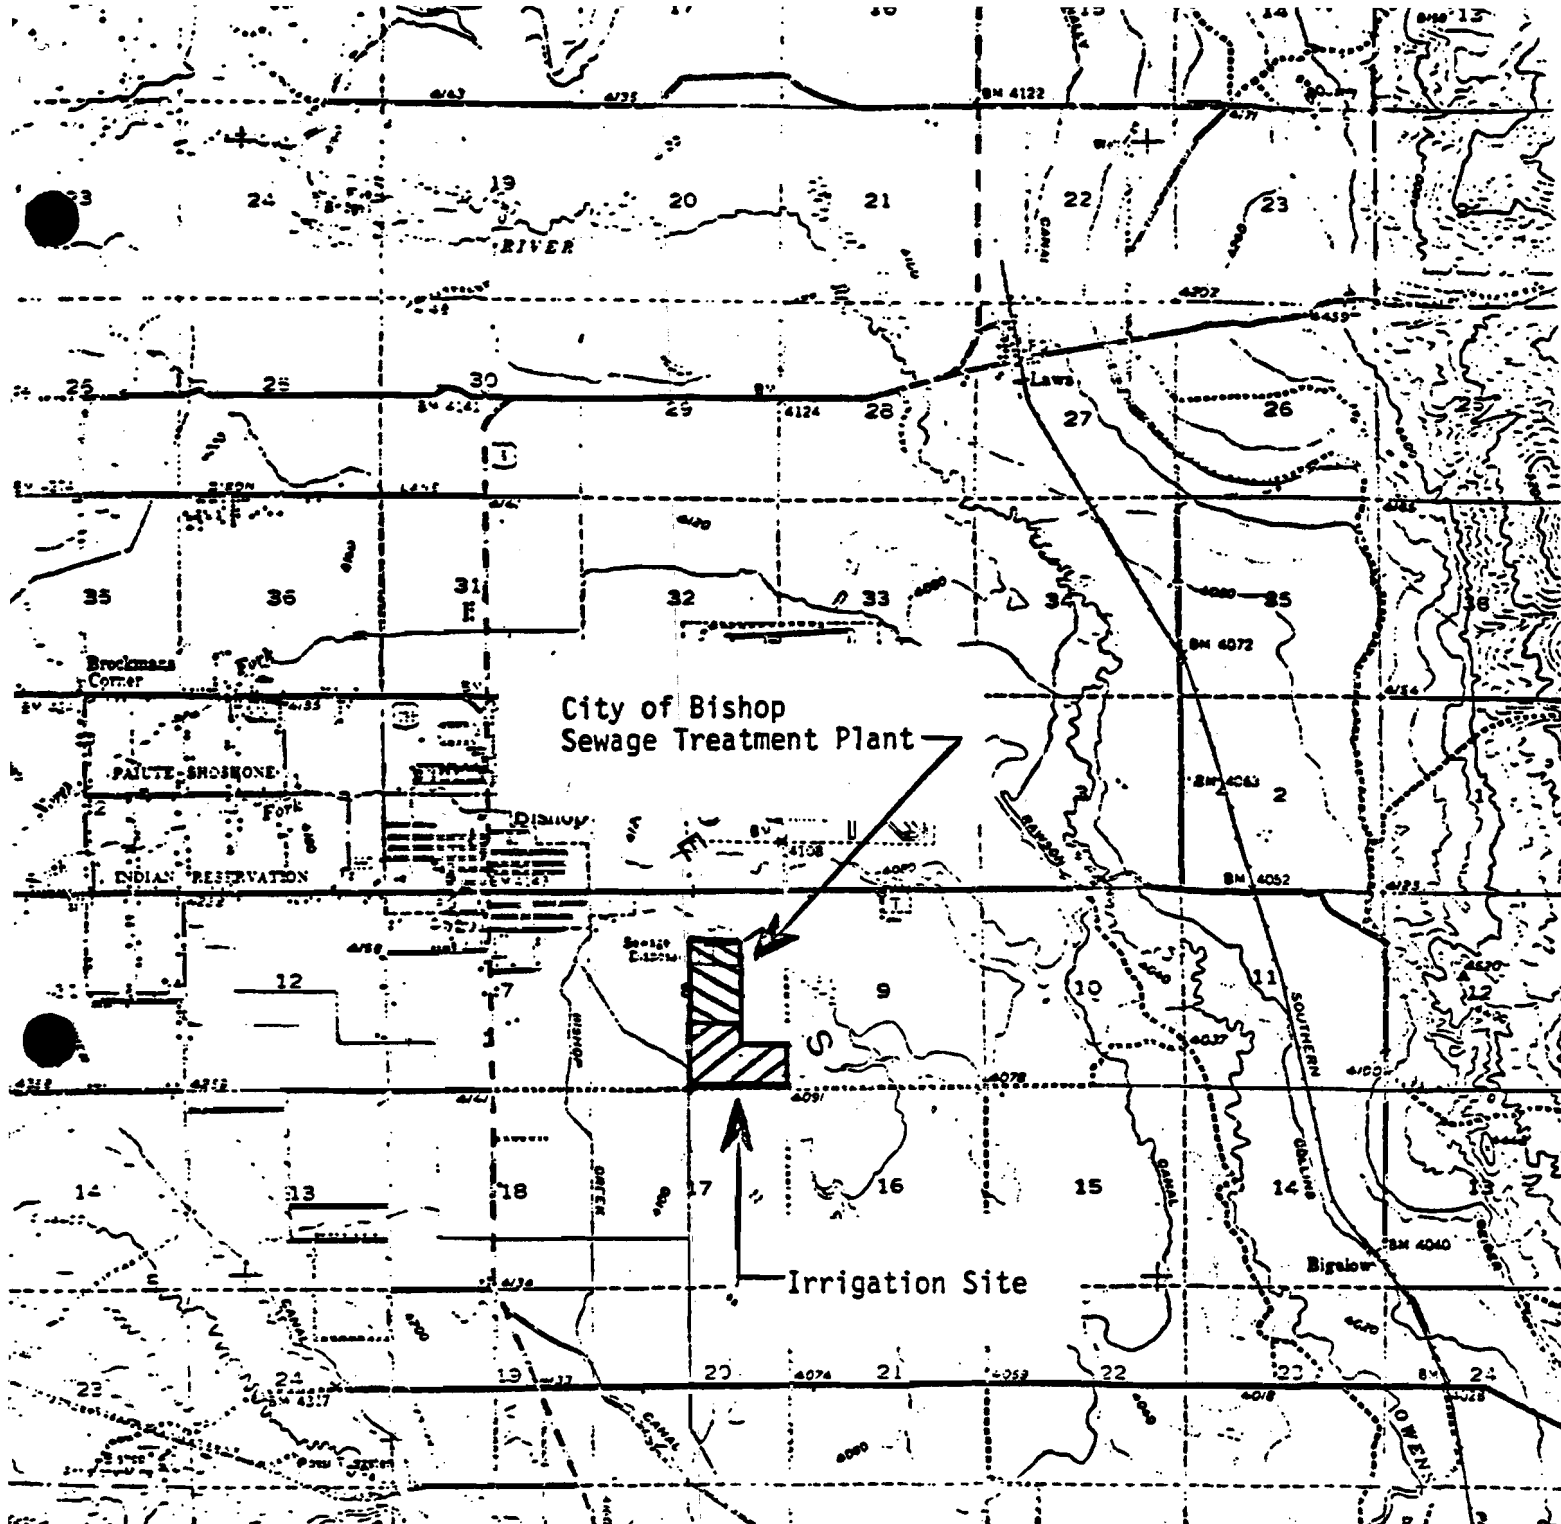

ATTACHMENT "A"

CITY OF BISHOP
SEWAGE TREATMENT PLANT

East of Bishop - Inyo County

Portion of Section 8, T17S, R33E, MDB&M

USGS Bishop 15 Minute Quadrangle

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

MONITORING AND REPORTING PROGRAM NO. 94-025
WDID NO. 6B140101001

FOR

CITY OF BISHOP
SEWAGE TREATMENT PLANT

Inyo County

I. MONITORING

A. Flow Monitoring

The following shall be recorded in a permanent log book:

1. The total volume, in million gallons, of wastewater flow to the treatment facility for each day.
2. The total volume, in million gallons, of wastewater flow to the treatment facility for each month.
3. The average flow rate, in million gallons per day (mgd), of wastewater to the treatment facility calculated for each month.
4. The maximum instantaneous flow rate, in million gallons per day (mgd), of wastewater to the treatment facility that occurs each day.
5. The total volume, in million gallons, of wastewater flow to the reclamation sites for each month.
6. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in the pond) measured each month in each surface impoundment (SI). If a surface impoundment does not contain wastewater, indicate that it is empty.

B. Plant Influent Monitoring

Beginning immediately, grab samples of the influent shall be collected and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
BOD ¹	mg/l	monthly

¹Biochemical Oxygen Demand (5 day, 20° C) of an unfiltered sample

C. Plant Effluent Monitoring

Beginning immediately, grab samples of the secondary effluent from wastewater treatment facilities shall be collected prior to chlorination and analyzed to determine the magnitude of the following parameters and the parameters listed.

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
pH		monthly
BOD	mg/l	monthly
COD ²	mg/l	quarterly
Methylene Blue Active Substances	mg/l	quarterly
Total Filterable Residue	mg/l	quarterly

D. Ground Water Monitoring

1. Groundwater samples shall be taken from monitoring wells Nos. 1, 3 and 4. Prior to sampling a well, a minimum of three (3) volumes in the casing shall be pumped or bailed.

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Nitrate-Nitrogen	mg/l as N	quarterly
Methylene Blue Active Substances	mg/l	quarterly
Total Filterable Residue	mg/l	quarterly

2. The depth to ground water in each well shall be measured and recorded each time a monitoring well is sampled.

E. Sludge Monitoring

1. By January 1, 1995, the Discharger shall submit a Sludge Management Plan for approval by the Executive Officer. The Discharger shall submit subsequent annual reports summarizing disposal of sludge in accordance with the provisions of the plan with the last quarterly report of the calendar year.
2. The Discharger shall report to the Regional Board all information necessary to comply with U.S. Environmental Protection Agency Sludge Management Regulations contained in Section 503 of the Federal Clean Water Act.

²Chemical Oxygen Demand of an unfiltered sample

F. Sampling and Analysis Methods

1. The Discharger shall comply with the attached General Provisions for Monitoring and Reporting, which is made part of this Monitoring and Reporting Program.

II. REPORTING

A. General Provisions

The Discharger shall comply with the "General Provisions for Monitoring and Reporting", dated July 1, 1993, which is attached to and made part of this Monitoring and Reporting Program.

B. Submittal Periods

Beginning on March 15, 1994, and continuing quarterly thereafter, a monitoring report of the previous quarter, including the preceding information, shall be submitted to the Regional Board. The reporting of Nitrate Nitrogen shall commence in the quarterly report for December 15, 1994, and continue quarterly thereafter.

Ordered by:

Harold J. Singer

HAROLD J. SINGER
EXECUTIVE OFFICER

Dated:

Feb 10, 1994

Attachment: General Provisions for Monitoring and Reporting