

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. 6-95-22
WDID NO. 6A020008000

UPDATED WASTE DISCHARGE REQUIREMENTS

FOR

MARKLEEVILLE PUBLIC UTILITY DISTRICT
WASTEWATER SYSTEM

Alpine County

The California Regional Water Quality Control Board, Lahontan Region (Regional Board) finds:

1. Discharger

Jim Funge, Chairman of the Board of Directors of the Markleeville Public Utility District, submitted information to update waste discharge requirements for the Markleeville Public Utility District Wastewater System on November 22, 1994. For the purposes of this Order, the Markleeville Public Utility District is referred to as the "Discharger."

2. Facility

The Markleeville Public Utility District operates a sewage collection, treatment, and disposal system which discharges treated domestic sewage. For the purposes of this Order, the Markleeville Public Utility District Wastewater System is referred to as the "Facility".

3. History of Previous Regulation by the Regional Board

The Regional Board previously established waste discharge requirements for the Facility under Board Order No. 6-84-109, which was adopted on October 11, 1984, and Order No. 6-77-16, which was adopted on March 10, 1977.

4. Reason for Action

The Regional Board is updating waste discharge requirements as part of an ongoing program to periodically review and revise requirements to reflect current regulations and policies. The purpose of this Order is to establish new requirements to monitor ground water quality at the Facility.

5. Facility Location

The Facility is located on the northern side of State Highway 89 in the community of Markleeville, Alpine County, within Section 22, T10N, R20E, MDB&M, as shown on Attachment "A", which is made part of this Order.

6. Description of Facility and Discharge

The Facility consists of a domestic sewage collection, treatment and disposal system serving homes and commercial establishments within the community of Markleeville. Raw sewage from the sewered portion of the community (66 service connections) flows via gravity to a pumphouse which delivers the wastewater to an unlined ± 1.0 million gallon earthen aeration pond. The pond is aerated by a diffused-air system consisting of parallel perforated pipes on the pond bottom. Portions of these pipes are failing due to clogging and the aeration system is scheduled to be replaced in 1995. The aeration pond is also subject to wind-induced mixing, and is typically operated full (three feet of freeboard). The aeration pond is of sufficient size to provide hydraulic detention times in excess of 37 days at peak daily flow rates. Following aeration the wastewater flows to one of two unlined earthen percolation/evaporation ponds where the oxidized wastewater either evaporates or percolates into the soil beneath the ponds.

7. Disposal Area

The treatment and disposal ponds are located in the northwest portion of Markleeville, and are accessible via a dirt road behind the Alpine County Court House. The ponds overlook Markleeville Creek, and are surrounded by a security fence. Flow from the aeration pond is discharged to the percolation/evaporation ponds. Although two ponds are available to dispose of wastewater, the Discharger currently utilizes only the northeastern basin. This unlined basin contains stands of emergent vegetation such as cattails and reeds in the wetter areas, and many mature aspen trees in and along the northern bank. The other adjacent oxidation pond area is normally dry, and contains pine, sage, and scrub brush growth typical of the drier portions of the Markleeville area. The Facility is designed to accept, treat, and dispose of average daily flows of 0.04 million gallons per day. Flow is gauged by recording the number of hours of pump operation at the pumphouse. The Facility currently operates below capacity, and an average of less than 0.03 million gallons of wastewater is disposed of daily.

8. Sludge Treatment and Disposal

To date, no sludge has been disposed of from the Facility, which has been in operation since 1967. The dirt access road to the Facility may be unsuitable to accommodate a typical sludge pumper truck. Excessive sludge build-up is not an identified problem, and no sludge is proposed to be removed from the Facility at this time. The Facility has no hazardous waste component, and sludges contained in the ponds are presumed to be of relatively high quality with low levels of heavy metals.

9. Authorized Disposal Site

The ponds on the Facility site are the only authorized disposal sites for wastewater. The ponds on the Facility site are the only authorized disposal sites for sludge. The authorized disposal sites are located on lands owned by the Markleeville Public Utility District.

10. Site Geology

The pond facilities are located at an elevation of 5520 feet mean sea level, on a bench in a large hill. The hill overlooks Markleeville Creek, which is located approximately 200 to 300 feet to the southeast. The substrata at the authorized disposal site has been reported to be alluvial in origin, and consists of clayey decomposed granite interspersed with lenses of water-worn gravel.

11. Site Hydrology

Markleeville Creek is a perennial stream which is tributary to the East Fork Carson River and a potential receiving water for waste discharges. The confluence of Markleeville Creek and the East Fork Carson River is approximately one mile northeast of the Facility. Markleeville Creek may be influenced by discharges of geothermal water from Grover Hot Springs State Park, approximately three miles upstream of the Facility, which tend to elevate temperature, pH, and concentrations of dissolved minerals in the Creek. The Discharger has performed regular water quality monitoring in Markleeville Creek since 1987. The data indicates that Markleeville Creek waters contain total dissolved solids concentrations generally less 200 milligrams per liter, and very low concentrations of chloride. Several ephemeral surface water drainages feed Markleeville Creek. The most significant named tributary is Millberry Creek; it's mouth is located approximately 800 feet upstream of the Facility. The collection system main trunk line crosses beneath both Markleeville Creek and Millberry Creek. The Facility is located immediately upstream of a public campground which provides swimming, fishing and other water-contact recreation opportunities associated with Markleeville Creek.

12. Site Hydrogeology

Surface flow, in the form of seeps and springs, occurs at the base of the hill in the general vicinity of the Facility. During the growing season, sedges and grasses grow in marshy areas on and near the base of the hill, and adjacent to Markleeville Creek. However, this type of wetland is not uncommon in the Markleeville area. Subsurface flow beneath the Facility migrates toward Markleeville Creek. The depth to groundwater beneath the Facility has not been determined, nor has the contribution to subsurface flow from the Facility been quantified. Ground water monitoring is needed to determine whether the discharge is impacting water quality.

13. Receiving Waters

The receiving waters are the ground and surface waters of the North Lahontan Hydrologic Basin, East Fork Carson River Hydrologic Unit, Markleeville Hydrologic Area (Department of Water Resources Hydrologic Unit No. 632.10).

14. North Lahontan Basin Plan

The Regional Board adopted a Water Quality Control Plan for the North Lahontan Basin (Basin Plan) on June 26, 1975 and this Order implements the Basin Plan as amended.

15. Beneficial Uses of Ground Water

The beneficial uses of the ground waters of the North Lahontan Hydrologic Basin, East Fork Carson River Hydrologic Unit, Markleeville Hydrologic Area as set forth and defined in the Basin Plan are:

- a. municipal and domestic supply
- b. agricultural supply
- c. industrial service supply
- d. freshwater replenishment

16. Beneficial Uses of Surface Water

The beneficial uses of the surface waters of the North Lahontan Hydrologic Basin, East Fork Carson River Hydrologic Unit, Markleeville Hydrologic Area as set forth and defined in the Basin Plan are:

- a. agricultural supply
- b. industrial service supply
- c. hydropower generation
- d. ground water recharge
- e. freshwater replenishment
- f. water-contact recreation
- g. non-water-contact recreation
- h. cold freshwater habitat
- i. wildlife habitat
- j. preservation of rare and endangered species

17. California Environmental Quality Act Compliance

These waste discharge requirements regulate waste discharges from an existing facility. The Facility is thus exempt from the provisions of the California Environmental Quality Act (CEQA, Public Resources Code 21000, et seq.) in accordance with Section 15301 of the CEQA Guidelines.

18. Notification of Interested Parties

The Regional Board has notified the Discharger and interested parties of its intent to update waste discharge requirements for the discharge.

19. Consideration of Public Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Discharge/Effluent Limitations

1. The total effluent flow of wastewater during a 24-hour period shall not exceed 0.04 million gallons.
2. All wastewater made available to the percolation/evaporation ponds shall not contain pollutant concentrations in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean¹</u>	<u>Maximum</u>
BOD ²	mg/l	30	45
MBAS ³	mg/l	1.0	2.0

3. All wastewater made available to the percolation/evaporation ponds shall have a pH of not less than 6 pH units nor more than 9 pH units. A pH over 9.0 is allowed if it results from a biological process within the treatment plant.
4. All wastewater made available to the percolation/evaporation ponds shall have a dissolved oxygen concentration of not less than 1.0 mg/l.

B. Receiving Water Limitations

The discharge of waste shall not cause the presence of the following substances or conditions in ground and surface waters of the North Lahontan Hydrologic Basin, East Fork Carson River Hydrologic Unit, Markleeville Hydrologic Area:

1. Any perceptible color, odor, taste or foaming.

¹ The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days.

² Biochemical Oxygen Demand (5 day, 20°C). Samples from oxidation ponds and other pond-type systems should be filtered (using a No. 1 Whatman filter, or equivalent) and reseeded with unfiltered sample. Other types of treatment units should analyze unfiltered samples.

³ Methylene Blue Active Substances

2. Coliform organisms attributable to human wastes.
3. Toxic substances in concentrations that individually, collectively, or cumulatively cause detrimental physiological responses in human, plants, animals, or aquatic life.
4. Identifiable chlorinated hydrocarbons, organophosphates, carbamates, and other pesticide and herbicide groups, in summations, in excess of the lowest detectable levels.
5. Concentrations of chemical constituents in excess of the maximum contaminant levels or secondary maximum contaminant levels based upon drinking water standards specified by the more restrictive of the California Code of Regulations, Title 22, Division 4, Chapter 15, or 40 CFR, Part 141.
6. The discharge shall not cause, or contribute to causing, the following receiving water limitations to be exceeded in surface waters of the East Fork Carson River Hydrologic Unit:

<u>Parameter</u>	<u>Units</u>	<u>Annual Average</u>	<u>90th Percentile</u>
Total Dissolved Solids	mg/l	80	100
Chloride	mg/l	4.0	6.0
Sulfate	mg/l	4.0	8.0
Sodium	percent	25	30
Boron	mg/l	0.12	0.25
Total Nitrogen	mg/l-N	0.20	0.30
Total Phosphorus	mg/l-P	0.02	0.03

C. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent at, or from, the authorized disposal site to adjacent land areas or surface waters is prohibited.
3. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than two (2) feet.

4. The discharge shall not cause a pollution as defined in Section 13050 of the California Water Code, or a threatened pollution.
5. Neither the treatment nor the discharge shall cause a nuisance as defined in Section 13050 of the California Water Code.
6. The discharge of wastewater except to the authorized disposal sites is prohibited.
7. The integrity of any pond structure shall be maintained and shall not be diminished as the result of any maintenance or cleaning operation.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Board Order No. 6-84-109 is hereby rescinded.

B. Standard Provisions

The Discharger shall comply with the "Standard Provisions for Waste Discharge Requirements," dated September 1, 1994, in Attachment "B", which is made part of this Order.


C. Monitoring and Reporting

1. Pursuant to Section 13267(b) of the California Water Code, the Discharger shall comply with the Monitoring and Reporting Program No. 95-22 as specified by the Executive Officer.
2. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of the Monitoring and Reporting Program.

D. Operator Certification

The Discharger's wastewater treatment plant shall be supervised by personnel possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to *Regulations for Wastewater Treatment Plant Operator Certification and Plant Classification*, Title 23, California Code of Regulations, Division 4, Chapter 14, Section 3670 et. seq.

I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on February 9, 1995.



HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments:

- A. Vicinity/Site Map
- B. Standard Provisions for Waste Discharge Requirements

Attachment A

Location Map


Markleeville PUD

Wastewater Treatment System

LEGEND

- State Route
- Street, Road
- - Trails
- == State Route

- River
- Airfield
- ▨ Open Water
- ||||| Contour
- Ephemeral Stream

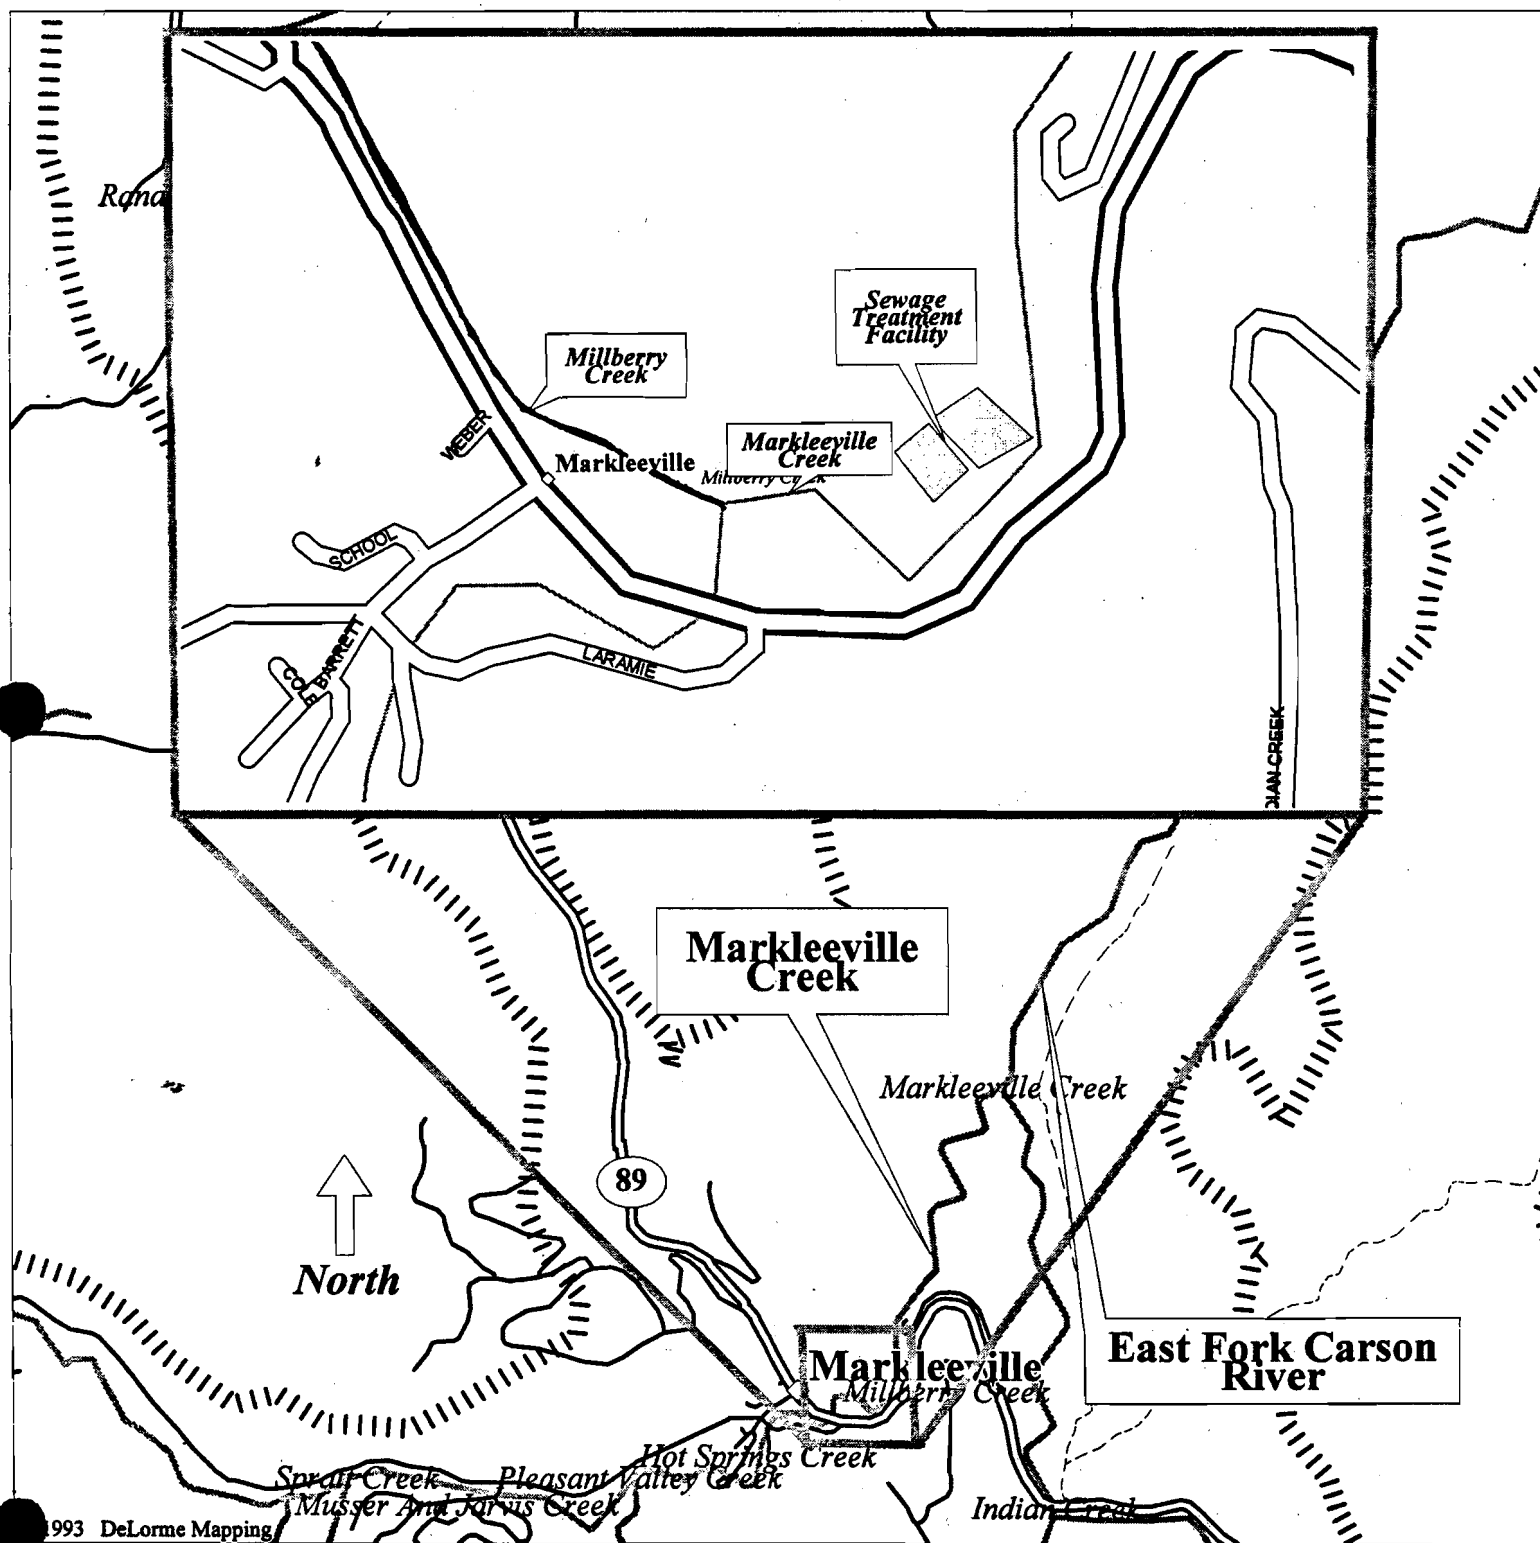

Attachment "B"

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

STANDARD PROVISIONS
FOR WASTE DISCHARGE REQUIREMENTS

1. **Inspection and Entry**

The discharger shall permit Regional Board staff:

- a. to enter upon premises in which an effluent source is located or in which any required records are kept;
- b. to copy any records relating to the discharge or relating to compliance with the waste discharge requirements;
- c. to inspect monitoring equipment or records; and
- d. to sample any discharge.

2. **Reporting Requirements**

- a. Pursuant to California Water Code 13267(b), the discharger shall immediately notify the Regional Board by telephone whenever an adverse condition occurred as a result of this discharge; written confirmation shall follow within two weeks. An adverse condition includes, but is not limited to, spills of petroleum products or toxic chemicals, or damage to control facilities that could affect compliance.
- b. Pursuant to California Water Code Section 13260 (c), any proposed material change in the character of the waste, manner or method of treatment or disposal, increase of discharge, or location of discharge, shall be reported to the Regional Board at least 120 days in advance of implementation of any such proposal. This shall include, but not be limited to, all significant soil disturbances.
- c. The owner(s) of, and discharger upon, property subject to waste discharge requirements shall be considered to have a continuing responsibility for ensuring compliance with applicable waste discharge requirements in the operations or use of the owned property. Pursuant to California Water Code Section 13260(c), any change in the ownership and/or operation of property subject to the waste discharge requirements shall be reported to the Regional Board. Notification of applicable waste discharge requirements shall be furnished in writing to the new owners and/or operators and a copy of such notification shall be sent to the Regional Board.
- d. If a discharger becomes aware that any information submitted to the Regional Board is incorrect, the discharger shall immediately notify the Regional Board, in writing, and correct that information.

- e. Reports required by the waste discharge requirements, and other information requested by the Regional Board, must be signed by a duly authorized representative of the discharger. Under Section 13268 of the California Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1000) for each day of violation.
- f. If the discharger becomes aware that their waste discharge requirements are no longer needed (because the project will not be built or the discharge will cease) the discharger shall notify the Regional Board in writing and request that their waste discharge requirements be rescinded.

3. Right to Revise Waste Discharge Requirements

The Board reserves the privilege of changing all or any portion of the waste discharge requirements upon legal notice to and after opportunity to be heard is given to all concerned parties.

4. Duty to Comply

Failure to comply with the waste discharge requirements may constitute a violation of the California Water Code and is grounds for enforcement action or for permit termination, revocation and reissuance, or modification.

5. Duty to Mitigate

The discharger shall take all reasonable steps to minimize or prevent any discharge in violation of the waste discharge requirements which has a reasonable likelihood of adversely affecting human health or the environment.

6. Proper Operation and Maintenance

The discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the discharger to achieve compliance with the waste discharge requirements. Proper operation and maintenance includes adequate laboratory control, where appropriate, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by the discharger, when necessary to achieve compliance with the conditions of the waste discharge requirements.

7. Waste Discharge Requirement Actions

The waste discharge requirements may be modified, revoked and reissued, or terminated for cause. The filing of a request by the discharger for waste discharge requirement modification, revocation and reissuance, termination, or a notification of planned changes or anticipated noncompliance, does not stay any of the waste discharge requirements conditions.

8. Property Rights

The waste discharge requirements do not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

9. Enforcement

The California Water Code provides for civil liability and criminal penalties for violations or threatened violations of the waste discharge requirements including imposition of civil liability or referral to the Attorney General.

10. Availability

A copy of the waste discharge requirements shall kept and maintained by the discharger and be available at all times to operating personnel.

11. Severability

Provisions of the waste discharge requirements are severable. If any provision of the requirements is found invalid, the remainder of the requirements shall not be affected.

12. Public Access

General public access shall be effectively excluded from treatment and disposal facilities.

13. Transfers

Providing there is no material change in the operation of the facility, this Order may be transferred to a new owner or operation. The owner/operator must request the transfer in writing and receive written approval from the Regional Board Executive Officer.

14. Definitions

- a. "Surface waters" as used in this Order, include, but are not limited to, live streams, either perennial or ephemeral, which flow in natural or artificial water courses and natural lakes and artificial impoundments of waters. "Surface waters" does not include artificial water courses or impoundments used exclusively for wastewater disposal.
- b. "Ground waters" as used in this Order, include, but are not limited to, all subsurface waters being above atmospheric pressure and the capillary fringe of these waters.

15. Storm Protection

All facilities used for collection, transport, treatment, storage, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

MONITORING AND REPORTING PROGRAM NO. 95-22
WDID NO. 6A020008000

FOR

MARKLEEVILLE PUBLIC UTILITY DISTRICT
WASTEWATER SYSTEM

Alpine County

I. MONITORING

A. Flow Monitoring

The Discharger shall monitor the following:

1. The total volume, in million gallons, of wastewater flow to the treatment facility for each month.
2. The average flow rate, in million gallons per day (mgd), of wastewater to the treatment facility calculated for each month.
3. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in the pond) measured each month in each surface impoundment. If a surface impoundment does not contain wastewater, indicate that it is empty.

B. Plant Effluent Monitoring

Beginning immediately, grab samples shall be withdrawn from mid-depth in the aerated pond, at a point near the overflow to the percolation/ evaporation ponds, and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
pH	pH units	Quarterly
Filtered Biochemical Oxygen Demand	mg/l	Quarterly
Methylene Blue Active Substances	mg/l	Quarterly
Total Dissolved Solids	mg/l	Quarterly
Chloride	mg/l	Quarterly

C. Ground Water Monitoring

1. The Discharger shall submit, by not later than August 31, 1995, a ground water monitoring system plan and a time schedule for installation of ground water monitoring wells as described below. The monitoring system, at a minimum, shall include the following:
 - a. A minimum of three monitoring wells shall be installed to determine the gradient of the ground water.
 - b. Additional wells shall be installed, if necessary, to insure that at least one (1) well is upgradient and two (2) wells are down gradient of the wastewater treatment facilities. The Discharger shall demonstrate that at least two downgradient wells are located such that ground water potentially impacted by the Discharge will be monitored.
 - c. The specific design and location of the wells shall be submitted for review and approval by the Regional Board Executive Officer.
 - d. The ground water monitoring wells shall be installed at the disposal site in accordance with the approved plan by not later than October 1, 1996.
 - e. An as-built design report shall be submitted within 60 days after the ground water monitoring system is installed. This shall include a statement of certification signed by a California registered civil engineer or geologist, regarding the placement, lithology and construction of the wells.
2. Grab samples from the entire thickness or the upper 20 feet, whichever is less, of the uppermost ground water bearing zone shall be collected from the monitoring wells and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
pH	pH	Quarterly
Total Dissolved Solids	mg/l	Quarterly
Total Nitrogen	mg/l -N	Quarterly
Nitrate Nitrogen	mg/l -N	Quarterly
Total Phosphorus	mg/l -P	Quarterly

Chloride, total dissolved solids, total nitrogen, and total phosphorus are to be sampled and analyzed quarterly for the first year (four quarters), and annually thereafter.

- a. Each time a monitoring well is sampled, and prior to well purging as specified below, the elevation (mean sea level) and depth (below ground surface) of ground water in each well shall be measured, and reported with the results of ground water analyses.
- b. Well Purging
 - (1) Ground water samples shall be collected only after at least three volumes of water in the well casing have been removed and temperature, electrical conductivity, and pH measurements of the water in the well have stabilized to approximately $\pm 10\%$ for each successive well volume removed.
 - (2) The measurements of temperature, electrical conductivity and pH during purging shall be reported with the results of ground water analyses. Parameter values shall be reported in the following units:

<u>Parameter</u>	<u>Units</u>
Temperature	°C or °F
Electrical Conductivity	mmhos/cm or dS/m
pH	pH units
 - (3) The well casing diameter, well depth, and total volume purged prior to sampling shall be reported with the results of ground water analyses.
- c. The direction of ground water flow under the disposal site shall be determined at least annually unless it can be shown that no changes have occurred.

D. Surface Water Monitoring

Grab samples shall be collected from Markleeville Creek upstream¹ and downstream² of the Facility and analyzed to determine the magnitude of the following parameters:

¹ The upstream sampling location shall be adjacent to, and immediately upstream of, the sewage lift station.

² The downstream sampling location shall be within the Markleeville Campground, near the first campsite accessible from the entrance drive.

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Chloride	mg/l	Quarterly
Total Dissolved Solids	mg/l	Quarterly
Total Nitrogen	mg/l as N	Quarterly
Total Phosphorus	mg/l as P	Quarterly
Temperature ³	°C or °F	Quarterly

E. Sludge Monitoring

1. The Discharger shall submit a Sludge Management Plan report by **June 1, 1995**.
2. The Discharger shall provide information on any deviations from the Sludge Management Plan.
3. The Discharger shall monitor:
 - a. Total quantity of sludge cleaned from any ponds during the monitoring period.
 - b. Date and quantity of any sludge landfilled or moved offsite, recipient (including name and address), location of receiving area, and sludge disposal method (including crops grown, if applicable).
 - c. For sewage sludge removed from ponds, stockpiled onsite, or discharged offsite, a representative composite sample shall be collected and analyzed for the following constituents:
 - (1) total Kjeldahl nitrogen as N
 - (2) ammonia nitrogen as N
 - (3) nitrate nitrogen as N
 - (4) total phosphate as P
 - (5) organic and inorganic persistent and bioaccumulative toxic substances listed in Section 66261.24, subsections (a)(2)(A) and (a)(2)(B), of Title 22, Division 4.5, Chapter 11, Article 3 of the California Code of Regulations.

³ Temperature should be recorded in the field at the time of sampling.

4. The Discharger shall make a determination whether the analyses in 3.c.(5), above, indicate that the sludge shall be considered a toxic hazardous material.
5. At least 90 days prior to sample collection and analysis, a sludge sampling protocol shall be submitted to the Executive Officer for approval.

II. REPORTING

A. General Provisions

The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program.

B. Submittal Periods

By not later than the 15th day of the month following the adoption of this Order, the Discharger shall submit a monitoring report including the preceding information to the Regional Board. Subsequent monitoring reports shall be submitted to the Regional Board by the 15th day following each quarter.

C. Annual Report

By **January 15** of each year, the Discharger shall submit an annual report to the Regional Board with the following information:

1. The compliance record, and corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.
2. Graphical and tabular presentation of the monitoring data obtained for the previous year.

Ordered by:


HAROLD J. SINGER
EXECUTIVE OFFICER

Dated:

Feb 9, 1995

Attachments: General Provisions for Monitoring and Reporting

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

GENERAL PROVISIONS
FOR MONITORING AND REPORTING

1. **SAMPLING AND ANALYSIS**

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes, EPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Regional Board Executive Officer. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The methods used shall also be reported. If methods other than EPA-approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Regional Board Executive Officer prior to use.
- d. The discharger shall establish chain-of-custody procedures to insure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage, and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall insure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book described in 2.b, below.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

2. OPERATIONAL REQUIREMENTS

a. Sample Results

Pursuant to California Water Code Section 13267(b), the discharger shall maintain all sampling and analytical results including: strip charts; date, exact place, and time of sampling; date analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.

b. Operational Log

Pursuant to California Water Code Section 13267(b), an operation and maintenance log shall be maintained at the facility. All monitoring and reporting data shall be recorded in a permanent log book.

3. REPORTING

- a. For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time, and shall submit a timetable for correction.
- b. Pursuant to California Water Code Section 13267(b), all sampling and analytical results shall be made available to the Regional Board upon request. Results shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.
- c. The discharger shall provide a brief summary of any operational problems and maintenance activities to the Board with each monitoring report. Any modifications or additions to, or any major maintenance conducted on, or any major problems occurring to the wastewater conveyance system, treatment facilities, or disposal facilities shall be included in this summary.
- d. Monitoring reports shall be signed by:
 - i. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
 - ii. In the case of a partnership, by a general partner;
 - iii. In the case of a sole proprietorship, by the proprietor; or

- iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
 - i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number.
- f. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Under Section 13268 of the Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation.

GENERAL PROVISIONS FOR MONITORING AND REPORTING

SAMPLING AND ANALYSIS

1. All analyses shall be performed in accordance with the current edition of Standard Methods for the Examination of Water and Wastewater, in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Executive Officer.
2. The discharger shall establish chain-of-custody procedures to assure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. These procedures shall be submitted to the Executive Officer in writing within 30 days of initial sample collection.
3. Effluent samples shall be taken downstream of any addition to the treatment works and prior to mixing with the receiving waters.
4. The discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to insure accuracy of measurements, or shall insure that both activities will be conducted.
5. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
6. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

REPORTING

1. For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.
2. The discharger shall maintain all sampling and analytical results, including strip charts; date, exact place, and time of sampling; what analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Board.

3. Monitoring reports shall be signed by:

- a. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
- b. In the case of a partnership, by a general partner;
- c. In the case of a sole proprietorship, by the proprietor;
- d. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.

4. Monitoring reports are to include the following:

- a. Name and telephone number of individual who can answer questions about the report.
- b. The Monitoring and Reporting Program Number.