

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 96-216

WASTE DISCHARGE REQUIREMENTS
FOR
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. R.K. Lowe, Owner of Yosemite Pines RV Park (hereafter Discharger) submitted a Report of Waste Discharge, dated 4 March 1995, for the wastewater treatment and disposal facility. The property is owned by R.K. Lowe.
2. Waste Discharge Requirements Order No. 85-313, adopted by the Board on 6 December 1985, prescribes requirements for a discharge from a campground to collection, treatment, and disposal systems located on-site.
3. Order No. 85-313 is neither adequate nor consistent with current plans and policies of the Board.
4. Wastewater treatment and disposal is accomplished via an extended aeration package plant, with discharge to an effluent reservoir. The treatment plant has a design capacity of 22,000 gallons per day (gpd). During the summer treated wastewater is discharged to a spray field. During the winter treated wastewater is discharged to a leachfield.
5. The Discharger discharges approximately 13,000 gpd during April through September, and approximately 2,000 gpd during October through March. The discharge to the treatment plant consists of RV wastes and other domestic wastes. Sludges generated from the treatment process are transported to the Tuolumne Utilities District Regional Wastewater Treatment Plant.
6. Yosemite Pines RV Park is in Section 26, T1S, R16E, MDB&M, with surface water drainage to Garrotte Creek, which is tributary to Pine Mountain Lake, as shown in Attachment A, which is attached hereto and part of the Order by reference.
7. The Board adopted a Water Quality Control Plan, Third Edition, the Sacramento River Basin and the San Joaquin River Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
8. The beneficial uses of Pine Mountain Lake are municipal, industrial, and agricultural supply; recreation; aesthetic enjoyment; navigation; ground water recharge; fresh water replenishment;

WASTE DISCHARGE REQUIREMENTS
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-2-

hydropower generation; and preservation and enhancement of fish, wildlife, and other aquatic resources.

9. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
10. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
11. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4.5, Chapter 11, as a hazardous waste.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 85-313 is rescinded and R.K. Lowe, Owner of Yosemite Pines RV Park, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

WASTE DISCHARGE REQUIREMENTS
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-3-

B. Discharge Specifications:

1. The discharge shall not cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. The effluent from the treatment facility to land irrigation shall not exceed the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	40	80
Settleable Solids	ml/l	0.2	0.5

¹ Five-day, 20° Celsius biochemical oxygen demand.

6. Ponds shall not have a pH less than 6.5 or greater than 8.5.
7. There shall be no standing water in the disposal area 24 hours after wastewater is applied.
8. Ponds shall be managed to prevent breeding of mosquitos. In particular:
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.

WASTE DISCHARGE REQUIREMENTS
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-4-

- c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
9. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
10. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 25 years, distributed monthly in accordance with historical rainfall patterns.
11. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 10.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15, Division 3, Title 23, of the California Code of Regulations and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and disposal of sewage sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landspreading of Sewage Sludge*.

WASTE DISCHARGE REQUIREMENTS
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-5-

5. Within 90 days of the Order's adoption date, the Discharger shall submit a sludge disposal plan describing the annual volume of sludge generated by the plant and specifying the disposal practices.

D. Ground Water Limitations:

The discharge shall not cause underlying ground water to:

1. Be degraded.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
4. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with Monitoring and Reporting Program No. 96-216, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. At least 90 days prior to termination or expiration of any lease, contract, or agreement involving disposal or reclamation areas or off-site reuse of effluent, used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall


WASTE DISCHARGE REQUIREMENTS
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-6-

notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.

5. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
6. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
7. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.
8. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 9 August 1996.

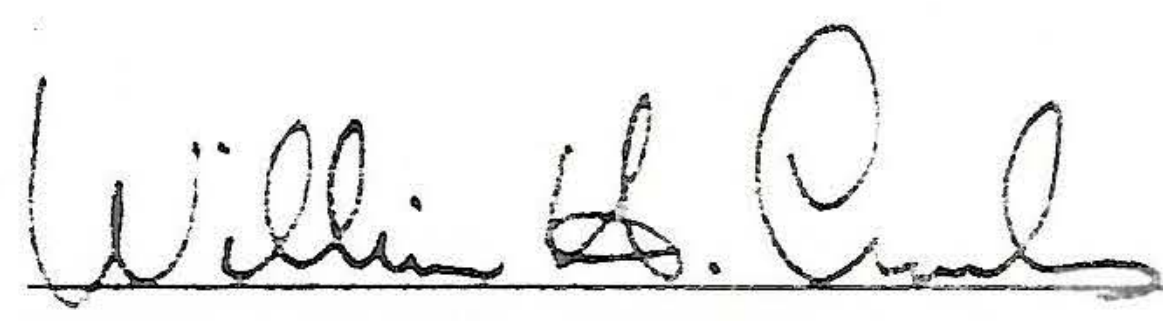
WILLIAM H. CROOKS, Executive Officer

9 August 1996/MRB:dlk

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 96-216

FOR

R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

MONITORING

The Discharger will monitor the ponds and irrigation field, at a minimum, for the following:

1. The weekly documentation of pond freeboard;
2. Daily flows to pond, irrigation field, and leachfield to include date, time and duration of use of irrigation field;
3. The dates and duration of any events relating to septic conditions (brown, grey or black colored water) in the pond. Monitoring shall include weekly dissolved oxygen;
4. The dates and duration of any nuisance odor events; and
5. Any other significant events or changes which may have water quality implications.

Effluent samples shall be collected just prior to discharge to irrigation or leachfield. Effluent samples should be representative of the volume and nature of the discharge. Samples collected from the outlet structure of the pond will be considered adequately composited. Time of collection of a grab sample shall be recorded. Effluent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	Grab	Monthly
Settleable Matter	ml/l	Grab	Monthly
Specific Conductivity	μmhos/cm	Grab	Weekly
pH	pH Units	Grab	Weekly
Formaldehyde	μg/l	Grab	2 x Yearly

SLUDGE MONITORING

A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of an annual report.

MONITORING AND REPORTING PROGRAM
R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

-2-

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.


The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by: William H. Crooks
WILLIAM H. CROOKS, Executive Officer

9 August 1996

(Date)

9 August 1996/MRB:dlk

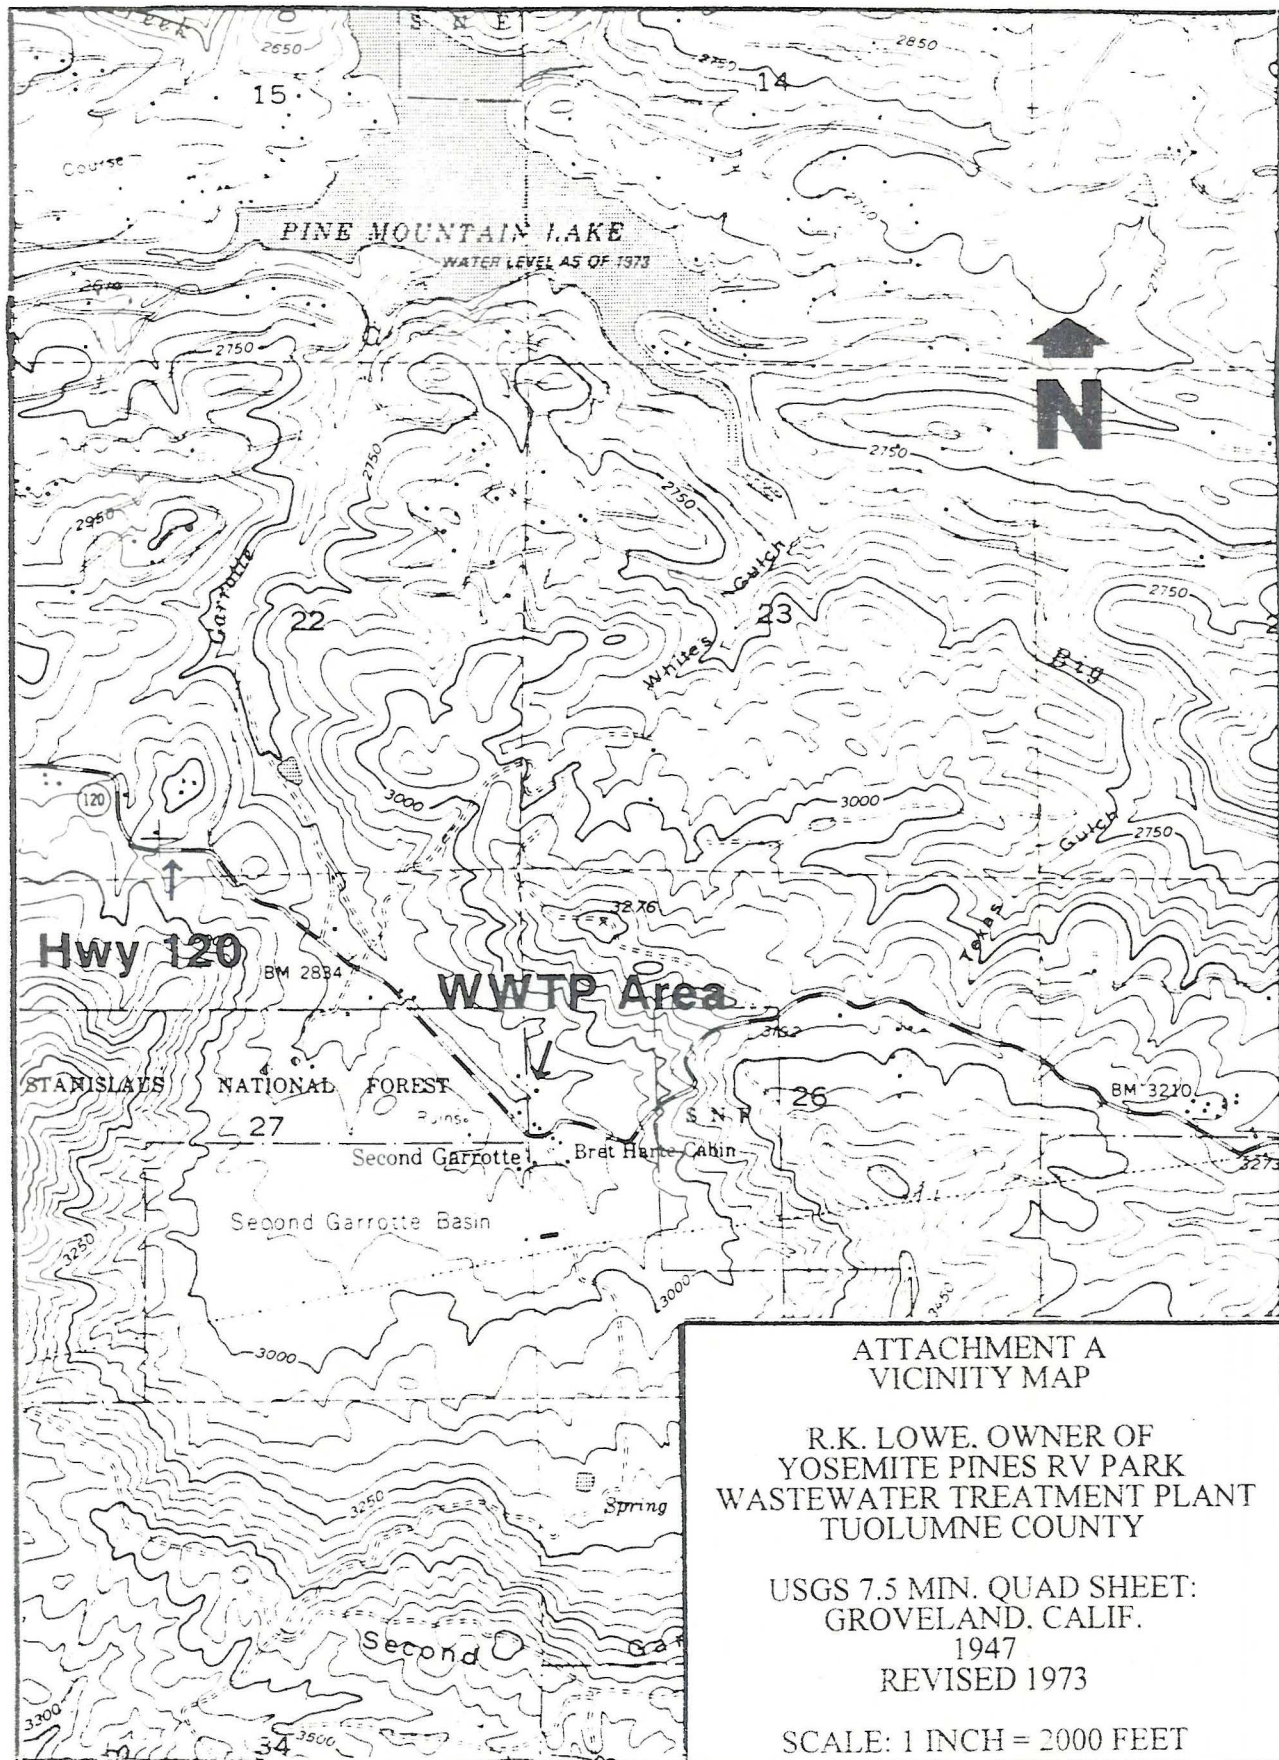

ATTACHMENT A
VICINITY MAP

R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
WASTEWATER TREATMENT PLANT
TUOLUMNE COUNTY

USGS 7.5 MIN. QUAD SHEET:
GROVELAND, CALIF.
1947
REVISED 1973

SCALE: 1 INCH = 2000 FEET

INFORMATION SHEET

R.K. LOWE, OWNER OF
YOSEMITE PINES RV PARK
TUOLUMNE COUNTY

The Dischargers operates a 181 unit campground and Recreation Vehicle (RV) park. The facility is on a 35-acre parcel near Groveland in Tuolumne County.

Wastewater treatment and disposal is accomplished via an extended aeration package plant, with discharge to an effluent reservoir. The treatment plant has a design capacity of 22,000 gallons per day (gpd). During the summer treated wastewater is discharged to a spray field. During the winter treated wastewater is discharged to a leachfield.

The Discharger discharges approximately 13,000 gpd during April through September, and approximately 2,000 gpd during October through March. The discharge to the treatment plant consists of RV wastes and other domestic wastes. Sludges generated from the treatment process are transported to the Tuolumne Utilities District Regional Wastewater Treatment Plant. Surface water drainage is to Garrotte Creek, tributary to Pine Mountain Lake.

9 August 1996/MRB:dlk