

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 93-208

WASTE DISCHARGE REQUIREMENTS

FOR
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY

*previous order
No. 86-212*

76-029

86-212

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Arbuckle Public Utility District (hereafter Discharger) submitted a site evaluation and expansion report, dated January 1991.
2. Waste Discharge Requirements Order No. 86-212, adopted by the Board on 24 October 1986, prescribes requirements for a discharge from the Community of Arbuckle to a primary clarifier and waste stabilization ponds for treatment and disposal.
3. Order No. 86-212 is neither adequate nor consistent with current plans and policies of the Board.
4. The wastewater treatment and disposal facility consists of an influent pump station, emergency storage pond, primary clarifier, evaporation/ percolation ponds, sludge digester and a sludge drying bed.
5. The Discharger currently discharges approximately 0.28 million gallons per day (mgd) average dry weather flow (ADWF) of domestic wastewater to the treatment/disposal facility.
6. The treatment/disposal system ADWF design capacity is 0.5 mgd.
7. The wastewater treatment/disposal facility is in Section 26, T14N, R2W, MDB&M, with surface water drainage to Salt Creek tributary to the Colusa Basin Drainage Canal, as shown in Attachment A, which is attached hereto and part of the Order by reference.
8. The Board adopted a Water Quality Control Plan, Second Edition, for the Sacramento River Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
9. The beneficial uses of the Colusa Basin Drainage Canal are agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water

**WASTE DISCHARGE REQUIREMENTS
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-2-

replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.

10. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
11. The action to update waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA) in accordance with Title 14, California Code of Regulations (CCR), Section 15301.
12. This discharge is exempt from the requirements of Title 23, CCR, Section 2510, et seq. (hereafter Chapter 15). The exemption, pursuant to Section 2511(b), is based on the following:
 - a. The Board is issuing waste discharge requirements, and
 - b. The discharge complies with the Basin Plan, and
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4, Chapter 30, as a hazardous waste.
13. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
14. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 86-212 is rescinded and the Arbuckle Public Utility District, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. By-pass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Chapter 15, is prohibited.

**WASTE DISCHARGE REQUIREMENTS
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-3-

B. Discharge Specifications:

1. The monthly average dry weather discharge flow shall not exceed 0.5 million gallons/day.
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas
3. As a means of discerning compliance with Discharge Specification No. 2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The treatment and disposal facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
5. Ponds shall not have a pH less than 6.5 or greater than 8.5.
6. Ponds shall be managed to prevent breeding of mosquitos. In particular,
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
7. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
8. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than two feet (measured vertically).
9. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification No. 8.

**WASTE DISCHARGE REQUIREMENTS
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-4-

10. Pond levees shall be protected from damage due to burrowing animals.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer at least 90 days in advance of the change.
3. Use and Disposal of sewage sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503. If the State Water Resources Control Board and the Regional Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503, whether or not they have been incorporated into this Order.
4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landscaping of Sewage Sludge*.

D. Ground Water Limitations:

The discharge, in combination with other sources, shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than background water quality.
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in 22 CCR, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.

**WASTE DISCHARGE REQUIREMENTS
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-5-

5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 93-208, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.
4. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
5. The Discharger shall comply with the following time schedule to assure compliance with Ground Water Limitations of this Order:

<u>Task</u>	<u>Compliance Date</u>	<u>Report Due</u>
Submit well design and location Plan for review and approval		1 Apr 94
Begin Construction	14 Oct 94	
Begin Monitoring	18 Nov 94	15 Dec 94


**WASTE DISCHARGE REQUIREMENTS
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-6-

The Discharger shall submit to the Board on or before each compliance report date, a report detailing compliance or noncompliance with the specific schedule date and task. If noncompliance is being reported, the reasons for such noncompliance shall be stated, plus an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Board by letter when it returns to compliance with the time schedule.

6. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
7. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.
8. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 October 1993.

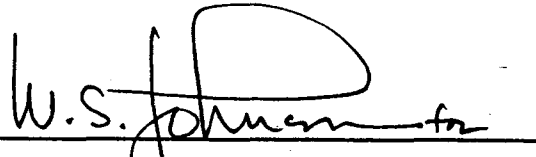
WILLIAM H. CROOKS, Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

**MONITORING AND REPORTING PROGRAM NO. 93-208
FOR**

**ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

Prior to construction, plans and specifications for ground water monitoring wells shall be submitted to Board staff for review and approval.

POND MONITORING

Time of collection of a grab sample shall be recorded. Effluent monitoring shall include at least the following. Pond monitoring shall include at least the following for each pond containing wastewater:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Total Dissolved Oxygen ¹	mg/l	Grab	Monthly
Specific Conductivity	μ mhos/cm	Grab	Monthly
Freeboard	feet/100	Grab	Monthly
pH	pH Units	Grab	Monthly
Odors		Observation	Monthly
Flow (total influent)	mgd	Cumulative	Weekly

¹ Dissolved Oxygen shall be sampled prior to 8:00 a.m. in the upper 1 foot of wastewater in the ponds

SLUDGE MONITORING

A composite sample of sludge shall be collected annually and tested for the following metals:

Arsenic	Copper	Nickel	Zinc
Cadmium	Lead	Molybdenum	
Chromium	Mercury	Selenium	

**MONITORING AND REPORTING PROGRAM
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-2-

A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the municipal water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Electrical Conductivity @ 25°C	μ mhos/cm	Quarterly

GROUND WATER MONITORING

Prior to construction, plans and specifications for ground water monitoring wells (a minimum of three) shall be submitted to Board staff for review and approval

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Electrical Conductivity @ 25°C	μ mhos/cm	Quarterly
pH	pH Units	Quarterly
Total Coliform Organisms	MPN/100 ml	Quarterly
Elevation of Ground Water ¹	feet MSL, measured to nearest 0.01 foot	Quarterly
Nitrates	mg/l	Quarterly

¹ Ground water monitoring shall be used to calculate the gradient and direction of flow.

REPORTING

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

**MONITORING AND REPORTING PROGRAM
ARBUCKLE PUBLIC UTILITY DISTRICT
WASTEWATER TREATMENT PLANT
COLUSA COUNTY**

-3-

Monthly monitoring reports shall be submitted to the Regional Board by the 20th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.


The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered By: W.S. Johnson for

WILLIAM H. CROOKS, Executive Officer

10/29/93


(Date)

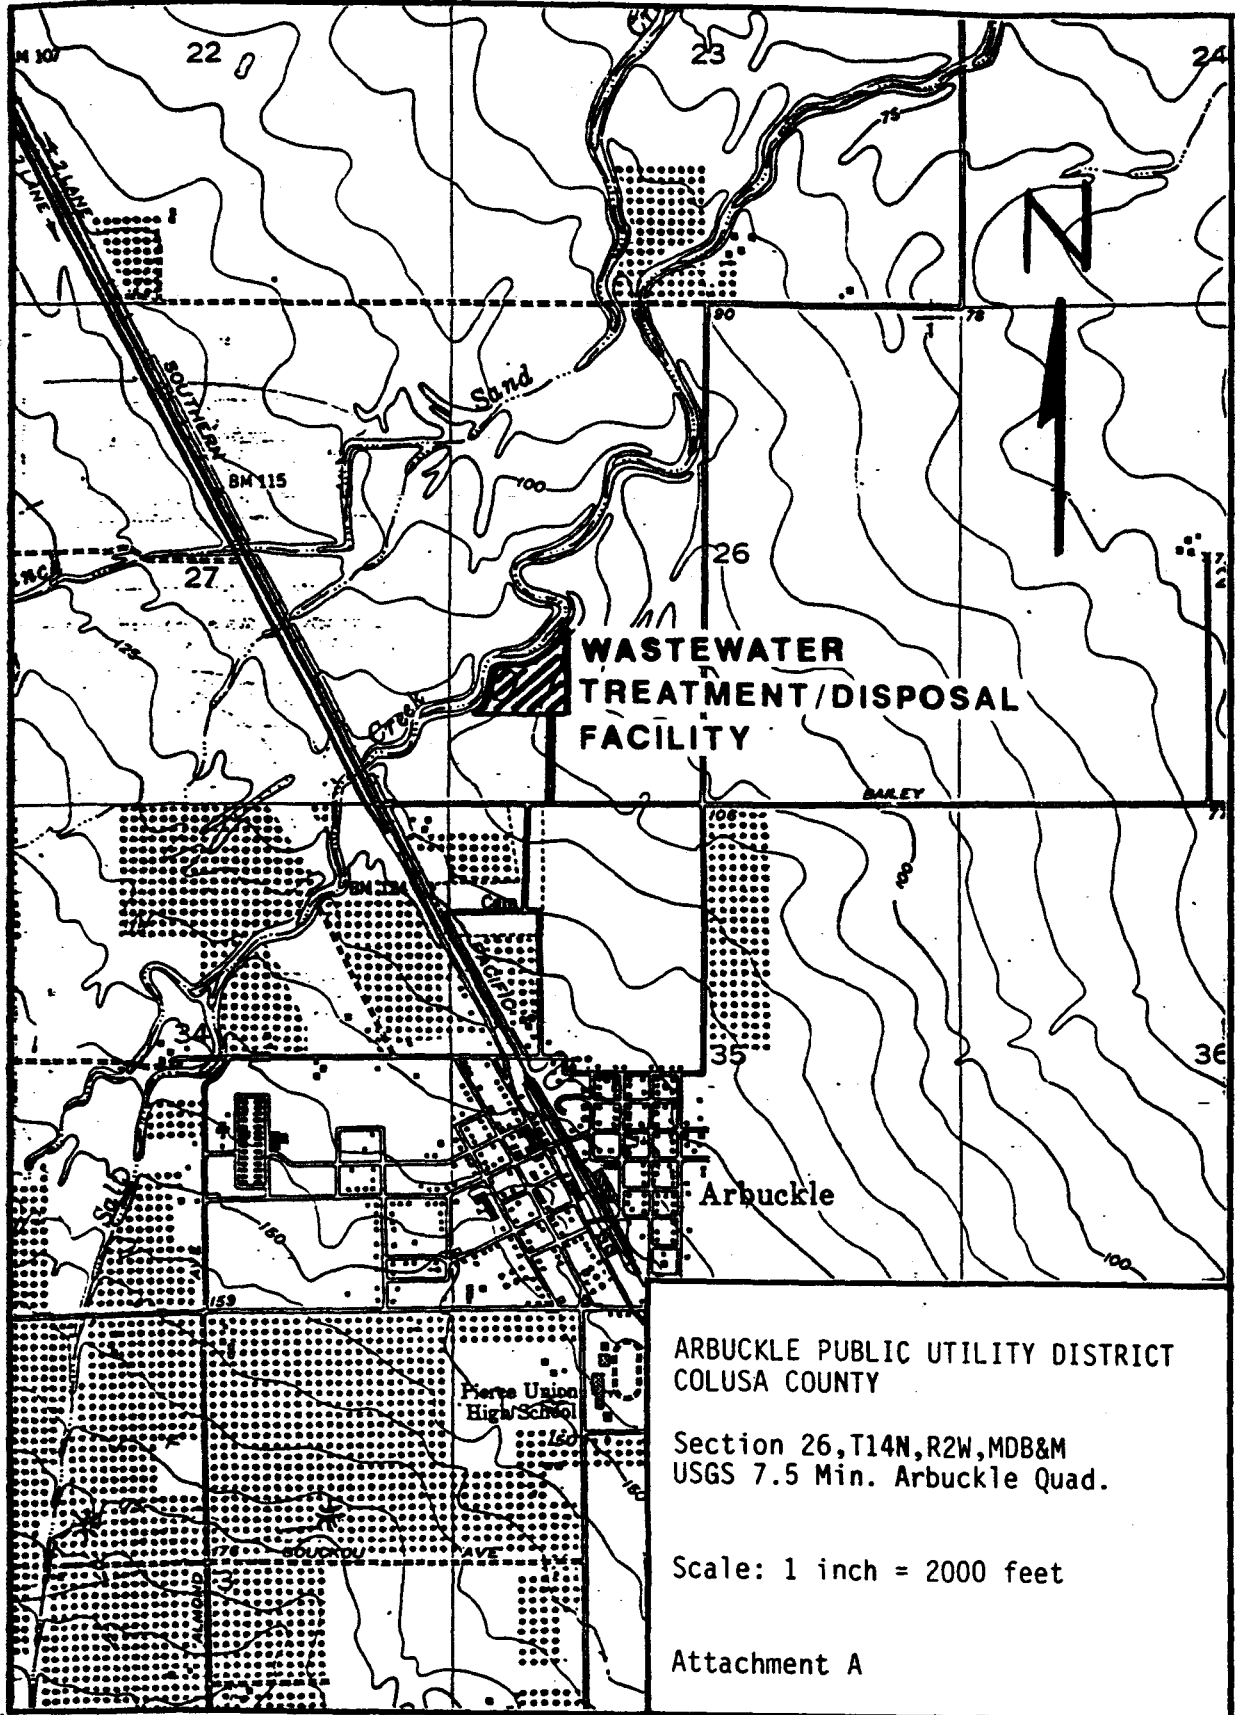

ARBUCKLE PUBLIC UTILITY DISTRICT
COLUSA COUNTY

Section 26, T14N, R2W, MDB&M
USGS 7.5 Min. Arbuckle Quad.

Arbuckle Public Utility District Wastewater Treatment Plant

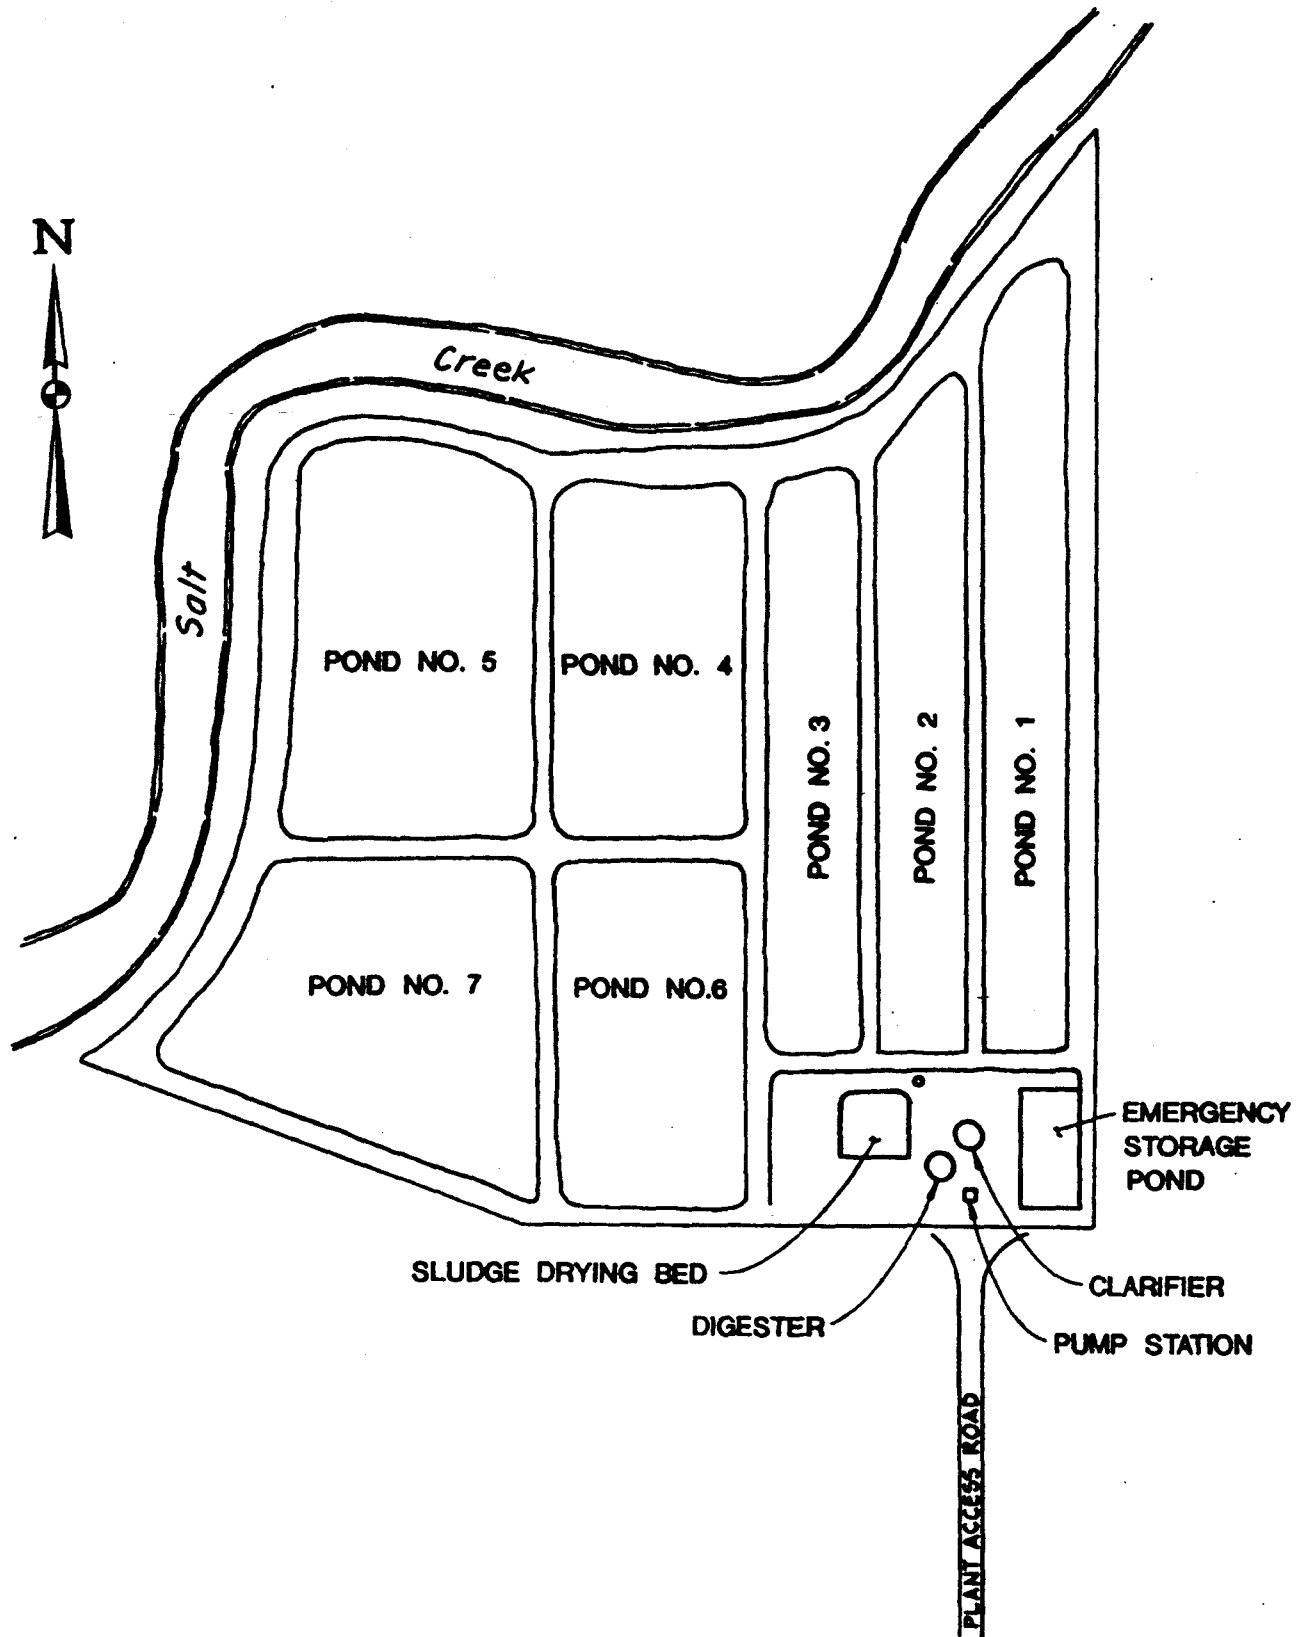

INFORMATION SHEET

ARBUCKLE PUBLIC UTILITY DISTRICT WASTEWATER TREATMENT PLANT COLUSA COUNTY

The Arbuckle Public Utility District's wastewater treatment plant (WWTP) is approximately one mile north of the community between Bailey Road and Salt Creek. The Community of Arbuckle currently generates approximately 0.28 million gallons per day (mgd) of domestic wastewater. The WWTP is designed for treatment and disposal of 0.5 mgd. The treatment and disposal system consists of an influent pump station, emergency storage pond, primary clarifier, evaporation/percolation ponds, sludge digester and a sludge drying bed. The facility has seven evaporation/percolation ponds for treatment and disposal of wastewater. Generally, only one of the seven ponds is used because of a high percolation rate estimated at 250,000 gallons/acre/day. The updated permit includes ground water quality limitations and a ground water monitoring program.