

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 97-133

WASTE DISCHARGE REQUIREMENTS
FOR
MADERA COUNTY MAINTENANCE DISTRICT NO. 27
AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WASTEWATER TREATMENT FACILITY
MADERA COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Madera County Maintenance District No. 27 operates an extended aeration wastewater treatment facility (WWTF) with a design capacity of 0.085 million gallons per day (mgd) in Oakhurst that provides treatment of domestic wastewater from the Goldside Estates subdivision, which includes 146 residential lots (three are vacant). The treated effluent is reclaimed for irrigation of a required greenbelt area within the subdivision that serves as a small 9-hole private golf course. The WWTF property of 1.3 acres (Assessor's Parcel No. 055-520-051) is owned by the County of Madera. The golf course property of 11.4 acres is owned by the Goldside Estates Association (Assessor's Parcel Nos. 055-480-001, 055-182-060, and 055-182-061). The District operates the WWTF and maintains the pond, and the Association operates and maintains the golf course area. Madera County Maintenance District No. 27 and Goldside Estates Association are referred to jointly in this document as Discharger.
2. Waste Discharge Requirements Order No. 72-187, adopted by the Board on 25 February 1972, prescribes requirements for a discharge of 0.085 mgd from the WWTF to the greenbelt/golf course. Current wastewater flows average 0.035 mgd and peak at 0.051 mgd.
3. Order No. 72-187 is not adequate and must be updated to reflect current plans and policies of the Board.
4. The WWTF consists of a steel aeration tank, steel clarifier, and chlorine gas disinfection unit. A pond (or 'effluent storage reservoir') on the golf course area provides storage for treated effluent prior to spray application on the golf course. Golf course irrigation is supplemented with water from a municipal water supply well. Sludge is hauled offsite for land application at a permitted facility.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-2-

5. The WWTF and golf course properties are in Section 7, T7S, R21E, MDB&M, with surface water drainage to the Fresno River, as shown in Attachment A, which is attached hereto and part of this Order by reference. The site lies within the Ahwahnee Hydrologic Unit (No. 539.31), as depicted on interagency hydrologic maps prepared by the Department of Water Resources.
6. Soils beneath the WWTF and golf course properties consist of sands, silts, and clays overlying granitic bedrock at a depth of about 20 feet below ground surface (bgs). Soil percolation rates in the area are variable, depending on location, and are considered rapid to moderately slow. No on-site percolation test data is available.
7. The greenbelt/golf course is surrounded by residential property, and its configuration is such that effluent sprinklers overspray lot lines, in some places reaching within a few feet of houses. Effluent is applied to the golf course between 9 p.m. and 3 a.m. when golfers are not present and residents less likely to be using backyards impacted by overspray. Golf course use is restricted and the on-site storage pond is fenced.
8. The Board adopted a Water Quality Control Plan for the Sacramento River and San Joaquin River Basins, Third Edition (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
9. Groundwater is found in fractured bedrock at varying depths.
10. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
11. The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act (CEQA) in accordance with Section 15301. Compliance with this Order will prevent and mitigate any adverse impacts on water quality.
12. The California Department of Health Services (DHS) has established water reuse criteria in Title 22, CCR, Sections 60301 to 60355 (hereafter Title 22) for use of reclaimed water, and has developed guidelines for specific uses. DHS is revising Title 22 and recommends using the proposed revisions as guidelines. Based on a Memorandum of Understanding with DHS, the Board implements both criteria and guidelines in requirements that regulate discharge of reclaimed (also 'recycled') water.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-3-

13. The Discharger has not submitted an engineering report with a description of the design of the proposed recycling system and the means for compliance with flexibility of design and reliability requirements for producing adequately disinfected, oxidized, coagulated, clarified, and filtered wastewater for the intended reclamation use as specified in Title 22, Section 60323.
14. The existing WWTF, installed as a second-hand facility in the early 1970's, is over 25 years old. It exhibits significant rust damage and deterioration and, according to an engineering assessment, is not repairable and in danger of leaks or collapse. The WWTF is about 100 yards upslope of the Fresno River and potential failure of the facility threatens the river. Further, the facility in its present configuration cannot comply with Title 22 requirements. The Discharger must replace the WWTF forthwith and assure that Title 22 is satisfied in the process. Madera County Maintenance District No. 27 has applied for a State Revolving Loan and Small Community Grant for the proposed WWTF replacement. Due to legal constraints on raising user fees, the Discharger reports that financing will delay completion of the project to 1 July 1998.
15. The permitted discharge is consistent with the antidegradation provisions of State Water Resources Control Board Resolution No. 68-16. The discharge specifications contained in this order require the replacement WWTF to produce a higher quality effluent than is currently produced, and allows no increase in flow. The effect of the discharge on water quality will be insignificant, except as an improvement. In addition, the discharge is a beneficial reuse of wastewater and reduces the demand on ground water for irrigation of the greenbelt/golf course area.
16. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
17. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 72-187 is rescinded and Madera County Maintenance District No. 27 and Goldside Estates Association, their agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-4-

A. Discharge Prohibitions

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Discharge of untreated or partially treated waste is prohibited.
3. The bypass or overflow of wastes from the WWTF is prohibited, except as allowed by Standard Provision E.2.
4. The discharge of waste classified as 'hazardous' or 'designated', as defined in Sections 2521(a) and 2522(a) of Title 23, California Code of Regulations, Sections 2510, et seq. (hereafter Chapter 15) is prohibited.

B. Discharge Specifications

1. The monthly average daily discharge shall not exceed 0.055 mgd.
2. Objectionable odors originating at this WWTF shall not be perceivable beyond the limits of the WWTF property.
3. The dissolved oxygen content in the upper zone (1 foot) of wastewater in the effluent storage reservoir shall not be less than 1.0 mg/l.
4. Until **1 July 1998**, the discharge from the treatment facility shall not exceed the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	30	60
Total Suspended Solids	mg/l	30	60
Settleable Solids	ml/l	0.2	1.0

¹ 5-day, 20 °C Biochemical Oxygen Demand.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-5-

5. Until **1 July 1998**, the median number of total coliform organisms shall be less than 23 MPN (most probable number) per 100 ml, as determined from the bacteriological results of the last seven days for which analyses have been completed, and the daily maximum number of coliform organisms shall not exceed 500 MPN/100 ml.
6. Effective **1 July 1998**, the discharge shall be at all times an adequately disinfected, oxidized, coagulated, and filtered wastewater as specified in Section 60313 (b) of Title 22 and shall not exceed the following limits:

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	10	30
Total Suspended Solids	mg/l	10	30
Settleable Solids	ml/l	0.1	0.2

¹ 5-day, 20 °C Biochemical Oxygen Demand.

7. Effective **1 July 1998**, the CT value (the product of the chlorine residual, in mg/l, times the modal contact time, in minutes) shall equal or exceed 300. The modal chlorine contact time at peak daily design flow shall equal or exceed 90 minutes.
8. Effective **1 July 1998**, the turbidity of the discharge shall not exceed the following:

<u>Units</u>	<u>Daily Average</u>	<u>95% Percentile</u>	<u>Instantaneous Maximum</u>
NTU	2	5	10

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-6-

9. Effective **1 July 1998**, the median number of total coliform organisms shall be less than 2.2 MPN (most probable number) per 100 ml, as determined from the bacteriological results of the last seven days for which analyses have been completed, and the daily maximum number of coliform organisms shall not exceed 23 MPN/100 ml. The number of total coliform bacteria shall not exceed an MPN of 23 per 100 ml in more than one sample in any 30-day period.
10. The discharge shall not have a pH less than 6.0 or greater than 9.0.
11. The Specific Electrical Conductance at 25° C, (also abbreviated as EC) of the discharge shall not exceed the average EC of the source water plus 500 μ mhos/cm.
12. Public contact with untreated wastewater at the WWTF shall be precluded through such means as fences and signs, or alternatives acceptable to health authorities.
13. The WWTF shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
14. Freeboard in the effluent storage reservoir shall never be less than two feet.
15. The effluent storage reservoir shall remain fenced to preclude public access.

C. Sludge Disposal Specifications

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Chapter 15 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice shall be reported to the Executive Officer **at least 90 days in advance** of the change.
3. Use and disposal of sewage sludge shall comply with State laws and regulations.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-7-

If the State Water Resources Control Board and the Regional Water Quality Control Boards ever implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. In the interim, the Discharger is accountable to the US EPA for permitting requirements and technical standards included in 40 CFR 503.

D. Recycled Water Specifications

1. The use of recycled water shall be limited to irrigation of the Goldside Estates golf course, and to construction use.
2. Recycled water used for irrigation shall be managed to minimize erosion, runoff, and movement of aerosols from the irrigation area.
3. Direct or windblown spray shall be confined to the golf course and prevented from contacting drinking water facilities, food handling facilities, and private structures.
4. Recycled water shall be applied at rates reasonable for the maintenance of turf and associated plants.
5. Workers involved in reuse activities shall be informed of the potential health hazards involved with contact or ingestion of recycled water, and should be educated regarding proper hygienic procedures to protect themselves and their families.
6. By 1 July 1997, recycled water controllers, valves, etc., shall be affixed with recycled water warning signs, and these and quick couplers and sprinkler heads shall be of a type, or secured in a manner, that permits operation by authorized personnel only. The recycled water piping system shall not include any hose bibs.
7. By 1 July 1997, no physical connection shall exist between recycled water piping and domestic water supply piping.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-8-

8. By 1 July 1997, an adequate number of conspicuous signs shall be posted at the golf course and effluent storage pond in a size no less than 4 inches by 8 inches that include the following wording, "Reclaimed Water - Do Not Drink" or "Recycled Water - Do Not Drink." Each sign shall display the international symbol shown on Attachment B.
9. The replacement WWTF shall be designed, constructed, and maintained with effective alarms, power reliability features, and treatment reliability features pursuant to and defined by Title 22, Sections 60333 through 60355.
10. Recycled water application shall be restricted to nocturnal hours between 9 p.m. and 5 a.m.

E. Ground Water Limitations

The discharge, in combination with other sources, shall not cause underlying ground water to contain waste constituents in concentrations statistically greater than background water quality.

F. Provisions

1. The Discharger shall comply with Monitoring and Reporting Program No. 97-133, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with all items of the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision (s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-9-

To assume operation under this Order, the succeeding owner or operator must apply in writing to the Executive Officer requesting transfer of the Order. The request must contain the requesting entity's full legal name, the State of incorporation if a corporation, the name and address and telephone number of the persons responsible for contact with the Board, and a statement. The statement shall comply with the signatory paragraph of Standard Provision B.3 and state that the new owner or operator assumes full responsibility for compliance with this Order. Failure to submit the request shall be considered a discharge without requirements, a violation of the California Water Code. Transfer shall be approved or disapproved by the Executive Officer.

4. By **1 July 1998**, the Discharger shall submit a technical report that certifies that the WWTF was constructed, designed, and ready to operate in full compliance with the terms of this Order. The report shall be prepared and signed by a California registered civil engineer experienced in wastewater treatment and disposal. The report shall be approved or disapproved by the Executive Officer.
5. By **1 July 1998**, the Discharger shall submit a copy of the operation and maintenance manual for the WWTF. The Operation and Maintenance Manual shall be prepared under the supervision of a California registered civil engineer and include descriptions of complete operational procedures for the WWTF, effluent storage reservoir, and golf course irrigation that assure compliance with Title 22 and this Order. Further, the operation and maintenance manual must address the items in Standard Provision B.2.
6. By **15 September 1997**, the Discharger shall submit a technical report demonstrating how it proposes to comply with Sludge Disposal Specifications C.1 and C.3. Unless sludge is transported to a properly permitted facility, the report shall be prepared and signed by a California registered civil engineer experienced in wastewater treatment and disposal.
7. The Discharger shall use the best practicable control technique currently available to comply with this Order.
8. If recycled water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes." Other uses of recycled water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with Title 22.

WASTE DISCHARGE REQUIREMENTS
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-10-

9. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
10. A copy of this Order shall be kept at the WWTF for reference by operating personnel. Key operating personnel shall be familiar with its contents.
11. The Board will review this Order periodically and will revise requirements when necessary.
12. Application of commercial fertilizers shall consider nutrients applied through recycled water and not exceed the nutrient needs of the turf and plants.
13. The WWTF shall be staffed with a sufficient number of qualified personnel to operate the WWTF effectively, where qualified personnel shall be determined by Standard Provision E. 1.
14. In addition to Standard Provision A.3, this Order may be modified (after notice and opportunity for hearing) to reflect future revisions to Title 22 that differ significantly from those implemented in this Order.
15. The Discharger shall not allow pollutant-free wastewater to be discharged into the collection system and WWTF in amounts that significantly diminish the system's capability to comply with this Order. Pollutant-free wastewater means rainfall, ground water, cooling waters, and condensates that without treatment are essentially free of pollutants.

I, GARY M. CARLTON, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 20 June 1997.


GARY M. CARLTON, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 97-133

FOR

MADERA COUNTY MAINTENANCE DISTRICT NO. 27

AND

GOLDSIDE ESTATES ASSOCIATION

GOLDSIDE ESTATES WASTEWATER TREATMENT FACILITY

MADERA COUNTY

INFLUENT MONITORING

Influent samples shall be collected at the inlet of the headworks and at approximately the same time as effluent samples. Influent monitoring shall include at least the following:

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
BOD ₅ ¹	mg/l	Grab	Weekly
Total Suspended Solids	mg/l	Grab	Weekly
Settleable Solids	ml/l	Grab	Weekly

¹ Five-day, 20° Celsius biochemical oxygen demand.

EFFLUENT MONITORING

Except for flow, which may be measured either at the headworks or the outlet from the treatment system, effluent samples shall be collected just prior to discharge for reclamation. Effluent samples should be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded.

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency¹</u>
Flow	mgd	Metered	Continuous
BOD ₅ ^{2,3}	mg/l	Grab	Weekly
Total Suspended Solids	mg/l	Grab	Weekly
Settleable Solids	ml/l	Grab	Weekly
Conductivity	μmhos/cm	Grab	Weekly
pH	pH Units	Grab	Weekly
Turbidity	NTU	Metered	Continuous ⁴

MONITORING AND REPORTING PROGRAM
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-2-

<u>Constituent</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency¹</u>
Total Coliform Organisms ³	MPN ⁵ /100 ml	Grab	Weekly ⁶ , Daily ⁷
CT Value	mg - minutes/l	Calculated	Daily ⁸

¹ If results of monitoring a pollutant appear to violate effluent limitations, but monitoring frequency is not sufficient to validate violation (e.g., the monthly average for BOD), or indicate a violation and potential upset of the treatment process (e.g, less than minimum D.O.), the frequency of sampling shall be increased to confirm the magnitude and duration of violation, if any, and aid in identification and resolution of the problem.

² Five-day, 20° Celsius biochemical oxygen demand.

³ BOD₅ and total coliform organisms samples shall be dechlorinated immediately following sample collection as part of sample collection procedures.

⁴ Effective 1 July 1998 effluent shall be sampled for turbidity using a continuous turbidity meter and recorder at a point prior to filtration and again following filtration. Turbidity measurements shall be based on a reading and recording of the turbidity charts or computer records at four-hour intervals. Compliance with the daily average operating turbidity shall be determined by averaging the results of all six four-hour turbidity samples read during the day.

⁵ Most Probable Number.

⁶ Prior to 1 July 1998 effluent shall be sampled for total coliform organisms weekly.

⁷ Effective 1 July 1998 effluent shall be sampled for total coliform organisms daily.

⁸ Effective 1 July 1998 the CT value shall be calculated and recorded based on conditions at the time of peak daily flow.

MONITORING AND REPORTING PROGRAM
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-3-

STORAGE RESERVOIR MONITORING

The freeboard shall be monitored in each effluent storage reservoir to the nearest tenth of a foot. Storage reservoir water monitoring shall include the following:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Frequency</u>
Freeboard	feet	Measurement	Weekly

SLUDGE MONITORING

When sludge is removed from the treatment units, but prior to disposal, a composite sample of sludge shall be analyzed, on a dry weight basis, for Total Solids (%), Nitrogen (total, NH₄-N, and NO₃-N), Total Phosphorous, Total Potassium, and totals of specific metals (Pb, Zn, Cu, Ni, Cd, and Ag). Analytical results shall be submitted to the Executive Officer. Analysis of soluble concentrations of these specific metals shall also be included as needed. Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report. Additional sludge sampling may be requested at subsequent intervals, depending upon review of analytical results.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the water supply can be obtained. Water supply monitoring shall include at least the following:

<u>Constituent</u>	<u>Unit</u>	<u>Sample Frequency</u>
Conductivity	μmhos/cm	Quarterly

If the source water is from more than one well, the Conductivity shall be reported as a weighted average and include copies of supporting calculations.

MONITORING AND REPORTING PROGRAM
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-4-

REPORTING

Monthly monitoring reports shall be submitted to the Board by the **20th day of the month** following sample collection. Quarterly and annual monitoring results shall be submitted by the **20th day of the month** following each calendar quarter and year, respectively.

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly whether the discharge complies with waste discharge requirements.

If the Discharger monitors any pollutant at the locations designated herein more frequently than is required by this Order, the results of such monitoring shall be included in the calculation and reporting of the values required in the discharge monitoring report form. Such increased frequency shall be indicated on the discharge monitoring report form.

The Discharger may also be requested to submit an annual report to the Board with tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

By **31 January of each year**, the Discharger shall submit a written report to the Executive Officer containing the following:

- a. The names, titles, certificate grades, and general responsibilities of persons operating and maintaining the wastewater treatment plant.
- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
- c. A certified statement of when the flow meter and other monitoring instruments and devices were last calibrated, including identification of who did the calibration (Standard Provision C.4).

MONITORING AND REPORTING PROGRAM
MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-5-

- d. A statement whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last reviewed for adequacy.
- e. The total quantity of sludge disposed of during the previous year and ultimate disposal site(s).

All reports submitted in response to this Order shall comply with the signatory requirements in Standard Provision B.3.

The Discharger shall implement the above monitoring program on the first day of the month following the effective date of this Order.


Ordered by:


GARY M. CARLTON, Executive Officer

20 June 1997

(Date)

LML:lml/fmc:6/20/97

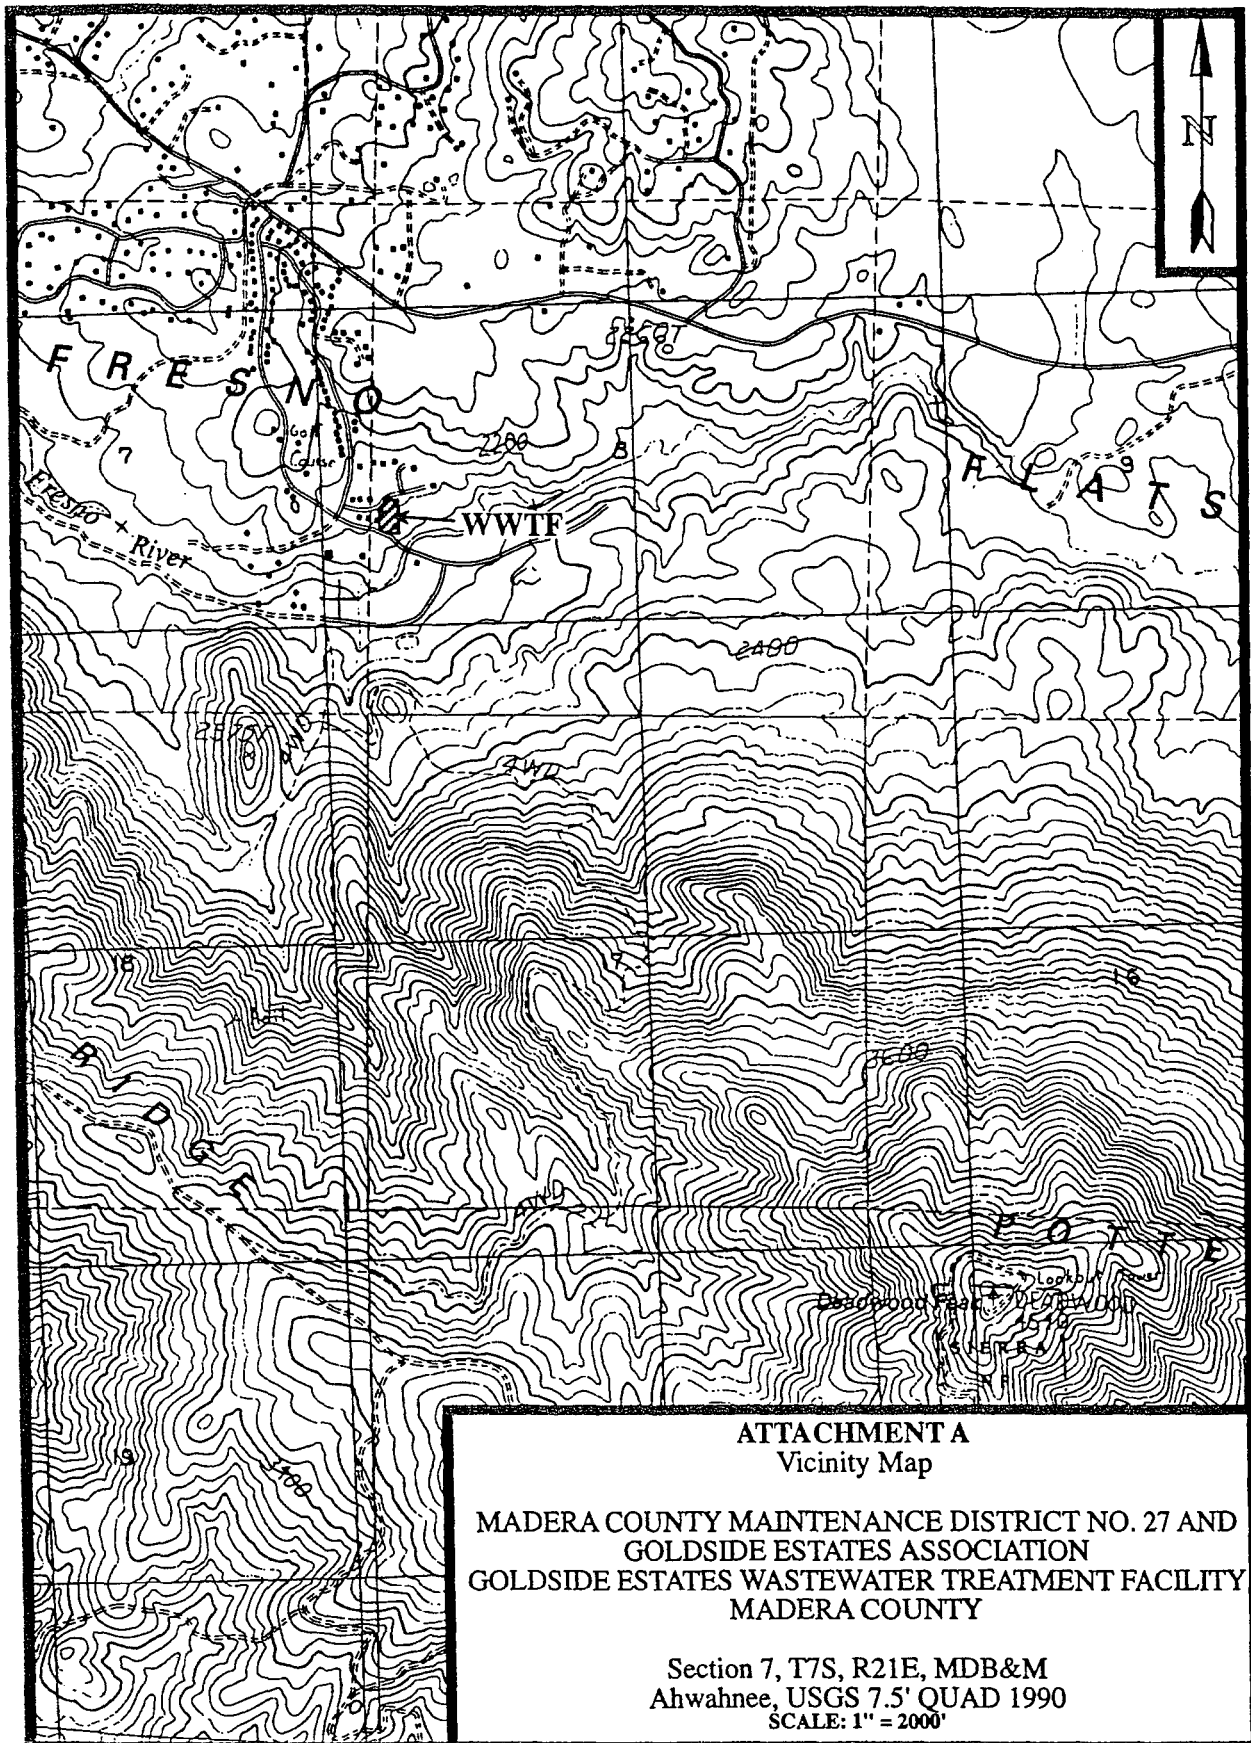

ATTACHMENT A
Vicinity Map

**MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WASTEWATER TREATMENT FACILITY
MADERA COUNTY**

Section 7, T7S, R21E, MDB&M
Ahwahnee, USGS 7.5' QUAD 1990
SCALE: 1" = 2000'



INFORMATION SHEET

MADERA COUNTY MAINTNEANCE DISTRICT NO. 27 AND GOLDSIDE ESTATES ASSOCIATION GOLDSIDE ESTATES WASTEWATER TREATMENT FACILITY MADERA COUNTY

Madera County Maintenance District No. 27 operates an extended aeration wastewater treatment facility (WWTF) with a design capacity of 0.085 million gallons per day (mgd) in Oakhurst that provides treatment of domestic wastewater from the Goldside Estates subdivision consisting of 143 residential lots. The treated effluent is reclaimed 'also recycled' for irrigation of the Goldside Estates golf course.

The WWTF consists of an aeration tank, clarifier and chlorine gas disinfection facilities. A pond on the golf course provides storage for treated effluent, prior to its spray application to the golf course. Golf course irrigation is supplemented with water from a municipal water supply well. Sludge is hauled off-site for land application at a permitted facility.

The existing WWTF, installed in the early 1970s, is deteriorated and the Discharger must replace it. Madera County Maintenance District No. 27 has applied for a State Revolving Loan and Small Community Grant for the proposed WWTF replacement.

The golf course is situated between residences with effluent spray extending beyond lot lines, sometimes within a few feet of houses. Effluent is applied to the golf course only in the evening when golfers are not present. The golf course is not fenced to preclude access, but the storage pond is.

The California Department of Health Services has established statewide reclamation criteria in Title 22, CCR, Section 60301, et seq. (hereafter Title 22) for use of reclaimed water, and has developed guidelines for specific uses. The Board consulted with the Department in developing appropriate conditions for this Order. The proposed Order requires full compliance with appropriate discharge specifications for use of recycled water by 1 July 1998, providing the Discharger with limited time to obtain funding, and complete design and construction of the placement WWTF. Interim discharge specifications apply to the discharge until 1 July 1998.

Soils on the WWTF and golf course properties consist of sands, silts, and clays overlying granitic bedrock encountered at a depth of about 20 feet ground surface (bgs). Soil percolation rates in the area are variable depending on location and are considered rapid to moderately slow. No on-site percolation test data is available.

INFORMATION SHEET - Continued

MADERA COUNTY MAINTENANCE DISTRICT NO. 27 AND
GOLDSIDE ESTATES ASSOCIATION
GOLDSIDE ESTATES WWTF
MADERA COUNTY

-2-

The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply. Groundwater is found in fractured bedrock at varying depths.

Average annual precipitation in the area is approximately 32 inches and average annual evaporation is roughly 40 inches.

Surface water drainage is to the Fresno River, by sheet flow. The beneficial uses of the Fresno River are municipal and domestic supply, agricultural supply; water contact and non contact water recreation; warm and cold fresh water habitat; and wildlife habitat.

The action to adopt waste discharge requirements for this existing facility is exempt from the provisions of the California Environmental Quality Act (CEQA) in accordance with Section 15301. Compliance with Order will prevent and mitigate any adverse impacts on water quality.

LML:lml/fmc:6/20/97