

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 94-224

WASTE DISCHARGE REQUIREMENTS
FOR
TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The Tejon Ranchcorp (hereafter Discharger), a California corporation, submitted a Report of Waste Discharge, dated 2 May 1991, and additional information in a letter report, dated 11 August 1993, in support of an increase in the discharge rate and a facility name change in the waste discharge requirements.
2. Waste Discharge Requirements (WDRs) Order No. 76-140, adopted by the Board on 25 June 1976, prescribes requirements for a monthly average discharge of 22,000 gallons per day (gpd) of domestic wastewater from Wm Flagg's Restaurant to a three pond, stabilization-evaporation system.
3. The wastewater treatment facility (WWTF) treats domestic wastewater produced from a commercial development approximately 0.25 mile northeast of the interchange on Interstate I-5 at Grapevine. The Discharger has an existing C2PD Zone of 87 acres, which presently contains three restaurants, two service stations, and a car wash. The Discharger plans to add a hotel, fast food restaurants, and more service stations, increasing the discharge to 235,000 gpd.
4. The WWTF consists of a flowmeter, Parshall flume, and three unlined disposal ponds. One of the disposal ponds is divided into four smaller cells. The Discharger uses only one of the four cells for the current discharge. Monthly monitoring reports indicated the discharge rate for the last six months of 1993 averaged 52,000 gpd. Existing wastewater infiltrates and evaporates within this one cell. Soil studies submitted by the Discharger indicate the percolation rate of the disposal ponds is approximately 127.5 acre-feet per acre per day. The total bottom and water surface areas of the disposal ponds are 4.95 and 6.62 acre (2.00 and 2.68 ha), respectively.
5. The Discharger states that the treatment facilities have been designed and constructed to prevent inundation or washout due to floods with a 100-year return. The Discharger also states that the ponds have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation.
6. The WWTF is in the NE 1/4 of the SW 1/4 of Section 17, T10N, R19W, SBB&M, with surface water drainage to Grapevine Creek, as shown in Attachment A, which is

WASTE DISCHARGE REQUIREMENTS
TEJON RANCHCORP
TEJON - GRAPEVINE
KERN COUNTY

-2-

attached hereto and part of this Order by reference. The site lies within the Arvin-Wheeler Ridge hydrologic area (No. 557.30), as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.

7. The Board adopted a Water Quality Control Plan for the Tulare Lake Basin (hereafter Basin Plan), which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
8. The beneficial uses of Grapevine Creek, a valley floor water, as identified in the Basin Plan, include agricultural supply; water contact and non-contact water recreation; warm water habitat; wildlife habitat; preservation of rare and endangered species; and ground water recharge.
9. The Basin Plan requires that each Report of Waste Discharge for land disposal justify why reclamation is not practiced or proposed. The Discharger has not evaluated opportunities for reclamation.
10. Wells in the area indicate ground water at an approximate depth of 1000 feet below the ground surface. The electrical conductivities of ground water range from 700 to 1000 $\mu\text{mhos/cm}$. Ground water flows northerly.
11. The water is supplied by an artesian well owned by the Discharger 5 1/2 miles south of the WWTF.
12. The beneficial uses of underlying ground water are domestic, industrial, and agricultural supply.
13. Kern County adopted a mitigated negative declaration on 10 January 1991 in accordance with the California Environmental Quality Act (CEQA)(Public Resources Code Section 21000, et seq.), and the State CEQA Guidelines. The Board has reviewed the mitigated negative declaration and concurs there are no significant impacts on water quality if the project as approved is operated in accordance with this Order.
14. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
15. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

**WASTE DISCHARGE REQUIREMENTS
TEJON RANCHCORP
TEJON - GRAPEVINE
KERN COUNTY**

-3-

IT IS HEREBY ORDERED that Order No. 76-140 is rescinded and the Tejon Ranchcorp, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous' or 'designated', as defined in Title 23, California Code of Regulation (CCR), Sections 2521(a) and 2522(a), is prohibited.

B. Discharge Specifications:

1. The monthly average discharge shall not exceed 0.235 million gallons per day (mgd).
2. Objectionable odors originating at this facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas.
3. As a means of discerning compliance with Discharge Specification No. B.2, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
4. The electrical conductivity (EC) of the discharge shall not exceed the average EC of the source water plus 500 μ mhos/cm.
5. Ponds shall not have a pH less than 6.5 or greater than 8.5.
6. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
7. Ponds shall be managed to prevent breeding of mosquitos. In particular:

**WASTE DISCHARGE REQUIREMENTS
TEJON RANCH CORP
TEJON - GRAPEVINE
KERN COUNTY**

-4-

- a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
8. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
 9. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the non-irrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than two feet (measured vertically).
 10. On or about 1 October of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification B.9.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Title 23, CCR, Section 2510 et seq., (Chapter 15) and approved by the Executive Officer.
2. Any proposed change in previously approved sludge use or disposal practice shall be reported to the Executive Officer at least 90 days in advance of the change.
3. Use and disposal of sewage sludge shall comply with existing federal and state laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Board are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards.

**WASTE DISCHARGE REQUIREMENTS
TEJON RANCHCORP
TEJON - GRAPEVINE
KERN COUNTY**

-5-

D. Ground Water Limitations:

The discharge, in combination with other sources, shall not cause underlying ground water to:

1. Contain waste constituents in concentrations statistically greater than receiving water limits, where specified below, or background water quality where not specified. (For purposes of comparison, background water quality shall be determined when background monitoring provides sufficient data. Quality determined in this manner establishes "water quality protection standards.")
2. Contain chemicals, heavy metals, or trace elements in concentrations that adversely affect beneficial uses or exceed maximum contaminant levels specified in the California Code of Regulations, Title 22, Division 4, Chapter 15.
3. Exceed a most probable number of total coliform organisms of 2.2/100 ml over any seven-day period.
4. Exceed concentrations of radionuclides specified in 22 CCR, Division 4, Chapter 15.
5. Contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.
6. Contain concentrations of chemical constituents in amounts that adversely affect agricultural use.

E. Provisions:

1. The Discharger shall comply with Monitoring and Reporting Program No. 94-224, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements," dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.

WASTE DISCHARGE REQUIREMENTS
TEJON RANCHCORP
TEJON - GRAPEVINE
KERN COUNTY

-6-

To assume operation under this Order, the succeeding owner or operator must apply in writing to the Executive Officer requesting transfer of the Order. The request must contain the requesting entity's full legal name, the State of incorporation if a corporation, the name and address and telephone number of the persons responsible for contact with the Board, and a statement. The statement shall comply with the signatory paragraph of Standard Provision B.3 and state that the new owner or operator assumes full responsibility for compliance with this Order. Failure to submit the request shall be considered a discharge without requirements, a violation of the California Water Code. Transfer shall be approved or disapproved by the Executive Officer.

4. The Discharger shall use the best practicable cost-effective control technique currently available to comply with salinity limits specified in this order.
5. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
6. A copy of this Order shall be kept at the WWTF for reference by operating personnel. Key operating personnel shall be familiar with its contents.
7. The Discharger shall evaluate opportunities for reclamation, and by (1 year) provide a report to the Board that summarizes the reclamation opportunities evaluated and either justifies why reclamation is not practical or provides a time schedule for implementing reclamation.
8. The Board will review this Order periodically and will revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 5 August 1994.


WILLIAM H. CROOKS, Executive Officer

AMV:cjs: 8/5/94

Enclosures

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 94-224

FOR
TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

Specific sample station locations shall be established with concurrence of the Board's staff, and a description of the stations shall be submitted to Board and attached to this Program.

EFFLUENT MONITORING

Flow may be measured at the point of discharge to the ponds. Effluent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency¹</u>
Flow Rate	gpd	Metered	Continuous
Dissolved Oxygen ²	mg/l	Grab	Weekly
Electrical Conductivity	μmhos/cm	Grab	Quarterly
pH	pH units	Grab	Monthly

¹ If results of monitoring a pollutant appear to violate effluent limitations, but monitoring frequency is not sufficient to validate violation (e.g., the monthly average for BOD), or indicate a violation and potential upset of the treatment process (e.g., less than minimum D.O.), the frequency of sampling shall be increased to confirm the magnitude and duration of violation, if any, and aid in identification and resolution of the problem.

² When the ponds is over one foot deep, samples shall be collected at a depth of one foot below the surface from each pond, at the side farthest from the inlet, and analyzed for dissolved oxygen. Samples shall be collected between 0800 and 0900 hours.

SLUDGE MONITORING

When sludge is removed from ponds, but prior to disposal, a composite sample shall be analyzed, on a dry weight basis, for Total Solids (%), Nitrogen (total, NH₄-N, and NO₃-N), Total Phosphorous, Total Potassium, Total PCBs, and totals of specific metals (Pb, Zn, Cu,

MONITORING AND REPORTING PROGRAM
TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

-2-

Ni, Cd, and Ag). Analytical results shall be submitted to the Executive Officer. Analysis of soluble concentrations of these specific metals shall also be included as needed. If final disposal is proposed to go to land, a technical report analyzing application rates and procedures relative to Department of Health Services' *Manual of Good Practices for Landspreading of Sewage Sludge* and EPA's *Process Design Manual for Land Application of Municipal Sludges* and Title 23, California Code of Regulations, Section 2511(f), shall be completed and submitted to the Executive Officer for approval. The report shall be prepared by a California registered civil engineer experienced in wastewater treatment and disposal.

Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the annual report.

POND MONITORING

The freeboard shall be monitored on the evaporation/percolation ponds in use to the nearest tenth foot. Pond water monitoring shall include the following:

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Freeboard	feet	Observation	Weekly

Permanent markers shall be placed in the pond with calibration indicating the water level at design capacity and available operational freeboard.

In addition, the Discharger shall inspect the condition of the ponds once per week and write visual observations in a bound log book. Notations shall include observations of: (1) weed growth and their location; (2) accumulation of dead algae, vegetation, scum, or debris and their location; (3) burrowing animals or insects; and (4) the color of the pond (e.g., dark sparkling green, dull green, yellow, grey, tan, brown, etc.). A copy of the entries made in the log during each month shall be submitted along with the monitoring report the following month. Where the O&M manual indicates remedial action is necessary, the Discharger shall briefly explain in the transmittal what action has been taken or is scheduled to be taken.

WATER SUPPLY MONITORING

A sampling station shall be established where a representative sample of the water supply can be obtained. ¹Water supply monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Sampling Frequency</u>
Electrical Conductivity @ 25°C	μ mhos/cm	Quarterly ²

¹ If the source water is from more than one well, the EC shall be reported as a weighted average and include copies of supporting calculations.

² If water quality is proved to be consistent, sampling frequency may be revised to annual.

REPORTING

Monthly monitoring reports shall be submitted to the Board by the 20th day of the following month.

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner that illustrates clearly whether the Discharger complies with waste discharge requirements, including calculation of all averages, etc.

If the Discharger monitors any pollutant at the locations designated herein more frequently than is required by this Order, the results of such monitoring shall be included in the discharge monitoring report.

The Discharger may also be requested to submit an annual report to the Board with tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

By 31 January of each year, the Discharger shall submit a written report to the Executive Officer containing the following:

MONITORING AND REPORTING PROGRAM
TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

-4-

- a. The names, titles, certificate grade (if any) and general responsibilities of persons operating and maintaining the wastewater treatment plant.
- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
- c. A certified statement of when the flow meter and other monitoring instruments and devices were last calibrated, including identification of who did the calibration (Standard Provision C.4).
- d. A statement whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates these documents were last reviewed for adequacy.
- e. The total quantity of sludge disposed of during the previous year and ultimate disposal site(s).

All reports submitted in response to this Order shall comply with the signatory requirements in Standard Provision B.3.


The Discharger shall implement the above monitoring program on the first day of the month following adoption of this Order.

Ordered by: William H. Crooks
WILLIAM H. CROOKS, Executive Officer

8/5/94

(Date)

AV:cjs: 8/5/94

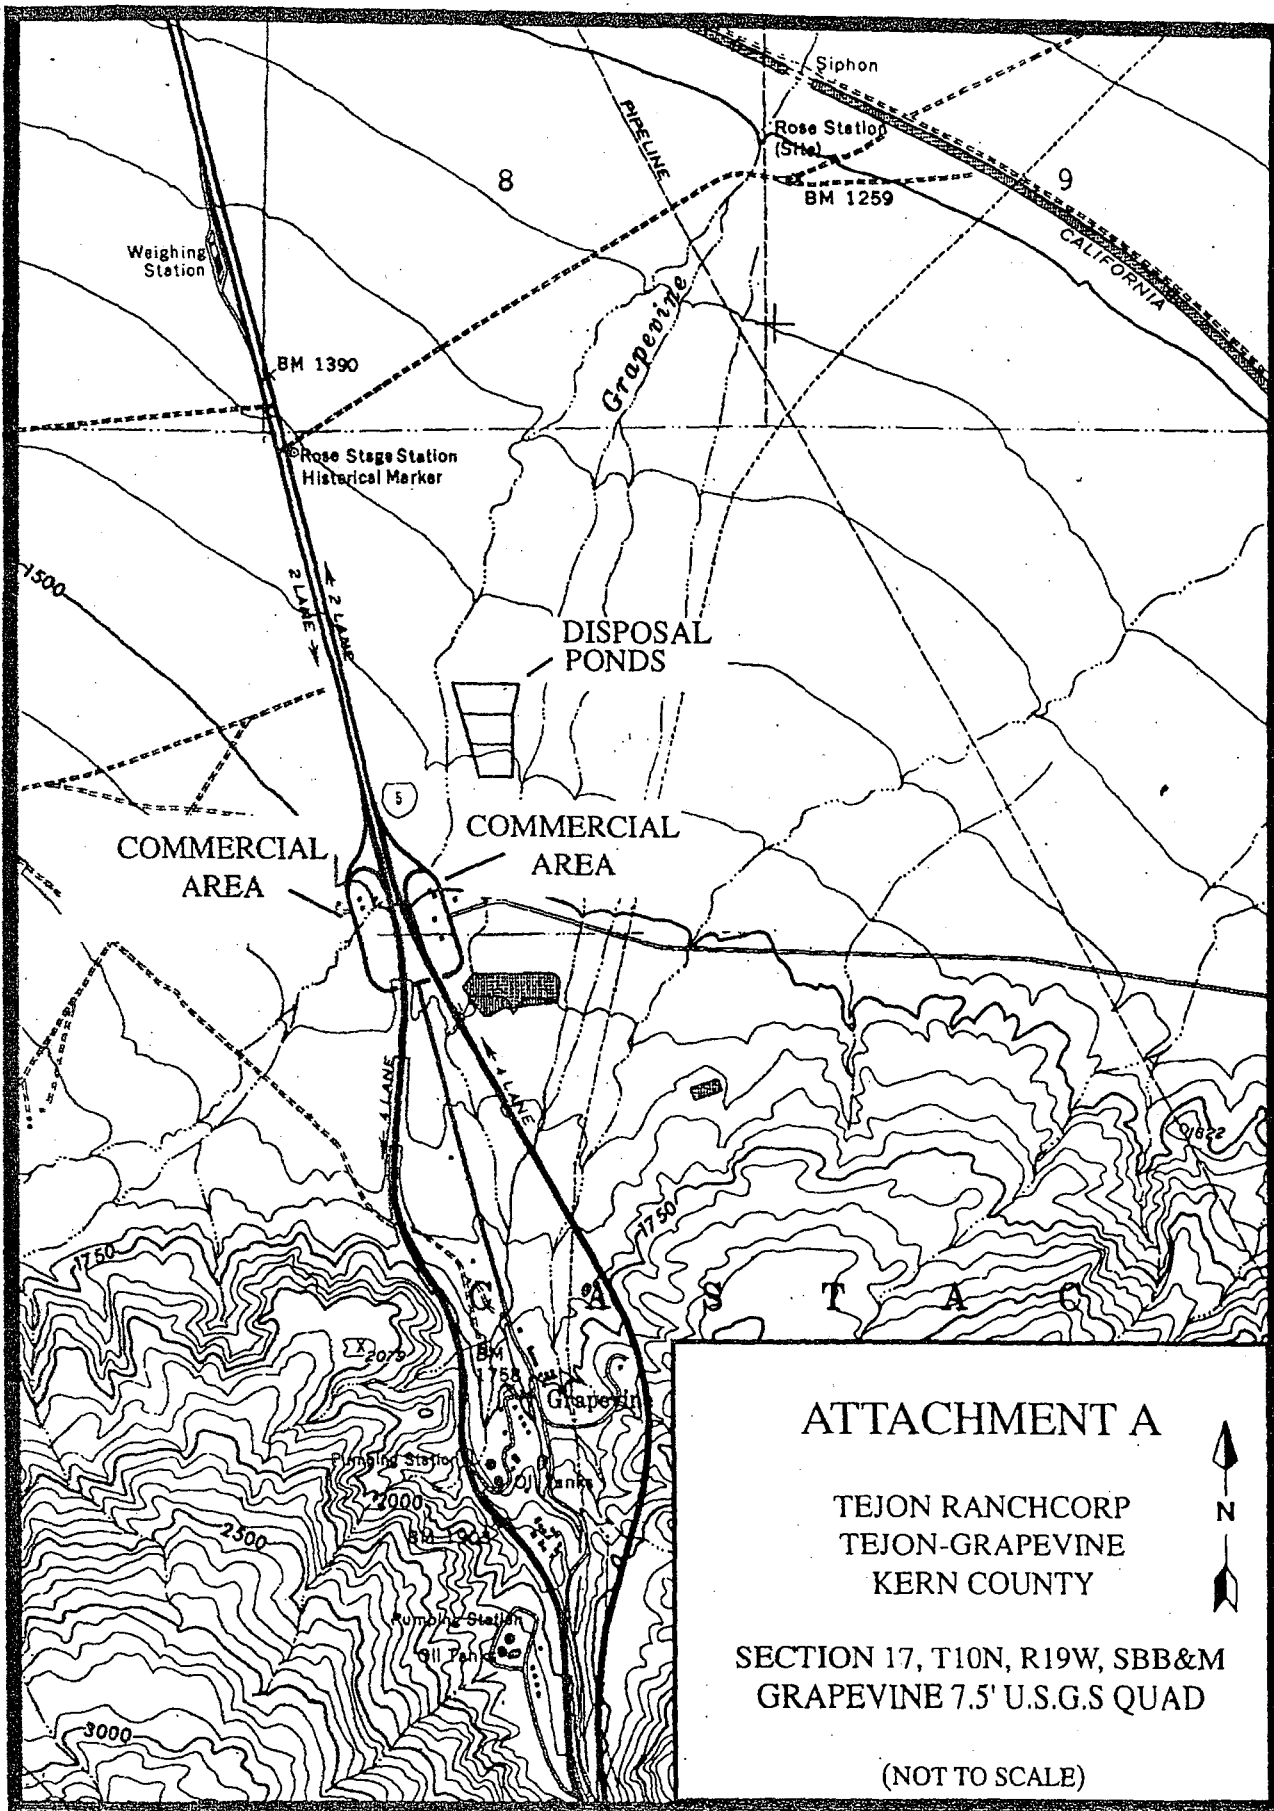

INFORMATION SHEET

TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

Tejon Ranchcorp operates a wastewater treatment facility (WWTF) northeast of the interchange on Interstate I-5 at Grapevine in Kern County. The WWTF is regulated by Waste Discharge Requirements (WDRs) Order No. 76-140.

The WDRs prescribe requirements for monthly average discharge of 22,000 gallons per day of wastewater from Wm Flag's Restaurant. Currently, the WWTF serves three restaurants, two service stations, and a car wash.

The Discharger has 87 acres zoned for commercial activity. The Discharger is planning to increase its commercial activity on the property by adding a hotel, fast food restaurants, and more service stations to the existing three restaurants, two service stations and car wash. The Discharger submitted a Report of Waste Discharge in 1991 and additional information in a letter report dated 11 August 1993. The Discharger proposes to increase the discharge rate from 22,000 gpd to 235,000 gpd and change the facility name from Wm Flagg's Restaurant to Tejon-Grapevine.

The WWTF consists of a flowmeter, Parshall flume, and three unlined disposal ponds. The total bottom and water surface of the disposal ponds are 4.95 and 6.62 ac, respectively. The Discharger uses about one-twelfth of the pond area for its current discharge. The Discharger divided one of the ponds into four cells and the discharge is directed to one of the cells. Monthly monitoring reports indicate that the average discharge rate from July through December of 1993 was 52,000 gpd. Wastewater infiltrates or evaporates before the holding capacity of the cell is exceeded. June 1987 and August 1990 inspection of the WWTF indicated the depth of wastewater in the cell was less than one foot. The proposed discharge rate is approximately ten times the discharge rate set in the WDRs. Current disposal practices show the ponds have sufficient capacity to handle the increased discharge rate.

The WWTF is on a recent Great Valley fan deposit. Soil is San Emigdio loamy sand. The parent materials are Mesozoic granitics and Oligocene sediments.

Ground water is found at a depth of approximately 1000 feet below ground surface. Its electrical conductivities range from 700 to 1000 $\mu\text{mhos/cm}$. Its direction of flow is to the north.

The average annual rainfall and evaporation rates in the area are 5 and 64 inches, respectively.

Surface drainage is to Grapevine Creek, a valley floor water. Beneficial uses of valley water include industrial and agricultural supply; contact and noncontact recreation; warm water habitat; wildlife habitat; preservation of rare and endangered species; and ground water recharge. Grapevine Creek flows only during and shortly after storm events, which are

INFORMATION SHEET - Continued

TEJON RANCHCORP
TEJON-GRAPEVINE
KERN COUNTY

-2-

infrequent in this arid area. In actuality, the only beneficial uses realized are non-contact water recreation, wildlife habitat, preservation of rare and endangered species, and ground water recharge.

The Tejon Ranchcorp adopted a mitigated negative declaration on 10 January 1991 in accordance with the California Environmental Quality Act (CEQA)(Public Resources Code Section 21000, et seq.), and the State CEQA Guidelines. The Board has reviewed the findings and concurs that the project as approved will not have a significant impact on water quality.

AV:cjs: 8/5/94