

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 91-069

WASTE DISCHARGE REQUIREMENTS
FOR
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. The City of Wheatland (hereafter Discharger) submitted a Report of Waste Discharge, received 23 July 1990, for a proposed expansion of its Wastewater Treatment Plant. The properties have Assessor's Parcel Nos. 28-220-018 (Sutter County), 28-220-019 (Sutter County), and 019-030-34 (Placer County), and are owned by the City of Wheatland, which is in Yuba County.
2. The Board, on 25 October 1985, adopted Order No. 85-296 which prescribed requirements for the Discharger to discharge from 0.21 million gallons per day (mgd) of secondary treated effluent to basins in the floodplain of the Bear River.
3. The Discharger proposes to expand the treatment plant to accommodate a projected increase in Wheatland's population from 1,500 to 5,600. The average treatment plant flow is estimated to increase from 0.21 mgd to 0.62 mgd. The expansion will include the addition of a 50-foot diameter clarifier, new sludge beds, and a third aerator for the oxidation ditch.
4. The Wheatland Wastewater Treatment Plant and disposal facilities are in Section 4 and 9, T13N, R5E, MDB&M, with surface water drainage to the Bear River, approximately 3,000 feet downstream of the Highway 65 Bridge, as shown on Attachment A, a part of this Order.
5. The beneficial uses of the Bear River are agricultural supply; recreation; esthetic enjoyment; navigation; ground water recharge; fresh water replenishment; and preservation and enhancement of fish, wildlife, and other aquatic resources.
6. The beneficial uses of the ground water are municipal and agricultural supply.
7. The Board has adopted a Water Quality Control Plan, 2nd Edition, for the Sacramento River Basin (5A) which contains water quality objectives for all waters of the Basin. These requirements are consistent with that Plan.

WASTE DISCHARGE REQUIREMENTS
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

-2-

8. The City of Wheatland adopted a final environmental impact report (EIR) on 10 September 1990, in accordance with the California Environmental Quality Act, (Public Resources Code Section 21000, et seq.), and the State Guidelines. The EIR was adopted for the Wheatland 1995 Specific Plan which will result in an increased demand for wastewater treatment capacity.
9. The Board has reviewed the EIR and concurs there are no significant impacts on water quality from the proposed wastewater treatment plant expansion.
10. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge.
11. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 85-296 be rescinded and that the City of Wheatland, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. The direct discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. The by-pass or overflow of untreated or partially treated waste is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a nuisance or condition of pollution as defined by the California Water Code, Section 13050.
2. The discharge shall not cause degradation of any water supply.
3. The discharge shall remain within the designated disposal areas (shown on Attachment C) at all times.
4. Collected screening, sludges, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer.
5. Reclaimed wastewater shall meet the criteria contained in Title 22, Division 4, CCR (Section 60301, et seq.).

WASTE DISCHARGE REQUIREMENTS
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

-3-

6. Effluent discharged to the infiltration basins shall not exceed the following limits:

<u>Constituents</u>	<u>Units</u>	<u>30-Day Average</u>	<u>Daily Maximum</u>
BOD ¹	mg/l	30	60
Total Suspended Matter	mg/l	30	60
Settleable Matter	ml/l	0.1	0.2

¹ 5-Day, 20°C Biochemical Oxygen Demand

7. The discharge shall not have a pH less than 6.5 nor greater than 8.5.
8. The 30-day average daily dry weather discharge flow shall not exceed 0.62 million gallons.
9. The dissolved oxygen content of holding ponds shall not be less than 1.0 mg/l for 6 hours in any 24-hour period.
10. The Discharger shall maintain a minimum of two feet of freeboard in the disposal ponds.

C. Provisions:


1. The Discharger may be required to submit technical reports as directed by the Executive Officer.
2. The Discharger shall comply with the attached Monitoring and Reporting Program No. 90-069.
3. The Discharger shall comply with the Standard Provisions and Reporting Requirements, dated 1 July 1990, which are a part of this Order.
4. The Discharger shall report promptly to the Board any material change or proposed change in the character, location, or volume of the discharge.
5. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to this office.

WASTE DISCHARGE REQUIREMENTS
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

-4-

6. The Board will review this Order periodically and may revise requirements when necessary.

I, WILLIAM H. CROOKS, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 22 February 1991.


WILLIAM H. CROOKS, Executive Officer

1/29/91:RJB:gs

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 91-069

FOR
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

Prior to construction, plans and specifications for ground water monitoring wells shall be submitted to Board staff for review and approval.

INFLUENT MONITORING

<u>Characteristic</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	mgd	Cumulative	Daily

EFFLUENT MONITORING

Effluent samples shall be collected just prior to discharge to the disposal facility. Effluent samples should be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded. The following shall constitute the effluent monitoring program:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	Grab	Twice Monthly
Suspended Matter	mg/l	Grab	Twice Monthly
Settleable Matter	ml/l	Grab	Daily
pH	pH Units	Grab	Daily
Flow	mgd	Cumulative	Daily

DISPOSAL BASIN MONITORING

<u>Constituent</u>	<u>Units</u>	<u>Station</u>	<u>Sampling Frequency</u>
Dissolved Oxygen	mg/l	Basins	Monthly

MONITORING AND REPORTING PROGRAM
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

-2-

A log shall be kept of the basin maintenance activities, documenting periods when basins are dried and serviced. Notes on basin maintenance activities shall be summarized in the monitoring report.

GROUND WATER MONITORING

For the rapid infiltration basin disposal system, at least one upgradient and two downgradient groundwater monitoring wells between shall be installed. Semi-annual samples shall be obtained from the wells and analyzed for the following:

<u>Constituent</u>	<u>Units</u>
Nitrate	mg/l
20°C BOD ₅	mg/l
Electrical Conductivity	μmhos/cm
pH	pH Units
Total Coliform Organisms	MPN/100 ml
Ground Water Elevation	feet, MSL

REPORTING


In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

Monthly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.

Upon written request of the Board, the Discharger shall submit a report to the Board by 30 January of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.

The Discharger shall implement the above monitoring program as of the date of this Order.


WILLIAM H. CROOKS, Executive Officer

22 February 1991
(Date)

INFORMATION SHEET

CITY OF WHEATLAND WASTEWATER TREATMENT PLANT YUBA/SUTTER/PLACER COUNTIES

The City of Wheatland is approximately 14 miles southeast of Marysville on Highway 65. Wastewater from the City flows south to the treatment plant on the bank of the Bear River (Attachment A). Wheatland is in the southeast portion of Yuba County, but the treatment plant, approximately 4000 feet south of the City, is divided between Sutter and Placer Counties. The plant was constructed in 1969 and modified with the addition of a laboratory building and sludge storage basin and the conversion of a disinfection lagoon into rapid infiltration basins in 1980. The treatment facilities currently consist of a headworks structure, a mechanically aerated oxidation ditch, a clarifier, a sludge storage basin, two sludge drying beds, a pumping station, three rapid filtration basins, an emergency retention basin, and a laboratory.

Waste Discharge Requirements Order No. 85-296 was adopted on 25 October 1985 for discharge of 0.21 mgd of secondary treated wastewater to rapid filtration basins in the flood plain of the Bear River. On 23 July 1990, the Board received a Report of Waste Discharge for a proposed plant expansion to accommodate an average dry weather flow of 0.62 mgd. The proposed plant expansion includes electrical modifications to accommodate an emergency generator and new facilities, an extension of the headworks channel, and the addition of a 50 foot diameter clarifier, a sludge pump station, a flow-splitting structure, effluent and sludge flow meters, new sludge drying beds, and a third aerator for the oxidation ditch (Attachment B).

Minor changes are proposed for the headworks and oxidation ditch. The headworks channel will be extended to eliminate the capacity restriction caused by the 12 inch headworks outlet pipe. A separate channel within the oxidation ditch will be opened up to provide full ditch volume for waste treatment. One additional aerator will be added to increase mixing and aeration capacity.

A new secondary clarifier and a new sludge pump station will be added. New paved drying beds will be constructed east of the existing plant site. The electrical power supply will be modified to accommodate an emergency power supply.

Treated wastewater will continue to be discharged to the rapid infiltration basins for disposal (Attachment C). The three basins cover an area of about 4.3 acres and are adequate for the 0.62 mgd flow. The basins are within the Bear River levee and therefore subject to potential inundation. Flows in the Bear River drainage basin, however, are significantly controlled by the Rollins and Camp Far West Reservoirs, upstream of the treatment plant. The basins have not flooded since the treatment plant was constructed in 1969. The maximum flood event occurred in 1986. The Bear River flow was estimated at 48,000 cubic feet per second, approximately the 50-year runoff event, and the basins were not flooded.

INFORMATION SHEET
CITY OF WHEATLAND
WASTEWATER TREATMENT PLANT
YUBA/SUTTER/PLACER COUNTIES

-2-


Wheatland will be required to install a ground water monitoring program for the disposal basins. A minimum of two downgradient wells and one upgradient well and a comprehensive sampling and analysis program will be required to monitor potential impacts to groundwater quality.


The City adopted a final environmental impact report on 10 September 1990 in accordance with the California Environmental Quality Act, (Public Resources Code Section 21000, et seq.), and the State Guidelines.


RJB:mkk

1/30/91

ATTACHMENT A

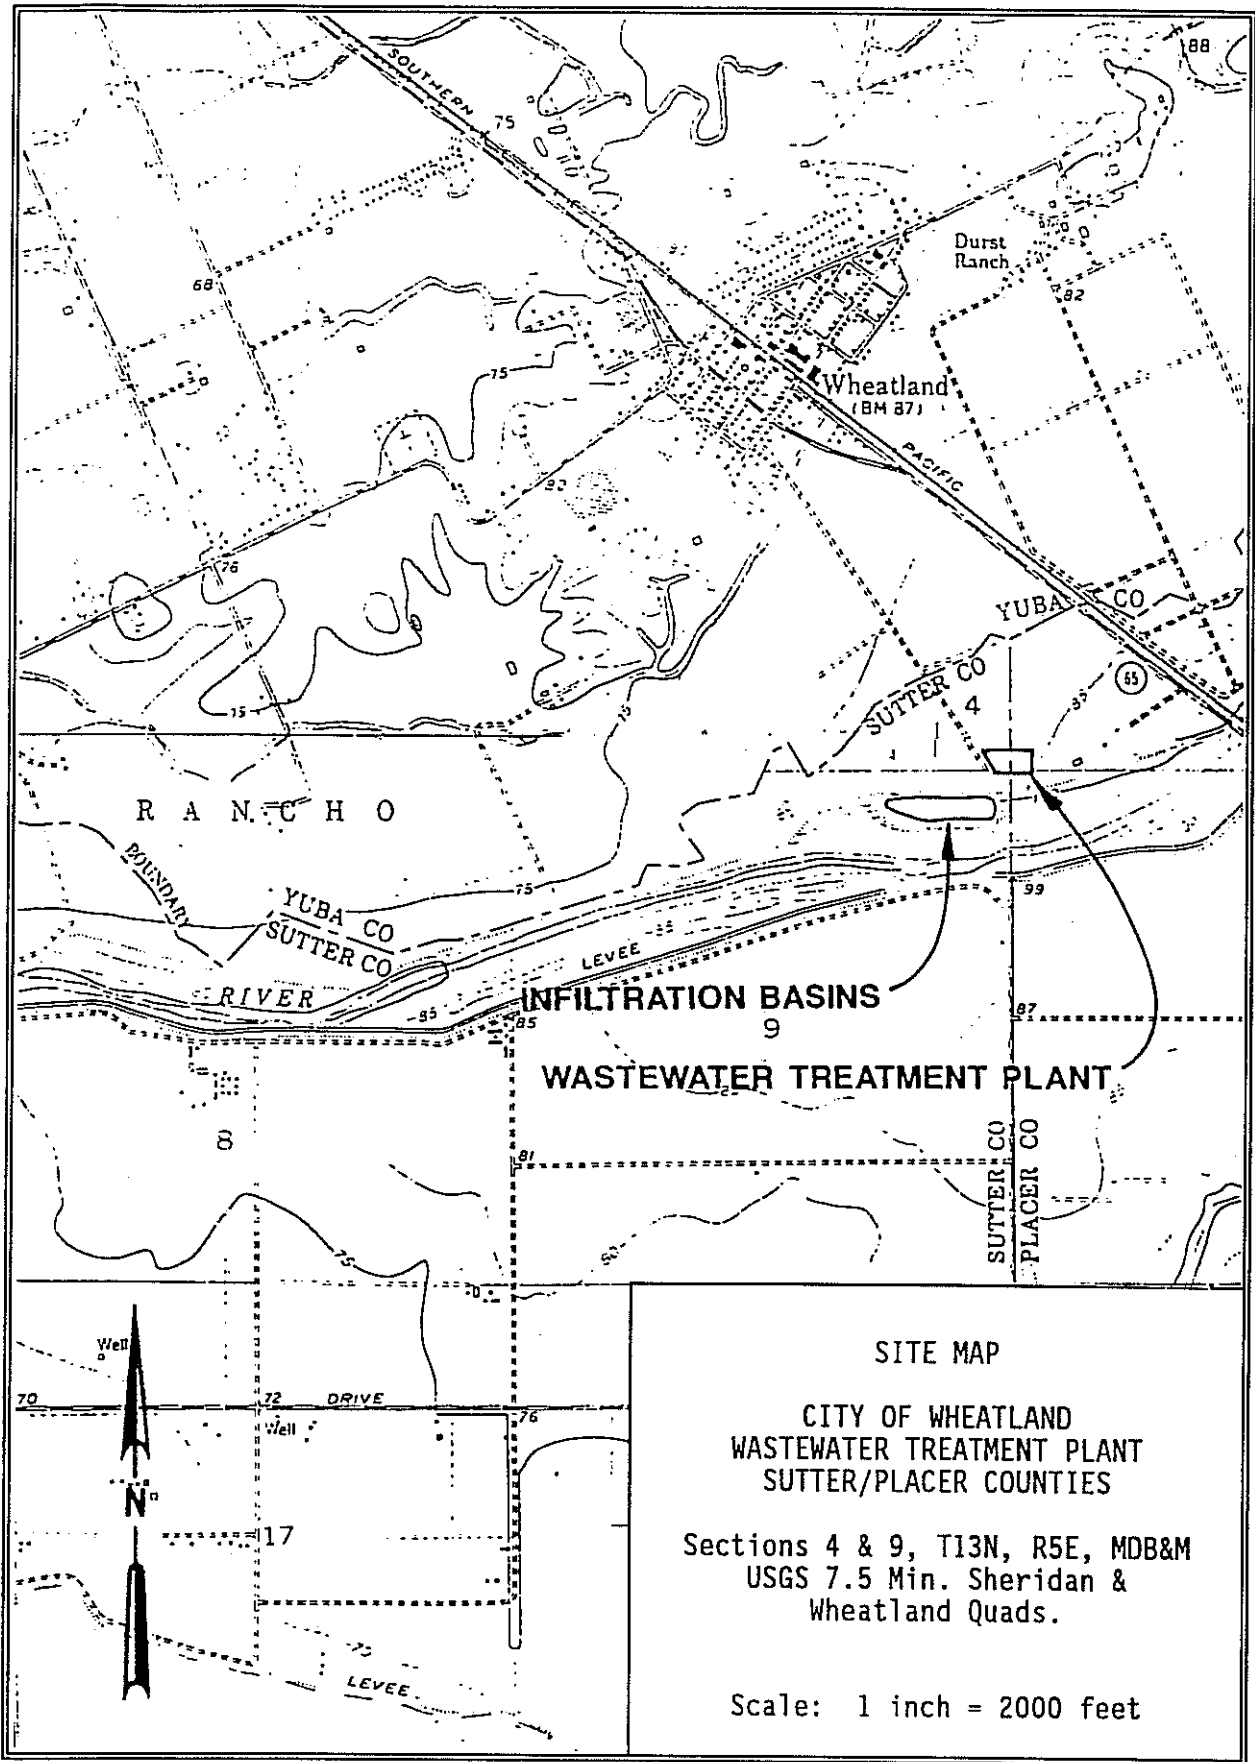

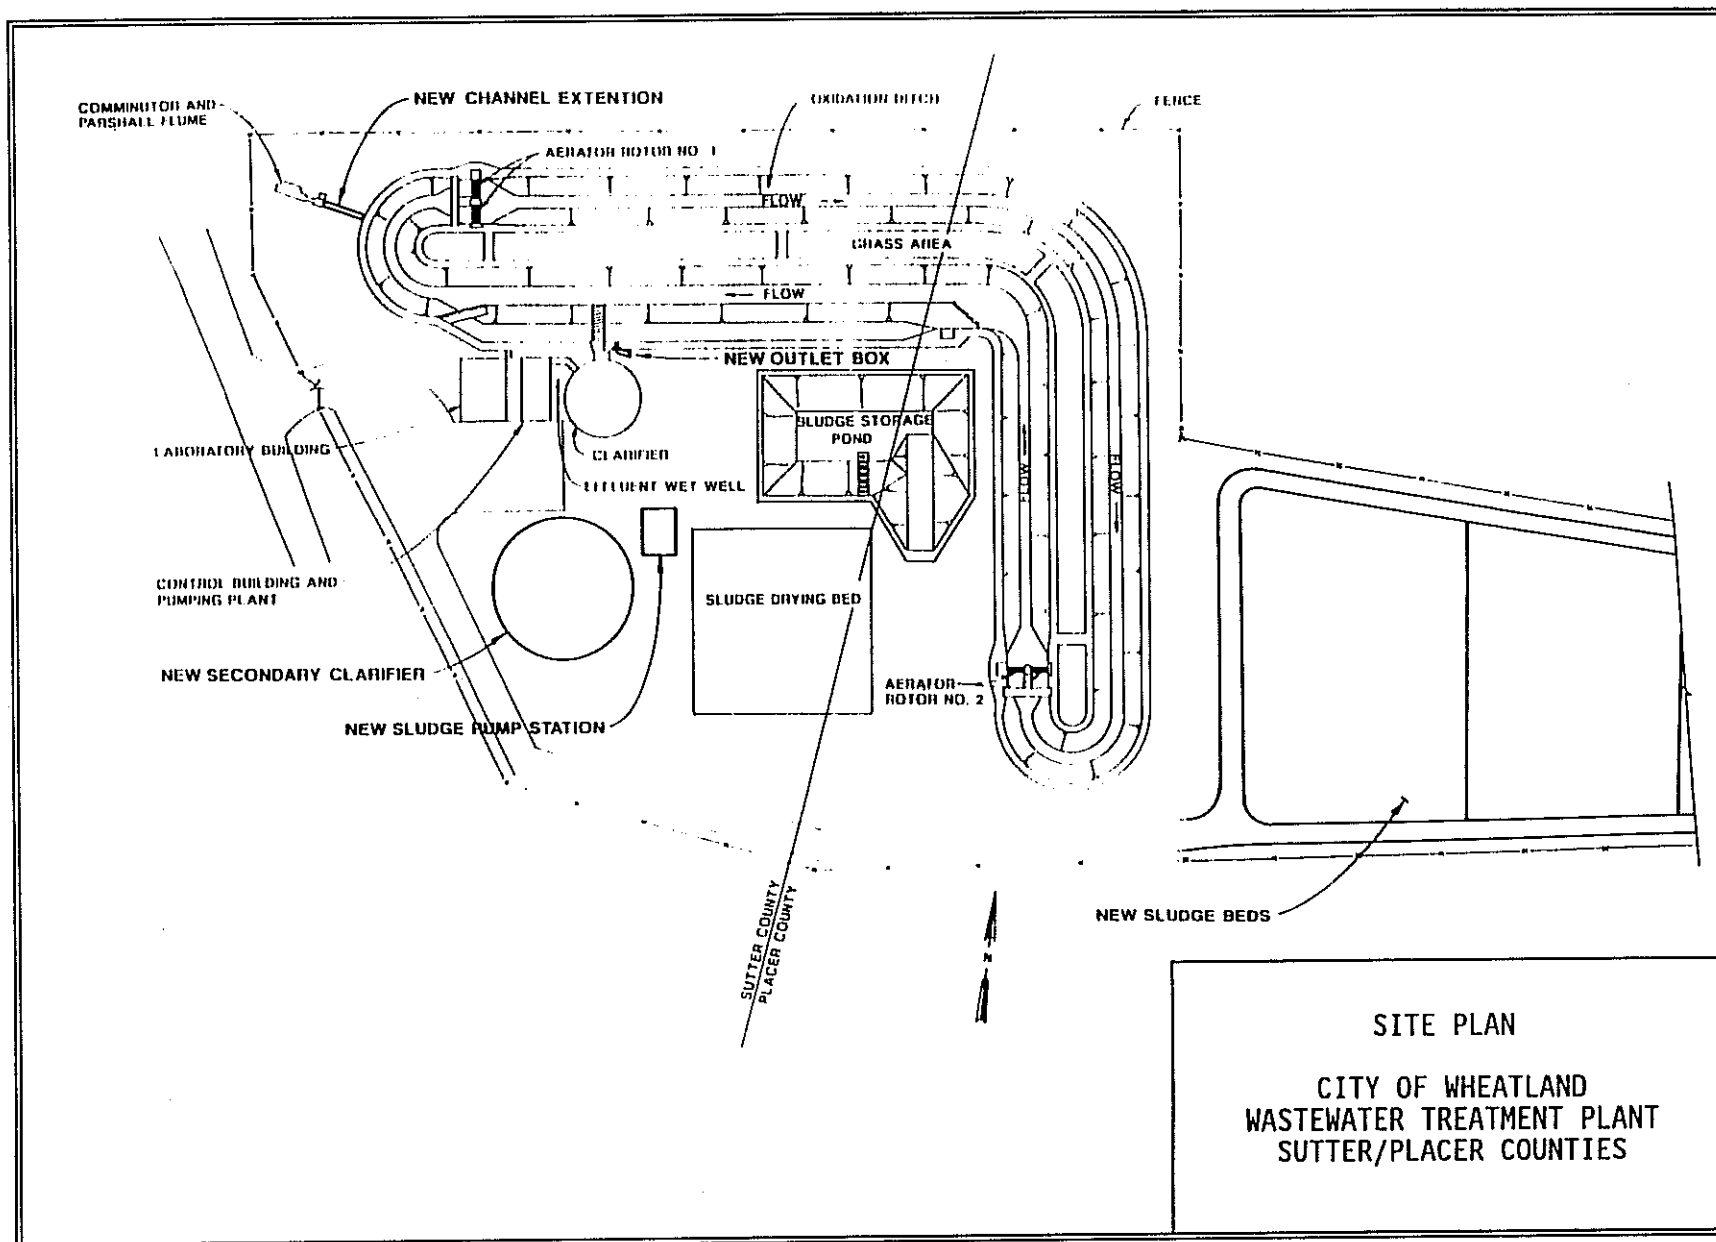

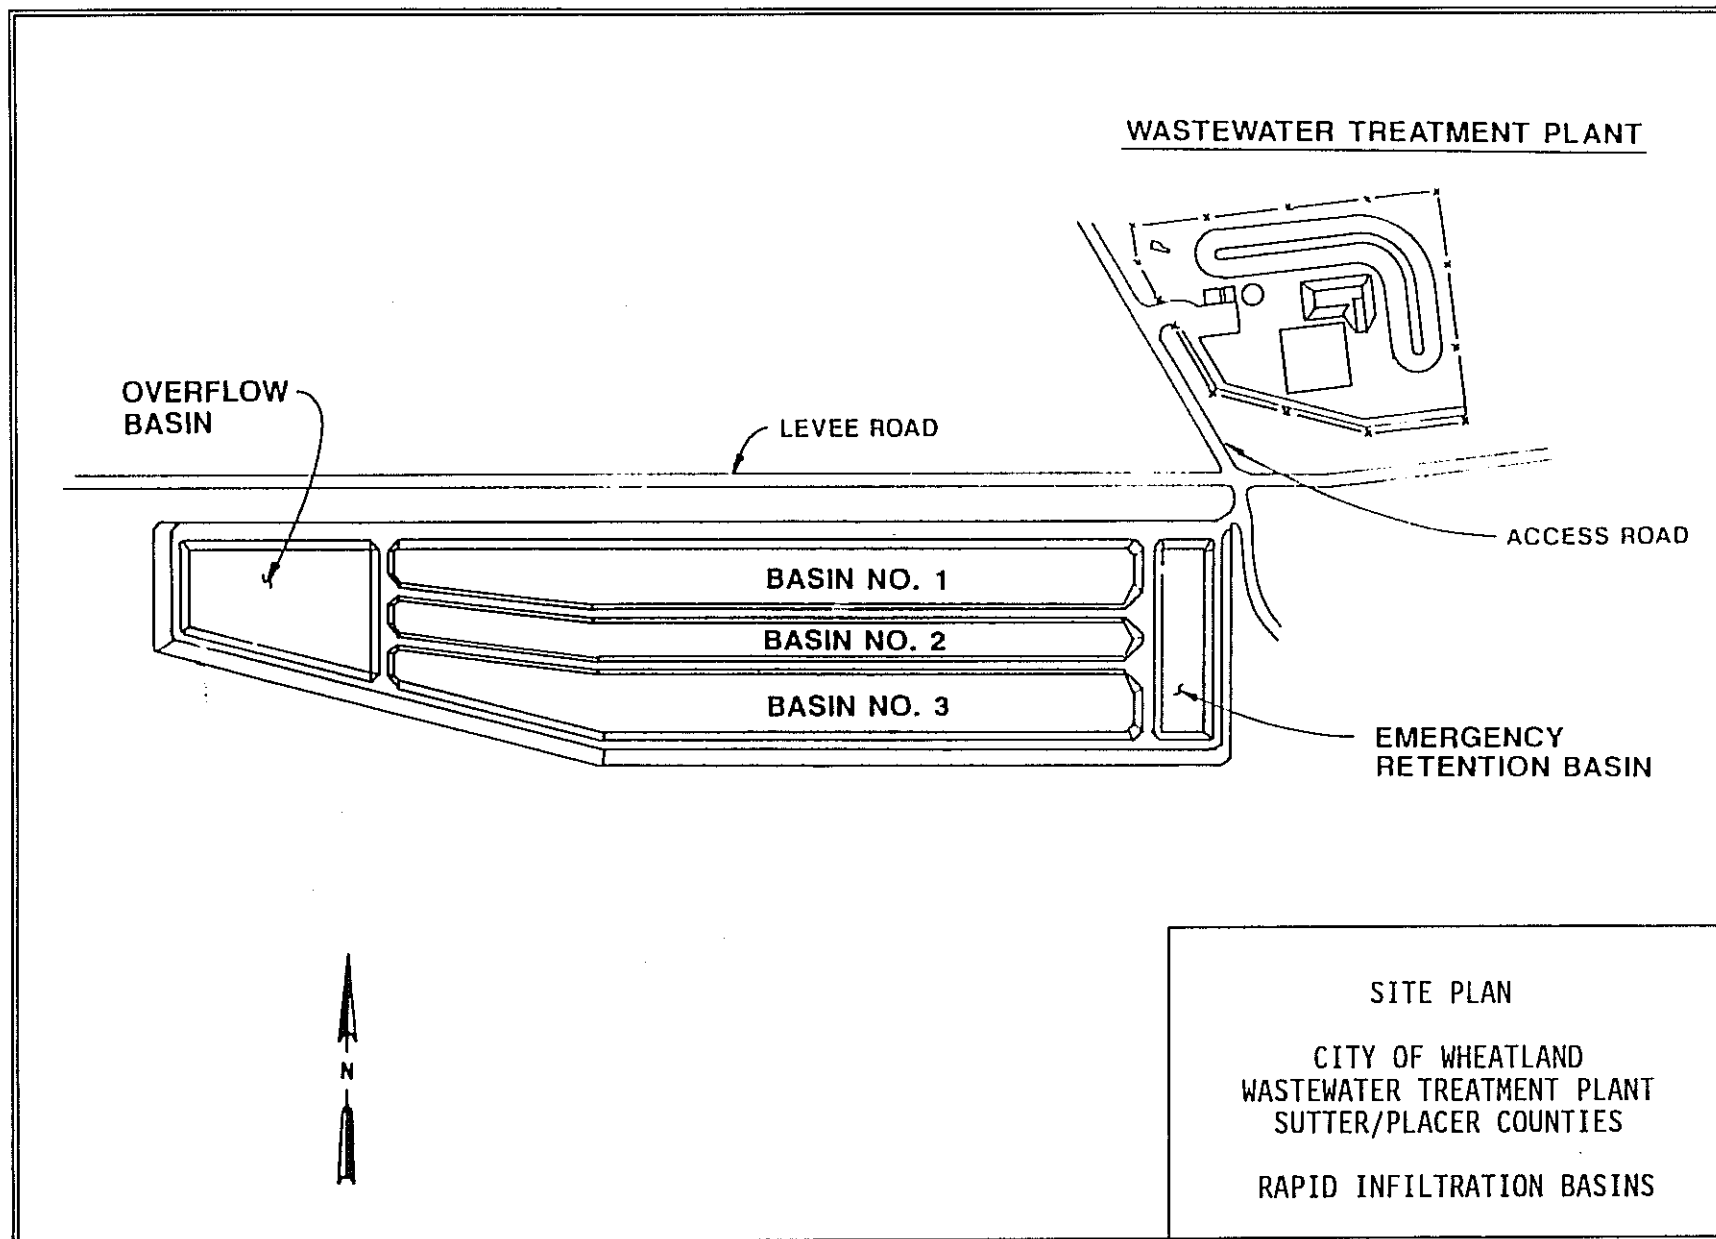

CITY OF WHEATLAND, YUBA COUNTY
WASTEWATER TREATMENT PLANT
MONITORING AND REPORTING PROGRAM NO. 91-069
WDS # 5A580103001

✓EAM
1

For Month of NOVEMBER 1998

Larry Panteligan 12-8-98
Authorized Signature, Date

Constituents	Influent	Effluent					Pond
	flow	BOD	Sus. Sol.	Set Sol.	pH	flow	DO
	Units	mg/l	mg/l	ml/l	pH units	mgd	mg/l
Frequency	daily	twice monthly	twice monthly	daily	daily	daily	monthly
Date							
1	0.297			<.1	7.18	0.294	7.2
2	0.264			<.1	7.32	0.258	
3	0.268			<.1	7.26	0.246	
4	0.292	not detected	2.7	<.1	7.24	0.270	
5	0.315			<.1	7.22	0.246	
6	0.270			<.1	7.33	0.240	
7	0.325			<.1	7.24	0.276	
8	0.340			<.1	7.17	0.276	
9	0.289			<.1	7.21	0.246	
10	0.311			<.1	7.10	0.264	7.9
11	0.327			<.1	7.21	0.270	
12	0.297			<.1	7.09	0.234	
13	0.288			<.1	7.31	0.246	
14	0.253			<.1	7.33	0.222	
15	0.243			<.1	7.40	0.228	
16	0.321			<.1	7.41	0.288	
17	0.310			<.1	7.41	0.276	8.7
18	0.295	not detected	2.7	<.1	7.38	0.264	
19	0.294			<.1	7.40	0.258	
20	0.288			<.1	7.28	0.270	
21	0.336			<.1	7.16	0.306	
22	0.319			<.1	7.17	0.276	
23	0.369			<.1	7.14	0.336	
24	0.308			<.1	7.21	0.276	
25	0.299			<.1	7.37	0.276	
26	0.300			<.1	7.22	0.294	7.8
27	0.341			<.1	7.12	0.324	
28	0.302			<.1	7.39	0.294	
29	0.385			<.1	7.29	0.336	
30	0.466			<.1	7.27	0.396	
Avg	0.310	not detected	2.7	<.1	7.26	0.276	8.06
Max	0.466	not detected	2.7	<.1	7.41	0.396	8.70
Permit	0.62	30/60	30/60	0.1 0.2	6.5 - 8.5		1.0 min
Viol. Y or N	N	N	N	N	N	N	N