

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

ORDER NO. 97-256

WASTE DISCHARGE REQUIREMENTS
FOR
TEKTRONIX, INCORPORATED
BITNEY SPRINGS ROAD - GRASS VALLEY
NEVADA COUNTY

The California Regional Water Quality Control Board, Central Valley Region, (hereafter Board) finds that:

1. Tektronix, Incorporated, an Oregon corporation, (hereafter Discharger) submitted a Report of Waste Discharge, dated 1 August 1997, for their wastewater treatment and disposal facility. The property (Assessor's Parcel Nos. 04-081, 52-05-01, 52-07-01) is owned by Tektronix, Incorporated. Additional information was submitted on 4 September 1997.
2. Waste Discharge Requirements Order No. 88-111, adopted by the Board on 24 June 1988, prescribe requirements for a discharge from a domestic (commercial) wastewater collection system and from a physical-chemical industrial wastewater collection, treatment, and pond system to an aerated oxidation pond, settling pond, chlorination, 21.6 acre-foot effluent storage pond, and 11.2 acres of spray disposal fields.
3. The industrial wastewater treatment plant and all appendices (pipe lines, treatment tanks, waste collection sumps) were closed and the industrial wastewater storage pond was cleaned and sludge properly hauled away and disposed of in 1992. A closure letter dated August 6, 1994 was provided by the California Department of Toxic Substances Control. Only domestic wastewater and small quantities of rinse water following washing of aluminum components and silk screen washing water are now discharged. The Discharger has requested that waste discharge requirements be revised to reflect the current operations.
4. Since the beginning of 1994, the Discharger has discharged an average of approximately 2,500 gallons per day (gpd) of wastewater to the treatment and disposal system. Existing waste discharge requirements and this Order allow a monthly average discharge of 40,000 gpd.
5. Tektronix, Incorporated is in Sections 12 and 13, T16N, R7E, and Sections 7 and 18, T16N, R8E, MDB&M, with surface water drainage to Kentucky Ravine, a tributary of the South Yuba River, as shown in Attachment A, which is attached hereto and part of

this Order by reference. The site lies within the South Yuba River hydrologic area (No. 17.31), as depicted on interagency hydrologic maps prepared by the Department of Water Resources in August 1986.

6. The Board adopted a Water Quality Control Plan, Third Edition, (hereafter Basin Plan) for the Sacramento River Basin and San Joaquin River Basin, which contains water quality objectives for all waters of the Basin. These requirements implement the Basin Plan.
7. The beneficial uses of Kentucky Ravine and the South Yuba River are municipal, industrial, and agricultural supply; recreation; aesthetic enjoyment; navigation; groundwater recharge; fresh water replenishment; hydropower generation; and preservation and enhancement of fish, wildlife, and other aquatic resources.
8. The beneficial uses of underlying groundwater are domestic, industrial, and agricultural supply.
9. The Basin Plan encourages reclamation. The Discharger reviewed opportunities for reclamation and cannot use or increase use of effluent on irrigated land because of the steepness and limited availability of agricultural land nearby.
10. The action to revise waste discharge requirements for this facility is exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, California Code of Regulations (CCR), Section 15308.
11. This discharge is exempt from the requirements of *Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste*, as set forth in Title 27, CCR, Division 2, Subdivision 1, Section 20005, et seq., (hereafter Title 27). The exemption, pursuant to Section 20090(b), is based on the following:
 - a. The Board is issuing waste discharge requirements,
 - b. The discharge complies with the Basin Plan, and,
 - c. The wastewater does not need to be managed according to 22 CCR, Division 4.5, Chapter 11, as a hazardous waste.
12. The Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for this discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.

13. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that Order No. 88-111 is rescinded and Tektronix, Incorporated, its agents, successors, and assigns, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, shall comply with the following:

A. Discharge Prohibitions:

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Bypass or overflow of untreated or partially treated waste is prohibited.
3. Discharge of waste classified as 'hazardous', as defined in Sections 2521(a) of Title 23, CCR, Section 2510, et seq., (hereinafter Chapter 15), or 'designated', as defined in Section 13173 of the California Water Code, is prohibited.
4. Surfacing of wastewater percolating from the reservoirs or irrigation areas is prohibited.

B. Discharge Specifications:

1. Neither the treatment nor the discharge shall cause a pollution or nuisance as defined by the California Water Code, Section 13050.
2. The monthly average dry weather discharge flow shall not exceed 40,000 gallons per day.
3. Objectionable odors originating at this facility shall not be perceivable beyond the limits of property owned by the Discharger.
4. As a means of discerning compliance with Discharge Specification No. 3, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/l.
5. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
6. Effluent discharged from the treatment facility to the storage lagoon shall not exceed the following limits:

WASTE DISCHARGE REQUIREMENTS
TEKTRONIX, INCORPORATED
NEVADA COUNTY

-4-

<u>Constituent</u>	<u>Units</u>	<u>Monthly Average</u>	<u>Daily Maximum</u>
BOD ₅ ¹	mg/l	40	80
Settleable Solids	ml/l	0.2	0.5
Total Coliform Organisms	MPN/ 100 ml	23	230

¹Five-day, 20° C Biochemical Oxygen Demand.

7. Ponds shall be managed to prevent breeding of mosquitoes. In particular, Management measures, such as the following, shall be implemented.
 - a. An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - b. Weeds shall be minimized through control of water depth, harvesting, or herbicides.
 - c. Dead algae, vegetation, and debris shall not accumulate on the water surface.
8. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
9. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the nonirrigation season. Freeboard in the storage lagoon shall never be less than two feet (measured vertically to the lowest point of overflow). Freeboard in the treatment pond shall not be less than 24 inches for more than 48 hours nor less than 16 inches at any time.
10. There shall be no standing water in the disposal area 48 hours after wastewater is applied.
11. On or about **1 October** of each year, available pond storage capacity shall at least equal the volume necessary to comply with Discharge Specification 9.

C. Sludge Disposal:

1. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Title 27 and approved by the Executive Officer.
2. Any proposed change in sludge use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency (EPA) Regional Administrator at least 90 days in advance of the change.
3. Use and Disposal of sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.

If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR 503 whether or not they have been incorporated into this Order.

4. The Discharger is encouraged to comply with the State Guidance Manual issued by the Department of Health Services titled *Manual of Good Practice for Landspreading of Sewage Sludge*.

D. Groundwater Limitations:

The discharge shall not cause underlying groundwater to be degraded.

E. Provisions:

1. The Discharger shall comply with the Monitoring and Reporting Program No. 97-256, which is part of this Order, and any revisions thereto as ordered by the Executive Officer.
2. The Discharger shall comply with the "Standard Provisions and Reporting Requirements for Waste Discharge Requirements", dated 1 March 1991, which are attached hereto and by reference a part of this Order. This attachment and its individual paragraphs are commonly referenced as "Standard Provision(s)."
3. In the event of any change in control or ownership of land or waste discharge facilities described herein, the Discharger shall notify the succeeding owner or

WASTE DISCHARGE REQUIREMENTS
TEKTRONIX, INCORPORATED
NEVADA COUNTY

-6-

operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to this office.

4. At least **90 days** prior to termination or expiration of any lease, contract, or agreement, or the sale of any property involving disposal or reclamation areas or off-site reuse of effluent used to justify the capacity authorized herein and assure compliance with this Order, the Discharger shall notify the Board in writing of the situation and of what measures have been taken or are being taken to assure full compliance with this Order.
5. The Discharger shall use the best practicable cost-effective control technique currently available to comply with salinity limits specified in this order.
6. The Discharger must comply with all conditions of this Order, including timely submittal of technical and monitoring reports as directed by the Executive Officer. Violations may result in enforcement action, including Regional Board or court orders requiring corrective action or imposing civil monetary liability, or in revision or rescission of this Order.
7. A copy of this Order shall be kept at the discharge facility for reference by operating personnel. Key operating personnel shall be familiar with its contents.
8. If reclaimed water is used for construction purposes, it shall comply with the most current edition of "Guidelines for Use of Reclaimed Water for Construction Purposes". Other uses of reclaimed water not specifically authorized herein shall be subject to the approval of the Executive Officer and shall comply with 22 CCR, Division 4.
9. The Board will review this Order periodically and will revise requirements when necessary.

I, GARY M. CARLTON, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on 5 December 1997.


GARY M. CARLTON, Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION

MONITORING AND REPORTING PROGRAM NO. 97-256

FOR
TEKTRONIX, INCORPORATED
BITNEY SPRINGS ROAD - GRASS VALLEY
NEVADA COUNTY

Specific sample station locations shall be established under direction of the Board's staff and a description of the stations shall be attached to this Order.

EFFLUENT MONITORING

Effluent samples shall be collected at a point following treatment but before discharge to the storage/disposal facility. Effluent samples should be representative of the volume and nature of the discharge. Time of collection of a grab sample shall be recorded. Effluent monitoring shall include at least the following:

<u>Constituents</u>	<u>Units</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
Flow	gpd	Cumulative	Weekly
Freeboard in Treatment Pond	Inches	Grab	Weekly
BOD ₅	mg/l	Grab	Monthly
Total Coliform Organisms	MPN/100 ml	Grab	Monthly
Settleable Matter	ml/l	Grab	Monthly
pH	pH Units	Grab	Monthly
Chemical Oxygen Demand (COD)	mg/l	Grab	Monthly
Total Recoverable Aluminum	μg/l	Grab	Quarterly
Total Recoverable Copper	μg/l	Grab	Quarterly
Total Recoverable Lead	μg/l	Grab	Quarterly
Total Recoverable Nickel	μg/l	Grab	Quarterly

SLUDGE MONITORING

A composite sample of sludge shall be collected from the aeration pond every other year in accordance with EPA's *POTW Sludge Sampling and Analysis Guidance Document, August 1989*, and tested for the following metals:

Aluminum	Lead
Copper	Nickel

Sampling records shall be retained for a minimum of five years. A log shall be kept of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log should be complete enough to serve as a basis for part of the biennial report.

REPORTING

Monitoring reports shall be submitted quarterly to the Regional Board by the **30th day** of the first month of the next quarter.

In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized in such a manner to illustrate clearly the compliance with waste discharge requirements.

The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Board.


Upon written request of the Board, the Discharger shall submit a report to the Board by **30 January** of each year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the Discharger shall discuss the compliance record and the corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements. The Discharger shall implement the above monitoring program as of the date of this Order.

Ordered by:


GARY M. CARLTON, Executive Officer

5 December 1997

ATTACHMENT A

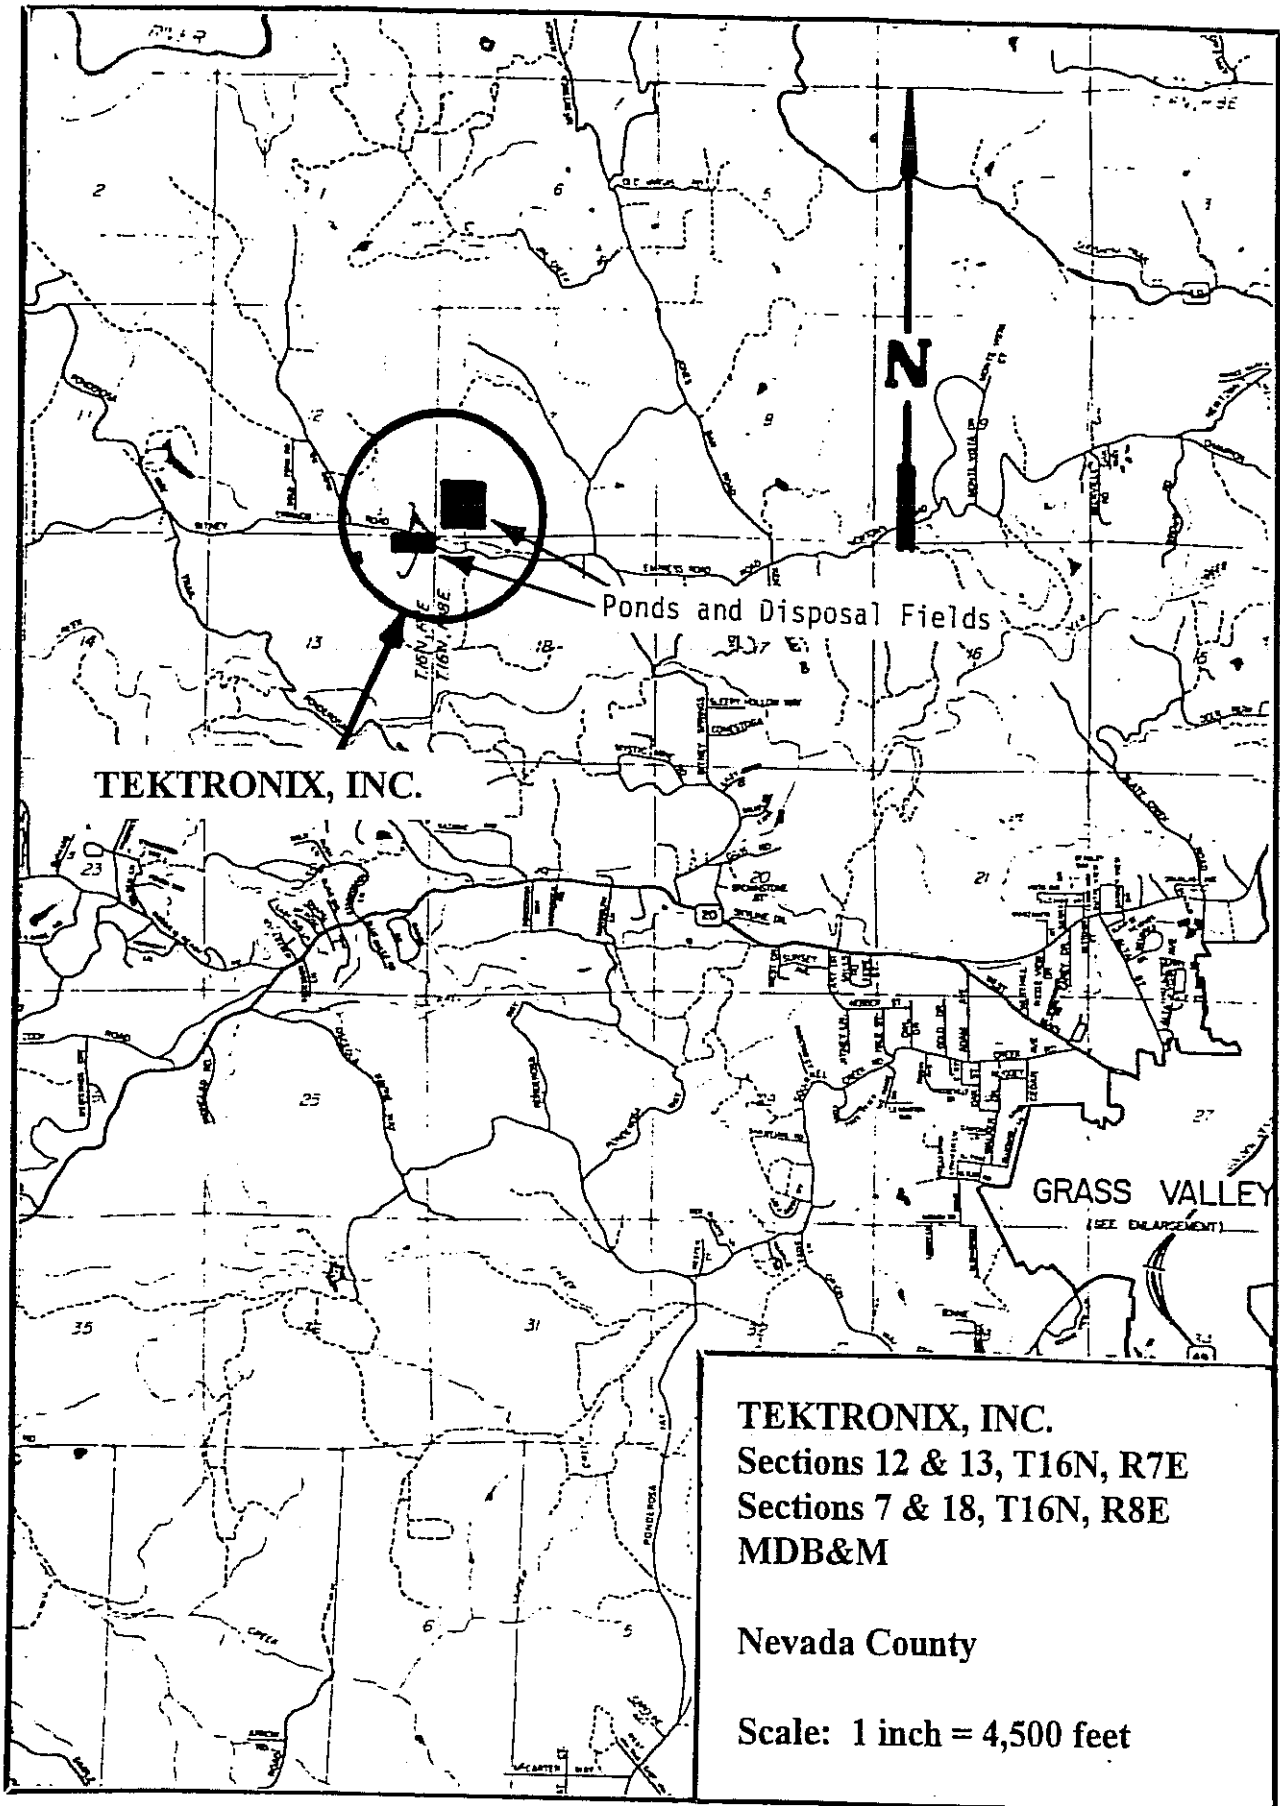

INFORMATION SHEET

TEKTRONIX, INCORPORATED
BITNEY SPRINGS ROAD - GRASS VALLEY
NEVADA COUNTY

Tektronix, Incorporated (formerly Grass Valley Group) submitted a request for revision of the waste discharge requirements for its facility on Bitney Springs Road. Order No. 88-111 prescribes requirements for a discharge from a domestic (commercial) wastewater collection system and from a physical-chemical industrial wastewater collection, treatment, and pond system to an aerated oxidation pond, settling pond, chlorination, 21.6 acre-foot effluent storage pond, and 11.2 acres of spray disposal fields. The industrial wastewater treatment plant and all appendices (pipe lines, treatment tanks, waste collection sumps) were closed and the industrial wastewater storage pond was cleaned and sludge properly hauled away and disposed of in 1992. A closure letter dated August 6, 1994 was provided by the California Department of Toxic Substances Control. The rest of the wastewater system remains as before. Only domestic wastewater and small quantities of rinse water following washing of aluminum components and silk screen washing water are now discharged.

Since the beginning of 1994, the Discharger has discharged an average of approximately 2,500 gallons per day of wastewater to the treatment and disposal system. The system is designed to treat 40,000 gallons per day, which this Order allows, as did Order No. 88-111. This Order has less stringent disinfection requirements than previous Orders because of the very low probability of human contact with the wastewater following treatment. The Discharger has stated that the system is designed to contain the 100-year storm event. Quarterly monitoring for four metals is required to ensure that metal component washwater is properly retained in the closed loop washing system, and not discharged to the sanitary wastewater system.

JLE:njs:/5 December 1997