

Central Coast Regional Water Quality Control Board

May 4, 2023

Sent Via Electronic Mail

Christopher Cook
Director of Operations
California American Water
511 Forest Lodge Road, Suite 100
Pacific Grove, CA 93950
e-mail: christopher.cook@amwater.com

Dear Christopher Cook:

**OAK HILLS WASTEWATER TREATMENT PLANT, 9152 CATHEDRAL OAK ROAD,
SALINAS, CA 93907, MONTEREY COUNTY:**

- **NOTICE OF APPLICABILITY FOR ENROLLMENT IN ORDER NO. R3-2020-0020, GENERAL WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES FROM DOMESTIC WASTEWATER SYSTEMS WITH FLOWS GREATER THAN 100,000 GALLONS PER DAY;**
- **TRANSMITTAL OF MONITORING AND REPORTING PROGRAM NO. R3-2023-0036; AND**
- **TERMINATION OF INDIVIDUAL PERMIT, WASTE DISCHARGE REQUIREMENTS ORDER NO. 01-009 WASTE DISCHARGER IDENTIFICATION NO. 3271007001 FOR WATERTEK, INC. FOR OAK HILLS WASTEWATER TREATMENT PLANT.**

The Central Coast Regional Water Quality Control Board (Central Coast Water Board) reviewed the June 17, 2022 notice of intent and available documents associated with California American Water's domestic wastewater treatment facility (Wastewater System) located at 9152 Cathedral Oak Road in Salinas, California. The Wastewater System, owned by California American Water is currently regulated pursuant to *Waste Discharge Requirements Order No. 01-009 for Watertek, Inc. Oak Hills Wastewater Treatment Plant* (Order No. 01-009).

On September 25, 2020, the Central Coast Water Board adopted *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

This letter serves as a notice of applicability for enrollment in the General Permit. This letter includes: wastewater system operation summary, specific requirements, and

JANE GRAY, CHAIR | MATTHEW T. KEELING, EXECUTIVE OFFICER

limitations (Attachment 1); figures (Attachment 2); and California American Water's monitoring and reporting program requirements (Attachment 3).

This letter also serves as a notice of termination of California American Water's coverage in existing individual permit, Order No. 01-009.

California American Water must comply with the following:

1. **General Permit** – California American Water must comply with all conditions and requirements of the General Permit. As described in the General Permit, ongoing operation, maintenance, monitoring, and reporting are required. A copy of the General Permit can be found electronically at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/r32020_0020.pdf

2. **Monitoring and Reporting Program** – California American Water must comply with the requirements of the monitoring and reporting program enclosed with this letter (monitoring and reporting program no. R3-2023-0036, Attachment 3). California American Water is required to submit quarterly monitoring reports and annual reports to the Central Coast Water Board and comply with annual volumetric reporting requirements¹ established by the State Water Resources Control Board (State Water Board). The first quarterly monitoring report is due **November 1, 2023**, the first annual report is due **March 1, 2024**, and the next annual volumetric data submission must be uploaded to the State Water Board GeoTracker database by **April 30, 2024**.

Quarterly monitoring reports and annual reports must be provided electronically in searchable PDF with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permitting/docs/transmittal_sheet.pdf

All annual reports must be formatted and completed as specified in the annual report template found at the following link:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

California American Water must submit all reports/documents and laboratory data (using the transmittal sheet as the cover page) to the publicly accessible

¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

State Water Board's GeoTracker^{2,3} database with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System – specific global identification number over the internet at:

<https://geotracker.waterboards.ca.gov/esi/login.asp>

The attached monitoring and reporting program outlines the GeoTracker electronic reporting requirements. The Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

3. **Fees** – California American Water paid an annual fee of \$3,326 on February 1, 2023 for coverage in existing individual permit, Order No. 01-009. This payment covers California American Water's enrollment in the General Permit for the 2022-2023 fiscal year.

California American Water must pay an annual fee to maintain coverage in the General Permit. Annual fees are determined by the State Water Board's fee program and cover the state fiscal year of July 1 through June 30. Your current annual fee is \$24,687. California American Water's Wastewater System is currently assigned a threat and complexity rating of 2B. A copy of the current state fee schedule is available electronically at the following link:

https://www.waterboards.ca.gov/resources/fees/water_quality/#wdr

4. **Notification** – The Central Coast Water Board will be notified of California American Water's enrollment at a regularly scheduled public meeting on June 22-23, 2023. Details about that meeting are available on our website at:

https://www.waterboards.ca.gov/centralcoast/board_info/agendas/

5. **Future Discharge Modifications** – Pursuant to California Water Code section 13260, California American Water must inform the Central Coast Water Board at least 120 days prior to modifying your discharge. If there are any significant changes in either treatment or disposal methodologies, or the volume or character of the treated wastewater, California American Water must notify the Central Coast Water Board immediately of such changes.

Attachment 1 contains the Central Coast Water Board's understanding of the Wastewater System located at 9152 Cathedral Oak Road, in Salinas, California.

² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/

³ Additional information available at: <http://geotracker.waterboards.ca.gov/>

Please review Attachment 1 to determine if the description is representative of your current system. Pursuant to California Water Code section 13267, California American Water must notify the Central Coast Water Board if this information is out of date or incorrect. You are required to provide staff with your updated information within **30 days** of issuance of this letter.

- 6. Responsible Party** – California American Water is responsible for the management and disposal of the domestic wastewater in compliance with the conditions of the General Permit. Any noncompliance with this General Permit constitutes a violation of the California Water Code, and subjects California American Water to enforcement action, and termination of enrollment under this General Permit.
- 7. Change in Ownership** - In the event of any change in control or ownership of the property, California American Water must notify the succeeding owner or operator of the existence of this General Permit by letter, a copy of which shall be immediately forwarded to the Central Coast Water Board so that the new owner or operator can be enrolled in the General Permit and California American Water's enrollment in the General Permit can be terminated.
- 8. Certified Operator** – California American Water is required to comply with the operator certification requirements⁴ administered by the State Water Board's Office of Operator Certification, which currently requires a Grade I certified operator onsite to maintain and operate the Wastewater System.
- 9. Termination of Permit** – The existing individual permit, Order No. 01-009 is terminated, except for enforcement purposes⁵. Watertek Inc. owned the WWTP previously and California American Water purchased the WWTP in late 2003. California American Water is responsible for compliance with Order No. 01-009 prior to the date of this letter.
- 10. Compliance Schedule** – As required in the attached monitoring and reporting program, California American Water must request a time schedule order 12 months from the date of this notice of applicability pursuant to Water Code section 13300, which must include more details, milestones, and a schedule for upgrades.

⁴ Title 23 Division 3. Chapter 26 Wastewater Treatment Plant Classification, Operator Certification and Contract Operator Registration.

https://www.waterboards.ca.gov/water_issues/programs/operator_certification/docs/ocr_clean.pdf

⁵ The General Permit states "... where a Wastewater System discharge is currently regulated by an individual permit, that permit is terminated upon the enrollment of the Wastewater System into this General Permit."

May 4, 2023

If you have any questions, please contact **Kathy Truong at (805) 549-3293 or by email at Kathy.Truong@waterboards.ca.gov** or Jennifer Epp at (805) 594-6181 or by email at Jennifer.Epp@waterboards.ca.gov.

Sincerely,

for Matthew T. Keeling
Executive Officer

Attachments:

Attachment 1: Wastewater System Operation Summary, Specific Requirements, and Limitations

Attachment 2: Figures

Attachment 3: Monitoring and Reporting Program Order No. R3-2023-0036

cc:

Robert Moss, California American Water, robert.moss@amwater.com

Jack Wang, California American Water, jack.wang@amwater.com

Jennifer Epp, Central Coast Water Board, Jennifer.Epp@Waterboards.ca.gov

Kathy Truong, Central Coast Water Board, Kathy.Truong@Waterboards.ca.gov

Kristina Olmos, Central Coast Water Board, Kristina.olmos@waterboards.ca.gov

Jesse Woodard, Central Coast Water Board, Jesse.Woodard@Waterboards.ca.gov

Nicole Fowler, Monterey County Health Department, FowlerNE@co.monterey.ca.us

Office of Operator Certification, wwopcertprogram@waterboards.ca.gov

WDR Program, GeoTracker RB3-WDR@Waterboards.ca.gov

ECM/CIWQS = CW-245564

GeoTracker No. = GT- WDR100029562

Rev 6/16/2022

ECM Subject Name = Oak Hills Wastewater Treatment Plant NOA for R3-2020-0020
\\ca.epa.local\rb\rb3\shared\wdr\wdr facilities\monterey co\oak hills development\big
order enrollment\oak hills noa_mrp_final.docx

**ATTACHMENT 1
WASTEWATER SYSTEM OPERATION SUMMARY, SPECIFIC REQUIREMENTS,
AND LIMITATIONS**

1. OWNERSHIP AND WASTEWATER SYSTEM INFORMATION

Ownership and wastewater system information submitted by California American Water to the Central Coast Water Board is shown in Table 1.

Table 1. Ownership and Wastewater System Information

Name	Oak Hills Wastewater Treatment Plant
Physical Address	9152 Cathedral Oak Road Salinas, CA 93907
Latitude	36°46'55.6"N
Longitude	121°43'28.2"W
Mailing Address	511 Forest Lodge Road, Suite 100 Pacific Grove, CA 93950
Owner	California American Water
Operator	California American Water phone: 831-233-1938 Email: robert.moss@amwater.com
Legally Responsible Official	Christopher Cook phone: 831-646-3241 Email: christopher.cook@amwater.com
Raw Wastewater Characteristics	Sewer Connections: 456 Population Served: 1370 Domestic (%): 100% Industrial (%): 0%
Permitted Design Flow, Maximum Daily (gallons per day, gpd)	125,000
Baseline Flow (average annual flow) in gpd	59,900
Threat to Water Quality	2
Complexity	B
For Internal Use	
Fee Code	58
Primary Place Type	Wastewater Treatment Facility
Facility Type	Municipal/Domestic
Facility Waste Type	Domestic Wastewater
Regulatory measure Type	Enrollee - WDR
Reclamation Included	No
EPA Approved Pretreatment Program	No

2. WASTEWATER SYSTEM OPERATION SUMMARY

Oak Hills Wastewater Treatment Plant (Wastewater System) is a Class I wastewater system. California American Water must staff a Grade I chief plant operator for proper operation of the Wastewater System. The current chief plant operator is Robert Moss, Grade 3, License Number 41116.

In the notice of intent, California American Water proposes that the Wastewater System is designed to treat and dispose of 125,000 gallons per day to a secondary treatment level. The Wastewater System consists of the treatment technologies shown in Table 2. The Central Coast Water Board is permitting the operation and disposal of the system as described below. California American Water must not change operation or disposal technology without Central Coast Water Board notification and review.

Table 2. Treatment Technology

Headworks/Preliminary Treatment	The headworks consist of one lift station. The station does not have any influent screening. Manual maintenance is performed to remove large debris from the suction side of influent pumps.
Primary and Secondary Treatment	Conventional treatment ponds are used. The main treatment pond (Pond 2) is 8-acres wide and 7 feet deep equipped with two floating aerators. The water from the main treatment pond then flows to Pond 1, a 0.4-acre wide and 7 feet deep pond before disposal. The ponds are not synthetically lined. Wastewater flows from Pond 2 to Pond 3 via gravity. Ponds provide both primary and biological treatment.
Wastewater Disposal Method	From Pond 1, wastewater is land disposed via spray fields with a total area of approximately 15 acres. Currently, only half of the area is used.
Wastewater Storage	Pond 3 is an unlined emergency overflow storage pond. Any wastewater that flows in pond 3 stays in pond 3.
Biosolids/Sludge Production and Handling	Solids are accumulated in the treatment ponds and are only removed by dredging and then disposed at a nearby municipal landfill facility when needed. There has been no disposal from the pond during California American Water's ownership.
	The ultimate destination of biosolids produced is Monterey Regional Waste Management District - Landfill Facility located at 14201 Del Monte Blvd, Marina, CA

A summary of historic and recent average effluent concentrations is included in Table 3, which were reported in California American Water's annual monitoring reports. A summary of historic and recent average groundwater concentrations is included in

Table 4, which were reported in California American Water annual monitoring reports. The Central Coast Water Board used reported effluent water quality data to establish the effluent and groundwater limitations in section 3.

Table 3. Effluent Water Quality for Select Constituents

Constituents	Units^[1]	Historical Average	Annual Average for 2021^[4]
Biochemical Oxygen Demand, 5-Day	mg/L	83 ^[2]	65
Total Suspended Solids	mg/L	92 ^[2]	50
Total Dissolved Solids	mg/L	769 ^[3]	791
Chloride	mg/L	202 ^[3]	239
Sodium	mg/L	129 ^[3]	137
Sulfate	mg/L	34 ^[3]	68
Boron	mg/L	0.43 ^[3]	0.34
Total Nitrogen	mg/L	19.6 ^[3]	21.2
Nitrate as Nitrogen	mg/L	0.13 ^[3]	2.3

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by California American Water in their 2018 to 2021 annual monitoring reports.

[3] Based on water quality data reported by California American Water in their 2004 to 2019 annual monitoring reports.

[4] Based on water quality data reported by California American Water in the 2021 annual monitoring report.

Table 4. Groundwater Quality for Select Constituents

Constituents	Units^[1]	MW-1 Historical Average^[2]	MW-1 Annual Average for 2021^[3]	MW-2 Historical Average^[2]	MW-2 Annual Average for 2021^[3]
Total Dissolved Solids	mg/L	530	370	1350	1000
Chloride	mg/L	100	50	120	135
Sodium	mg/L	80	50	90	80
Nitrate as Nitrogen	mg/L	1.0	0.01	60	30

[1] mg/L denotes milligrams per liter

[2] Based on water quality data reported by California American Water in their 2004 to 2020 annual monitoring reports.

[3] Based on water quality data reported by California American Water in the 2021 annual monitoring report.

3. WASTEWATER SYSTEM SPECIFIC REQUIREMENTS AND LIMITATIONS

California American Water must operate the Wastewater System in accordance with the General Permit and this notice of applicability. California American Water must comply with the wastewater specific limitations specified in Table 5 through Table 9. California

American Water land applies treated wastewater and thus organic loading limitations specified in Table 10 apply.

Flow limitations are shown in Table 5. Interim effluent limitations are shown in **Table 6** and apply for up to 24 months from the date of this notice of applicability. After 24 months, effluent limitations shown in **Table 7** apply. Effluent limits that are immediately attainable are shown in Table 8.

A. Flow Limitations:

Table 5. Flow Limitations

Flow	Units	Limit	Point of Compliance
Maximum Daily	Gallons per day	125,000	Influent
Average Monthly	Gallons per day	100,000	Influent

B. Effluent Limitations:

Based on reported water quality data, effluent water quality for 5-day Biochemical Oxygen Demand (BOD₅) and Total Suspended Solids (TSS) (see Table 3) exceed the General Permit effluent limits for Treatment Ponds. Therefore, pursuant to the General Permit, California American Water can comply with their individual permit No. 01-009 limits for two years. The individual permit No. 01-009 did not contain effluent limits for settleable solids, therefore there is no effluent limit for settleable solids for the first 24 months from the date of this notice of applicability. **After 24 months from the date of this notice of applicability, treatment pond effluent limitations shown in Table 7 apply.**

Table 6. Interim Effluent Limitations: Treatment Ponds

Constituent	Units	30-Day Average	7-Day Average
Biochemical Oxygen Demand, 5-Day	mg/L	not less than 85% removal	not less than 85% removal
Total Suspended Solids	mg/L	not less than 85% removal	not less than 85% removal
pH	Not Applicable	Between 6.5 and 8.3	Not Applicable

Table 7. Effluent Limitations: Treatment Ponds

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Biochemical Oxygen Demand, 5-Day	mg/L	45	65	Not Applicable

Constituent	Units	30-Day Average	7-Day Average	Sample Maximum
Total Suspended Solids	mg/L	45	65	Not Applicable
Settleable Solids	mL/L ^[1]	0.3	Not Applicable	0.5
pH	Not Applicable	Between 6.5 and 8.4	Not Applicable	Not Applicable

[1] mL/L denotes milliliters per liter

Based on existing water quality, **Table 8 effluent limits are immediately attainable and therefore apply as of the date of this notice of applicability.** Total nitrogen effluent limits apply in 24-months from the date of this notice of applicability, or California America Water could choose to monitor groundwater and verify compliance in groundwater.

Table 8. Effluent Limitations
Based on - Salinas Valley 180 foot Aquifer

Constituents	Units	25-Month Rolling Median
Total Dissolved Solids	mg/L	1500
Chloride	mg/L	250
Sodium	mg/L	150
Sulfate	mg/L	600
Boron	mg/L	0.5
Total Nitrogen	mg/L	Not applicable ¹

[1] A total nitrogen limit of 10 mg/L will apply 24-months from the date of this notice of applicability, or California America Water could choose to monitor groundwater to verify compliance in groundwater.

C. Groundwater Limitations:

California American Water must comply with Table 9 groundwater limitations immediately. Currently, California American Water is required to monitor groundwater semi-annually from two groundwater wells onsite. One well exceeds the total nitrogen limit (see Table 4). California American Water must either install additional wells to further evaluate groundwater and demonstrate compliance with total nitrogen limits, improve the system to reduce nitrogen loading to comply with Table 9 limits, or propose to consolidate with a neighboring wastewater system.

Table 9. Groundwater Limitations
for Designated Groundwater Basin - Salinas Valley 180 foot Aquifer

Constituents	Units	25-Month Rolling Median ^[1]
Total Dissolved Solids	mg/L	1,500
Chloride	mg/L	250
Sodium	mg/L	150
Sulfate	mg/L	600

Constituents	Units	25-Month Rolling Median ^[1]
Boron	mg/L	0.5
Total Nitrogen	mg/L	10

[1] Rolling Median is the median from all data collected over the most recent 25 months

Central Coast Water Board staff anticipates California American Water will need additional time, more than 24-months, to achieve compliance with the final effluent limitations provided in Table 7. Within 12 months from the date of this notice of applicability, California American Water must notify the Central Coast Water Board and refer to the General Permit to request a compliance time schedule order pursuant to Water Code section 13300 for consideration by the Central Coast Water Board.

D. Organic Loading Limitations

California American Water land applies treated wastewater and thus organic loading limitations specified in Table 10 apply.

Table 10. Organic Loading Limitations

Constituents	Units	30-Day Average	Maximum
Biochemical Oxygen Demand, 5-Day	Pounds/acre/day	100	300

ATTACHMENT 2

FIGURES



Figure 1. Overview of system and sample locations.



Figure 2. Facility Map. California American Water only owns Parcels 133072019000, 133072020000, 133072027000, and 133391009000.

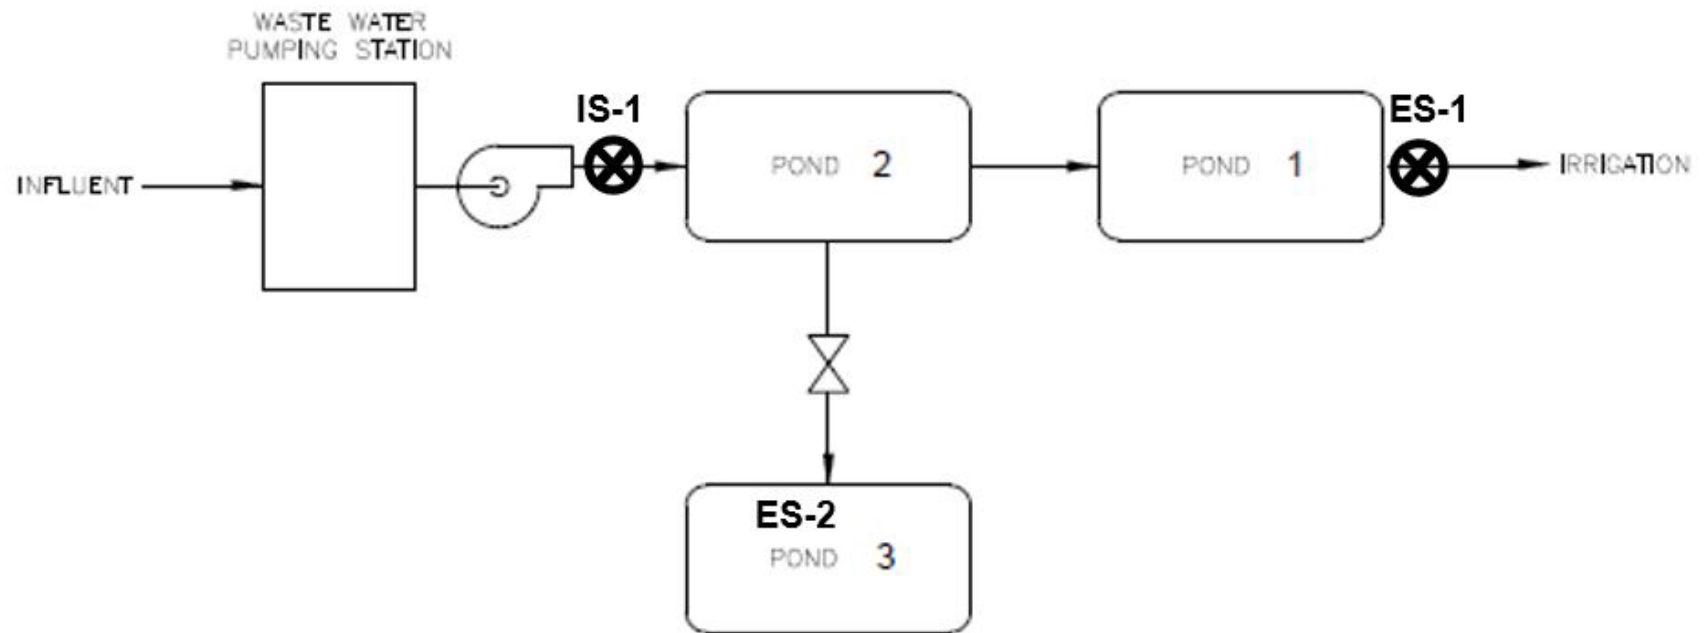


Figure 3. Process Flow Diagram from 2021 Annual Report.

ATTACHMENT 3
MONITORING AND REPORTING PROGRAM

CENTRAL COAST REGIONAL WATER QUALITY CONTROL BOARD

**MONITORING AND REPORTING PROGRAM NO. R3-2023-0036
(MODIFICATION OF MONITORING AND REPORTING PROGRAM
NO. R3-2020-0020)**

FOR

**OAK HILLS WASTEWATER TREATMENT PLANT
SALINAS, MONTEREY COUNTY**

May 4, 2023

This Monitoring and Reporting Program applies to the monitoring and reporting requirements for Oak Hills Wastewater Treatment Plant (Wastewater System) enrolled in *General Waste Discharge Requirements Order No. R3-2020-0020 for Discharges from Domestic Wastewater Systems with Flows Greater than 100,000 Gallons per Day* (General Permit).

California American Water owns and operates the Wastewater System that is subject to the General Permit and notice of applicability. California American Water must not implement any changes to this monitoring and reporting program unless and until a revised monitoring and reporting program is issued by the Central Coast Regional Water Quality Control Board (Central Coast Water Board).

The State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards are transitioning to the use of the publicly accessible State Water Board's GeoTracker database for the tracking of environmental and regulatory data for sites that operate under waste discharge requirements. The monitoring and reporting program directs California American Water to submit reports (both technical and monitoring reports) and analytical data electronically to the State Water Board's GeoTracker database (see monitoring and reporting program section VII.C).

I. SAMPLING AND ANALYSIS

California American Water must collect representative samples in accordance with the most recently approved sampling and analysis plan contained in the Operations and Maintenance Manual and validate analytical results prior to submittal to the Central Coast Water Board. All samples (e.g., wastewater, groundwater, soil, sludge, etc.) must be representative of the volume and nature of the discharge or matrix of materials sampled.

All samples must be collected by a qualified person, trained in proper procedures for collecting the samples. The name of the sampler, sample type (grab or composite), time, date, location, bottle/container type, and any preservative used for each sample must be recorded on the sample chain of custody form. The chain of custody form must also contain all custody information including date, time, and to whom samples were relinquished. If composite samples are collected, the basis for sampling (time or flow weighted) must be included in the sampling and analysis plan contained in the

Operations and Maintenance Manual for Central Coast Water Board review and approval.

- A. Sampling Schedule** – Unless otherwise specified below, sampling must be performed in accordance with Table 1.

Table 1. Sampling Schedule

Monitoring Period	Sample Collection Time
Quarterly	January, April, July, and October
Semiannual	April and October
Annual	October

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity, etc.) may be used if they are used by a State Water Board Environmental Laboratory Accreditation Program accredited laboratory, or:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are maintained and available for at least three years.

- B. Monitoring Location Descriptions** – All samples including influent samples (IS), effluent samples (ES), groundwater monitoring well (MW), etc. must be collected at the locations described in Table 2. These locations must be consistent with the Central Coast Water Board approved sampling and analysis plan. **California American Water must upload the GeoTracker field point information for each sampling location in the GeoTracker database once, prior to uploading laboratory data (see Table 10).**

Table 2. Sample Identification Details

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Influent Sample	IS-1	Raw wastewater sample collected at the influent discharge point at Pond 2
Effluent Sample 1	ES-1	Treated wastewater sample collected in Pond 1 at the irrigation disposal pump ^[1]

GeoTracker Field Point Class	GeoTracker Field Point Name (Sample ID)	GeoTracker Field Point Description
Effluent Sample 2	ES-2	Overflow of treated wastewater sample collected from Pond 3 at the influent outlet ^[1]
Monitoring Well 1	MW-1	Northeast of pond 1; no well screen information available.
Monitoring Well 2	MW-2	Southwest of pond 3; no well screen information available.

[1] Effluent samples must be taken at all ponds that are in service, or have standing water, at the time of sampling.

II. WATER SUPPLY MONITORING

Representative samples of California American Water's raw water supply (sampled before use or treatment) must be collected and analyzed, at a minimum, for constituents specified in Table 3. ⁶

In lieu of the required water supply sampling, California American Water may request Central Coast Water Board approval to submit a Well Identification Number and the reporting year's consumer confidence report (annual water quality report or drinking water quality report), as required by the State Water Board Division of Drinking Water and/or county, provided, at a minimum, all of the required constituents are sampled at the frequency specified in Table 3. California American Water must report the results of any constituent monitored more frequently than is required by the monitoring program shown in Table 3. California American Water must also report detectable concentrations (above the reporting limit) for any other constituent that has a published maximum contaminant level (MCL).

California American Water must evaluate and provide a tabular summary of the water supply data with the annual monitoring report.

Table 3. Water Supply Monitoring

Constituent	Units^[1]	Sample Type	Sampling Frequency
Nitrate (as N)	mg/L	Grab	Annually
Total Dissolved Solids	mg/L	Grab	Annually
Chloride	mg/L	Grab	Annually

⁶ California American Water may use the California Water Service Company's annual Water Quality Report for the water supply reporting when the data becomes available.

Constituent	Units ^[1]	Sample Type	Sampling Frequency
Sodium	mg/L	Grab	Annually
Sulfate	mg/L	Grab	Annually
Boron	mg/L	Grab	Annually
Carbonate	mg/L	Grab	Annually
Bicarbonate	mg/L	Grab	Annually
Calcium	mg/L	Grab	Annually
Potassium	mg/L	Grab	Annually
Magnesium	mg/L	Grab	Annually

[1] mg/L denotes milligrams per liter

III. INFLUENT AND EFFLUENT MONITORING

A. Influent and Effluent Flow Monitoring – California American Water must monitor and report flow in gallons per day, as described in Table 4, with each monitoring report. See monitoring and reporting program section VII.A.3 for supplemental volumetric annual reporting requirements established by the State Water Board.

Table 4. Influent and Effluent Flow Monitoring

	INFLUENT	INFLUENT	EFFLUENT	EFFLUENT
Parameter	Sample Type	Reporting Frequency	Sample Type	Reporting Frequency
Daily Flow ^[1]	Metered	Daily	Metered	Daily
Maximum Daily Flow	Metered	Monthly	Metered	Monthly
Mean Daily Flow	Calculated	Monthly	Calculated	Monthly

[1] The General Permit notice of applicability specifies the Wastewater System's maximum permitted flow. In the monitoring reports, California American Water must evaluate and provide a comparison of monitored flow to the permitted flow.

B. Wastewater System Monitoring – Representative samples of California American Water's influent (raw wastewater) into the Wastewater System and effluent (treated wastewater) discharged to land must be collected and analyzed in accordance with the treatment technology-based monitoring requirements (including sample type and frequency) summarized in the tables below. See Figures 1 and 2 for the location of samples and GeoTracker field points.

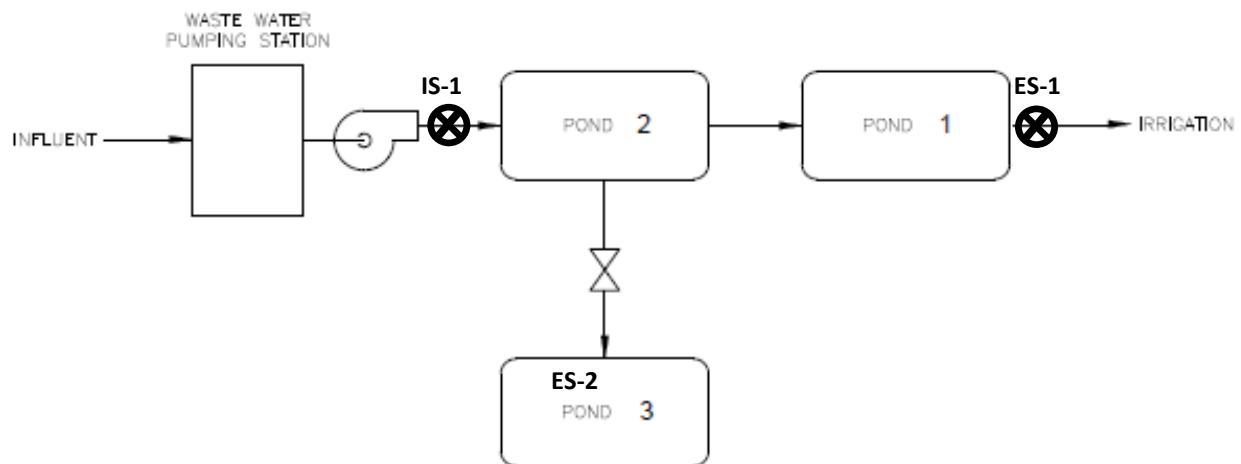


Figure 1. Process Flow Diagram and Sample Locations Referenced in Figure 2



Figure 2. Overview of system and sample locations.



Figure 3. Facility Map. California American Water only owns Parcels 133072019000, 133072020000, 133072027000, and 133391001000.

1. Pond System Monitoring

- i. **Required Pond Monitoring** – All wastewater treatment ponds must be monitored as specified in Table 5.

Table 5. Wastewater Treatment/Storage/Disposal Pond Monitoring

Parameter/ Constituent	Units	Sample Type	Sampling/Monitoring Frequency
Freeboard	0.1 feet	Measured	Weekly
pH	pH Units	Grab	Weekly
Dissolved Oxygen (in pond)	mg/L	Grab	Monthly
Odors	Not Applicable	Observation	Weekly
Berm condition	Not Applicable	Observation and Pictures	Monthly
Pond color and condition	Not Applicable	Observation and Pictures	Monthly
Sludge Depth	0.1 feet	Measured	Annually
Precipitation	inches/day and date	Measured ^[1]	Each precipitation event _[2]

- [1] California American Water may use a rain gauge or use a National Oceanic and Atmospheric Administration or the United States Geological Survey rain station, such as <http://scacis.rcc-acis.org/>.
- [2] A precipitation event is one producing precipitation of ½ inch or more.

- ii. **Influent and Effluent Monitoring** – At a minimum, influent and effluent constituent monitoring for the pond treatment systems must be monitored as specified in Table 6.

Table 6. Influent and Effluent Monitoring for Pond Treatment Systems

		INFLUENT IS-1	INFLUENT IS-1	EFFLUENT ES-1 and ES-2	EFFLUENT ES-1 and ES-2
Parameter/ Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Biochemical Oxygen Demand, 5-Day	mg/L	Grab	Monthly	Grab	Monthly
Total Suspended Solids	mg/L	Grab	Monthly	Grab	Monthly
Settleable Solids	mg/L	Not Applicable	Not Required	Grab	Monthly
Total Nitrogen ^[1]	mg/L	Calculated	Monthly	Calculated	Monthly
Nitrate (as N) + Nitrite (as N) or separate species	mg/L	Grab	Monthly	Grab	Monthly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Monthly	Grab	Monthly
Ammonia (as N)	mg/L	Grab	Monthly	Grab	Monthly
Total Dissolved Solids	mg/L	Grab	Monthly	Grab	Quarterly
Chloride	mg/L	Grab	Monthly	Grab	Quarterly
Sodium	mg/L	Grab	Monthly	Grab	Quarterly
Sulfate	mg/L	Grab	Monthly	Grab	Quarterly
Boron	mg/L	Not Applicable	Not Required	Grab	Quarterly
Carbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Bicarbonate	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Calcium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually

		INFLUENT IS-1	INFLUENT IS-1	EFFLUENT ES-1 and ES-2	EFFLUENT ES-1 and ES-2
Parameter/ Constituent	Units	Sample Type	Sampling Frequency	Sample Type	Sampling Frequency
Potassium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually
Magnesium	mg/L	Not Applicable	Not Applicable	Grab	Semiannually

[1] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

IV. WASTEWATER DISPOSAL MONITORING

California American Water must monitor all wastewater disposal areas (e.g., land application areas, percolation ponds, etc.) when wastewater is applied. Inspections (observations) must be conducted as described in Table 7. Notations must be made in a bound logbook and problems must be promptly corrected and recorded. A log of these inspections must be maintained onsite and made available to Central Coast Water Board upon inspection. Observations do not need to be reported in the monitoring reports unless a violation of permit conditions is observed. If violations are observed, planned, and implemented mitigation measures to address the violations must be reported.

California American Water must evaluate and summarize wastewater disposal application rates, loading rates (pounds/acre/day), violations found during the inspections, etc. with each monitoring report.

California American Water must report when the sprayfield disposal area has been rotated/changed. This must be reported to the Central Coast Water Board in the first monitoring report due following the change.

Table 7. Wastewater Disposal Monitoring

Constituent	Units	Sample Type	Monitoring Frequency
Supplemental Irrigation	Gallons per day	Metered/Estimated ^[1]	Daily
Local Precipitation	Inches/day	Weather Station ^[2]	Each precipitation event
Acreage Applied ^[3]	Acres	Measured	Daily
Application Rate	Gallons per day	Metered/Estimated ^[1]	Daily

Constituent	Units	Sample Type	Monitoring Frequency
Average Monthly Biochemical Oxygen Demand, 5-Day (BOD) Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly
Maximum Daily BOD ₅ Applied ^[5]	lbs/acre/day	Calculated	Monthly
Total Nitrogen Applied ^[4] ^[5]	lbs/acre/day	Calculated	Monthly
Salts Applied ^[4] ^[5] (total dissolved solids, sodium, chloride, sulfate, boron)	lbs/acre/day	Calculated	Monthly
Soil Erosion Evidence	Not Applicable	Observation	Monthly
Containment Berm Condition	Not Applicable	Observation	Monthly
Soil Saturation/Ponding	Not Applicable	Observation	Monthly
Nuisance Odors/Vectors	Not Applicable	Observation	Monthly
Discharge Offsite	Not Applicable	Observation	Monthly

- [1] Requires meter reading, a pump run time meter, or other approved method. If the flow is estimated, California American Water is required to provide an explanation (e.g., no meter-estimated using pump operations including rate and time) with each monitoring report.
- [2] California American Water must have a rain gauge or use a NOAA or USGS rain station, such as <http://scacis.rcc-acis.org/>.
- [3] Acreage applied denotes the acreage to which wastewater is applied.
- [4] The total nitrogen, salts, and BOD applied loading rates must be calculated from wastewater flow volumes, applied acreage, and concentrations reported in effluent analytical testing as follows:

Total Nitrogen/Salts/BOD Applied (pounds/acre/ day) =

$$\frac{X \text{ [mg/L]} \times Q \text{ [million gallons per day]} \times 8.34 \text{ [(conversion from mg/L to pounds/million gallons per day)]}}{\text{Acreage Applied [acres]}}$$

Where X = Total nitrogen, salts, or BOD concentration

Where Q = Application Rate (often effluent flow rate)

- [5] Frequencies of analytical testing are defined in the influent and effluent monitoring tables (Table 5, Table 6, and Table 7).

V. SLUDGE/BIOSOLIDS DISPOSAL MONITORING

California American Water must report the handling and disposal of all sludge/biosolids generated at the Wastewater System. Records must include the date removed from the Wastewater System, name/contact information for the hauling company, the type and volume of waste transported, the disposal facility name and address, and copies of analytical data required by the entity accepting the waste. These records must be submitted as part of the annual monitoring report.

California American Water must also monitor sludge/biosolids consistent with a Central Coast Water Board approved sludge management plan and in accordance with the requirements specified by the receiving party, including a regulated landfill and/or regulated composting facility.

If sludge/biosolids are not removed during the year, California American Water must explain the absence of this monitoring in the annual report.

VI. GROUNDWATER MONITORING

Monitoring data submitted to the Central Coast Water Board shows that California American Water cannot meet groundwater limitations (e.g. for nitrate) in the notice of applicability and water quality objectives specified in the Basin Plan in effluent water. Therefore, California American Water must implement a groundwater monitoring program to demonstrate compliance with the groundwater limitations in the notice of applicability and water quality objectives specified in the Basin Plan. Groundwater monitoring reports, workplans, etc., that interpret groundwater data must be prepared and stamped by a California licensed civil engineer or professional geologist.

California American Water must monitor MW-1 and MW-2 consistent with Table 8⁷.

Prior to sampling, depth to groundwater must be measured and groundwater elevations⁸ must be calculated. The monitoring wells must be purged of at least three well volumes and until measurements of the following parameters have stabilized (i.e., are reproducible within 10 percent): pH, temperature, dissolved oxygen, electrical conductivity, and turbidity. No-purge, low-flow, or other sampling techniques are acceptable only if they are approved in advance by the Central Coast Water Board and described in an approved sampling and analysis plan. Once the groundwater level in each of the wells has recovered sufficiently to ensure the collection of representative groundwater samples, a qualified individual (e.g., consultant, technician, etc.) trained in using proper sampling methods must recover samples using approved USEPA methods. Laboratories analyzing groundwater samples must be accredited by the State Water Board Environmental Laboratory Accreditation Program, in accordance with California Water Code section 13176, and must include quality assurance/quality control data with their reports.

California American Water must provide monitoring well field sheets and report monitoring data, as described in Table 8, with each monitoring report.

⁷ Additional monitoring wells and a hydrogeologic assessment and work plan may be required in the future, depending on the feasibility assessment and time schedule compliance plan.

⁸ The locations and top-of-casing elevations for the existing groundwater monitoring wells must be surveyed by a licensed land surveyor if not already completed at the time of installation.

Table 8. Groundwater Monitoring

Constituent	Units	Sample Type	Sampling Frequency
Groundwater Elevation ^[1]	0.01 ft msl	Calculated	Quarterly
Depth to Groundwater ^[1]	0.01 ft bgs	Measurement	Quarterly
Gradient	feet/feet	Calculated	Quarterly
Groundwater Flow Direction ^[4]	degrees	Calculated	Quarterly
Total Nitrogen ^[5]	mg/L	Calculated	Quarterly
Nitrate (as N) + Nitrite (as N)	mg/L	Grab	Quarterly
Total Kjeldahl Nitrogen (as N)	mg/L	Grab	Quarterly
Carbonate	mg/L	Grab	Semiannually
Bicarbonate	mg/L	Grab	Semiannually
Calcium	mg/L	Grab	Semiannually
Potassium	mg/L	Grab	Semiannually
Magnesium	mg/L	Grab	Semiannually

[1] ft.msl denotes feet above mean sea level and ft bgs denotes feet below ground surface.

[2] $\mu\text{S/cm}$ denotes microsiemens per centimeter

[3] mV denotes millivolts

[4] Calculations must be prepared by, or under the responsible charge of, a California licensed professional. Currently, there are only two wells and three wells are needed to calculate the groundwater flow direction. California American Water can estimate the flow direction with the two wells until a third well is installed.

[5] Total nitrogen is the sum of total inorganic nitrogen (nitrate + nitrite + ammonium + ammonia) and organic nitrogen.

VII. REPORTING REQUIREMENTS

A. QUARTERLY AND ANNUAL MONITORING REPORTS

Quarterly and annual monitoring reports are due as described in Table 9.

Table 9. Quarterly and Annual Monitoring Reporting

Report	Monitoring Period	Report Due Date
First Quarter Monitoring Report	January 1 to March 31	May 1
Second Quarter Monitoring Report	April 1 to June 30	August 1

Report	Monitoring Period	Report Due Date
Third Quarter Monitoring Report	July 1 to September 30	November 1
Fourth Quarter Monitoring Report	October 1 to December 31	February 1
Annual Report	January 1 to December 31	March 1
State Water Board Volumetric Annual Reporting	January 1 to December 31	April 30

1. **Quarterly Monitoring Reporting** – At a minimum, the quarterly reports must include:
 - i. Results of all required monitoring in tabular format.
 - ii. The results of any pollutant or parameter monitored more frequently than is required by this monitoring program. Values obtained through additional monitoring must be used in calculations as appropriate.
 - iii. A comparison of monitoring data to the discharge specifications, applicable effluent limitations, disclosure of any violations of the notice of applicability and/or General Permit, and an explanation of any violation of those requirements. California American Water **must calculate 7-day averages, 30-day averages and 25-month rolling medians for select analytes when comparing monitoring data to applicable effluent limitations specified in the General Permit.** Data must be presented in tabular format.
 - iv. Copies of laboratory analytical report(s) and chain of custody form(s).
 - v. Copies of groundwater monitoring well field sheets with purge methods and data.
2. **Annual Reporting** – California American Water must submit annual reports in compliance with Standard Provisions 2013⁹, (and any updates to the Standard Provisions) Section C, General Reporting Requirements, Item 16 using the most recent annual report template provided by Central Coast Water Board.

The current annual report template can be found here:

https://www.waterboards.ca.gov/centralcoast/board_decisions/adopted_orders/2020/wdr_annual_report_format.pdf

3. **State Water Board Volumetric Annual Reporting** – California American Water must electronically certify and submit a summary of the monthly influent and

⁹ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

effluent flow volume by April 30th of each calendar year via the State Water Board's Internet GeoTracker database¹⁰.

The following information is required:

- i. Monthly volume of wastewater collected and treated by the wastewater treatment plant (i.e. total monthly influent volume).
- ii. Monthly volume of wastewater treated, specifying level of treatment, including treated wastewater discharged.
- iii. If applicable, monthly volume of recycled water distributed, and annual volume of treated wastewater distributed for beneficial use in compliance with California Code of Regulations, title 22 use categories.

Additional information about volumetric annual reporting of wastewater and recycled water and the Recycled Water Policy is available at the Recycled Water Policy Volumetric Annual Reporting Website¹¹.

B. VERBAL NON-COMPLIANCE REPORTING:

California American Water must verbally notify and report to Central Coast Water Board noncompliance of limits related to pond freeboard, flow rate, bypass or overflow, and wastewater containment failure, pursuant to General Permit section VI.C.2.

C. ELECTRONIC GEOTRACKER SUBMITTAL

All monitoring reports must be provided electronically in a searchable PDF format, with the Central Coast Water Board's current transmittal sheet found at the link below as the cover page. The transmittal sheet must be signed.

https://www.waterboards.ca.gov/centralcoast/water_issues/programs/wastewater_permittting/docs/transmittal_sheet.pdf

California American Water must submit all reports/documents and laboratory analytical data to the State Water Board's GeoTracker^{12,13} database consistent with applicable Electronic Submittal of Information (ESI) requirements under the Wastewater System-specific global identification number WDR100029562 at:

<https://geotracker.waterboards.ca.gov/esi/login>

For general questions, please contact the GeoTracker Help Desk at:
Geotracker@waterboards.ca.gov.

¹⁰ See: <https://geotracker.waterboards.ca.gov/>

¹¹ See: [Volumetric Annual Reporting | California State Water Resources Control Board](#)

¹² Information for first-time GeoTracker users is available at:

https://www.waterboards.ca.gov/ust/electronic_submittal/docs/beginnerguid2.pdf

¹³ Additional information available at:

<https://geotracker.waterboards.ca.gov/>

Table 10 summarizes all the GeoTracker electronic reporting requirements. Central Coast Water Board may request submittal of some documents on paper, particularly drawings or maps that require a large size to be readable, or in other electronic formats where evaluation of data is required.

Table 10. GeoTracker Electronic Submittal Information Data Requirements

Electronic Submittal	Description of Action	Action	Frequency
Reports and Documents	Complete copy of all documents including monitoring reports (in searchable PDF format) and any other associated documents related to the Wastewater System.	Upload directly to GeoTracker all monitoring reports (in searchable PDF format) and any other associated documents.	On or before the due dates required by this General Permit and for other documents when required by the Central Coast Water Board.
Laboratory Data	All analytical data (including geochemical data) in electronic deliverable format (EDF). This includes all water, soil, and vapor samples collected when monitoring a discharge.	Upload, or direct your California ELAP-accredited laboratory staff to upload, all EDF laboratory data directly to GeoTracker.	On or before the due date of the required monitoring report.
Depth to Groundwater	Monitoring wells must have the depth-to-water information reported. Report data only for wells defined as permanent sampling points.	Upload depth-to-water information to the GeoTracker GEO_WELL file.	On or before the due date of the required monitoring report.
Boring Logs and Well Screen Intervals	Boring logs must be prepared by a registered professional and submitted in PDF format separately (not only as attachments to reports).	Upload boring logs (in searchable PDF format) to GeoTracker GEO_BORE file whenever a new boring is drilled.	Every time a new boring is drilled.

Electronic Submittal	Description of Action	Action	Frequency
Field Points, Location Data (Geo XY) ^[1]	Name, classify, and identify the location (latitude and longitude) of all sampling points. Monitoring wells must be surveyed, influent and effluent sample locations must be identified on the GeoTracker mapping tool under “non-surveyed data.” These data points are required prior to laboratory data uploads.	Upload the location data (surveyed and non-surveyed) to the GeoTracker Geo_XY file.	Every time a permanent monitoring point is established.
Elevation Data (Geo Z) ^[2]	Survey and mark the elevation at the top of groundwater well casings for all permanent groundwater wells. These points are required prior to depth-to-water data uploads.	Upload the survey data to the GeoTracker GEO_Z file.	One-time, for all groundwater monitoring wells.
Geo Map	Site layout, map of facilities, Wastewater System including treatment and disposal area(s).	Upload the Site layout PDF to the GeoTracker site plan file.	Year one and every five years thereafter and when the facilities are modified.

[1] Geo XY required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data. California American Water must also upload sample locations (e.g., influent and effluent samples) that are not defined as a **permanent monitoring well** and have not been surveyed by a licensed professional.

[2] Geo Z required for all wells. New wells must be surveyed. For existing wells, use original well installation survey data.

TECHNICAL REPORTS

The technical reports are due as described in Table 11.

Table 11. Technical Report Submittal Due Dates

Report	Report Due Date
Pond Liner Permeability Report	(May 4, 2024)
Operations and Maintenance Manual	(May 4, 2024)
Climate Change Adaptation Plan	(May 4, 2025)
Time Schedule Compliance Plan	(May 4, 2024)
Groundwater Monitoring Well Workplan ^[1]	(June 4, 2024)

[1] Required if California American Water choose the point of compliance as groundwater for nitrate.

1. **Pond Liner Permeability Report**– In accordance with General Permit Section IV.B.1 all treatment, storage, and evaporation ponds must be lined¹⁴ to protect groundwater and associated beneficial uses. Existing wastewater treatment, storage, or evaporation ponds constructed prior to the adoption date of the General Permit where the type of existing lining systems is unknown must be evaluated by a California licensed Professional Engineer or Professional Geologist for permeability and a report submitted to the Central Coast Water Board for approval within one year of the date of enrollment in this General Permit (issuance of the notice of applicability). Therefore, California American Water must submit a pond liner permeability report in one year.
2. **Operations and Maintenance Manual** – In addition to the required components specified in Standard Provisions¹⁵ A.12 and A.28 (and any updates to the Standard Provisions) and General Permit section VI.A.2, the Operations and Maintenance Manual must contain the following components. Each component must contain an implementation schedule and identification of adequate funding to implement the component.
 - i. **Sampling and Analysis Plan** – California American Water’s Operation and Maintenance Manual must contain a sampling and analysis plan that meets the requirements specified herein. Anyone performing sampling on behalf of California American Water must be familiar with the sampling and analysis plan. At a minimum, the sampling and analysis plan must contain the following:
 - a. A wastewater treatment process flow schematic with the monitoring locations labeled and scaled Wastewater System maps with treatment components, discharge locations (both treated wastewater and non-potable recycled water), monitoring locations, groundwater wells, storage locations (e.g., chemical, sludge, emergency overflow ponds, etc.), buildings, etc. (if California American Water needs to update Figure 1 and 2 to comply with this requirement, a copy of the updated process flow schematic will also be included with the annual report).

¹⁴ Liner must have a permeability of less than 1×10^{-6} centimeters per second and may be constructed with synthetic materials, two feet of low permeable soils, or another engineered alternative. Discharger must provide documentation for Central Coast Water Board approval to confirm that a treatment, storage, or evaporation pond is sufficiently impermeable to prevent discharges of untreated or partially treated wastewater.

¹⁵ See Attachment E, Standard Provisions, 2013:

https://www.waterboards.ca.gov/centralcoast/board_decisions/docs/wdr_standard_provisions_2013.pdf

- b. Sample identification details in tabular format. The table must include the sample titles, GeoTracker field point information, sample description(s), and sampling frequencies.
 - c. Sample chain-of-custody procedures and documentation.
 - d. Sample handling/preservation procedures.
 - e. A description of the analytical methods.
 - f. A description of sample containers, preservatives, and holding times.
 - g. For water supply monitoring, a description of the location and method of data collection (e.g., onsite well sampling, use of consumer confidence report, etc.).
 - h. For groundwater monitoring, a description of the well purging and field methods.
- ii. **Sludge Management Plan** – California American Water’s Operation and Maintenance Manual must contain a sludge management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the plan must describe the following:
 - a. An estimated volume/amount and quality of sludge and scum that will be generated.
 - b. How sludge, scum, and supernatant will be stored and disposed of to protect groundwater quality.
 - c. If sludge will be subject to further treatment, describe the treatment and storage requirements.
 - d. Procedures for cleaning of digesters or storage vessels and the treatment and disposal of the residuals. If drying of residuals is planned, describe how that will be performed to prevent nuisance odors, prevent vectors, and protect groundwater quality.
- iii. **Wastewater Disposal Management Plan** – California American Water’s Operation and Maintenance Manual must contain a wastewater disposal management plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. At a minimum, the wastewater disposal management plan must include:
 - a. A description of the wastewater disposal area and a map denoting acreage.
 - b. Loading calculations based on flow volumes, applied acreage, and biochemical oxygen demand, salts (total dissolved solids, sodium, chloride, sulfate, boron), and nitrogen analytical results.

- c. A description of wastewater disposal and water quality protection practices.
- iv. **Spill Prevention and Emergency Response Plan** – California American Water’s Operation and Maintenance Manual must contain a spill prevention and emergency response plan that is sufficient to ensure compliance with the terms of the General Permit and the notice of applicability. The spill prevention and emergency response plan must describe operation and maintenance activities to prevent accidental releases of wastewater and to effectively respond to such releases and minimize the environmental impact. At a minimum, the spill prevention and emergency response plan must address the following:
 - a. Operation and Control of Wastewater System - A description of the wastewater treatment equipment, operational controls, flow measurement and calibration procedures, and treatment system schematic including valve/gate locations.
 - b. Sludge Handling - A description of the sludge handling equipment, operational controls, and disposal procedures.
 - c. Collection System Maintenance - A description of collection system cleaning and maintenance, equipment tests, and alarm functionality tests to minimize the potential for wastewater spills originating in the collection system or headworks. For collection systems subject to State Water Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (or its replacement), reports prepared to comply with State Water Board Order No. 2006-0003-DWQ satisfy this requirement.
 - d. Emergency Response - A description of emergency response procedures including for emergencies such as power outage, severe weather, flooding, or inadequate freeboard (for systems with wastewater treatment, storage, or disposal ponds or treated non-potable recycled water storage ponds). An equipment and telephone list for contractors/consultants, emergency personnel, and equipment vendors.
 - e. Finance - At a minimum, discuss current fees, projected fees, current budget for spill prevention and emergency response, projected budget for spill prevention and emergency response.
 - f. Notification Procedures - Coordination procedures with fire, police, Governor’s Office of Emergency Services (CalOES), Central Coast Water Board, and local county health department personnel.
- v. **Training Records Log** – California American Water’s Operation and Maintenance Manual must contain updated training records logs that

demonstrates California American Water is complying with General Permit section VI.B.3.

3. **Climate Change Adaptation** –The Climate Change Adaptation Plan must, at a minimum, include the following components:
 - i. Hazards and Vulnerabilities – Identify climate change hazards, at a minimum accounting for the hazards listed below, applicable to the Wastewater System. Using up-to-date tools, data, and guidance from the State of California (e.g., Cal-Adapt¹⁶, Sea-Level Rise Guidance from Ocean Protection Council, reports from the Climate-Safe Infrastructure Working Group, the Climate Adaptation Planning Guide, and California Climate Assessment Regional Reports), assess the Wastewater System's vulnerability to identified hazards that could cause reduction, loss, or failure of treatment processes and/or critical structures at the Wastewater System. Identify and justify the resources (e.g., models and tools, design parameters) used to inform identification of these hazards and vulnerabilities.
 - a. Sea Level Rise – Saltwater intrusion, flooding and inundation, and increased coastal erosion.
 - b. Precipitation Pattern Changes.
 - I. Drought – Decreased influent quantity and quality.
 - II. Peak Events – Flooding and increased influent quantity.
 - c. Temperature fluctuations and extremes.
 - d. Increased wildfires.
 - e. Increased power outages.
 - ii. Resiliency Actions – Identify actions to build Wastewater System and operational resilience to identified vulnerabilities, accounting for options that minimize resource impacts.
4. **Time Schedule Compliance Plan** - As set forth in General Permit sections V.A and VI.A.5, if California American Water anticipates that additional time is needed to achieve compliance with the effluent limitations, California American Water must prepare and submit for Central Coast Water Board review and

¹⁶ Cal-Adapt is an online resource with downscaled climate project data. It provides users with projections and more detailed downloadable data supporting a range of needs and array of climate models and emissions scenarios. Cal-Adapt offers climate projections for the major stressors facing California, including the following: temperature averages and extremes, precipitation averages and extremes, sea-level rise, wildfires, and drought. The Governor's Office of Planning and Research (OPR) recommends agencies use Representative Concentration Pathway (RCP) 8.5 for analyses considering impacts through 2050, because there are minimal differences between emissions scenarios during the first half of the 21st century.

approval, a time schedule compliance plan. At a minimum, the time schedule compliance plan must address the following:

- i. Comparison of the current effluent quality to the effluent and groundwater limitations in General Permit Tables 3-6.
 - ii. A detailed description and chronology of efforts, since issuance of the notice of applicability, to reduce wastes.
 - iii. Justification of the need for additional time to achieve the effluent limitations in General Permit Tables 3-6.
 - iv. A detailed time schedule of specific actions California American Water will take to achieve the effluent limitations.
 - v. A demonstration that the time schedule requested is as short as possible, considering the technological, operation, and economic factors that affect the design, development, and implementation of the measures that are necessary to comply with the effluent limitation(s).
 - vi. If the requested time schedule exceeds one year, the proposed schedule shall include interim requirements and the date(s) for their achievement. The interim requirements shall include both of the following:
 - a. Effluent limitation(s) for the pollutant(s) of concern.
 - b. Actions, measurable milestones, and tangible products leading to compliance with the effluent limitation(s).
5. **Groundwater Monitoring Workplan** – If, in the Time Schedule Compliance Workplan, California American Water proposes groundwater as the point of compliance for nitrogen it must submit a Groundwater Monitoring Workplan. This workplan is not required if California American Water will consolidate or upgrade the system to treat nitrogen and meet the nitrogen effluent limit. **The workplan must be submitted 13 months from the** issuance of notice of applicability.

At a minimum, the workplan must include a preliminary hydrogeologic conceptual site model and propose the installation of at least three shallow groundwater monitoring wells to establish groundwater gradient, groundwater flow velocity and direction, and evaluate groundwater quality influenced by the wastewater disposal. The number and location of the proposed groundwater monitoring well network must be on a scale sufficient to determine potential impacts and be sufficiently representative of groundwater conditions upgradient and downgradient of the permitted disposal area. The groundwater monitoring wells should not be installed prior to Central Coast Water Board approval of the groundwater monitoring workplan and preliminary hydrogeologic conceptual site model.

The groundwater monitoring wells must be installed within first encountered groundwater and in accordance with California Department of Water Resources

May 4, 2023

Bulletin No. 74-81 and Supplement No. 74-90, California Water Code sections 13710 through 13755, and any local permitting requirements. The locations and top-of-casing elevations for the newly installed monitoring wells must be surveyed by a licensed land surveyor. California American Water must begin sampling¹⁷ the Central Coast Water Board approved groundwater monitoring well network within **90 days** of receiving Central Coast Water Board approval.

VIII. LEGAL REQUIREMENTS

The Central Coast Water Board's requirements that the California American Water submit the technical and monitoring reports described in this monitoring and reporting program are made pursuant to [section 13267 of the California Water Code](#). Failure to submit reports in accordance with schedules established by this General Permit and notice of applicability with attachments or failure to submit a report of sufficient technical quality to be acceptable to the Central Coast Water Board may subject California American Water to enforcement action pursuant to section 13268 of the California Water Code. Pursuant to [section 13268 of the Water Code](#), a violation of a request made pursuant to section 13267 may subject California American Water to civil liability assessment of up to \$1,000 per day in which the violation occurs.

The Central Coast Water Board needs the required information to ensure compliance with the notice of applicability and the General Permit. California American Water is required to submit this information because it is subject to the General Permit and is responsible for the discharge.

The burden, including costs, of the reports bears a reasonable relationship to their need and the benefits to be obtained. The requirement for the reports is necessary to ensure compliance with the General Permit, notice of applicability, and monitoring and reporting program to protect water quality.

California American Water must implement the above monitoring program on July 1, 2023. The Central Coast Water Board may rescind or modify this monitoring and reporting program at any time.

Ordered By:

for Matthew T. Keeling
Executive Officer

\\ca.epa.local\RB\RB3\Shared\WDR\WDR Facilities\Monterey Co\Oak Hills Development\Big Order enrollment\Oak Hills NOA_MRP_final.docx

¹⁷ Well installation must be supervised by a California licensed Civil Engineer or Professional Geologist.