

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. 6-01-12
WDID NO. 6A265300900

UPDATED WASTE DISCHARGE REQUIREMENTS
FOR

BRIDGEPORT PUBLIC UTILITY DISTRICT WASTEWATER DISPOSAL FACILITY

Mono County

The California Regional Water Quality Control Board, Lahontan Region (Regional Board) finds:

1. Discharger

Bob Loding, an employee of Tri-State Water Operations, Inc. and Certified Operator for the Bridgeport Public Utility District (PUD) Wastewater Disposal Facility, submitted a complete report of waste discharge on behalf of the Bridgeport PUD on December 4, 2000. For the purposes of this Order, the Bridgeport PUD is referred to as the "Discharger."

2. Facility

The Bridgeport PUD Wastewater Disposal Facility is the facility from which the discharge occurs. For the purposes of this Order, the Bridgeport PUD Wastewater Disposal Facility is referred to as the "Facility." The Facility discharges domestic wastewater from the service area of the Bridgeport PUD.

3. History of Previous Regulation by the Regional Board

The Regional Board previously established waste discharge requirements (WDRs) for the Facility under Board Order No. 6-77-4 and Board Order No. 6-91-918, which were adopted on January 13, 1977 and September 12, 1991, respectively. The requirements under Board Order No. 6-77-4 were adopted to regulate the disposal of domestic wastewater from the Bridgeport PUD system. Board Order No. 6-91-918 updated those WDRs as part of a statewide review program.

4. Reason for Action

The Regional Board is updating WDRs as part of an ongoing program to periodically review and revise requirements to reflect current regulatory policies, and incorporate monitoring and reporting program revisions, including certain changes requested by the Discharger.

**BRIDGEPORT PUD
WASTEWATER DISPOSAL FACILITY
Mono County**

-2-

**BOARD ORDER NO. 6-01-12
WDID NO. 6A265300900**

5. Facility Location

The Bridgeport PUD is located in the community of Bridgeport, Mono County, within portions of Section 28, R25E, T5N, MDB&M as shown on Attachment "A," which is made a part of this Order.

6. Description of Facility and Discharge

The Discharger proposes to continue operation of the existing wastewater disposal Facility, consisting of two percolation ponds and three oxidation ponds as shown in Attachment "B," which is made part of this Order. The oxidation ponds are unlined. The capacity of oxidation pond No. 1 is approximately 1.5 million gallons. The capacity of oxidation ponds No. 2 and No. 3 are each approximately one million gallons. An aerator was added to oxidation pond No. 1 in 2000. Aerators are proposed to be added to the remaining two oxidation ponds by June of 2002. The Facility treats and disposes up to 0.200 million gallons per day (MGD) of domestic wastewater from the service area of the Bridgeport PUD. Septage from holding tanks and septic tanks is not accepted at the Facility. The population served by the Facility is approximately 300 persons. The sewer connections total approximately 100. Not all areas within the service area are sewered.

7. Sludge Treatment and Disposal

Sludge is currently retained in the three oxidation ponds. Excessive sludge build-up is not an identified problem, and no sludge is proposed to be removed from the Facility at this time. The Facility has no known hazardous waste component and sludge contained in the ponds is presumed to be of relatively high quality, with low levels of heavy metals or other toxic constituents.

8. Disposal Area

The disposal area consists of two percolation ponds that accept effluent from the oxidation ponds. The oxidized wastes either evaporate or percolate into the soil beneath the ponds.

9. Authorized Disposal Site

The oxidation and percolation ponds are the only authorized disposal sites for wastewater and sludge and are shown in Attachment "B." The authorized disposal sites are located on land owned by Bridgeport PUD and operated by Tri-state Water Operations, Inc.

10. Site Geology

The Facility lies at the edge of an alluvial valley along the eastern escarpment of the Sierra Nevada mountains. The substrata at the authorized disposal site consists of alluvium from the Sierra Nevada to the west. Information is not available to determine the percolation rate. Well logs indicate that the subsurface consists of alternating layers of sandy gravel, clayey gravel, sand, sandy clay, and clay.

11. Site Hydrology

The Facility is located on mildly sloping terrain within an alluvial valley, at an elevation of approximately 6,600 feet. The annual rainfall in the area is approximately 10 inches. An ephemeral drainage channel which is tributary to Bridgeport Reservoir is located near the north side of the Facility and is a potential receiving water for any unauthorized waste discharges. Bridgeport Reservoir is located approximately one half mile downgradient from the Facility.

12. Site Hydrogeology

The local groundwater flow direction follows the surface topology, generally west toward Bridgeport Reservoir. Well logs and recent groundwater elevation monitoring measurements suggest confined conditions may exist below an 11 foot clay layer that lies approximately 47 feet below ground surface. During well installation in 1990, the depth to groundwater beneath the Facility was found to be 58 feet, just below the aforementioned clay layer. The groundwater well and two vadose zone monitoring wells were installed west (downgradient) of the Facility in 1990 as part of Pollution Study No. 49 and monitored during that study. These wells are labeled in Attachment "B" as Groundwater Monitoring Well 1-A and Vadose Monitoring Wells #2 and #3. The Discharger has not monitored Wells #2 or #3 since they were found to be dry at a depth of approximately 30 feet in Pollution Study No. 49. However, a perched aquifer may exist during periods following heavy precipitation or during years of above average precipitation. Another well lies to the northwest of the Facility, labeled as "Pre-existing Groundwater Monitoring Well" in Attachment "B." The Discharger has not been required to monitor the pre-existing well in the past and no information on the well is presently available. However, the pre-existing well may be a potential location for additional groundwater monitoring.

13. Receiving Waters

The receiving waters are the ground and surface waters of the Bridgeport Valley Basin (Department of Water Resources Basin No. 6-8) and Bridgeport Hydrologic Area (Department of Water Resources Hydrologic Unit No. 630.30), respectively.

14. Lahontan Basin Plan

The Regional Board adopted a *Water Quality Control Plan for the Lahontan Region* (Basin Plan) on March 31, 1995. This Order implements the Basin Plan, as amended.

15. Beneficial Uses of Ground Water

The beneficial uses of the ground waters of the Bridgeport Valley Basin, as set forth and defined in the Basin Plan, are:

- a. municipal and domestic supply
- b. agricultural supply
- c. industrial service supply
- d. freshwater replenishment

16. Beneficial Uses of Surface Water

The beneficial uses of the surface waters of the Bridgeport Hydrologic Area, East Walker River (above Bridgeport Reservoir) subarea, as set forth and defined in the Basin Plan, are:

- a. municipal and domestic supply
- b. agricultural supply
- c. groundwater recharge
- d. freshwater replenishment
- e. navigation
- f. water contact recreation
- g. non-contact water recreation
- h. commercial and sportfishing
- i. cold freshwater habitat
- j. wildlife habitat
- k. rare, threatened, or endangered species
- l. spawning, reproduction, and development

17. Constituents of Concern and Monitoring Parameters

The Discharger has recently installed an aerator into oxidation pond No. 1 to address biochemical oxygen demand (BOD) values that exceeded effluent limits and resulting odor problems due to insufficient dissolved oxygen. BPUD obtained a two million dollar loan/grant in 2001 from the United States Department of Agriculture, Rural Development for the installation of two additional aerators for the oxidation ponds No. 2 and No. 3, and repairs to collection system components (sewer and pump repairs). Previous WDRs included oxidation pond effluent limitations for dissolved oxygen (DO), but did not require the Discharger to monitor DO. The updated monitoring and reporting program (MRP) has been revised to include DO as a required monitoring parameter. Methylene Blue Active Substances (MBAS) monitoring frequency has been revised in this Order from quarterly to annually since previous monitoring reports indicate that MBAS are values well-below effluent limitations. The MRP for the Facility has been updated to include Total Phosphorus as a required quarterly monitoring parameter. In order to ensure adequate protection of beneficial uses for groundwater, the MRP for the Facility has been updated to include a requirement for additional wells to be installed, if necessary, to insure that the effects of the discharge on local groundwater quality are adequately monitored. Comments from the Discharger on the Tentative requirements received on February 8, 2001 indicate that the Discharger objects to this requirement for cost reasons. The fact that the Discharger may object to the requirement does not relieve the Discharger from responsibility to provide groundwater data to the Regional Board for determining that the wastewater disposal system functions properly and the beneficial uses for groundwater are adequately protected, nor provide defense for liability from failing to adequately monitor the discharge.

**BRIDGEPORT PUD
WASTEWATER DISPOSAL FACILITY
Mono County**

-5-

**BOARD ORDER NO. 6-01-12
WDID NO. 6A265300900**

18. CEQA Compliance

These updated waste discharge requirements govern an existing facility which the Discharger is currently operating. The project consists only of the continued operation of the existing Facility and is therefore exempt from the provisions of the California Environmental Quality Act (Public Resources Code, §21000 et seq.) in accordance with §15301, Chapter 3, Title 14, of the California Code of Regulations.

19. Notification of Interested Parties

The Board has notified the Discharger and interested parties of its intent to update waste discharge requirements for the Bridgeport PUD Wastewater Disposal Facility.

20. Consideration of Public Comments

The Regional Board, in a public meeting, heard and considered all comments pertaining to the Facility and the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Discharge/Effluent Limitations

1. The total flow of wastewater to treatment and disposal facilities during any 24-hour period shall not exceed 0.200 million gallons (0.200 MG).
2. All wastewater made available for percolation at the authorized disposal site shall not contain pollutants at concentrations in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Maximum</u>
BOD ²	mg/l	30	45
MBAS ³	mg/l	1.0	2.0

3. All wastewater made available for percolation at the authorized disposal site shall have a pH of not less than 6 pH units nor more than 9 pH units. A pH over 9.0 is allowed if it results from a biological process within the treatment plant.

¹ The arithmetic mean of lab results for effluent samples collected in a period of 30 consecutive days.

² Biochemical Oxygen Demand (5 day, 20°C). Samples from oxidation and percolation ponds should be filtered (using a No. 1 Whatman filter, or equivalent) and reseeded with unfiltered sample. Other types of treatment units should analyze unfiltered samples.

³ Methylene Blue Active Substances

4. All wastewater made available for percolation at the authorized disposal site shall have a dissolved oxygen (DO) concentration of not less than 1.0 mg/l.

B. Receiving Water Limitations

The discharge of waste shall not cause the presence of the following substances or conditions in ground waters of the Bridgeport Valley Basin and/or surface waters of the Bridgeport Hydrologic Area:

1. Any perceptible color, odor, taste or foaming.
 2. Coliform organisms attributable to human wastes.
 3. Toxic substances in concentrations that individually, collectively, or cumulatively cause detrimental physiological responses in humans, plants, animals, or aquatic life.
 4. Identifiable chlorinated hydrocarbons, organophosphates, carbamates, and other pesticide and herbicide groups, in summations, in excess of the lowest detectable levels.
 5. Concentrations of chemical constituents in excess of the maximum contaminant levels or secondary maximum contaminant levels based upon drinking water standards specified by the more restrictive of the California Code of Regulations, Title 22, Division 4, Chapter 15, or 40 CFR, Part 141.
6. The discharge shall not cause, or contribute to causing, the following receiving water limitations to be exceeded in surface waters of the East Walker River at Bridgeport:

<u>Parameter</u>	<u>Units</u>	<u>Annual Average</u>	<u>90th Percentile</u>
Total Dissolved Solids	mg/l	145	160
Chloride	mg/l	4.0	8.0
Sulfate	mg/l	4.0	8.0
Sodium	percent	30	35
Boron	mg/l	0.12	0.25
Total Nitrogen	mg/l-N	0.50	0.80
Total Phosphorus	mg/l-P	0.06	0.10

C. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent at, or from, the authorized disposal site to adjacent land areas or surface waters is prohibited.
3. The vertical distance between the liquid surface elevation and the lowest point of a pond dike or the invert of an overflow structure shall not be less than two (2) feet.
4. The discharge shall not cause a pollution as defined in §13050 of the California Water Code, or a threatened pollution.
5. Neither the treatment nor the discharge shall cause a nuisance as defined in §13050 of the California Water Code.
6. The discharge of wastewater except to the authorized disposal site is prohibited.
7. The integrity of any pond structures shall be maintained throughout the life of the ponds and shall not be diminished as the result of any maintenance or cleaning operation.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

Board Order No. 6-91-918 is hereby rescinded.

B. Standard Provisions

The Discharger shall comply with the "Standard Provisions for Waste Discharge Requirements," dated September 1, 1994, in Attachment "C," which is made part of this Order.

C. Monitoring and Reporting

1. Pursuant to Section 13383 and Section 13267(b) of the California Water Code, the Discharger shall comply with Monitoring and Reporting Program No. 01-12 as specified by the Executive Officer.

**BRIDGEPORT PUD
WASTEWATER DISPOSAL FACILITY
Mono County**

-8-


**BOARD ORDER NO. 6-01-12
WDID NO. 6A265300900**

2. The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of the Monitoring and Reporting Program.

D. Operator Certification

The Discharger's wastewater treatment plant shall be supervised by personnel possessing a wastewater treatment plant operator certificate of appropriate grade pursuant to *Regulations for Wastewater Treatment Plant Operator Certification and Plant Classification*, Title 23, California Code of Regulations, Division 4, Chapter 14, Section 3670 et. seq.

I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on March 14, 2001.




HAROLD J. SINGER
EXECUTIVE OFFICER


- Attachments:
- A. Vicinity/Site Map
 - B. Existing Sewage Treatment Facility
 - C. Standard Provisions for Waste Discharge Requirements

RFM/shT:BPUD Board Order

Attachment "A"

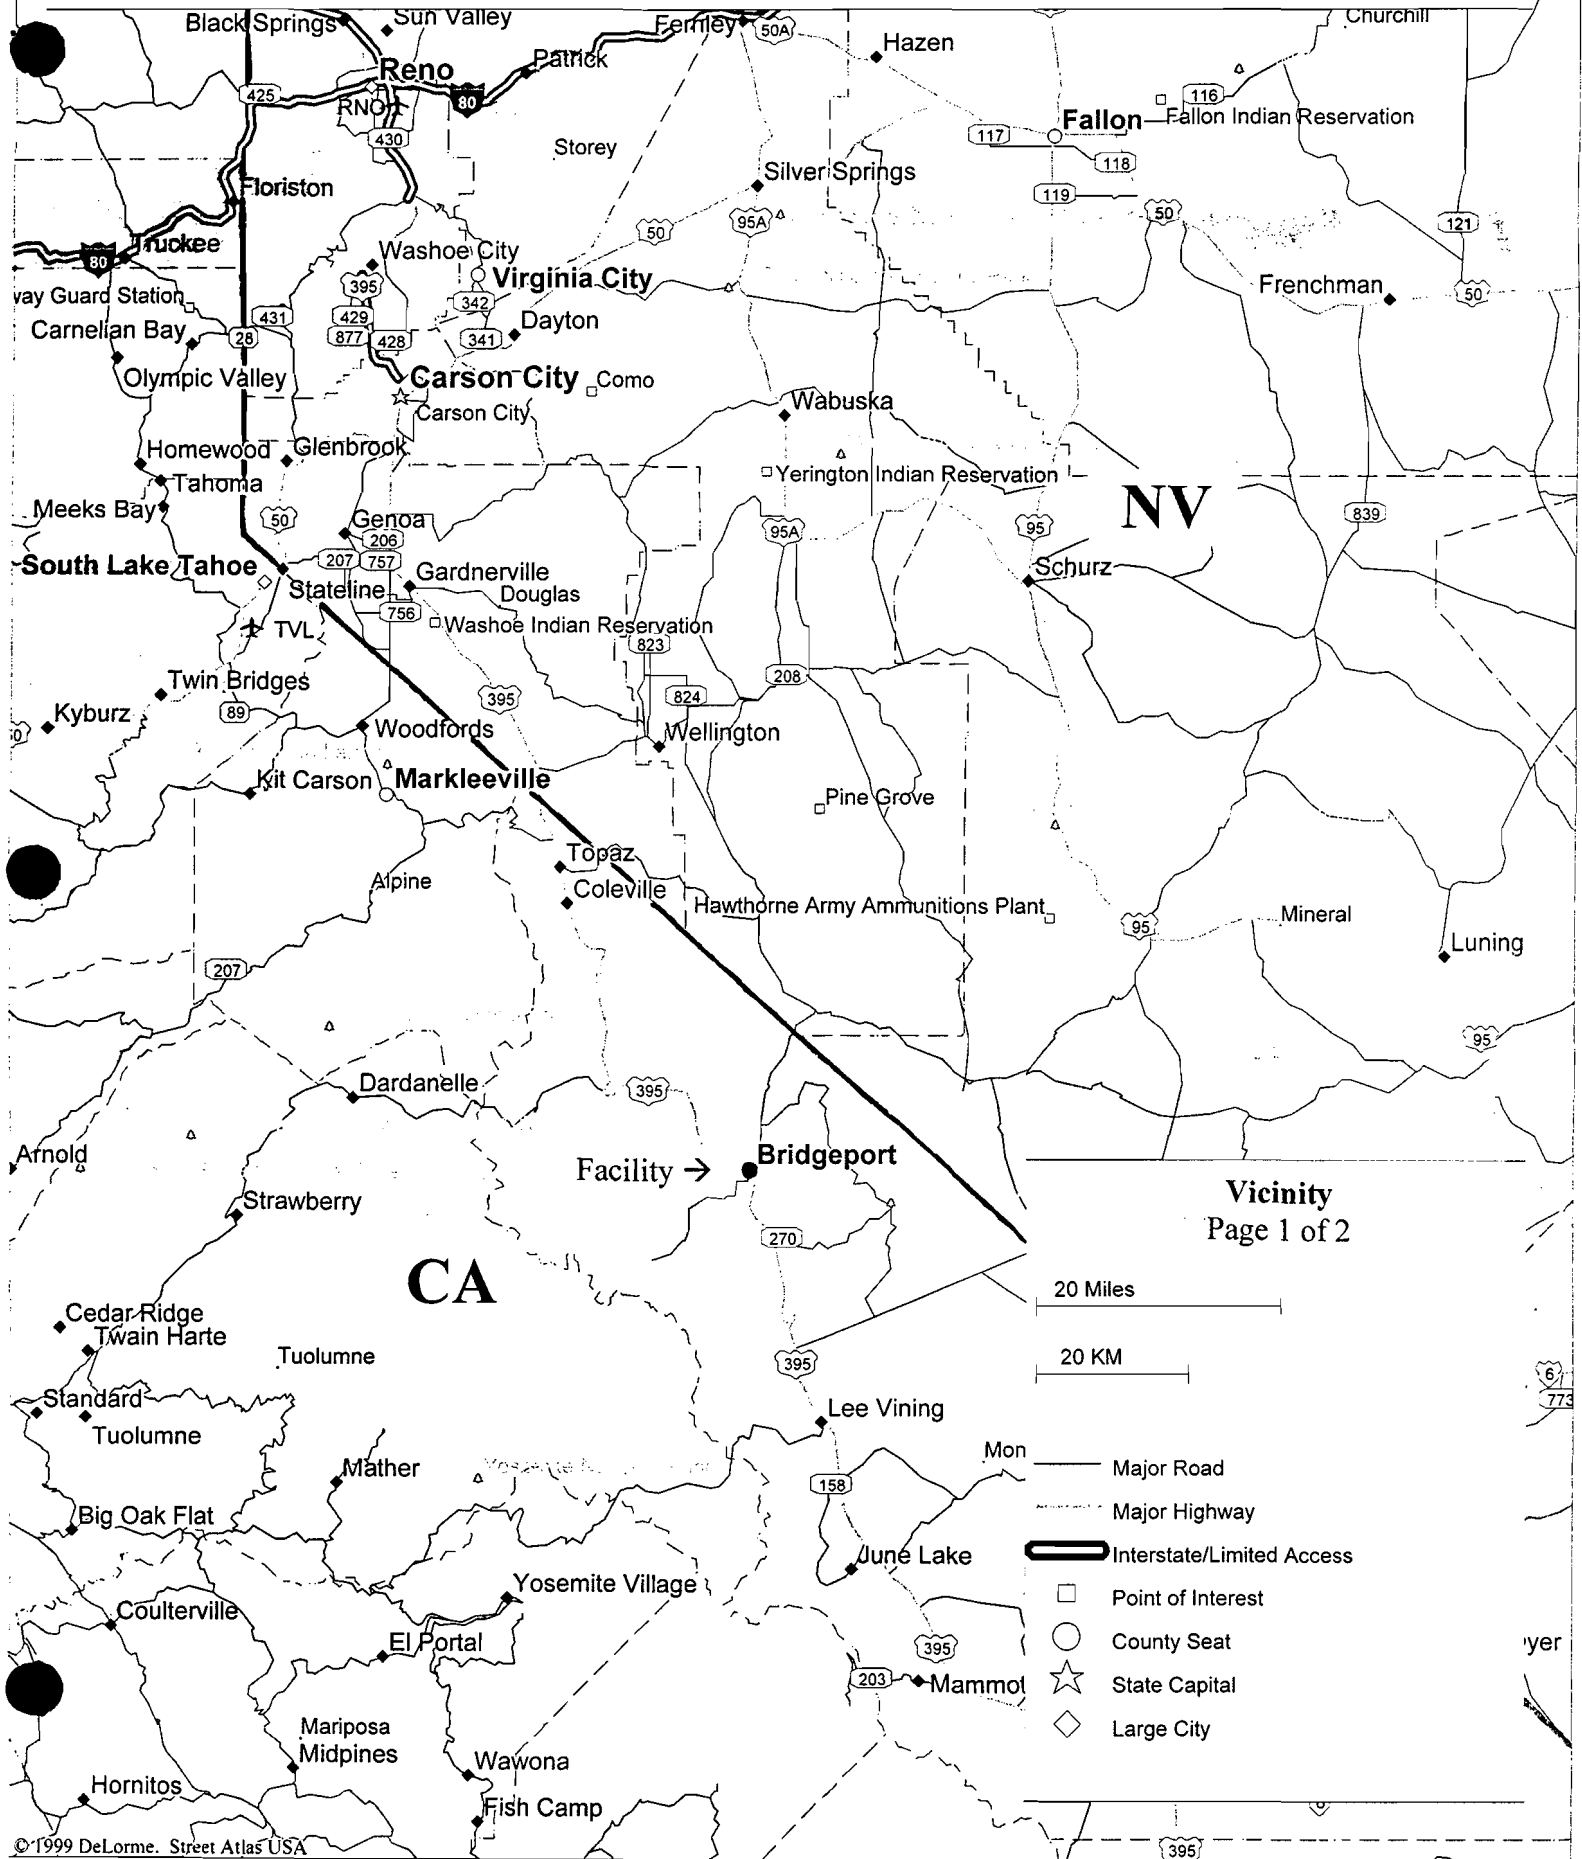


Attachment "A"

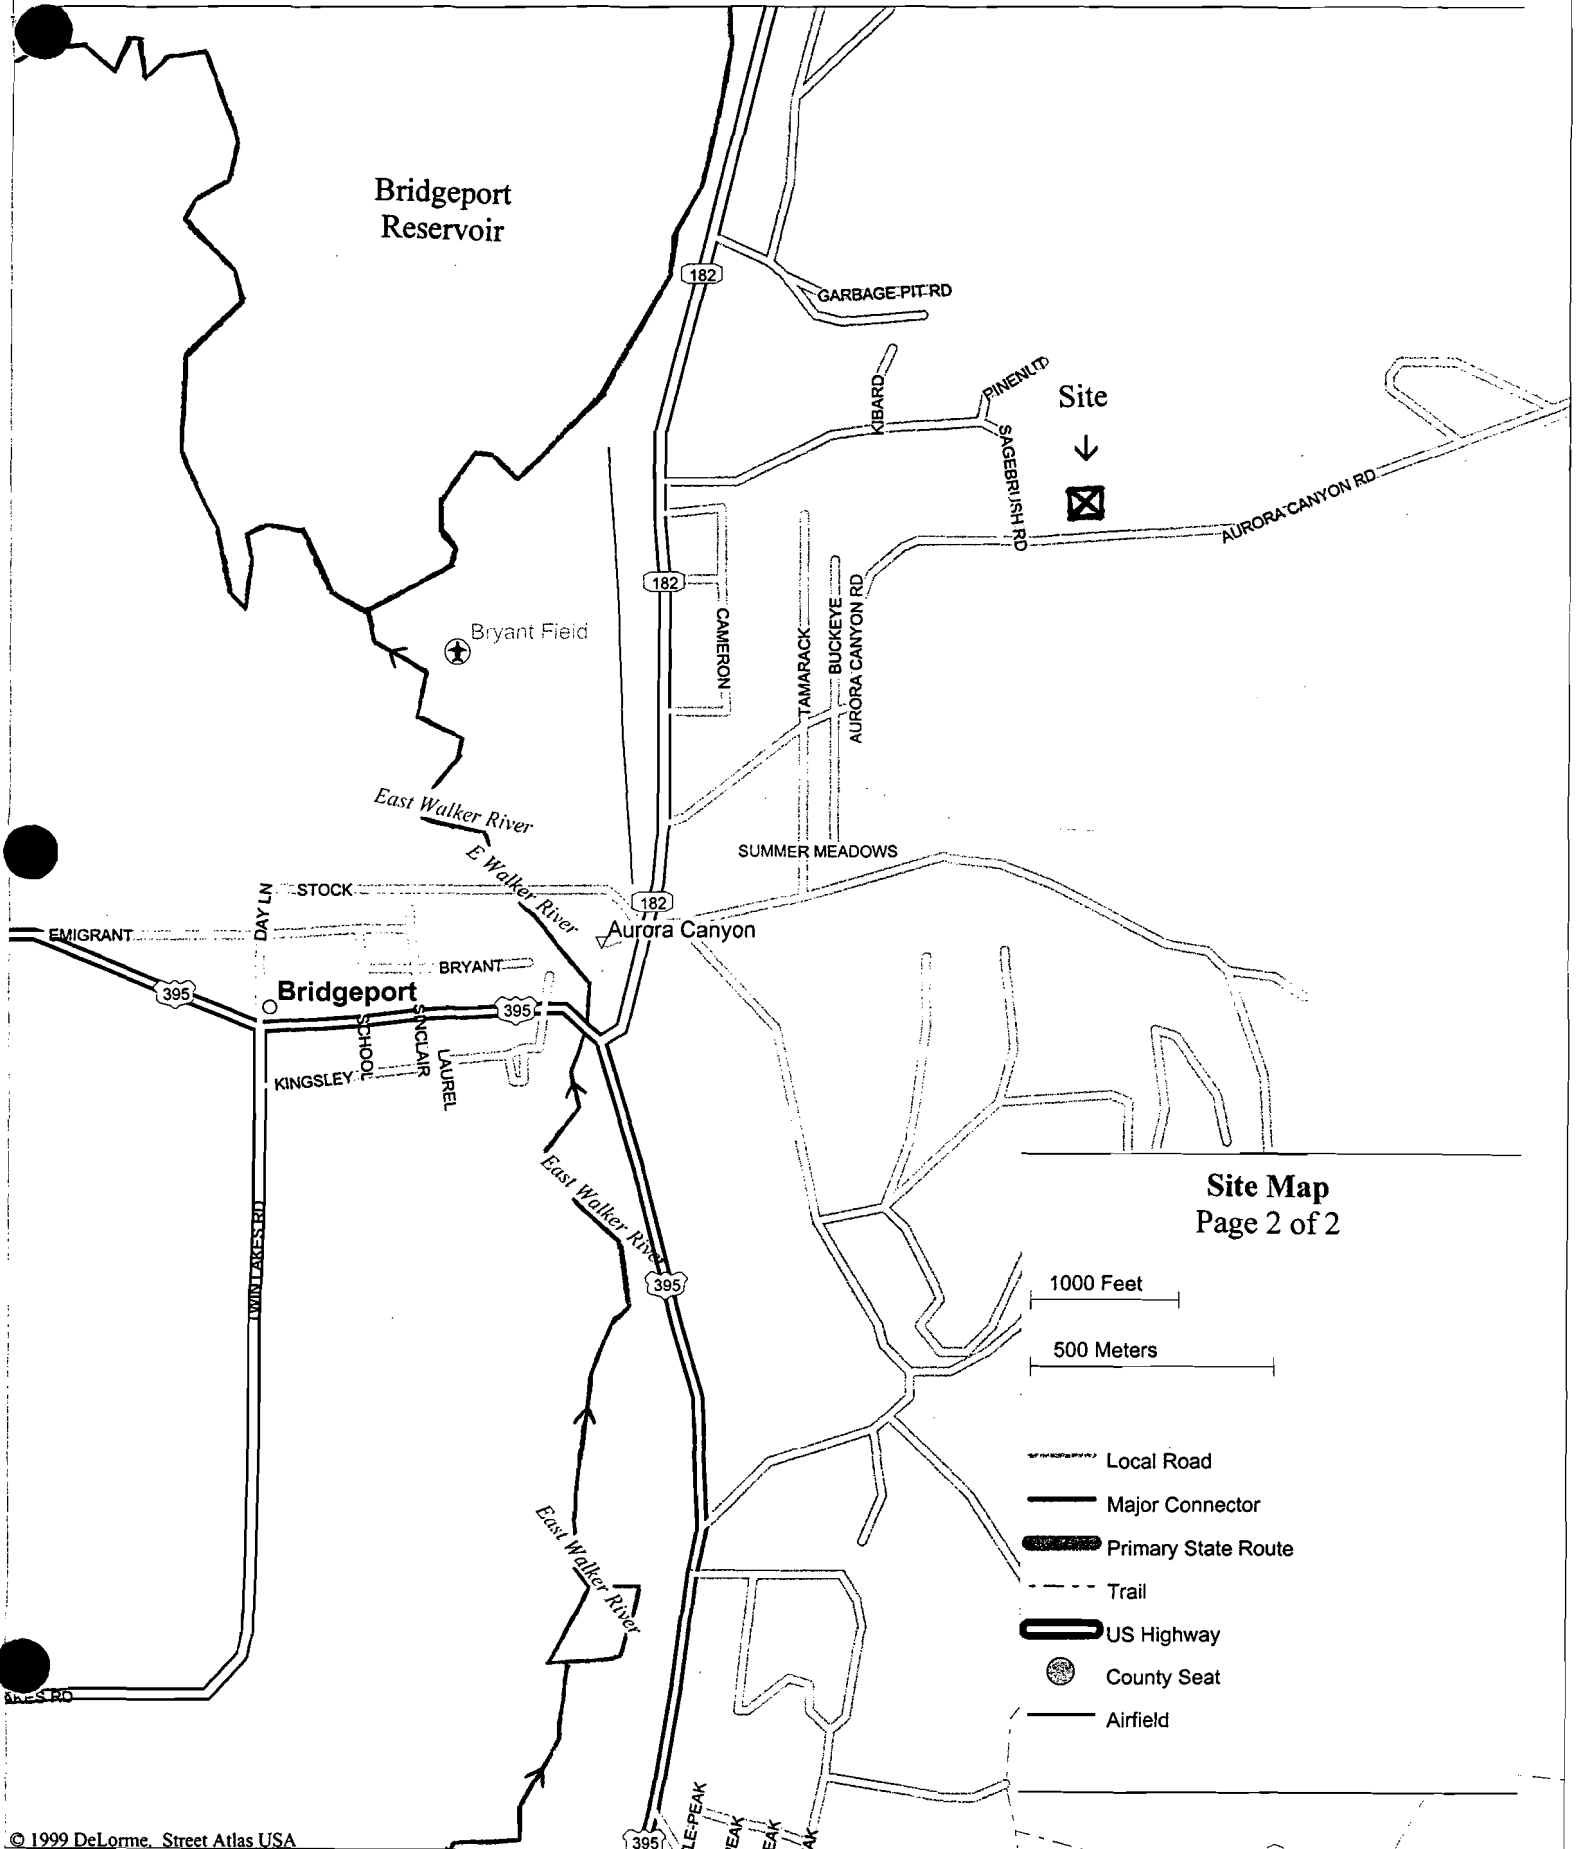

Site Map
Page 2 of 2

ATTACHMENT "B"

EXISTING SEWAGE TREATMENT FACILITY

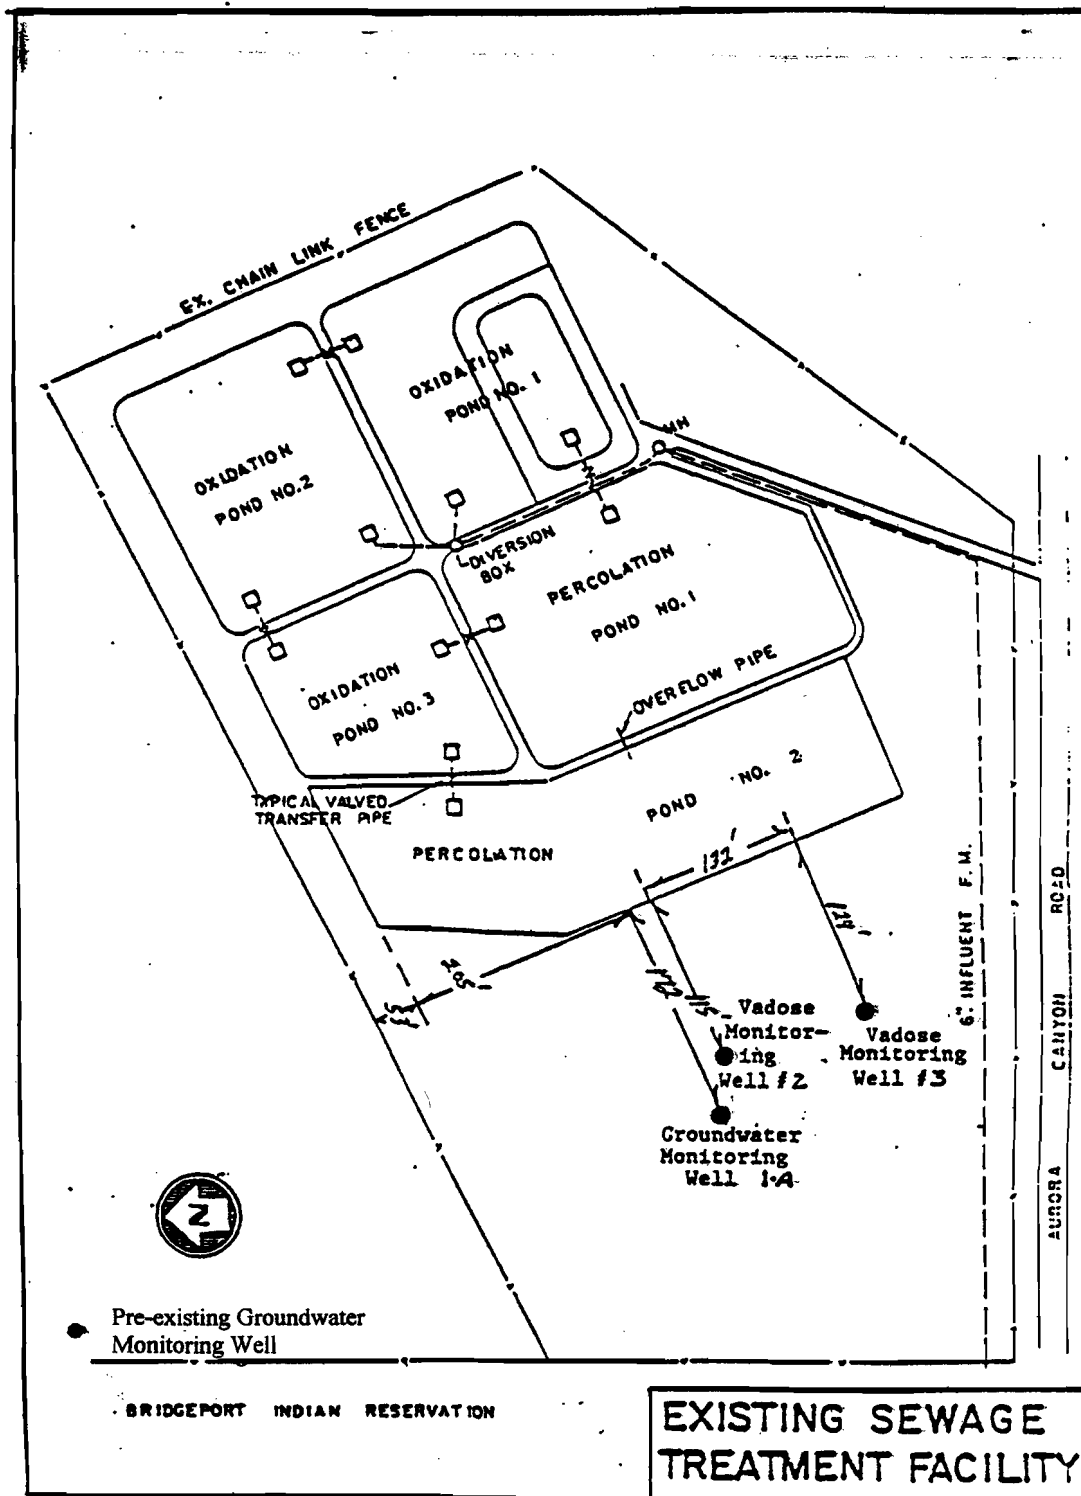

ATTACHMENT "C"

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

STANDARD PROVISIONS
FOR WASTE DISCHARGE REQUIREMENTS

1. Inspection and Entry

The discharger shall permit Regional Board staff:

- a. to enter upon premises in which an effluent source is located or in which any required records are kept;
- b. to copy any records relating to the discharge or relating to compliance with the waste discharge requirements;
- c. to inspect monitoring equipment or records; and
- d. to sample any discharge.

2. Reporting Requirements

- a. Pursuant to California Water Code 13267(b), the discharger shall immediately notify the Regional Board by telephone whenever an adverse condition occurred as a result of this discharge; written confirmation shall follow within two weeks. An adverse condition includes, but is not limited to, spills of petroleum products or toxic chemicals, or damage to control facilities that could affect compliance.
- b. Pursuant to California Water Code Section 13260 (c), any proposed material change in the character of the waste, manner or method of treatment or disposal, increase of discharge, or location of discharge, shall be reported to the Regional Board at least 120 days in advance of implementation of any such proposal. This shall include, but not be limited to, all significant soil disturbances.
- c. The owner(s) of, and discharger upon, property subject to waste discharge requirements shall be considered to have a continuing responsibility for ensuring compliance with applicable waste discharge requirements in the operations or use of the owned property. Pursuant to California Water Code Section 13260(c), any change in the ownership and/or operation of property subject to the waste discharge requirements shall be reported to the Regional Board. Notification of applicable waste discharge requirements shall be furnished in writing to the new owners and/or operators and a copy of such notification shall be sent to the Regional Board.
- d. If a discharger becomes aware that any information submitted to the Regional Board is incorrect, the discharger shall immediately notify the Regional Board, in writing, and correct that information.

- e. Reports required by the waste discharge requirements, and other information requested by the Regional Board, must be signed by a duly authorized representative of the discharger. Under Section 13268 of the California Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1000) for each day of violation.
- f. If the discharger becomes aware that their waste discharge requirements are no longer needed (because the project will not be built or the discharge will cease) the discharger shall notify the Regional Board in writing and request that their waste discharge requirements be rescinded.

3. Right to Revise Waste Discharge Requirements

The Board reserves the privilege of changing all or any portion of the waste discharge requirements upon legal notice to and after opportunity to be heard is given to all concerned parties.

4. Duty to Comply

Failure to comply with the waste discharge requirements may constitute a violation of the California Water Code and is grounds for enforcement action or for permit termination, revocation and reissuance, or modification.

5. Duty to Mitigate

The discharger shall take all reasonable steps to minimize or prevent any discharge in violation of the waste discharge requirements which has a reasonable likelihood of adversely affecting human health or the environment.

6. Proper Operation and Maintenance

The discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the discharger to achieve compliance with the waste discharge requirements. Proper operation and maintenance includes adequate laboratory control, where appropriate, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by the discharger, when necessary to achieve compliance with the conditions of the waste discharge requirements.

7. Waste Discharge Requirement Actions

The waste discharge requirements may be modified, revoked and reissued, or terminated for cause. The filing of a request by the discharger for waste discharge requirement

modification, revocation and reissuance, termination, or a notification of planned changes or anticipated noncompliance, does not stay any of the waste discharge requirements conditions.

8. Property Rights

The waste discharge requirements do not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

9. Enforcement

The California Water Code provides for civil liability and criminal penalties for violations or threatened violations of the waste discharge requirements including imposition of civil liability or referral to the Attorney General.

10. Availability

A copy of the waste discharge requirements shall kept and maintained by the discharger and be available at all times to operating personnel.

11. Severability

Provisions of the waste discharge requirements are severable. If any provision of the requirements is found invalid, the remainder of the requirements shall not be affected.

12. Public Access

General public access shall be effectively excluded from treatment and disposal facilities.

13. Transfers

Providing there is no material change in the operation of the facility, this Order may be transferred to a new owner or operation. The owner/operator must request the transfer in writing and receive written approval from the Regional Board Executive Officer.

14. Definitions

- a. "Surface waters" as used in this Order, include, but are not limited to, live streams, either perennial or ephemeral, which flow in natural or artificial water courses and natural lakes and artificial impoundments of waters. "Surface waters" does not include artificial water courses or impoundments used exclusively for wastewater disposal.
- b. "Ground waters" as used in this Order, include, but are not limited to, all subsurface waters being above atmospheric pressure and the capillary fringe of these waters.

15. Storm Protection

All facilities used for collection, transport, treatment, storage, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

MONITORING AND REPORTING PROGRAM NO. 01-12
WDID NO. 6A265300900

FOR
BRIDGEPORT PUBLIC UTILITY DISTRICT WASTEWATER DISPOSAL FACILITY

Mono County

I. MONITORING

A. Flow Monitoring

The Discharger shall monitor the following:

1. The total volume, in million gallons, of wastewater flow to the treatment facility for each day.
2. The average flow rate, in million gallons per day (mgd), of wastewater to the treatment facility calculated for each month.
3. The total volume, in million gallons, of wastewater flow to each disposal facility for each month.
4. The freeboard (distance from the top of the lowest part of the dike to the wastewater surface in the pond) measured each month in each surface impoundment. If a surface impoundment does not contain wastewater, indicate that it is empty.

B. Plant Effluent Monitoring

Beginning immediately, grab samples of the effluent discharged from wastewater treatment facilities to percolation ponds shall be collected and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Biochemical Oxygen Demand	mg/l	Quarterly
Dissolved Oxygen	mg/l	Quarterly
Chloride	mg/l	Quarterly
Purgeable Halocarbons	mg/l	Annually
Purgeable Aromatics	mg/l	Annually
Methylene Blue Active Substances	mg/l	Annually

C. Ground Water Monitoring

1. The Discharger shall submit, by not later than **March 1, 2002**, a ground water monitoring system plan or information to verify that the current groundwater

monitoring system is adequate. The monitoring system, at a minimum, shall include the following:

- a. A minimum of three monitoring wells to determine the gradient of the ground water.
 - b. Additional wells shall be installed, if necessary, to insure that at least one (1) well is upgradient and two (2) wells are downgradient of the wastewater treatment Facility. The Discharger shall demonstrate that at least two downgradient wells are located such that ground water potentially impacted by the discharge will be monitored.
 - c. The specific design and location of any proposed wells and specific location of the current wells shall be submitted for review and approval by the Regional Board Executive Officer by not later than **March 1, 2002.**
 - d. Any proposed ground water monitoring wells shall be installed at the disposal site in accordance with the approved plan by not later than **August 1, 2002.**
 - e. If additional wells are installed, an as-built design report shall be submitted within 60 days after the installation. This shall include a statement of certification signed by a California registered civil engineer or geologist, regarding the placement, lithology and construction of the wells.
2. Beginning immediately, grab samples from the entire thickness or the upper 20 feet, whichever is less, of the uppermost ground water bearing zone shall be collected from Vadose Monitoring Well #3 and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Chloride	mg/l	Quarterly
Total Dissolved Solids	mg/l	Quarterly
Nitrate Nitrogen	mg/l as N	Quarterly
Total Phosphorus	mg/l as N	Quarterly

- a. Each time a monitoring well is sampled, and prior to well purging as specified below, the elevation (mean sea level) and depth (below ground surface) of ground water in each well shall be measured, and reported with the results of ground water analyses. If no measurable ground water is found in Vadose Monitoring Well #3, a statement to that effect shall be included in the monitoring report submitted to the Regional Board.

b. Well Purging

- (1) Ground water samples shall be collected only after at least three volumes of water in the well casing have been removed and temperature, electrical conductivity, and pH measurements of the water in the well have stabilized to approximately $\pm 10\%$ for each successive well volume removed.
- (2) The measurements of temperature, electrical conductivity and pH during purging shall be reported with the results of ground water analyses. Parameter values shall be reported in the following units:

<u>Parameter</u>	<u>Units</u>
Temperature	$^{\circ}\text{C}$ or $^{\circ}\text{F}$
Electrical Conductivity	mmhos/cm or dS/m
pH	pH units

- (3) The well casing diameter, well depth, and total volume purged prior to sampling shall be reported with the results of ground water analyses.

3. Beginning **August 1, 2002**, grab samples from the entire thickness or the upper 20 feet, whichever is less, of the uppermost ground water bearing zone shall be collected from the monitoring wells in the approved plan and analyzed to determine the magnitude of the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Chloride	mg/l	Quarterly
Total Dissolved Solids	mg/l	Quarterly
Nitrate Nitrogen	mg/l as N	Quarterly
Total Phosphorus	mg/l as N	Quarterly

- a. Each time a monitoring well is sampled, and prior to well purging as specified below, the elevation (mean sea level) and depth (below ground surface) of ground water in each well shall be measured, and reported with the results of ground water analyses.

b. Well Purging

- (1) Ground water samples shall be collected only after at least three volumes of water in the well casing have been removed and temperature, electrical conductivity, and pH measurements

of the water in the well have stabilized to approximately $\pm 10\%$ for each successive well volume removed.

- (2) The measurements of temperature, electrical conductivity and pH during purging shall be reported with the results of ground water analyses. Parameter values shall be reported in the following units:

<u>Parameter</u>	<u>Units</u>
Temperature	$^{\circ}\text{C}$ or $^{\circ}\text{F}$
Electrical Conductivity	mmhos/cm or dS/m
pH	pH units

- (3) The well casing diameter, well depth, and total volume purged prior to sampling shall be reported with the results of ground water analyses.

- c. The direction of ground water flow under the disposal site shall be determined at least annually unless it can be shown that no changes have occurred.

II. REPORTING

A. General Provisions

The Discharger shall comply with the "General Provisions for Monitoring and Reporting," dated September 1, 1994, which is attached to and made part of this Monitoring and Reporting Program.

B. Submittal Periods

Monitoring reports including the preceding information shall be submitted to the Regional Board on a quarterly basis, as tabulated below, beginning on May 1, 2001.

<u>Quarter</u>	<u>Monitoring Period</u>	<u>Due date</u>
1	January 1 – March 30	May 1
2	April 1 – June 30	August 1
3	July 1 – September 30	November 1
4	October 1 – December 31	February 1

C. Annual Report

By February 1 of each year, the Discharger shall submit an annual report to the Regional Board with the following information:

1. The compliance record for the previous year, and corrective actions taken or planned which may be needed to bring the discharge into full compliance with the waste discharge requirements.
2. Graphical and tabular presentation of the monitoring data obtained for the previous year.
3. The Discharger shall clearly identify any violations of WDRs in any self-monitoring reports or other Facility compliance information provided to the Regional Board.

Ordered by: Harold J. Singer Dated: Mar 14, 2001
HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: General Provisions for Monitoring and Reporting

RFM/shT:BPUD.MRP

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

GENERAL PROVISIONS
FOR MONITORING AND REPORTING

1. **SAMPLING AND ANALYSIS**

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes, EPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Regional Board Executive Officer. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The methods used shall also be reported. If methods other than EPA-approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Regional Board Executive Officer prior to use.
- d. The discharger shall establish chain-of-custody procedures to insure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage, and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall insure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book described in 2.b, below.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.
- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

2. OPERATIONAL REQUIREMENTS

a. Sample Results

Pursuant to California Water Code Section 13267(b), the discharger shall maintain all sampling and analytical results including: strip charts; date, exact place, and time of sampling; date analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.

b. Operational Log

Pursuant to California Water Code Section 13267(b), an operation and maintenance log shall be maintained at the facility. All monitoring and reporting data shall be recorded in a permanent log book.

3. REPORTING

- a. For every item where the requirements are not met, the discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time, and shall submit a timetable for correction.
- b. Pursuant to California Water Code Section 13267(b), all sampling and analytical results shall be made available to the Regional Board upon request. Results shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.
- c. The discharger shall provide a brief summary of any operational problems and maintenance activities to the Board with each monitoring report. Any modifications or additions to, or any major maintenance conducted on, or any major problems occurring to the wastewater conveyance system, treatment facilities, or disposal facilities shall be included in this summary.
- d. Monitoring reports shall be signed by:
 - i. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
 - ii. In the case of a partnership, by a general partner;
 - iii. In the case of a sole proprietorship, by the proprietor; or

- iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
 - i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number 6A265300900.
- f. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Under Section 13268 of the Water Code, any person failing or refusing to furnish technical or monitoring reports, or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation.