

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

BOARD ORDER NO. 6-93-72
WDID NO. 6A260154101

REVISED WASTE DISCHARGE REQUIREMENTS

FOR

UNITED STATES MARINE CORPS MOUNTAIN WARFARE TRAINING CENTER
WASTEWATER TREATMENT FACILITY

Mono County

The California Regional Water Quality Control Board, Lahontan Region (Board) finds:

1. Discharger

The United States Marine Corps (USMC) operates the USMC Mountain Warfare Training Center which is located in the Toiyabe National Forest, which is owned and administered by the United States Forest Service (USFS). Wastewater from the training center facilities is collected, treated, and disposed of on the training center site. For the purposes of this Order, the United States Marine Corps, as the facility operator, is referred to hereinafter as the "Discharger" and the wastewater treatment and disposal facilities are hereinafter referred to as the "facility".

2. Permit History

The Board previously established waste discharge requirements for the facility under Board Order No. 6-74-128, which was adopted on October 24, 1974. In August 1979, the original leachfield system failed prompting the Board to adopt Board Order No. 6-80-35 on March 13, 1980, which established a time schedule for compliance with Board Order No. 6-74-128. At the request of the USMC, the Board adopted Board Order No. 6-82-97 on August 12, 1982, which revised the time schedule established by Board Order No. 6-80-35. The USMC constructed new wastewater treatment and disposal facilities in accordance with the revised time schedule established by Board Order No. 6-82-97. On September 10, 1987, the Board adopted Board Order No. 6-87-97, which updated Board Order No. 6-74-128 and reflected changes in wastewater quantity and treatment facilities.

3. Reason for Action

The Board is updating the existing waste discharge requirements as part of a statewide program to periodically update review and revise outdated Board Orders. Additionally, the waste discharge requirements are being updated to reflect changes in the design flow and treatment facilities.

UNITED STATES MARINE CORPS
MWTC WASTEWATER TREATMENT
FACILITY
Mono County

2

BOARD ORDER NO. 6-93-72
WDID NO. 6A260154101

4. Facility Location

The facility is located in Pickel Meadow along Highway 108, approximately 11 miles east of Sonora Pass and 20 miles north of town of Bridgeport in Mono County. The facility is in the West Walker River Hydrologic Unit within the NW 1/4 of Section 24, T6N, R22E, MDB&M, as shown on Attachments "A" and "B", which are a part of this Order.

5. Discharge Description

The USMC proposes to upgrade the existing facilities which consist of a screen and cominutor, a 27,000 gallon flow equalization tank, an activated sludge package treatment plant, an aerobic sludge digester, a polishing pond, and five leachfields for effluent disposal. The upgraded facilities will consist of a screen and cominutor, the 27,000 gallon flow equalization tank, three sequential batch reactors, a two-chamber aerobic sludge digester, a sludge dewatering facility, and five leachfields. The wastewater treatment facility will continue to be an activated sludge process, but one that is more suited to highly variable flows. The facility will continue to treat domestic wastewater that is generated from permanent training center facilities and the upper and lower camp areas. The facility will also treat wastewater from the shower facilities, which has been discharged to a greywater leachfield in the past. A permanent training center population of approximately 250 personnel and a transient training center population of up to approximately 1,350 personnel contributes to the wastewater flow. The facility will treat influent flows that range from a minimum average daily flow of 0.014 mgd to a maximum average daily flow of 0.140 mgd. The facility is designed to treat a maximum instantaneous flow of 0.490 mgd. The wastewater treatment facility design criteria for effluent quality before discharging to the leachfield is as follows:

<u>Parameter</u>	<u>Maximum Concentration</u>
Biological Oxygen Demand	30 mg/l
Suspended Solids	30 mg/l
Total Nitrogen as N	10 mg/l

6. Disposal Site

The treated wastewater effluent is discharged to a series of five leachfields as shown on Attachment "C", which is a part of this Order. Use of the leachfields will be cycled so that a rest period is provided for each leachfield. The existing flows to the leachfields ranges from approximately 0.006 mgd to 0.065 mgd. The future flows will range from 0.014 mgd to 0.140 mgd. The calculated capacity of each leachfield

is approximately 33,000 gallons per day. Field studies indicate that each leachfield may have an actual maximum hydraulic capacity of 50,100 gallons per day. The discrepancy between calculated capacity and field results may be explained by the very coarse granular nature of the glacial outwash soils within the leachfield. These soils have shown the ability to resist clogging and recover high permeability after a low flow resting cycle that occurs when troops are not training at the training center. The leachfields have been operating in this manner (heavy dosing followed by low flow periods) since 1985. The leachfields have had minor incidents of failure due to injecting solids into the leachfields and not cycling the leachfields. The leachfields currently have piezometers for monitoring leachfield saturation levels which will improve leachfield operations.

7. Sludge Treatment and Disposal

Sludge will be periodically wasted from the three sequential batch reactors and discharged into a two-chamber aerobic digester (converted existing wastewater treatment facility). The aerobic digester will have a capacity of 59,000 gallons (36,000 gallons - existing step aeration cell, 23,000 gallons - existing aerobic digester). Solids concentration within the aerobic digester will range from one to two percent and will allow 45 - 90 days storage time. The digested sludge will be dewatered on a Wedgewater filter bed system with the filtrate returning to the wastewater influent stream. A combination of polymer injection and a positive displacement sludge pump will allow approximately two pounds (dry weight) of digested sludge to be applied per square foot of Wedgewater filtration bed area. The dewatered sludge (25 - 40 percent solids after 10 - 12 days) will be disposed of at a legal disposal site.

8. Authorized Disposal Site

The five leachfields are the only authorized sites for wastewater disposal. The sludge disposal site shall comply with all local, state and federal regulations regarding sludge disposal. The authorized disposal sites for wastewater are located on federal lands administered by the USFS, Toiyabe National Forest, Bridgeport Ranger District.

9. Site Geology

The soils in the wastewater disposal sites are of glacial and alluvial origin. The upper 20 inches consist of gravelly sandy loam, loam and clay loam material. The substratum material below 20 inches consists of stratified alluvial sand and loamy sand textures modified by 70 - 80 percent gravel and cobbles. Recent field studies indicate that percolation rates are approximately five minutes per inch.

10. Site Hydrology

Surface runoff in and around the facility flows into Silver Creek, which flows through the training center approximately 100 yards east of the facility. Surface runoff also flows into the West Walker River, which flows through Pickel Meadow, approximately one-half to three-quarters of a mile south of the facility.

11. Site Hydrogeology

Recent monitoring has shown ground water depth in the wastewater disposal sites to range between 25 - 30 feet below grade. Ground water flow is generally accepted to be in the direction of the West Walker River which flows along the southern boundary of Pickel Meadow.

12. Receiving Waters

The receiving waters are the ground waters of the West Walker River Hydrologic Unit (Hydrologic Unit No. 631.10).

13. North Lahontan Basin Plan

The Board adopted the Water Quality Control Plan for the North Lahontan Basin on June 26, 1975 and this Order implements the Plan, as amended.

14. Beneficial Uses

The beneficial uses of ground water of the West Walker River Hydrologic Unit as set forth and defined in the Water Quality Control Plan for the North Lahontan Basin, as amended, are:

- a. municipal and domestic supply;
- b. agricultural supply; and
- c. freshwater replenishment.

15. CEQA Compliance

The United States Forest Service prepared an environmental assessment for the United States Marine Corps Mountain Warfare Training Center Master Plan Update. The Master Plan Update addressed the wastewater treatment upgrade activities in addition to several other training center improvements. Based upon the information contained within the environmental assessment, the United States Forest Service determined that the proposed projects, including the wastewater treatment upgrade, would have no significant impacts. As a result of this determination, the United States Forest

Service filed a Decision Notice and Finding of No Significant Impact (FONSI). Regional Board staff has determined that the environmental assessment and FONSI satisfy the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000 et seq.) in accordance with Sections 15221 and 15225, Chapter 3, Title 14, California Code of Regulations.

16. Notification of Interested Parties

The Board has notified the Discharger and interested parties of its intent to update waste discharge requirements for the discharge.

17. Public Comments

The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

I. DISCHARGE SPECIFICATIONS

A. Effluent/Discharge Limitations

1. The total effluent flow of wastewater during a 24-hour period shall not exceed 0.140 million gallons.
2. The maximum (peak) instantaneous flowrate of wastewater shall not exceed 0.490 million gallons per day (mgd).
3. All wastewater made available for discharge to the authorized disposal sites shall not contain concentrations of parameters in excess of the following limits:

<u>Parameter</u>	<u>Units</u>	<u>Mean</u> ¹	<u>Daily Maximum</u>
BOD ²	mg/l	30	45
MBAS ³	mg/l	1.0	2.0

¹The arithmetic mean of measurements made during a 30-day period

²Biochemical Oxygen Demand, 5 days, 20°C, unfiltered

³Methylene Blue Active Substances

UNITED STATES MARINE CORPS
MWTC WASTEWATER TREATMENT
FACILITY
Mono County

-6-

BOARD ORDER NO. 6-93-72
WDID NO. 6A260154101

4. All wastewater made available to the authorized disposal sites shall have a pH of not less than 6.5 pH units nor more than 8.5 pH units.
5. All wastewater made available to the authorized disposal sites shall have a dissolved oxygen concentration not less than 1.0 mg/l.

B. Receiving Water Limitations

The discharge of waste shall not cause the presence of the following substances or conditions in ground waters of the West Walker River Hydrologic Unit:

1. Any perceptible color, odor, taste or foaming.
2. Coliform organisms attributable to human wastes.
3. Toxic substances in concentrations that individually or collectively, or cumulatively cause detrimental physiological responses in human, plants, animals or aquatic life.
4. Identifiable chlorinated hydrocarbons, organophosphates, carbamates, and other pesticide and herbicide groups, in summations, in excess of the lowest detectable levels.

C. General Requirements and Prohibitions

1. There shall be no discharge, bypass, or diversion of raw or partially treated sewage, sewage sludge, grease, or oils from the collection, transport, treatment, or disposal facilities to adjacent land areas or surface waters.
2. Surface flow or visible discharge of sewage or sewage effluent at/or from the authorized disposal sites to adjacent land areas or surface waters is prohibited.
3. All facilities used for collection, transport, treatment, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.
4. The discharge shall not cause a pollution as defined in Section 13050 of the California Water Code, or a threatened pollution.

UNITED STATES MARINE CORPS
MWTC WASTEWATER TREATMENT
FACILITY
Mono County

-7-

BOARD ORDER NO. 6-93-72
WDID NO. 6A260154101

5. Neither the treatment nor the discharge shall cause a nuisance as defined in Section 13050 of the California Water Code.
6. The discharge of wastewater except to the authorized disposal sites is prohibited.
7. The disposal of waste residue, including sludge, shall be in compliance with all local, state, and federal requirements.
8. The Discharger shall comply with all existing federal and state laws and regulations that apply to sewage sludge use and disposal practices. The Discharger shall further comply with all requirements regarding sludge use and disposal specified in the Clean Water Act, Section 405(d) when it is promulgated.

II. PROVISIONS

A. Rescission of Waste Discharge Requirements

1. Board Order No. 6-87-97 is hereby rescinded.

B. Standard Provisions

1. The Discharger shall comply with the Standard Provisions for Waste Discharge Requirements in Attachment "D", which is made part of this Order.

UNITED STATES MARINE CORPS
MWTC WASTEWATER TREATMENT
FACILITY
Mono County

-8-

BOARD ORDER NO. 6-93-72
WDID NO. 6A260154101


C. Monitoring and Reporting

1. Pursuant to the California Water Code Section 13267(b), the Discharger shall comply with Monitoring and Reporting Program No. 93-72 as specified by the Executive Officer.


I, Harold J. Singer, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Lahontan Region, on August 12, 1993.


HAROLD J. SINGER
EXECUTIVE OFFICER


- Attachments:
- A. Location Map
 - B. Site Plan
 - C. Leachfields and Monitoring Wells
 - D. Standard Provisions for Waste Discharge Requirements

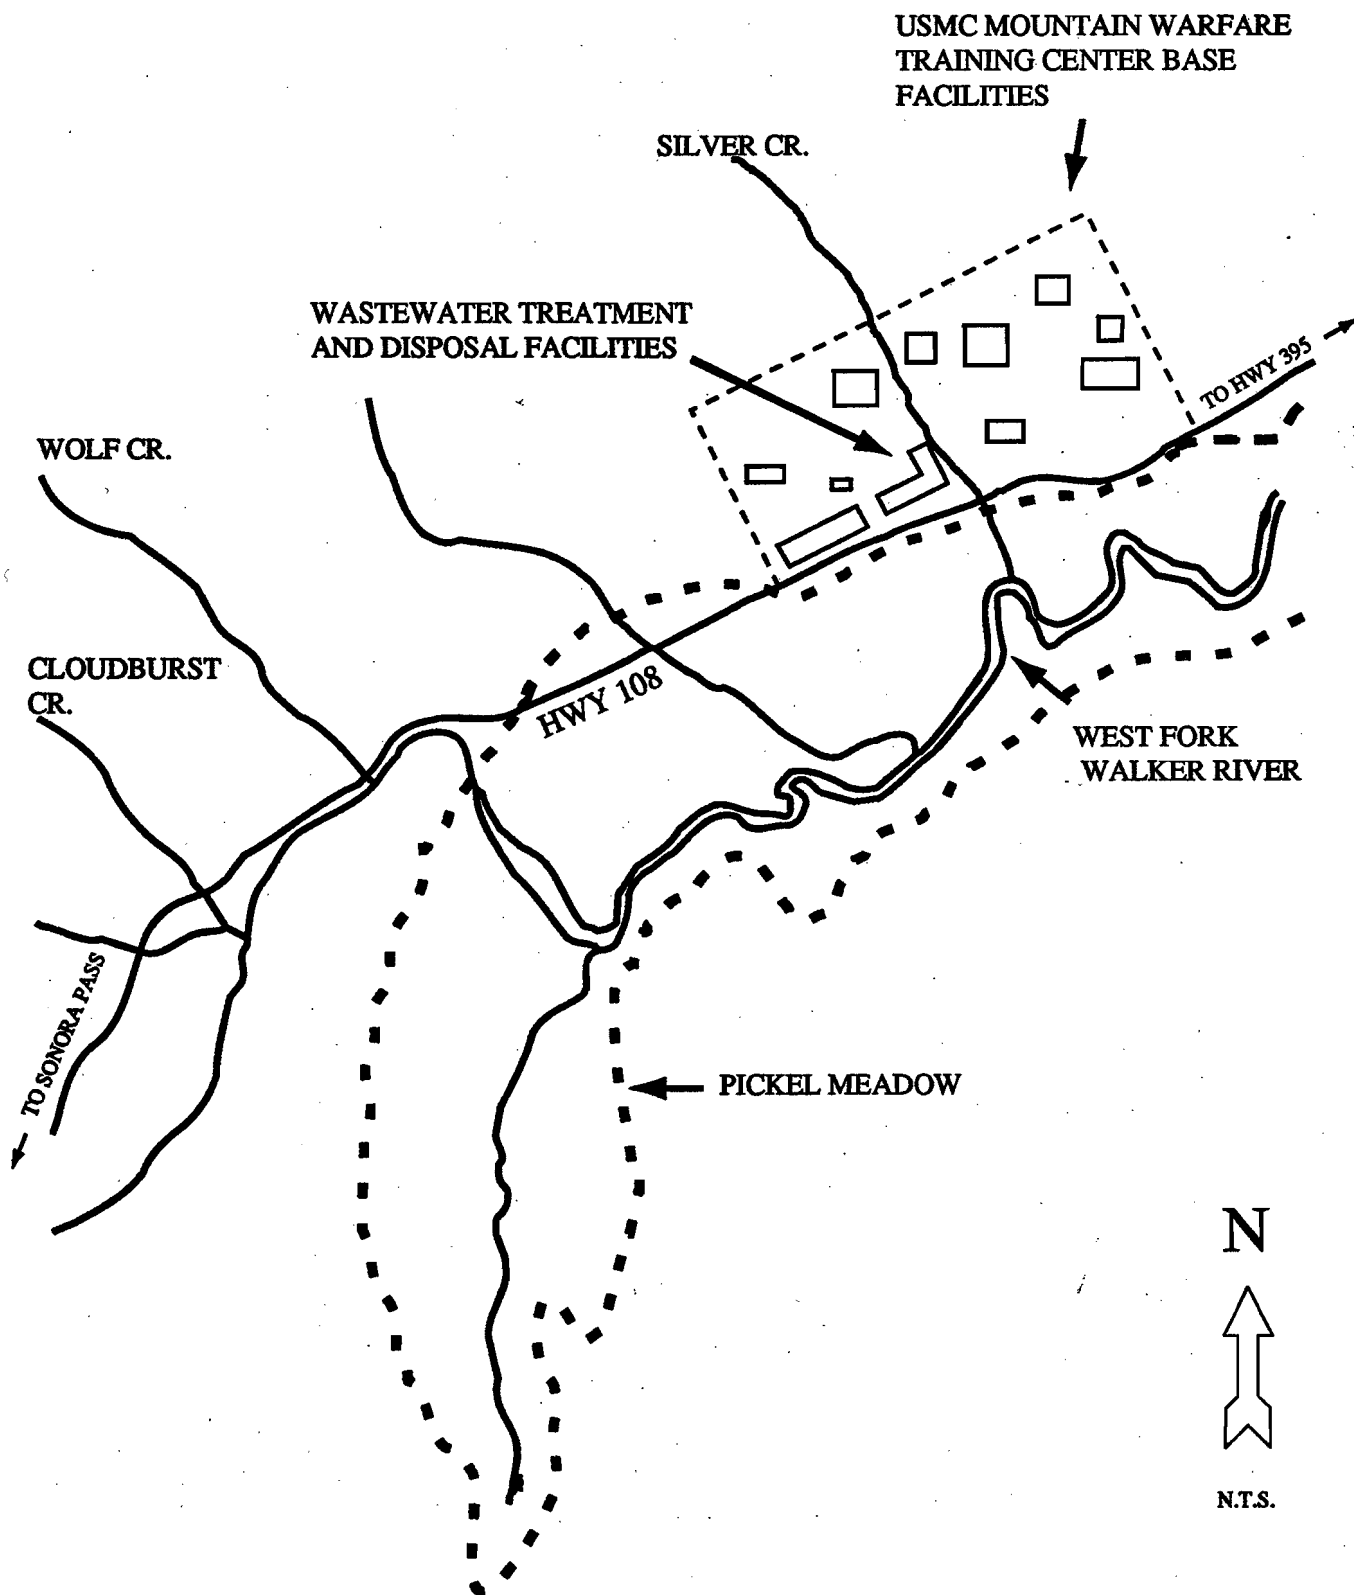

ATTACHMENT "A" - LOCATION MAP
UNITED STATES MARINE CORPS MOUNTAIN
WARFARE TRAINING CENTER

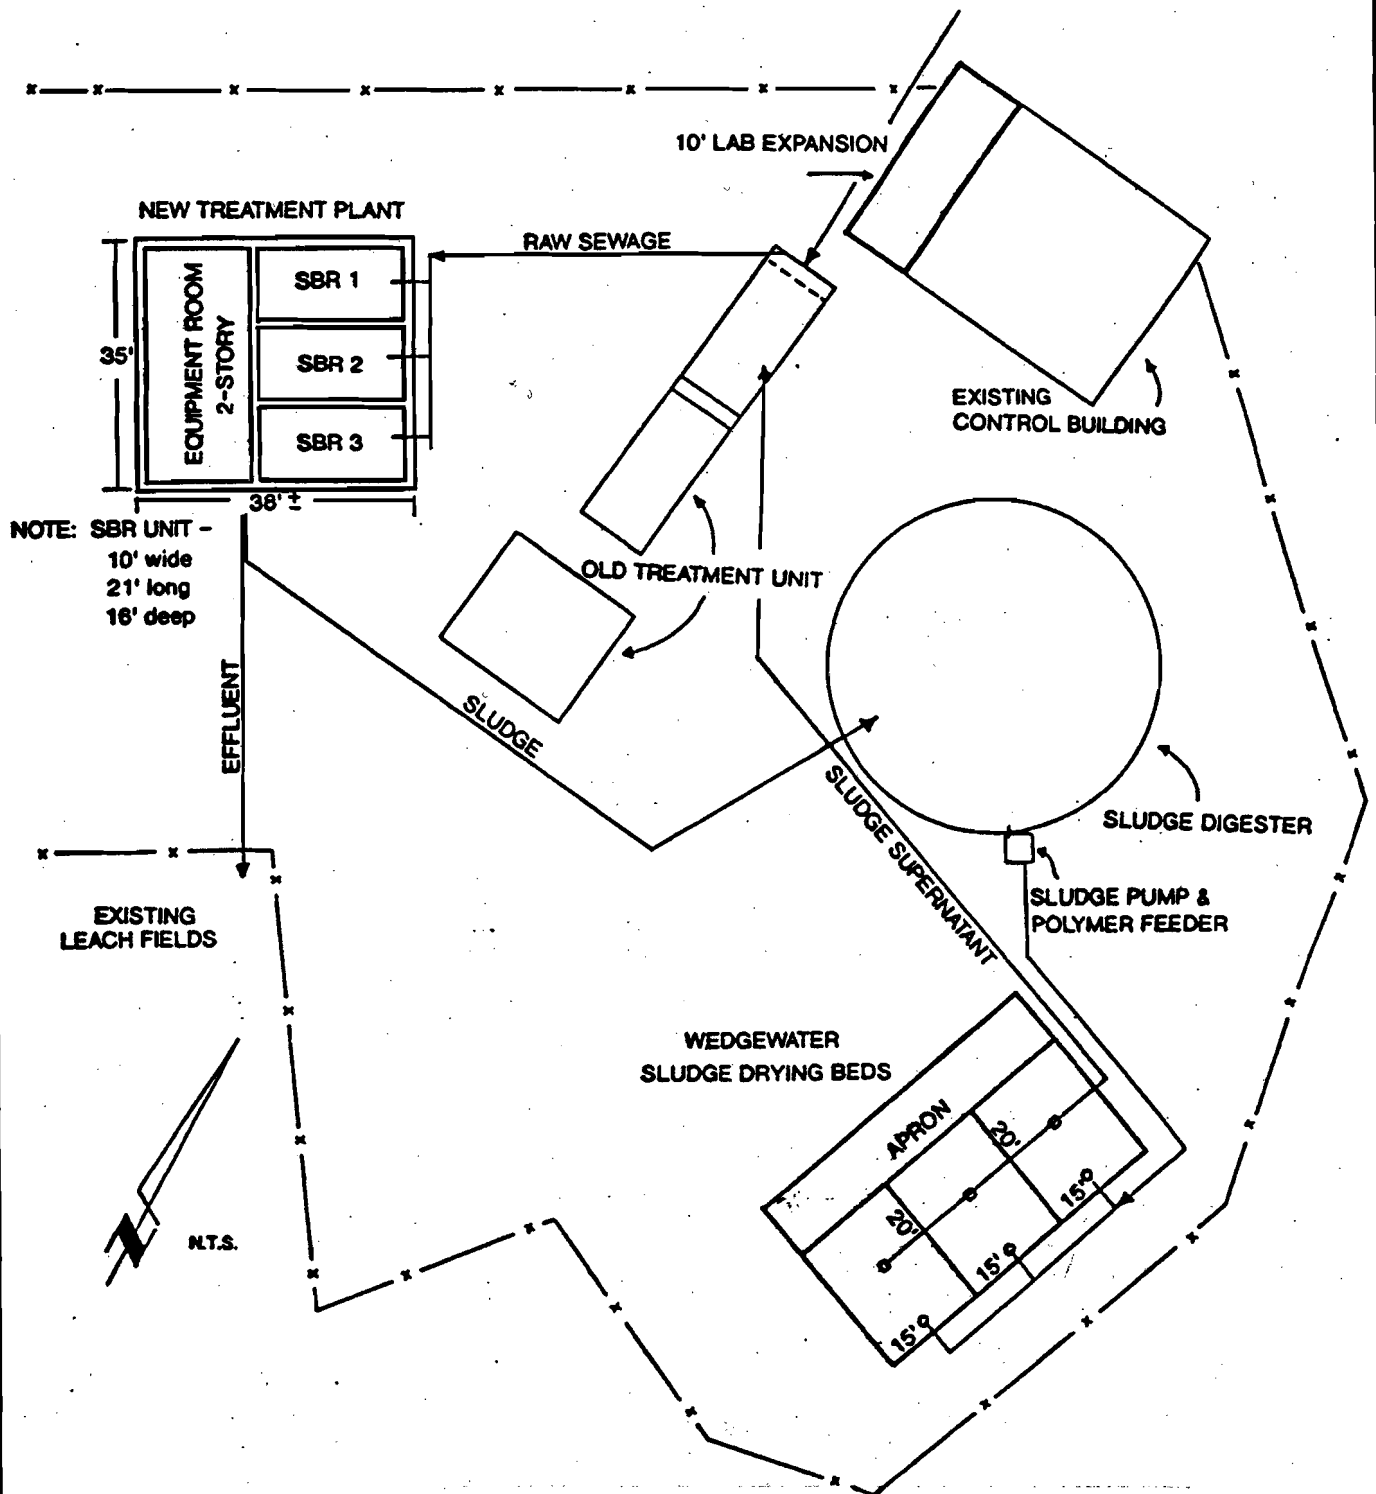

ATTACHMENT "B" - SITE PLAN
UNITED STATES MARINE CORPS
MOUNTAIN WARFARE TRAINING
CENTER WASTEWATER TREATMENT
FACILITY

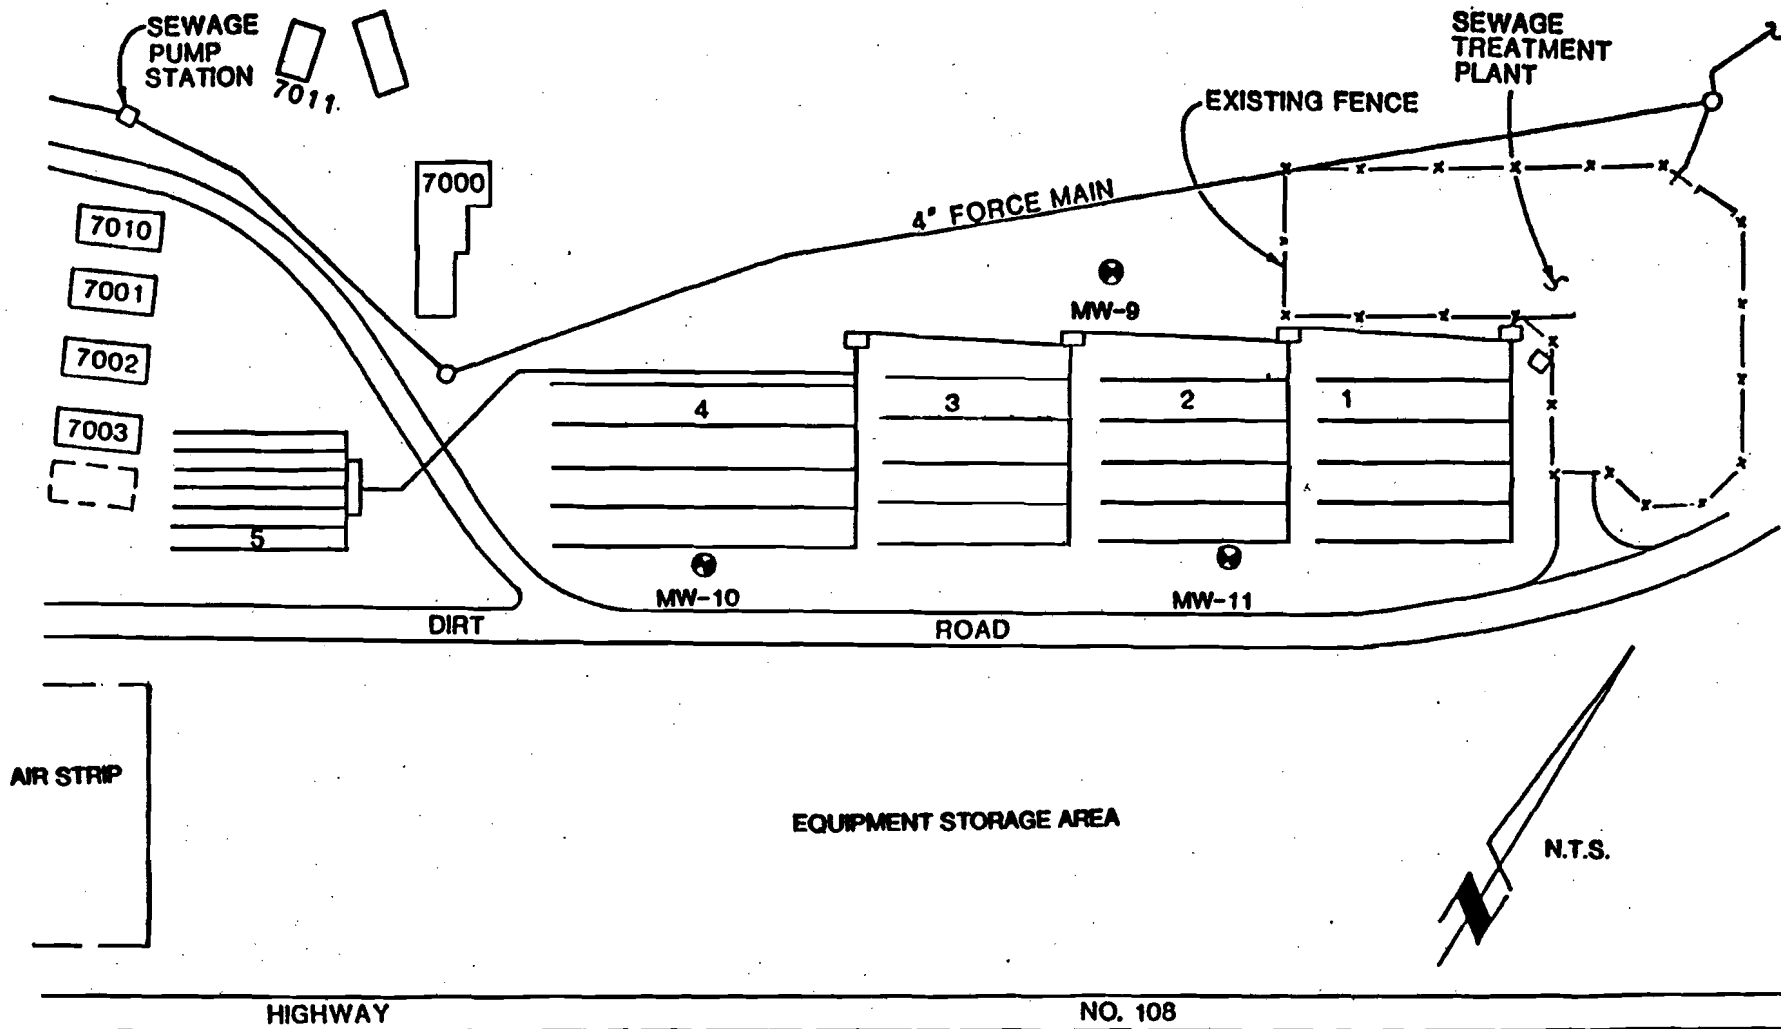

ATTACHMENT "C"
LEACHFIELDS AND MONITORING WELLS

⊙ MONITORING WELLS

**STANDARD PROVISIONS
FOR WASTE DISCHARGE REQUIREMENTS**

ATTACHMENT "D"

1. Inspection and Entry

The discharger shall permit Regional Board staff:

- a. to enter upon premises in which an effluent source is located or in which any required records are kept;
- b. to copy any records relating to the discharge or relating to compliance with the waste discharge requirements;
- c. to inspect monitoring equipment or records; and
- d. to sample any discharge.

2. Reporting Requirements

- a. Pursuant to California Water Code 13267(b), the discharger shall immediately notify the Board by telephone whenever an adverse condition occurred as a result of this discharge; written confirmation shall follow within two weeks. An adverse condition includes, but is not limited to, spills of petroleum products or toxic chemicals, or damage to control facilities that could affect compliance.
- b. Pursuant to California Water Code Section 13260(c), any proposed material change in the character of the waste, manner or method of treatment or disposal, increase of discharge, or location of discharge, shall be reported to the Board at least 120 days in advance of implementation of any such proposal. This shall include, but not limited to, all significant soil disturbances.
- c. The owners/discharger of property subject to waste discharge requirements shall be considered to have a continuing responsibility for ensuring compliance with applicable waste discharge requirements in the operations or use of the owned property. Pursuant to 13260(c), any change in the ownership and/or operation of property subject to the waste discharge requirements shall be reported to the Board. Notification of applicable waste discharge requirements shall be furnished in writing to the new owners and/or operators and a copy of such notification shall be sent to the Board.
- d. If a discharger becomes aware that any information submitted to the Board is incorrect, the discharger shall immediately notify the Board, in writing and correct that information.
- e. Reports required by the waste discharge requirements, and other information requested by the Board, must be signed by a duly authorized representative of the discharger.
- f. If the discharger becomes aware that their waste discharge requirements (or permit) is no longer needed (because the project will not be built or the discharge will cease) the discharger shall notify the Regional Board in writing and request that their waste discharge requirements (or permit) be rescinded.

3. Right to Revise Waste Discharge Requirements

The Board reserves the privilege of changing all or any portion of the waste discharge requirements upon legal notice to and after opportunity to be heard is given to all concerned parties.

4. Duty to Comply

Failure to comply with the waste discharge requirements may constitute a violation of the California Water Code and is grounds for enforcement action or for permit termination, revocation and reissuance, or modification.

5. Duty to Mitigate

The discharger shall take all reasonable steps to minimize or prevent any discharge in violation of the waste discharge requirements which has a reasonable likelihood of adversely affecting human health or the environment.

6. Proper Operation and Maintenance

The discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the discharger to achieve compliance with the waste discharge requirements. Proper operation and maintenance includes adequate laboratory control, where appropriate, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by the discharger, when necessary to achieve compliance with the conditions of the waste discharge requirements.

7. Waste Discharge Requirement Actions

The waste discharge requirements may be modified, revoked and reissued, or terminated for cause. The filing of a request by the discharger for waste discharge requirement modification, revocation and reissuance, termination, or a notification of planned changes or anticipated noncompliance, does not stay any of the waste discharge requirements conditions.

8. Property Rights

The waste discharge requirements do not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

9. Enforcement

The California Water Code provides for civil liability and criminal penalties for violations or threatened violations of the waste discharge requirements including imposition of civil liability or referral to the Attorney General.

10. Availability

A copy of the waste discharge requirements shall be kept and maintained by the discharger and be available at all times to operating personnel.

11. Severability

Provisions of the waste discharge requirements are severable. If any provision of the requirements is found invalid, the remainder of the requirements shall not be affected.

12. Public Access

General public access shall be effectively excluded from disposal/treatment facilities.

13. Transfers

Providing there is no material change in the operation of the facility, this Order may be transferred to a new owner or operation. The owner/operator must request the transfer in writing and receive written approval from the Board's Executive Officer.

14. Definitions

- a. "Surface waters" as used in this Order, include, but are not limited to, live streams, either perennial or ephemeral, which flow in natural or artificial water courses and natural lakes and artificial impoundments of waters. "Surface waters" does not include artificial water courses or impoundments used exclusively for wastewater disposal.
- b. "Ground waters" as used in this Order, include, but are not limited to, all subsurface waters being above atmospheric pressure and the capillary fringe of these waters.

15. Storm Protection

- a. All facilities used for collection, transport, treatment, storage, or disposal of waste shall be adequately protected against overflow, washout, inundation, structural damage or a significant reduction in efficiency resulting from a storm or flood having a recurrence interval of once in 100 years.

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

MONITORING AND REPORTING PROGRAM NO. 93-72
WDID NO. 6A260154101

FOR

UNITED STATES MARINE CORPS MOUNTAIN WARFARE TRAINING CENTER
WASTEWATER TREATMENT FACILITY

Mono County

I. MONITORING

A. Flow Monitoring

The following shall be recorded in a permanent log book:

1. The total volume, in million gallons, of wastewater flow to the treatment facility for each day.
2. The total volume, in million gallons, of wastewater flow to the treatment facility for each month.
3. The average flow rate, in million gallons per day (mgd), of wastewater to the treatment facility calculated for each month.
4. The maximum instantaneous flow rate, in million gallons per day (mgd), of wastewater to the treatment facility that occurs each day.
5. The total volume, in million gallons, of wastewater flow to the authorized disposal sites for each month.

B. Plant Influent Monitoring

1. Influent samples shall be collected and analyzed for the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
BOD ₅	mg/l	Monthly

C. Plant Effluent Monitoring

1. Effluent samples shall be collected and analyzed for the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
pH	pH units	Twice per month
BOD ₅	mg/l	Twice per month
Total Kjeldahl Nitrogen	mg/l as N	Monthly
Nitrate Nitrogen	mg/l as N	Monthly
Ammonia Nitrogen	mg/l as N	Monthly
Chloride	mg/l	Monthly
Oil and Grease	mg/l	Annually
Purgeable Organics	ug/l	Annually
Base/Neutral Extractable Organics	ug/l	Annually
Acid Extractable Organics	ug/l	Annually
Heavy Metals	ug/l	Annually
Total Petroleum Hydrocarbons	mg/l	Annually

D. Ground Water Monitoring

1. Ground water samples from the three monitoring wells (Wells No. 9, 10, and 11) shall be collected and analyzed for the following parameters:

<u>Parameter</u>	<u>Units</u>	<u>Frequency</u>
Depth to groundwater	Feet above msl	Quarterly
Nitrate Nitrogen	mg/l as N	Quarterly
Total Kjeldahl Nitrogen	mg/l as N	Quarterly
Ammonia Nitrogen	mg/l as N	Quarterly
Chlorides	mg/l	Quarterly
Oil and Grease	mg/l	Annually
Purgeable Organics	ug/l	Annually

E. Sludge Monitoring

1. The Dischargers shall record the date and quantity of dewatered sludge landfilled. The name and location of the landfill receiving the sludge shall also be recorded. This information shall be submitted on a

UNITED STATES MARINE CORPS
MWTC WASTEWATER TREATMENT
FACILITY
Mono County

-3-

MONITORING AND REPORTING
PROGRAM NO. 93-72

quarterly basis as part of the monitoring reports discussed below.

F. Sampling and Analysis Methods

1. The Dischargers shall comply with the General Provisions for Monitoring and Reporting which is attached to and is part of Monitoring and Reporting Program No. 93-(**PROPOSED**).

II. REPORTING

The Dischargers shall continue to submit monthly monitoring reports containing the data and information requested above. The monthly monitoring reports shall be submitted to the Board by the 15th day of the month following each monitoring period.

Beginning November 15, 1993, the Dischargers shall submit a monitoring report containing information regarding the quarterly, semiannual, and annual monitoring parameters. The results of the quarterly, semiannual, and annual monitoring may be included in the appropriate monthly monitoring report submittal to the Board.

Ordered by:



Dated:

Aug 12, 1993

HAROLD J. SINGER
EXECUTIVE OFFICER

Attachments: General Provisions for Monitoring and Reporting

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LAHONTAN REGION

GENERAL PROVISIONS FOR MONITORING AND REPORTING

1. SAMPLING AND ANALYSIS

- a. All analyses shall be performed in accordance with the current edition(s) of the following documents:
 - i. Standard Methods for the Examination of Water and Wastewater
 - ii. Methods for Chemical Analysis of Water and Wastes, USEPA
- b. All analyses shall be performed in a laboratory certified to perform such analyses by the California State Department of Health Services or a laboratory approved by the Executive Officer. Specific methods of analysis must be identified on each laboratory report.
- c. Any modifications to the above methods to eliminate known interferences shall be reported with the sample results. The method used shall also be reported. If methods other than USEPA approved methods or Standard Methods are used, the exact methodology must be submitted for review and must be approved by the Executive Officer prior to use.
- d. The Discharger shall establish chain-of-custody procedures to insure that specific individuals are responsible for sample integrity from commencement of sample collection through delivery to an approved laboratory. Sample collection, storage and analysis shall be conducted in accordance with an approved Sampling and Analysis Plan (SAP). The most recent version of the approved SAP shall be kept at the facility.
- e. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to ensure accuracy of measurements, or shall insure that both activities will be conducted. The calibration of any wastewater flow measuring device shall be recorded and maintained in the permanent log book.
- f. A grab sample is defined as an individual sample collected in fewer than 15 minutes.

- g. A composite sample is defined as a combination of no fewer than eight individual samples obtained over the specified sampling period at equal intervals. The volume of each individual sample shall be proportional to the discharge flow rate at the time of sampling. The sampling period shall equal the discharge period, or 24 hours, whichever period is shorter.

2. OPERATIONAL REQUIREMENTS

a. Sample Results

Pursuant to California Water Code § 13267(b), a copy of all sample results shall be available to the plant operator and/or Board staff for inspection. The results shall be retained for a minimum of three years.

b. Operational Log

- i. Pursuant to California Water Code § 13267(b), an operation and maintenance log shall be maintained at the facility.
- ii. Evidence that the Discharger has a wastewater treatment plant operator/supervisor of the appropriate grade pursuant to Chapter 14, Title 23, California Code of Regulations (§ 3670-3702).

3. REPORTING

- a. For every item where the requirements are not met, the Discharger shall submit a statement of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time and submit a timetable for correction.
- b. The Discharger shall maintain all sampling and analytical results, including strip charts; date, exact place, and time of sampling; date analyses were performed; sample collector's name; analyst's name; analytical techniques used; and results of all analyses. Such records shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Board.

- c. The Discharger shall provide a brief summary of any operational problems and maintenance activities to the Board with each monitoring report. Any modifications or additions to, or any major maintenance conducted on, or any major problems occurring to the wastewater conveyance system, treatment facilities, or disposal facilities shall be included in this summary.
- d. Monitoring reports shall be signed by:
 - i. In the case of a corporation, by a principal executive officer at least of the level of vice-president or his duly authorized representative, if such representative is responsible for the overall operation of the facility from which the discharge originates;
 - ii. In the case of a partnership, by a general partner;
 - iii. In the case of a sole proprietorship, by the proprietor;
 - iv. In the case of a municipal, state or other public facility, by either a principal executive officer, ranking elected official, or other duly authorized employee.
- e. Monitoring reports are to include the following:
 - i. Name and telephone number of individual who can answer questions about the report.
 - ii. The Monitoring and Reporting Program Number.
 - iii. WDID Number.
- f. Submittal Periods

Beginning on the 15th of the month following the first quarter after the adoption of this permit, a monitoring report including the preceding information shall be submitted to the Board. Subsequent monitoring reports shall be submitted to the Board by the 15th day of the month following each quarter.

g. Annual Report

By January 30 of each year, the Discharger shall submit an annual report to the Board with the following information:

- i. The compliance record and corrective actions taken or planned which may be needed to bring the discharge into full compliance with the discharge requirements.
- ii. Graphical and tabular data for the monitoring data obtained for the previous year.
- iii. A copy of the most recent annual report to customers of the drinking water distribution system supply analysis prepared in accordance with Department of Health Services regulations.

h. Modifications

This Monitoring and Reporting Program may be modified at the discretion of the Regional Board Executive Officer.

4. NONCOMPLIANCE

Any person failing or refusing to furnish technical or monitoring reports or falsifying any information provided therein, is guilty of a misdemeanor and may be liable civilly in an amount of up to one thousand dollars (\$1,000) for each day of violation under § 13268 of the Water Code.